

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
CENTRAL VALLEY REGION**

**MONITORING AND REPORTING PROGRAM NO. R5-2010-R5061  
FOR  
FRENCH CAMP RV PARK AND GOLF COURSE  
WASTEWATER TREATMENT FACILITY  
SAN JOAQUIN COUNTY**

This Monitoring and Reporting Program (MRP) describes requirements for monitoring the treatment system effluent, wastewater disposal pond, sludge disposal, and leachfields. This MRP is issued pursuant to Water Code Section 13267. The Discharger shall not implement any changes to this MRP unless and until a revised MRP is issued by the Executive Officer.

Section 13267 of the California Water Code states, in part:

*“In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports, and shall identify the evidence that supports requiring that person to provide the reports.”*

Section 13268 of the California Water Code states, in part:

*“(a) Any person failing or refusing to furnish technical or monitoring program reports as required by subdivision (b) of Section 13267, or failing or refusing to furnish a statement of compliance as required by subdivision (b) of Section 13399.2, or falsifying and information provided therein, is guilty of a misdemeanor and may be liable civilly in accordance with subdivision (b).  
(b)(1) Civil liability may be administratively imposed by a regional board in accordance with Article 2.5 (commencing with section 13323) of Chapter 5 for a violation of subdivision (a) in an amount which shall not exceed one thousand dollars (\$1,000) for each day in which the violation occurs.”*

The Discharger owns and operates the facility that is subject to the Notice of Applicability (NOA) of Water Quality Order No. 97-10-DWQ. The reports are necessary to ensure that the Discharger complies with the NOA and WQO. Pursuant to Section 13267 of the California Water Code, the Discharger shall implement this MRP and shall submit the monitoring reports described herein.

All samples shall be representative of the volume and nature of the discharge or matrix of material sampled. The time, date, and location of each grab sample shall be recorded on the sample chain of custody form.

Field test instruments (such as those used to test pH, dissolved oxygen, and electrical conductivity) may be used provided that:

1. The user is trained in proper use and maintenance of the instruments;
2. The instruments are field calibrated prior to monitoring events at the frequency recommended by the manufacturer;
3. Instruments are serviced and/or calibrated by the manufacturer at the recommended frequency; and
4. Field calibration reports are submitted as described in the "Reporting" section of this MRP.

### EFFLUENT MONITORING

Samples of effluent shall be taken from the wastewater treatment plant effluent. At a minimum, effluent monitoring shall consist of the following:

<u>Constituent</u>	<u>Units</u>	<u>Sample Type</u>	<u>Sample Frequency</u>	<u>Reporting Frequency</u>
Discharge Location	N/A	N/A	Monthly	Quarterly
Flow Rate <sup>1</sup>	Gpd	Meter	Weekly	Quarterly
Total Coliform <sup>2</sup>	MPN/100 mL	Grab	Weekly	Quarterly
pH	Std. Units	Grab	Monthly	Quarterly
Biochemical Oxygen Demand	mg/L	Grab	Monthly	Quarterly
Total Suspended Solids <sup>3</sup>	mg/L	Grab	Monthly	Quarterly
Nitrate as N	mg/L	Grab	Monthly	Quarterly
Total Nitrogen as N	mg/L	Grab	Monthly	Quarterly
Electrical Conductivity	umhos/cm	Grab	Monthly	Quarterly
Ammonium as N	mg/L	Grab	Quarterly	Quarterly
Zinc	mg/L	Grab	Quarterly	Quarterly
Phenol	mg/L	Grab	Quarterly	Quarterly
Formaldehyde	mg/L	Grab	Quarterly	Quarterly

<sup>1</sup> At a minimum, the total flow shall be measured weekly to calculate the average daily flow for the week.

<sup>2</sup> Coliform sampling required only until the discharge is switched to the leachfields.

<sup>3</sup> Total suspended solids shall be determined using a Whatman glass fiber filter with a nominal pore size of 1.58 um, or equivalent.

### POND MONITORING

Pond monitoring shall be performed until the pond has been rehabilitated into a golf course pond as described in the NOA. Samples shall be collected from a designated monitoring location that will provide representative samples. Freeboard shall be measured vertically from the water surface to the lowest elevation of the pond berm. Pond monitoring shall include, at a minimum, the following:

<u>Constituent</u>	<u>Units</u>	<u>Sample Type</u>	<u>Sample Frequency</u>	<u>Reporting Frequency</u>
Freeboard	0.1 feet	Measurement	Weekly	Quarterly
pH <sup>1</sup>	Std. Unit	Grab	Monthly	Quarterly
Electrical Conductivity	umhos/cm	Grab	Monthly	Quarterly
Dissolved Oxygen <sup>1</sup>	mg/L	Grab	Monthly	Quarterly
Nitrate as N	mg/L	Grab	Monthly	Quarterly
Total Nitrogen as N	mg/L	Grab	Monthly	Quarterly

<sup>1</sup> Samples shall be collected opposite the pond inlet at a depth of one foot between 0700 and 0900 hours.

### SLUDGE DISPOSAL MONITORING

The Discharger shall monitor the quantity of sludge removed from the treatment system for disposal. Records shall include the name/contact information for the hauling company, the type and amount of waste transported, the date removed from the facility, the disposal facility name and address, and copies of all analytical data required by the entity accepting the waste. These records shall be submitted as part of the Annual Monitoring Report.

### LEACHFIELD MONITORING

The Discharger shall begin monitoring the leachfields upon initiation of wastewater discharge to them. Leachfield monitoring shall consist of visual inspection of the leachfield and nearby areas. The leachfield shall be inspected on a monthly basis for the presence of wet areas, leachate or groundwater seepage, objectionable odors, and/or unexpected plant growth.

### REPORTING

In reporting monitoring data, the Discharger shall arrange the data in tabular form so that the date, sample type (e.g., effluent, pond, etc.), and reported analytical or visual inspection result are readily discernible. The data shall be summarized in such a manner to clearly illustrate compliance with the NOA and spatial or temporal trends, as applicable. The results of any monitoring done more frequently than required at the locations specified in the Monitoring and Reporting Program shall be reported to the Central Valley Regional Water Quality Control Board (Central Valley Water Board).

#### A. Quarterly Monitoring Reports

Quarterly reports shall be submitted to the Central Valley Water Board on the **first day of the second month after the quarter ends** (e.g. the January - March Quarterly Report is due by 1 May). The reports shall bear the certification and signature of the Discharger's authorized representative. At a minimum, the quarterly reports shall include:

1. Results of effluent, pond, sludge disposal, and leachfield monitoring. Include any characterization of sludge required by the disposal facility.
2. A comparison of monitoring data to the discharge specifications, disclosure of any violations of the NOA and/or WQO, and an explanation of any violation of those requirements. Data shall be presented in tabular format.
3. Copies of current calibration logs for all field test instruments.
4. If requested by staff, copies of laboratory analytical report(s).
5. A statement of the status of leachfield construction and pond rehabilitation work. This requirement ends when the pond has been successfully rehabilitated to a golf course pond.

## **B. Annual Report**

An Annual Report shall be prepared as the fourth quarterly monitoring report. The Annual Report shall include all monitoring data required in the quarterly report, and shall be submitted to the Central Valley Water Board by **1 February** each year. In addition to the data normally presented in a monthly monitoring report, the Annual Report shall include the following:

1. Tabular and graphical summaries of all data collected during the year.
2. An evaluation of the performance of the WWTF, including discussion of capacity issues, nuisance conditions, system problems, and a forecast of the flows anticipated in the next year.
3. A discussion of compliance and the corrective action taken, as well as any planned or proposed actions needed to bring the discharge into full compliance with the NOA and/or WQO.
4. A discussion of any data gaps and potential deficiencies/redundancies in the monitoring system or reporting program.
5. The name and contact information for the certified wastewater operator responsible for operation, maintenance, and system monitoring.

A letter transmitting the self-monitoring reports shall accompany each report. The letter shall include a discussion of requirement violations found during the reporting period, and actions taken or planned for correcting noted violations, such as operation or facility modifications. If the Discharger has previously submitted a report describing corrective actions and/or a time schedule for implementing the corrective actions, reference to the previous correspondence will be satisfactory. The transmittal letter shall contain the following penalty of perjury statement and shall be signed by the Discharger or the Discharger's authorized agent:

*"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on*

*my inquiry of the those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.”*


The Discharger shall implement the above monitoring program as of the date of this Order.  
Ordered by:

Original signed by

\_\_\_\_\_  
PAMELA C. CREEDON, Executive Officer

\_\_\_\_\_  
10 March 2010

Date

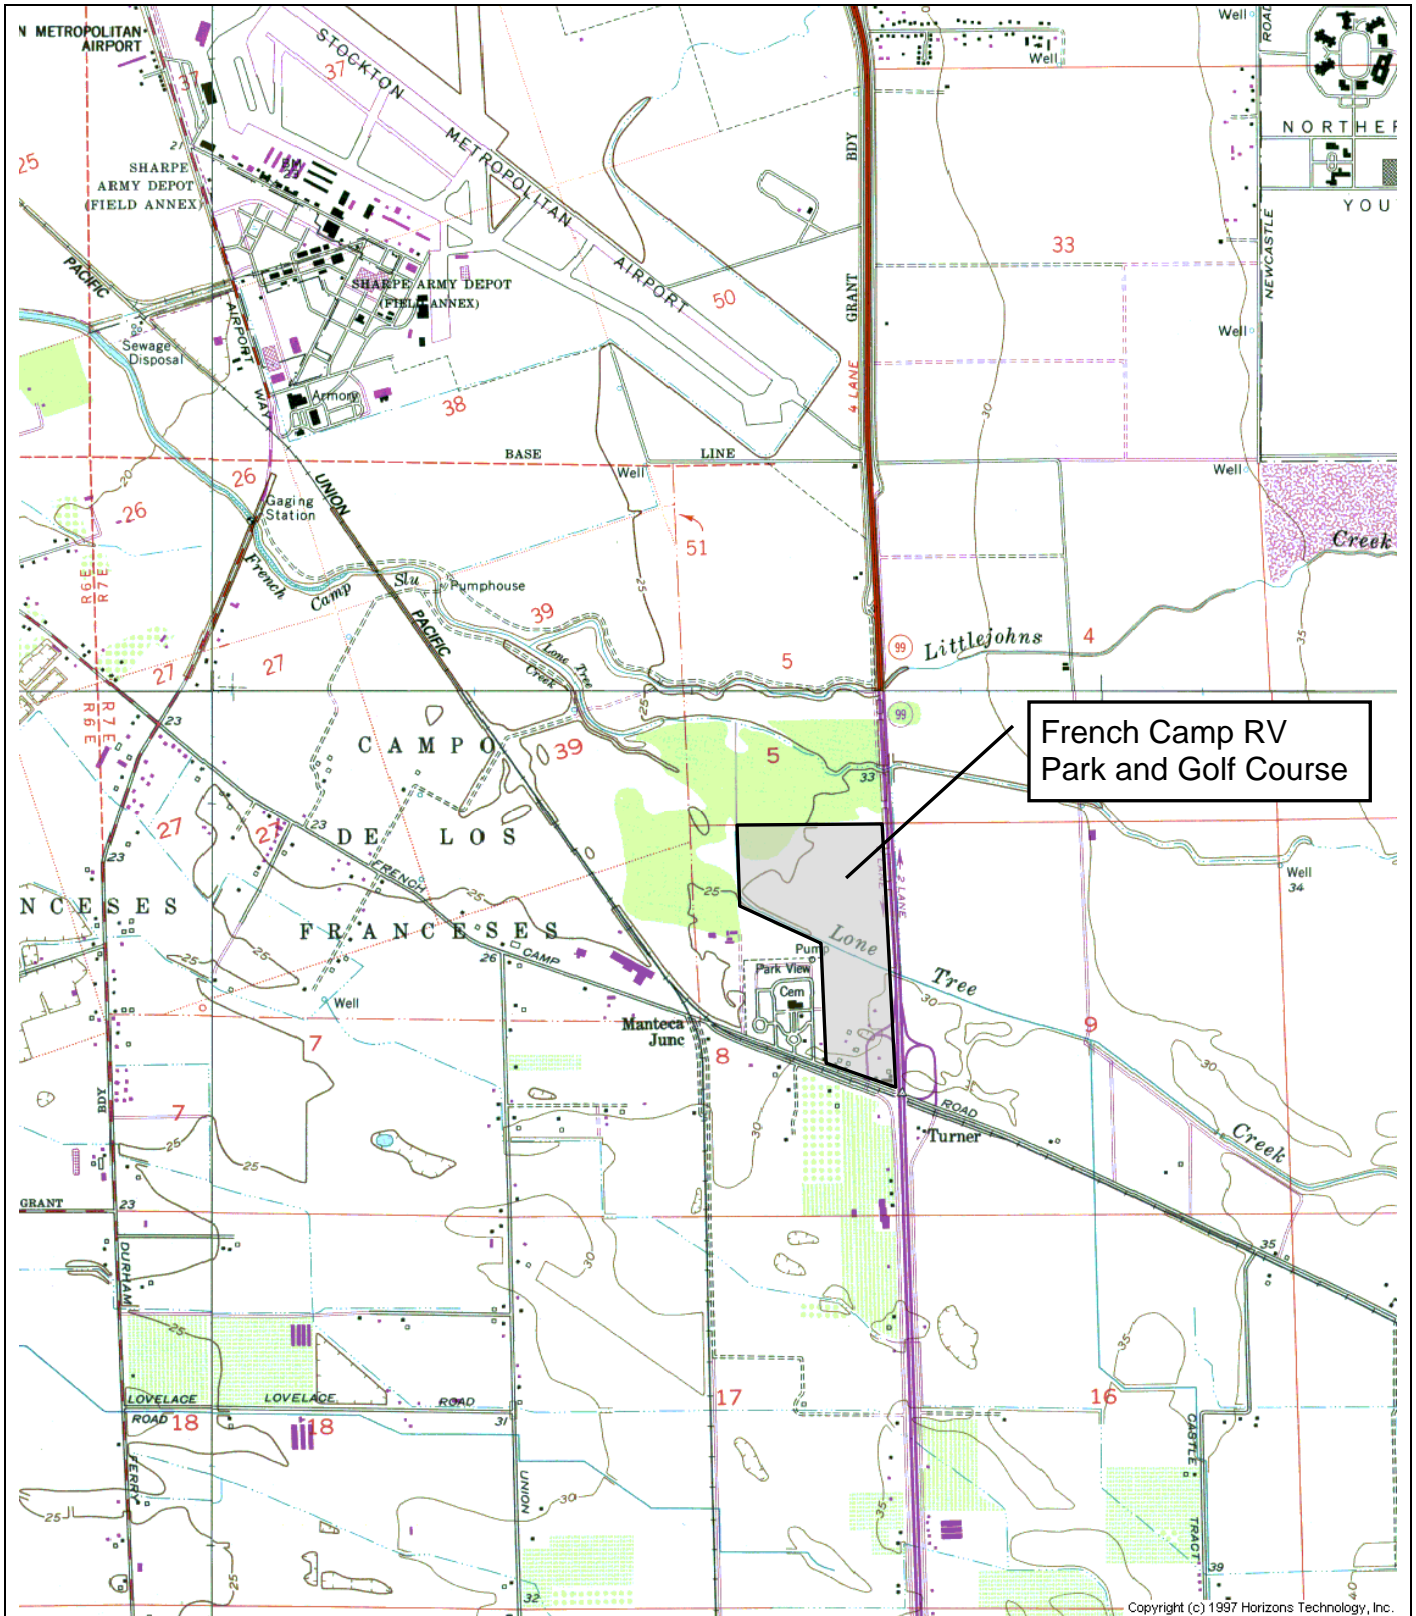

Drawing Reference:  
 USGS MANTECA  
 TOPOGRAPHIC MAP  
 7.5 MINUTE QUAD

**SITE LOCATION MAP**  
 FRENCH CAMP RV PARK AND GOLF COURSE  
 3919 E. French Camp Road,  
 Manteca, San Joaquin County

approx. scale  
 1 in. = 2,575 ft.



Approximate Scale

1 in. = 200 ft.



Drawing Reference:  
Modified from Figure 1  
2/8/10 Additional Information  
Hydroscience Operations, Inc.

**SITE PLAN**  
FRENCH CAMP RV PARK AND GOLF COURSE  
3919 E. French Camp Road,  
Manteca, San Joaquin County