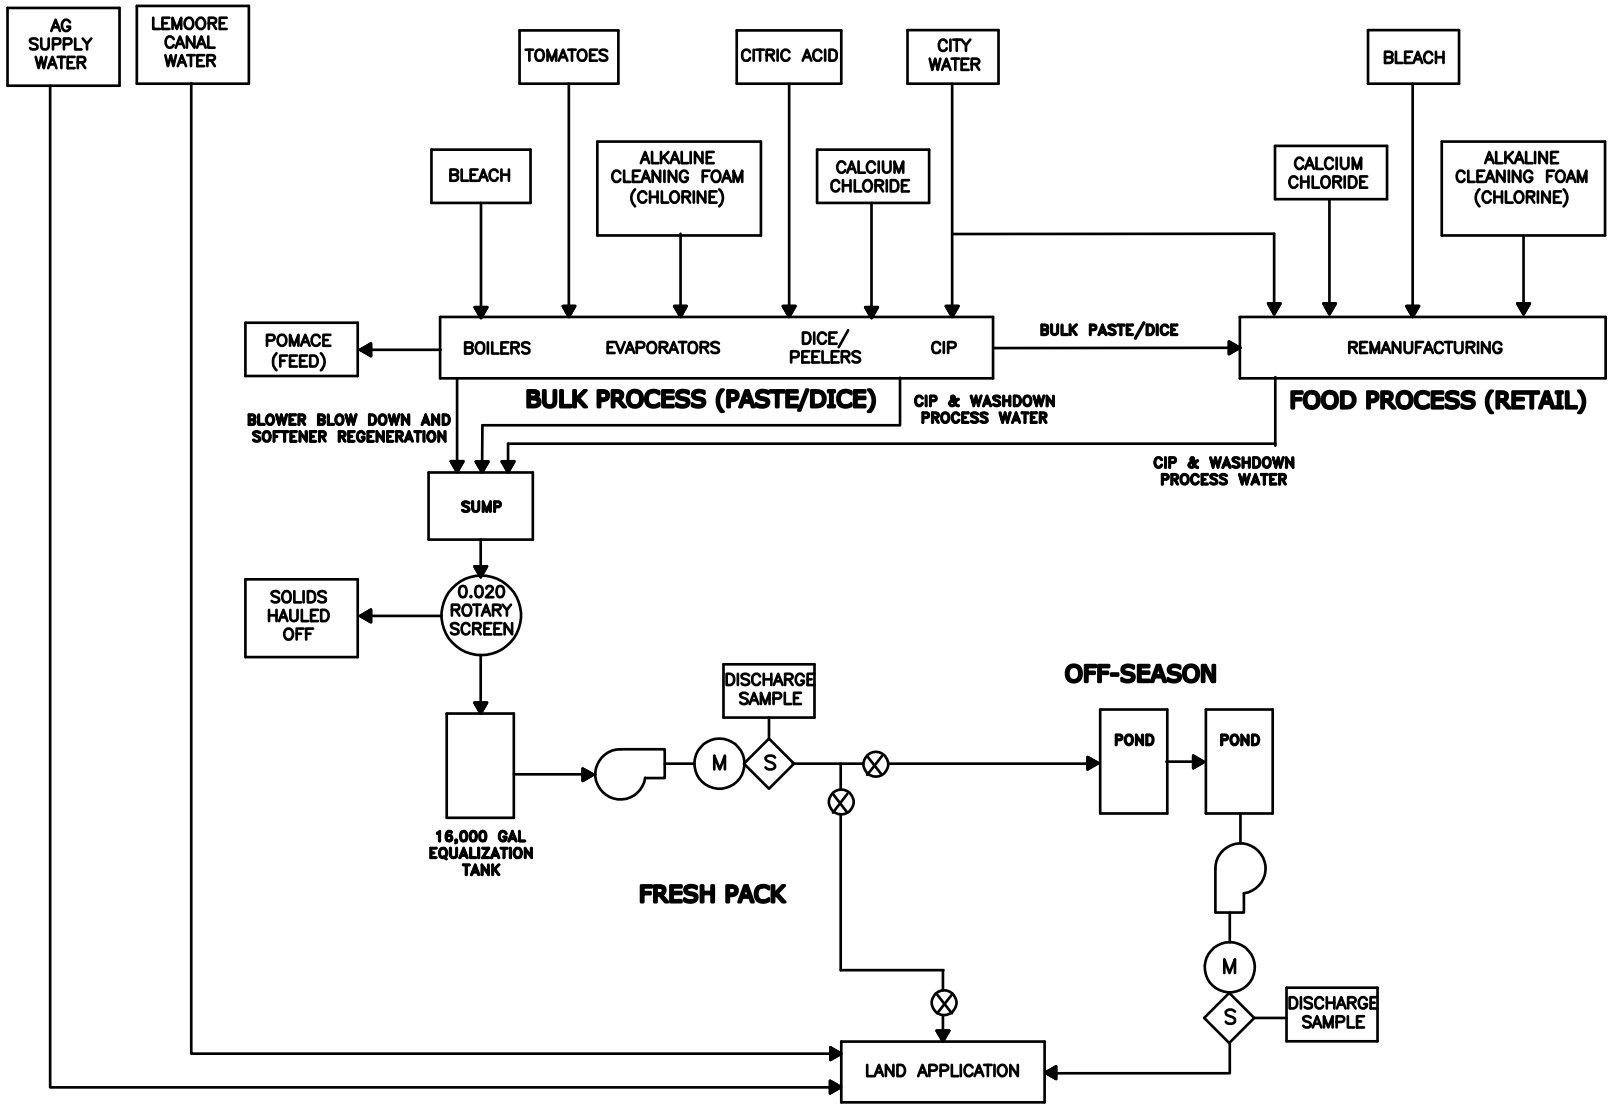

NOT TO SCALE

WASTEWATER TREATMENT PLANT FLOW DIAGRAM

ORDER NO. R5 -
WASTE DISCHARGE REQUIREMENTS
FOR
S K FOODS
LEMOORE FACLITY
KINGS COUNTY

ATTACHMENT B