

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION

ORDER NO. 84-74

WASTE DISCHARGE REQUIREMENTS  
FOR  
BERMUDA PALMS MOBILE HOME PARK  
Northeast of Earp - San Bernardino County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. D.P.J. Randall (hereinafter also referred to as the discharger), P. O. Box 353, Earp, California, 92242, verified on April 6, 1984, that the information in Findings No. 3, 4 and 5, below, is accurate.
2. The discharge from this mobile home and recreational vehicle park has been subject to waste discharge requirements adopted in Board Order No. 77-17.
3. The discharger is discharging a maximum of 37,000 gallons-per-day of domestic sewage from a mobile home and recreational vehicle park consisting of 113 mobile home spaces, 69 recreational vehicle spaces, and two restrooms. Wastewater is discharged into septic tanks and then pumped into oxidation basins (for disposal by infiltration and evaporation), which are located in the NE $\frac{1}{4}$  of the NW $\frac{1}{4}$  of Section 16, T1N, R26E, SBB&M.
4. There are no domestic wells within 500 feet of the sewage disposal facilities described in Finding No. 3 (above).
5. The discharger reports that the park no longer has any water softeners.
6. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted on May 16, 1984. The Basin Plan contains water quality objectives for the Colorado Hydrologic Unit.
7. The beneficial uses of the ground water of the Colorado Hydrologic Unit are:
  - a. Municipal supply
  - b. Industrial supply
  - c. Agricultural supply
8. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
9. The Board in a public meeting heard and considered all comments pertaining to the discharge.

*Superseded*  
89-052-  
06/28/89

10. This sewage disposal facility constitutes an ongoing project in accordance with provisions of the California Environmental Quality Act (Public Resources Code Section 21000 et. seq.) and the State guidelines because the governmental approvals on or after April 5, 1973, do not involve a greater degree of responsibility or control over such activity than the governmental approvals received prior to that date.

IT IS HEREBY ORDERED, the discharger shall comply with the following:


A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage shall be discharged at this location.
3. A minimum freeboard depth of at least two feet shall be maintained in each basin.
4. Adequate measures shall be taken to assure that unauthorized persons and animal pets are effectively excluded from contact with the discharge.
5. Adequate protective works shall be provided to assure that a flood which would be expected to occur on a frequency of once in a 100-year period, would not erode or otherwise render portions of the treatment and discharge facilities inoperable.
6. Treated or untreated sludge, or similar solid waste materials, shall not be discharged to or enter any drainage channels or Colorado River.
7. There shall be no surface flow of wastewater away from the discharge facilities, and there shall be no direct discharge to any drainage channel or to Colorado River.
8. Treatment and disposal by ponding shall be conducted in such manner that there shall be no stranded or exposed sewage solids.
9. Treatment and discharge of wastewater shall be conducted by technical procedures which will maintain a surface aerobic environment.
10. Infiltration facilities shall be maintained and operated so as to maximize infiltration and minimize the increase in salinity of the infiltrating wastewater.
11. Facilities shall be provided in the event of pump and/or commercial power failure.

B. Provisions

1. Prior to any modifications in this facility which could result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
2. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the treatment and discharge of waste.
3. In the event of any change in control or ownership of land or waste disposal facilities owned or controlled by the discharger, the discharger shall:
  - a. Notify the Board of such change; and
  - b. Transmit a copy of this Order to the succeeding owner or operator, and file a copy of the transmittal letter with this Board.
4. This Order supersedes Board Order No. 77-17.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on June 20, 1984.

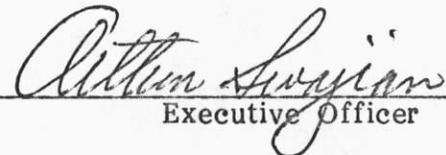  
Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION**

**MONITORING AND REPORTING PROGRAM NO. 84-74  
FOR  
BERMUDA PALMS MOBILE HOME PARK  
Northeast of Earp - San Bernardino County**

Location of Discharge: NE $\frac{1}{4}$  of NW $\frac{1}{4}$  of Section 16, T1N, R26E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Estimate of maximum daily flow (gpd) of sewage discharged to basin(s).
2. Number of mobile home and RV spaces and restrooms presently connected to the sewerage system.
3. List any proposed changes in the sewage disposal facilities during the upcoming year.

REPORTING

1. Monitoring reports shall be submitted to the Regional Board annually by January 15th of each year.

Submit monitoring reports to:

California Regional Water Quality Control Board  
Colorado River Basin Region  
73-271 Highway 111, Suite 21  
Palm Desert, CA 92260


2. Immediately report to this office by telephone and follow-up by letter any failures of the sewerage system.

ORDERED BY:

*Arthur Swazian*  
Executive Officer

*Jan. 26, 1988*  
Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD -7

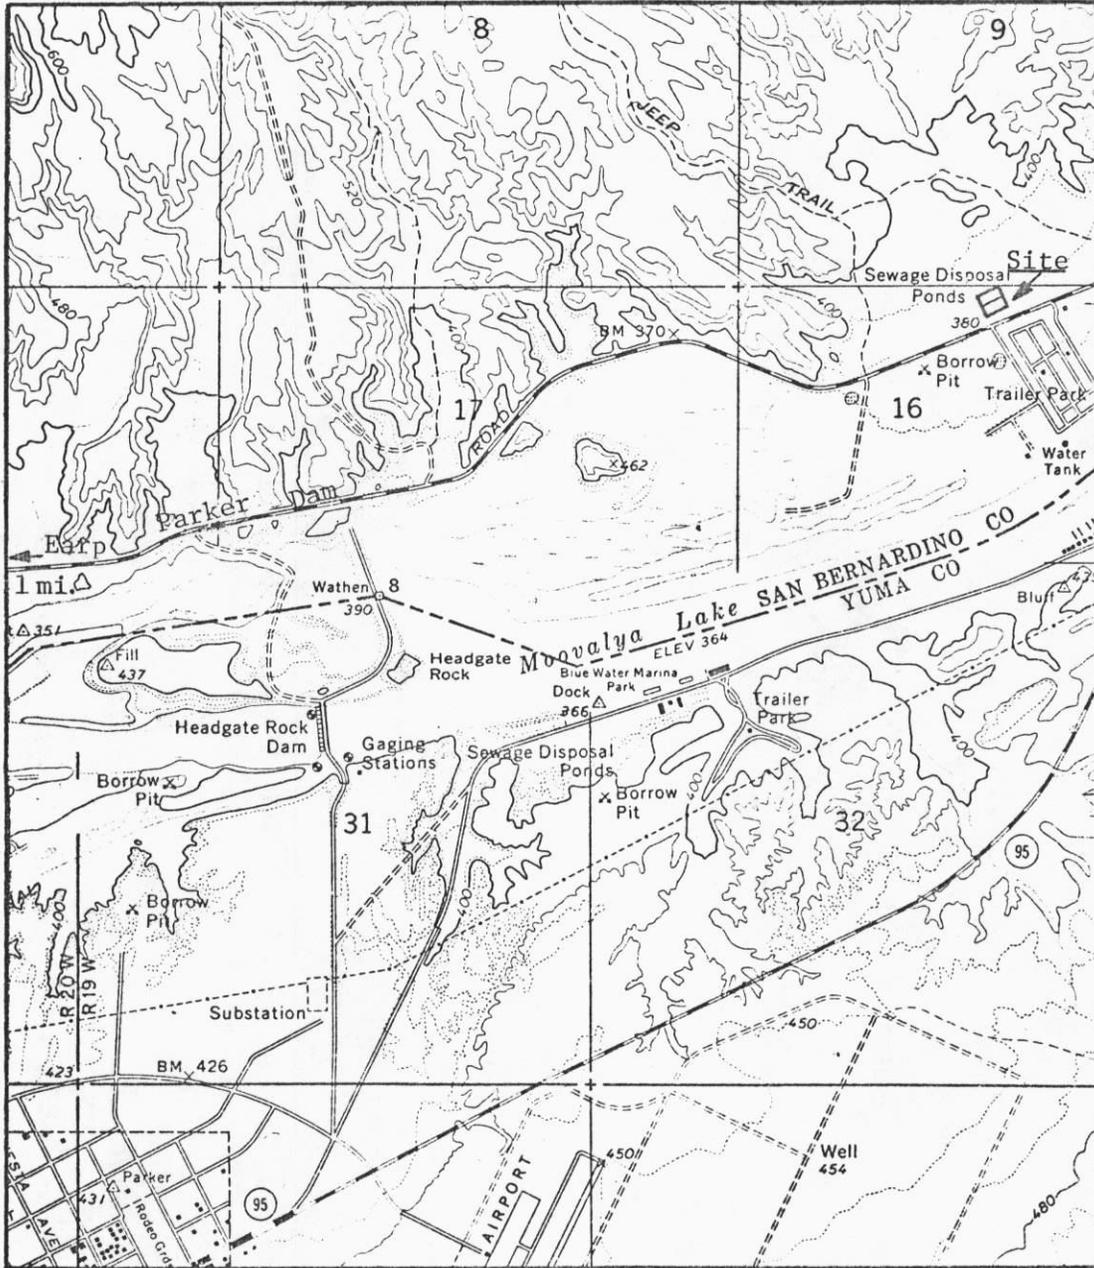

**SITE MAP**  
**BERMUDA PALMS MOBILE HOME PARK**  
 Northeast of Earp - San Bernardino County  
 Portion of NE $\frac{1}{4}$ , NW $\frac{1}{4}$  of Section 16, T1N, R26E, SBB&M  
 USGS Parker, Ariz. 7.5 min. Topographic Map