

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

ORDER NO. 87-46

**WASTE DISCHARGE REQUIREMENTS
FOR
EMERALD COVE RESORT
Northeast of Earp - San Bernardino County**

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Emerald Cove Partnership (hereinafter also referred to as the discharger), P.O. Box 8, Parker Dam, California, 92267, verified on March 23, 1987 via the park sales manager that the below information is accurate.
2. The discharger is discharging a maximum of 64,000 gallons-per-day of domestic sewage from 407 recreational vehicle spaces, a clubhouse, a laundry room and six (6) restrooms. Wastewater from this recreational vehicle park is pumped into septic tank/leach field disposal systems, which are located in the NW 1/4 of Section 2, T1N, R26E, SBB&M.
3. The discharger is reserving areas of sufficient size for possible future 100 percent replacement of the leach lines.
4. There are no domestic wells within 200 feet of the discharge facilities described in Findings No. 2 and 3 (above).
5. The discharge has been subject to waste discharge requirements contained in Board Order No. 81-68.
6. The discharger states that the wastewater disposal facilities are more than 200 feet from the high water line of the Colorado River.
7. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984.
8. The Basin Plan delineates the location of discharge to be in the Colorado Hydrologic Unit, which has the following beneficial uses of ground water:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply
9. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.

*Superseded
by Bd. Ord. # 96-005
1/24/96*

10. The Board in a public meeting heard and considered all comments pertaining to the discharge.
11. These waste discharge requirements govern an existing facility, which the discharger is currently operating, and therefore is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Chapter 3, Title 14 of the California Administrative Code.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications


1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage shall be discharged at this location.
3. Wastewater discharged subsurface shall be retained underground with no surfacing.
4. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
5. Septic tank cleanings shall be discharged only by a duly authorized service.
6. The sewage disposal facilities shall not be located within 200 feet of the regulated high water line of the Colorado River.
7. Standby facilities shall be available to keep the sewage collection system in operation in the event of commercial power failure.

B. Provisions

1. Sufficient land area shall be reserved for possible future 100 percent replacement of the leach fields, until such time as this development is connected to a municipal sewerage system.
2. The discharger shall comply with the attached "Monitoring and Reporting Program No. 87-46", and future revisions thereto, as specified by the Executive Officer.
3. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.

4. Prior to any change of ownership of this recreational vehicle park, the discharger shall:
 - a. Specify as a condition of transfer that the area specified in Provision B.1 (above) remain servient to the park, for the purpose of providing additional subsurface sewage disposal capacity, until such time as this park is connected to a municipal sewerage system.
 - b. Transmit a copy of this Order to the succeeding owner or operator, and file a copy of the transmittal letter with this Board.
5. This Order supersedes Board Order No. 81-68.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on May 20, 1987.

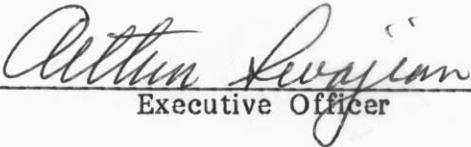

Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

MONITORING AND REPORTING PROGRAM NO. 87-46
FOR
EMERALD COVE RESORT
Northeast of Earp - San Bernardino County

Location: NW $\frac{1}{4}$ of Section 2, T1N, R26E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Number of RV spaces, clubhouse, laundry rooms and restrooms presently connected to the sewerage system.
2. List any proposed changes in the sewage disposal facilities during the upcoming year.
3. Explain any surfacing of wastewater or other failures to the system during the preceding year.


REPORTING

1. Annual reports are to be submitted by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

2. Report immediately any surfacing of wastewater or other failures of the system by telephone and follow-up by letter.

Ordered by:


Executive Officer


Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 87-46
FOR
EMERALD COVE RESORT
Northeast of Earp - San Bernardino County

Location: NW 1/4 of Section 2, T1N, R26E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Number of mobile home and RV spaces and restrooms presently connected to the sewerage system.
2. List any proposed changes in the sewage disposal facilities during the upcoming year.
3. Explain any surfacing of wastewater or other failures of the system over the past year.


REPORTING

Annual reports are to be submitted by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

*Superseded
by
87-46
8/17/87*

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD -7

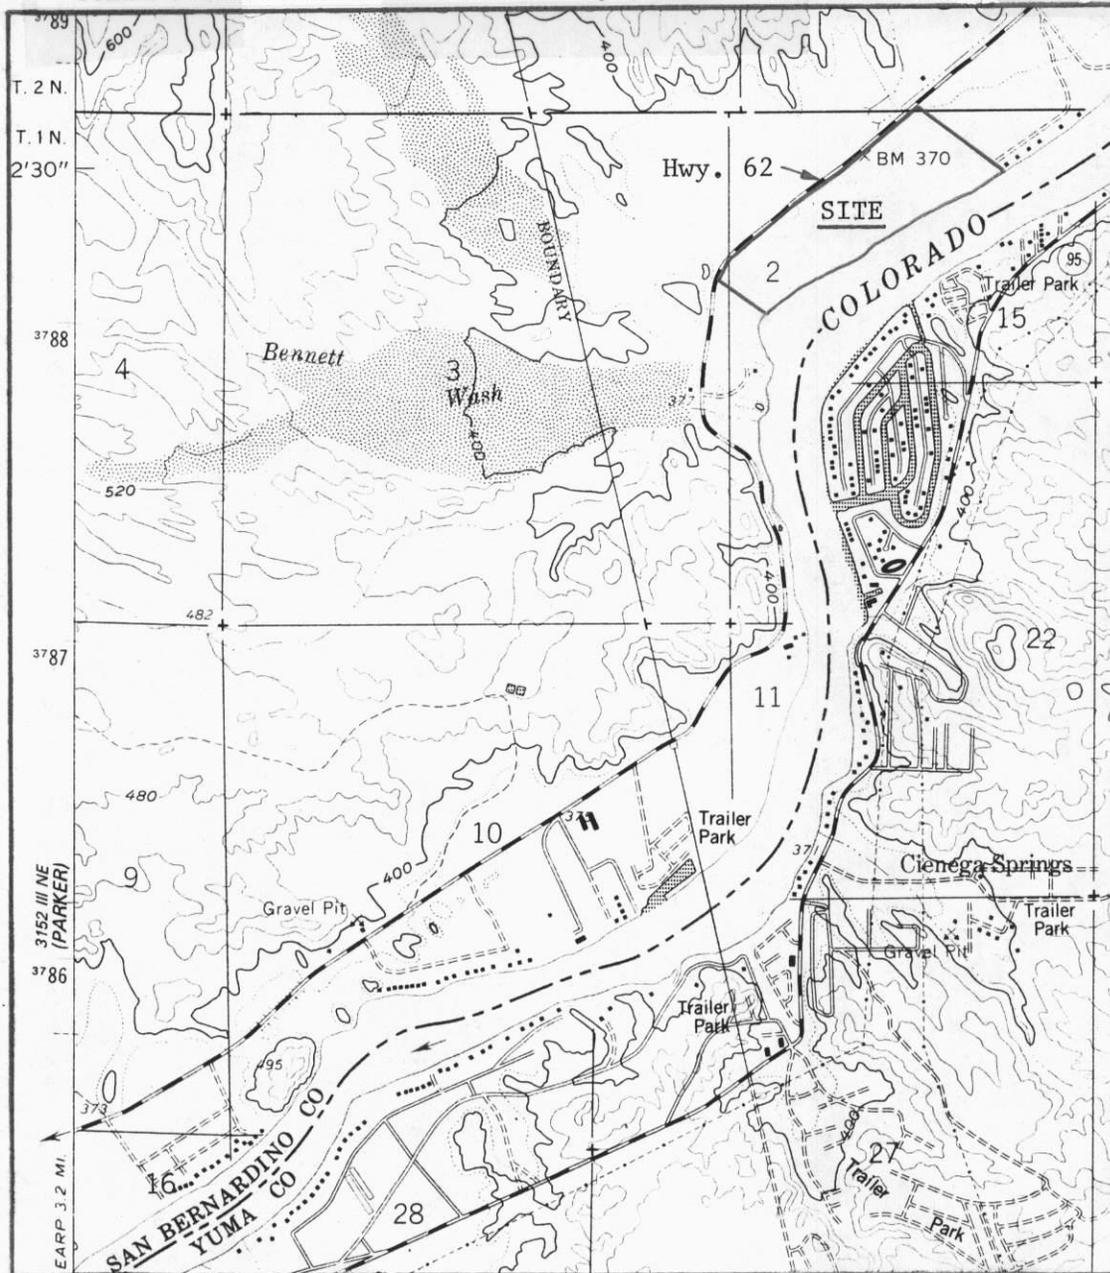

Scale:
1" = 2000'

SITE MAP

EMERALD COVE RESORT
 Northeast of Earp - San Bernardino County
 Portion of NW 1/4 of Section 2, T1N, R26E, SBB&M
 USGS Cross Roads 7.5 min. Topographic Map


Order No. 87-46

7.6



6.5 MILES TO EARP, CALIF. ← → 6.5 MILES TO PARKER DAM

REDUCED SCALE 1" = 300'

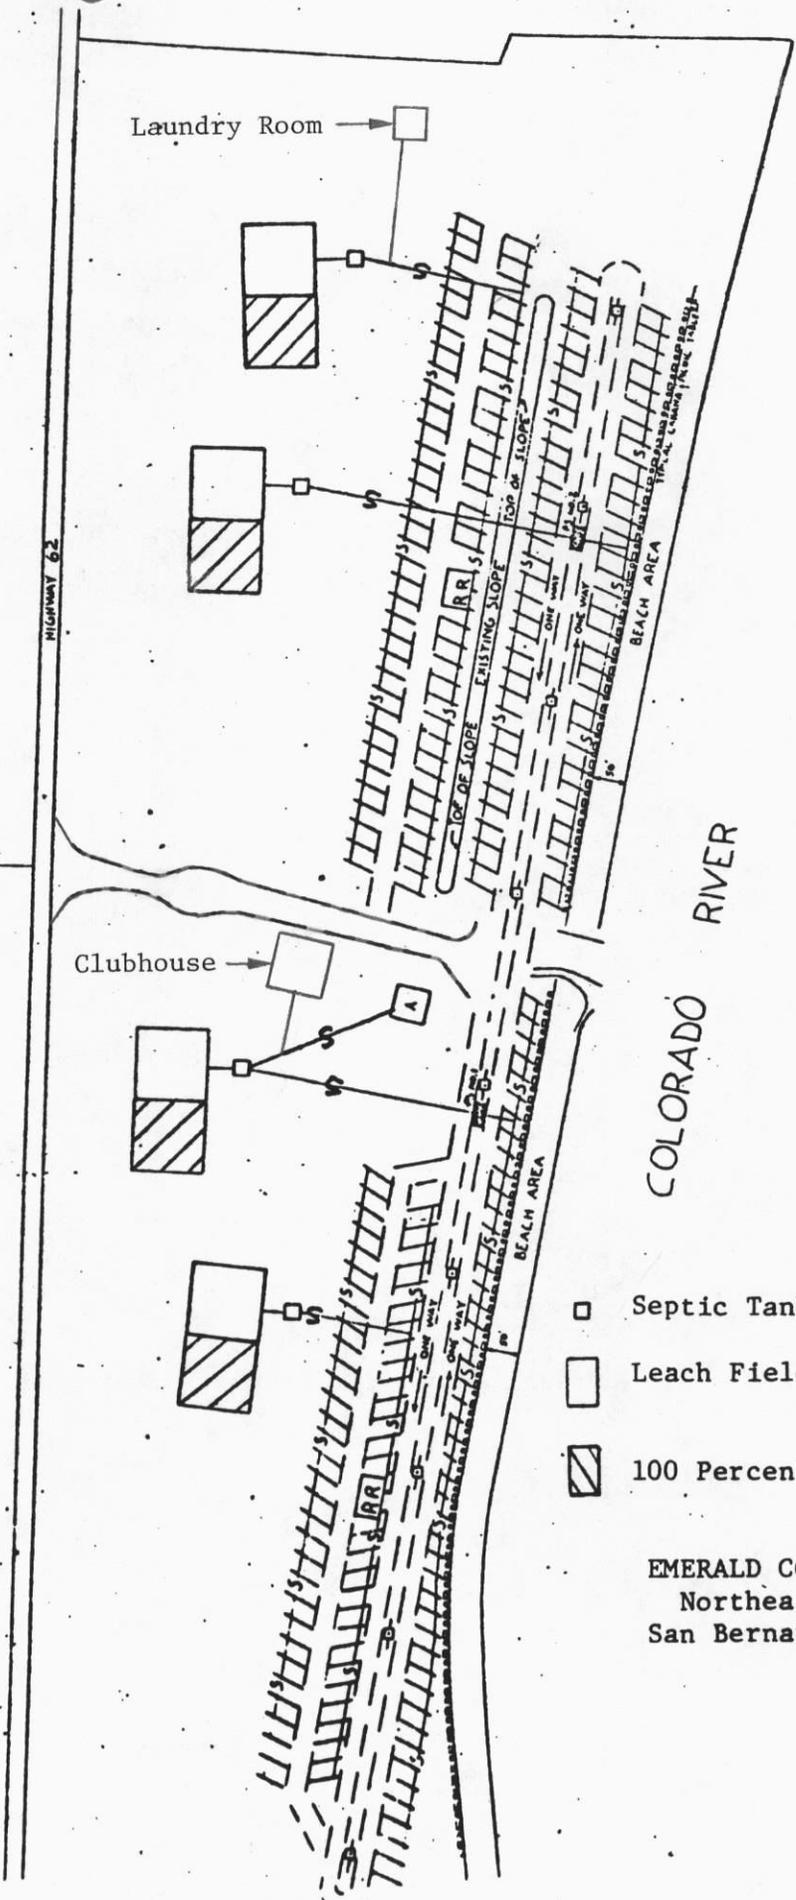

- Septic Tank
- ▭ Leach Field
- ▨ 100 Percent Replacement Area

EMERALD COVE RESORT
Northeast of Earp
San Bernardino County

SEWAGE DISPOSAL FACILITIES SKETCH