**STATE OF CALIFORNIA**

**STATE WATER RESOURCES CONTROL BOARD**

**DIVISION OF DRINKING WATER**

**IN RE:** Leisure Lake Mobile Home Park
48303 N 20th Street West
Lancaster, CA 93534

**TO:** Ms. Mary Orr, Regional Manager
Leisure Lake Mobile Home Park

**CITATION FOR VIOLATION OF CALIFORNIA CODE OF REGULATIONS, TITLE 22, SECTION 64442 - WATER SYSTEM NO. 1910066**

**CITATION NO. 04_22_15C_002**

**Issued on May 15, 2015**

Section 116650 of the California Health and Safety Code authorizes the issuance of a citation to a public water system for violation of the California Safe Drinking Water Act (Health and Safety Code, Division 104, Part 12, Chapter 4, commencing with Section 116270) (hereinafter "California SDWA"), or any regulation, standard, permit or order issued or adopted thereunder.

The State Water Resources Control Board, acting by and through its Division of Drinking Water (hereinafter "Division") and the Deputy Director for the Division (hereinafter "Deputy Director"), hereby issues a citation to the Leisure Lake Mobile Home Park (hereinafter, Leisure Lake) (mailing address: 48303 N 20th Street West, Lancaster, CA 93534) for violation of Section 64442 (d) of Title 22, California Code of Regulations.

COURT PAPER
STATE OF CALIFORNIA
STD. 113 (REV. 8-72)

85 34769

**APPLICABLE AUTHORITIES**

Section 116650 of Health and Safety Code provides:

*116650. Citations*

*(a) If the Department determines that a public water system is in violation of this chapter or any regulation, permit, standard, citation, or order issued or adopted thereunder, the Department may issue a citation to the public water system. The citation shall be served upon the public water system personally or by certified mail. Service shall be deemed effective as of the date of personal service or the date of receipt of the certified mail. If a person to whom a citation is directed refuses to accept delivery of the certified mail, the date of service shall be deemed to be the date of mailing.*

*(b) Each citation shall be in writing and shall describe the nature of the violation or violations, including a reference to the statutory provision, standard, order, citation, permit, or regulation alleged to have been violated.*

*(c) A citation may specify a date for elimination or correction of the condition constituting the violation.*

*(d) A citation may include the assessment of a penalty as specified in subdivision (e).*

*(e) The Department may assess a penalty in an amount not to exceed one thousand dollars ($1,000) per day for each day that a violation occurred, and for each day*

*that a violation continues to occur. A separate penalty may be assessed for each violation.*

Title 22, California Code of Regulations, Article 5. Radioactivity, Section 64442 provides in relevant parts:

*64442. MCLs and Monitoring – Gross Alpha Particle Activity, Radium-226, Radium-228, and Uranium*

*(a) Each community and nontransient-noncommunity water system (system) shall comply with the primary MCLs in Table 64442 in the drinking water supplied to the public and use the DLRs for reporting monitoring results:*

***Table 64442***

***Radionuclide Maximum Contaminant Levels (MCLs)***

***and Detection Levels for Purposes of Reporting (DLRs)***

| *Radionuclide* | *MCL* | *DLR* |
|---|---|---|
| *Radium-226* | *5 pCi/L (combined radium-226 & -228)* | *1 pCi/L* |
| *Radium–228* | | *1 pCi/L* |
| *Gross Alpha particle activity (excluding radon and uranium)* | *15 pCi/L* | *3 pCi/L* |
| *Uranium* | *20 pCi/L* | *1 pCi/L* |

*(b) Each system shall monitor to determine compliance with the MCL in Table 64442, as follows:*

*(1) Monitor at each water source, or every entry point to the distribution system that is representative of all sources being used under normal operating conditions; conduct all monitoring at the same sample site(s) unless a change is approved by the Department, based on a review of the system and its historical water quality data;...*

*(3) By December 31, 2007, complete initial monitoring that consists of four consecutive quarterly samples at each sampling site for each radionuclide in Table 64442, except that nontransient-noncommunity water systems shall not be required to monitor radium-228 as a separate analyte, but shall monitor for compliance with the combined radium MCL using the analytical method described in Prescribed Procedures for Measurement of Radioactivity in Drinking Water, Section 6, Alpha-emitting Radium Isotopes in Drinking Water, Method 903.0 (EPA/600/4-80-032, August 1980);*

*(A) Data collected for a sampling site between January 1, 2001, and December 31, 2004, may be used to satisfy the initial monitoring requirement, subject to the Department's approval based on whether the analytical methods, DLRs, sampling sites, and the frequency of monitoring used were consistent with this article.*

*(B) For gross alpha particle activity, uranium, radium-226 and radium-228, the Department may waive the final two quarters of initial monitoring at a sampling site if the results from the previous two quarters are below the DLR(s) and the sources are not known to be vulnerable to contamination...*

*(d) After initial monitoring, each system shall monitor for each radionuclide at each sampling site at a frequency determined by the monitoring result(s) [single*

*sample result or average of sample results if more than one sample collected] from the most recent compliance period as follows:*

*(1) For nontransient-noncommunity water systems, the results for the total radium analyses shall be averaged.*

*(2) For community water systems, the results of radium-226 and radium-228 analyses shall be added and the average calculated.*

*(3) The values used for the radionuclide MCLs and DLRs shall be as specified in Table 64442.*

*(4) If the single sample result or average is:*

*A. Below the DLR, the system shall collect and analyze at least one sample every nine years (3 compliance periods).*

*B. At or above the DLR, but at or below ½ the MCL, the system shall collect and analyze at least one sample every six years.*

*C. Above ½ the MCL, but not above the MCL, the system shall collect and analyze at least one sample every three years.*

**STATEMENT OF FACTS**

Leisure Lake is a community water system located approximately five miles north of the City of Lancaster. Its service area is bounded by Freeway 14, W Avenue E, 20th Street W, and a vacant lot. It serves a population of approximately 280 through 211 service connections. It is currently operating under the authority of a water supply permit issued by the Division on August 18, 1989, and the subsequent permit amendments issued on March 2, 1990 and May 9, 2005, respectively.

Leisure Lake's water supply system consists of three wells, one storage tank, and one pressure tank in a single pressure zone. Wells 1 and 2 are located west of the service

area, while Well 3 is located at the south-west corner of the service area. Leisure Lake provides precautionary chlorination to water produced by Well 1. Wells 2 and 3 have arsenic levels exceeding the MCL. As result, Well 3 is disconnected from distribution system and utilized as the water supply source for the recreational lake. Well 2 has also been removed from service since early 2010.

As confirmed by the Division's letter dated February 9, 2009 (Attachment A) , Leisure Lake had successfully completed the initial radionuclide monitoring in accordance with the requirements specified in Section 64442 (b)(3) of Title 22, California Code of Regulation for Well 1. Additionally, per the letter, Wells 1 is on once every six years monitoring frequency for gross alpha, based on the average concentration (3.83 pCi/L) of the initial four quarterly samples.

In March 2015, the Division reviewed radionuclides monitoring data in the Division's database (Attachment B). The records show that the most recent gross alpha sample for Well 1 was collected on September 10, 2008. Leisure Lake should have collected a gross alpha sample from Well 1 in or before September 2014, to satisfy the once every six years monitoring requirement.

March 18, 2015

Mr. Dmitriy Ginzburg, an Associate Sanitary Engineer with the Division, conducted a Sanitary Survey site visit of Leisure Lake. During the visit, Mr. Ginzburg requested Leisure Lake to submit the missing radionuclide analytical result for Well 1 to the Division. Mr. Jerry Delucia, the Chief Water Operator of Leisure Lake, promised to search for the missing data and report back to the Division. Reportedly, Leisure Lake has delegated the radionuclides scheduling and sample collection duties to their contracted laboratory, the Fruit Growers Laboratory, Inc. (FGL).

April 23, 2015

Mr. Delucia notified the Division via an email that he could not find any records of the missing sampling result and was still waiting for the response from FGL.

April 29, 2015

Mr. Delucia notified the Division via an email that the missing sample had not been collected. During the follow-up telephone conversation with Mr. Ginzburg, Mr. Delucia stated that the sample had been missed due to FGL's oversight in scheduling.

**DETERMINATIONS**

The Division has determined that Leisure Lake is in violation of Section 64442 (d) of Title 22, California Code of Regulations due to the failure to conduct gross alpha monitoring for Well 1 in or before September 2014. Leisure Lake completed the initial gross alpha monitoring for Well 1 in September 2008. The average of four consecutive quarters of gross alpha samples was greater than the DLR of 3 pCi/L, but less than the ½ MCL for gross alpha (7.5 pCi/L). Pursuant to Section 64442 (d), Leisure Lake should have collected and analyzed at least one gross alpha sample from Well 1 every six years. Leisure Lake has not collected any gross alpha sample from Well 1 since September 2008.

**DIRECTIVES**

Leisure Lake is hereby directed to take the following actions:

1. Leisure Lake shall institute a permanent internal control mechanism to ensure all compliance samples are collected in a timely manner. By **August 3, 2015,**

Leisure Lake shall develop a plan to improve its water quality monitoring program and submit the plan to the Division.

2. The Leisure Lake's staff responsible for overseeing the compliance with Title 22 monitoring and reporting requirements and staff responsible for collecting the samples shall be fully trained to carry out their duties. By **September 1, 2015**, Leisure Lake shall submit a letter listing the names of the trainees, contents of the training sections (courses), and dates and locations of these training sections provided. If in-house training is used, information regarding the experiences and qualifications of the instructors shall also be provided. The training courses must be related to radionuclides monitoring, reporting and notification regulations.

3. Notify all persons served by Leisure Lake of the gross alpha monitoring violation in conformance with Section 64463.7 and Section 64465 of Title 22, California Code of Regulations. Within one year of receiving this citation, Leisure Lake shall complete the notification. Leisure Lake shall deliver the notice to water users by mail or direct delivery. In addition, Leisure Lake must use one or more of the following methods to reach persons not likely to be reached by a mailing or direct delivery (renters, university students, nursing home patients, prison inmates, etc.): 1) publication in a local newspaper, 2) posting in conspicuous public places served by the water system, or on the internet; or 3) delivery to community organizations. A template for the Tier 3 public notice is attached (Attachment C). The content of the notice shall be approved by the Division prior to issuance. A copy of the notification shall be submitted to the Division **within ten days of the issuance**, along with the enclosed proof of notification form (Attachment D).

COURT PAPER
STATE OF CALIFORNIA
STD. 113 (REV. 8-72)

85 34769

The Division reserves the right to make modifications to this Citation, as it may deem necessary to protect public health and safety. Such modifications may be issued as amendments to this Citation and shall be effective upon issuance.

Nothing in this Citation relieves Leisure Lake of its obligation to meet the requirements of California SDWA, or any regulation, permit, standard or order issued or adopted thereunder.

All submittals required by this Citation, shall be submitted to the Division at the following address:

Shu-Fang Orr, P.E.
District Engineer, Angeles District
State Water Resources Control Board
Division of Drinking Water
500 N. Central Avenue, Suite 500
Glendale, CA 91203

**PARTIES BOUND**

This Citation shall apply to and be binding upon Leisure Lake, its officers, managers, agents, employees, contractors, successors and assignees

**SEVERABILITY**

The directives of this Citation are severable, and Leisure Lake shall comply with each and every provision thereof notwithstanding the effectiveness of any provision.

## FURTHER ENFORCEMENT ACTION

The California SDWA authorizes the Division to: issue citation with assessment of administrative penalties to a public water system for violation or continued violation of the requirements of the California SDWA or any permit, regulation, permit or order issued or adopted thereunder including, but not limited to, failure to correct a violation identified in a citation or compliance order. The California SDWA also authorizes the Division to take action to suspend or revoke a permit that has been issued to a public water system if the system has violated applicable law or regulations or has failed to comply with an order of the Division; and to petition the superior court to take various enforcement measures against a public water system that has failed to comply with an order of the Division. The Division does not waive any further enforcement action by issuance of this citation.

May 15, 2015
Date

Shu-Fang Orr, P.E.
District Engineer, Angeles District
Division of Drinking Water
State Water Resources Control Board

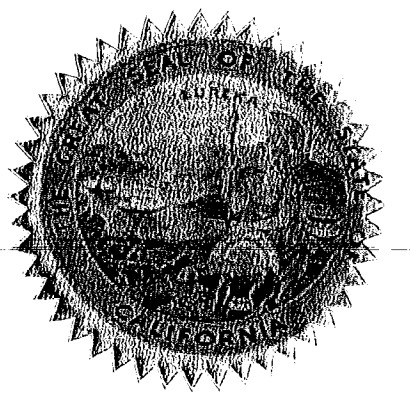

A. The Division's Letter to Leisure Lake dated February 9, 2009

B. Well 1 Radionuclides Monitoring Records in the Division's Water Quality Database

C. Tier 3 Public Notice Template

D. Proof of Public Notification for Radionuclides Monitoring Failure

BY CERTIFIED MAIL NO. 7014 2870 0001 2130 1557

# The Division's Letter to Leisure Lake dated February 9, 2009

State of California—Health and Human Services Agency
California Department of Public Health

MARK B HORTON, MD, MSPH
*Director*

ARNOLD SCHWARZENEGGER
*Governor*

February 9, 2009

Mr. Dave Timok
Manager
Leisure Lake Mobile Home Park
48303 N 20th Street West
Lancaster, CA 93534

**SYSTEM NO. 1910066– LEISURE LAKE MOBILE HOME PARK, RADIONUCLIDES MONITORING**

Dear Mr. Timok:

The letter is to confirm that the Leisure Lake Mobile Home Park (Leisure Lake) has successfully completed the initial radionuclides monitoring in accordance with the requirements specified in Section 64442 (b)(3) of Title 22, California Code of Regulations.

The next radionuclides monitoring frequencies and sample dates for all wells are summarized in the table in Enclosure 1 for your reference. Please collect one sample for each radionuclide from the wells by the sample due date. If the next sample date is not indicated for uranium for a well, Leisure Lake will be required to collect a sample for uranium analysis immediately when gross alpha particle activity (GA + 0.84 x counting error) in the sample collected from the well exceeds 5-pCi/L. In addition, Leisure Lake must immediately sample the well for radium 226 and radium 228, if gross alpha particle activity (GA + 0.84 x counting error) minus uranium exceeds 5-pCi/L. Please be advised that we have changed the gross alpha monitoring frequency for Well 3 from once every nine years, as indicated in our letter to Leisure Lake dated March 25, 2008, to once every six years. This revision is made based on our review of the gross alpha sampling results of samples collected from the well in 2008 (Enclosure 2).

Subsequent radionuclides monitoring frequencies will be determined based on the next round of monitoring results.

Southern California Drinking Water Field Operations Branch, Southern California Section
1449 West Temple St., Room 202, Los Angeles, CA 90026
Telephone: (213)580-5723 Fax: (213)580-5711
Internet Address: www.cdph.ca.gov

Should you have any questions regarding this matter, please feel free to contact Dmitriy Ginzburg at (213) 580-5736 or me at (213) 580-5702.

Sincerely,

Shu-Fang Orr

Shu-Fang Orr, P.E.
District Engineer
Angeles District

Enclosures: 1. Future Monitoring Frequency Table
2. Radionuclides data in the Department's Water Quality Database

bcc: 1910066 – Correspondence
1910066 – Water Quality
District
Region
Reading
D. Ginzburg – PICME

1910066 Radionuclide Final Mon Frequency
SO/DG

# Enclosure 1

**Future Monitoring Frequency Table**

**Water System Name:** Leisure Lake Mobile Home Park

| PS Code | Source Name | Source Class | Gross / Alpha | | | Uranium | | | Radium 226 | Radium 228 |
|---|---|---|---|---|---|---|---|---|---|---|
| | | | Last Sample Date | Monitoring Frequency for the next sample | Next Sample Due | Last Sample Date | Monitoring Frequency for the next sample | Next Sample Due | Next Sample Due | Next Sample Due |
| 1910066-001 | WELL 01 | CGMJ | 09/10/2008 | 6 years | 09/2014 | 07/03/2007 | ** | ** | *** | *** |
| 1910066-002 | WELL 02 | CGMJ | 09/10/2008 | 6 years | 09/2014 | 07/03/2007 | ** | ** | *** | *** |
| 1910066-005 | WELL 03 | CGMJ | 09/10/2008 | 6 years | 09/2014 | 08/25/2008 | ** | ** | *** | *** |
| | | | | | | | | | | |

** Monitor for uranium when gross alpha particle activity (GA + 0.84 x counting error) in the sample collected from the well exceeds 5 pCi/L.
*** Monitor for radium 226 and radium 228, when gross alpha particle activity (GA + 0.84 x counting error) minus uranium in the sample collected from the well exceeds 5 pCi/L.

**Future Monitoring Frequency:**

- If radionuclide results is less than (<) DLR, collect 1 sample in 9 years.
- If radionuclide result is between DLR to ≤ ½ MCL, collect 1 sample in 6 years.
- If radionuclide result is greater than (>) ½ MCL to MCL, collect 1 sample in 3 years.

| Radionuclide | DLR | MCL |
|---|---|---|
| Gross Alpha | 3 pCi/L | 15 pCi/L |
| Uranium | 1 pCi/L | 20 pCi/L |
| Radium 226, Radium 228 | 1 pCi/L each | 5 pCi/L combined |

# Enclosure 2

DATE: 01/26/09
REPORT: R-040/2-3

STATE OF CALIFORNIA
DRINKING WATER PROGRAM



DRINKING WATER ANALYSES RESULTS REPORT
ALL SAMPLES FOR SELECTED CHAPTER 15 GROUPS - ALL RESULTS
FOR SAMPLE DATE RANGE OF 20010101 THRU 20090126
REPORT OF COUNTY: 19 LOS ANGELES

SYSTEM NO: 1910066 NAME: LEISURE LAKE MOBILE HOME PARK COUNTY: LOS ANGELES
SOURCE NO: 001 NAME: WELL 01 PSCODE: 1910066-001 CLASS: CGMJ STATUS: AR

| GROUP IDENTIFICATION / CONSTITUENT IDENTIFICATION | SAMPLE DATE | RESULT * | MCL | DLR | TRIGGER | UNIT |
|---|---|---|---|---|---|---|
| RA RADIOLOGICAL | | | | | | |
| 01501 GROSS ALPHA | 05/04/2005 | 5.0300 * | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 04/19/2006 | 3.7000 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 03/21/2007 | 3.5400 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 07/03/2007 | 3.9800 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 12/19/2007 | 4.8800 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 09/10/2008 | 3.1300 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 05/04/2005 | 2.1800 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 04/19/2006 | 1.2300 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 03/21/2007 | 1.7500 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 07/03/2007 | 1.3400 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 12/19/2007 | 1.4700 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 09/10/2008 | 2.2300 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 03/21/2007 | 1.7000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 07/03/2007 | 1.3000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 12/19/2007 | 1.3000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 09/10/2008 | 2.2300 * | ---------- | ---------- | ---------- | PCI/L |
| 09501 RADIUM 226 | 05/04/2005 | .2000 | 3.0000 | 1.0000 | 3.0000 | PCI/L |
| 09501 RADIUM 226 | 04/19/2006 | .1330 | 3.0000 | 1.0000 | 3.0000 | PCI/L |
| 09502 RADIUM 226 COUNTING ERROR | 05/04/2005 | .1300 * | ---------- | ---------- | ---------- | PCI/L |
| 09502 RADIUM 226 COUNTING ERROR | 04/19/2006 | .2420 * | ---------- | ---------- | ---------- | PCI/L |
| 11501 RADIUM 228 | 05/04/2005 | .0000 | 2.0000 | 1.0000 | 2.0000 | PCI/L |

Avg = 3.83

Avg [α+0.84 CE] = 5.2

NOTE1: * = RESULT IS EQUAL TO OR GREATER THAN TRIGGER
NOTE2: .000 = RESULT WAS REPORTED AS NON-DETECTED EXCEPT FOR RAD

DRINKING WATER ANALYSES RESULTS REPORT
ALL SAMPLES FOR SELECTED CHAPTER 15 GROUPS - ALL RESULTS
FOR SAMPLE DATE RANGE OF 20010101 THRU 20090126
REPORT OF COUNTY: 19 LOS ANGELES

SYSTEM NO: 1910066 NAME: LEISURE LAKE MOBILE HOME PARK COUNTY: LOS ANGELES
SOURCE NO: 001 NAME: WELL 01 PSCODE: 1910066-001 CLASS: CGMJ STATUS: AR

| GROUP IDENTIFICATION / CONSTITUENT IDENTIFICATION | SAMPLE DATE | RESULT | * | MCL | DLR | TRIGGER | UNIT |
|---|---|---|---|---|---|---|---|
| 11501 RADIUM 228 | 04/19/2006 | .0000 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 03/21/2007 | .0000 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 07/03/2007 | .2250 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 12/19/2007 | .3540 | * | ---------- | 1.0000 | ---------- | |
| 11502 RADIUM 228 COUNTING ERROR | 05/04/2005 | .5570 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 04/19/2006 | .3760 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 03/21/2007 | .5280 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 07/03/2007 | .6350 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 12/19/2007 | .7030 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 03/21/2007 | .5000 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 07/03/2007 | 1.1000 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 12/19/2007 | .5500 | * | ---------- | ---------- | ---------- | PCI/L |
| 28012 URANIUM (PCI/L) | 05/04/2005 | 6.0300 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| 28012 URANIUM (PCI/L) | 04/19/2006 | 3.2600 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| 28012 URANIUM (PCI/L) | 07/03/2007 | 4.6200 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| A-028 URANIUM COUNTING ERROR | 05/04/2005 | 1.1900 | * | ---------- | ---------- | ---------- | PCI/L |
| A-028 URANIUM COUNTING ERROR | 04/19/2006 | .9830 | * | ---------- | ---------- | ---------- | PCI/L |
| A-028 URANIUM COUNTING ERROR | 07/03/2007 | 1.2200 | * | ---------- | ---------- | ---------- | PCI/L |
| A-073 URANIUM MDA95 | 07/03/2007 | .8500 | * | ---------- | ---------- | ---------- | PCI/L |

NOTE1: * = RESULT IS EQUAL TO OR GREATER THAN TRIGGER
NOTE2: .000 = RESULT WAS REPORTED AS NON-DETECTED EXCEPT FOR RAD

DATE: 01/26/09
REPORT: R-040/2-3

STATE OF CALIFORNIA
DRINKING WATER PROGRAM



DRINKING WATER ANALYSES RESULTS REPORT
ALL SAMPLES FOR SELECTED CHAPTER 15 GROUPS - ALL RESULTS
FOR SAMPLE DATE RANGE OF 20010101 THRU 20090126
REPORT OF COUNTY: 19 LOS ANGELES

SYSTEM NO: 1910066 NAME: LEISURE LAKE MOBILE HOME PARK COUNTY: LOS ANGELES
SOURCE NO: 002 NAME: WELL 02 PSCODE: 1910066-002 CLASS: CGMJ STATUS: AR

| GROUP IDENTIFICATION / CONSTITUENT IDENTIFICATION | SAMPLE DATE | RESULT * | MCL | DLR | TRIGGER | UNIT |
|---|---|---|---|---|---|---|
| RA RADIOLOGICAL | | | | | | |
| 01501 GROSS ALPHA | 05/04/2005 | 3.6000 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 04/19/2006 | 5.8500 * | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 03/21/2007 | 3.7500 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 07/03/2007 | 4.1100 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 12/19/2007 | 2.5900 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 09/10/2008 | 2.9300 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 05/04/2005 | 1.2900 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 04/19/2006 | 1.8300 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 03/21/2007 | 1.1600 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 07/03/2007 | 1.3100 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 12/19/2007 | 1.4400 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 09/10/2008 | 1.0100 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 03/21/2007 | 1.1000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 07/03/2007 | 1.3000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 12/19/2007 | 1.5000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 09/10/2008 | .9300 * | ---------- | ---------- | ---------- | PCI/L |
| 09501 RADIUM 226 | 05/04/2005 | .0750 | 3.0000 | 1.0000 | 3.0000 | PCI/L |
| 09501 RADIUM 226 | 04/19/2006 | .0440 | 3.0000 | 1.0000 | 3.0000 | PCI/L |
| 09501 RADIUM 226 | 03/21/2007 | .0000 | 3.0000 | 1.0000 | 3.0000 | PCI/L |
| 09502 RADIUM 226 COUNTING ERROR | 05/04/2005 | .0920 * | ---------- | ---------- | ---------- | PCI/L |
| 09502 RADIUM 226 COUNTING ERROR | 04/19/2006 | .2180 * | ---------- | ---------- | ---------- | PCI/L |

Avg = 2.35

Avg [d+ on RCE] = 2.38

NOTE1: * = RESULT IS EQUAL TO OR GREATER THAN TRIGGER
NOTE2: .000 = RESULT WAS REPORTED AS NON-DETECTED EXCEPT FOR RAD

DRINKING WATER ANALYSES RESULTS REPORT
ALL SAMPLES FOR SELECTED CHAPTER 15 GROUPS - ALL RESULTS
FOR SAMPLE DATE RANGE OF 20010101 THRU 20090126
REPORT OF COUNTY: 19 LOS ANGELES

SYSTEM NO: 1910066 NAME: LEISURE LAKE MOBILE HOME PARK COUNTY: LOS ANGELES
SOURCE NO: 002 NAME: WELL 02 PSCODE: 1910066-002 CLASS: CGMJ STATUS: AR

| GROUP IDENTIFICATION / CONSTITUENT IDENTIFICATION | SAMPLE DATE | RESULT | * | MCL | DLR | TRIGGER | UNIT |
|---|---|---|---|---|---|---|---|
| 09502 RADIUM 226 COUNTING ERROR | 03/21/2007 | .2560 | * | ---------- | ---------- | ---------- | PCI/L |
| A-074 RADIUM 226 MDA95 | 03/21/2007 | .6500 | * | ---------- | ---------- | ---------- | PCI/L |
| 11501 RADIUM 228 | 05/04/2005 | .1420 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 04/19/2006 | .0610 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 03/21/2007 | .0120 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 07/03/2007 | .0000 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 12/19/2007 | .0920 | * | ---------- | 1.0000 | ---------- | |
| 11502 RADIUM 228 COUNTING ERROR | 05/04/2005 | .5220 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 04/19/2006 | .3870 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 03/21/2007 | .5360 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 07/03/2007 | .6610 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 12/19/2007 | .6230 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 03/21/2007 | 1.0000 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 07/03/2007 | 1.2000 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 12/19/2007 | .6000 | * | ---------- | ---------- | ---------- | PCI/L |
| 28012 URANIUM (PCI/L) | 05/04/2005 | 4.2900 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| 28012 URANIUM (PCI/L) | 04/19/2006 | 5.3500 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| 28012 URANIUM (PCI/L) | 07/03/2007 | 3.5000 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| A-028 URANIUM COUNTING ERROR | 05/04/2005 | 1.1400 | * | ---------- | ---------- | ---------- | PCI/L |
| A-028 URANIUM COUNTING ERROR | 04/19/2006 | 1.2900 | * | ---------- | ---------- | ---------- | PCI/L |
| A-028 URANIUM COUNTING ERROR | 07/03/2007 | 1.2000 | * | ---------- | ---------- | ---------- | PCI/L |
| A-073 URANIUM MDA95 | 07/03/2007 | .6500 | * | ---------- | ---------- | ---------- | PCI/L |

NOTE1: * = RESULT IS EQUAL TO OR GREATER THAN TRIGGER
NOTE2: .000 = RESULT WAS REPORTED AS NON-DETECTED EXCEPT FOR RAD

DATE: 01/26/09
REPORT: R-040/2-3

STATE OF CALIFORNIA
DRINKING WATER PROGRAM



DRINKING WATER ANALYSES RESULTS REPORT
ALL SAMPLES FOR SELECTED CHAPTER 15 GROUPS - ALL RESULTS
FOR SAMPLE DATE RANGE OF 20010101 THRU 20090126
REPORT OF COUNTY: 19 LOS ANGELES

SYSTEM NO: 1910066 NAME: LEISURE LAKE MOBILE HOME PARK COUNTY: LOS ANGELES
SOURCE NO: 005 NAME: WELL 03 PSCODE: 1910066-005 CLASS: CGMJ STATUS: AR

| GROUP IDENTIFICATION / CONSTITUENT IDENTIFICATION | SAMPLE DATE | RESULT * | MCL | DLR | TRIGGER | UNIT |
|---|---|---|---|---|---|---|
| RA RADIOLOGICAL | | | | | | |
| 01501 GROSS ALPHA | 02/04/2004 | 3.6300 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 04/01/2004 | 5.4100 * | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 07/21/2004 | 1.6700 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 10/13/2004 | 2.8500 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 03/21/2007 | 2.4100 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 07/03/2007 | 2.4900 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 12/19/2007 | 2.7000 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 08/25/2008 | 4.6100 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01501 GROSS ALPHA | 09/10/2008 | 2.6600 | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 02/04/2004 | 1.1300 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 04/01/2004 | 1.1200 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 07/21/2004 | 1.4900 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 10/13/2004 | 1.6400 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 03/21/2007 | 1.4500 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 07/03/2007 | 1.5000 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 12/19/2007 | .7980 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 08/25/2008 | 1.5300 * | ---------- | ---------- | ---------- | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 09/10/2008 | 1.8000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 03/21/2007 | 1.7000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 07/03/2007 | 1.6000 * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 12/19/2007 | .8000 * | ---------- | ---------- | ---------- | PCI/L |

initial Avg = 2.60
Avg (Ex + Avg CE) = 3.5
1st reduced monitoring
Avg = 3.64
Avg (Ex + Avg CE) = 5.04

NOTE1: * = RESULT IS EQUAL TO OR GREATER THAN TRIGGER
NOTE2: .000 = RESULT WAS REPORTED AS NON-DETECTED EXCEPT FOR RAD

DRINKING WATER ANALYSES RESULTS REPORT
ALL SAMPLES FOR SELECTED CHAPTER 15 GROUPS - ALL RESULTS
FOR SAMPLE DATE RANGE OF 20010101 THRU 20090126
REPORT OF COUNTY: 19 LOS ANGELES

SYSTEM NO: 1910066 NAME: LEISURE LAKE MOBILE HOME PARK COUNTY: LOS ANGELES
SOURCE NO: 005 NAME: WELL 03 PSCODE: 1910066-005 CLASS: CGMJ STATUS: AR

| GROUP IDENTIFICATION / CONSTITUENT IDENTIFICATION | SAMPLE DATE | RESULT | * | MCL | DLR | TRIGGER | UNIT |
|---|---|---|---|---|---|---|---|
| A-072 GROSS ALPHA MDA95 | 08/25/2008 | 1.1200 | * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 09/10/2008 | 1.7500 | * | ---------- | ---------- | ---------- | PCI/L |
| 09501 RADIUM 226 | 07/28/2005 | .1590 | | 3.0000 | 1.0000 | 3.0000 | PCI/L |
| 09501 RADIUM 226 | 11/16/2005 | .0000 | | 3.0000 | 1.0000 | 3.0000 | PCI/L |
| 09502 RADIUM 226 COUNTING ERROR | 07/28/2005 | .1350 | * | ---------- | ---------- | ---------- | PCI/L |
| 09502 RADIUM 226 COUNTING ERROR | 11/16/2005 | .2890 | * | ---------- | ---------- | ---------- | PCI/L |
| 11501 RADIUM 228 | 07/28/2005 | .0000 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 11/16/2005 | .0000 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 03/21/2007 | .0110 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 07/03/2007 | .5440 | | 2.0000 | 1.0000 | 2.0000 | PCI/L |
| 11501 RADIUM 228 | 12/19/2007 | .0000 | * | ---------- | 1.0000 | ---------- | |
| 11502 RADIUM 228 COUNTING ERROR | 07/28/2005 | .4030 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 11/16/2005 | .4260 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 03/21/2007 | .5270 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 07/03/2007 | .6690 | * | ---------- | ---------- | ---------- | PCI/L |
| 11502 RADIUM 228 COUNTING ERROR | 12/19/2007 | .6440 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 03/21/2007 | .5000 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 07/03/2007 | .5500 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 12/19/2007 | .6000 | * | ---------- | ---------- | ---------- | PCI/L |
| 28012 URANIUM (PCI/L) | 07/28/2005 | 2.9300 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| 28012 URANIUM (PCI/L) | 11/16/2005 | 2.9600 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| 28012 URANIUM (PCI/L) | 08/25/2008 | 1.9200 | | 20.0000 | 2.0000 | 20.0000 | PCI/L |
| A-028 URANIUM COUNTING ERROR | 07/28/2005 | .9510 | * | ---------- | ---------- | ---------- | PCI/L |

NOTE1: * = RESULT IS EQUAL TO OR GREATER THAN TRIGGER
NOTE2: .000 = RESULT WAS REPORTED AS NON-DETECTED EXCEPT FOR RAD

DRINKING WATER ANALYSES RESULTS REPORT
ALL SAMPLES FOR SELECTED CHAPTER 15 GROUPS - ALL RESULTS
FOR SAMPLE DATE RANGE OF 20010101 THRU 20090126
REPORT OF COUNTY: 19 LOS ANGELES

SYSTEM NO: 1910066 NAME: LEISURE LAKE MOBILE HOME PARK COUNTY: LOS ANGELES
SOURCE NO: 005 NAME: WELL 03 PSCODE: 1910066-005 CLASS: CGMJ STATUS: AR

| GROUP IDENTIFICATION / CONSTITUENT IDENTIFICATION | SAMPLE DATE | RESULT * | MCL | DLR | TRIGGER | UNIT |
|---|---|---|---|---|---|---|
| A-028 URANIUM COUNTING ERROR | 11/16/2005 | .7620 * | ---------- | ---------- | ---------- | PCI/L |
| A-028 URANIUM COUNTING ERROR | 08/25/2008 | 1.1500 * | ---------- | ---------- | ---------- | PCI/L |
| A-073 URANIUM MDA95 | 08/25/2008 | .3920 * | ---------- | ---------- | ---------- | PCI/L |

NOTE1: * = RESULT IS EQUAL TO OR GREATER THAN TRIGGER
NOTE2: .000 = RESULT WAS REPORTED AS NON-DETECTED EXCEPT FOR RAD

# Well 1 Radionuclides Monitoring Records in the Division's Water Quality Database

1

DATE: 05/11/15
REPORT: R-040/1-3

STATE OF CALIFORNIA
DRINKING WATER PROGRAM



DRINKING WATER ANALYSES RESULTS REPORT
LAST SAMPLE FOR SELECTED CHAPTER 15 GROUPS - ALL RESULTS
REPORT OF COUNTY: 19 LOS ANGELES

SYSTEM NO: 1910066 NAME: LEISURE LAKE MOBILE ESTATES COUNTY: LOS ANGELES
SOURCE NO: 001 NAME: WELL 01 PSCODE: 1910066-001 CLASS: LGSF STATUS: AR

| GROUP IDENTIFICATION / CONSTITUENT IDENTIFICATION | SAMPLE DATE | | RESULT | * | MCL | DLR | TRIGGER | UNIT |
|---|---|---|---|---|---|---|---|---|
| RA RADIOLOGICAL | | | | | | | | |
| 01501 GROSS ALPHA | 09/10/2008 | | 3.1300 | | 15.0000 | 3.0000 | 5.0000 | PCI/L |
| 01502 GROSS ALPHA COUNTING ERROR | 09/10/2008 | | 2.2300 | * | ---------- | ---------- | ---------- | PCI/L |
| A-072 GROSS ALPHA MDA95 | 09/10/2008 | | 2.2300 | * | ---------- | ---------- | ---------- | PCI/L |
| A-080 RA-226 FOR CWS OR TOTAL RA FOR NTNC BY 903.0 | 11/14/2012 | . | .0990 | * | ---------- | ---------- | ---------- | PCI/L |
| A-081 RA-226 OR TOTAL RA BY 903.0 C.E. | 11/14/2012 | | .2740 | * | ---------- | ---------- | ---------- | PCI/L |
| 09501 RADIUM 226 | 04/19/2006 | | .1330 | * | 3.0000 | 1.0000 | ---------- | PCI/L |
| 09502 RADIUM 226 COUNTING ERROR | 04/19/2006 | | .2420 | * | ---------- | ---------- | ---------- | PCI/L |
| 11501 RADIUM 228 | 12/19/2007 | | .3540 | * | ---------- | 1.0000 | ---------- | |
| 11502 RADIUM 228 COUNTING ERROR | 12/19/2007 | | .7030 | * | ---------- | ---------- | ---------- | PCI/L |
| A-075 RADIUM 228 MDA95 | 12/19/2007 | | .5500 | * | ---------- | ---------- | ---------- | PCI/L |
| A-082 RADIUM, TOTAL, MDA95-NTNC ONLY, BY 903.0 | 11/14/2012 | | .4390 | * | ---------- | ---------- | ---------- | PCI/L |
| 28012 URANIUM (PCI/L) | 11/14/2012 | . | 5.9100 | | 20.0000 | 1.0000 | 20.0000 | PCI/L |
| A-028 URANIUM COUNTING ERROR | 11/14/2012 | . | 1.3300 | * | ---------- | ---------- | ---------- | PCI/L |
| A-073 URANIUM MDA95 | 11/14/2012 | . | .3680 | * | ---------- | ---------- | ---------- | PCI/L |

NOTE1: * = RESULT IS EQUAL TO OR GREATER THAN TRIGGER
NOTE2: .000 = RESULT WAS REPORTED AS NON-DETECTED EXCEPT FOR RAD

# Tier 3 Public Notice Template

## Instructions for Tier 3 Monitoring Violations Annual Notice Template

### Template Attached

Since most monitoring violations are included in Tier 3, you must provide public notice to persons served within one year after you learn of the violation [California Code of Regulations, Title 22, Chapter 15, Section 64463.7(b)]. Multiple monitoring violations can be serious. **Each water system required to give public notice must submit the notice to the State Water Resources Control Board, Division of Drinking Water (DDW) for approval prior to distribution or posting, unless otherwise directed by the DDW [64463(b)].**

### Notification Methods

You must use the methods summarized in the table below to deliver the notice to consumers. If you mail, post, or hand deliver, print your notice on letterhead, if available.

| *If You Are a…* | *You Must Notify Consumers by…* | *…and By One or More of the Following Methods to Reach Persons Not Likely to be Reached by the Previous Method…* |
|---|---|---|
| Community Water System [64463.7(c)(1)] | Mail or direct delivery [(a)] | Publication in a local newspaper |
| | | Posting [(b)] in conspicuous public places served by the water system or on the Internet |
| | | Delivery to community organizations |
| Non-Community Water System [64463.7(c)(2)] | Posting in conspicuous locations throughout the area served by the water system [(b)] | Publication in a local newspaper or newsletter distributed to customers |
| | | Email message to employees or students |
| | | Posting [(b)] on the Internet or intranet |
| | | Direct delivery to each customer |

(a) Notice must be distributed to each customer receiving a bill including those that provide their drinking water to others (e.g., schools or school systems, apartment building owners, or large private employers), and other service connections to which water is delivered by the water system.

(b) Notice must be posted in place for as long as the violation or occurrence continues, but in no case less than seven days.

The notice attached is appropriate for the methods described above, insertion in an annual notice, or included in the Consumer Confidence Report[1]. However, you may wish to modify it before using it for posting. If you do, you must still include all the required elements and leave the standard language for monitoring and testing

[1] CCR may be used as long as public notification timing, content, and delivery requirements are met [64463.7(d)].

procedure violations and notification language in italics unchanged. This language is mandatory [64465].

You may need to modify the template for a notice for individual monitoring violations. The template presents violations in a table; however, you may write out an explanation for each violation if you wish. For any monitoring violation for volatile organic compounds (VOCs) or other groups, you may list the group name in the table, but you must provide the name of every chemical in the group on the notice (e.g., in a footnote). An example is shown in the table below.

| *Contaminant* | *Required Sampling Frequency* | *Number of Samples Taken* | *When All Samples Should Have Been Taken* | *When Samples Were or Will Be Taken* |
|---|---|---|---|---|
| VOCs [(a)] | 1 sample every 3 years | None | 2002 – 2005 | February 2006 |

(a) Benzene; Carbon Tetrachloride; 1,2-Dichlorobenzene; 1,4-Dichlorobenzene; 1,1-Dichloroethane; 1,2-Dichloroethane; 1,1-Dichloroethylene; cis-1,2-Dichloroethylene; trans-1,2-Dichloroethylene; Dichloromethane; 1,2-Dichloropropane; 1,3-Dichloropropene; Ethylbenzene; Methyl-*tert*-butyl ether; Monochlorobenzene; Styrene; 1,1,2,2-Tetrachloroethane; Tetrachloroethylene; Toluene; 1,2,4-Trichlorobenzene; 1,1,1-Trichloroethane; 1,1,2-Trichloroethane; Trichloroethylene; Trichlorofluoromethane; 1,1,2-Trichloro-1,2,2-Trifluoroethane; Vinyl Chloride; and Xylenes.

You may need to modify the notice if you had any monitoring violations for which monitoring later showed a maximum contaminant level or other violation. In such cases, you should refer to the public notice you issued at that time.

**Multilingual Requirement**

The notice must (1) be provided in English, Spanish, and the language spoken by any non-English-speaking group exceeding 10 percent of the persons served by the water system and (2) include a telephone number or address where such individuals may contact the water system for assistance.

If any non-English-speaking group exceeds 1,000 persons served by the water system, but does not exceed 10 percent served, the notice must (1) include information in the appropriate language(s) regarding the importance of the notice and (2) contain the telephone number or address where such individuals may contact the water system to obtain a translated copy of the notice from the water system or assistance in the appropriate language.

**Population Served**

Make sure it is clear who is served by your water system -- you may need to list the areas you serve.

## Corrective Actions

In your notice, describe corrective actions you took or are taking. Listed below are some steps commonly taken by water systems with monitoring violations. Choose the appropriate language, or develop your own:

- "We have since taken the required samples, as described in the last column of the table above. The samples showed we are meeting drinking water standards."
- "We have since taken the required samples, as described in the last column of the table above. The sample for [contaminant] exceeded the limit. [Describe corrective action; use information from public notice prepared for violating the limit.]"
- "We plan to take the required samples soon, as described in the last column of the table above."

## After Issuing the Notice

Send a copy of each type of notice and a certification that you have met all the public notice requirements to the DDW within ten days after you issue the notice [64469(d)]. You should also issue a follow-up notice in addition to meeting any repeat notice requirements the DDW sets.

It is recommended that you notify health professionals in the area of the violation. People may call their doctors with questions about how the violation may affect their health, and the doctors should have the information they need to respond appropriately.

It is a good idea to issue a "problem corrected" notice when the violation is resolved.

**IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER**

Este informe contiene información muy importante sobre su agua potable.
Tradúzcalo o hable con alguien que lo entienda bien.

# Monitoring Requirements Not Met for [System]

Our water system failed to monitor as required for drinking water standards during the past year and, therefore, was in violation of the regulations. Even though this failure was not an emergency, as our customers, you have a right to know what you should do, what happened, and what we did to correct this situation.

*We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not our drinking water meets health standards. During [compliance period dates], we ['did not monitor or test' or 'did not complete all monitoring or testing'] for [contaminant(s)] and therefore, cannot be sure of the quality of our drinking water during that time.*

**What should I do?**

- There is nothing you need to do at this time.
- The table below lists the contaminant(s) we did not properly test for during the last year, how many samples we are required to take and how often, how many samples we took, when samples should have been taken, and the date on which follow-up samples were (or will be) taken.

| *Contaminant* | *Required Sampling Frequency* | *Number of Samples Taken* | *When All Samples Should Have Been Taken* | *When Samples Were or Will Be Taken* |
|---|---|---|---|---|
| | [number] sample every [number][time interval] | | | |
| | | | | |
| | | | | |

- If you have health issues concerning the consumption of this water, you may wish to consult your doctor.

**What happened? What is being done?**

[Describe corrective action].

For more information, please contact [name of contact] at [phone number] or [mailing address].

*Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this public notice in a public place or distributing copies by hand or mail.*

**Secondary Notification Requirements**

Upon receipt of notification from a person operating a public water system, the following notification must be given within 10 days [Health and Safety Code Section 116450(g)]:

- SCHOOLS: Must notify school employees, students, and parents (if the students are minors).
- RESIDENTIAL RENTAL PROPERTY OWNERS OR MANAGERS (including nursing homes and care facilities): Must notify tenants.
- BUSINESS PROPERTY OWNERS, MANAGERS, OR OPERATORS: Must notify employees of businesses located on the property.

This notice is being sent to you by [system].

State Water System ID#: _____. Date distributed: _____.

# Proof of Public Notification for Radionuclides Monitoring Failure

## PROOF OF NOTIFICATION

Name of Water System: Leisure Lake Mobile Home Park

System Number: 1910066

**Certification of Notification for**
**Radionuclides Monitoring Violation**

As required by *California Code of Regulations,* Title 22, Section 64463.7, I notified the users of the water supplied by the Leisure Lake Mobile Home Park of the violation of Section 64442 (d), Title 22, *California Code of Regulations*. I complied with the requirement to conduct public notification as indicated below:

| Required Action (indicate all that were used) | Date Completed |
|---|---|
| Public Notification – Hand Delivery | |
| Public Notification - Mail Delivery | |
| Public Notification – Continuous Posting | |
| Public Notification - Consumer Confidence Report | |
| Public Notification - Other method<br>Specify other method used: | |

_____

_____ _____

Signature of Water System Representative Date

**ATTACH A COPY OF THE NOTICE USED.**

**THIS FORM MUST BE COMPLETED AND RETURNED TO THE DIVISION**