

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LOS ANGELES REGION**

320 W. 4th Street, Suite 200, Los Angeles, California 90013
Phone (213) 576-6600 • Fax (213) 576-6640
<http://www.waterboards.ca.gov/losangeles>

**ORDER NO. R4-2015-XXXX
NPDES NO. CA0063908**

**WASTE DISCHARGE REQUIREMENTS
FOR POLYNT COMPOSITES USA, INC., LYNWOOD FACILITY
DISCHARGE TO COMPTON CREEK VIA DISCHARGE POINT 001**

The following Discharger is subject to waste discharge requirements (WDRs) set forth in this Order:

Table 1. Discharger Information

Discharger	Polynt Composites USA, Inc. (formerly PCCR USA, Inc.)
Name of Facility	Lynwood Facility
Facility Address	2801 Lynwood Road
	Lynwood, CA 90262
	Los Angeles County

Table 2. Discharge Location

Discharge Point	Effluent Description	Discharge Point Latitude (North)	Discharge Point Longitude (West)	Receiving Water
001	Treated storm water runoff	33.9261°	-118.2217°	Compton Creek

Table 3. Administrative Information

This Order was adopted on:	October 8, 2015
This Order shall become effective on:	December 1, 2015
This Order shall expire on:	November 30, 2020
The Discharger shall file a Report of Waste Discharge as an application for reissuance of WDRs in accordance with title 23, California Code of Regulations, and an application for reissuance of a National Pollutant Discharge Elimination System (NPDES) permit no later than:	180 days prior to the Order expiration date
The U.S. Environmental Protection Agency (U.S. EPA) and the California Regional Water Quality Control Board, Los Angeles Region have classified this discharge as follows:	Minor

I, Samuel Unger, Executive Officer, do hereby certify that this Order with all attachments is a full, true, and correct copy of the Order adopted by the California Regional Water Quality Control Board, Los Angeles Region, on the date indicated above.

Samuel Unger, P.E., Executive Officer

CONTENTS

I.	Facility Information	3
II.	Findings	3
III.	Discharge Prohibitions	3
IV.	Effluent Limitations and Discharge Specifications	4
	A. Effluent Limitations – Discharge Point 001	4
	1. Final Effluent Limitations – Discharge Point 001	4
	B. Land Discharge Specifications – Not Applicable	6
	C. Recycling Specifications – Not Applicable	6
V.	Receiving Water Limitations	7
	A. Surface Water Limitations	7
	B. Groundwater Limitations – Not Applicable	8
VI.	Provisions	8
	A. Standard Provisions	8
	B. Monitoring and Reporting Program (MRP) Requirements	11
	C. Special Provisions	11
	1. Reopener Provisions	11
	2. Special Studies, Technical Reports and Additional Monitoring Requirements	11
	3. Best Management Practices and Pollution Prevention	12
	4. Construction, Operation and Maintenance Specifications	12
	5. Other Special Provisions – Not Applicable	12
	6. Compliance Schedules – Not Applicable	12
VII.	Compliance Determination	13

TABLES

Table 1.	Discharger Information	1
Table 2.	Discharge Location	1
Table 3.	Administrative Information	1
Table 4.	Effluent Limitations at Discharge Point 001	4

ATTACHMENTS

Attachment A –	Definitions	A-1
Attachment B –	Map	B-1
Attachment C-1 –	Flow Schematic	C-1
Attachment C-2 –	Site Drainage Map (Lynwood Facility)	C-2
Attachment D –	Standard Provisions	D-1
Attachment E –	Monitoring and Reporting Program (MRP No. 7655)	E-1
Attachment F –	Fact Sheet	F-1
Attachment G –	Storm Water Pollution Prevention Plan Requirements	G-1
Attachment H –	State Water Board Minimum Levels	H-1
Attachment I –	List of Priority Pollutants	I-1
Attachment J –	Summary Of Effluent Limitation Calculations	J-1

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

I. FACILITY INFORMATION

Information describing the Polynt Composites USA, Inc., Lynwood Facility (Facility) is summarized in Table 1 and in sections I and II of the Fact Sheet (Attachment F). Section I of the Fact Sheet also includes information regarding the Facility's permit application.

II. FINDINGS

The California Regional Water Quality Control Board, Los Angeles Region (Regional Water Board), finds:

- A. Legal Authorities.** This Order serves as WDRs pursuant to article 4, chapter 4, division 7 of the California Water Code (commencing with section 13260). This Order is also issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. EPA and chapter 5.5, division 7 of the Water Code (commencing with section 13370). It shall serve as an NPDES permit for point source discharges from this Facility to surface waters.
- B. Background and Rationale for Requirements.** The Regional Water Board developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and other available information. The Fact Sheet (Attachment F), which contains background information and rationale for the requirements in this Order, is hereby incorporated into and constitutes Findings for this Order. Attachments A through E and G through J are also incorporated into this Order.
- C. Notification of Interested Parties.** The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe WDRs for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of the notification are provided in the Fact Sheet.
- D. Consideration of Public Comment.** The Regional Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet.

THEREFORE, IT IS HEREBY ORDERED that this Order supersedes Order No. R4-2010-0161 except for enforcement purposes, and, in order to meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the CWA and regulations and guidelines adopted thereunder, the Discharger is authorized to discharge from the identified Facility and outfall into waters of the United States and shall comply with the requirements in this Order. This action in no way prevents the Regional Water Board from taking enforcement action for past violations of the previous Order.

III. DISCHARGE PROHIBITIONS

- A.** Wastes shall be limited to 0.34 million gallons per day (MGD) of treated storm water runoff through Discharge Point 001 as described in the Fact Sheet. The discharge of wastes from accidental spills or other sources are prohibited.
- B.** Discharges of water, materials, thermal wastes, elevated temperature wastes, toxic wastes, deleterious substances, or wastes other than those authorized by this Order, to a storm drain system, Compton Creek, or other waters of the State, are prohibited.
- C.** Neither the treatment nor the discharge of pollutants shall create pollution, contamination, or a nuisance as defined by Section 13050 of the Water Code.
- D.** Wastes discharged shall not contain any substances in concentrations toxic to human, animal, plant, or aquatic life.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- E. The discharge shall not cause a violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or the State Water Resources Control Board (State Water Board) as required by the federal CWA and regulations adopted thereunder. If more stringent applicable water quality standards are promulgated or approved pursuant to section 303 of the federal CWA, and amendments thereto, the Regional Water Board will revise and modify this Order in accordance with such more stringent standards.
- F. The discharge of any radiological, chemical, or biological warfare agent or high-level radiological waste is prohibited.
- G. Any discharge of wastes at any point(s) other than specifically described in this Order is prohibited, and constitutes a violation of the Order.

IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

A. Effluent Limitations – Discharge Point 001

1. Final Effluent Limitations – Discharge Point 001

- a. The Discharger shall maintain compliance with the following effluent limitations at Discharge Point 001, with compliance measured at Monitoring Location EFF-001 as described in the Monitoring and Reporting Program, Attachment E:

Table 4. Effluent Limitations at Discharge Point 001

Parameter	Units	Effluent Limitations			
		Average Monthly (30-day Average)	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Conventional Pollutants					
Biochemical Oxygen Demand (BOD ₅ @ 5-day; 20 deg. C)	mg/L	--	30	--	--
	lbs/day ²	--	85	--	--
Oil and Grease	mg/L	--	15	--	--
	lbs/day ²	--	43	--	--
pH	standard units	--	--	6.5	8.5
Total Suspended Solids (TSS)	mg/L	--	75	--	--
	lbs/day ²	--	210	--	--
Non-Conventional Pollutants					
Chronic Toxicity ⁶	Pass or Fail and % Effect (for TST Statistical Approach)	--	Pass or % Effect <50	--	--
E. coli	CFU/100mL or MPN/100mL	1			
Ammonia, Total (as Nitrogen) ⁴	mg/L	--	10.1	--	--
	lbs/day ²	--	28.6	--	--
Chloride	mg/L	--	150	--	--
	lbs/day ²	--	430	--	--

Parameter	Units	Effluent Limitations			
		Average Monthly (30-day Average)	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Nitrate-nitrogen (as N) ⁴	mg/L	8.0	--	--	--
	lbs/day ²	23	--	--	--
Nitrite-nitrogen (as N) ⁴	mg/L	1.0	--	--	--
	lbs/day ²	2.8	--	--	--
Nitrate plus Nitrite (total as Nitrogen) ⁴	mg/L	8.0	--	--	--
	lbs/day ²	23	--	--	--
Sulfate	mg/L	--	350	--	--
	lbs/day ²	--	990	--	--
Temperature	Degree F	--	--	--	86
Total Dissolved Solids	mg/L	--	1500	--	--
	lbs/day ²	--	4300	--	--
Total Petroleum Hydrocarbons ³	µg/L	--	100	--	--
	lbs/day ²	--	0.28	--	--
Priority Pollutants					
Cadmium, Total Recoverable, Wet Weather ^{5,7}	µg/L	--	3.1	--	--
	lbs/day ²	--	0.0088	--	--
Copper, Total Recoverable, Wet Weather ^{5,7}	µg/L	--	17	--	--
	lbs/day ²	--	0.048	--	--
Copper, Total Recoverable, Dry Weather ^{5,8}	µg/L	--	32	--	--
	lbs/day ²	--	0.091	--	--
Lead, Total Recoverable, Wet Weather ^{5,7}	µg/L	--	62	--	--
	lbs/day ²	--	0.18	--	--
Lead, Total Recoverable, Dry Weather ^{5,8}	µg/L	--	15	--	--
	lbs/day ²	--	0.043	--	--
2,3,7,8-TCDD	µg/L	--	2.8 x 10⁻⁸	--	--
	lbs/day²	--	7.9 x 10⁻¹¹	--	--
TCDD Equivalents ⁹	µg/L	--	2.8 x 10 ⁻⁸	--	--
	lbs/day ²	--	7.9 x 10 ⁻¹¹	--	--
Zinc, Total Recoverable, Wet Weather ^{5,7}	µg/L	--	159	--	--
	lbs/day ²	--	0.45	--	--
Zinc, Total Recoverable, Dry Weather ⁸	µg/L	--	113	--	--
	lbs/day ²	--	0.32	--	--

¹ The effluent limitation is based on the LA River Bacteria TMDL WLAs. The LA River Bacteria TMDL contains WLAs of zero days of allowable exceedances of the single sample target of 235/100mL E.coli for both dry and wet weather (defined as days with 0.1 inch of rain or greater and the three days following the rain event) and no exceedances of the geometric mean TMDL numeric target of 126/100 mL E.coli for general and individual NPDES permits. The rolling 30-day geometric mean values should be calculated based on a statistically sufficient number of samples (generally not less than 5 samples equally spaced over a 30-day period). If any of the single sample limits are exceeded, the Regional Water Board may require repeat sampling on a daily

basis until the sample falls below the single sample limit in order to determine persistence of exceedance. Results collected during this accelerated monitoring period can be used to calculate the rolling 30-day geometric mean.

2 The mass limitations are based on a maximum flow of 0.34 MGD and is calculated as follows:

Flow (MGD) x Concentration (mg/L) x 8.34 (conversion factor) = lbs/day

3 TPH equals the sum of TPH gasoline (C4-C12) and TPH diesel (C13-C22), and TPH waste oil (C23+).

4 The effluent limitations are based on the LA River Nutrients TMDL WLAs. The MDEL for ammonia are translated based on its 1-hour average WLA as included in the LA River Nutrients TMDL; the AMELs for nitrite, nitrate, and total nitrate and nitrite as nitrogen are translated based on their respective 30-day average WLAs as included in the LA River Nutrients TMDL to ensure the protection of aquatic life.

5 The effluent limitations are based on the LA River Metals TMDL WLAs and calculated using the CTR-SIP procedures.

6 Report "Pass" or "Fail" and "% Effect" for Maximum Daily Effluent Limitation (MDEL). During a calendar month, exactly three independent toxicity tests are required for routine monitoring when one toxicity test results in "Fail." This limit applies for wet weather discharges only.

7 The wet weather TMDL limits apply when the maximum daily flow in the Los Angeles River at Wardlow gauge station (F319-R) is greater than or equal to 500 cubic feet per second (cfs).

8 Dry weather targets are applicable when flow in the Los Angeles River at the Wardlow stream gauge station (F319-R) is less than 500 cfs.

9 TCDD equivalents shall be calculated using the following formula, where the MLs and the toxicity equivalency factors (TEFs) are as listed in the Table below. The Discharger shall report all measured values of individual congeners, including data qualifiers. When calculating TCDD equivalents, the Discharger shall set congener concentrations below the MLs to zero. U.S. EPA method 1613 may be used to analyze dioxin and furan congeners.

Dioxin-TEQ (TCDD equivalents) = $\sum(Cx \times TEFx)$

where: Cx = concentration of dioxin or furan congener x

TEFx= TEF for congener x

Congeners	Minimum Levels (pg/L)	Toxicity Equivalence Factor (TEF)
2,3,7,8 - tetra CDD	10	1.0
1,2,3,7,8 - penta CDD	50	1.0
1,2,3,4,7,8 - hexa CDD	50	0.1
1,2,3,6,7,8 - hexa CDD	50	0.1
1,2,3,7,8,9 - hexa CDD	50	0.1
1,2,3,4,6,7,8 - hepta CDD	50	0.01
Octa CDD	100	0.0001
2,3,7,8 - tetra CDF	10	0.1
1,2,3,7,8 - penta CDF	50	0.05
2,3,4,7,8 - penta CDF	50	0.5
1,2,3,4,7,8 - hexa CDF	50	0.1
1,2,3,6,7,8 - hexa CDF	50	0.1
1,2,3,7,8,9 - hexa CDF	50	0.1
2,3,4,6,7,8 - hexa CDF	50	0.1
1,2,3,4,6,7,8 - hepta CDFs	50	0.01
1,2,3,4,7,8,9 - hepta CDFs	50	0.01
Octa CDF	100	0.0001

B. Land Discharge Specifications – Not Applicable

C. Recycling Specifications – Not Applicable

V. RECEIVING WATER LIMITATIONS

A. Surface Water Limitations

The discharge shall not cause the following in Compton Creek:

1. The normal ambient pH to fall below 6.5 nor exceed 8.5 units nor vary from normal ambient pH levels by more than 0.5 units.
2. Surface water temperature to rise greater than 5° F above the natural temperature of the receiving waters at any time or place. At no time shall the temperature be raised above 80° F as a result of waste discharged.
3. Water Contact Standards

In fresh water designated for water contact recreation (REC-1), the waste discharged shall not cause the following bacterial standards to be exceeded in the receiving water:

- a. Rolling 30 Days Geometric Mean Limits
 - a. *E. coli* density shall not exceed 126/100 mL.
 - b. Single Sample Maximum Limits (SSM)
 - a. *E. coli* density shall not exceed 235/100 mL.
4. Depressed the concentration of dissolved oxygen to fall below 5.0 mg/L at any time, and the median dissolved oxygen concentration for any three consecutive months shall not be less than 80 percent of the dissolved oxygen content at saturation.
5. Exceed total ammonia (as N) concentrations specified in the 1994 Basin Plan and its amendments. The Regional Water Board revised the water quality objectives for ammonia to be consistent with the *"1999 Update of Ambient Water Quality Criteria for Ammonia"* through the adoption of Resolution No. 2002-011 on April 25, 2002. This amendment was approved by the State Water Board, OAL and U.S. EPA on April 30, 2003, June 5, 2003, and June 19, 2003, respectively. The amendment became effective on July 15, 2003. On December 1, 2005, Resolution No. 2005-014, *Amendment to the Water Quality Control Plan for the Los Angeles Region to Revise the Early Life Stage Implementation Provision of the Freshwater Ammonia Objectives for Inland Surface Waters (including enclosed bays, estuaries and wetlands) for Protection of Aquatic Life*, was adopted by the Regional Water Board. Resolution No. 2005-014 was approved by the State Water Board, OAL, and U.S. EPA on July 19, 2006, August 31, 2006, and April 5, 2007, respectively; it became effective on April 5, 2007. On June 7, 2007, the Regional Water Board adopted Resolution No. 2007-005 to incorporate site-specific 30-day average objectives for ammonia along with corresponding site-specific early life stage implementation provisions for select water body reaches and tributaries in the Santa Clara, Los Angeles, and San Gabriel River watersheds. The State Water Board, OAL, and U.S. EPA approved this Basin Plan amendment on January 15, 2008, May 12, 2008, and March 30, 2009, respectively. The amendment became effective on April 23, 2009.
6. The presence of visible, floating, suspended or deposited macroscopic particulate matter or foam.
7. Oils, greases, waxes, or other materials in concentrations that result in a visible film or coating on the surface of the receiving water or on objects in the water.
8. Suspended or settleable materials, chemical substances or pesticides in amounts that cause nuisance or adversely affect any designated beneficial use.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

9. Toxic or other deleterious substances in concentrations or quantities which cause deleterious effects on aquatic biota, wildlife, or waterfowl or render any of these unfit for human consumption either at levels created in the receiving waters or as a result of biological concentration.
10. Accumulation of bottom deposits or aquatic growths.
11. Biostimulatory substances at concentrations that promote aquatic growth to the extent that such growth causes nuisance or adversely affects beneficial uses.
12. The presence of substances that result in increases of BOD that adversely affect beneficial uses.
13. Taste or odor-producing substances in concentrations that alter the natural taste, odor, and/or color of fish, shellfish, or other edible aquatic resources; cause nuisance; or adversely affect beneficial uses.
14. Alteration of turbidity, or apparent color beyond present natural background levels.
15. Damage, discolor, or formation of sludge deposits on flood control structures or facilities, or overloading of the design capacity.
16. Degrade surface water communities and populations including vertebrate, invertebrate, and plant species.
17. Problems associated with breeding of mosquitoes, gnats, black flies, midges, or other pests.
18. Nuisance or adverse effects on beneficial uses of the receiving water.
19. Violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or State Water Board. If more stringent applicable water quality standards are promulgated or approved pursuant to section 303 of the CWA, or amendments thereto, the Regional Water Board will revise or modify this Order in accordance with such standards.

B. Groundwater Limitations – Not Applicable

VI. PROVISIONS

A. Standard Provisions

1. The Discharger shall comply with all Standard Provisions included in Attachment D of this Order.
2. The Discharger shall comply with the following provisions. In the event that there is any conflict, duplication, or overlap between provisions specified by this Order, the more stringent provision shall apply:
 - a. This Order may be modified, revoked, reissued, or terminated in accordance with the provisions of 40 C.F.R., sections 122.44, 122.62, 122.63, 122.64, 125.62 and 125.64. Causes for taking such actions include, but are not limited to: failure to comply with any condition of this Order; endangerment to human health or the environment resulting from the permitted activity; or acquisition of newly-obtained information which would have justified the application of different conditions if known at the time of Order adoption. The filing of a request by the Discharger for an Order modification, revocation, and issuance or termination, or a notification of planned changes or anticipated noncompliance does not stay any condition of this Order.
 - b. The Discharger must comply with the lawful requirements of municipalities, counties, drainage districts, and other local agencies regarding discharges of storm

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

water to storm drain systems or other water courses under their jurisdiction; including applicable requirements in municipal storm water management programs developed to comply with NPDES permits issued by the Regional Water Board to local agencies.

- c. A discharge of wastes to any point other than specifically described in this Order is prohibited and constitutes a violation thereof.
- d. The Discharger shall comply with all applicable effluent limitations, national standards of performance, toxic effluent standards, and all federal regulations established pursuant to sections 301, 302, 303(d), 304, 306, 307, 316, 318, 405, and 423 of the Federal CWA and amendments thereto.
- e. These requirements do not exempt the operator of the waste disposal facility from compliance with any other laws, regulations, or ordinances which may be applicable; they do not legalize this waste disposal facility, and they leave unaffected any further restraints on the disposal of wastes at this site which may be contained in other statutes or required by other agencies.
- f. Oil or oily material, chemicals, refuse, or other waste materials shall not be stored or deposited in areas where they may be picked up by rainfall and carried off the property and/or discharged to surface waters. Any such spill of such materials shall be contained and removed immediately.
- g. A copy of these waste discharge specifications shall be maintained at the discharge facility so as to be available at all times to operating personnel.
- h. After notice and opportunity for a hearing, this Order may be terminated or modified for cause, including, but not limited to:
 - i. Violation of any term or condition contained in this Order;
 - ii. Obtaining this Order by misrepresentation, or failure to disclose all relevant facts;
 - iii. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.
- i. If there is any storage of hazardous or toxic materials or hydrocarbons at this facility and if the facility is not manned at all times, a 24-hour emergency response telephone number shall be prominently posted where it can easily be read from the outside.
- j. The Discharger shall notify the Regional Water Board not later than 120 days in advance of implementation of any plans to alter production capacity of the product line of the manufacturing, producing or processing facility by more than ten percent. Such notification shall include estimates of proposed production rate, the type of process, and projected effects on effluent quality. Notification shall include submittal of a new report of waste discharge and the appropriate filing fee. The Discharger shall also file with the Regional Water Board a report of waste discharge at least 120 days before making any material change or proposed change in the character, location or volume of the discharge. A new report of waste discharge with the appropriate filing fee shall be included in this submittal.
- k. All existing manufacturing, commercial, mining, and silvicultural dischargers must notify the Regional Water Board as soon as they know or have reason to believe that they have begun or expect to begin to use or manufacture intermediate or final product or byproduct of any toxic pollutant that was not reported on their application.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

- l. In the event of any change in name, ownership, or control of these waste disposal facilities, the Discharger shall notify this Regional Water Board of such change and shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to the Regional Water Board.
- m. The Water Code provides that any person who violates a waste discharge requirement or a provision of the Water Code is subject to civil penalties of up to \$5,000 per day, \$10,000 per day, or \$25,000 per day of violation, or when the violation involves the discharge of pollutants, is subject to civil penalties of up to \$10 per gallon per day or \$25 per gallon per day of violation; or some combination thereof, depending on the violation, or upon the combination of violations.
- n. Violation of any of the provisions of the NPDES program or of any of the provisions of this Order may subject the violator to any of the penalties described herein, or any combination thereof, at the discretion of the prosecuting authority; except that only one kind of penalty may be applied for each kind of violation.
- o. The discharge of any product registered under the Federal Insecticide, Fungicide, and Rodenticide Act to any waste stream which may ultimately be released to waters of the United States, is prohibited unless specifically authorized elsewhere in this permit or another NPDES permit. This requirement is not applicable to products used for lawn and agricultural purposes.
- p. The discharge of any waste resulting from the combustion of toxic or hazardous wastes to any waste stream that ultimately discharges to waters of the United States is prohibited, unless specifically authorized elsewhere in this Order.
- q. The Discharger shall notify the Executive Officer in writing no later than 6 months prior to the planned discharge of any chemical, other than the products previously reported to the Executive Officer, which may be toxic to aquatic life. Such notification shall include:
 - i. Name and general composition of the chemical,
 - ii. Frequency of use,
 - iii. Quantities to be used,
 - iv. Proposed discharge concentrations, and
 - v. U.S. EPA registration number, if applicable.
- r. Failure to comply with provisions or requirements of this Order, or violation of other applicable laws or regulations governing discharges from this facility, may subject the Discharger to administrative or civil liabilities, criminal penalties, and/or other enforcement remedies to ensure compliance. Additionally, certain violations may subject the Discharger to civil or criminal enforcement from appropriate local, state, or federal law enforcement entities.
- s. In the event the Discharger does not comply or will be unable to comply for any reason, with any prohibition, effluent limitations, or receiving water limitations of this Order, the Discharger shall notify the Regional Water Board by telephone (213) 576-6600 within 24 hours of having knowledge of such noncompliance, and shall confirm this notification in writing within five days, unless the Regional Water Board waives confirmation. The written notification shall state the nature, time, duration, and cause of noncompliance, and shall describe the measures being taken to remedy the current noncompliance and, prevent recurrence including, where applicable, a

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

schedule of implementation. Other noncompliance requires written notification as above at the time of the normal monitoring report.

- t. Prior to making any change in the point of discharge, place of use, or purpose of use of treated wastewater that results in a decrease of flow in any portion of a watercourse, the Discharger must file a petition with the State Water Board, Division of Water Rights, and receive approval for such a change. (Wat. Code § 1211.)

B. Monitoring and Reporting Program (MRP) Requirements

The Discharger shall comply with the MRP, and future revisions thereto, in Attachment E of this Order.

C. Special Provisions

1. Reopener Provisions

- a. If more stringent applicable water quality standards are promulgated or approved pursuant to Section 303 of the Federal CWA, and amendments thereto, the Regional Water Board may revise and modify this Order in accordance with such more stringent standards.
- b. This Order may be reopened to include effluent limitations for toxic constituents determined to be present in significant amounts in the discharge through a more comprehensive monitoring program included as part of this Order and based on the results of the RPA.
- c. This Order may be reopened and modified, to incorporate in accordance with the provisions set forth in 40 C.F.R., parts 122 and 124, requirements for the implementation of the watershed management approach or to include new MLs.
- d. This Order may be reopened and modified to revise effluent limitations as a result of future Basin Plan Amendments, such as an update of an objective or the adoption of a TMDL for Compton Creek.
- e. This Order may also be reopened and modified, revoked, and reissued or terminated in accordance with the provisions of 40 C.F.R. sections 122.44, 122.62 to 122.64, 125.62, and 125.64. Causes for taking such actions include, but are not limited to, failure to comply with any condition of this Order, and endangerment to human health or the environment resulting from the permitted activity.
- f. This Order may be reopened for modification, or revocation and reissuance, as a result of the detection of a reportable priority pollutant generated by special conditions included in this Order. These special conditions may be, but are not limited to, fish tissue sampling, whole effluent toxicity, monitoring requirements on internal waste stream(s), and monitoring for surrogate parameters. Additional requirements may be included in this Order as a result of the special condition monitoring data.

2. Special Studies, Technical Reports and Additional Monitoring Requirements

a. Initial Investigation Toxicity Reduction Evaluation (TRE) Workplan.

The Discharger shall submit to the Regional Water Board an Initial Investigation TRE workplan (1-2 pages) **within 90 days** of the effective date of this Order. This plan shall describe the steps the permittee intends to follow in the event that toxicity is detected. See section V of the Monitoring and Reporting Program (Attachment E) for an overview of Toxicity Reduction Evaluation (TRE) requirements.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

3. **Best Management Practices and Pollution Prevention**

The Discharger shall submit the following within 90 days of the effective date of this Order:

- a. An updated **Storm Water Pollution Prevention Plan (SWPPP)** that describes site-specific management practices for minimizing contamination of storm water runoff and for preventing contaminated storm water runoff from being discharged directly to waters of the State. The SWPPP shall address procedures for preventing fire test water from commingling with storm water discharges. In particular, the Discharger shall develop and implement specific Best Management Practices (BMPs) at the southeastern portion of the site near the railcar gate to prevent the contamination of storm water runoff in those areas. The SWPPP shall be developed in accordance with the requirements in Attachment G.
- b. An updated **Best Management Practices Plan (BMPP)** that will be implemented to reduce the discharge of pollutants to the receiving water. The BMPP shall include site-specific plans and procedures implemented and/or to be implemented to prevent hazardous waste/material from being discharged to waters of the State. Further, the Discharger shall ensure that the storm water discharges from the Facility would neither cause, nor contribute to the exceedance of water quality standards and objectives, nor create conditions of nuisance in the receiving water, and that unauthorized discharges (i.e., spills) to the receiving water have been effectively prohibited. In particular, a risk assessment of each area identified by the Discharger shall be performed to determine the potential for hazardous or toxic waste/material discharge to surface waters. The BMPP shall be developed in accordance with requirements in Attachment G.
- c. A **Spill Contingency Plan (SCP)** that shall include a technical report on the preventive (failsafe) and contingency (cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events at the site. The SCP may be substituted with an updated version of the Discharger's existing Spill Prevention Control and Countermeasure (SPCC) Plan.

Each plan shall cover all areas of the Facility and shall include an updated drainage map for the Facility. The Discharger shall identify on a map of appropriate scale the areas that contribute runoff to the permitted discharge point; describe the activities in each area and the potential for contamination of storm water runoff and the discharge of hazardous waste/material; and address the feasibility of containment and/or treatment of storm water. The plans shall be reviewed annually and at the same time. Updated information shall be submitted within 30 days of revision.

The Discharger shall implement the SWPPP, BMPP, and SCP (or SPCC) within 10 days of the approval by the Executive Officer or no later than 90 days after submission to the Regional Water Board, whichever comes first.

4. **Construction, Operation and Maintenance Specifications**

The Discharger shall at all times properly operate and maintain all facilities and systems installed or used to achieve compliance with this order.

5. **Other Special Provisions – Not Applicable**

6. **Compliance Schedules – Not Applicable**

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

VII. COMPLIANCE DETERMINATION

Compliance with the effluent limitations contained in section IV of this Order will be determined as specified below:

A. Single Constituent Effluent Limitation.

If the concentration of the pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reported Minimum Level (see Reporting Requirement I.G. of the MRP), then the Discharger is out of compliance.

B. Effluent Limitations Expressed as a Sum of Several Constituents.

If the sum of the individual pollutant concentrations is greater than the effluent limitation, then the Discharger is out of compliance. In calculating the sum of the concentrations of a group of pollutants, consider constituents reported as ND or DNQ to have concentrations equal to zero, provided that the applicable ML is used.

C. Effluent Limitations Expressed as a Median.

In determining compliance with a median limitation, the analytical results in a set of data will be arranged in order of magnitude (either increasing or decreasing order); and

1. If the number of measurements (n) is odd, then the median will be calculated as $X_{(n+1)/2}$, or
2. If the number of measurements (n) is even, then the median will be calculated as $[X_{n/2} + X_{(n/2)+1}]/2$, i.e. the midpoint between the $n/2$ and $n/2+1$ data points.

D. Multiple Sample Data.

When determining compliance with an AMEL or MDEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:

1. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
2. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.

E. Average Monthly (30-Day Average) Effluent Limitation (AMEL).

If the average (or when applicable, the median determined by subsection D above for multiple sample data) of daily discharges over a calendar month exceeds the AMEL for a given parameter, this will represent a single violation; though the Discharger will be considered out of compliance for each day of that month for that parameter (e.g., resulting in 31 days of non-compliance in a 31-day month). If only a single sample is taken during the calendar month and the analytical result for that sample exceeds the AMEL, the Discharger will be considered out of compliance for that calendar month. For anyone calendar month during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar month.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

In determining compliance with the AMEL, the following provisions shall also apply to all constituents:

1. If the analytical result of a single sample, monitored monthly, quarterly, semiannually, or annually, does not exceed the AMEL for that constituent, the Discharger has demonstrated compliance with the AMEL for that month;
2. If the analytical result of a single sample monitored monthly, quarterly, semiannually, or annually, exceeds the AMEL for any constituent, the Discharger shall collect four additional samples at approximately equal intervals during the month. All five analytical results shall be reported in the monitoring report for that month, or 45 days after results for the additional samples were received, whichever is later.

When all sample results are greater than or equal to the reported Minimum Level (see Reporting Requirement I.H. of the MRP), the numerical average of the analytical results of these five samples will be used for compliance determination.

When one or more sample results are reported as "Not-Detected (ND)" or "Detected, but Not Quantified (DNQ)" (see Reporting Requirement I.G. of the MRP), the median value of these four samples shall be used for compliance determination. If one or both of the middle values is ND or DNQ, the median shall be the lower of the two middle values.

3. In the event of noncompliance with an AMEL, the sampling frequency for that constituent shall be increased to weekly and shall continue at this level until compliance with the AMEL has been demonstrated.
4. If only one sample was obtained for the month or more than a monthly period and the result exceeds the AMEL; then the Discharger is in violation of the AMEL.

F. Maximum Daily Effluent Limitations (MDEL).

If a daily discharge exceeds the MDEL for a given parameter, an alleged violation will be flagged and the discharger will be considered out of compliance for that parameter for that 1 day only within the reporting period. For any 1 day during which no sample is taken, no compliance determination can be made for that day.

G. Instantaneous Minimum Effluent Limitation.

If the analytical result of a single grab sample is lower than the instantaneous minimum effluent limitation for a parameter, a violation will be flagged and the discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both are lower than the instantaneous minimum effluent limitation would result in two instances of non-compliance with the instantaneous minimum effluent limitation).

H. Instantaneous Maximum Effluent Limitation.

If the analytical result of a single grab sample is higher than the instantaneous maximum effluent limitation for a parameter, a violation will be flagged and the discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both exceed the instantaneous maximum effluent limitation would result in two instances of non-compliance with the instantaneous maximum effluent limitation.)

I. Median Monthly Effluent Limitation (MMEL)

If the median of daily discharges over a calendar month exceeds the MMEL for a given parameter, an alleged violation will be flagged and the Discharger will be considered out of compliance for each day of that month for that parameter (e.g., resulting in 31 days of

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

noncompliance in a 31-day month). However, an alleged violation of the MMEL will be considered one violation for the purpose of assessing State mandatory minimum penalties. If no sample (daily discharge) is taken over a calendar month, no compliance determination can be made for that month with respect to effluent violation determination, but compliance determination can be made for that month with respect to reporting violation determination.

J. Chronic Toxicity

The discharge is subject to determination of "Pass" or "Fail" and "Percent (%) Effect" from a single-effluent concentration chronic toxicity test at the discharge IWC using the Test of Significant Toxicity (TST) statistical approach described in *National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document* (EPA 833-R-10-003, 2010), Appendix A, Figure A-1, and Table A-1. The null hypothesis (H_0) for the TST statistical approach is: Mean discharge IWC response $\leq (0.75 \times \text{Mean control response})$. A test result that rejects this null hypothesis is reported as "Pass." A test result that does not reject this null hypothesis is reported as "Fail." The relative "Percent Effect" at the discharge IWC is defined and reported as $((\text{Mean control response} - \text{Mean discharge IWC response}) / \text{Mean control response}) \times 100\%$.

The Maximum Daily Effluent Limitation (MDEL) for chronic toxicity is exceeded and a violation will be flagged when a chronic toxicity test, analyzed using the TST statistical approach, results in "Fail" and the "Percent (%) Effect" is $\geq 50\%$.

K. Mass Concentration Limitations

Compliance with mass effluent limitations and concentration effluent limitations for the same parameter shall be determined separately. When the concentration for a parameter in a sample is reported as ND or DNQ, the corresponding mass emission rate determined using that sample concentration shall also be reported as ND or DNQ.

L. Bacterial Standards and Analyses

The geometric mean used for determining compliance with bacterial standards is calculated using the following equation:

$$\text{Geometric Mean} = (C_1 \times C_2 \times \dots \times C_n)^{1/n}$$

where n is the number of days samples were collected during the period and C is the concentration of bacteria (MPN/100 mL or CFU/100 mL) found on each day of sampling. For bacterial analyses, sample dilutions should be performed so the expected range of values is bracketed (for example, with multiple tube fermentation method or membrane filtration method, 2 to 16,000 per 100 ml for total and fecal coliform, at a minimum, and 1 to 1000 per 100 ml for *Enterococcus*). The detection method used for each analysis shall be reported with the results of the analysis.

Detection methods used for coliforms (total and fecal) and *Enterococcus* shall be those presented in Table 1A of 40 C.F.R. part 136 (revised May 18, 2012), unless alternate methods have been approved by U.S. EPA pursuant to 40 C.F.R. part 136 or improved methods have been determined by the Executive Officer and/or U.S. EPA.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT A – DEFINITIONS

Arithmetic Mean ()

Also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

Arithmetic mean = $\Sigma x / n$ where: Σx is the sum of the measured ambient water concentrations, and n is the number of samples.

Average Monthly (30-Day Average) Effluent Limitation (AMEL)

The highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

Average Weekly Effluent Limitation (AWEL)

The highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

Bioaccumulative

Those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

Carcinogenic

Pollutants are substances that are known to cause cancer in living organisms.

Coefficient of Variation (CV)

CV is a measure of the data variability and is calculated as the estimated standard deviation divided by the arithmetic mean of the observed values.

Daily Discharge

Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of one day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

For composite sampling, if 1 day is defined as a 24-hour period other than a calendar day, the analytical result for the 24-hour period will be considered as the result for the calendar day in which the 24-hour period ends.

Detected, but Not Quantified (DNQ)

DNQ are those sample results less than the RL, but greater than or equal to the laboratory's MDL. Sample results reported as DNQ are estimated concentrations.

Dilution Credit

Dilution Credit is the amount of dilution granted to a discharge in the calculation of a water quality-based effluent limitation, based on the allowance of a specified mixing zone. It is calculated from the

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

dilution ratio or determined through conducting a mixing zone study or modeling of the discharge and receiving water.

Effluent Concentration Allowance (ECA)

ECA is a value derived from the water quality criterion/objective, dilution credit, and ambient background concentration that is used, in conjunction with the coefficient of variation for the effluent monitoring data, to calculate a long-term average (LTA) discharge concentration. The ECA has the same meaning as waste load allocation (WLA) as used in U.S. EPA guidance (Technical Support Document For Water Quality-based Toxics Control, March 1991, second printing, EPA/505/2-90-001).

Enclosed Bays

Enclosed Bays means indentations along the coast that enclose an area of oceanic water within distinct headlands or harbor works. Enclosed bays include all bays where the narrowest distance between the headlands or outermost harbor works is less than 75 percent of the greatest dimension of the enclosed portion of the bay. Enclosed bays include, but are not limited to, Humboldt Bay, Bodega Harbor, Tomales Bay, Drake's Estero, San Francisco Bay, Morro Bay, Los Angeles-Long Beach Harbor, Upper and Lower Newport Bay, Mission Bay, and San Diego Bay. Enclosed bays do not include inland surface waters or ocean waters.

Estimated Chemical Concentration

The estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

Estuaries

Estuaries means waters, including coastal lagoons, located at the mouths of streams that serve as areas of mixing for fresh and ocean waters. Coastal lagoons and mouths of streams that are temporarily separated from the ocean by sandbars shall be considered estuaries. Estuarine waters shall be considered to extend from a bay or the open ocean to a point upstream where there is no significant mixing of fresh water and seawater. Estuarine waters included, but are not limited to, the Sacramento-San Joaquin Delta, as defined in Water Code section 12220, Suisun Bay, Carquinez Strait downstream to the Carquinez Bridge, and appropriate areas of the Smith, Mad, Eel, Noyo, Russian, Klamath, San Diego, and Otay rivers. Estuaries do not include inland surface waters or ocean waters.

Existing Discharger

Any Discharger that is not a new discharger. An existing discharger includes an "increasing discharger" (i.e., any existing facility with treatment systems in places for its current discharge that is or will be expanding, upgrading, or modifying its permitted discharge after the effective date of this Order.)

Infeasible

Not capable of being accomplished in a successful manner within a reasonable period of time, taking into account economic, environmental, legal, social, and technological factors.

Inland Surface Waters

All surface waters of the state that do not include the ocean, enclosed bays, or estuaries.

Instantaneous Maximum Effluent Limitation

The highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

Instantaneous Minimum Effluent Limitation

The lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Maximum Daily Effluent Limitation (MDEL)

The highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

Median

The middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of measurements (n) is odd, then the median = $X_{(n+1)/2}$. If n is even, then the median = $(X_{n/2} + X_{(n/2)+1})/2$ (i.e., the midpoint between the n/2 and n/2+1).

Method Detection Limit (MDL)

MDL is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero, as defined in 40 C.F.R. part 136, Attachment B, revised as of July 3, 1999.

Minimum Level (ML)

ML is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

Mixing Zone

Mixing Zone is a limited volume of receiving water that is allocated for mixing with a wastewater discharge where water quality criteria can be exceeded without causing adverse effects to the overall water body.

Not Detected (ND)

Sample results which are less than the laboratory's MDL.

Persistent Pollutants

Persistent pollutants are substances for which degradation or decomposition in the environment is nonexistent or very slow.

Pollutant Minimization Program (PMP)

PMP means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Regional Water Board may consider cost effectiveness when establishing the requirements of a PMP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to Water Code section 13263.3(d), shall be considered to fulfill the PMP requirements.

Pollution Prevention

Pollution Prevention means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

defined in Water Code section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the State Water Resources Control Board (State Water Board) or Regional Water Board.

Reporting Level (RL)

The RL is the ML (and its associated analytical method) chosen by the Discharger for reporting and compliance determination from the MLs included in this Order, including an additional factor if applicable as discussed herein. The MLs included in this Order correspond to approved analytical methods for reporting a sample result that are selected by the Regional Water Board either from Appendix 4 of the SIP in accordance with section 2.4.2 of the SIP or established in accordance with section 2.4.3 of the SIP. The ML is based on the proper application of method-based analytical procedures for sample preparation and the absence of any matrix interferences. Other factors may be applied to the ML depending on the specific sample preparation steps employed. For example, the treatment typically applied in cases where there are matrix-effects is to dilute the sample or sample aliquot by a factor of ten. In such cases, this additional factor must be applied to the ML in the computation of the RL.

Significant Storm Event

A continuous discharge of storm water for a minimum of one hour, or the intermittent discharge of storm water for a minimum of 3 hours in a 12-hour period.

Source of Drinking Water

Any water designated as municipal or domestic supply (MUN) in a Regional Water Board Basin Plan.

Standard Deviation (Σ)

Standard Deviation is a measure of variability that is calculated as follows:

$$\Sigma = (\Sigma[(x - \bar{x})^2]/(n - 1))^{0.5}$$

where:
x is the observed value;
 \bar{x} is the arithmetic mean of the observed values; and
n is the number of samples.

Toxicity Reduction Evaluation (TRE)

TRE is a study conducted in a step-wise process designed to identify the causative agents of effluent or ambient toxicity, isolate the sources of toxicity, evaluate the effectiveness of toxicity control options, and then confirm the reduction in toxicity. The first steps of the TRE consist of the collection of data relevant to the toxicity, including additional toxicity testing, and an evaluation of facility operations and maintenance practices, and best management practices. A Toxicity Identification Evaluation (TIE) may be required as part of the TRE, if appropriate. (A TIE is a set of procedures to identify the specific chemical(s) responsible for toxicity. These procedures are performed in three phases (characterization, identification, and confirmation) using aquatic organism toxicity tests.)

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ACRONYMS AND ABBREVIATIONS

AMEL.....	Average Monthly (30-Day Average) Effluent Limitation
B.....	Background Concentration
BAT	Best Available Technology Economically Achievable
Basin Plan	Water Quality Control Plan for the Coastal Watersheds of Los Angeles and Ventura Counties
BCT	Best Conventional Pollutant Control Technology
BMP.....	Best Management Practices
BMPP	Best Management Practices Plan
BPJ	Best Professional Judgment
BOD.....	Biochemical Oxygen Demand 5-day @ 20 °C
BPT	Best Practicable Treatment Control Technology
C.....	Water Quality Objective
CCR	California Code of Regulations
CEQA	California Environmental Quality Act
C.F.R.....	Code of Federal Regulations
CTR.....	California Toxics Rule
CV	Coefficient of Variation
CWA.....	Clean Water Act
CWC	California Water Code
Discharger	Polynt Composite USA, Inc.
DMR	Discharge Monitoring Report
DNQ	Detected But Not Quantified
ELAP	State Water Resources Control Board, Drinking Water Division, Environmental Laboratory Accreditation Program
ELG	Effluent Limitations, Guidelines and Standards
Facility	Lynwood Facility
g/kg.....	grams per kilogram
gpd	gallons per day
IC.....	Inhibition Coefficient
IC ₁₅	Concentration at which the organism is 15% inhibited
IC ₂₅	Concentration at which the organism is 25% inhibited
IC ₄₀	Concentration at which the organism is 40% inhibited
IC ₅₀	Concentration at which the organism is 50% inhibited
LA.....	Load Allocations
LOEC.....	Lowest Observed Effect Concentration
µg/L	micrograms per Liter
LACDPW	County of Los Angeles, Department of Public Works
mg/L	milligrams per Liter
MDEL	Maximum Daily Effluent Limitation
MEC	Maximum Effluent Concentration
MGD	Million Gallons per Day
ML	Minimum Level
MRP	Monitoring and Reporting Program
ND	Not Detected
ng/L	nanograms per liter
NOEC.....	No Observable Effect Concentration
NPDES	National Pollutant Discharge Elimination System
NSPS.....	New Source Performance Standards

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**



NTR	National Toxics Rule
OAL	Office of Administrative Law
PAHs	Polynuclear Aromatic Hydrocarbons
pg/L	picograms per liter
PMEL.....	Proposed Maximum Daily Effluent Limitation
PMP.....	Pollutant Minimization Plan
POTW.....	Publicly Owned Treatment Works
ppm	parts per million
ppb	parts per billion
QA	Quality Assurance
QA/QC.....	Quality Assurance/Quality Control
Ocean Plan.....	Water Quality Control Plan for Ocean Waters of California
Regional Water Board.....	California Regional Water Quality Control Board, Los Angeles Region
RPA.....	Reasonable Potential Analysis
SCP	Spill Contingency Plan
Sediment Quality Plan	<i>Water Quality Control Plan for Enclosed Bays and Estuaries – Part 1 Sediment Quality</i>
SIP.....	State Implementation Policy (Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California)
SMR	Self-Monitoring Reports
State Water Board	California State Water Resources Control Board
SWPPP	Storm Water Pollution Prevention Plan
TAC	Test Acceptability Criteria
TBEL	Technology-Based Effluent Limitation
Thermal Plan	Water Quality Control Plan for Control of Temperature in the Coastal and Interstate Water and Enclosed Bays and Estuaries of California
TIE.....	Toxicity Identification Evaluation
TMDL.....	Total Maximum Daily Load
TOC.....	Total Organic Carbon
TRE	Toxicity Reduction Evaluation
TSD	Technical Support Document
TSS	Total Suspended Solid
TST.....	Test of Significant Toxicity
TU _c	Chronic Toxicity Unit
U.S. EPA	United States Environmental Protection Agency
WDR.....	Waste Discharge Requirements
WET	Whole Effluent Toxicity
WLA.....	Waste Load Allocations
WQBELs.....	Water Quality-Based Effluent Limitations
WQS.....	Water Quality Standards
%	Percent

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT B – MAP

**POLYNT COMPOSITES
USA INC.**

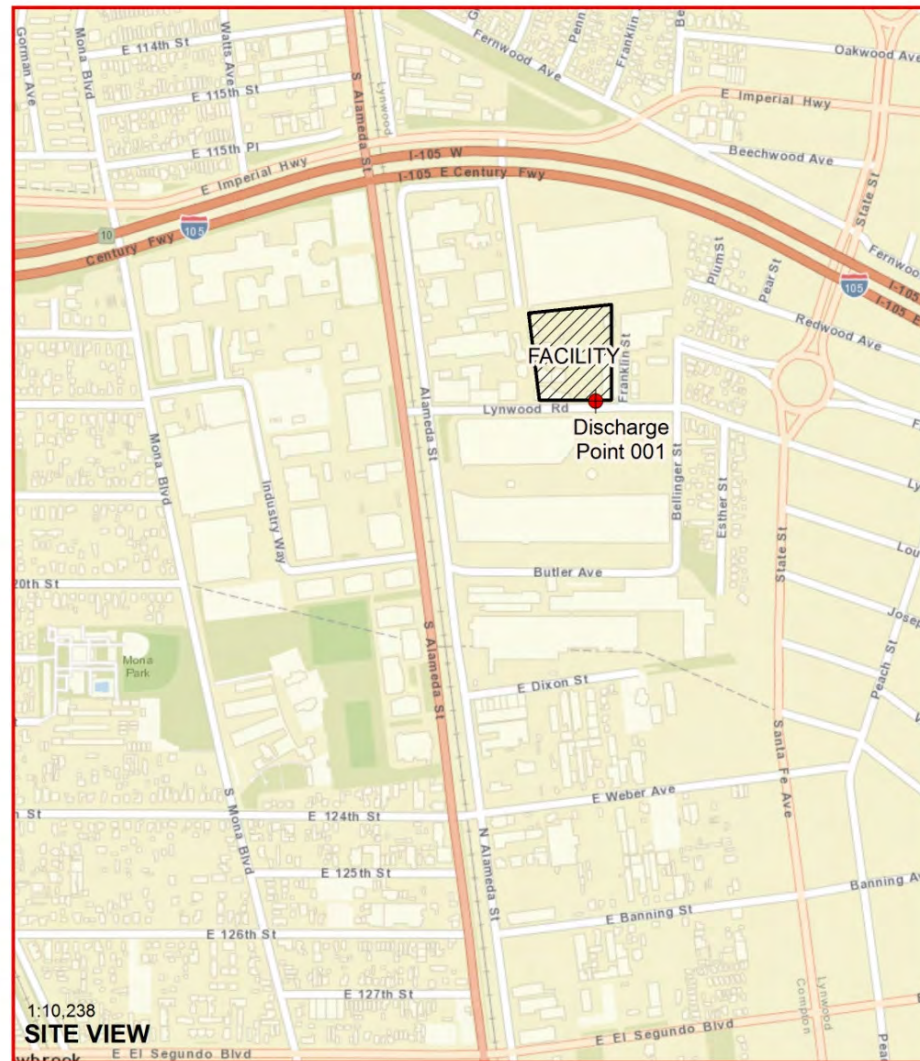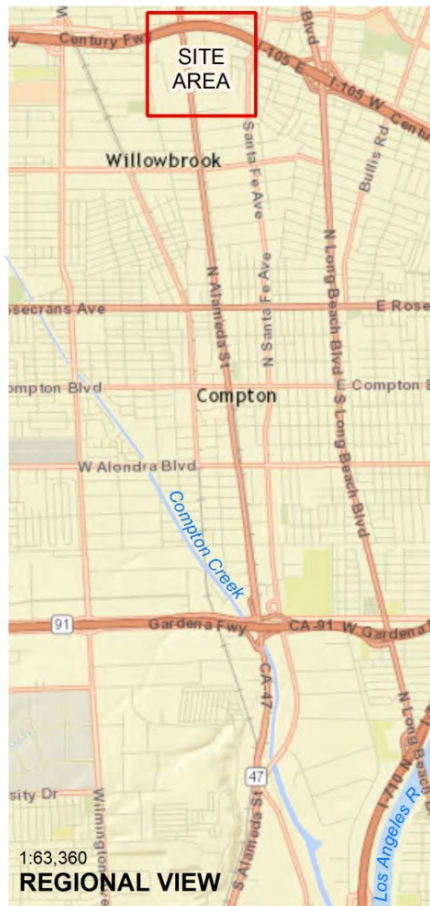


**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT C-1 – FLOW SCHEMATIC


POLYNT COMPOSITE USA, INC. (FORMERLY PCCR USA, INC.)
3/17/2015

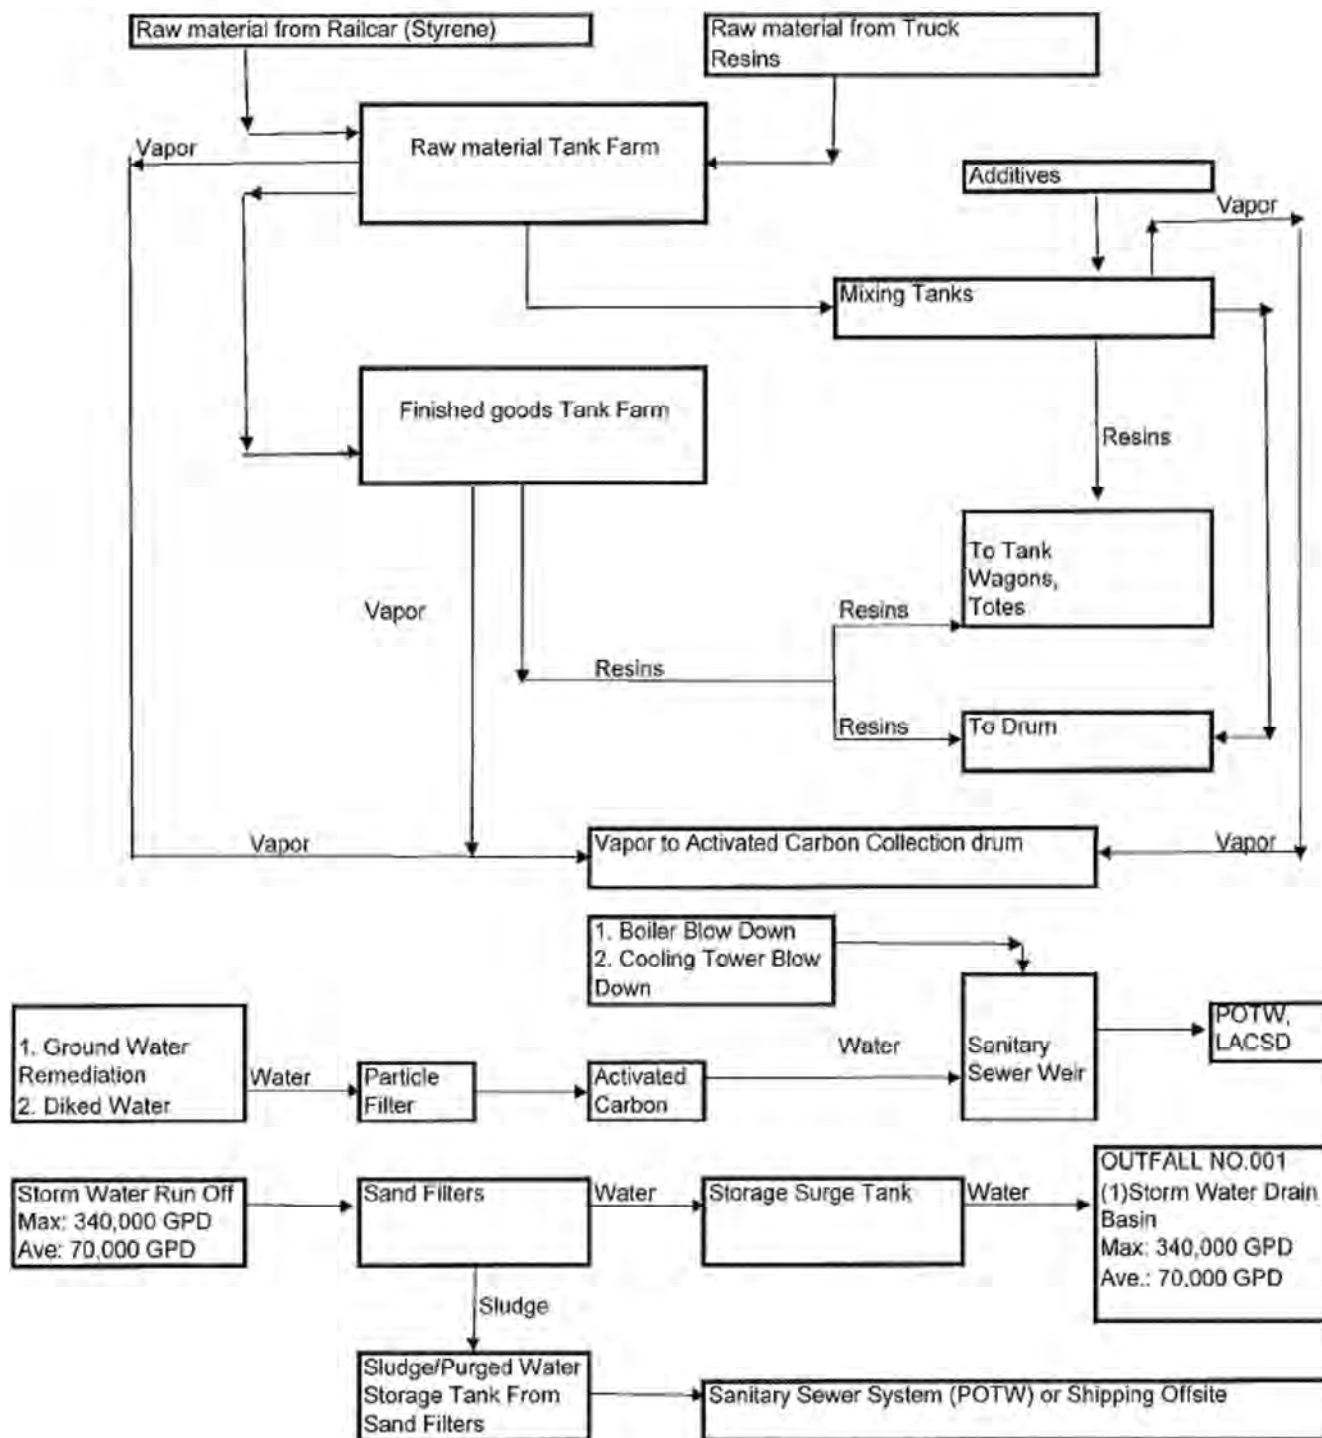

Notes: (1): Only storm water runoff from the site is discharged to Discharge Point 001. The average discharge rate is about 70,000 GPD (during storm event days) and the maximum discharge rate is about 340,000 GPD (during storm event days). All other waste waters, i.e. Groundwater remediation, cooling tower blowdown, boiler blowdown, diked water are discharged to Los Angeles County Sanitary Sewer System (POTW)

REVISED TENTATIVE

ATTACHMENT C-2 – SITE DRAINAGE MAP (LYNWOD FACILITY)

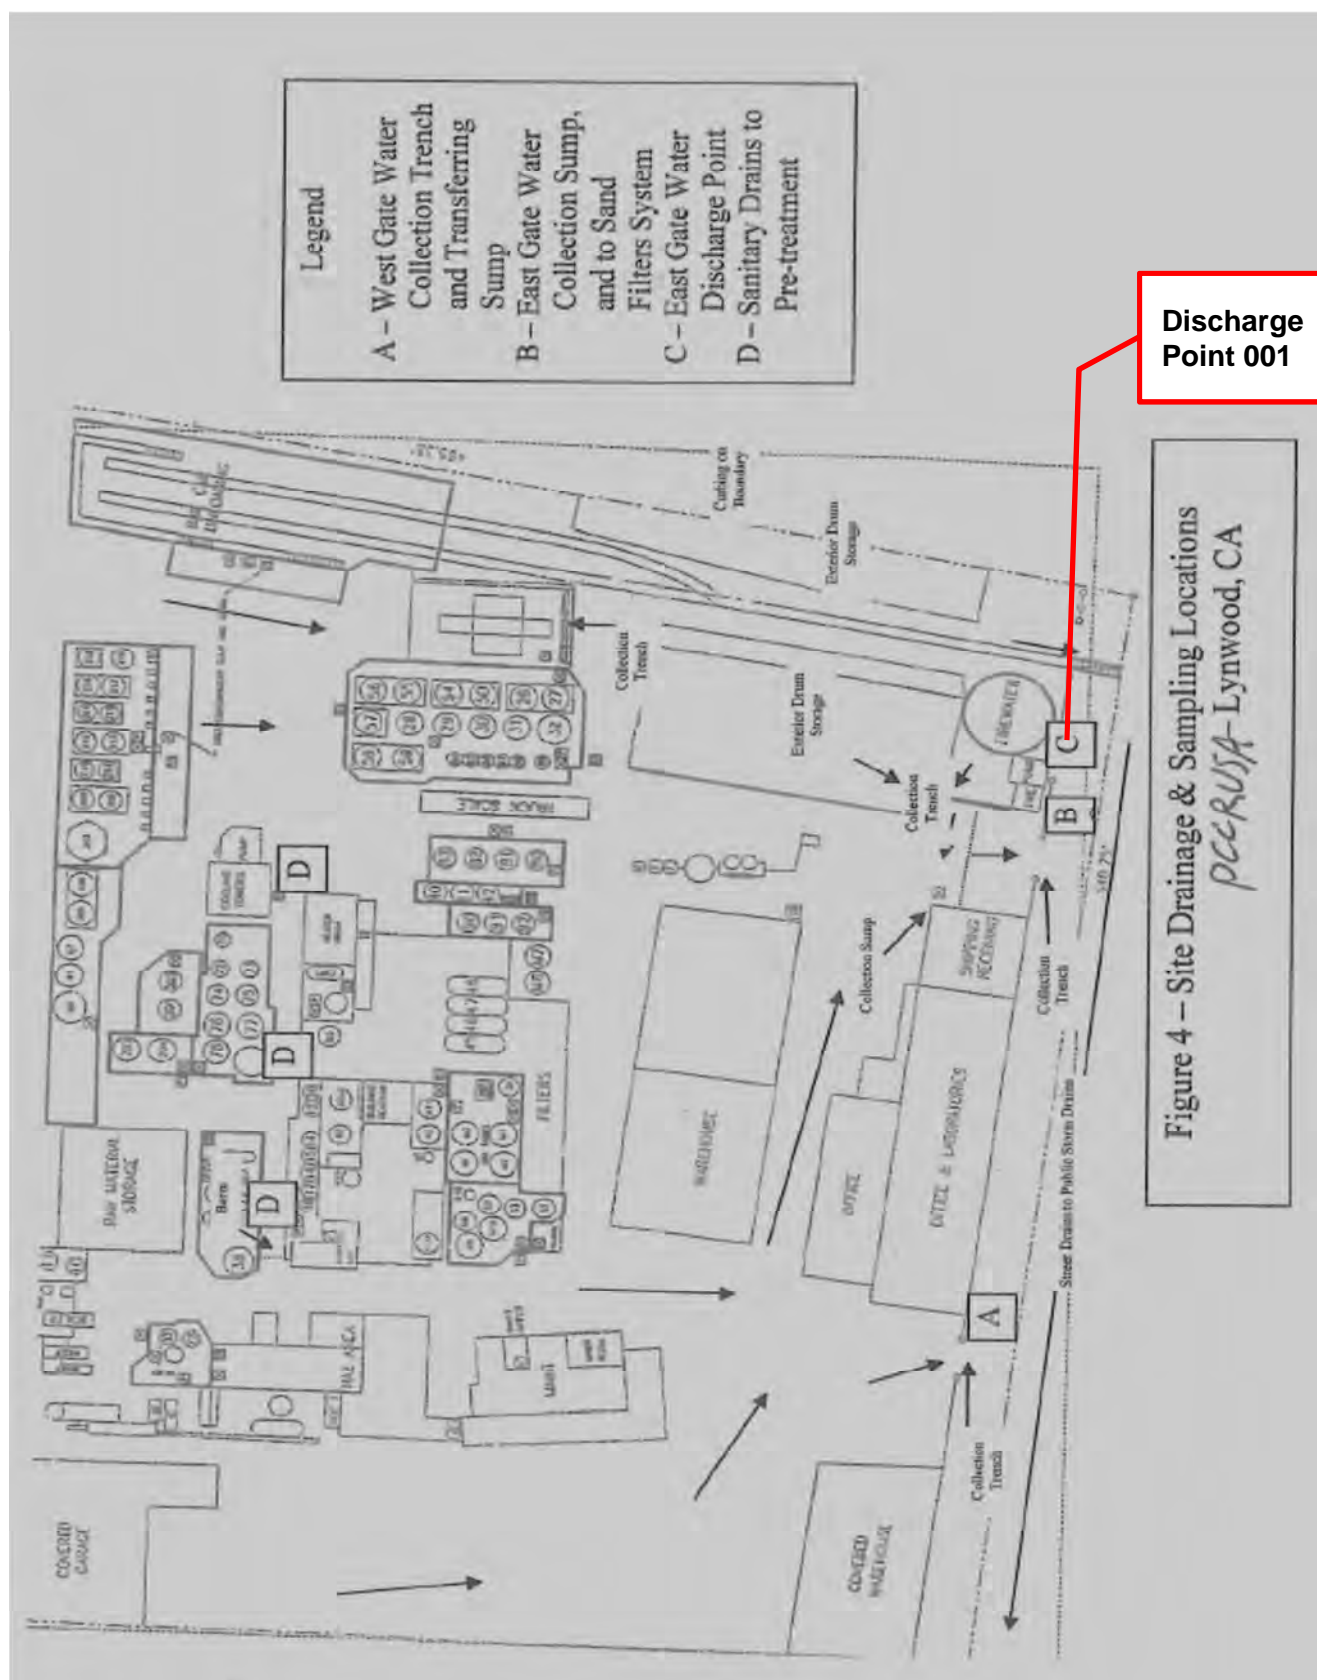

REVISED TENTATIVE

ATTACHMENT D – STANDARD PROVISIONS

I. STANDARD PROVISIONS – PERMIT COMPLIANCE

A. Duty to Comply

1. The Discharger must comply with all of the terms, requirements, and conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code and is grounds for enforcement action; permit termination, revocation and reissuance, or modification; denial of a permit renewal application; or a combination thereof. (40 C.F.R. § 122.41(a); Wat. Code, §§ 13261, 13263, 13265, 13268, 13000, 13001, 13304, 13350, 13385.)
2. The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants and with standards for sewage sludge use or disposal established under Section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement. (40 C.F.R. § 122.41(a)(1).)

B. Need to Halt or Reduce Activity Not a Defense

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order. (40 C.F.R. § 122.41(c).)

C. Duty to Mitigate

The Discharger shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment. (40 C.F.R. § 122.41(d).)

D. Proper Operation and Maintenance

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order. (40 C.F.R. § 122.41(e).)

E. Property Rights

1. This Order does not convey any property rights of any sort or any exclusive privileges. (40 C.F.R. § 122.41(g).)
2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of state or local law or regulations. (40 C.F.R. § 122.5(c).)

F. Inspection and Entry

The Discharger shall allow the Regional Water Board, State Water Board, U.S. EPA, and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to (33 U.S.C. § 1318(a)(4)(B); 40 C.F.R. § 122.41(i); Wat. Code, §§ 13267, 13383):

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order (33 U.S.C. § 1318(a)(4)(B)(i); 40 C.F.R. § 122.41(i)(1); Wat. Code, §§ 13267, 13383);
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order (33 U.S.C. § 1318(a)(4)(B)(ii); 40 C.F.R. § 122.41(i)(2); Wat. Code, §§ 13267, 13383);
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order (33 U.S.C. § 1318(a)(4)(B)(ii); 40 C.F.R. § 122.41(i)(3); Wat. Code, §§ 13267, 13383); and
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the Water Code, any substances or parameters at any location. (33 U.S.C. § 1318(a)(4)(B); 40 C.F.R. § 122.41(i)(4); Wat. Code, §§ 13267, 13383.)

G. Bypass

1. Definitions
 - a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility. (40 C.F.R. § 122.41(m)(1)(i).)
 - b. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production. (40 C.F.R. § 122.41(m)(1)(ii).)
2. Bypass not exceeding limitations. The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3, I.G.4, and I.G.5 below. (40 C.F.R. § 122.41(m)(2).)
3. Prohibition of bypass. Bypass is prohibited, and the Regional Water Board may take enforcement action against a Discharger for bypass, unless (40 C.F.R. § 122.41(m)(4)(i)):
 - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage (40 C.F.R. § 122.41(m)(4)(i)(A));
 - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance (40 C.F.R. § 122.41(m)(4)(i)(B)); and
 - c. The Discharger submitted notice to the Regional Water Board as required under Standard Provisions – Permit Compliance I.G.5 below. (40 C.F.R. § 122.41(m)(4)(i)(C).)
4. The Regional Water Board may approve an anticipated bypass, after considering its adverse effects, if the Regional Water Board determines that it will meet the three conditions listed in Standard Provisions – Permit Compliance I.G.3 above. (40 C.F.R. § 122.41(m)(4)(ii).)

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

5. Notice

- a. Anticipated bypass. If the Discharger knows in advance of the need for a bypass, it shall submit a notice, if possible at least 10 days before the date of the bypass. (40 C.F.R. § 122.41(m)(3)(i).)
- b. Unanticipated bypass. The Discharger shall submit notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below (24-hour notice). (40 C.F.R. § 122.41(m)(3)(ii).)

H. Upset

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the Discharger. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation. (40 C.F.R. § 122.41(n)(1).)

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of Standard Provisions – Permit Compliance I.H.2 below are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review. (40 C.F.R. § 122.41(n)(2).)
2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that (40 C.F.R. § 122.41(n)(3)):
 - a. An upset occurred and that the Discharger can identify the cause(s) of the upset (40 C.F.R. § 122.41(n)(3)(i));
 - b. The permitted facility was, at the time, being properly operated (40 C.F.R. § 122.41(n)(3)(ii));
 - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b below (24-hour notice) (40 C.F.R. § 122.41(n)(3)(iii)); and
 - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above. (40 C.F.R. § 122.41(n)(3)(iv).)
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof. (40 C.F.R. § 122.41(n)(4).)

II. STANDARD PROVISIONS – PERMIT ACTION

A. General

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition. (40 C.F.R. § 122.41(f).)

B. Duty to Reapply

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit. (40 C.F.R. § 122.41(b).)

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

C. Transfers

This Order is not transferable to any person except after notice to the Regional Water Board. The Regional Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the Water Code. (40 C.F.R. §§ 122.41(l)(3), 122.61.)

III. STANDARD PROVISIONS – MONITORING

- A.** Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity. (40 C.F.R. § 122.41(j)(1).)
- B.** Monitoring results must be conducted according to test procedures approved under 40 C.F.R. part 136 for the analyses of pollutants unless another method is required under 40 C.F.R. subchapters N or O. In the case of pollutants for which there are no approved methods under 40 C.F.R. part 136 or otherwise required under 40 C.F.R. subchapters N or O, monitoring must be conducted according to a test procedure specified in this Order for such pollutants. (40 C.F.R. §§ 122.41(j)(4), 122.44(i)(1)(iv).)

IV. STANDARD PROVISIONS – RECORDS

- A.** Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 C.F.R. part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Regional Water Board Executive Officer at any time. (40 C.F.R. § 122.41(j)(2).)
- B.** Records of monitoring information shall include:
 - 1. The date, exact place, and time of sampling or measurements (40 C.F.R. § 122.41(j)(3)(i));
 - 2. The individual(s) who performed the sampling or measurements (40 C.F.R. § 122.41(j)(3)(ii));
 - 3. The date(s) analyses were performed (40 C.F.R. § 122.41(j)(3)(iii));
 - 4. The individual(s) who performed the analyses (40 C.F.R. § 122.41(j)(3)(iv));
 - 5. The analytical techniques or methods used (40 C.F.R. § 122.41(j)(3)(v)); and
 - 6. The results of such analyses. (40 C.F.R. § 122.41(j)(3)(vi).)
- C.** Claims of confidentiality for the following information will be denied (40 C.F.R. § 122.7(b)):
 - 1. The name and address of any permit applicant or Discharger (40 C.F.R. § 122.7(b)(1)); and
 - 2. Permit applications and attachments, permits and effluent data. (40 C.F.R. § 122.7(b)(2).)

V. STANDARD PROVISIONS – REPORTING

A. Duty to Provide Information

The Discharger shall furnish to the Regional Water Board, State Water Board, or U.S. EPA within a reasonable time, any information which the Regional Water Board, State Water

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

Board, or U.S. EPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Regional Water Board, State Water Board, or U.S. EPA copies of records required to be kept by this Order. (40 C.F.R. § 122.41(h); Wat. Code, §§ 13267, 13383.)

B. Signatory and Certification Requirements

1. All applications, reports, or information submitted to the Regional Water Board, State Water Board, and/or U.S. EPA shall be signed and certified in accordance with Standard Provisions – Reporting V.B.2, V.B.3, V.B.4, and V.B.5 below. (40 C.F.R. § 122.41(k).)
2. All permit applications shall be signed by a responsible corporate officer. For the purpose of this section, a responsible corporate officer means: (i) A president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy- or decision-making functions for the corporation, or (ii) the manager of one or more manufacturing, production, or operating facilities, provided, the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental laws and regulations; the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. (40 C.F.R. § 122.22(a)(1).)
3. All reports required by this Order and other information requested by the Regional Water Board, State Water Board, or U.S. EPA shall be signed by a person described in Standard Provisions – Reporting V.B.2 above, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by a person described in Standard Provisions – Reporting V.B.2 above (40 C.F.R. § 122.22(b)(1));
 - b. The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.) (40 C.F.R. § 122.22(b)(2)); and
 - c. The written authorization is submitted to the Regional Water Board and State Water Board. (40 C.F.R. § 122.22(b)(3).)
4. If an authorization under Standard Provisions – Reporting V.B.3 above is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Standard Provisions – Reporting V.B.3 above must be submitted to the Regional Water Board and State Water Board prior to or together with any reports, information, or applications, to be signed by an authorized representative. (40 C.F.R. § 122.22(c).)
5. Any person signing a document under Standard Provisions – Reporting V.B.2 or V.B.3 above shall make the following certification:

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations." (40 C.F.R. § 122.22(d).)

C. Monitoring Reports

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program (Attachment E) in this Order. (40 C.F.R. § 122.41(l)(4).)
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Regional Water Board or State Water Board for reporting results of monitoring of sludge use or disposal practices. (40 C.F.R. § 122.41(l)(4)(i).)
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under 40 C.F.R. part 136, or another method required for an industry-specific waste stream under 40 C.F.R. subchapters N or O, the results of such monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Regional Water Board. (40 C.F.R. § 122.41(l)(4)(ii).)
4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order. (40 C.F.R. § 122.41(l)(4)(iii).)

D. Compliance Schedules

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date. (40 C.F.R. § 122.41(l)(5).)

E. Twenty-Four Hour Reporting

1. The Discharger shall report any noncompliance that may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the Discharger becomes aware of the circumstances. A written submission shall also be provided within five (5) days of the time the Discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance. (40 C.F.R. § 122.41(l)(6)(i).)
2. The following shall be included as information that must be reported within 24 hours under this paragraph (40 C.F.R. § 122.41(l)(6)(ii)):
 - a. Any unanticipated bypass that exceeds any effluent limitation in this Order. (40 C.F.R. § 122.41(l)(6)(ii)(A).)
 - b. Any upset that exceeds any effluent limitation in this Order. (40 C.F.R. § 122.41(l)(6)(ii)(B).)
3. The Regional Water Board may waive the above-required written report under this provision on a case-by-case basis if an oral report has been received within 24 hours. (40 C.F.R. § 122.41(l)(6)(iii).)

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

F. Planned Changes

The Discharger shall give notice to the Regional Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when (40 C.F.R. § 122.41(l)(1)):

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in section 122.29(b) (40 C.F.R. § 122.41(l)(1)(i)); or
2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are subject neither to effluent limitations in this Order nor to notification requirements under section 122.42(a)(1) (see Additional Provisions—Notification Levels VII.A.1). (40 C.F.R. § 122.41(l)(1)(ii).)
3. The alteration or addition results in a significant change in the Discharger's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan. (40 C.F.R. § 122.41(l)(1)(iii).)

G. Anticipated Noncompliance

The Discharger shall give advance notice to the Regional Water Board or State Water Board of any planned changes in the permitted facility or activity that may result in noncompliance with this Order's requirements. (40 C.F.R. § 122.41(l)(2).)

H. Other Noncompliance

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting V.C, V.D, and V.E above at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E above. (40 C.F.R. § 122.41(l)(7).)

I. Other Information

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Regional Water Board, State Water Board, or U.S. EPA, the Discharger shall promptly submit such facts or information. (40 C.F.R. § 122.41(l)(8).)

VI. STANDARD PROVISIONS – ENFORCEMENT

- A.** The Regional Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13268, 13385, 13386, and 13387.
- B.** The CWA provides that any person who violates section 301, 302, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any such sections in a permit issued under section 402, or any requirement imposed in a pretreatment program approved under sections 402(a)(3) or 402(b)(8) of the Act, is subject to a civil penalty not to exceed \$25,000 per day for each violation. The CWA provides that any person who negligently violates sections 301, 302, 306, 307, 308, 318, or 405 of the Act, or any condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, or any requirement imposed in a pretreatment program approved under section 402(a)(3) or 402(b)(8) of the Act, is subject to criminal penalties of \$2,500 to \$25,000 per day of violation, or imprisonment of not more than one (1) year, or both. In the case of a second or

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation, or by imprisonment of not more than two (2) years, or both. Any person who knowingly violates such sections, or such conditions or limitations is subject to criminal penalties of \$5,000 to \$50,000 per day of violation, or imprisonment for not more than three (3) years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than six (6) years, or both. Any person who knowingly violates section 301, 302, 303, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine of not more than \$250,000 or imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the CWA, shall, upon conviction of violating the imminent danger provision, be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions [section 122.41(a)(2)] [Water Code sections 13385 and 13387].

- C. Any person may be assessed an administrative penalty by the Regional Water Board for violating section 301, 302, 306, 307, 308, 318 or 405 of this Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of this Act. Administrative penalties for Class I violations are not to exceed \$10,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$25,000. Penalties for Class II violations are not to exceed \$10,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$125,000 [40 C.F.R. section 122.41(a)(3)].
- D. The CWA provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this Order shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than 2 years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than 4 years, or both [40 C.F.R. section 122.41(j)(5)].
- E. The CWA provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this Order, including monitoring reports or reports of compliance or noncompliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six months per violation, or by both [40 C.F.R. section 122.41(k)(2)].

VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS

A. Non-Municipal Facilities

Existing manufacturing, commercial, mining, and silvicultural Dischargers shall notify the Regional Water Board as soon as they know or have reason to believe (40 C.F.R. § 122.42(a)):

1. That any activity has occurred or will occur that would result in the discharge, on a routine or frequent basis, of any toxic pollutant that is not limited in this Order, if that discharge will exceed the highest of the following "notification levels" (40 C.F.R. § 122.42(a)(1)):

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

- a. 100 micrograms per liter ($\mu\text{g/L}$) (40 C.F.R. § 122.42(a)(1)(i));
 - b. 200 $\mu\text{g/L}$ for acrolein and acrylonitrile; 500 $\mu\text{g/L}$ for 2,4-dinitrophenol and 2-methyl-4,6-dinitrophenol; and 1 milligram per liter (mg/L) for antimony (40 C.F.R. § 122.42(a)(1)(ii));
 - c. Five (5) times the maximum concentration value reported for that pollutant in the Report of Waste Discharge (40 C.F.R. § 122.42(a)(1)(iii)); or
 - d. The level established by the Regional Water Board in accordance with section 122.44(f). (40 C.F.R. § 122.42(a)(1)(iv).)
2. That any activity has occurred or will occur that would result in the discharge, on a non-routine or infrequent basis, of any toxic pollutant that is not limited in this Order, if that discharge will exceed the highest of the following "notification levels" (40 C.F.R. § 122.42(a)(2)):
- a. 500 micrograms per liter ($\mu\text{g/L}$) (40 C.F.R. § 122.42(a)(2)(i));
 - b. 1 milligram per liter (mg/L) for antimony (40 C.F.R. § 122.42(a)(2)(ii));
 - c. Ten (10) times the maximum concentration value reported for that pollutant in the Report of Waste Discharge (40 C.F.R. § 122.42(a)(2)(iii)); or
 - d. The level established by the Regional Water Board in accordance with section 122.44(f). (40 C.F.R. § 122.42(a)(2)(iv).)

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP NO. 7655)

CONTENTS

I.	General Monitoring Provisions	E-2
II.	Monitoring Locations	E-5
III.	Influent Monitoring Requirements – Not Applicable	E-5
IV.	Effluent Monitoring Requirements	E-5
	A. Monitoring Location EFF-001	E-5
V.	Whole Effluent Toxicity Testing Requirements	E-7
VI.	Land Discharge Monitoring Requirements – Not Applicable	E-11
VII.	Recycling Monitoring Requirements – Not Applicable	E-11
VIII.	Receiving Water Monitoring Requirements	E-11
	A. Monitoring Location RSW-001	E-11
	B. Monitoring Location RSW-002	E-13
IX.	Other Monitoring Requirements	E-13
X.	Reporting Requirements	E-13
	A. General Monitoring and Reporting Requirements	E-13
	B. Self-Monitoring Reports (SMRs)	E-14
	C. Discharge Monitoring Reports (DMR's) – Not Applicable	E-15
	D. Other Reports	E-16

TABLES

Table E-1.	Monitoring Station Locations	E-5
Table E-2.	Effluent Monitoring at Monitoring Location EFF-001	E-5
Table E-3.	Receiving Water Monitoring Requirements at RSW-001.....	E-11
Table E-4.	Monitoring Periods and Reporting Schedule.....	E-14

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP CI-7655)

Section 308 of the federal Clean Water Act (CWA) and sections 122.41(h), (j)-(l), 122.44(i), and 122.48 of title 40 of the Code of Federal Regulations (40 C.F.R.) require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Regional Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. This MRP establishes monitoring, reporting, and recordkeeping requirements that implement the federal and California laws and/or regulations.

I. GENERAL MONITORING PROVISIONS

- A. An effluent sampling station shall be established for Discharge Point 001 and shall be located where representative samples of that effluent can be obtained.
- B. Laboratory Certification. Laboratories analyzing monitoring samples shall be certified by the State Water Board, Drinking Water Division, Environmental Laboratory Accreditation Program (ELAP) in accordance with the provision of Water Code section 13176, and must include quality assurance/quality control data with their reports. A copy of the laboratory certification shall be provided each time a new certification and/or renewal of the certification is obtained from ELAP.
- C. Effluent samples shall be taken downstream of any additions to treatment works and prior to mixing with the receiving waters.
- D. The Regional Water Board shall be notified in writing of any change in the sampling stations once established or in the methods for determining the quantities of pollutants in the individual waste streams.
- E. Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. sections 136.3, 136.4, and 136.5 (revised August 19, 2014); or, where no methods are specified for a given pollutant, by methods approved by this Regional Water Board or the State Water Board.
- F. For any analyses performed for which no procedure is specified in the U.S. EPA guidelines or in the MRP, the constituent or parameter analyzed and the method or procedure used must be specified in the monitoring report.
- G. Each monitoring report must affirm in writing that “all analyses were conducted at a laboratory certified for such analyses by the State Water Board or approved by the Executive Officer and in accordance with current U.S. EPA guideline procedures or as specified in this MRP”.
- H. The monitoring reports shall specify the analytical method used, the Method Detection Limit (MDL), and the Minimum Level (ML) for each pollutant. For the purpose of reporting compliance with numerical limitations, performance goals, and receiving water limitations, analytical data shall be reported by one of the following methods, as appropriate:
 - 1. An actual numerical value for sample results greater than or equal to the ML; or
 - 2. “Detected, but Not Quantified (DNQ)” if results are greater than or equal to the laboratory’s MDL but less than the ML; or,
 - 3. “Not-Detected (ND)” for sample results less than the laboratory’s MDL with the MDL indicated for the analytical method used.

Analytical data reported as “less than” for the purpose of reporting compliance with permit limitations shall be the same or lower than the permit limit(s) established for the given parameter.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Current MLs (Attachment H) are those published by the State Water Board in the Policy for the Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California, February 24, 2005.

- I. Where possible, the MLs employed for effluent analyses to determine compliance with effluent limitations shall be lower than the effluent limitations established in this Order for a given parameter. If the ML value is not below the effluent limitations, then the lowest ML value and its associated analytical method shall be selected for compliance purposes. At least once a year, the Discharger shall submit a list of the analytical methods employed for each test and associated laboratory QA/QC procedures.
- J. Where possible, the MLs employed for effluent analyses not associated with determining compliance with effluent limitations in this Order shall be lower than the lowest applicable water quality objective, for a given parameter. Water quality objectives for parameters may be found in Chapter 3 of the Basin Plan and the CTR (40 C.F.R. section 131.38). If the ML value is not below the water quality objective, then the lowest ML value and its associated analytical method shall be selected for compliance purposes. At least once a year, the Discharger shall submit a list of the analytical methods employed for each test, the associated laboratory QA/QC procedures, reporting levels (RLs), and method detection limits (MDLs).

The Regional Water Board, in consultation with the State Water Board Quality Assurance Program, shall establish a ML that is not contained in Attachment H to be included in the Discharger's permit in any of the following situations:

- 1. When the pollutant under consideration is not included in Attachment H;
 - 2. When the Discharger and Regional Water Board agree to include in the permit a test method that is more sensitive than that specified in 40 C.F.R. part 136 (revised August 19, 2014);
 - 3. When the Discharger agrees to use an ML that is lower than that listed in Attachment H;
 - 4. When the Discharger demonstrates that the calibration standard matrix is sufficiently different from that used to establish the ML in Attachment H, and proposes an appropriate ML for their matrix; or,
 - 5. When the Discharger uses a method whose quantification practices are not consistent with the definition of an ML. Examples of such methods are the U.S. EPA-approved method 1613 for dioxins and furans, method 1624 for volatile organic substances, and method 1625 for semi-volatile organic substances. In such cases, the Discharger, the Regional Water Board, and the State Water Board shall agree on a lowest quantifiable limit and that limit will substitute for the ML for reporting and compliance determination purposes.
- K. Water/wastewater samples must be analyzed within allowable holding time limits as specified in 40 C.F.R. section 136.3. All QA/QC items must be run on the same dates the samples were actually analyzed, and the results shall be reported in the Regional Water Board format, when it becomes available, and submitted with the laboratory reports. Proper chain of custody procedures must be followed, and a copy of the chain of custody shall be submitted with the report.
 - L. Field analyses with short sample holding times such as pH, total residual chlorine, and temperature, may be performed using properly calibrated and maintained portable instruments by trained personnel acting on the Discharger's behalf, using methods in accordance with 40 C.F.R. part 136. All field instruments must be calibrated per manufacturer's instructions. A manual containing the standard operating procedures for all field analyses, including records of personnel proficiency training, instruments calibration and

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

maintenance, and quality control procedures shall be maintained onsite, and shall be available for inspection by Regional Water Board staff. Information including instrument calibration, time of sample collection, time of analysis, name of analyst, quality assurance/quality control data, and measurement values shall be clearly documented during each field analysis and submitted to the Regional Water Board as part of the corresponding regular monitoring report.

- M.** All analyses shall be accompanied by the chain of custody, including but not limited to date and time of sampling, sample identification, and name of person who performed sampling, date of analysis, name of person who performed analysis, QA/QC data, method detection limits, analytical methods, copy of laboratory certification, and a statement under penalty of perjury executed by the person responsible for the laboratory.
- N.** The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments to insure accuracy of measurements, or shall insure that both equipment activities will be conducted.
- O.** The Discharger shall have, and implement, an acceptable written quality assurance (QA) plan for laboratory analyses. Unless otherwise specified in the analytical method, duplicate samples must be analyzed at a frequency of 5% (1 in 20 samples) with at least one if there are fewer than 20 samples in a batch. A batch is defined as a single analytical run encompassing no more than 24 hours from start to finish. A similar frequency shall be maintained for analyzing spiked samples.
- P.** When requested by the Regional Water Board or U.S. EPA, the Discharger will participate in the NPDES discharge monitoring report QA performance study. The Discharger must have a success rate equal to or greater than 80%.
- Q.** For parameters that both average monthly and daily maximum limits are specified and the monitoring frequency is less than four times a month, the following shall apply. If an analytical result is greater than the average monthly limit, the Discharger shall collect four additional samples at approximately equal intervals during the month, until compliance with the average monthly limit has been demonstrated. All five analytical results shall be reported in the monitoring report for that month, or 45 days after results for the additional samples were received, whichever is later. In the event of noncompliance with an average monthly effluent limitation, the sampling frequency for that constituent shall be increased to weekly and shall continue at this level until compliance with the average monthly effluent limitation has been demonstrated. The Discharger shall provide for the approval of the Executive Officer a program to ensure future compliance with the average monthly limit.
- R.** In the event wastes are transported to a different disposal site during the report period, the following shall be reported in the monitoring report:
 - 1. Types of wastes and quantity of each type;
 - 2. Name and address for each hauler of wastes (or method of transport if other than by hauling); and
 - 3. Location of the final point(s) of disposal for each type of waste.If no wastes are transported off-site during the reporting period, a statement to that effect shall be submitted.
- S.** Each monitoring report shall state whether or not there was any change in the discharge as described in the Order during the reporting period.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

Table E-1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
001	EFF-001	An effluent sampling location shall be established where representative samples of Discharge Point 001 can be obtained prior to discharge into the storm drain that conveys to the Compton Creek. (Latitude 33.9261° N, Longitude 118.2217° W)
--	RSW-001	A receiving water sampling location where representative samples of Compton Creek can be obtained upstream of the public storm drain outfall.
--	RSW-002	The Los Angeles County Department of Public Works' Willow Street Gauge station at Wardlow (F319-R). The stream flow data may be obtained by contacting LACDPW at (626) 458-5100 or through Mr. Arthur Gotingco at (626)458-6379 or at agoting@dpw.lacounty.gov . The data for this station is downloaded once a month with a 1-2 week processing time for the provisional data.

The North latitude and West longitude information in Table E-1 are approximate for administrative purposes.

III. INFLUENT MONITORING REQUIREMENTS – NOT APPLICABLE

IV. EFFLUENT MONITORING REQUIREMENTS

A. Monitoring Location EFF-001

- The Discharger shall monitor the treated storm water discharge at EFF-001 as follows. If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding Minimum Level:

Table E-2. Effluent Monitoring at Monitoring Location EFF-001

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	Gallons/day	Meter	1/Day ⁸	--
Conventional Pollutants and Non-conventional Pollutants				
Ammonia, Total (as Nitrogen) ²	mg/L	Grab	1/Discharge Event ¹	3
Biochemical Oxygen Demand (BOD ₅) 5-day @ 20°C ²	mg/L	Grab	1/Quarter ⁹	3
Chloride ²	mg/L	Grab	1/Quarter ⁹	3
Chronic Toxicity	Pass or Fail, % effect (for TST Statistical Approach)	Grab	1/Year ⁴	5

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
<i>E. Coli</i>	CFU/100mL or MPN/100mL	Grab	1/Discharge Event ¹	3
Nitrate (as Nitrogen) ²	mg/L	Grab	1/Discharge Event ¹	3
Nitrite (as Nitrogen) ²	mg/L	Grab	1/Discharge Event ¹	3
Nitrite plus nitrate (total as Nitrogen) ²	mg/L	Grab	1/Discharge Event ¹	3
Oil and Grease ²	mg/L	Grab	1/Quarter ⁹	3
pH	standard units	Grab	1/Discharge Event ¹	3
Sulfates	mg/L	Grab	1/Quarter ⁹	3
Temperature	°F	Grab	1/Discharge Event ¹	3
Total Dissolved Solids (TDS) ²	mg/L	Grab	1/Quarter ⁹	3
Total Suspended Solids (TSS) ²	mg/L	Grab	1/Quarter ⁹	3
Total Petroleum Hydrocarbons (TPH) as Gasoline (C ₄ -C ₁₂) ²	µg/L	Grab	1/Discharge Event ¹	EPA Method 503.1 or 8015B
TPH as Diesel (C ₁₃ -C ₂₂) ²	µg/L	Grab	1/Discharge Event ¹	EPA method 503.1, 8015b, or 8270
TPH as Waste Oil (C ₂₃₊) ²	µg/L	Grab	1/Discharge Event ¹	EPA method 503.1, 8015b, or 8270
Turbidity	NTU	Grab	1/Quarter ⁹	3
Priority Pollutants				
Cadmium, Total Recoverable ²	µg/L	Grab	1/Discharge Event ¹	3
Copper, Total Recoverable ²	µg/L	Grab	1/Discharge Event ¹	3
Lead, Total Recoverable ²	µg/L	Grab	1/Discharge Event ¹	3
Zinc, Total Recoverable ²	µg/L	Grab	1/Discharge Event ¹	3
2,3,7,8-TCDD²	µg/L	Grab	1/Discharge Event¹	3
TCDD Equivalents ^{2,6}	µg/L	Grab	1/Discharge Event ¹	3
Nickel, Total Recoverable ²	µg/L	Grab	1/Quarter ⁹	3
Bromoform	µg/L	Grab	1/Quarter ⁹	3
Chlorodibromomethane	µg/L	Grab	1/Quarter ⁹	3
Chloroform	µg/L	Grab	1/Quarter ⁹	3
Dichlorobromomethane	µg/L	Grab	1/Quarter ⁹	3
Tetrachloroethylene	µg/L	Grab	1/Quarter ⁹	3
Toluene	µg/L	Grab	1/Quarter ⁹	3
Remaining Priority Pollutants ¹	µg/L	Grab	1/Year ⁴	3

¹ During periods of extended discharge, no more than one sample per week (or 7-day period) is required to be collected. Sampling shall be conducted during the first hour of discharge. If, for safety reasons, a sample cannot be obtained during the first hour of discharge, a sample shall be obtained at the first safe opportunity, and the reason for the delay shall be included in the report.

² The mass emission (lbs/day) for the discharge shall be calculated and reported using the limitation concentration and the actual flow rate measured at the time of discharge, using the formula:

$$M = 8.34 \times C_e \times Q$$

where:

M = mass discharge for a pollutant, lbs/day

C_e = Reported concentration for a pollutant in mg/L

Q = actual discharge flow rate (MGD).

- ³ Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. Part 136; for priority pollutants, the methods must meet the lowest MLs specified in Attachment 4 of the SIP (Attachment H of this Order), where no methods are specified for a given pollutant, by methods approved by this Regional Water Board or the State Water Board. If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding Minimum Level necessary to demonstrate compliance with applicable effluent limitations.
- ⁴ Monitoring is only required during years in which discharge occurs. Annual samples shall be collected during the first discharge of the year. If there is no discharge to surface waters, the Discharger will indicate in the corresponding monitoring report, under penalty of perjury, that no effluent was discharged to surface water during the reporting period.
- ⁵ Refer to section V of this MRP, Whole Effluent Toxicity Requirements.
- ⁶ TCDD equivalents shall be calculated using the following formula, where the Minimum Levels (MLs) and the toxicity equivalency factors (TEFs) are as listed in the Table below. The Discharger shall report all measured values of individual congeners, including data qualifiers. When calculating TCDD equivalents, the Discharger shall set congener concentrations below the MLs to zero. U.S. EPA method 1613 may be used to analyze dioxin and furan congeners.

$$\text{Dioxin-TEQ (TCDD equivalents)} = \sum(Cx \times \text{TEF}_x)$$

where: Cx = concentration of dioxin or furan congener x
TEF_x = TEF for congener x

Congeners	Minimum Levels (pg/L)	Toxicity Equivalence Factor (TEF)
2,3,7,8 - tetra CDD	10	1.0
1,2,3,7,8 - penta CDD	50	1.0
1,2,3,4,7,8 - hexa CDD	50	0.1
1,2,3,6,7,8 - hexa CDD	50	0.1
1,2,3,7,8,9 - hexa CDD	50	0.1
1,2,3,4,6,7,8 - hepta CDD	50	0.01
Octa CDD	100	0.0001
2,3,7,8 - tetra CDF	10	0.1
1,2,3,7,8 - penta CDF	50	0.05
2,3,4,7,8 - penta CDF	50	0.5
1,2,3,4,7,8 - hexa CDF	50	0.1
1,2,3,6,7,8 - hexa CDF	50	0.1
1,2,3,7,8,9 - hexa CDF	50	0.1
2,3,4,6,7,8 - hexa CDF	50	0.1
1,2,3,4,6,7,8 - hepta CDFs	50	0.01
1,2,3,4,7,8,9 - hepta CDFs	50	0.01
Octa CDF	100	0.0001

- ⁷ Priority Pollutants as defined by the California Toxics Tule (CTR) defined in Attachment I to this Order.
- ⁸ Flow shall be recorded daily during each period of discharge.
- ⁹ Sampling shall be conducted during the first discharge event for each quarter (October 1- December 31, January 1-March 31, April 1-June 30, July 1- September 30).

V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

A. Chronic Toxicity Testing

1. Discharge In-stream Waste Concentration (IWC) for Chronic Toxicity

The chronic toxicity IWC for this discharge is **100 percent** effluent.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. Sample Volume and Holding Time

The total sample volume shall be determined by the specific toxicity test method used. Sufficient sample volume shall be collected to perform the required toxicity test and Toxicity Identification Evaluation (TIE) studies. All toxicity tests shall be conducted as soon as possible following sample collection. No more than 36 hours shall elapse before the conclusion of sample collection and test initiation.

3. Chronic Freshwater Species and Test Methods

If effluent samples are collected from outfalls discharging to receiving waters with salinity <1 ppt, the Discharger shall conduct the following chronic toxicity tests on effluent samples—at the in-stream waste concentration for the discharge—in accordance with species and test methods in *Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms* (EPA/821/R-02/013, 2002). In no case shall these species be substituted with another test species unless written authorization from the Regional Board Executive Officer is received.

- A static renewal toxicity test with the fathead minnow, *Pimephales promelas* (Larval Survival and Growth Test Method 1000.0).
- A static renewal toxicity test with the daphnid, *Ceriodaphnia dubia* (Survival and Reproduction Test Method 1002.0).
- A static renewal toxicity test with the green alga, *Selenastrum capricornutum* (also named *Raphidocelis subcapitata*) (Growth Test Method 1003.0).

4. Species Sensitivity Screening

Species sensitivity screening shall be conducted monthly for a period of three months for this Order's first required sample collection event. During each month, the~~Species sensitivity screening shall be conducted during this Order's first required sample collection. The~~ Discharger shall collect a single effluent sample and concurrently conduct three toxicity tests, using the fish, an invertebrate, and the alga species as referenced in this section. The sample shall also be analyzed for the parameters required for the discharge. The species that exhibits the highest "Percent Effect" at the discharge IWC during species sensitivity screening shall be used for routine monitoring during the permit cycle.

Rescreening is required at least once per five (5) years. The Discharger shall rescreen with the three species listed above and continue to monitor with the most sensitive species. If the first suite of rescreening tests demonstrates that the same species is the most sensitive, then the rescreening does not need to include more than one suit of tests. If a different species is the most sensitive, or if there is ambiguity, then the Discharger shall proceed with suites of screening tests using enough collected effluent for a minimum of three, but not to exceed five suites.

5. Quality Assurance and Additional Requirements

Quality assurance measures, instructions, and other recommendations and requirements are found in the test methods manuals previous referenced. Additional requirements are specified below.

- The discharge is subject to a determination of "Pass" or "Fail" and "Percent Effect" from a single-effluent concentration chronic toxicity test at the discharge IWC using the Test of Significant Toxicity (TST) statistical approach described in *National Pollutant Discharge Elimination System Test of Significant Toxicity/Implementation Document* (EPA 833-R-10-003, 2010), Appendix A, Figure A-1, and Table A-1. The

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

null hypothesis (H_0) for the TST statistical approach is: Mean discharge IWC response \leq (0.75 x Mean control response). A test result that does not reject this null hypothesis is reported as "Fail". The relative "Percent Effect" at the discharge IWC is defined and reported as: ((Mean control response-Mean discharge IWC response) \div Mean control response) x 100%.

- b. The Median Monthly Effluent Limitation (MMEL) for chronic toxicity only applies when there is a discharge on more than one day in a calendar month period. During such calendar months, exactly three independent toxicity tests are required when one toxicity test results in "Fail". This limitation is not applicable to discharges composed entirely of industrial storm water.
- c. Dilution water and control water, including brine controls, shall be laboratory water prepared and used as specified in the test methods manual. If dilution water and control water is different from test organism culture water, then a second control using culture water shall also be used.
- d. Monthly reference toxicant testing is sufficient. All reference toxicant test results should be reviewed and reported.
- e. The Discharger shall perform toxicity tests on final effluent samples. Chlorine and ammonia shall not be removed from the effluent sample prior to toxicity testing, unless explicitly authorized under this section of the Monitoring and Reporting Program and the rationale is explained in the Fact Sheet (Attachment F).

6. Preparation of Initial Investigation TRE Work Plan

The Discharger shall prepare and submit a generic Initial Investigation TRE Work Plan within 90 days of the permit effective date to be ready to respond to toxicity events. The Discharger shall review and update this work plan as necessary so it remains current and applicable to the discharge. At a minimum, the work plan shall include:

- a. A description of the investigation and evaluation techniques that would be used to identify potential causes and source of toxicity, effluent variability, and treatment system efficiency.
- b. A description of methods for maximizing in-house treatment system efficiency, good housekeeping practices, and a list of all chemicals used in operations at the facility.
- c. If a Toxicity Identification Evaluation (TIE) is necessary, an indication of who would conduct the TIEs (i.e., an in-house expert or outside contractor).

7. Toxicity Identification Evaluation and Toxicity Reduction Evaluation Process

- a. **Toxicity Identification Evaluation (TIE).** A toxicity test sample is immediately subject to TIE procedures to identify the toxic chemical(s), if a chronic toxicity test shows "Fail and % Effect value ≥ 50 ". The Discharger shall initiate a TIE using, as guidance, EPA manuals: *Methods for Aquatic Toxicity Identification Evaluations: Phase I Toxicity Characterization Procedures* (EPA/600/6-91/003, 1991); *Methods for Aquatic Toxicity Identification Evaluations, Phase II Toxicity Identification Procedures for Samples Exhibiting Acute and Chronic Toxicity* (EPA/600/R-92/080, 1993); *Methods for Aquatic Toxicity Identification Evaluations, Phase III Toxicity Confirmation Procedures for Samples Exhibiting Acute and Chronic Toxicity* (EPA/600/R-92/081, 1993); and *Marine Toxicity Identification Evaluation (TIE): Phase I Guidance Document* (EPA/600/R-96-054, 1996). The TIE should be conducted on the species demonstrating the most sensitive toxicity response.

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

- b. **Toxicity Reduction Evaluation (TRE).** When a toxicant or class of toxicants is identified, a TRE shall be performed for that toxicant. The TRE shall include all reasonable steps to identify the source(s) of toxicity and discuss appropriate BMPs to eliminate the causes of toxicity. No later than 30 days after the source of toxicity and appropriate BMPs and/or treatment are identified, the Discharger shall submit a TRE Corrective Action Plan to the Executive Officer for approval. At minimum, the plan shall include:
 - i. The potential sources of pollutant(s) causing toxicity.
 - ii. Recommended BMPs and/or treatment to reduce the pollutant(s) causing toxicity.
 - iii. Follow-up monitoring to demonstrate that toxicity has been removed.
 - iv. Actions the Discharger will take to mitigate the effects of the discharge and prevent the recurrence of toxicity.
 - v. A schedule for these actions, progress reports, and the final report.
- c. Many recommended TRE elements parallel required or recommended efforts for source control, pollution prevention, and storm water control programs. TRE efforts should be coordinated with such efforts. As toxic substances are identified or characterized, the Discharger shall continue the TRE by determining the sources and evaluating alternative strategies for reducing or eliminating the substances from the discharge. All reasonable steps shall be taken to reduce toxicity to levels consistent with toxicity evaluation parameters.
- d. The Discharger shall conduct routine effluent monitoring for the duration of the TIE/TRE process.
- e. The Regional Water Board recognizes that toxicity may be episodic and identification of causes and reduction of sources of toxicity may not be successful in all cases. The TRE may be ended at any stage if monitoring finds there is no longer toxicity.

8. **Reporting**

The Self-Monitoring Report (SMR) shall include a full laboratory report for each toxicity test. This report shall be prepared using the format and content of the test methods manual chapter titled *Report Preparation*, including:

- a. The toxicity test results for the TST statistical approach, reported as "Pass" or "Fail" and "Percent Effect" at the chronic toxicity IWC for the discharge.
- b. Water quality measurements for each toxicity test (e.g., pH, dissolved oxygen, temperature, conductivity, hardness, salinity, chlorine, ammonia).
- c. TRE/TIE results. The Regional Water Board Executive Officer shall be notified no later than 30 days from completion of each aspect of TRE/TIE analyses.
- d. Statistical program (e.g., TST calculator, CETIS, etc.) output results for each toxicity test.

B. Ammonia Removal

1. Except with prior approval from the Executive Officer of the Regional Water Board, ammonia shall not be removed from bioassay samples. The Discharger must demonstrate the effluent toxicity is caused by ammonia because of increasing test pH when conducting the toxicity test. It is important to distinguish the potential toxic effects

of ammonia from other pH sensitive chemicals, such as certain heavy metals, sulfide, and cyanide. The following may be steps to demonstrate that the toxicity is caused by ammonia and no other toxicants before the Executive Officer would allow for control of pH in the test.

- a. There is consistent toxicity in the effluent and the maximum pH in the toxicity test is in the range to cause toxicity due to increased pH.
 - b. Chronic ammonia concentrations in the effluent are greater than 4 mg/L total ammonia.
 - c. Conduct graduated pH tests as specified in the toxicity identification evaluation methods. For example, mortality should be higher at pH 8 and lower at pH 6.
 - d. Treat the effluent with a zeolite column to remove ammonia. Mortality in the zeolite treated effluent should be lower than the non-zeolite treated effluent. Then add ammonia back to the zeolite-treated samples to confirm toxicity due to ammonia.
2. When it has been demonstrated that toxicity is due to ammonia because of increasing test pH, pH may be controlled using appropriate procedures which do not significantly alter the nature of the effluent, after submitting a written request to the Regional Water Board, and receiving written permission expressing approval from the Executive Officer of the Regional Water Board.

C. Chlorine Removal

Except with prior approval from the Executive Office of the Regional Water Board, chlorine shall not be removed from bioassay samples.

VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE

VII. RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE

VIII. RECEIVING WATER MONITORING REQUIREMENTS

A. Monitoring Location RSW-001

1. The Discharger shall monitor Compton Creek at Monitoring Location RSW-001 as follows:

Table E-3. Receiving Water Monitoring Requirements at RSW-001

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
pH	standard units	Grab	1/Year ¹	2,3,6
Ammonia Nitrogen, Total (as N)	mg/L	Grab	1/Year ¹	2,3
Conductivity	µS/m	Grab	1/Year ¹	2,3
Dissolved Oxygen	mg/L	Grab	1/Year ¹	2,6
Hardness, Total (as CaCO ₃) ⁴	mg/L	Grab	1/Year ¹	2
Temperature	°F	Grab	1/Year ¹	2,3,6
Turbidity	NTU	Grab	1/Year ¹	2
Priority Pollutants ⁵	µg/L	Grab	1/Year ¹	2
TCDD Equivalents ⁷	µg/L	Grab	1/Year ¹	2
E.coli	MPN/100 mL	Grab	1/Year ¹	2

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Salinity	mg/L	Grab	1/Year ¹	²

¹ Receiving water monitoring at RSW-001 is required at least once per year for the first three years of discharge. Samples shall be collected during the first hour of discharge from the first storm event of the wet season (October 1 – May 30). If, for safety reasons, a sample cannot be obtained during the first hour of discharge, a sample shall be obtained at the first safe opportunity, and the reason for the delay shall be included in the report. The results shall be reported in the annual self-monitoring report of the corresponding year. If no receiving water monitoring was conducted in a given year, the annual report shall so state.

² Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. part 136; for priority pollutants, the methods must meet the lowest MLs specified in Attachment 4 of the SIP, provided as Attachment H in this Order. Where no methods are specified for a given pollutant, the methods must be approved by this Regional Water Board or the State Water Board. If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding Minimum Level.

³ Receiving water pH, temperature, salinity, and conductivity must be collected at the same time as ammonia samples.

⁴ Hardness shall be collected at the same time as priority pollutant analyses.

⁵ Priority Pollutants as defined by the California Toxics Rule (CTR) defined in Attachment I.

⁶ Receiving water pH, temperature, and dissolved oxygen must be analyzed at the same time the samples are collected for Priority Pollutants analysis. A hand-held field meter may be used for pH and temperature, provided the meter utilizes an EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

⁷ TCDD equivalents shall be calculated using the following formula, where the MLs and the toxicity equivalency factors (TEFs) are as listed in the Table below. The Discharger shall report all measured values of individual congeners, including data qualifiers. When calculating TCDD equivalents, the Discharger shall set congener concentrations below the MLs to zero. U.S. EPA method 1613 may be used to analyze dioxin and furan congeners.

$$\text{Dioxin-TEQ (TCDD equivalents)} = \sum(Cx \times \text{TEF}_x)$$

where: Cx = concentration of dioxin or furan congener x
TEF_x = TEF for congener x

Congeners	Minimum Levels (pg/L)	Toxicity Equivalence Factor (TEF)
2,3,7,8 - tetra CDD	10	1.0
1,2,3,7,8 - penta CDD	50	1.0
1,2,3,4,7,8 - hexa CDD	50	0.1
1,2,3,6,7,8 - hexa CDD	50	0.1
1,2,3,7,8,9 - hexa CDD	50	0.1
1,2,3,4,6,7,8 - hepta CDD	50	0.01
Octa CDD	100	0.0001
2,3,7,8 - tetra CDF	10	0.1
1,2,3,7,8 - penta CDF	50	0.05
2,3,4,7,8 - penta CDF	50	0.5
1,2,3,4,7,8 - hexa CDF	50	0.1
1,2,3,6,7,8 - hexa CDF	50	0.1
1,2,3,7,8,9 - hexa CDF	50	0.1
2,3,4,6,7,8 - hexa CDF	50	0.1
1,2,3,4,6,7,8 - hepta CDFs	50	0.01
1,2,3,4,7,8,9 - hepta CDFs	50	0.01
Octa CDF	100	0.0001

**R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E**

B. Monitoring Location RSW-002

The Discharger shall report the maximum daily flow in the Los Angeles River, at the Los Angeles County Department of Public Works' Willow Street Gauge Station at Wardlow. This station is designated as RSW-002 in this Order. The stream flow data can be obtained by contacting LACDPW at (626) 458-5100 or through Mr. Arthur Gotingco at (626)458-6379 or at agoting@dpw.lacounty.gov. The data for this station is downloaded once a month with a 1-2 week processing time for the provisional data. This information is necessary to determine the wet weather and dry weather condition of the river, as defined in the Los Angeles River Metals TMDL. If the gauging station is not operational, an estimated maximum daily flow may be submitted.

IX. OTHER MONITORING REQUIREMENTS

A. Storm Water Monitoring

1. Rainfall Monitoring

The Discharger shall measure and record the rainfall on each day of the month in which the discharge occurred. This information shall be included in the monitoring report for that month. If no discharge occurred during the month, a rainfall record is not required for that month.

2. Visual Observation

The Discharger shall make visual observations of all storm water discharge locations on at least one storm event per month that produces a significant storm water discharge to observe the presence of floating and suspended materials, oil and grease, discoloration, turbidity, and odor. A "significant storm water discharge" is a continuous discharge of storm water for a minimum of one hour, or the intermittent discharge of storm water for a minimum of 3 hours in a 12-hour period.

X. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. If there is no discharge during any reporting period, the report shall so state.
3. If the Discharger monitors (other than for process/operational control, startup, research, or equipment testing) any influent, effluent, or receiving water constituent more frequently than required by this Order using approved analytical methods, the results of those analyses shall be included in the monitoring report. These results shall be reflected in the calculation of the average (or median) used in demonstrating compliance with this Order/Permit.
4. Each monitoring report shall contain a separate section titled "Summary of Non-Compliance" which discusses the compliance record and corrective actions taken or planned that may be needed to bring the discharge into full compliance with waste discharge requirements. This section shall clearly list all non-compliance with waste discharge requirements, as well as all excursions of effluent limitations.
5. The Discharger shall inform the Regional Water Board well in advance of any proposed construction activity that could potentially affect compliance with applicable requirements.
6. The Discharger shall report the results of chronic toxicity testing, TRE and TIE as required in the Attachment E, Monitoring and Reporting, section V.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

B. Self-Monitoring Reports (SMRs)

1. The Discharger shall electronically submit SMRs using the State Water Board's California Integrated Water Quality System (CIWQS) Program Web site (<http://www.waterboards.ca.gov/ciwqs/index.html>). The CIWQS website will provide additional information for SMR submittal in the event there will be a planned service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through IX. The Discharger shall submit monthly and annual SMRs including the results of all required monitoring using U.S. EPA-approved test methods or other test methods specified in this Order. SMRs are to include all new monitoring results obtained since the last SMR was submitted. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.
3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

Table E-4. Monitoring Periods and Reporting Schedule

Sampling Frequency	Monitoring Period Begins On...	Monitoring Period	SMR Due Date
1/Day	December 1, 2015	January 1 – March 31 April 1 – June 30 July 1 – September 30 October 1 – December 31	May 1 August 1 November 1 February 1
1/Discharge Event	December 1, 2015	January 1 – March 31 April 1 – June 30 July 1 – September 30 October 1 – December 31	May 1 August 1 November 1 February 1
1/Quarter	December 1, 2015	January 1 – March 31 April 1 – June 30 July 1 – September 30 October 1 – December 31	May 1 August 1 November 1 February 1
1/Year	December 1, 2015	January 1 through December 31	February 1

4. Reporting Protocols. The Discharger shall report with each sample result the applicable Reporting Level (RL) and the current Method Detection Limit (MDL), as determined by the procedure in 40 C.F.R. part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory's MDL, shall be reported as "Detected, but Not Quantified," or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ. The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (\pm a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.
 - d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.
5. Compliance Determination. Compliance with effluent limitations for priority pollutants shall be determined using sample reporting protocols defined above and Attachment A of this Order. For purposes of reporting and administrative enforcement by the Regional Water Board and State Water Board, the Discharger shall be deemed out of compliance with effluent limitations if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reporting level (RL).
6. Multiple Sample Data. When determining compliance with an AMEL or MDEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
 - a. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
7. The Discharger shall submit SMRs in accordance with the following requirements:
 - a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data is required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.

C. Discharge Monitoring Reports (DMRs)

As of the effective date of this Order, if the Discharger operates a "minor" facility as designated on page 1 of this Order, submittal of Discharge Monitoring Reports (DMRs) is not required. However, at any time during the term of this Order, the State Water Board or the Regional Water Board may notify and require the Discharger to electronically submit DMRs.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

D. Other Reports

1. The Discharger shall report the results of any TRE/TIE required by the Special Provisions.
2. Within 90 days of the effective date of this Order, the Discharger is required to submit the following to the Regional Water Board:
 - a. Initial Investigation TRE workplan
 - b. Updated SWPPP
 - c. Updated BMPP
 - d. Spill Contingency Plan

The SWPPP, BMPP, and Spill Contingency Plan status shall be reviewed at a minimum once per year and updated as needed to ensure all actual or potential sources of pollutants in storm water discharged from the facility are addressed. All changes or revisions to the SWPPP, BMPP, and Spill Contingency Plan shall be submitted to the Regional Water Board within 30 days of revisions.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT F – FACT SHEET

CONTENTS

I.	Permit Information.....	F-3
II.	Facility Description	F-4
	A. Description of Wastewater and Biosolids Treatment and Controls	F-4
	B. Discharge Points and Receiving Waters	F-6
	C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data	F-6
	D. Compliance Summary.....	F-7
	E. Planned Changes	F-8
III.	Applicable Plans, Policies, and Regulations	F-8
	A. Legal Authorities	F-8
	B. California Environmental Quality Act (CEQA).....	F-8
	C. State and Federal Laws, Regulations, Policies, and Plans	F-8
	D. Impaired Water Bodies on CWA 303(d) List.....	F-11
	E. Other Plans, Policies and Regulations – Not Applicable	F-13
IV.	Rationale For Effluent Limitations and Discharge Specifications	F-13
	A. Discharge Prohibitions	F-13
	B. Technology-Based Effluent Limitations	F-13
	1. Scope and Authority	F-13
	2. Applicable Technology-Based Effluent Limitations.....	F-14
	C. Water Quality-Based Effluent Limitations (WQBELs)	F-16
	1. Scope and Authority	F-16
	2. Applicable Beneficial Uses and Water Quality Criteria and Objectives.....	F-17
	3. Determining the Need for WQBELs	F-19
	4. WQBEL Calculations	F-21
	5. WQBELs Based on Basin Plan Objectives	F-26
	6. Whole Effluent Toxicity (WET)	F-27
	7. Final WQBELs.....	F-28
	D. Final Effluent Limitation Considerations	F-29
	1. Anti-Backsliding Requirements	F-30
	2. Antidegradation Policies	F-30
	3. Mass-based Effluent Limitations	F-31
	4. Stringency of Requirements for Individual Pollutants	F-31
	5. Summary of Final Effluent Limitations.....	F-32
	E. Interim Effluent Limitations – Not Applicable	F-34
	F. Land Discharge Specifications – Not Applicable	F-34
	G. Recycling Specifications – Not Applicable.....	F-34
V.	Rationale for Receiving Water Limitations	F-34
	A. Surface Water.....	F-34
	B. Groundwater – Not Applicable	F-34
VI.	Rationale for Provisions	F-35
	A. Standard Provisions	F-35
	B. Special Provisions.....	F-35
	1. Reopener Provisions	F-35
	2. Special Studies and Additional Monitoring Requirements	F-35
	3. Best Management Practices and Pollution Prevention.....	F-35
	4. Construction, Operation, and Maintenance Specifications	F-36
	5. Other Special Provisions – Not Applicable.....	F-36

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

6. Compliance Schedules – Not Applicable	F-36
VII. Rationale for Monitoring and Reporting Requirements	F-36
A. Influent Monitoring – Not Applicable.....	F-36
B. Effluent Monitoring	F-36
C. Whole Effluent Toxicity Testing Requirements	F-37
D. Receiving Water Monitoring	F-37
1. Surface Water	F-37
2. Groundwater – Not Applicable	F-37
E. Other Monitoring Requirements	F-37
VIII. Public Participation.....	F-38
A. Notification of Interested Parties	F-38
B. Written Comments	F-38
C. Public Hearing	F-38
D. Reconsideration of Waste Discharge Requirements	F-39
E. Information and Copying	F-39
F. Register of Interested Persons.....	F-39
G. Additional Information	F-39

TABLES

Table F-1. Facility Information.....	F-3
Table F-2. Historic Effluent Limitations and Monitoring Data	F-6
Table F-3. Basin Plan Beneficial Uses	F-9
Table F-4. Summary of Technology-based Effluent Limitations at Discharge Point 001	F-16
Table F-5. Applicable Water Quality Criteria	F-17
Table F-6. Metals TMDL Applicable Waste Load Allocations	F-18
Table F-7. Nutrients TMDL Applicable Waste Load Allocations	F-18
Table F-8. Summary Reasonable Potential Analysis.....	F-20
Table F-9. Summary of Water Quality-based Effluent Limitations – EFF-001	F-28
Table F-10. Summary of Final Effluent Limitations at Discharge Point 001	F-32

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT F – FACT SHEET

As described in section II.B of this Order, the Regional Water Board incorporates this Fact Sheet as findings of the Regional Water Board supporting the issuance of this Order. This Fact Sheet includes the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

This Order has been prepared under a standardized format to accommodate a broad range of discharge requirements for Dischargers in California. Only those sections or subsections of this Order that are specifically identified as “not applicable” have been determined not to apply to this Discharger. Sections or subsections of this Order not specifically identified as “not applicable” are fully applicable to this Discharger.

I. PERMIT INFORMATION

The following table summarizes administrative information related to the Facility.

Table F-1. Facility Information

WDID	4B191297001
Discharger	Polynt Composites USA, Inc.
Name of Facility	Lynwood Facility
Facility Address	2801 Lynwood Road
	Lynwood, CA 90262
	Los Angeles County
Facility Contact, Title and Phone	John Dang, Environmental Health & Safety Manager, (562)295-5592
Authorized Person to Sign and Submit Reports	Robert Usab, Environmental Health & Safety Manager, (847)836-3730
Mailing Address	Same as Facility Address
Billing Address	Same as Facility Address
Type of Facility	Industrial, Standard Industrial Classification (SIC) Code 2821 (Resins Manufacturing)
Major or Minor Facility	Minor
Threat to Water Quality	2
Complexity	B
Pretreatment Program	N/A
Recycling Requirements	N/A
Facility Permitted Flow	0.34 million gallons per day (MGD)
Facility Design Flow	0.34 MGD
Watershed	Los Angeles River Watershed
Receiving Water	Compton Creek
Receiving Water Type	Inland Surface Water

- A. Polynt Composites USA, Inc. (hereinafter, Discharger) is the owner and operator of the Lynwood Facility (hereinafter Facility), a polyester and alkyd resins manufacturing facility. The Discharger was formerly known as PCCR USA, Inc.; the name change for the Discharger was effective April 1, 2015.

For the purposes of this Order, references to the “discharger” or “permittee” in applicable federal and state laws, regulations, plans, or policy are held to be equivalent to references to the Discharger herein.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

- B. The Facility discharges treated storm water runoff through a storm drain to Compton Creek, tributary to the Los Angeles River, a water of the United States. Discharges from the Facility were previously regulated by Order No. R4-2010-0161, adopted on September 2, 2010, and expired on August 10, 2015. Attachment B provides a map of the area around the Facility. Attachment C provides a flow schematic and a drainage map of the Facility.
- C. The Discharger filed a report of waste discharge and submitted an application for reissuance of its WDRs and NPDES permit on March 3, 2015. The application was deemed complete on April 6, 2015. A site visit was conducted on March 24, 2015, to observe operations and collect additional data to develop permit limitations and requirements for waste discharge.

II. FACILITY DESCRIPTION

Polynt Composites USA, Inc. operates and owns the 4.5-acre resins manufacturing and processing Facility at 2801 Lynwood Road, Lynwood, California. The Facility produces a variety of batch type resin products, including unsaturated polyester, saturated polyester, and synthetic alkyd. Operations at the Facility also include maintenance of aboveground storage tanks (ASTs) for raw materials and finished goods, resins loading operations, and storage of finished products in 350-gallon totes and 55-gallon drums within warehouses. Ancillary Facility operations include quality assurance and research and development laboratories, administration, maintenance, and shipping and receiving. The site is generally flat and slopes gently from the North to the South; it is covered by 4 to 6 inches of concrete with localized asphalt aprons. The Facility's reactor vessels and all bulk raw materials storage tanks, with the exception of styrene tanks, have been in temporarily shutdown since 2009; the Facility has not manufactured resin or other raw materials except styrene since the shutdown, but is instead storing and mixing resin products (manufactured off-site) for distribution. However, the Facility may resume resin production at full capacity at any time.

A. Description of Wastewater and Biosolids Treatment and Controls

Synthetic alkyd, saturated polyester, and unsaturated resins are manufactured in batches at the plant using reactor vessels and mix tanks. The majority of the feedstock is liquid raw materials, which are pumped from ASTs to kettles and mix tanks via a closed piping system. Additional feedstock are added manually, such as solids (i.e., granular, powders) from bags and sacks via manway on top of the kettles. The resin is then heated to react in the kettles. The primary by-product of the reaction is water vapor containing soluble organics that are condensed and flow to an isolated tank. The vapors are directed towards the onsite thermal oxidizer. After completion of the reaction step, the resin is transferred from the kettles to the mix tanks for the addition of solvents or monomers to thin the resin. The finished resin is then pumped through one of three different types of filtration systems into finished goods ASTs, 55-gallon drums, 350-gallon intermediate bulk container (IBC) totes, or directly into tanker trucks for distribution.

Raw materials used onsite may include, but are not limited to: monomers (styrene, alpha methyl styrene), hydrocarbons and natural oils (dicyclopentadiene, tall oil fatty acids, linseed oil, refined soya oils, safflower oil, sunflower oil), organic acids and anhydrides (adipic acid, maleic anhydride, isophthalic acid, terephthalic acid, and phthalic anhydride), glycols or polyols (propylene glycol, diethylene glycol, ethylene glycols, glycol ether PM), solvents (toluene, xylene, mineral spirits), cyanates (toluene diisocyanate), and various small quantities of additives or modifiers (antioxidants, alcohols, fumed silica).

All process areas, including the bulk and non-bulk liquid raw material and finished goods storage warehouses and hazardous wastes areas, are equipped with secondary containment. All ASTs, located at the northern side of the Facility, are bermed into several sections, each section with a designed capacity to hold the volume of the largest tank within the section plus

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

a 6-inch rain event. The truck and railcar loading and unloading areas located at the northeast of the Facility are each curbed and equipped with collection trenches. These trenches lead to an underground sump located within each of the loading areas (with a capacity of 75000 gallons for the railcar loading area and 20433 gallons for the truck loading area). In case of a spill during loading and unloading operations, the spill will be routed through the trenches into the underground sumps; the content within the sumps will be manually pumped and collected into baker tanks or drums and tanker to be disposed at a licensed treatment storage disposal facility (TSDF) offsite. The Facility recycles any resin spills as much as they can within the Facility. During a rain event, storm water collected in the trenches from the loading areas, as well as from other process areas of the Facility, will be routed to the Facility's pretreatment system using a series of air operated diaphragm pumps, and eventually be discharged to the sanitary sewer under an industrial wastewater permit with the Los Angeles County Sanitation Districts (LACSD).

The Facility pretreatment system consists of a series of bag filters, storage tanks, and activated carbon absorption vessels. The pretreatment system also has a 12,000 gallon surge tank (Tank 81) with its own secondary containment. During normal rainfall event, storm water collected in the process areas will drain immediately to the treatment system and it is discharged to the sanitary sewer. In the event of heavy precipitation (when the influx of storm water exceeds the permitted discharge flow rate to the sanitary sewer), any excess storm water collected within secondary containments are left stagnant within the secondary containments, and any additional flow from the pretreatment system will be directed to the surge tank. The water will be drained subsequently and gradually as permitted to the LACSD sanitary sewer system.

The majority of the process water is transferred to a TSDF for treatment offsite. Some process water within the Facility, (i.e. cooling tower water and boiler blowdown water) is discharged to the sanitary sewer system. An onsite groundwater remediation project is presently in operation due to leaking underground storage tanks, but it is unrelated to the current operations at the Facility. However, the Facility (in a shared liability of the costs and management of the remediation effort with Momentive, the prior owner of the Facility) is responsible for the ongoing remediation of the groundwater. The system consists of a bag filter system and activated carbon vessels, used to treat the extracted groundwater prior to its discharge to the sanitary sewer. All process water including the treated groundwater is prohibited from entering the storm drain or exiting the property through Discharge Point 001.

Non-process areas are located at the southern portion of the Facility (including roads, office buildings, and service areas), and are undiked. Storm water from non-process areas is diverted through pavement depressions to the front of the Facility, adjacent to Lynwood Road. The Facility has two gates (East Gate and West Gate) to Lynwood Road, divided by an office building; each gate is equipped with a trench drain, which leads to a sump. The majority of storm water is diverted to the East Gate collection sump. Storm water collected in the West Gate collection sump will be pumped into the East Gate collection sump, which is then routed to the storm water treatment system consisting of four sand filters, a backwash sand filter storage tank, an additive injection system, and a 300,000 gallon storage tank. Sludge from the sand filters and purge water from the storage tank are disposed offsite or to the sanitary sewer system. When the storage tank is full, the treated storm water will be discharged from the pipeline connected to the top of the tank through Discharge Point 001 into the storm drain that leads to Compton Creek.

During non-storm events, spills that may come into the non-process areas of the Facility may be directed to an open area in front of the shipping and receiving building, which has a capacity of approximately 9000 gallons (due to ground elevation). Any spills as well as storm water collected in this area will be directed to the Facility pretreatment system and be

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

discharged to the sanitary sewer system. Any spills that may occur within the Facility are immediately cleaned up as per the Facility's Spill Prevention Control and Countermeasure (SPCC) Plan.

B. Discharge Points and Receiving Waters

Consistent with the prior permit Order No. R4-2010-0161 and the submitted ROWD, the Facility proposes to discharge up to 0.34 million gallons per day (MGD) of treated storm water runoff through Discharge Point 001 into a storm drain, which leads to Compton Creek, a water of the United States. Compton Creek is tributary to Los Angeles River, a water of the United States, and is part of the Los Angeles River Watershed. The coordinates for Discharge Point 001 were listed incorrectly in the prior Order; the correct coordinates are included in this Order (Latitude 33.9261°, Longitude -118.2217°).

C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data

1. Effluent limitations contained in the existing Order for discharges from Discharge Point 001 (Monitoring Location EFF-001) and representative monitoring data from the term of the previous Order are as follows:

Table F-2. Historic Effluent Limitations and Monitoring Data

Parameter	Units	Effluent Limitation		Monitoring Data (From October 2010 to March 2015)	
		Average Monthly (30-Day Average)	Maximum Daily	Highest Average Monthly Discharge	Highest Daily Discharge
Conventional Pollutants					
Biochemical Oxygen Demand 5-day @ 20 deg. C (BOD)	mg/L	--	30	--	7.2
	lbs/day ¹	--	85	--	NR
Oil and Grease	mg/L	--	15	--	5.2
	lbs/day ¹	--	43	--	NR
pH	Standard Units	6.5 - 8.5 ²		6.9 – 8.5 ²	
Total Suspended Solids (TSS)	mg/L	--	75	--	7
	lbs/day ¹	--	213	--	NR
Non-Conventional Pollutants					
Acute Toxicity	% Survival	3		4	
Temperature	°F	86 ²		68 ²	
Total Dissolved Solids (TDS)	mg/L	--	1,500	--	430
	lbs/day ¹	--	4,250	--	NR
Sulfate	mg/L	--	350	--	103
	lbs/day ¹	--	990	--	NR
Chloride	mg/L	--	150	--	63
	lbs/day ¹	--	430	--	NR
Phenols	mg/L	--	1.0	--	0.15
	lbs/day ¹	--	2.8	--	NR
Total Ammonia (as nitrogen)	mg/L	--	10.1	--	0.42
	lbs/day ¹	--	27	--	NR

REVISITED TENTATIVE

Parameter	Units	Effluent Limitation		Monitoring Data (From October 2010 to March 2015)	
		Average Monthly (30-Day Average)	Maximum Daily	Highest Average Monthly Discharge	Highest Daily Discharge
Nitrate-nitrogen (NO3-N)	mg/L	8	--	1.4	--
	lbs/day ¹	23	--	NR	--
Nitrite-nitrogen (NO2-N)	mg/L	1	--	0.058	--
	lbs/day ¹	2.8	--	NR	--
Nitrate-nitrogen + Nitrite-nitrogen (NO3-N + NO2-N)	mg/L	8	--	NR	--
	lbs/day ¹	23	--	NR	--
Total Petroleum Hydrocarbons (TPH) as Gasoline	ug/L	--	--	--	670
	lbs/day ¹	--	--	--	--
Total Petroleum Hydrocarbons (TPH) as Diesel	ug/L	--	--	--	110
	lbs/day ¹	--	--	--	--
Total Petroleum Hydrocarbons (TPH) as Waste Oil	ug/L	--	--	--	<100
	lbs/day ¹	--	--	--	--
E.coli	MPN/100mL	--	--	--	110
Priority Pollutants					
Cadmium, Total Recoverable (Wet-weather) ⁵	µg/L	--	3.1	--	<0.2
	lbs/day ¹	--	8.8	--	NR
Copper, Total Recoverable (Dry-weather) ⁵	µg/L	--	30	--	7.94
	lbs/day ¹	--	85	--	NR
Copper, Total Recoverable (Wet-weather) ⁵	µg/L	--	17	--	7.94
	lbs/day ¹	--	48	--	NR
Lead, Total Recoverable (Dry-weather) ⁵	µg/L	--	15	--	12.5
	lbs/day ¹	--	43	--	NR
Lead, Total Recoverable (Wet-weather) ⁵	µg/L	--	62	--	12.5
	lbs/day ¹	--	180	--	NR
Zinc, Total Recoverable (Dry-weather) ⁵	µg/L	--	353	--	149
	lbs/day ¹	--	1000	--	NR
Zinc, Total Recoverable (Wet-weather) ⁵	µg/L	--	159	--	149
	lbs/day ¹	--	450	--	NR
TCDD Equivalents ⁶	µg/L	--	--	--	3.1 x 10 ⁻⁶
	lbs/day ¹	--	--	--	--

NR= Not Reported

¹ Mass-based effluent limitations are based on a maximum permitted flow rate of 0.34 MGD.

² Instantaneous minimum and maximum.

³ The average survival in the undiluted effluent for any three (3) consecutive 96-hour static or continuous flow bioassay test shall be at least 90%, and no single test shall produce less than 70% survival.

⁴ All reported results were 100% survival. Out of eleven (11) reported results, three (3) were 95% survival and eight (8) were 100%.

⁵ Dry-weather effluent limitations are applicable when the maximum daily flow in the Los Angeles River at Willow Street gage station at Wardlow (Wardlow station) is less than 500 cubic feet per second (cfs). Wet-weather effluent limitations are applicable when the maximum daily flow in the Los Angeles River is equal to or greater than 500 cfs.

⁵⁶ TCDD Equivalents includes contributions from 2,3,7,8-TCDD.

D. Compliance Summary

Data submitted to the Regional Water Board during the period of October 2010 through March 2015 indicated that there have not been any exceedances of effluent limitations as specified in Order No. R4-2010-0161. During the same period, the Discharger was cited for nine counts of minor deficient reporting violations, including violations such as failure to submit data electronically and insufficient reporting for parameters requiring once per discharge event sampling. The Discharger was last cited for a reporting violation on February 1, 2013. Instances of non-compliance are currently being evaluated by the Regional Water Board for appropriate action.

E. Planned Changes

The Discharger has indicated that there are no anticipated alterations to the Facility or treatment processes.

III. APPLICABLE PLANS, POLICIES, AND REGULATIONS

The requirements contained in this Order are based on the requirements and authorities described in this section.

A. Legal Authorities

This Order serves as Waste Discharge Requirements (WDRs) pursuant to article 4, chapter 4, division 7 of the California Water Code (commencing with section 13260). This Order is also issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (U.S. EPA) and chapter 5.5, division 7 of the Water Code (commencing with section 13370). It shall serve as a National Pollutant Discharge Elimination System (NPDES) permit for point source discharges from this Facility to surface waters.

B. California Environmental Quality Act (CEQA)

Under Water Code section 13389, this action to adopt an NPDES permit is exempt from the provisions of Chapter 3 of CEQA, (commencing with section 21100) of Division 13 of the Public Resources Code.

C. State and Federal Laws, Regulations, Policies, and Plans

1. **Water Quality Control Plan.** The Regional Water Board adopted a *Water Quality Control Plan for the Los Angeles Region* (hereinafter Basin Plan) on June 13, 1994, that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. Requirements in this Order implement the Basin Plan. In addition, the Basin Plan implements State Water Board Resolution 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply. Beneficial uses applicable to Compton Creek are as follows:

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Table F-3. Basin Plan Beneficial Uses

Discharge Point	Receiving Water Name	Beneficial Use(s)
001	Compton Creek	<p><u>Existing:</u> Ground water recharge (GWR), contact (REC-1¹) and non-contact (REC-2) water recreation, warm freshwater habitat (WARM); wildlife habitat (WILD), and wetland habitat (WET).</p> <p><u>Potential:</u> Municipal and domestic water supply (MUN)².</p>

¹. Access prohibited by Los Angeles County Department of Public Works.

². MUN designations are designated under State Water Board Resolution 88-63 and Regional Water Board Resolution 89-03. Some designations may be considered for exemption at a later date (See pages 2-3, 4 of the Basin Plan for more details).

Title 22 of the California Code of Regulations. The State established primary and secondary maximum contaminant levels (MCLs) for inorganic, organic, and radioactive contaminants in drinking water. These MCLs are codified in Title 22, California Code of Regulations (Title 22). The Basin Plan (Chapter 3) incorporates Title 22 primary MCLs by reference. This incorporation by reference is prospective including future changes to the incorporated provisions as the changes take effect. Title 22 primary MCLs have been used as bases for effluent limitations in WDRs and NPDES permits to protect the groundwater recharge beneficial use when that receiving groundwater is designated as MUN. In addition, the Basin Plan specifies that “Ground waters shall not contain taste or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses.” Therefore, the secondary MCLs, are also considered in this permit to protect groundwater quality.

Groundwater Recharge (GWR). Compton Creek is designated as GWR. Surface water from Compton Creek percolates into the Central Los Angeles Coastal Plain Groundwater Basin. Since groundwater from this Basin is used to provide drinking water to the community, the groundwater aquifers should be protected. Therefore, Title 22-based limits are needed to protect that drinking water supply. The MCLs were considered during the development of effluent limits included in this Order.

2. **Thermal Plan.** The State Water Board adopted the *Water Quality Control Plan for Control of Temperature in the Coastal and Interstate Waters and Enclosed Bays and Estuaries of California* (Thermal Plan) on January 7, 1971, and amended this plan on September 18, 1975. This plan contains temperature objectives for surface waters. Requirements of this Order implement the Thermal Plan and a white paper developed by Regional Water Board staff entitled *Temperature and Dissolved Oxygen Impacts on Biota in Tidal Estuaries and Enclosed Bays in the Los Angeles Region*. The white paper evaluated the optimum temperatures for steelhead, topsmelt, ghost shrimp, brown rock crab, jackknife clam, and blue mussel, a number of aquatic species prevalent in the region. The white paper provided the basis to conclude the maximum effluent temperature limitation of 86°F is appropriate for protection of aquatic life and it is included in this Order.
3. **National Toxics Rule (NTR) and California Toxics Rule (CTR).** U.S. EPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995 and November 9, 1999. About forty criteria in the NTR applied in California. On May 18, 2000, U.S. EPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on February 13, 2001. These rules contain water quality criteria for priority pollutants.

4. **State Implementation Policy.** On March 2, 2000, the State Water Board adopted the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California* (State Implementation Policy or SIP). The SIP became effective on April 28, 2000, with respect to the priority pollutant criteria promulgated for California by the U.S. EPA through the NTR and to the priority pollutant objectives established by the Regional Water Board in the Basin Plan. The SIP became effective on May 18, 2000, with respect to the priority pollutant criteria promulgated by the U.S. EPA through the CTR. The State Water Board adopted amendments to the SIP on February 24, 2005, that became effective on July 13, 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.
5. **Domestic Water Quality.** In compliance with the Water Code section 106.3, it is the policy of the State of California that every human being has the right to safe, clean, affordable, and accessible water adequate for human consumption, cooking, and sanitary purposes. This Order promotes that policy by requiring discharges to meet maximum contaminant levels implemented by the Basin Plan that are designed to protect human health and ensure that water is safe for domestic use.
6. **Antidegradation Policy.** 40 C.F.R. section 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution 68-16 ("*Statement of Policy with Respect to Maintaining High Quality of Waters in California*"). Resolution 68-16 is deemed to incorporate the federal antidegradation policy where the federal policy applies under federal law. Resolution 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the state and federal antidegradation policies. The permitted discharge must be consistent with the antidegradation provision of 40 C.F.R. section 131.12 and State Water Board Resolution 68-16.
7. **Anti-Backsliding Requirements.** Sections 402(o)(2) and 303(d)(4) of the CWA and federal regulations at 40 C.F.R. section 122.44(l) restrict backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed. Clean Water Act section 402(o)(2) and 40 C.F.R. section 122.44(l) provide that the relaxation of effluent limits may be allowed where:
 - a. There has been material and substantial alternations or additions to the permitted facility which justify relaxation.
 - b. New information (other than revised regulations, guidance, or test methods) is available that was not available at the time of permit issuance which would have justified a less stringent effluent limitation.
 - c. Technical mistakes or mistaken interpretations of the law were made in issuing the permit under section 402(a)(1)(b) of the Clean Water Act.
 - d. Good cause exists due to events beyond the permittee's control and for which there is no reasonably available remedy.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- e. The permit has been modified under 40 C.F.R. § 122.62, or a variance has been granted.
 - f. The permittee has installed and properly operated and maintained treatment facilities required to meet the effluent limitations in the previous permit but still has been unable to meet the permit limitations (relaxation may only be allowed to the treatment levels actually achieved).
8. **Endangered Species Act Requirements.** This Order does not authorize any act that results in the taking of a threatened or endangered species or any act that is now prohibited, or becomes prohibited in the future, under either the California Endangered Species Act (Fish and Game Code, §§ 2050 to 2097) or the Federal Endangered Species Act (16 U.S.C.A. §§ 1531 to 1544). This Order requires compliance with effluent limits, receiving water limits, and other requirements to protect the beneficial uses of waters of the state. The discharger is responsible for meeting all requirements of the applicable Endangered Species Act.

D. Impaired Water Bodies on CWA 303(d) List

Section 303(d) of the CWA requires states to identify specific water bodies where water quality standards are not expected to be met after implementation of technology-based effluent limitations on point sources. For all CWA section 303(d)-listed water bodies and pollutants, the Regional Water Board plans to develop and adopt total maximum daily loads (TMDLs) that will specify waste load allocations (WLAs) for point sources and load allocations (LAs) for non-point sources, as appropriate.

Certain receiving waters in the Los Angeles and Ventura County watersheds do not fully support beneficial uses and therefore have been classified as impaired on the 2010 CWA section 303(d) list and have been scheduled for TMDL development. On November 12, 2010, U.S. EPA approved California's 2010 CWA Section 303(d) list of impaired waters and disapproved the omission of several water bodies and associated pollutants that met federal listing requirements. U.S. EPA identified additional water bodies and pollutants for inclusion on the State's CWA section 303(d) list. On October 11, 2011, U.S. EPA issued its final decision regarding the waters U.S. EPA added to the State's CWA section 303(d) list.

The Facility discharges into Compton Creek. The 2010 State Water Board's California 303(d) list classifies Compton Creek as impaired. The pollutants and stressors of concern for Compton Creek include: benthic-macroinvertebrate bioassessment, coliform bacteria, copper, lead, pH, and trash. The following are adopted applicable TMDLs for the Los Angeles River, to which Compton Creek is a tributary and in which TMDLs for discharges to Compton Creek are addressed:

1. **Trash TMDL:** The Los Angeles River Trash TMDL was adopted by the Regional Water Board on September 19, 2001. The TMDL established a numeric target of zero trash in the Los Angeles River. The TMDL was to be implemented via storm water permits in a phased reduction for a period of 10 years. The Los Angeles River Trash TMDL became effective on August 28, 2002. There were legal challenges to the Los Angeles River Trash TMDL, which resulted in the TMDL being set aside by the Regional Water Board on June 8, 2006 and the State Water Board on July 17, 2006. The Regional Water Board adopted an amendment to the Los Angeles River Trash TMDL (Resolution No. 2007-012) on August 9, 2007. The State Water Board approved the TMDL on April 15, 2008. OAL approved the TMDL on July 1, 2008. The U.S. EPA approved the TMDL on July 24, 2008, and it became effective on September 23, 2008. This TMDL is implemented through Municipal Separate Storm Sewer System (MS4) NPDES permits. This Order requires a Storm Water Pollution Prevention Plan (SWPPP), which is expected when

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

implemented to minimize/prevent the discharge of trash from the Facility to the Los Angeles River Watershed. This Order is consistent with the intent of Resolution No. 2007-012.

2. **Nutrient TMDL for Los Angeles River:** The Regional Water Board adopted Resolution No. 03-009 on July 10, 2003, that amended the Basin Plan to incorporate a TMDL for Nutrients (nitrogen compounds and related effects) in the Los Angeles River (LA River Nutrients TMDL). The TMDL was approved by the State Water Board and Office of Administrative Law on November 19, 2003, and February 27, 2004, respectively. The LA River Nutrients TMDL was approved by USEPA on March 18, 2004, and it became effective on March 23, 2004. Subsequently, Resolution No. 2003-016 which revised the interim effluent limitations for ammonia, was adopted by the Regional Water Board on December 4, 2003. The State Water Board approved the TMDL with Resolution No. 2004-0014 on March 24, 2004. OAL approved the TMDL on September 27, 2004, and it became effective on the same date. The TMDL was amended again by Resolution No. R12-010 to incorporate site-specific objectives for select reaches and tributaries of the Los Angeles River watershed. This amendment was approved by the Regional Water Board on December 6, 2012; by the State Water Board on June 4, 2013; by the OAL on June 9, 2014; by the U.S. EPA on August 7, 2014; and became effective on August 7, 2014. The TMDL established WLAs for the Los Angeles River, to which Compton Creek is a tributary, for total ammonia and nitrate-nitrogen. This Order includes effluent limitations based on the LA River Nutrients TMDL.
3. **Metals TMDL for Los Angeles River:** The Regional Water Board adopted Resolution No. 2005-006 on June 2, 2005, that amended the Basin Plan to incorporate a TMDL for metals in the Los Angeles River (LA River Metals TMDL). The State Water Board approved the LA River Metals TMDL on October 20, 2005, and OAL approved the TMDL on December 9, 2005. U.S. EPA approved the metals TMDL on December 22, 2005, and it became effective on January 11, 2006. The LA River Metals TMDL establishes numeric water quality targets that are based on objectives established by U.S. EPA in the CTR. An amendment to the TMDL (Resolution No. R2007-014) was adopted by the Regional Water Board on September 6, 2007. The State Water Board and OAL approved the amendment on June 17, 2008, and October 17, 2008, respectively. U.S. EPA approved the amendment on October 14, 2008, and it became effective on October 29, 2008. The LA River Metals TMDL was subsequently amended by Resolution No. R10-003, which was adopted by the Regional Water Board on May 6, 2010; by the State Water Board on April 19, 2011; by the OAL on July 28, 2011; and by the U.S. EPA on November 3, 2011. The metals TMDL establishes numeric water quality targets that are based on objectives established by U.S. EPA in the CTR. Resolution No. R2007-014 establishes WLAs in Compton Creek for cadmium, copper, lead, and zinc in dry and wet weather events (defined where the maximum daily flow at station F319-R is greater than 500 cubic feet per second). This Order includes effluent limitations based on the LA River Metals TMDL.
4. **Bacteria TMDL for Los Angeles River Watershed:** The Regional Water Board adopted Resolution No. R10-007, *Amendment to the Water Quality Control Plan for the Los Angeles Region to Incorporate a TMDL for Indicator Bacteria in the Los Angeles River Watershed* (LA River Bacteria TMDL). The LA River Bacteria TMDL contains WLAs of single sample and geometric mean numeric targets for E.coli during both dry and wet weather events for general and individual NPDES permits. The LA River Bacteria TMDL was approved by the State Water Board on November 1, 2011; by the OAL on March 21, 2012; and by the U.S. EPA on March 23, 2012. It became effective on March 23, 2012. This Order includes effluent limitations based on the LA River Bacteria TMDL.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

E. Other Plans, Policies and Regulations – Not Applicable

IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

The CWA requires point source dischargers to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States. The control of pollutants discharged is established through effluent limitations and other requirements in NPDES permits. There are two principal bases for effluent limitations in the Code of Federal Regulations: 40 C.F.R. section 122.44(a) requires that permits include applicable technology-based limitations and standards; and 40 C.F.R. section 122.44(d) requires that permits include water quality-based effluent limitations to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water.

Order No. R4-2010-0161 established effluent limitations for a number of pollutants believed to be present in the discharge of storm water runoff from the resin manufacturing and processing Facility. Effluent limitations in Order No. R4-2010-0161 were established for pH, temperature, total suspended solids, total dissolved solids, BOD, oil and grease, phenols, sulfate, chloride, ammonia, nitrate, nitrite, total nitrate plus nitrite, cadmium, copper, lead, zinc, and acute toxicity. Due to the nature of products that are handled at the Facility (as explained in section II.A of this Fact Sheet), these constituents can be indicators of spills within the Facility. In addition, total petroleum hydrocarbons are pollutants of concern as these constituents were identified based on a review of pollutants commonly found in discharges from similar facilities and/or they were historically detected in the effluent.

Generally, mass-based effluent limitations ensure that proper treatment, and not dilution, is employed to comply with the final effluent concentration limitations. Section 122.45(f)(1) requires that all permit limitations, standards or prohibitions be expressed in terms of mass units except under the following conditions: (1) for pH, temperature, radiation or other pollutants that cannot appropriately be expressed by mass limitations; (2) when applicable standards or limitations are expressed in terms of other units of measure; or (3) if in establishing technology-based permit limitations on a case-by-case basis limitations based on mass are infeasible because the mass or pollutant cannot be related to a measure of production. The limitations, however, must ensure that dilution will not be used as a substitute for treatment.

A. Discharge Prohibitions

The discharge prohibitions are based on the requirements of the Basin Plan, State Water Board's plans and policies, the CWA, the Water Code, previous permit provisions, and are consistent with the requirements set for other discharges regulated by NPDES permits.

B. Technology-Based Effluent Limitations

1. Scope and Authority

Section 301(b) of the CWA and implementing U.S. EPA permit regulations at 40 C.F.R. section 122.44 require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Best Professional Judgment (BPJ) in accordance with 40 C.F.R. section 125.3.

The CWA requires that technology-based effluent limitations be established based on several levels of controls:

- a. Best practicable treatment control technology (BPT) represents the average of the best existing performance by well-operated facilities within an industrial category or

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

subcategory. BPT standards apply to toxic, conventional, and non-conventional pollutants.

- b. Best available technology economically achievable (BAT) represents the best existing performance of treatment technologies that are economically achievable within an industrial point source category. BAT standards apply to toxic and non-conventional pollutants.
- c. Best conventional pollutant control technology (BCT) represents the control from existing industrial point sources of conventional pollutants including BOD, TSS, fecal coliform, pH, and oil and grease. The BCT standard is established after considering a two-part reasonableness test. The first test compares the relationship between the costs of attaining a reduction in effluent discharge and the resulting benefits. The second test examines the cost and level of reduction of pollutants from the discharge from publicly owned treatment works to the cost and level of reduction of such pollutants from a class or category of industrial sources. Effluent limitations must be reasonable under both tests.
- d. New source performance standards (NSPS) represent the best available demonstrated control technology standards. The intent of NSPS guidelines is to set limitations that represent state-of-the-art treatment technology for new sources.

The CWA requires U.S. EPA to develop effluent limitations, guidelines and standards (ELGs) representing application of BPT, BAT, BCT, and NSPS. Section 402(a)(1) of the CWA and 40 C.F.R. section 125.3 authorize the use of best professional judgment (BPJ) to derive technology-based effluent limitations on a case-by-case basis where ELGs are not available for certain industrial categories and/or pollutants of concern. Where BPJ is used, the Regional Water Board must consider specific factors outlined in 40 C.F.R. section 125.3.

2. Applicable Technology-Based Effluent Limitations

Federal ELGs have not been developed for storm water runoff from polyester and alkyd resins manufacturing and processing facilities. Pursuant to section 122.44(k), the prior Order required the Discharger to develop and implement Best Management Practices (BMPs) and submit a Storm Water Pollution Prevention Plan (SWPPP). The Discharger updated their SWPPP on January 21, 2015, and it reflects current Facility operations. This Order will continue to require the Discharger to update and implement, consistent with the prior Order requirements, a SWPPP to outline site-specific management processes for minimizing storm water runoff contamination and for preventing contaminated storm water runoff from being discharged directly into the storm drain or receiving water or through the Facility's perimeters. At a minimum, the management practices should ensure that raw materials and chemicals (in all forms of primary containment) do not come into contact with storm water in any undiked areas, that all storm water in the process area is contained within the dike at all times, and unauthorized non-storm water discharges (including steam condensate from the Facility's process) do not occur at the Facility. This Order also requires the Discharger to update and implement, consistent with the prior Order requirements, a Best Management Practices Plan (BMPP) to establish site-specific procedures that will ensure proper operation and maintenance of transfer and storage areas, and to ensure that unauthorized non-storm water discharges (i.e. spills) do not occur at the Facility.

This Order will also require the Discharger to update and implement a Spill Contingency Plan (SCP). The SCP shall be site specific, to ensure that operational methods are in place to minimize the potential of on-site spills and to define specific procedures to be

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

implemented in the event of a spill. A Spill Prevention Control and Countermeasure Plan (SPCC), developed in accordance with 40 C.F.R. part 112, may be substituted for the SCP.

The combination of the SWPPP, BMPP, SCP, and permit limitations based on past performance and reflecting BPJ will serve as the equivalent of technology based effluent limitations, in the absence of established ELGs, in order to carry out the purposes and intent of the CWA.

The technology-based requirements in this Order are based on case-by-case numeric limitations developed using BPJ in accordance with 40 C.F.R. section 125.3. Effluent limitations were established in Order No. R4-2010-0161 for total suspended solids, phenols, oil and grease, and BOD at Discharge Point 001. This Order retains effluent limitations for the above except phenol based on BPJ and federal antibacksliding requirements. The limitations for these pollutants are consistent with technology-based effluent limitations (TBEL) included in other Orders within the State for similar types of discharges. The Regional Water Board considered other relevant factors pursuant to 40 C.F.R. section 125.3, and for the reasons described below with respect to the removal of TBEL for phenol and addition of TBEL for total petroleum hydrocarbons (TPH), concluded that the limitations are appropriate.

The effluent limitations for phenol were inherited from historical Orders for the Discharger and are no longer applicable. There have been significant modifications to the Facility with implementation of additional BMPs since the adoption of those limits. In addition, recent effluent monitoring results from the Discharger consistently show non-detected levels for phenols, providing evidence that there is no reasonable potential for phenol to be present in the current discharge. Therefore, removing these effluent limitations is appropriate based on BPJ and consistent with anti-backsliding requirements, with substantial modification made to the Facility as a result of implementation of additional BMPs during recent years. The Discharger is still required to monitor phenol in future discharges as stated in the MRP.

The Regional Water Board has included a new BPJ technology-based effluent limitation for TPH equal to 100 µg/L, as authorized by section 402(a)(1) of the CWA and 40 C.F.R. section 125.3. The Facility handles and manufactures a range of hydrocarbon materials, such as synthetic alkyd and saturated and unsaturated polyester (section II.A of this Fact Sheet provides a more detailed lists of the range of materials handled by the Facility), as part of its operations. Discharge from the Facility may include hydrocarbons that may become entrained in storm water. Rather than establishing individual effluent limitations on numerous hydrocarbon parameters, this Order includes a new BPJ technology-based effluent limitation for TPH to serve as an indicator pollutant. The technology-based effluent limitation represents the level achievable through BPT and BAT. In setting these limitations, the Regional Water Board considered the factors listed in 40 C.F.R. section 125.3(d)(1) and 125.3(d)(3), respectively. Effluent monitoring data for TPH (as diesel, as gasoline, and as waste oil) during the term of Order No. R4-2010-0161 showed detections in four of the five samples, with a maximum observed value of 690 µg/L as the sum of all three fractions of TPH. It is uncertain whether the Discharger has the capability of meeting the new limitations, changes to equipment, facilities, processes, or controls may be necessary.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Table F-4. Summary of Technology-based Effluent Limitations at Discharge Point 001

Parameter	Units	Effluent Limitations
		Maximum Daily
Total Suspended Solids (TSS)	mg/L	75
	lbs/day ²	210
BOD ₅ @ 20°C	mg/L	30
	lbs/day ²	85
Oil and Grease	mg/L	15
	lbs/day ²	43
Total Petroleum Hydrocarbons (TPH) ¹	µg/L	100
	lbs/day ²	0.28

¹ TPH equals the sum of TPH gasoline (C4-C12), TPH diesel (C13-C22), and TPH waste oil (C23+).

² Mass-based effluent limitations are based on a storm water discharge flow rate of 340,000 gpd.

C. Water Quality-Based Effluent Limitations (WQBELs)

1. Scope and Authority

CWA Section 301(b) and 40 C.F.R. section 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards.

40 C.F.R. Section 122.44(d)(1)(i) requires that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, water quality-based effluent limitations (WQBELs) must be established using: (1) U.S. EPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state's narrative criterion, supplemented with other relevant information, as provided in section 122.44(d)(1)(vi). WQBELs must also be consistent with the assumption and requirements of TMDL WLAs approved by U.S. EPA.

The process for determining reasonable potential and calculating WQBELs when necessary is intended to protect the designated beneficial uses of the receiving water as specified in the Basin Plan, and achieve applicable water quality objectives and criteria that are contained in other state plans and policies, or any applicable water quality criteria contained in the CTR and NTR.

The specific procedures for determining reasonable potential for discharges from the Facility, and if necessary for calculating WQBELs, are contained in the U.S. EPA Technical Support Document for Water Quality-Based Toxics Control (TSD) for storm water discharges and in the SIP for non-storm water discharges. The TSD in section 3.3.8 in the first paragraph on page 64 states: "*The statistical approach shown in Box 3-2 or an analogous approach developed by a regulatory authority can be used to determine the reasonable potential.*" The Regional Water Board has determined the procedures for determining reasonable potential and calculating WQBELs contained in the SIP for non-storm water discharges may be used to evaluate reasonable potential and calculate WQBELs for storm water discharges as well. As described in the statement from the

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

TSD, an analogous approach may also be used to evaluate reasonable potential and calculate WQBELs for storm water discharges as well. Hence, for this Order, the Regional Water Board has used the SIP methodology to evaluate reasonable potential for discharges through Discharge Point 001.

2. Applicable Beneficial Uses and Water Quality Criteria and Objectives

As noted in section II of the Limitations and Discharge Requirements of this Order, the Regional Water Board adopted a Basin Plan that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the Basin Plan. The beneficial uses applicable to Compton Creek are summarized in Section III.C.1 of this Fact Sheet. The Basin Plan includes both narrative and numeric water quality objectives applicable to the receiving water.

Priority pollutant water quality criteria in the CTR are applicable to the Compton Creek. The CTR contains both saltwater and freshwater criteria. Because a distinct separation generally does not exist between freshwater and saltwater aquatic communities, the following apply, in accordance with 40 C.F.R. section 131.38(c)(3). Freshwater criteria apply at salinities of 1 part per thousand (ppt) and below at locations where this occurs 95 percent or more of the time. The CTR criteria for freshwater or human health for consumption of organisms, or the applicable CCR Title 22 MCLs as listed in the Basin Plan, whichever is more stringent, are used to prescribe the effluent limitations in this Order to protect the beneficial uses of the Compton Creek, a water of the United States.

Table F-5 summarizes the applicable water quality criteria/objective for priority pollutants that were reported in detectable concentrations in the effluent at EFF-001 or receiving water at RSW-001, and are not addressed in any TMDLs applicable to Compton Creek. These criteria were used in conducting the RPA for this Order. Some water quality criteria are hardness dependent. Compton Creek ambient monitoring data was collected by the Discharger at Monitoring Location RSW-001 between October 2010 and December 2014. The median hardness value observed during this period was 93 mg/L as CaCO₃, which is the value used in the reasonable potential analysis.

Table F-5. Applicable Water Quality Criteria

CTR No.	Constituent	Selected Criteria	CTR/NTR Water Quality Criteria						Title 22
			Freshwater		Saltwater ¹		Human Health for Consumption of:		Maximum Contaminant Level
			Acute	Chronic	Acute	Chronic	Water & Org. ²	Organisms Only	
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	g/L
9	Nickel, Total Recoverable	49	442	49	--	--	--	4,600	100
12	Zinc, Total Recoverable	113	113	113	--	--	--	--	--
16	2,3,7,8-TCDD	1.4E-08	--	--	--	--	--	1.4E-08	3.0E-08
--	TCDD Equivalents ³	1.4E-08	--	--	--	--	--	1.4E-08	3.0E-08
20	Bromoform	360	--	--	--	--	--	360	--
23	Chlorodibromomethane	34	--	--	--	--	--	34	--
26	Chloroform	No Criteria	--	--	--	--	--	--	--
27	Dichlorobromomethane	46	--	--	--	--	--	46	--
38	Tetrachloroethylene	5	--	--	--	--	--	8.9	5
39	Toluene	150	--	--	--	--	--	200,000	150

¹ The receiving water body is not characterized as saltwater.

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

² Water quality criteria for the protection of human health for the consumption of water and organisms are not applicable to the receiving water body.

³ TCDD equivalents includes contribution from 2,3,7,8-TCDD.

LA River Metals TMDL. The TMDL establishes concentration-based dry weather WLAs in Compton Creek for copper and lead and concentration based wet weather WLAs for cadmium, copper, lead, and zinc. The numeric target portion of the TMDL specifies when the wet weather and dry weather targets (based on numeric water quality criteria established by the CTR) are applicable. Wet weather targets are applicable when the flow in the Los Angeles River at Wardlow gauge is greater than or equal to 500 cubic feet per second (cfs). Dry weather targets are applicable when flow in the Los Angeles River at station F319-R (Wardlow gauge) is less than 500 cfs. The TMDL states that permit writers may translate applicable WLAs into effluent limitations for the major, minor, and general NPDES permits by applying the effluent limitation procedures in Section 1.4 of the SIP or other applicable engineering practices authorized under federal regulations. This Order includes dry-weather effluent limitations for copper and lead, and wet weather effluent limitations for cadmium, copper, lead, and zinc based on the WLAs contained in the LA River Metals TMDL and applying the procedures in Section 1.4 of the SIP.

Table F-6 summarizes the dry and wet weather WLAs for cadmium, copper, lead, and zinc contained in the LA River Metals TMDL applicable to Compton Creek. These WLAs are applicable to Discharge Point 001 discharging to the Compton Creek, and are converted into effluent limitations by applying CTR-SIP procedures.

Table F-6. Metals TMDL Applicable Waste Load Allocations

Parameter	Units	Waste Load Allocation	
		Dry-Weather	Wet-Weather
Cadmium, Total Recoverable	µg/L	Not Applicable	3.1
Copper, Total Recoverable	µg/L	19	17
Lead, Total Recoverable	µg/L	8.9	62
Zinc, Total Recoverable	µg/L	Not Applicable	159

LA River Nutrients TMDL. The TMDL establishes concentration-based WLAs for minor point sources. The implementation portion of the TMDL states that WLAs shall be applied to minor point source dischargers on the effective date of the TMDL. This Order implements the applicable WLAs as required in the TMDLs. Table F-7 summarizes the WLAs applicable to the discharges under this Order:

Table F-7. Nutrients TMDL Applicable Waste Load Allocations

Parameter	Units	Waste Load Allocation	
		30-day Average	One-hour Average
Total Ammonia as N	mg/L	2.3	10.1
Nitrate as N	mg/L	8	--
Nitrite as N	mg/L	1	--
Nitrate plus nitrite as N	mg/L	8	--

LA River Bacteria TMDL. The LA River Bacteria TMDL contains WLAs of zero days of allowable exceedances of the single sample target of 235/100mL E.coli for both dry and wet weather (defined as days with 0.1 inch of rain or greater and the three days following

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

the rain event) and no exceedances of the geometric mean numeric target of 126/100 mL E.coli for general and individual NPDES permits. The calculation of the rolling 30-day geometric mean requires a statistically sufficient number of samples (generally, at least five equally spaced samples over a 30-day period). This Order includes effluent limitations based on the LA River Bacteria TMDL.

LA River Trash TMDL. The TMDL establishes WLAs for trash to the Los Angeles River and its tributaries applicable to municipal storm water permittees, including Caltrans. The implementation of the TMDL is specific to MS4 permittees within the Los Angeles River watershed. No specific WLAs are specified for non-municipal storm water NPDES permittees. However, the implementation of the SWPPP discussed in section IV.B.2 of this Fact Sheet is expected to prevent/minimize the discharge of trash to the Los Angeles River watershed from the Facility and is consistent with the intent of the TMDL.

3. Determining the Need for WQBELs

In accordance with Section 1.3 of the SIP, the Regional Water Board conducts a Reasonable Potential Analysis (RPA) for each priority pollutant with an applicable criterion or objective to determine if a WQBEL is required in the permit. The Regional Water Board analyzes effluent and receiving water data and identifies the maximum observed effluent concentration (MEC) and maximum background concentration (B) in the receiving water for each constituent, based on data provided by the Discharger. To determine reasonable potential, the MEC and the B are then compared with the applicable water quality objectives (C) outlined in the CTR, NTR, as well as the Basin Plan. For all pollutants that have a reasonable potential to cause or contribute to an excursion above a state water quality standard, numeric WQBELs are required.

Section 1.3 of the SIP provides the procedures for determining reasonable potential to exceed applicable water quality criteria and objectives. The SIP specifies three triggers to complete a RPA:

- a. Trigger 1 – if $MEC \geq C$, a limit is needed.
- b. Trigger 2 – If the background concentration (B) > C and the pollutant is detected in the effluent, a limit is needed.
- c. Trigger 3 – If other related information such as CWA section 303(d) listing for a pollutant, discharge type, compliance history, or other applicable factors indicate that a WQBEL is required.

Sufficient effluent and receiving water data are needed to conduct a complete RPA. If data are not sufficient, the Discharger will be required to gather the appropriate data for the Regional Water Board to conduct the RPA. Upon review of the data, and if the Regional Water Board determines that WQBELs are needed to protect the beneficial uses, the permit will be reopened for appropriate modification. Effluent and receiving water monitoring data collected by the Discharger from February 2010 through March 2015 was considered in the RPA.

The Regional Water Board developed WQBELs for cadmium, copper, lead, and zinc based on the waste load allocations included in the LA River Metals TMDL. The Regional Water Board also developed WQBELs for ammonia as nitrogen, nitrite as nitrogen, nitrate as nitrogen, and total nitrate plus nitrite as nitrogen based on the waste load allocations specified in the LA River Nutrients TMDL; and WQBELs for E. coli in accordance with the LA River Bacteria TMDL. The effluent limitations for these pollutants were established regardless of whether or not there is reasonable potential for the pollutants to be present in the discharge at levels that would cause or contribute to a

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

violation of water quality standards. The Regional Water Board developed water quality-based effluent limitations for these pollutants pursuant to 40 C.F.R. section 122.44(d)(1)(vii), which does not require or contemplate a reasonable potential analysis for effluent limitations consistent with the assumption and requirements of a TMDL WLA. Similarly, the SIP at Section 1.3 recognizes that reasonable potential analysis is not appropriate if a TMDL has been developed.

The RPA was performed for the priority pollutants regulated in the CTR for which data are available. Multiple sets of discharge data are available for Discharge Point 001 (Monitoring Location EFF-001) from October 2010 to March 2015. Ambient receiving water data from the same period were also available (i.e., 5 sampling events dating from 2010 through March 2015). Based on the RPA, cadmium (wet weather), copper (dry and wet weather), lead (dry and wet weather), TCDD-equivalents, and zinc (dry and wet weather) displayed reasonable potential in the discharge to cause or contribute to an excursion above water quality standards. Refer to Attachment J for a summary of the RPA and associated effluent limitation calculations. Order No. R4-2010-0161 established effluent limitations for zinc (dry weather) based on the requirements of the CTR and SIP. Based on the newly available data and RPA, zinc continues to display reasonable potential and effluent limitations for zinc have been included in this Order.

The following table summarizes results from the RPA.

Table F-8. Summary Reasonable Potential Analysis

CTR No.	Constituent	Applicable Water Quality Criteria (µg/L)	Maximum Effluent Concentration (µg/L)	Maximum Detected Receiving Water Concentration (µg/L)	RPA Result – Need Limitation?	Reason
4	Cadmium, Total Recoverable	3.5	0.20	<0.5	YES	TMDL ¹
6	Copper, Total Recoverable	19	7.9	31	YES	TMDL ¹
7	Lead, Total Recoverable	8.9	13	6.9	YES	MEC>C; TMDL ¹
9	Nickel, Total Recoverable	49	6.5	<0.5	NO	MEC<C; B<C
13	Zinc, Total Recoverable (dry weather)	113	146	336	YES	MEC>C
13	Zinc, Total Recoverable (wet weather)	174	146	336	YES	TMDL ¹
16	2,3,7,8-TCDD	1.3×10^{-8}	2.7×10^{-6}	2.8×10^{-6}	YES	MEC>C
--	TCDD-Equivalents ²	1.3×10^{-8}	3.1×10^{-6}	1.9×10^{-5}	YES	MEC>C
20	Bromoform	360	19	<0.5	NO	MEC<C; B<C
23	Chlorodibromomethane	34	26	<0.5	NO	MEC<C; B<C
26	Chloroform	No Criteria	5.7	<2	NO	MEC<C; B<C
27	Dichlorobromomethane	46	14	<0.5	NO	MEC<C; B<C
38	Tetrachloroethylene	5	0.91	<0.5	NO	MEC<C; B<C

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

CTR No.	Constituent	Applicable Water Quality Criteria (µg/L)	Maximum Effluent Concentration (µg/L)	Maximum Detected Receiving Water Concentration (µg/L)	RPA Result – Need Limitation?	Reason
39	Toluene	150	0.75	<2	NO	MEC<C; B<C

¹. A wet and/or dry weather limitation is required for this constituent, regardless of reasonable potential determination in order to implement the LA River Metals TMDL.

² TCDD equivalents includes contribution from 2,3,7,8-TCDD.

4. WQBEL Calculations

- a. If reasonable potential exists to exceed applicable water quality criteria or objectives, then a WQBEL must be established in accordance with one or more of the three procedures contained in section 1.4 of the SIP. These procedures include:
 - i. If applicable and available, use the WLA established as part of a TMDL.
 - ii. Use of a steady-state model to derive maximum daily effluent limitations (MDELs) and average monthly effluent limitations (AMELs).
 - iii. Where sufficient effluent and receiving water data exist, use of a dynamic model, which has been approved by the Regional Water Board.
- b. WQBELs for E.coli, cadmium, copper, lead, zinc, ammonia as nitrogen, nitrite as nitrogen, nitrate as nitrogen, and total nitrate plus nitrite as nitrogen are based on TMDLs applicable to Compton Creek.
- c. Since many of the streams in the Region have minimal upstream flows, mixing zones and dilution credits are usually not appropriate. Therefore, in this Order, no dilution credit is included.

WQBELs Calculation Example

Using total recoverable copper (dry weather and wet weather) and zinc (dry and wet weather) as examples, the following demonstrates how WQBELs were established for this Order. The tables in Attachment J summarize the development and calculation of all WQBELs for this Order using the process described below.

Concentration-Based Effluent Limitations

A set of AMEL and MDEL values are calculated separately, one set for the protection of aquatic life and the other for the protection of human health. The AMEL and MDEL limitations for aquatic life and human health are compared, and the most restrictive AMEL and the most restrictive MDEL are selected as the WQBEL.

Calculation of aquatic life AMEL and MDEL:

Step 1: For each constituent requiring an effluent limit, identify the applicable water quality criteria or objective. For each criterion determine the effluent concentration allowance (ECA) using the following steady state equation:

$$ECA = C + D(C-B) \quad \text{when } C > B, \text{ and}$$

$$ECA = C \quad \text{when } C \leq B,$$

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Where C = The priority pollutant criterion/objective, adjusted if necessary for hardness, pH and translators. In this Order a hardness value of 93 mg/L (as CaCO₃) was used for development of hardness-dependent criteria for Discharge Point 001, and a pH of 6.39 was used for pH-dependent criteria,

D = The dilution credit, and

B = The ambient background concentration.

As discussed above, for this Order, dilution was not allowed; therefore:

$$ECA = C$$

When a WLA has been established through a TMDL for a parameter, the WLA is set equal to the ECA. Note that for cadmium, copper, lead, and zinc, the acute criterion was used to develop the wet weather WLA and therefore wet weather WLA for these constituents will become the ECA_{acute}. Chronic criterion was used to develop dry weather WLA and therefore dry weather WLA will become the ECA_{chronic}. The chronic criterion is used for dry weather because it is the most protective and the most applicable to dry weather, which occurs for long, uninterrupted periods of time in the Los Angeles Region.

For total recoverable zinc (wet weather) the applicable water quality criteria is (reference Table F-6):

$$ECA_{acute} = 159 \mu\text{g/L (TMDL wet weather WLA)}$$

$$ECA_{chronic} = \text{Not Applicable (No dry weather WLA in TMDL)}$$

For total recoverable zinc (dry weather), there is no applicable TMDL WLA. Therefore, the aquatic life criteria for freshwater as specified in the CTR are used:

$$ECA_{acute} = 112.98 \mu\text{g/L}$$

$$ECA_{chronic} = 112.98 \mu\text{g/L}$$

For total recoverable copper the applicable water quality criteria are (reference Table F-6):

$$ECA_{acute} = 17 \mu\text{g/L (TMDL wet weather WLA)}$$

$$ECA_{chronic} = 19 \mu\text{g/L (TMDL dry weather WLA)}$$

Step 2: For each ECA based on aquatic life criterion/objective, determine the long-term average discharge condition (LTA) by multiplying the ECA by a factor (multiplier). The multiplier is a statistically based factor that adjusts the ECA to account for effluent variability. The value of the multiplier varies depending on the coefficient of variation (CV) of the data set and whether it is an acute or chronic criterion/objective. Table 1 of the SIP provides pre-calculated values for the multipliers based on the value of the CV. Equations to develop the multipliers are provided in Section 1.4, Step 3 of the SIP and will not be repeated here.

$$LTA_{acute} = ECA_{acute} \times \text{Multiplier}_{acute}$$

$$LTA_{chronic} = ECA_{chronic} \times \text{Multiplier}_{chronic}$$

The CV for the data set must be determined before the multipliers can be selected and will vary depending on the number of samples and the standard deviation of a data set.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

If the data set is less than 10 samples, or at least 80% of the samples in the data set are reported as non-detect, the CV shall be set equal to 0.6. In the case for copper and zinc, CVs are calculated in accordance to the SIP by dividing the estimated standard deviation by the arithmetic mean of the observed values.

The following values were used to develop the acute and chronic LTA using equations provided in Section 1.4, Step 3 of the SIP (Table 1 of the SIP also provides these values up to three decimals):

No. of Samples	CV	ECA Multiplier _{acute 99}	ECA Multiplier _{chronic 99}
Copper (dry weather)			
46	0.7	0.282	0.481
Copper (wet weather)			
46	0.7	0.282	0.481
Zinc (dry weather)			
46	1.14	0.181	0.335
Zinc (wet weather)			
46	1.14	0.181	0.335

Total recoverable copper (dry weather):

$LTA_{acute} = \text{Not applicable}$

$LTA_{chronic} = 19 \mu\text{g/L} \times 0.481 = 9.139 \mu\text{g/L}$

Total recoverable copper (wet weather):

$LTA_{acute} = 17 \mu\text{g/L} \times 0.282 = 4.79 \mu\text{g/L}$

$LTA_{chronic} = \text{Not applicable}$

Total recoverable zinc (dry weather):

$LTA_{acute} = 112.98 \mu\text{g/L} \times 0.181 = 20.5 \mu\text{g/L}$

$LTA_{chronic} = 112.98 \mu\text{g/L} \times 0.181 = 20.5 \mu\text{g/L}$

Total recoverable zinc (wet weather):

$LTA_{acute} = 159 \mu\text{g/L} \times 0.181 = 28.8 \mu\text{g/L}$

$LTA_{chronic} = \text{Not applicable}$

Step 3: Select the most limiting (lowest) of the LTA.

For copper, since the acute criteria will be used to develop the wet weather effluent limitations and chronic criteria will be used to develop the dry weather effluent limitations, we only have one criterion for each condition for the parameters listed in the LA River Metals TMDL; thus, both LTAs (wet and dry) will be used.

Since we only have acute criteria for total recoverable zinc (wet weather), the acute criterion must be used for wet weather zinc calculation. The acute and chronic values for dry weather zinc are the same as the chronic and acute aquatic life criteria.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Step 4: Calculate the WQBELs by multiplying the LTA by a factor (multiplier). WQBELs are expressed as Average Monthly Effluent Limitations (AMEL) and Maximum Daily Effluent Limitation (MDEL). The multiplier is a statistically based factor that adjusts the LTA for the averaging periods and exceedance frequencies of the criteria/objectives and the effluent limitations. The value of the multiplier varies depending on the probability basis, the coefficient of variation (CV) of the data set, the number of samples (for AMEL) and whether it is a monthly or daily limit. Table 2 of the SIP provides pre-calculated values for the multipliers based on the value of the CV and the number of samples. Equations to develop the multipliers in place of using values in the tables are provided in Section 1.4, Step 5 of the SIP and will not be repeated here.

$$\text{AMEL}_{\text{aquatic life}} = \text{LTA} \times \text{AMEL}_{\text{multiplier 95}}$$

$$\text{MDEL}_{\text{aquatic life}} = \text{LTA} \times \text{MDEL}_{\text{multiplier 99}}$$

AMEL multipliers are based on a 95th percentile occurrence probability, and the MDEL multipliers are based on the 99th percentile occurrence probability. If the number of samples is less than four (4), the default number of samples to be used is four (4).

For copper and zinc (wet weather), the following values were used to develop the AMEL and MDEL for aquatic life using equations provided in Section 1.4, Step 5 of the SIP (Table 2 of the SIP also provides this data up to two decimals):

No. of Samples Per Month	CV	Multiplier _{MDEL 99}	Multiplier _{AMEL 95}
For copper			
4	0.7	3.551	1.649
For zinc			
4	1.14	5.514	2.080

Total recoverable copper (dry weather):

$$\text{AMEL}_{\text{aquatic life}} = 9.139 \times 1.649 = 15.1 \mu\text{g/L}$$

$$\text{MDEL}_{\text{aquatic life}} = 9.139 \times 3.551 = 32.5 \mu\text{g/L}$$

Total recoverable copper (wet weather):

$$\text{AMEL}_{\text{aquatic life}} = 4.79 \times 1.649 = 7.90 \mu\text{g/L}$$

$$\text{MDEL}_{\text{aquatic life}} = 4.79 \times 3.551 = 17.0 \mu\text{g/L}$$

Total recoverable zinc (dry weather):

$$\text{AMEL}_{\text{aquatic life}} = 20.5 \times 2.080 = 42.5 \mu\text{g/L}$$

$$\text{MDEL}_{\text{aquatic life}} = 20.5 \times 5.514 = 112.76 \mu\text{g/L}$$

Total recoverable zinc (wet weather):

$$\text{AMEL}_{\text{aquatic life}} = 28.8 \times 2.080 = 60.0 \mu\text{g/L}$$

$$\text{MDEL}_{\text{aquatic life}} = 28.8 \times 5.514 = 159 \mu\text{g/L}$$

Calculation of human health AMEL and MDEL:

Step 5: For the ECA based on human health, set the AMEL equal to the ECA_{human health}

$$\text{AMEL}_{\text{human health}} = \text{ECA}_{\text{human health}}$$

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

For copper and zinc, this is not necessary since the WLAs were based on a TMDL; also, there is also no human health criteria for zinc in the CTR for these parameters. Therefore, AMELs based on human health criteria for copper and zinc are not appropriate.

Step 6: Calculate the MDEL for human health by multiplying the AMEL by the ratio of the Multiplier_{MDEL} to the Multiplier_{AMEL}. Table 2 of the SIP provides pre-calculated ratios to be used in this calculation based on the CV and the number of samples.

$$\text{MDEL}_{\text{human health}} = \text{AMEL}_{\text{human health}} \times (\text{Multiplier}_{\text{MDEL}} / \text{Multiplier}_{\text{AMEL}})$$

This step is not applicable for the parameters addressed in this Order.

Step 7: Select the lower of the AMEL and MDEL based on aquatic life and human health as the water-quality based effluent limit for the Order.

For the parameters subject to the LA River Metals TMDL, such as cadmium, copper, lead, and zinc, a comparison is not necessary and the effluent limitations are applied directly.

Final WQBELs:

Parameters	AMEL	MDEL
Total Recoverable Copper (dry weather)	15.1	32.5
Total Recoverable Copper (wet weather)	7.90	17.0
Total Recoverable Zinc (dry weather)	42.5	113
Total Recoverable Zinc (wet weather)	60.0	159

Since the Facility discharges storm water runoff only and the occurrence of discharge is infrequent, only MDELs are prescribed in this Order (except for nitrite as nitrogen, nitrate as nitrogen, and total nitrate plus nitrite as nitrogen as explained below).

For cadmium (wet weather), copper (wet and dry weather), lead (wet and dry weather), and zinc (wet weather), there are no human health (Consumption of Organism Only) criteria, and WLAs have been established based on the LA River Metals TMDL; therefore, the established effluent limitations are based on aquatic life criteria used for the LA River Metals TMDL WLAs. There are no human health criteria for zinc (dry weather); therefore, the established effluent limitations are based on the aquatic life criteria as listed in the CTR.

In accordance with the LA River Nutrients TMDL, this Order applies the 1-hour average WLA for ammonia directly as the MDEL for ammonia, and applies the 30-day average WLAs for nitrite as nitrogen, nitrate as nitrogen, and total nitrate plus nitrite as nitrogen directly as average monthly (30-day average) effluent limitations for these parameters. The limitations for ammonia, nitrite as nitrogen, nitrate as nitrogen, and total nitrate plus nitrite as nitrogen included in this Order are consistent with the limits included in Order No. R4-2010-0161 for these parameters, and with the intent of the Los Angeles River Nutrient TMDL.

~~The pollutants that were not addressed by TMDLs were evaluated as follows. Human health criteria in the CTR for 2,3,7,8-TCDD were used for 2,3,7,8-TCDD and TCDD equivalents. The calculation of TCDD equivalents includes the quantification~~

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

of the amount of 2,3,7,8-TCDD present in the discharge. These limitations included for TCDD equivalents in this Order are expected to be protective of the beneficial uses of Compton Creek. Final WQBELs for each are summarized in Table F-98 of this Fact Sheet.

5. WQBELs Based on Basin Plan Objectives

The following Basin Plan Objectives, evaluated with respect to effluent monitoring data and Facility Operations, are applicable to the Discharger:

- a. **pH.** The pH of inland surface waters shall not be depressed below 6.5 or raised above 8.5 as a result of waste discharge. Ambient pH levels shall not be changed more than 0.5 units from natural conditions as a result of waste discharge. This Order includes effluent and receiving water limitations for pH to ensure compliance with Basin Plan Objectives for pH.
- b. **Dissolved Oxygen.** Depress the concentration of dissolved oxygen to fall below 5.0 mg/L anytime, and the median dissolved oxygen concentration for any three consecutive months shall not be less than 80 percent of the dissolved oxygen content at saturation. This Order addresses dissolved oxygen through receiving water monitoring and receiving water limitations.
- c. **Turbidity.** Where natural turbidity is between 0 to 50 NTU, increases shall not exceed 20%. Where natural turbidity is greater than 50 NTU, increases shall not exceed 10%. This Order addresses turbidity through receiving water monitoring and receiving water limitations.
- d. **Temperature.** The Basin Plan lists temperature requirements for the receiving waters and references the Thermal Plan. Based on the requirements of the Thermal Plan and a white paper developed by Regional Water Board staff titled *Temperature and Dissolved Oxygen Impacts on Biota in Tidal Estuaries and Enclosed Bays in the Los Angeles Region*, a maximum effluent temperature limitation of 86°F was determined to be appropriate for protection of aquatic life and is included in the permit. The white paper evaluated the optimum temperatures for aquatic species routinely available in surface water bodies within the Los Angeles Region including: steelhead, topsmelt, ghost shrimp, brown rock crab, jackknife clam, and blue mussel. This Order addresses the water quality objective for temperature by establishing effluent limitations based on the interpretation of the Thermal Plan and the White Paper.
- e. **Total Suspended Solids.** The Basin Plan requires that, "Waters shall not contain suspended or settleable material in concentrations that cause nuisance or adversely affect beneficial uses." This narrative objective has been translated into a numeric effluent limit, based on U.S. EPA's *Quality Criteria for Water* (commonly known as the "Gold Book"). In the Gold Book, U.S. EPA notes that "In a study downstream from a discharge where inert suspended solids were increased to 80 mg/L, the density of macroinvertebrates decreased by 60 percent...". This indicates that suspended solids concentrations of 80 mg/L in the receiving water resulted in adverse effects to aquatic life. As such, the Regional Water Board implemented an MDEL of 75 mg/L for the implementation of the narrative water quality objective for solids. These limitations are consistent with the limitations in Order No. R4-2010-0161 and are retained as the technology-based effluent limitations.
- f. **TDS, Sulfate, and Chloride.** Water quality objectives for TDS, sulfate, chloride for Compton Creek are established in the Basin Plan in Table 3-10 and are included in this Order.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

6. Whole Effluent Toxicity (WET)

Whole effluent toxicity (WET) protects the receiving water quality from the aggregate toxic effect of a mixture of pollutants in the effluent. WET tests measure the degree of response of exposed aquatic test organisms to an effluent. The WET approach allows for protection of the narrative “no toxics in toxic amounts” criterion while implementing numeric criteria for toxicity. There are two types of WET tests: acute and chronic. An acute toxicity test is conducted over a short time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and may measure mortality, reproduction, and growth.

The Basin Plan specifies a narrative objective for toxicity, requiring that all waters be maintained free of toxic substances in concentrations that are lethal to or produce other detrimental responses by aquatic organisms. Detrimental response includes, but is not limited to, decreased growth rate, decreased reproductive success of resident or indicator species, and/or significant alterations in population, community ecology, or receiving water biota. Order No. R4-2010-0161 contained acute toxicity limitations and monitoring requirements in accordance with the Basin Plan, in which the acute toxicity objective for discharges dictates that the average survival in undiluted effluent for any three consecutive 96-hour static or continuous flow bioassay tests shall be at least 90%, with no single test having less than 70% survival. For the period of January 2010, through December 2014, effluent acute toxicity monitoring results were 100% survival for all sample events.

Chronic toxicity is a more stringent requirement than acute toxicity. A chemical at a low concentration can have chronic effects but no acute effects. Because discharge from the Facility may include a number of chemicals, which individually may not be present in toxic concentrations while exhibiting aggregated toxic effects as a whole, this Order prescribes a chronic toxicity effluent limitation and requires chronic toxicity monitoring for the effluent at Discharge Point 001. The whole effluent toxicity testing requirements are based on U.S. EPA’s 2010 Test of Significant Toxicity (TST) statistical approach. In 2010, U.S. EPA endorsed the peer-reviewed Test of Significant Toxicity (TST) statistical approach in *National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document* (EPA 833-R-10-003, 2010) as an improved statistical tool to evaluate data from USEPA’s toxicity test methods. The TST statistical approach more reliably identifies toxicity than the current no observed effect concentration (NOEC) statistical approach. TST statistical results are also more transparent than the point estimate model approach used for acute toxicity that is not designed to address the question of statistical uncertainty around the modeled toxicity test result in relation to the effect level of concern. The TST statistical approach is the superior statistical approach for addressing statistical uncertainty when used in combination with USEPA’s toxicity test methods and is implemented in federal permits issued by U.S. EPA Region 9.

The TST’s null hypothesis for chronic toxicity is:

H_0 : Mean response (In-stream Waste Concentration (IWC) in % effluent) \leq (0.75 x mean response (Control)).

Results obtained from a single-concentration chronic toxicity test are analyzed using the TST statistical approach and an acceptable level of chronic toxicity is demonstrated by rejecting the null hypothesis and reporting “Pass” or “P”. Chronic toxicity results are expressed as “Pass” or “Fail” and “% Effect. The chronic toxicity IWCs for Discharge Points 001 is 100 percent effluent.

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

7. Final WQBELs

Table F-9. Summary of Water Quality-based Effluent Limitations – EFF-001

Parameter	Units	Effluent Limitations			
		Average Monthly (30-Day Average)	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
pH	s.u.	--	--	6.5	8.5
Temperature	°F	--	--	--	86
Chronic Toxicity	Pass or Fail and % Effect (for TST Statistical Approach)	--	Pass or % Effect <50 ³	--	--
Total Dissolved Solids	mg/L	--	1500	--	--
	lbs/day ¹	--	4300	--	--
Sulfate	mg/L	--	350	--	--
	lbs/day ¹	--	990	--	--
Chloride	mg/L	--	150	--	--
	lbs/day ¹	--	430	--	--
Ammonia as Nitrogen ⁷	mg/L	--	10.1	--	--
	lbs/day ¹	--	28.6	--	--
Nitrite as Nitrogen ⁷	mg/L	1.0	--	--	--
	lbs/day ¹	2.8	--	--	--
Nitrate as Nitrogen ⁷	mg/L	8.0	--	--	--
	lbs/day ¹	23	--	--	--
Nitrate-Nitrogen plus Nitrite-Nitrogen, Total ⁷	mg/L	8.0	--	--	--
	lbs/day ¹	23	--	--	--
E.coli	CFU/100mL or MPN/100mL	4			
Cadmium, Total Recoverable (Wet Weather) ^{2,5}	µg/L	--	3.1	--	--
	lbs/day ¹	--	0.0088	--	--
Copper, Total Recoverable (Dry Weather) ^{2,6}	µg/L	--	32	--	--
	lbs/day ¹	--	0.091	--	--
Copper, Total Recoverable (Wet Weather) ^{2,5}	µg/L	--	17	--	--
	lbs/day ¹	--	0.048	--	--
Lead, Total Recoverable (Dry Weather) ^{2,6}	µg/L	--	15	--	--
	lbs/day ¹	--	0.043	--	--
Lead, Total Recoverable (Wet Weather) ^{2,5}	µg/L	--	62	--	--
	lbs/day ¹	--	0.18	--	--
Zinc, Total Recoverable (Dry Weather) ^{2,6}	µg/L	--	113	--	--
	lbs/day ¹	--	0.32	--	--
Zinc, Total Recoverable (Wet Weather) ^{2,5}	µg/L	--	159	--	--
	lbs/day ¹	--	0.45	--	--

**R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E**

Parameter	Units	Effluent Limitations			
		Average Monthly (30-Day Average)	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
2,3,7,8-TCDD	µg/L	--	2.8×10^{-8}	--	--
	lbs/day¹	--	7.9×10^{-11}	--	--
TCDD Equivalents	µg/L	--	2.8×10^{-8}	--	--
	lbs/day ¹	--	7.9×10^{-11}	--	--

- Mass-based effluent limitations are based on a storm water discharge of 0.34 MGD and are calculated as follows:
Flow (MGD) x Concentration (mg/L) x 8.34 (conversion factor) = lbs/day.
- The effluent limitations are based on the LA River Metals TMDL WLAs using the CTR-SIP procedures.
- Report "Pass" or "Fail" and "% Effect" for Maximum Daily Effluent Limitation (MDEL). During a calendar month, exactly three independent toxicity tests are required for routine monitoring when one toxicity test results in "Fail".
- The LA River Bacteria TMDL contains WLAs of zero days of allowable exceedances of the single sample target of 235/100mL *E.coli* for both dry and wet weather (defined as days with 0.1 inch of rain or greater and the three days following the rain event) and no exceedances of the geometric mean TMDL numeric target of 126/100 mL *E.coli* for general and individual NPDES permits. The calculation of the rolling 30-day geometric mean requires a statistically sufficient number of samples (generally, at least five equally spaced samples over a 30-day period).
- The wet weather TMDL limits apply when the maximum daily flow in the Los Angeles River at Wardlow gauge station (F319-R) is greater than or equal to 500 cubic feet per second (cfs).
- Dry weather targets are applicable when flow in the Los Angeles River at the Wardlow stream gauge station (F319-R) is less than 500 cfs.
- The MDEL for ammonia and AMEL for nitrite, nitrate, and total nitrate and nitrite as nitrogen are based on their respective WLAs as included in the LA River Nutrients TMDL. The 1-hour average WLA for ammonia is translated into MDEL in accordance to the LA River Nutrient TMDL. The 30-day average WLAs for nitrite, nitrate, and total nitrate plus nitrite in the TMDL are translated into AMELs to ensure the protection of aquatic life.

D. Final Effluent Limitation Considerations

Dry-weather effluent limitations for copper and lead, and wet-weather limitations for cadmium, copper, lead, and zinc are included consistent with Order No. R4-2010-0161 and TMDLs for the Los Angeles River; the mass-based effluent limitations for these parameters are modified in this Order to correct for a unit conversion error in the calculations of the mass-based effluent limitations for these parameters in Order No. R4-2009-0161. Effluent limitations for ammonia-nitrogen, nitrate-nitrogen, nitrite-nitrogen, and nitrate-nitrogen plus nitrite-nitrogen are consistent with Order No. R4-2010-0161 and the intent of the LA River Nutrients TMDL. In addition, this Order establishes new effluent limitations for *E. coli* which are based on the LA River Bacteria TMDL. Effluent limitations for TSS, BOD, oil and grease, sulfates, TDS, sulfate, and chloride from Order R4-2010-0161, consistent with the Basin Plan water quality objectives, are also included. Chronic toxicity effluent limitation, evaluated using the TST statistical approach, is also included.

New effluent limitations are established based on CTR and SIP procedures for pollutants that exhibited reasonable potential (zinc in dry weather, ~~2,3,7,8-TCDD~~, and TCDD equivalents) based on available effluent monitoring data. Refer to Attachment J for a summary of the RPA and associated effluent limitation calculations. This Order also establishes a new TBEL for TPH based on BPJ and consistent with 40 C.F.R. section 125.3.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

1. Anti-Backsliding Requirements

Sections 402(o) and 303(d)(4) of the CWA and federal regulations at 40 C.F.R. section 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require effluent limitations in a reissued permit to be as stringent as those in the previous permit, with some exceptions where limitations may be relaxed. All effluent limitations in this Order are at least as stringent as the effluent limitations in the previous Order, with the exception of the removal of technology-based effluent limitations for phenol. As discussed below, the relaxations of effluent limitations for phenol are consistent with the anti-backsliding exceptions allowed in the CWA and federal regulations.

The effluent limitations for phenols in Order No. R4-2010-0161 are inherited from historical Orders. Since the introduction of these limitations, the Facility has implemented additional BMPs, and monitoring results for phenols from recent discharges were consistently non-detected, demonstrating the Facility's ability to comply with the effluent limits and that there is no reasonable potential for phenols to exceed applicable limits. Monitoring requirements for phenols are included in this Order, as stated in the MRP. The removal of effluent limitations for phenol that were included in the previous Order are consistent with the exceptions to the anti-backsliding requirements of the CWA and federal regulations, based on consideration of recent modifications to the Facility with the implementation of additional BMPs since the adoption of Order No. R4-2010-0161.

Order No. R4-2010-0161 contained an acute toxicity effluent limitation in accordance with the Basin Plan's narrative objective for toxicity. This Order includes a chronic toxicity effluent limitation which is assessed using the TST statistical approach, and which, under this testing framework, is protective of the Basin Plan's narrative objective for toxicity. The chronic toxicity limitation is more stringent than the acute toxicity limitation. Therefore, consistent with section 402(o)(2)(B) the acute toxicity limitation is redundant and the limit contained in the previous permit has not been retained in this Order.

2. Antidegradation Policies

40 C.F.R. section 131.12 requires that the state water quality standards include an anti-degradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies. Compliance with these requirements will result in the use of best practicable treatment or control of the discharge.

The permitted discharge is not a new discharge. The discharge is temporally limited, lasting only during the storm event that necessitates the discharge. This Order does not provide for an increase in the permitted design flow or allow for a reduction in the level of treatment.

This NPDES permit includes effluent limits to ensure that the discharge does not adversely impact the beneficial uses of the Compton Creek or degrade water quality. The inclusion of the effluent limitations and prohibitions in the NPDES permit, which ensure that any discharge would not result in the lowering of water quality, coupled with the fact that the discharge occurs infrequently and is temporally limited, support the conclusion that no degradation will arise as a result of reissuing this Order.

Removal of the effluent limitations for phenols will not result in the degradation of high quality waters, because sampling conducted after improvements in the BMPs at the

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Facility consistently resulted in non-detected level of phenol that does not have a reasonable potential to cause an excursion above its applicable water quality standard.

The effluent limitations in this Order hold the Discharger to performance levels that will not cause or contribute to water quality impairments or water quality degradation. The effluent limitations, receiving water limitations, and monitoring requirements ensure that excursions in excess of the water quality limits that are designed to protect beneficial uses will be apparent and addressed immediately. Further, compliance with these requirements will result in the use of best practicable treatment or control of the discharge. Therefore, the permitted discharge is consistent with the state's antidegradation policy.

3. Mass-based Effluent Limitations

Generally, mass-based effluent limitations ensure that proper treatment, and not dilution, is employed to comply with the final effluent concentration limitations. 40 C.F.R. 122.45(f)(1) requires that all permit limitations, standards or prohibitions be expressed in terms of mass units except under the following conditions: (1) for pH, temperature, radiation or other pollutants that cannot appropriately be expressed by mass limitations; (2) when applicable standards or limitations are expressed in terms of other units of measure; or (3) if in establishing technology-based permit limitation on a case-by-case basis, limitation based on mass are infeasible because the mass or pollutant cannot be related to a measure of production.

Mass-based effluent limitations are established using the following formula:

Mass (lbs/day) = flow rate (MGD) x 8.34 x effluent limitation (mg/L)

where: Mass = mass limitation for a pollutant (lbs/day)

Effluent limitation = concentration limit for a pollutant (mg/L)

Flow rate = discharge flow rate (MGD)

4. Stringency of Requirements for Individual Pollutants

This Order contains both technology-based and water quality-based effluent limitations for individual pollutants. The technology-based effluent limitations consist of restrictions on BOD, TSS, oil and grease, and TPH. Restrictions on these pollutants are discussed in section IV.B of the Fact Sheet. This Order's technology-based pollutant restrictions implement the minimum, applicable federal technology-based requirements.

Water quality-based effluent limitations have been derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable federal water quality standards. To the extent that toxic pollutant water quality-based effluent limitations were derived from the CTR, the CTR is the applicable standard pursuant to 40 C.F.R. section 131.38. The procedures for calculating the individual water quality-based effluent limitations for priority pollutants are based on the CTR implemented by the SIP, which was approved by U.S. EPA on May 18, 2000. All beneficial uses and water quality objectives contained in the Basin Plan were approved under state law and submitted to and approved by U.S. EPA prior to May 30, 2000. Any water quality objectives and beneficial uses submitted to U.S. EPA prior to May 30, 2000, but not approved by U.S. EPA before that date, are nonetheless "applicable water quality standards for purposes of the CWA" pursuant to 40 C.F.R. section 131.21(c)(1). Collectively, this Order's restrictions on individual pollutants are no more stringent than required to implement the requirements of the CWA.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

5. Summary of Final Effluent Limitations

Table F-10. Summary of Final Effluent Limitations at Discharge Point 001

Parameter	Units	Effluent Limitations				Basis ¹
		Average Monthly (30-Day Average)	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum	
Conventional Pollutants						
Biochemical Oxygen Demand (BOD ₅ @ 5-day; 20 deg. C)	mg/L	--	30	--	--	E, BPJ
	lbs/day ²	--	85	--	--	
Oil and Grease	mg/L	--	15	--	--	E, BPJ
	lbs/day ²	--	43	--	--	
pH	standard units	--	--	6.5	8.5	E, BP
Total Suspended Solids (TSS)	mg/L	--	75	--	--	E, BPJ
	lbs/day ²	--	210	--	--	
Non-Conventional Pollutants						
Chronic Toxicity ⁷	Pass or Fail and % Effect (for TST Statistical Approach)	--	Pass or % Effect <50	--	--	BP
<i>E. coli</i>	CFU/100mL or MPN/100mL	4				TMDL
Ammonia, Total (as Nitrogen) ⁵	mg/L	--	10.1	--	--	TMDL, BP
	lbs/day ²	--	28.6	--	--	
Chloride	mg/L	--	150	--	--	E, BP
	lbs/day ²	--	430	--	--	
Nitrate-nitrogen (as N) ⁵	mg/L	8.0	--	--	--	TMDL
	lbs/day ²	23	--	--	--	
Nitrite-nitrogen (as N) ⁵	mg/L	1.0	--	--	--	TMDL
	lbs/day ²	2.8	--	--	--	
Nitrate-nitrogen + Nitrite-nitrogen (as N) ⁵	mg/L	8.0	--	--	--	TMDL
	lbs/day ²	23	--	--	--	
Sulfate	mg/L	--	350	--	--	E, BP
	lbs/day ²	--	990	--	--	
Temperature	Degrees F	--	--	--	86	E, BP, TP, WP
Total Dissolved Solids	mg/L	--	1500	--	--	E, BP
	lbs/day ²	--	4300	--	--	
Total Petroleum Hydrocarbons ³	µg/L	--	100	--	--	BPJ
	lbs/day ²	--	0.28	--	--	
Priority Pollutants						
Cadmium, Total Recoverable, Wet Weather ^{6,8}	µg/L	--	3.1	--	--	TMDL
	lbs/day ²	--	0.0088	--	--	

REVISED TENTATIVE

Parameter	Units	Effluent Limitations				Basis ¹
		Average Monthly (30-Day Average)	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum	
Copper, Total Recoverable, Wet Weather ^{6,8}	µg/L	--	17	--	--	TMDL
	lbs/day ²	--	0.048	--	--	
Copper, Total Recoverable, Dry Weather ^{6,9}	µg/L	--	32	--	--	TMDL
	lbs/day ²	--	0.091	--	--	
Lead, Total Recoverable, Wet Weather ^{6,8}	µg/L	--	62	--	--	TMDL
	lbs/day ²	--	0.18	--	--	
Lead, Total Recoverable, Dry Weather ^{6,9}	µg/L	--	15	--	--	TMDL
	lbs/day ²	--	0.043	--	--	
2,3,7,8-TCDD	µg/L	--	2.8×10^{-8}	--	--	CTR, SIP
	lbs/day ²	--	7.9×10^{-11}	--	--	
TCDD Equivalents ¹⁰	µg/L	--	2.8×10^{-8}	--	--	CTR, SIP
	lbs/day ²	--	7.9×10^{-11}	--	--	
Zinc, Total Recoverable, Wet Weather ^{6,8}	µg/L	--	159	--	--	TMDL
	lbs/day ²	--	0.45	--	--	
Zinc, Total Recoverable, Dry Weather ⁹	µg/L	--	113	--	--	CTR, SIP
	lbs/day ²	--	0.32	--	--	

¹ E = Existing Requirement; BPJ = Best Professional Judgment; BP = Basin Plan; TMDL = Total Maximum Daily Load; CTR = California Toxic Rule; SIP = State Implementation Policy; WP = White Paper

² The mass limitations are based on a maximum flow of 0.34 MGD and is calculated as follows:

$$\text{Flow (MGD)} \times \text{Concentration (mg/L)} \times 8.34 \text{ (conversion factor)} = \text{lbs/day}$$

³ TPH equals the sum of TPH gasoline (C4-C12) and TPH diesel (C13-C22), and TPH waste oil (C23+).

⁴ The effluent limitation is based on the LA River Bacteria TMDL WLAs. The LA River Bacteria TMDL contains WLAs of zero days of allowable exceedances of the single sample target of 235/100mL E.coli for both dry and wet weather (defined as days with 0.1 inch of rain or greater and the three days following the rain event) and no exceedances of the geometric mean TMDL numeric target of 126/100 mL E.coli for general and individual NPDES permits. The rolling 30-day geometric mean values should be calculated based on a statistically sufficient number of samples (generally not less than 5 samples equally spaced over a 30-day period). If any of the single sample limits are exceeded, the Regional Water Board may require repeat sampling on a daily basis until the sample falls below the single sample limit in order to determine persistence of exceedance. Results collected during this accelerated monitoring period can be used to calculate the rolling 30-day geometric mean.

⁵ The effluent limitations are based on the LA River Nutrients TMDL WLAs. The 1-hour average WLA for ammonia is translated into MDEL in accordance to the LA River Nutrients TMDL; the AMEL for nitrite, nitrate, and total nitrate and nitrite as nitrogen are translated based on their respective 30-day average WLAs as included in the LA River Nutrients TMDL to ensure the protection of aquatic life.

⁶ The effluent limitations are based on the LA River Metals TMDL WLAs and calculated using the CTR-SIP procedures.

⁷ Report "Pass" or "Fail" and "% Effect" for Maximum Daily Effluent Limitation (MDEL). During a calendar month, exactly three independent toxicity tests are required for routine monitoring when one toxicity test results in "Fail". This limit applies for wet weather discharges only.

⁸ The wet weather TMDL limits apply when the maximum daily flow in the Los Angeles River at Wardlow gauge station (F319-R) is greater than or equal to 500 cubic feet per second (cfs).

REVISED TENTATIVE

- ⁹ Dry weather targets are applicable when flow in the Los Angeles River at the Wardlow stream gauge station (F319-R) is less than 500 cfs.
- ¹⁰ TCDD equivalents shall be calculated using the following formula, where the MLs and the toxicity equivalency factors (TEFs) are as listed in the Table below. The Discharger shall report all measured values of individual congeners, including data qualifiers. When calculating TCDD equivalents, the Discharger shall set congener concentrations below the MLs to zero. U.S. EPA method 1613 may be used to analyze dioxin and furan congeners.

$$\text{Dioxin-TEQ (TCDD equivalents)} = \sum(Cx \times \text{TEF}_x)$$

where: Cx = concentration of dioxin or furan congener x
TEF_x = TEF for congener x

Congeners	Minimum Levels (pg/L)	Toxicity Equivalence Factor (TEF)
2,3,7,8 - tetra CDD	10	1.0
1,2,3,7,8 - penta CDD	50	1.0
1,2,3,4,7,8 - hexa CDD	50	0.1
1,2,3,6,7,8 - hexa CDD	50	0.1
1,2,3,7,8,9 - hexa CDD	50	0.1
1,2,3,4,6,7,8 - hepta CDD	50	0.01
Octa CDD	100	0.0001
2,3,7,8 - tetra CDF	10	0.1
1,2,3,7,8 - penta CDF	50	0.05
2,3,4,7,8 - penta CDF	50	0.5
1,2,3,4,7,8 - hexa CDF	50	0.1
1,2,3,6,7,8 - hexa CDF	50	0.1
1,2,3,7,8,9 - hexa CDF	50	0.1
2,3,4,6,7,8 - hexa CDF	50	0.1
1,2,3,4,6,7,8 - hepta CDFs	50	0.01
1,2,3,4,7,8,9 - hepta CDFs	50	0.01
Octa CDF	100	0.0001

E. Interim Effluent Limitations – Not Applicable

F. Land Discharge Specifications – Not Applicable

G. Recycling Specifications – Not Applicable

V. RATIONALE FOR RECEIVING WATER LIMITATIONS

The receiving water limitations in this Order are based upon the water quality objectives contained in the Basin Plan. As such, they are a required part of the Order.

A. Surface Water

The Basin Plan contains numeric and narrative water quality objectives applicable to all surface waters within the Los Angeles Region. Water quality objectives include an objective to maintain the high quality waters pursuant to federal regulations (40 C.F.R. section 131.12) and State Water Board Resolution No. 68-16. Receiving water limitations in this Order are included to ensure protection of the beneficial uses of the receiving water and are based on the water quality objectives contained in the Basin Plan. If there is reasonable potential (RP) or a U.S. EPA-approved TMDL WLA, then WQBELs are included in this Order to ensure protection of the water quality standards.

B. Groundwater – Not Applicable

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

VI. RATIONALE FOR PROVISIONS

A. Standard Provisions

Standard Provisions, which apply to all NPDES permits in accordance with 40 C.F.R. section 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 C.F.R. section 122.42, are provided in Attachment D. The Discharger must comply with all standard provisions and with those additional conditions that are applicable under section 122.42.

Sections 122.41(a)(1) and (b) through (n) of 40 C.F.R. establish conditions that apply to all state-issued NPDES permits. These conditions must be incorporated into the permits either expressly or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. Section 123.25(a)(12) of 40 C.F.R. allows the state to omit or modify conditions to impose more stringent requirements. In accordance with 40 C.F.R. section 123.25, this Order omits federal conditions that address enforcement authority specified in 40 C.F.R. sections 122.41(j)(5) and (k)(2) because the enforcement authority under the Water Code is more stringent. In lieu of these conditions, this Order incorporates by reference Water Code section 13387(e).

B. Special Provisions

1. Reopener Provisions

These provisions are based on 40 C.F.R. part 123 of and Order No. R4-2010-0161. The Regional Water Board may reopen the permit to modify permit conditions and requirements. Causes for modifications include the promulgation of new federal regulations, modification in toxicity requirements, or adoption of new regulations by the State Water Board or Regional Water Board, including revisions to the Basin Plan or revisions to the TMDLs associated with LA River Watershed.

2. Special Studies and Additional Monitoring Requirements

- a. **Initial Investigation Toxicity Reduction Evaluation (TRE) Workplan.** This provision is based on section 4 of the SIP, Toxicity Control Provisions, which establishes minimum toxicity control requirements for implementing the narrative toxicity objective for aquatic life protection established in the basin plans of the State of California.

3. Best Management Practices and Pollution Prevention

- a. **Storm Water Pollution Prevention Plan (SWPPP).** This Order requires the Discharger to update, as necessary, and continue to implement a SWPPP. The SWPPP will outline site-specific management processes for minimizing storm water runoff contamination and for preventing contaminated storm water runoff from being discharged directly into the receiving water. At a minimum, the management practices should ensure that raw materials and chemicals do not come into contact with storm water. SWPPP requirements are included in Attachment G of this Order, and are based on 40 C.F.R section 122.44(k).
- b. **Best Management Practices Plan (BMPP).** Order No. R4-2010-0161 required the Discharger to develop and implement BMPs to reduce or prevent pollutants in storm water discharges and non-storm water discharges. The BMPP may be included as a component of the SWPPP. The purpose of the BMPP is to establish site-specific procedures that ensure proper operation and maintenance of equipment, to ensure that unauthorized non-storm water discharges (i.e., spills) do not occur at the Facility.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Special Provision VI.C.3.a requires the Discharger to update and maintain a SWPPP that incorporates requirements contained in Attachment G of this Order. Attachment G requires a discussion on the effectiveness of each BMP to reduce or prevent pollutants in storm water discharges and non-storm water discharges. Considering that discharges are infrequent, Special Provision VI.C.3.a and Attachment G requirements satisfy the TMDL component to address BMP performance for this Facility.

- c. **Spill Contingency Plan (SCP).** This Order requires the Discharger to develop and continue to implement a SCP to control the discharge of pollutants. The SCP shall include a technical report on the preventive (failsafe) and contingency (cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events at the site. This provision is included in this Order to minimize and control the amount of pollutants discharged in case of a spill. The SCP shall be site specific and shall cover all areas of the Facility.

4. **Construction, Operation, and Maintenance Specifications**

This provision is based on the requirements of 40 C.F.R. section 122.41(e) and Order No. R4-2010-0161.

5. **Other Special Provisions – Not Applicable**

6. **Compliance Schedules – Not Applicable**

VII. **RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS**

CWA section 308 and 40 C.F.R. sections 122.41(h), (j)-(l), 122.44(i), and 122.48 require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Regional Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. The Monitoring and Reporting Program (MRP), Attachment E of this Order establishes monitoring, reporting, and recordkeeping requirements that implement federal and state requirements. The following provides the rationale for the monitoring and reporting requirements contained in the MRP for this Facility.

A. **Influent Monitoring – Not Applicable**

B. **Effluent Monitoring**

Effluent monitoring for pollutants expected to be present in the discharge will be required at Monitoring Location EFF-001 as prescribed in Table E-2 in the MRP. To demonstrate compliance with established effluent limitations, the Order includes monitoring requirements of at least once per quarter to parameters for which effluent limitations have been established. Monitoring requirements of once per discharge event are established for parameters for which effluent limitations have been established and WLAs have been prescribed in a TMDL. Monitoring for additional pollutants is required based on pollutants commonly associated with similar operations, and is consistent with the monitoring requirements contained in the MRP for Order No. R4-2010-0161. For parameters that were detected in the monitoring events during the term of Order No. R4-2010-0161 and were not associated with any effluent limitations, monitoring frequencies of once per quarter are prescribed. This Order did not retain monitoring requirements as prescribed in Order No. R4-2010-0161 for fecal coliform, chemical oxygen demand, ethylbenzene, acute toxicity, and total organic carbon as these pollutants no longer possess effluent limitations, were undetected in the effluent monitoring data, or they are replaced by a more stringent and comprehensive method (with associated monitoring requirements) to assess their synergistic effects to the receiving water quality (Chronic toxicity using the TST statistical approach for analysis replaces the acute toxicity limits).

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

The SIP states that the Regional Water Board will require periodic monitoring for pollutants for which criteria or objectives apply and for which no effluent limitations have been established. This Order requires the Discharger to conduct annual monitoring for the remaining CTR priority pollutants at Discharge Point 001. The Regional Water Board will use the additional data to conduct an RPA and determine if additional WQBELs are required. The Regional Water Board may reopen the permit to incorporate additional effluent limitations and requirements, if necessary.

C. Whole Effluent Toxicity Testing Requirements

Whole effluent toxicity (WET) protects the receiving water quality from the aggregate toxic effect of a mixture of pollutants in the effluent. An acute toxicity test is conducted over a short time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and may measure mortality, reproduction, and growth. A chemical at a low concentration can have chronic effects but no acute effects. Chronic toxicity is a more stringent requirement than acute toxicity. For this Order, chronic toxicity monitoring in the discharge is required. The chronic toxicity testing requirements are based on U.S. EPA's 2010 TST statistical approach.

D. Receiving Water Monitoring

1. Surface Water

Monitoring requirements from Order No. R4-2010-0161 at the upstream receiving water station RSW-001 are retained for this Order. The SIP requires monitoring of the upstream receiving water for the CTR priority pollutants, including TCDD equivalents, to determine reasonable potential. This Order requires the Discharger conduct receiving water monitoring of the CTR priority pollutants, including TCDD equivalents, at Monitoring Location RSW-001. Additionally, the Discharger must analyze pH, temperature, hardness, dissolved oxygen, ammonia, conductivity, turbidity, E.coli, and salinity of the receiving water at the same time as the samples are collected for priority pollutants analyses. The Discharger is required to perform upstream receiving monitoring at RSW-001 at least once per year during the first three years of discharge.

The Discharger is required to report the maximum daily flow in the Los Angeles River, at the Los Angeles County Department of Public Works' Willow Street Gauge Station at Wardlow (Wardlow gauging station F319-R). This station is designated as RSW-002 in this Order. The stream flow data can be obtained by contacting LACDPW at (626)458-5100 or through Mr. Arthur Gotingco at (626)458-6379 or at agoting@dpw.lacounty.gov. The data for this station is downloaded once a month with a 1-2 week processing time for the provisional data. This data shall be used to determine wet weather and dry weather conditions for compliance with the effluent limitations set forth in this Order.

2. Groundwater – Not Applicable

E. Other Monitoring Requirements

1. Storm Water Monitoring

The discharge is comprised of storm water runoff. As such, the Discharger is required to measure and record the rainfall each day of the month. The Discharger is also required to conduct visual observations of all storm water discharges in the vicinity of the discharge to observe the presence of floating and suspended materials, oil and grease, discoloration, turbidity, and odor.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. **SWPPP, BMPP and SPCC Plan Effectiveness Report**

The Discharger is required by Special Provision VI.C.3 of the Order to update and implement a SWPPP, BMPs, and SPCC Plan. This Order requires the Discharger to report on the effectiveness of the plans and update them as needed to ensure all actual or potential sources of pollutants in the storm water discharged from the Facility are addressed.

VIII. PUBLIC PARTICIPATION

The Regional Water Board has considered the issuance of waste discharge requirements (WDRs) that will serve as a National Pollutant Discharge Elimination System (NPDES) permit for the Polynt Composites USA, Inc., Lynwood Facility. As a step in the WDR adoption process, the Regional Water Board staff developed tentative WDRs. The Regional Water Board encouraged public participation in the WDR adoption process.

A. Notification of Interested Parties

The Regional Water Board notified the Discharger and interested agencies and persons of its intent to prescribe WDRs for the discharge and provided an opportunity to submit written comments and recommendations. Notification was provided to all interested parties through email.

The public had access to the agenda and any changes in dates and locations through the Regional Water Board's website at:

<http://www.waterboards.ca.gov/losangeles>

B. Written Comments

Interested persons were invited to submit written comments concerning the tentative WDRs as provided through the notification process. Comments were required to be submitted either in person or by mail to the Executive Office at the Regional Water Board at 320 West 4th Street, Suite 200, Los Angeles, CA 90013, or by email to losangeles@waterboards.ca.gov with a copy to Ching-Yin.To@waterboards.ca.gov.

To be fully responded to by staff and considered by the Regional Water Board, written comments were due at the Regional Water Board office by 5:00 p.m. on September 7, 2015.

C. Public Hearing

The Regional Water Board held a public hearing on the tentative WDRs during its regular Board meeting on the following date and time and at the following location:

Date: October 8, 2015

Time: 9:00 a.m.

Location: Metropolitan Water District of Southern California

700 North Alameda Street

Los Angeles, California

Interested persons were invited to attend. At the public hearing, the Regional Water Board will hear testimony, if any, pertinent to the discharge, WDRs, and permit. Oral testimony was heard; however, for accuracy of the record, important testimony was requested to be in writing.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

D. Reconsideration of Waste Discharge Requirements

Any aggrieved person may petition the State Water Board to review the decision of the Regional Water Board regarding the final WDRs. The petition must be received by the State Water Board at the following address within 30 calendar days of the Regional Water Board's action:

State Water Resources Control Board
Office of Chief Counsel
P.O. Box 100, 1001 I Street
Sacramento, CA 95812-0100

For instructions on how to file a petition for review, see

http://www.waterboards.ca.gov/public_notices/petitions/water_quality/wqpetition_instr.shtml

E. Information and Copying

The Report of Waste Discharge (ROWD), tentative WDRs, comments received, and other supporting documents are on file and may be inspected at the Regional Water Board's office at any time between 8:30 a.m. and 4:45 p.m., Monday through Friday. Viewing and copying of documents may be arranged through the Regional Water Board by calling (213) 576 – 6600.

F. Register of Interested Persons

Any person interested in being placed on the mailing list for information regarding the WDRs and NPDES permit should contact the Regional Water Board, reference this Facility, and provide a name, mailing address, email address, and phone number.

G. Additional Information

Requests for additional information or questions regarding this order should be directed to Ching-Yin To at Ching-Yin.To@waterboards.ca.gov or at (213) 576-6696.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT G – STORM WATER POLLUTION PREVENTION PLAN REQUIREMENTS

I. IMPLEMENTATION SCHEDULE

A storm water pollution prevention plan (SWPPP) shall be developed and submitted to the Regional Water Board within 90 days following the adoption of this Order. The SWPPP shall be implemented for each facility covered by this Permit within 10 days of approval from the Regional Water Board, or 6-months from the date of the submittal of the SWPPP to the Regional Water Board (whichever comes first).

II. OBJECTIVES

The SWPPP has two major objectives: (a) to identify and evaluate sources of pollutants associated with industrial activities that may affect the quality of storm water discharges and authorized non-storm water discharges from the facility; and (b) to identify and implement site-specific best management practices (BMPs) to reduce or prevent pollutants associated with industrial activities in storm water discharges and authorized non-storm water discharges. BMPs may include a variety of pollution prevention measures or other low-cost and pollution control measures. They are generally categorized as non-structural BMPs (activity schedules, prohibitions of practices, maintenance procedures, and other low-cost measures) and as structural BMPs (treatment measures, run-off controls, overhead coverage.) To achieve these objectives, facility operators should consider the five phase process for SWPPP development and implementation as shown in Table A.

The SWPPP requirements are designed to be sufficiently flexible to meet the needs of various facilities. SWPPP requirements that are not applicable to a facility should not be included in the SWPPP.

A facility's SWPPP is a written document that shall contain a compliance activity schedule, a description of industrial activities and pollutant sources, descriptions of BMPs, drawings, maps, and relevant copies or references of parts of other plans. The SWPPP shall be revised whenever appropriate and shall be readily available for review by facility employees or Regional Water Board inspectors.

III. PLANNING AND ORGANIZATION

A. Pollution Prevention Team

The SWPPP shall identify a specific individual or individuals and their positions within the facility organization as members of a storm water pollution prevention team responsible for developing the SWPPP, assisting the facility manager in SWPPP implementation and revision, and conducting all monitoring program activities required in Attachment E of this Permit. The SWPPP shall clearly identify the Permit related responsibilities, duties, and activities of each team member. For small facilities, storm water pollution prevention teams may consist of one individual where appropriate.

B. Review Other Requirements and Existing Facility Plans

The SWPPP may incorporate or reference the appropriate elements of other regulatory requirements. Facility operators should review all local, state, and federal requirements that impact, complement, or are consistent with the requirements of this General permit. Facility operators should identify any existing facility plans that contain storm water pollutant control measures or relate to the requirements of this Permit. As examples, facility operators whose facilities are subject to Federal Spill Prevention Control and Countermeasures' requirements should already have instituted a plan to control spills of certain hazardous materials. Similarly,

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

facility operators whose facilities are subject to air quality related permits and regulations may already have evaluated industrial activities that generate dust or particulates.

IV. SITE MAP

The SWPPP shall include a site map. The site map shall be provided on an 8-½ x 11 inch or larger sheet and include notes, legends, and other data as appropriate to ensure that the site map is clear and understandable. If necessary, facility operators may provide the required information on multiple site maps.

TABLE A
FIVE PHASES FOR DEVELOPING AND IMPLEMENTING INDUSTRIAL
STORM WATER POLLUTION PREVENTION PLANS

PLANNING AND ORGANIZATION Form Pollution Prevention Team Review other plans
ASSESSMENT PHASE Develop a site map Identify potential pollutant sources Inventory of materials and chemicals List significant spills and leaks Identify non-storm water discharges Assess pollutant risks
BEST MANAGEMENT PRACTICES IDENTIFICATION PHASE Non-structural BMPs Structural BMPs Select activity and site-specific BMPs
IMPLEMENTATION PHASE Train employees Implement BMPs Conduct recordkeeping and reporting
EVALUATION / MONITORING Conduct annual site evaluation Review monitoring information Evaluate BMPs Review and revise SWPPP

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

The following information shall be included on the site map:

- A. The facility boundaries; the outline of all storm water drainage areas within the facility boundaries; portions of the drainage area impacted by run-on from surrounding areas; and direction of flow of each drainage area, on-site surface water bodies, and areas of soil erosion. The map shall also identify nearby water bodies (such as rivers, lakes, and ponds) and municipal storm drain inlets where the facility's storm water discharges and authorized non-storm water discharges may be received.
- B. The location of the storm water collection and conveyance system, associated points of discharge, and direction of flow. Include any structural control measures that affect storm water discharges, authorized non-storm water discharges, and run-on. Examples of structural control measures are catch basins, berms, detention ponds, secondary containment, oil/water separators, diversion barriers, etc.
- C. An outline of all impervious areas of the facility, including paved areas, buildings, covered storage areas, or other roofed structures.
- D. Locations where materials are directly exposed to precipitation and the locations where significant spills or leaks identified in section VI.A.4 below have occurred.
- E. Areas of industrial activity. This shall include the locations of all storage areas and storage tanks, shipping and receiving areas, fueling areas, vehicle and equipment storage/maintenance areas, material handling and processing areas, waste treatment and disposal areas, dust or particulate generating areas, cleaning and rinsing areas, and other areas of industrial activity which are potential pollutant sources.

V. LIST OF SIGNIFICANT MATERIALS

The SWPPP shall include a list of significant materials handled and stored at the site. For each material on the list, describe the locations where the material is being stored, received, shipped, and handled, as well as the typical quantities and frequency. Materials shall include raw materials, intermediate products, final or finished products, recycled materials, and waste or disposed materials.

VI. DESCRIPTION OF POTENTIAL POLLUTANT SOURCES

- A. The SWPPP shall include a narrative description of the facility's industrial activities, as identified in section IV.E above, associated potential pollutant sources, and potential pollutants that could be discharged in storm water discharges or authorized non-storm water discharges. At a minimum, the following items related to a facility's industrial activities shall be considered:
 - 1. **Industrial Processes.** Describe each industrial process, the type, characteristics, and quantity of significant materials used in or resulting from the process, and a description of the manufacturing, cleaning, rinsing, recycling, disposal, or other activities related to the process. Where applicable, areas protected by containment structures and the corresponding containment capacity shall be described.
 - 2. **Material Handling and Storage Areas.** Describe each handling and storage area, type, characteristics, and quantity of significant materials handled or stored, description of the shipping, receiving, and loading procedures, and the spill or leak prevention and response procedures. Where applicable, areas protected by containment structures and the corresponding containment capacity shall be described.
 - 3. **Dust and Particulate Generating Activities.** Describe all industrial activities that generate dust or particulates that may be deposited within the facility's boundaries and identify their discharge locations; the characteristics of dust and particulate pollutants;

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

the approximate quantity of dust and particulate pollutants that may be deposited within the facility boundaries; and a description of the primary areas of the facility where dust and particulate pollutants would settle.

4. **Significant Spills and Leaks.** Describe materials that have spilled or leaked in significant quantities in storm water discharges or non-storm water discharges since April 17, 1994. Include toxic chemicals (listed in 40 CFR, part 302) that have been discharged to storm water as reported on U.S. Environmental Protection Agency (U.S. EPA) Form R, and oil and hazardous substances in excess of reportable quantities (see 40 Code of Federal Regulations [CFR], parts 110, 117, and 302).

The description shall include the type, characteristics, and approximate quantity of the material spilled or leaked, the cleanup or remedial actions that have occurred or are planned, the approximate remaining quantity of materials that may be exposed to storm water or non-storm water discharges, and the preventative measures taken to ensure spill or leaks do not reoccur. Such list shall be updated as appropriate during the term of this Permit.

5. **Non-Storm Water Discharges.** Facility operators shall investigate the facility to identify all non-storm water discharges and their sources. As part of this investigation, all drains (inlets and outlets) shall be evaluated to identify whether they connect to the storm drain system.

All non-storm water discharges shall be described. This shall include the source, quantity, frequency, and characteristics of the non-storm water discharges and associated drainage area.

Non-storm water discharges that contain significant quantities of pollutants or that do not meet the conditions provided in Special Conditions D of the storm water general permit are prohibited by this Permit (Examples of prohibited non-storm water discharges are contact and non-contact cooling water, rinse water, wash water, etc.). Non-storm water discharges that meet the conditions provided in Special Condition D of the general storm water permit are authorized by this Permit. The SWPPP must include BMPs to prevent or reduce contact of non-storm water discharges with significant materials or equipment.

6. **Soil Erosion.** Describe the facility locations where soil erosion may occur as a result of industrial activity, storm water discharges associated with industrial activity, or authorized non-storm water discharges.
- B. The SWPPP shall include a summary of all areas of industrial activities, potential pollutant sources, and potential pollutants. This information should be summarized similar to Table B. The last column of Table B, "Control Practices", should be completed in accordance with section VIII. below.

VII. ASSESSMENT OF POTENTIAL POLLUTANT SOURCES

- A. The SWPPP shall include a narrative assessment of all industrial activities and potential pollutant sources as described in section VI above to determine:
 1. Which areas of the facility are likely sources of pollutants in storm water discharges and authorized non-storm water discharges, and
 2. Which pollutants are likely to be present in storm water discharges and authorized non-storm water discharges. Facility operators shall consider and evaluate various factors when performing this assessment such as current storm water BMPs; quantities of significant materials handled, produced, stored, or disposed of; likelihood of exposure to

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

storm water or authorized non-storm water discharges; history of spill or leaks; and run-on from outside sources.

- B.** Facility operators shall summarize the areas of the facility that are likely sources of pollutants and the corresponding pollutants that are likely to be present in storm water discharges and authorized non-storm water discharges.

Facility operators are required to develop and implement additional BMPs as appropriate and necessary to prevent or reduce pollutants associated with each pollutant source. The BMPs will be narratively described in section VIII below.

VIII. STORM WATER BEST MANAGEMENT PRACTICES

The SWPPP shall include a narrative description of the storm water BMPs to be implemented at the facility for each potential pollutant and its source identified in the site assessment phase (sections VI and VII above). The BMPs shall be developed and implemented to reduce or prevent pollutants in storm water discharges and authorized non-storm water discharges. Each pollutant and its source may require one or more BMPs. Some BMPs may be implemented for multiple pollutants and their sources, while other BMPs will be implemented for a very specific pollutant and its source.

TABLE B
EXAMPLE
ASSESSMENT OF POTENTIAL POLLUTION SOURCES AND
CORRESPONDING BEST MANAGEMENT PRACTICES
SUMMARY

Area	Activity	Pollutant Source	Pollutant	Best Management Practices
Vehicle & Equipment Fueling	Fueling	Spills and leaks during delivery. Spills caused by topping off fuel tanks. Hosing or washing down fuel oil fuel area. Leaking storage tanks. Rainfall running off fuel oil, and rainfall running onto and off fueling area.	fuel oil	Use spill and overflow protection. Minimize run-on of storm water into the fueling area. Cover fueling area. Use dry cleanup methods rather than hosing down area. Implement proper spill prevention control program. Implement adequate preventative maintenance program to preventive tank and line leaks. Inspect fueling areas regularly to detect problems before they occur. Train employees on proper fueling, cleanup, and spill response techniques.

The description of the BMPs shall identify the BMPs as (1) existing BMPs, (2) existing BMPs to be revised and implemented, or (3) new BMPs to be implemented. The description shall also include a discussion on the effectiveness of each BMP to reduce or prevent pollutants in storm water discharges and authorized non-storm water discharges. The SWPPP shall provide a summary of

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

all BMPs implemented for each pollutant source. This information should be summarized similar to Table B.

Facility operators shall consider the following BMPs for implementation at the facility:

A. Non-Structural BMPs

Non-structural BMPs generally consist of processes, prohibitions, procedures, schedule of activities, etc., that prevent pollutants associated with industrial activity from contacting with storm water discharges and authorized non-storm water discharges. They are considered low technology, cost-effective measures. Facility operators should consider all possible non-structural BMPs options before considering additional structural BMPs (see section VIII.B. below). Below is a list of non-structural BMPs that should be considered:

1. **Good Housekeeping.** Good housekeeping generally consists of practical procedures to maintain a clean and orderly facility.
2. **Preventive Maintenance.** Preventive maintenance includes the regular inspection and maintenance of structural storm water controls (catch basins, oil/water separators, etc.) as well as other facility equipment and systems.
3. **Spill Response.** This includes spill clean-up procedures and necessary clean-up equipment based upon the quantities and locations of significant materials that may spill or leak.
4. **Material Handling and Storage.** This includes all procedures to minimize the potential for spills and leaks and to minimize exposure of significant materials to storm water and authorized non-storm water discharges.
5. **Employee Training.** This includes training of personnel who are responsible for (1) implementing activities identified in the SWPPP, (2) conducting inspections, sampling, and visual observations, and (3) managing storm water. Training should address topics such as spill response, good housekeeping, and material handling procedures, and actions necessary to implement all BMPs identified in the SWPPP. The SWPPP shall identify periodic dates for such training. Records shall be maintained of all training sessions held.
6. **Waste Handling/Recycling.** This includes the procedures or processes to handle, store, or dispose of waste materials or recyclable materials.
7. **Recordkeeping and Internal Reporting.** This includes the procedures to ensure that all records of inspections, spills, maintenance activities, corrective actions, visual observations, etc., are developed, retained, and provided, as necessary, to the appropriate facility personnel.
8. **Erosion Control and Site Stabilization.** This includes a description of all sediment and erosion control activities. This may include the planting and maintenance of vegetation, diversion of run-on and runoff, placement of sandbags, silt screens, or other sediment control devices, etc.
9. **Inspections.** This includes, in addition to the preventative maintenance inspections identified above, an inspection schedule of all potential pollutant sources. Tracking and follow-up procedures shall be described to ensure adequate corrective actions are taken and SWPPPs are made.
10. **Quality Assurance.** This includes the procedures to ensure that all elements of the SWPPP and Monitoring Program are adequately conducted.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

B. Structural BMPs.

Where non-structural BMPs as identified in section VIII.A above are not effective, structural BMPs shall be considered. Structural BMPs generally consist of structural devices that reduce or prevent pollutants in storm water discharges and authorized non-storm water discharges. Below is a list of structural BMPs that should be considered:

1. **Overhead Coverage.** This includes structures that provide horizontal coverage of materials, chemicals, and pollutant sources from contact with storm water and authorized non-storm water discharges.
2. **Retention Ponds.** This includes basins, ponds, surface impoundments, bermed areas, etc. that do not allow storm water to discharge from the facility.
3. **Control Devices.** This includes berms or other devices that channel or route run-on and runoff away from pollutant sources.
4. **Secondary Containment Structures.** This generally includes containment structures around storage tanks and other areas for the purpose of collecting any leaks or spills.
5. **Treatment.** This includes inlet controls, infiltration devices, oil/water separators, detention ponds, vegetative swales, etc. that reduce the pollutants in storm water discharges and authorized non-storm water discharges.

IX. ANNUAL COMPREHENSIVE SITE COMPLIANCE EVALUATION

The facility operator shall conduct one comprehensive site compliance evaluation (evaluation) in each reporting period (July 1-June 30). Evaluations shall be conducted within 8-16 months of each other. The SWPPP shall be revised, as appropriate, and the revisions implemented within 90 days of the evaluation. Evaluations shall include the following:

- A. A review of all visual observation records, inspection records, and sampling and analysis results.
- B. A visual inspection of all potential pollutant sources for evidence of, or the potential for, pollutants entering the drainage system.
- C. A review and evaluation of all BMPs (both structural and non-structural) to determine whether the BMPs are adequate, properly implemented and maintained, or whether additional BMPs are needed. A visual inspection of equipment needed to implement the SWPPP, such as spill response equipment, shall be included.
- D. An evaluation report that includes, (i) identification of personnel performing the evaluation, (ii) the date(s) of the evaluation, (iii) necessary SWPPP revisions, (iv) schedule, as required in section X.E., for implementing SWPPP revisions, (v) any incidents of non-compliance and the corrective actions taken, and (vi) a certification that the facility operator is in compliance with this Permit. If the above certification cannot be provided, explain in the evaluation report why the facility operator is not in compliance with this General Permit. The evaluation report shall be submitted as part of the annual report, retained for at least five years, and signed and certified in accordance with Standard Provisions V.B.5 of Attachment D.

X. SWPPP GENERAL REQUIREMENTS

- A. The SWPPP shall be retained on site and made available upon request of a representative of the Regional Water Board and/or local storm water management agency (local agency) which receives the storm water discharges.
- B. The Regional Water Board and/or local agency may notify the facility operator when the SWPPP does not meet one or more of the minimum requirements of this section. As requested by the Regional Water Board and/or local agency, the facility operator shall submit

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

an SWPPP revision and implementation schedule that meets the minimum requirements of this section to the Regional Water Board and/or local agency that requested the SWPPP revisions. Within 14 days after implementing the required SWPPP revisions, the facility operator shall provide written certification to the Regional Water Board and/or local agency that the revisions have been implemented.

- C. The SWPPP shall be revised, as appropriate, and implemented prior to changes in industrial activities which (i) may significantly increase the quantities of pollutants in storm water discharge, (ii) cause a new area of industrial activity at the facility to be exposed to storm water, or (iii) begin an industrial activity which would introduce a new pollutant source at the facility.
- D. The SWPPP shall be revised and implemented in a timely manner, but in no case more than 90 days after a facility operator determines that the SWPPP is in violation of any requirement(s) of this Permit.
- E. When any part of the SWPPP is infeasible to implement due to proposed significant structural changes, the facility operator shall submit a report to the Regional Water Board prior to the applicable deadline that (i) describes the portion of the SWPPP that is infeasible to implement by the deadline, (ii) provides justification for a time extension, (iii) provides a schedule for completing and implementing that portion of the SWPPP, and (iv) describes the BMPs that will be implemented in the interim period to reduce or prevent pollutants in storm water discharges and authorized non-storm water discharges. Such reports are subject to Regional Water Board approval and/or modifications. Facility operators shall provide written notification to the Regional Water Board within 14 days after the SWPPP revisions are implemented.
- F. The SWPPP shall be provided, upon request, to the Regional Water Board. The SWPPP is considered a report that shall be available to the public by the Regional Water Board under section 308(b) of the Clean Water Act.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT H – STATE WATER BOARD MINIMUM LEVELS (MICROGRAMS/LITER(UG/L))

The Minimum Levels (MLs) in this appendix are for use in reporting and compliance determination purposes in accordance with section 2.4 of the State Implementation Policy. These ML's were derived from data for priority pollutants provided by State certified analytical laboratories in 1997 and 1998. These ML's shall be used until new values are adopted by the State Water Board and become effective. The following tables (Tables 2a - 2d) present MLs for four major chemical groupings: volatile substances, semi-volatile substances, inorganics, and pesticides and PCB's.

Table 2a - VOLATILE SUBSTANCES*	GC	GCMS
1,1 Dichloroethane	0.5	1
1,1 Dichloroethylene	0.5	2
1,1,1 Trichloroethane	0.5	2
1,1,2 Trichloroethane	0.5	2
1,1,2,2 Tetrachloroethane	0.5	1
1,2 Dichlorobenzene (volatile)	0.5	2
1,2 Dichloroethane	0.5	2
1,2 Dichloropropane	0.5	1
1,3 Dichlorobenzene (volatile)	0.5	2
1,3 Dichloropropene (volatile)	0.5	2
1,4 Dichlorobenzene (volatile)	0.5	2
Acrolein	2.0	5
Acrylonitrile	2.0	2
Benzene	0.5	2
Bromoform	0.5	2
Methyl Bromide	1.0	2
Carbon Tetrachloride	0.5	2
Chlorobenzene	0.5	2
Chlorodibromo-methane	0.5	2
Chloroethane	0.5	2
Chloroform	0.5	2
Chloromethane	0.5	2
Dichlorobromo-methane	0.5	2
Dichloromethane	0.5	2
Ethylbenzene	0.5	2
Tetrachloroethylene	0.5	2
Toluene	0.5	2
Trans-1,2 Dichloroethylene	0.5	1
Trichloroethene	0.5	2
Vinyl Chloride	0.5	2

*The normal method-specific factor for these substances is 1; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

R
E
V
I
S
E
D
T
E
N
T
A
T
I
V
E

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
Benzo (a) Anthracene	10	5		
1,2 Dichlorobenzene (semivolatile)	2	2		
1,2 Diphenylhydrazine		1		
1,2,4 Trichlorobenzene	1	5		
1,3 Dichlorobenzene (semivolatile)	2	1		
1,4 Dichlorobenzene (semivolatile)	2	1		
2 Chlorophenol	2	5		
2,4 Dichlorophenol	1	5		
2,4 Dimethylphenol	1	2		
2,4 Dinitrophenol	5	5		
2,4 Dinitrotoluene	10	5		
2,4,6 Trichlorophenol	10	10		
2,6 Dinitrotoluene		5		
2- Nitrophenol		10		
2-Chloroethyl vinyl ether	1	1		
2-Chloronaphthalene		10		
3,3' Dichlorobenzidine		5		
Benzo (b) Fluoranthene		10	10	
3-Methyl-Chlorophenol	5	1		
4,6 Dinitro-2-methylphenol	10	5		
4- Nitrophenol	5	10		
4-Bromophenyl phenyl ether	10	5		
4-Chlorophenyl phenyl ether		5		
Acenaphthene	1	1	0.5	
Acenaphthylene		10	0.2	
Anthracene		10	2	
Benzidine		5		
Benzo(a) pyrene		10	2	
Benzo(g,h,i)perylene		5	0.1	
Benzo(k)fluoranthene		10	2	
bis 2-(1-Chloroethoxyl) methane		5		
bis(2-chloroethyl) ether	10	1		
bis(2-Chloroisopropyl) ether	10	2		
bis(2-Ethylhexyl) phthalate	10	5		
Butyl benzyl phthalate	10	10		
Chrysene		10	5	
di-n-Butyl phthalate		10		
di-n-Octyl phthalate		10		
Dibenzo(a,h)-anthracene		10	0.1	
Diethyl phthalate	10	2		
Dimethyl phthalate	10	2		
Fluoranthene	10	1	0.05	
Fluorene		10	0.1	
Hexachloro-cyclopentadiene	5	5		
Hexachlorobenzene	5	1		
Hexachlorobutadiene	5	1		
Hexachloroethane	5	1		
Indeno(1,2,3,cd)-pyrene		10	0.05	
Isophorone	10	1		
N-Nitroso diphenyl amine	10	1		
N-Nitroso-dimethyl amine	10	5		
N-Nitroso -di n-propyl amine	10	5		

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
Naphthalene	10	1	0.2	
Nitrobenzene	10	1		
Pentachlorophenol	1	5		
Phenanthrene		5	0.05	
Phenol **	1	1		50
Pyrene		10	0.05	

* With the exception of phenol by colorimetric technique, the normal method-specific factor for these substances is 1,000; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 1,000.

** Phenol by colorimetric technique has a factor of 1.

Table 2c – INORGANICS*	FAA	GFAA	ICP	ICPMS	SPGFAA	HYDRIDE	CVAA	COLOR	DCP
Antimony	10	5	50	0.5	5	0.5			1,000
Arsenic		2	10	2	2	1		20	1,000
Beryllium	20	0.5	2	0.5	1				1,000
Cadmium	10	0.5	10	0.25	0.5				1,000
Chromium (total)	50	2	10	0.5	1				1,000
Chromium VI	5							10	
Copper	25	5	10	0.5	2				1,000
Cyanide								5	
Lead	20	5	5	0.5	2				10,000
Mercury				0.5			0.2		
Nickel	50	5	20	1	5				1,000
Selenium		5	10	2	5	1			1,000
Silver	10	1	10	0.25	2				1,000
Thallium	10	2	10	1	5				1,000
Zinc	20		20	1	10				1,000

* The normal method-specific factor for these substances is 1; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

Table 2d – PESTICIDES – PCB's*	GC
4,4'-DDD	0.05
4,4'-DDE	0.05
4,4'-DDT	0.01
a-Endosulfan	0.02
alpha-BHC	0.01
Aldrin	0.005
b-Endosulfan	0.01
Beta-BHC	0.005
Chlordane	0.1
Delta-BHC	0.005
Dieldrin	0.01

Table 2d – PESTICIDES – PCB's*	GC
Endosulfan Sulfate	0.05
Endrin	0.01
Endrin Aldehyde	0.01
Heptachlor	0.01
Heptachlor Epoxide	0.01
Gamma-BHC (Lindane)	0.02
PCB 1016	0.5
PCB 1221	0.5
PCB 1232	0.5
PCB 1242	0.5
PCB 1248	0.5
PCB 1254	0.5
PCB 1260	0.5
Toxaphene	0.5

* The normal method-specific factor for these substances is 100; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 100.

Techniques:

GC - Gas Chromatography

GCMS - Gas Chromatography/Mass Spectrometry

HRGCMS - High Resolution Gas Chromatography/Mass Spectrometry (i.e., EPA 1613, 1624, or 1625)

LC - High Pressure Liquid Chromatography

FAA - Flame Atomic Absorption

GFAA - Graphite Furnace Atomic Absorption

HYDRIDE - Gaseous Hydride Atomic Absorption

CVAA - Cold Vapor Atomic Absorption

ICP - Inductively Coupled PLA'sma

ICPMS - Inductively Coupled PLA'sma/Mass Spectrometry

SPGFAA - Stabilized Platform Graphite Furnace Atomic Absorption (i.e., EPA 200.9)

DCP - Direct Current PLA'sma

COLOR – Colorimetric

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT I – LIST OF PRIORITY POLLUTANTS

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
1	Antimony	7440360	1
2	Arsenic	7440382	1
3	Beryllium	7440417	1
4	Cadmium	7440439	1
5a	Chromium (III)	16065831	1
5a	Chromium (VI)	18540299	1
6	Copper	7440508	1
7	Lead	7439921	1
8	Mercury	7439976	1
9	Nickel	7440020	1
11	Selenium	7782492	1
11	Silver	7440224	1
12	Thallium	7440280	1
13	Zinc	7440666	1
14	Cyanide	57125	1
15	Asbestos	1332214	1
16	2,3,7,8-TCDD	1746016	1
17	Acrolein	117028	1
18	Acrylonitrile	117131	1
19	Benzene	71432	1
20	Bromoform	75252	1
21	Carbon Tetrachloride	56235	1
22	Chlorobenzene	118907	1
23	Chlorodibromomethane	124481	1
24	Chloroethane	75003	1
25	2-Chloroethylvinyl Ether	111758	1
26	Chloroform	67663	1
27	Dichlorobromomethane	75274	1
28	1,1-Dichloroethane	75343	1
29	1,2-Dichloroethane	117062	1
30	1,1-Dichloroethylene	75354	1
31	1,2-Dichloropropane	78875	1
32	1,3-Dichloropropylene	542756	1
33	Ethylbenzene	110414	1
34	Methyl Bromide	74839	1
35	Methyl Chloride	74873	1
36	Methylene Chloride	75092	1
37	1,1,2,2-Tetrachloroethane	79345	1
38	Tetrachloroethylene	127184	1
39	Toluene	118883	1
40	1,2-Trans-Dichloroethylene	156605	1
41	1,1,1-Trichloroethane	71556	1
42	1,1,2-Trichloroethane	79005	1
43	Trichloroethylene	79016	1
44	Vinyl Chloride	75014	1
45	2-Chlorophenol	95578	1

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
47	2,4-Dimethylphenol	115679	1
48	2-Methyl-4,6-Dinitrophenol	534521	1
49	2,4-Dinitrophenol	51285	1
50	2-Nitrophenol	88755	1
51	4-Nitrophenol	110027	1
52	3-Methyl-4-Chlorophenol	59507	1
53	Pentachlorophenol	87865	1
54	Phenol	118952	1
55	2,4,6-Trichlorophenol	88062	1
56	Acenaphthene	83329	1
57	Acenaphthylene	208968	1
58	Anthracene	120127	1
59	Benzidine	92875	1
60	Benzo(a)Anthracene	56553	1
61	Benzo(a)Pyrene	50328	1
62	Benzo(b)Fluoranthene	205992	1
63	Benzo(ghi)Perylene	191242	1
64	Benzo(k)Fluoranthene	207089	1
65	Bis(2-Chloroethoxy)Methane	111911	1
66	Bis(2-Chloroethyl)Ether	111444	1
67	Bis(2-Chloroisopropyl)Ether	118601	1
68	Bis(2-Ethylhexyl)Phthalate	117817	1
69	4-Bromophenyl Phenyl Ether	111553	1
70	Butylbenzyl Phthalate	85687	1
71	2-Chloronaphthalene	91587	1
72	4-Chlorophenyl Phenyl Ether	7005723	1
73	Chrysene	218019	1
74	Dibenzo(a,h)Anthracene	53703	1
75	1,2-Dichlorobenzene	95501	1
76	1,3-Dichlorobenzene	541731	1
77	1,4-Dichlorobenzene	116467	1
78	3,3'-Dichlorobenzidine	91941	1
79	Diethyl Phthalate	84662	1
80	Dimethyl Phthalate	131113	1
81	Di-n-Butyl Phthalate	84742	1
82	2,4-Dinitrotoluene	121142	1
83	2,6-Dinitrotoluene	606202	1
84	Di-n-Octyl Phthalate	117840	1
85	1,2-Diphenylhydrazine	122667	1
86	Fluoranthene	206440	1
87	Fluorene	86737	1
88	Hexachlorobenzene	118741	1
89	Hexachlorobutadiene	87863	1
90	Hexachlorocyclopentadiene	77474	1
91	Hexachloroethane	67721	1
92	Indeno(1,2,3-cd)Pyrene	193395	1
93	Isophorone	78591	1
94	Naphthalene	91203	1
95	Nitrobenzene	98953	1
96	N-Nitrosodimethylamine	62759	1
97	N-Nitrosodi-n-Propylamine	621647	1
98	N-Nitrosodiphenylamine	86306	1

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
110	Pyrene	129000	1
111	1,2,4-Trichlorobenzene	120821	1
112	Aldrin	309002	1
113	alpha-BHC	319846	1
114	beta-BHC	319857	1
115	gamma-BHC	58899	1
116	delta-BHC	319868	1
117	Chlordane	57749	1
118	4,4'-DDT	50293	1
119	4,4'-DDE	72559	1
111	4,4'-DDD	72548	1
111	Dieldrin	60571	1
112	alpha-Endosulfan	959988	1
113	beta-Endosulfan	33213659	1
114	Endosulfan Sulfate	1131178	1
115	Endrin	72208	1
116	Endrin Aldehyde	7421934	1
117	Heptachlor	76448	1
118	Heptachlor Epoxide	1124573	1
119	PCB-1116	12674112	1
120	PCB-1221	11114282	1
121	PCB-1232	11141165	1
122	PCB-1242	53469219	1
123	PCB-1248	12672296	1
124	PCB-1254	11197691	1
125	PCB-1260	11196825	1
126	Toxaphene	8001352	1

¹ Pollutants shall be analyzed using the methods described in 40 C.F.R Part 136.

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

ATTACHMENT J – SUMMARY OF EFFLUENT LIMITATION CALCULATIONS

**R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E**

CTR#	Parameters	Units	CV	MEC	CTR Water Quality Criteria (ug/L)						REASONABLE POTENTIAL ANALYSIS (RPA)													
					Freshwater		Saltwater		Human Health for consumption of:		MEC >= Lowest C	Tier 1 - Enter the limit?	B Available (Y/N)?	Are all B data points non-detects (Y/N)?	If all data points ND Enter the min detection limit (MDL)	Enter the pollutant B detected max conc (ug/L)	If all B is ND, is MDL>C?	If B>C, effluent limit required	Tier 3 - other info. ?	RPA Result - Need Limit?	Reason			
					C acute = CMC tot	C chronic = CCC tot	C acute = CMC tot	C chronic = CCC tot	Water & organisms	Organisms only												Lowest C or WLAs		
1	Antimony	ug/L			5				6.00	4300.00	6.00	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
2	Arsenic	ug/L			10	340.00	150.00		50.00		50.00	No	No	Y	Y	10	N	No detected value of B, Step 7	No	MEC-C & B is ND				
3	Beryllium	ug/L			0.5				4.00	Narrative	4.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
4	Cadmium	ug/L	0.6		0.2		2.33		5.00	Narrative	2.33	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
5a	Chromium (III)				0.01	1640.63	195.55			Narrative	195.55	No	No	Y	N		19.8	B<=C, Step 7	No	MEC-C & B<=C				
5b	Chromium (VI)	ug/L			5	16.00	11.00		50.00	Narrative	11.00	No	No	Y	Y	10	N	No detected value of B, Step 7	No	MEC-C & B is ND				
6	Copper	ug/L	0.698		7.94		19.00				19.00	No	No	Y	N		31.2	Limit required, B>C & pollutant detected	Yes	B>C & pollutant detected in e				
7	Lead	ug/L	0.6		12.5		8.90		50.00	Narrative	8.90	Yes	Yes	Y	N		6.92	B<=C, Step 7	Yes	MEC>=C				
8	Mercury	ug/L		0.05000	Reserved	Reserved			2.00000	0.05100	0.05100	No	No	Y	Y	0.05000	N	No detected value of B, Step 7	No	MEC-C & B is ND				
9	Nickel	ug/L			6.52	442.44	49.19		100.00	4600.00	49.19	No	No	Y	N		16.4	B<=C, Step 7	No	MEC-C & B<=C				
10	Selenium	ug/L			2	20.00	5.00		10.00	Narrative	5.00	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND				
11	Silver	ug/L			0.25	3.60			50.00		3.60	No	No	Y	Y	0.25	N	No detected value of B, Step 7	No	MEC-C & B is ND				
12	Thallium	ug/L			1				2.00	6.30	2.00	No	No	Y	Y	1	N	No detected value of B, Step 7	No	MEC-C & B is ND				
13	Zinc	ug/L	1.141		146	112.98	112.98				113.0	Yes	Yes	Y	N		336	Limit required, B>C & pollutant detected	Yes	MEC>=C				
14	Cyanide	ug/L			0.01	22.00	5.20		150.00	220000.0	5.20	No	No	Y	Y	0.01	N	No detected value of B, Step 7	No	MEC-C & B is ND				
15	Asbestos	MFL			0.2				7.00		7.00	No	No	Y	Y	0.2	N	No detected value of B, Step 7	No	MEC-C & B is ND				
16	2,3,7,8 TCDD	ug/L	0.6		2.73E-06				0.000030000	1.4E-08	1.40E-08	Yes	Yes	Y	N		1.9018E-05	Limit required, B>C & pollutant detected	Yes	MEC>=C				
	TCDD Equivalents	ug/L	0.6		3.15E-06				0.000030000	1.4E-08	1.40E-08	Yes	Yes	Y	N			No detected value of B, Step 7	Yes	MEC>=C				
17	Acrolein	ug/L			5					780.0	780	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
18	Acrylonitrile	ug/L							0.66	0.660		No	No	Y	Y	2	Y	No detected value of B, Step 7	No	UD: effluent ND, MDL>C, and				
19	Benzene	ug/L			0.5				1.0	71	1.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
20	Bromoform	ug/L			19.5					360	360.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
21	Carbon Tetrachloride	ug/L							0.50	4.4	0.50	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	UD: effluent ND, MDL>C, and				
22	Chlorobenzene	ug/L			2				30	21000	30	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND				
23	Chlorodibromomethane	ug/L			25.8					34	34.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
24	Chloroethane	ug/L		No Criteria							No Criteria	No Criteria	No Criteria	Y	Y	2	N	No Criteria	No Criteria	Uc	No Criteria			
25	2-Chloroethylvinyl ether	ug/L		No Criteria							No Criteria	No Criteria	No Criteria	Y	Y	1	N	No Criteria	No Criteria	Uc	No Criteria			
26	Chloroform	ug/L		No Criteria							No Criteria	No Criteria	No Criteria	Y	Y			No Criteria	No Criteria	Uc	No Criteria			
27	Dichlorobromomethane	ug/L			14.2					46	46.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
28	1,1-Dichloroethane	ug/L			1				5.00		5.00	No	No	Y	Y	1	N	No detected value of B, Step 7	No	MEC-C & B is ND				
29	1,2-Dichloroethane	ug/L							0.50	99	0.50	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	UD: effluent ND, MDL>C, and				
30	1,1-Dichloroethylene	ug/L			0.5				6.000	3.2	3,200	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
31	1,2-Dichloropropane	ug/L			0.5				5.00	39	5.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
32	1,3-Dichloropropylene	ug/L							1	1700	1	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	UD: effluent ND, MDL>C, and				
33	Ethylbenzene	ug/L			2				300	29000	300	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND				
34	Methyl Bromide	ug/L			2					4000	4000	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND				
35	Methyl Chloride	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	Y	Y	Y	0.5	N	No Criteria	No Criteria	Uc	No Criteria			
36	Methylene Chloride	ug/L			0.5				5.0	1600	5.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
37	1,1,2,2-Tetrachloroethane	ug/L			0.5				1.00	11	1.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
38	Tetrachloroethylene	ug/L			0.91				5.0	8.85	5.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
39	Toluene	ug/L			0.75				150	200000	150	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND				
40	1,2-Trans-Dichloroethylene	ug/L			1				10	140000	10	No	No	Y	Y	1	N	No detected value of B, Step 7	No	MEC-C & B is ND				
41	1,1,1-Trichloroethane	ug/L			2				200.00		200.00	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND				
42	1,1,2-Trichloroethane	ug/L			0.5				5.0	42	5.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
43	Trichloroethylene	ug/L			0.5				5.0	81	5.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
44	Vinyl Chloride	ug/L							1	525	1	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	UD: effluent ND, MDL>C, and				
45	2-Chlorophenol	ug/L			5					400	400	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
46	2,4-Dichlorophenol	ug/L			5					790	790	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
47	2,4-Dimethylphenol	ug/L			2					2300	2300	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND				
48	4,6-dinitro-o-resol (aka2-methyl-4,6-Dinitrophenol)	ug/L			5					765	765.0	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
49	2,4-Dinitrophenol	ug/L			5					14000	14000	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND				
50	2-Nitrophenol	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	Y	Y	Y	10	N	No Criteria	No Criteria	Uc	No Criteria			
51	4-Nitrophenol	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	Y	Y	Y	5	N	No Criteria	No Criteria	Uc	No Criteria			
	3-Methyl-4-Chlorophenol (aka P-chloro-m-resol)	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	Y	Y	Y	1	N	No Criteria	No Criteria	Uc	No Criteria			
52	Pentachlorophenol	ug/L				4.73	3.63		1.00	8.2	1.00	No	No	Y	Y	1	N	No detected value of B, Step 7	No	UD: effluent ND, MDL>C, and				
53	Phenol	ug/L			1					4600000	4600000	No	No	Y	Y	10	Y	No detected value of B, Step 7	No	MEC-C & B is ND				
54	2,4,6-Trichlorophenol	ug/L								6.5	6.5	No	No	Y	Y	10	N	No detected value of B, Step 7	No	UD: effluent ND, MDL>C, and				
56	Acenaphthene	ug/L			0.1					2700	2700	No	No	Y	Y	0.1	N	No detected value of B, Step 7	No	MEC-C & B is ND				
57	Acenaphthylene	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	Y	Y	Y	0.1	N	No Criteria	No Criteria	Uc	No Criteria			

CTR#	Parameters	HUMAN HEALTH CALCULATIONS			AQUATIC LIFE CALCULATIONS										LIMITS		Recommendation
		Organisms only			Saltwater / Freshwater / Basin Plan										Lowest AMEL	Lowest MDEL	
		AMEL hh = ECA = C hh O only	MDEL/AMEL multiplier	MDEL hh	ECA acute multiplier (p.7)	LTA acute	ECA chronic multiplier	LTA chronic	Lowest LTA	AMEL multiplier 95	AMEL aq life	MDEL multiplier 99	MDEL aq life				
1	Antimony																No Limit
2	Arsenic																No Limit
3	Beryllium																No Limit
4	Cadmium																No Limit
5a	Chromium (III)																No Limit
5b	Chromium (VI)																No Limit
6	Copper		2.15		0.28		0.48	9.14	9.14	1.65	15.08	3.55	32.47175	15.082	32.472		
7	Lead	Narrative	2.01		0.32		0.53	4.69	4.69	1.55	7.29	3.11	14.61975	7.287	14.620		
8	Mercury																No Limit
9	Nickel																No Limit
10	Selenium																No Limit
11	Silver																No Limit
12	Thallium																No Limit
13	Zinc		2.65		0.18	20.49	0.33	37.83	20.49	2.08	42.62	5.51	112.9788	42.625	112.979		
14	Cyanide																No Limit
15	Asbestos																No Limit
16	2,3,7,8 TCDD	0.000000014	2.01	0.00000						1.55		3.11		0.000	0.000		
	TCDD Equivalents	1.40E-08	2.01	2.81E-08						1.55		3.11		0.000	0.000		
17	Acrolein																No Limit
18	Acrylonitrile																No Limit
19	Benzene																No Limit
20	Bromoform																No Limit
21	Carbon Tetrachloride																No Limit
22	Chlorobenzene																No Limit
23	Chlorodibromomethane																No Limit
24	Chloroethane																No Limit
25	2-Chloroethylvinyl ether																No Limit
26	Chloroform																No Limit
27	Dichlorobromomethane																No Limit
28	1,1-Dichloroethane																No Limit
29	1,2-Dichloroethane																No Limit
30	1,1-Dichloroethylene																No Limit
31	1,2-Dichloropropane																No Limit
32	1,3-Dichloropropylene																No Limit
33	Ethylbenzene																No Limit
34	Methyl Bromide																No Limit
35	Methyl Chloride																No Limit
36	Methylene Chloride																No Limit
37	1,1,2,2-Tetrachloroethane																No Limit
38	Tetrachloroethylene																No Limit
39	Toluene																No Limit
40	1,2-Trans-Dichloroethylene																No Limit
41	1,1,1-Trichloroethane																No Limit
42	1,1,2-Trichloroethane																No Limit
43	Trichloroethylene																No Limit
44	Vinyl Chloride																No Limit
45	2-Chlorophenol																No Limit
46	2,4-Dichlorophenol																No Limit
47	2,4-Dimethylphenol																No Limit
48	4,6-dinitro-o-resol (aka 2-methyl-4,6-Dinitrophenol)																No Limit
49	2,4-Dinitrophenol																No Limit
50	2-Nitrophenol																No Limit
51	4-Nitrophenol																No Limit
52	3-Methyl-4-Chlorophenol (aka P-chloro-m-resol)																No Limit
53	Pentachlorophenol																No Limit
54	Phenol																No Limit
55	2,4,6-Trichlorophenol																No Limit
56	Acenaphthene																No Limit
57	Acenaphthylene																No Limit

CTR#			CV	MEC	CTR Water Quality Criteria (ug/L)				Human Health for consumption of:	REASONABLE POTENTIAL ANALYSIS (RPA)													
					Freshwater		Saltwater			Water & organisms	Organisms only	Lowest C or WLAS	MEC >= Lowest C	Tier 1 - Need limit?	B Available (Y/N)?	Are all B data points non-detects (Y/N)?	If all data points ND Enter the min detection limit (MDL)	Enter the pollutant B detected max conc (ug/L)	If all B is ND, is MDL>C?	If B>C, effluent limit required	Tier 3 - other info. ?	RPA Result - Need Limit?	Reason
					C acute = CMC tot	C chronic = CCC tot	C acute = CMC tot	C chronic = CCC tot															
58	Anthracene	ug/L		0.1						110000	110000	No			Y	Y	0.1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
59	Benidine	ug/L								0.00054	0.00054	No			Y	Y	5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
60	Benzo(a)Anthracene	ug/L								0.049	0.049				Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
61	Benzo(a)Pyrene	ug/L						0.20	0.049	0.049	0.049				Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
62	Benzo(b)Fluoranthene	ug/L								0.049	0.0490				Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
63	Benzo(ghi)Perylene	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	0.1	N	No Criteria	No Criteria	Uc	No Criteria	
64	Benzo(k)Fluoranthene	ug/L								0.049	0.0490				Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
65	Bis(2-Chloroethoxy)Methane	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria		No	UD: effluent ND, MDL-C, an	
66	Bis(2-Chloroethyl)Ether	ug/L		1						1.4	1.400	No	No		Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
67	Bis(2-Chloroisopropyl)Ether	ug/L		2						170000	170000	No	No		Y	Y	2	N	No detected value of B, Step 7		No	MEC-C & B is ND	
68	Bis(2-Ethylhexyl)Phthalate	ug/L						4.0	5.9	4.0	4.0				Y	Y	5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
69	4-Bromophenyl Phenyl Ether	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria	No Criteria	Uc	No Criteria	
70	Butylbenzyl Phthalate	ug/L		10						5200	5200	No	No	Y	Y	Y	10	N	No detected value of B, Step 7		No	MEC-C & B is ND	
71	2-Chloronaphthalene	ug/L		10						4300	4300	No	No	Y	Y	Y	10	N	No detected value of B, Step 7		No	MEC-C & B is ND	
72	4-Chlorophenyl Phenyl Ether	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria	No Criteria	Uc	No Criteria	
73	Chrysene	ug/L								0.049	0.049				Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
74	Dibenz(a,h)Anthracene	ug/L								0.049	0.0490				Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
75	1,2-Dichlorobenzene	ug/L		0.5					600	17000	600	No	No	Y	Y	Y	0.5	N	No detected value of B, Step 7		No	MEC-C & B is ND	
76	1,3-Dichlorobenzene	ug/L		2						2600	2600	No	No	Y	Y	Y	2	N	No detected value of B, Step 7		No	MEC-C & B is ND	
77	1,4-Dichlorobenzene	ug/L		0.5					5	2600	5	No	No	Y	Y	Y	0.5	N	No detected value of B, Step 7		No	MEC-C & B is ND	
78	3,3-Dichlorobenzidine	ug/L								0.077	0.08				Y	Y	5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
79	Diethyl Phthalate	ug/L		2						120000	120000	No	No	Y	Y	Y	2	N	No detected value of B, Step 7		No	MEC-C & B is ND	
80	Dimethyl Phthalate	ug/L		2						2900000	2900000	No	No	Y	Y	Y	2	N	No detected value of B, Step 7		No	MEC-C & B is ND	
81	Di-n-Butyl Phthalate	ug/L		10						12000	12000	No	No	Y	Y	Y	10	N	No detected value of B, Step 7		No	MEC-C & B is ND	
82	2,4-Dinitrotoluene	ug/L		5						9.10	9.10	No	No	Y	Y	Y	5	N	No detected value of B, Step 7		No	MEC-C & B is ND	
83	2,6-Dinitrotoluene	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria	No Criteria	Uc	No Criteria	
84	Di-n-Octyl Phthalate	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	10	N	No Criteria	No Criteria	Uc	No Criteria	
85	1,2-Diphenylhydrazine	ug/L								0.54	0.540				Y	Y	1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
86	Fluoranthene	ug/L		0.1						370	370	No	No	Y	Y	Y	0.1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
87	Fluorene	ug/L		0.1						14000	14000	No	No	Y	Y	Y	0.1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
88	Hexachlorobenzene	ug/L						1.00000	0.00077	0.00077	0.00077				Y	Y	1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
89	Hexachlorobutadiene	ug/L		1						50	50.00	No	No	Y	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
90	Hexachlorocyclopentadiene	ug/L		5					50	17000	50	No	No	Y	Y	Y	5	N	No detected value of B, Step 7		No	MEC-C & B is ND	
91	Hexachloroethane	ug/L		1						8.9	8.9	No	No	Y	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
92	Indeno(1,2,3-cd)Pyrene	ug/L								0.049	0.0490				Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
93	Isophorone	ug/L		1						600	600.0	No	No	Y	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
94	Naphthalene	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	0.1	N	No Criteria	No Criteria	Uc	No Criteria	
95	Nitrobenzene	ug/L		1						1900	1900	No	No	Y	Y	Y	10	N	No detected value of B, Step 7		No	MEC-C & B is ND	
96	N-Nitrosodimethylamine	ug/L		5						8.10	8.10000	No	No	Y	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
97	N-Nitrosodi-n-Propylamine	ug/L								1.40	1.400				Y	Y	5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
98	N-Nitrosodiphenylamine	ug/L		1						16	16.0	No	No	Y	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
99	Phenanthrene	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	0.1	N	No Criteria	No Criteria	Uc	No Criteria	
100	Pyrene	ug/L		0.1						11000	11000	No	No	Y	Y	Y	0.1	N	No detected value of B, Step 7		No	MEC-C & B is ND	
101	1,2,4-Trichlorobenzene	ug/L							5.00		5.00				Y	Y	5	N	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
102	Aldrin	ug/L		3.00						0.00014	0.00014				Y	Y			No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
103	alpha-BHC	ug/L		0.01						0.013	0.0130	No	No	Y	Y	Y			No detected value of B, Step 7		No	MEC-C & B is ND	
104	beta-BHC	ug/L		0.005						0.046	0.046	No	No	Y	Y	Y	0.005	N	No detected value of B, Step 7		No	MEC-C & B is ND	
105	gamma-BHC	ug/L		0.02	0.95				0.200	0.063	0.063	No	No	Y	Y	Y	0.02	N	No detected value of B, Step 7		No	MEC-C & B is ND	
106	delta-BHC	ug/L		0.005					4.00	4.00	4.00	No	No	Y	Y	Y	0.005	N	No detected value of B, Step 7		No	MEC-C & B is ND	
107	Chlordane	ug/L			2.40	0.00			0.10	0.00059	0.00059				Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
108	4,4'-DDT	ug/L			1.10	0.00				0.00059	0.00059				Y	Y	0.01	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
109	4,4'-DDE (linked to DDT)	ug/L								0.00059	0.00059				Y	Y	0.05	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
110	4,4'-DDD	ug/L								0.00084	0.00084				Y	Y	0.05	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
111	Dieldrin	ug/L			0.24	0.06				0.00014	0.00014				Y	Y	0.01	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
112	alpha-Endosulfan	ug/L		0.01	0.22	0.056				240	0.0560	No	No	Y	Y	Y	0.01	N	No detected value of B, Step 7		No	MEC-C & B is ND	
113	beta-Endosulfan	ug/L		0.01	0.22	0.056				240	0.0560	No	No	Y	Y	Y	0.01	N	No detected value of B, Step 7		No	MEC-C & B is ND	
114	Endosulfan Sulfate	ug/L		0.05						240	240	No	No	Y	Y	Y	0.05	N	No detected value of B, Step 7		No	MEC-C & B is ND	
115	Endrin	ug/L		0.01	0.086	0.036			0.20	0.81	0.0360	No	No	Y	Y	Y	0.01	N	No detected value of B, Step 7		No	MEC-C & B is ND	
116	Endrin Aldehyde	ug/L		0.01						0.81	0.81	No	No	Y	Y	Y	0.01	N	No detected value of B, Step 7		No	MEC-C & B is ND	
117	Heptachlor	ug/L			0.52	0.0038			0.01000	0.00021	0.00021				Y	Y	0.01	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
118	Heptachlor Epoxide	ug/L			0.52	0.0038			0.01000	0.00011	0.00011				Y	Y	0.01	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an	
119-125	PCBs sum (2)	ug/L				0.01				0.50	0.00017	0.00017				Y	Y	0.5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an
126	Toxaphene	ug/L			0.73	0.0002				3.00000	0.00075	0.0002				Y	Y	0.5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an

Notes:
Ud = Undetermined due to lack of data
Uc = Undetermined due to lack of CTR Water Quality Criteria
C = Water Quality Criteria
B = Background receiving water data

CTR#		HUMAN HEALTH CALCULATIONS				AQUATIC LIFE CALCULATIONS										LIMITS		Recommendation
		Organisms only			Saltwater / Freshwater / Basin Plan													
		AMEL hh = ECA = C hh O only	MDEL/AMEL multiplier	MDEL hh	ECA acute multiplier (p.7)	LTA acute	ECA chronic multiplier	LTA chronic	Lowest LTA	AMEL multiplier 95	AMEL aq life	MDEL multiplier 99	MDEL aq life	Lowest AMEL	Lowest MDEL			
58	Anthracene															No Limit		
59	Benzidine															No Limit		
60	Benzo(a)Anthracene															No Limit		
61	Benzo(a)Pyrene															No Limit		
62	Benzo(b)Fluoranthene															No Limit		
63	Benzo(ghi)Perylene															No Limit		
64	Benzo(k)Fluoranthene															No Limit		
65	Bis(2-Chloroethoxy)Methane															No Limit		
66	Bis(2-Chloroethyl)Ether															No Limit		
67	Bis(2-Chloroisopropyl)Ether															No Limit		
68	Bis(2-Ethylhexyl)Phthalate															No Limit		
69	4-Bromophenyl Phenyl Ether															No Limit		
70	Butylbenzyl Phthalate															No Limit		
71	2-Chloronaphthalene															No Limit		
72	4-Chlorophenyl Phenyl Ether															No Limit		
73	Chrysene															No Limit		
74	Dibenzo(a,h)Anthracene															No Limit		
75	1,2-Dichlorobenzene															No Limit		
76	1,3-Dichlorobenzene															No Limit		
77	1,4-Dichlorobenzene															No Limit		
78	3,3-Dichlorobenzidine															No Limit		
79	Diethyl Phthalate															No Limit		
80	Dimethyl Phthalate															No Limit		
81	Di-n-Butyl Phthalate															No Limit		
82	2,4-Dinitrotoluene															No Limit		
83	2,6-Dinitrotoluene															No Limit		
84	Di-n-Octyl Phthalate															No Limit		
85	1,2-Diphenylhydrazine															No Limit		
86	Fluoranthene															No Limit		
87	Fluorene															No Limit		
88	Hexachlorobenzene															No Limit		
89	Hexachlorobutadiene															No Limit		
90	Hexachlorocyclopentadiene															No Limit		
91	Hexachloroethane															No Limit		
92	Indeno(1,2,3-cd)Pyrene															No Limit		
93	Isophorone															No Limit		
94	Naphthalene															No Limit		
95	Nitrobenzene															No Limit		
96	N-Nitrosodimethylamine															No Limit		
97	N-Nitrosodi-n-Propylamine															No Limit		
98	N-Nitrosodiphenylamine															No Limit		
99	Phenanthrene															No Limit		
100	Pyrene															No Limit		
101	1,2,4-Trichlorobenzene															No Limit		
102	Aldrin															No Limit		
103	alpha-BHC															No Limit		
104	beta-BHC															No Limit		
105	gamma-BHC															No Limit		
106	delta-BHC															No Limit		
107	Chlordane															No Limit		
108	4,4'-DDT															No Limit		
109	4,4'-DDE (linked to DDT)															No Limit		
110	4,4'-DDD															No Limit		
111	Dieldrin															No Limit		
112	alpha-Endosulfan															No Limit		
113	beta-Endosulfan															No Limit		
114	Endosulfan Sulfate															No Limit		
115	Endrin															No Limit		
116	Endrin Aldehyde															No Limit		
117	Heptachlor															No Limit		
118	Heptachlor Epoxide															No Limit		
119-125	PCBs sum (2)															No Limit		
126	Toxaphene															No Limit		

Notes:
 Ud = Undetermined due to lack of data
 Uc = Undetermined due to lack of CTR
 C = Water Quality Criteria
 B = Background receiving water data

CTR#	Parameters	Units	CV	MEC	CTR Water Quality Criteria (ug/L)				REASONABLE POTENTIAL ANALYSIS (RPA)												
					Freshwater		Saltwater		Human Health for consumption of:		Are all B data points non-detects (Y/N)?	If all data points ND Enter the min detection limit (MDL)	Enter the pollutant B detected max conc (ug/L)	If all B is ND, is MDL>C?	If B>C, effluent limit required	Tier 3 - other info. ?	RPA Result - Need Limit?	Reason			
					C acute = CMC tot	C chronic = CCC tot	C acute = CMC tot	C chronic = CCC tot	Water & organisms	Organisms only									Lowest C or WLAs	MEC >= Lowest C	Tier 1 - Need limit?
1	Antimony	ug/L		5					6.00	4300.00	6.00	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
2	Arsenic	ug/L		10	340.00	150.00			50.00		50.00	No	No	Y	Y	10	N	No detected value of B, Step 7	No	MEC-C & B is ND	
3	Beryllium	ug/L		0.5					4.00	Narrative	4.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
4	Cadmium	ug/L	0.6	0.2	3.10				5.00	Narrative	3.10	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
5a	Chromium (III)			0.01	1640.63	195.55				Narrative	195.55	No	No	Y	N		19.8	B<=C, Step 7	No	MEC-C & B<=C	
5b	Chromium (VI)	ug/L		5	16.00	11.00			50.00	Narrative	11.00	No	No	Y	Y	10	N	No detected value of B, Step 7	No	MEC-C & B is ND	
6	Copper	ug/L	0.698	7.94	17.00					Narrative	17.00	No	No	Y	N		31.2	Limit required, B>C & pollutant detected in e	Yes	B>C & pollutant detected in e	
7	Lead	ug/L	0.6	12.5	62.00				50.00	Narrative	50.00	No	No	Y	N		6.92	B<=C, Step 7	No	MEC-C & B<=C	
8	Mercury	ug/L		0.05000	Reserved	Reserved			2.00000	0.05100	0.05100	No	No	Y	Y	0.05000	N	No detected value of B, Step 7	No	MEC-C & B is ND	
9	Nickel	ug/L		6.52	442.44	49.19			100.00	4600.00	49.19	No	No	Y	N		16.4	B<=C, Step 7	No	MEC-C & B<=C	
10	Selenium	ug/L		2	20.00	5.00			10.00	Narrative	5.00	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND	
11	Silver	ug/L		0.25	3.60				50.00		3.60	No	No	Y	Y	0.25	N	No detected value of B, Step 7	No	MEC-C & B is ND	
12	Thallium	ug/L		1					2.00	6.30	2.00	No	No	Y	Y	1	N	No detected value of B, Step 7	No	MEC-C & B is ND	
13	Zinc	ug/L	1.141	146	159.00						159.0	No	No	Y	N		336	Limit required, B>C & pollutant detected in e	Yes	B>C & pollutant detected in e	
14	Cyanide	ug/L		0.01	22.00	5.20			150.00	220000.0	5.20	No	No	Y	Y	0.01	N	No detected value of B, Step 7	No	MEC-C & B is ND	
15	Asbestos	MFL		0.2					7.00		7.00	No	No	Y	Y	0.2	N	No detected value of B, Step 7	No	MEC-C & B is ND	
16	2,3,7,8 TCDD	ug/L	0.6	2.73E-06					0.000030000	1.4E-08	1.40E-08	Yes	Yes	Y	N		1.9018E-05	Limit required, B>C & pollutant detected in e	Yes	MEC-C & B is ND	
16	TCDD Equivalents	ug/L	0	3.15E-06					0.000030000	1.4E-08	1.40E-08	Yes	Yes	Y	N			No detected value of B, Step 7	Yes	MEC>=C	
17	Acrolein	ug/L		5							780.0	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
18	Acrylonitrile	ug/L									0.66	0.660	No	No	Y	Y	2	Y	No detected value of B, Step 7	No	UD; effluent ND, MDL>C, and
19	Benzene	ug/L		0.5					1.0	71	1.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
20	Bromofom	ug/L		19.5						360	360.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
21	Carbon Tetrachloride	ug/L							0.50	4.4	0.50	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	UD; effluent ND, MDL>C, and	
22	Chlorobenzene	ug/L		2					30	21000	30	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND	
23	Chlorodibromomethane	ug/L		25.8						34	34.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
24	Chloroethane	ug/L		No Criteria							No Criteria	No Criteria	No Criteria	Y	Y	2	N	No Criteria	No Criteria	Uc	No Criteria
25	2-Chloroethylvinyl ether	ug/L		No Criteria							No Criteria	No Criteria	No Criteria	Y	Y	1	N	No Criteria	No Criteria	Uc	No Criteria
26	Chloroform	ug/L		No Criteria							No Criteria	No Criteria	No Criteria	Y	Y			No Criteria	No Criteria	Uc	No Criteria
27	Dichlorobromomethane	ug/L		14.2						46	46.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
28	1,1-Dichloroethane	ug/L		1					5.00		5.00	No	No	Y	Y	1	N	No detected value of B, Step 7	No	MEC-C & B is ND	
29	1,2-Dichloroethane	ug/L							0.50	99	0.50	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	UD; effluent ND, MDL>C, and	
30	1,1-Dichloroethylene	ug/L		0.5					6,000	3.2	3,200	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
31	1,2-Dichloropropane	ug/L		0.5					5,000	39	5,000	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
32	1,3-Dichloropropylene	ug/L							1	1700	1	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	UD; effluent ND, MDL>C, and	
33	Ethylbenzene	ug/L		2					300	29000	300	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND	
34	Methyl Bromide	ug/L		2						4000	4000	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND	
35	Methyl Chloride	ug/L		No Criteria							No Criteria	No Criteria	No Criteria	Y	Y	0.5	N	No Criteria	No Criteria	Uc	No Criteria
36	Methylene Chloride	ug/L		0.5					5.0	1600	5.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
37	1,1,2,2-Tetrachloroethane	ug/L		0.5					1.00	11	1.00	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
38	Tetrachloroethylene	ug/L		0.91					5.0	8.85	5.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
39	Toluene	ug/L		0.75					150	200000	150	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND	
40	1,2-Trans-Dichloroethylene	ug/L		1					10	140000	10	No	No	Y	Y	1	N	No detected value of B, Step 7	No	MEC-C & B is ND	
41	1,1,1-Trichloroethane	ug/L		2					200.00		200.00	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND	
42	1,1,2-Trichloroethane	ug/L		0.5					5.0	42	5.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
43	Trichloroethylene	ug/L		0.5					5.0	81	5.0	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
44	Vinyl Chloride	ug/L							1	525	1	No	No	Y	Y	0.5	N	No detected value of B, Step 7	No	UD; effluent ND, MDL>C, and	
45	2-Chlorophenol	ug/L		5						400	400	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
46	2,4-Dichlorophenol	ug/L		5						790	790	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
47	2,4-Dimethylphenol	ug/L		2						2300	2300	No	No	Y	Y	2	N	No detected value of B, Step 7	No	MEC-C & B is ND	
48	4,6-dinitro-o-resol (aka2-methyl-4,6-Dinitrophenol)	ug/L		5						765	765.0	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
49	2,4-Dinitrophenol	ug/L		5						14000	14000	No	No	Y	Y	5	N	No detected value of B, Step 7	No	MEC-C & B is ND	
50	2-Nitrophenol	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	10	N	No Criteria	No Criteria	Uc	No Criteria
51	4-Nitrophenol	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria	No Criteria	Uc	No Criteria
52	3-Methyl-4-Chlorophenol (aka P-chloro-m-resol)	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	1	N	No Criteria	No Criteria	Uc	No Criteria
53	Pentachlorophenol	ug/L		1	4.73	3.63			1.00	8.2	1.00	No	No	Y	Y	1	N	No detected value of B, Step 7	No	UD; effluent ND, MDL>C, and	
54	Phenol	ug/L								4600000	4600000	No	No	Y	Y	10	N	No detected value of B, Step 7	No	MEC-C & B is ND	
55	2,4,6-Trichlorophenol	ug/L								6.5	6.5	No	No	Y	Y	10	Y	No detected value of B, Step 7	No	UD; effluent ND, MDL>C, and	
56	Acenaphthene	ug/L		0.1						2700	2700	No	No	Y	Y	0.1	N	No detected value of B, Step 7	No	MEC-C & B is ND	
57	Acenaphthylene	ug/L		No Criteria						No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	0.1	N	No Criteria	No Criteria	Uc	No Criteria

CTR#	Parameters	HUMAN HEALTH CALCULATIONS			AQUATIC LIFE CALCULATIONS									LIMITS		Recommendation
		Organisms only			Saltwater / Freshwater / Basin Plan											
		AMEL hh = ECA = C hh O only	MDEL/AMEL multiplier	MDEL hh	ECA acute multiplier (p.7)	LTA acute	ECA chronic multiplier	LTA chronic	Lowest LTA	AMEL multiplier 95	AMEL aq life	MDEL multiplier 99	MDEL aq life			
1	Antimony															No Limit
2	Arsenic															No Limit
3	Beryllium															No Limit
4	Cadmium	Narrative	2.01		0.32	1.00	0.53		1.00	1.55	1.55	3.11	3.1	1.5	3.1	No Limit
5a	Chromium (III)															No Limit
5b	Chromium (VI)															No Limit
6	Copper		2.15		0.28	4.79	0.48		4.79	1.65	7.90	3.55	17	7.9	17	No Limit
7	Lead	Narrative	2.01		0.32	19.91	0.53		19.91	1.55	30.90	3.11	62	31	62	No Limit
8	Mercury															No Limit
9	Nickel															No Limit
10	Selenium															No Limit
11	Silver															No Limit
12	Thallium															No Limit
13	Zinc		2.65		0.18	28.84	0.33		28.84	2.08	59.99	5.51	159	60	159	No Limit
14	Cyanide															No Limit
15	Asbestos															No Limit
16	2,3,7,8 TCDD	0.000000014	2.01	0.00000						1.55		3.11		1.4E-08	2.8E-08	No Limit
	TCDD Equivalents	1.40E-08	2.01	2.81E-08						1.55		3.11		1.4E-08	2.8E-08	No Limit
17	Acrolein															No Limit
18	Acrylonitrile															No Limit
19	Benzene															No Limit
20	Bromoform															No Limit
21	Carbon Tetrachloride															No Limit
22	Chlorobenzene															No Limit
23	Chlorodibromomethane															No Limit
24	Chloroethane															No Limit
25	2-Chloroethylvinyl ether															No Limit
26	Chloroform															No Limit
27	Dichlorobromomethane															No Limit
28	1,1-Dichloroethane															No Limit
29	1,2-Dichloroethane															No Limit
30	1,1-Dichloroethylene															No Limit
31	1,2-Dichloropropane															No Limit
32	1,3-Dichloropropylene															No Limit
33	Ethylbenzene															No Limit
34	Methyl Bromide															No Limit
35	Methyl Chloride															No Limit
36	Methylene Chloride															No Limit
37	1,1,2,2-Tetrachloroethane															No Limit
38	Tetrachloroethylene															No Limit
39	Toluene															No Limit
40	1,2-Trans-Dichloroethylene															No Limit
41	1,1,1-Trichloroethane															No Limit
42	1,1,2-Trichloroethane															No Limit
43	Trichloroethylene															No Limit
44	Vinyl Chloride															No Limit
45	2-Chlorophenol															No Limit
46	2,4-Dichlorophenol															No Limit
47	2,4-Dimethylphenol															No Limit
48	4,6-dinitro-o-resol (aka 2-methyl-4,6-Dinitrophenol)															No Limit
49	2,4-Dinitrophenol															No Limit
50	2-Nitrophenol															No Limit
51	4-Nitrophenol															No Limit
52	3-Methyl-4-Chlorophenol (aka p-chloro-m-resol)															No Limit
53	Pentachlorophenol															No Limit
54	Phenol															No Limit
55	2,4,6-Trichlorophenol															No Limit
56	Acenaphthene															No Limit
57	Acenaphthylene															No Limit

CTR#					CTR Water Quality Criteria (ug/L)				Human Health for consumption of:	REASONABLE POTENTIAL ANALYSIS (RPA)													
					Freshwater		Saltwater			Water & organisms	Organisms only	Lowest C or WLAs	MEC >= Lowest C	Tier 1 - Need limit?	B Available (Y/N)?	Are all B data points non-detects (Y/N)?	If all data points ND Enter the min detection limit (MDL)	Enter the pollutant B detected max conc (ug/L)	If all B is MDL>C?	If B>C, effluent limit required	Tier 3 - other info. ?	RPA Result - Need Limit?	Reason
					C acute = CMC tot	C chronic = CCC tot	C acute = CMC tot	C chronic = CCC tot															
58	Anthracene	ug/L		0.1						110000	110000	No	No	Y	Y	0.1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
59	Benidine	ug/L								0.00054	0.00054	No		Y	Y	5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
60	Benzo(a)Anthracene	ug/L								0.049	0.049			Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
61	Benzo(a)Pyrene	ug/L							0.20	0.049	0.049			Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
62	Benzo(b)Fluoranthene	ug/L								0.049	0.0490			Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
63	Benzo(ghi)Perylene	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	0.1	N	No Criteria	No Criteria	Uc	No Criteria		
64	Benzo(k)Fluoranthene	ug/L								0.049	0.0490			Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
65	Bis(2-Chloroethoxy)Methane	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria		No	No Criteria		
66	Bis(2-Chloroethyl)Ether	ug/L		1						1.4	1.400	No	No	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
67	Bis(2-Chloroisopropyl)Ether	ug/L		2						170000	170000	No	No	Y	Y	2	N	No detected value of B, Step 7		No	MEC-C & B is ND		
68	Bis(2-Ethylhexyl)Phthalate	ug/L							4.0	5.9	4.0			Y	Y	5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
69	4-Bromophenyl Phenyl Ether	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria	No Criteria	Uc	No Criteria		
70	Butylbenzyl Phthalate	ug/L		10						5200	5200	No	No	Y	Y	10	N	No detected value of B, Step 7		No	MEC-C & B is ND		
71	2-Chloronaphthalene	ug/L		10						4300	4300	No	No	Y	Y	10	N	No detected value of B, Step 7		No	MEC-C & B is ND		
72	4-Chlorophenyl Phenyl Ether	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria	No Criteria	Uc	No Criteria		
73	Chrysene	ug/L								0.049	0.049			Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
74	Dibenz(a,h)Anthracene	ug/L								0.049	0.0490			Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
75	1,2-Dichlorobenzene	ug/L		0.5					600	17000	600	No	No	Y	Y	0.5	N	No detected value of B, Step 7		No	MEC-C & B is ND		
76	1,3-Dichlorobenzene	ug/L		2						2600	2600	No	No	Y	Y	2	N	No detected value of B, Step 7		No	MEC-C & B is ND		
77	1,4-Dichlorobenzene	ug/L		0.5					5	2600	5	No	No	Y	Y	0.5	N	No detected value of B, Step 7		No	MEC-C & B is ND		
78	3,3-Dichlorobenzidine	ug/L								0.077	0.08			Y	Y	5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
79	Diethyl Phthalate	ug/L		2						120000	120000	No	No	Y	Y	2	N	No detected value of B, Step 7		No	MEC-C & B is ND		
80	Dimethyl Phthalate	ug/L		2						290000	290000	No	No	Y	Y	2	N	No detected value of B, Step 7		No	MEC-C & B is ND		
81	Di-n-Butyl Phthalate	ug/L		10						12000	12000	No	No	Y	Y	10	N	No detected value of B, Step 7		No	MEC-C & B is ND		
82	2,4-Dinitrotoluene	ug/L		5						9.10	9.10	No	No	Y	Y	5	N	No detected value of B, Step 7		No	MEC-C & B is ND		
83	2,6-Dinitrotoluene	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	5	N	No Criteria	No Criteria	Uc	No Criteria		
84	Di-n-Octyl Phthalate	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	10	N	No Criteria	No Criteria	Uc	No Criteria		
85	1,2-Diphenylhydrazine	ug/L								0.54	0.540			Y	Y	1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
86	Fluoranthene	ug/L		0.1						370	370	No	No	Y	Y	0.1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
87	Fluorene	ug/L		0.1						14000	14000	No	No	Y	Y	0.1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
88	Hexachlorobenzene	ug/L							1.00000	0.00077	0.00077			Y	Y	1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
89	Hexachlorobutadiene	ug/L		1						50	50.00	No	No	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
90	Hexachlorocyclopentadiene	ug/L		5					50	17000	50	No	No	Y	Y	5	N	No detected value of B, Step 7		No	MEC-C & B is ND		
91	Hexachloroethane	ug/L		1						8.9	8.9	No	No	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
92	Indeno(1,2,3-cd)Pyrene	ug/L								0.049	0.0490			Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
93	Isophorone	ug/L		1						600	600.0	No	No	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
94	Naphthalene	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	0.1	N	No Criteria	No Criteria	Uc	No Criteria		
95	Nitrobenzene	ug/L		1						1900	1900	No	No	Y	Y	10	N	No detected value of B, Step 7		No	MEC-C & B is ND		
96	N-Nitrosodimethylamine	ug/L		5						8.10	8.10000	No	No	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
97	N-Nitroso-di-n-Propylamine	ug/L								1.40	1.400			Y	Y	5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
98	N-Nitrosodiphenylamine	ug/L		1						16	16.0	No	No	Y	Y	1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
99	Phenanthrene	ug/L	No Criteria							No Criteria	No Criteria	No Criteria	No Criteria	Y	Y	0.1	N	No Criteria	No Criteria	Uc	No Criteria		
100	Pyrene	ug/L		0.1						11000	11000	No	No	Y	Y	0.1	N	No detected value of B, Step 7		No	MEC-C & B is ND		
101	1,2,4-Trichlorobenzene	ug/L								5.00	5.00			Y	Y	5	N	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
102	Aldrin	ug/L			3.00					0.00014	0.00014			Y	Y			No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
103	alpha-BHC	ug/L		0.01						0.013	0.0130	No	No	Y	Y			No detected value of B, Step 7		No	MEC-C & B is ND		
104	beta-BHC	ug/L		0.005						0.046	0.046	No	No	Y	Y	0.005	N	No detected value of B, Step 7		No	MEC-C & B is ND		
105	gamma-BHC	ug/L		0.02	0.95				0.200	0.063	0.063	No	No	Y	Y	0.02	N	No detected value of B, Step 7		No	MEC-C & B is ND		
106	delta-BHC	ug/L		0.005					4.00	4.00	4.00	No	No	Y	Y	0.005	N	No detected value of B, Step 7		No	MEC-C & B is ND		
107	Chlordane	ug/L			2.40	0.00			0.10	0.00059	0.00059			Y	Y	0.1	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
108	4,4'-DDT	ug/L			1.10	0.00				0.00059	0.00059			Y	Y	0.01	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
109	4,4'-DDE (linked to DDT)	ug/L								0.00059	0.00059			Y	Y	0.05	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
110	4,4'-DDD	ug/L								0.00084	0.00084			Y	Y	0.05	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
111	Dieldrin	ug/L				0.24	0.06			0.00014	0.00014			Y	Y	0.01	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
112	alpha-Endosulfan	ug/L		0.01	0.22	0.056				240	0.0560	No	No	Y	Y	0.01	N	No detected value of B, Step 7		No	MEC-C & B is ND		
113	beta-Endosulfan	ug/L		0.01	0.22	0.056				240	0.0560	No	No	Y	Y	0.01	N	No detected value of B, Step 7		No	MEC-C & B is ND		
114	Endosulfan Sulfate	ug/L		0.05						240	240	No	No	Y	Y	0.05	N	No detected value of B, Step 7		No	MEC-C & B is ND		
115	Endrin	ug/L		0.01	0.086	0.036			0.20	0.81	0.0360	No	No	Y	Y	0.01	N	No detected value of B, Step 7		No	MEC-C & B is ND		
116	Endrin Aldehyde	ug/L		0.01						0.81	0.81	No	No	Y	Y	0.01	N	No detected value of B, Step 7		No	MEC-C & B is ND		
117	Heptachlor	ug/L			0.52	0.0038			0.01000	0.00021	0.00021			Y	Y	0.01	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
118	Heptachlor Epoxide	ug/L			0.52	0.0038			0.01000	0.00011	0.00011			Y	Y	0.01	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
119-125	PCBs sum (2)	ug/L				0.01			0.50	0.00017	0.00017			Y	Y	0.5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		
126	Toxaphene	ug/L			0.73	0.0002			3.00000	0.00075	0.0002			Y	Y	0.5	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL-C, an		

Notes:
Ud = Undetermined due to lack of data
Uc = Undetermined due to lack of CTR Water Quality Criteria
C = Water Quality Criteria
B = Background receiving water data

CTR#	Parameters	HUMAN HEALTH CALCULATIONS			AQUATIC LIFE CALCULATIONS								LIMITS		Recommendation		
		Organisms only			Saltwater / Freshwater / Basin Plan								Lowest AMEL			Lowest MDEL	
		AMEL hh = ECA = C hh O only	MDEL/AMEL multiplier	MDEL hh	ECA acute multiplier (p.7)	LTA acute	ECA chronic multiplier	LTA chronic	Lowest LTA	AMEL multiplier 95	AMEL aq life	MDEL multiplier 99					
58	Anthracene															No Limit	
59	Benzidine															No Limit	
60	Benzo(a)Anthracene															No Limit	
61	Benzo(a)Pyrene															No Limit	
62	Benzo(b)Fluoranthene															No Limit	
63	Benzo(ghi)Perylene															No Limit	
64	Benzo(k)Fluoranthene															No Limit	
65	Bis(2-Chloroethoxy)Methane															No Limit	
66	Bis(2-Chloroethyl)Ether															No Limit	
67	Bis(2-Chloroisopropyl)Ether															No Limit	
68	Bis(2-Ethylhexyl)Phthalate															No Limit	
69	4-Bromophenyl Phenyl Ether															No Limit	
70	Butylbenzyl Phthalate															No Limit	
71	2-Chloronaphthalene															No Limit	
72	4-Chlorophenyl Phenyl Ether															No Limit	
73	Chrysene															No Limit	
74	Dibenzo(a,h)Anthracene															No Limit	
75	1,2-Dichlorobenzene															No Limit	
76	1,3-Dichlorobenzene															No Limit	
77	1,4-Dichlorobenzene															No Limit	
78	3,3-Dichlorobenzidine															No Limit	
79	Diethyl Phthalate															No Limit	
80	Dimethyl Phthalate															No Limit	
81	Di-n-Butyl Phthalate															No Limit	
82	2,4-Dinitrotoluene															No Limit	
83	2,6-Dinitrotoluene															No Limit	
84	Di-n-Octyl Phthalate															No Limit	
85	1,2-Diphenylhydrazine															No Limit	
86	Fluoranthene															No Limit	
87	Fluorene															No Limit	
88	Hexachlorobenzene															No Limit	
89	Hexachlorobutadiene															No Limit	
90	Hexachlorocyclopentadiene															No Limit	
91	Hexachloroethane															No Limit	
92	Indeno(1,2,3-cd)Pyrene															No Limit	
93	Isophorone															No Limit	
94	Naphthalene															No Limit	
95	Nitrobenzene															No Limit	
96	N-Nitrosodimethylamine															No Limit	
97	N-Nitrosodi-n-Propylamine															No Limit	
98	N-Nitrosodiphenylamine															No Limit	
99	Phenanthrene															No Limit	
100	Pyrene															No Limit	
101	1,2,4-Trichlorobenzene															No Limit	
102	Aldrin															No Limit	
103	alpha-BHC															No Limit	
104	beta-BHC															No Limit	
105	gamma-BHC															No Limit	
106	delta-BHC															No Limit	
107	Chlordane															No Limit	
108	4,4'-DDT															No Limit	
109	4,4'-DDE (linked to DDT)															No Limit	
110	4,4'-DDD															No Limit	
111	Dieldrin															No Limit	
112	alpha-Endosulfan															No Limit	
113	beta-Endosulfan															No Limit	
114	Endosulfan Sulfate															No Limit	
115	Endrin															No Limit	
116	Endrin Aldehyde															No Limit	
117	Heptachlor															No Limit	
118	Heptachlor Epoxide															No Limit	
119-125	PCBs sum (2)															No Limit	
126	Toxaphene															No Limit	

Notes:

Ud = Undetermined due to lack of data
Uc = Undetermined due to lack of CTR
C = Water Quality Criteria
B = Background receiving water data

Ud = Undetermined due to lack of data
Uc = Undetermined due to lack of CTR Water Quality Criteria
C = Water Quality Criteria
B = Background receiving water data