


PLANT WELL
(POTABLE WATER)

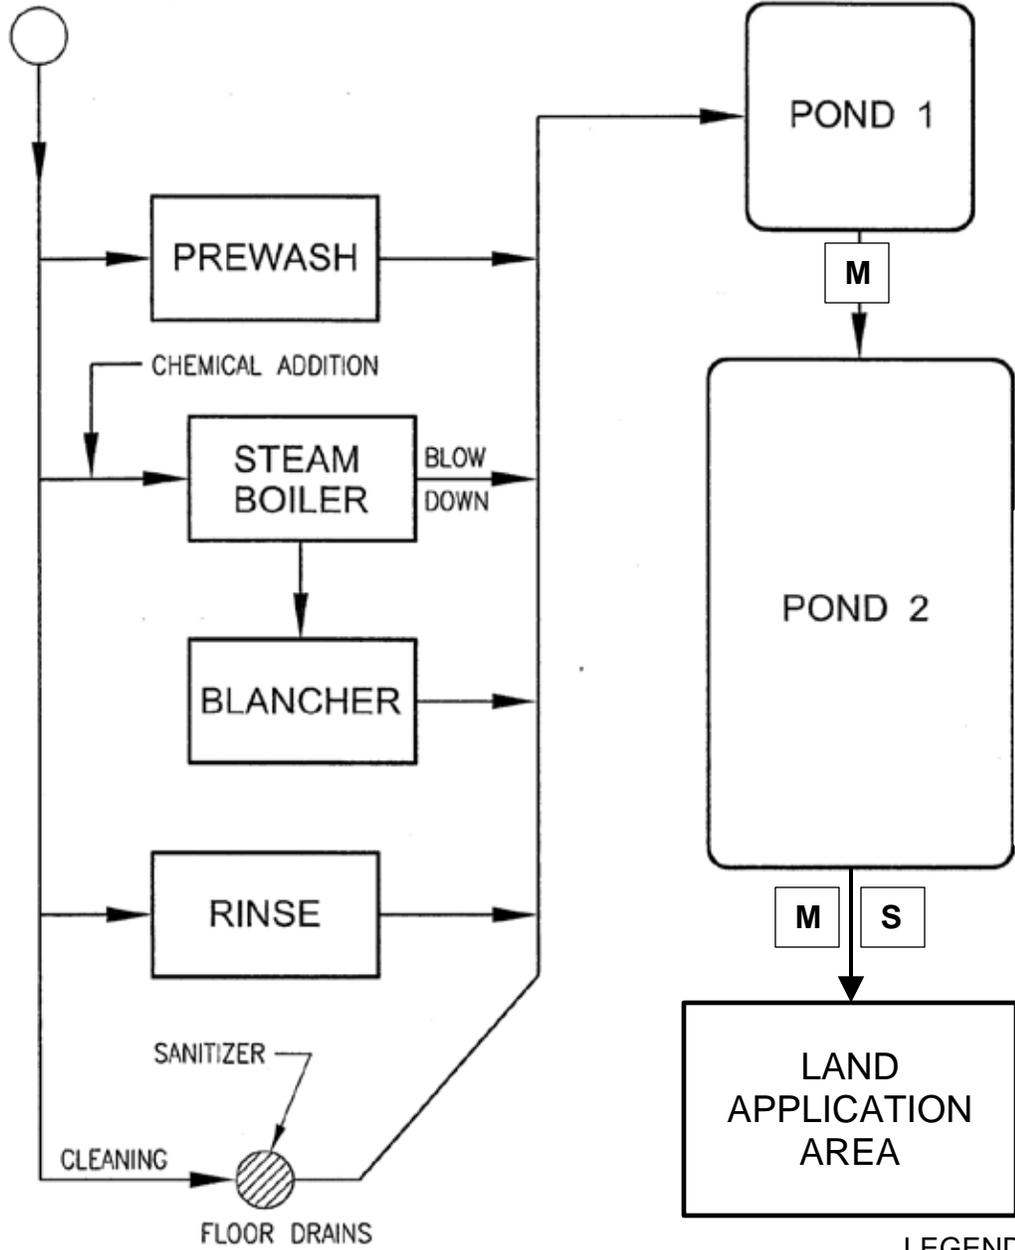

LEGEND

— Water flow

S

Required effluent limit sampling and compliance point

M

Required flow limit compliance point. Flow meter to be installed pursuant to Provision H.1.a

DRAWING REFERENCE:

RWD
August 2007

PROCESS FLOW SCHEMATIC

HUGHSON NUT INC.
VERDUGA ROAD FACILITY
STANISLAUS COUNTY