

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 79-28

WASTE DISCHARGE REQUIREMENTS
FOR
CARONS EXCLUSIVE SPA
Southeast of Desert Hot Springs - Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. R. C. Wilkinson (hereinafter also referred to as the discharger), 12223 Fidel Ave., Whittier, CA 90605, submitted a completed Report of Waste Discharge dated December 11, 1978.
2. The discharger proposes to discharge a maximum of 31,000 gallons-per-day of domestic sewage from a mobile home park having 172 mobile home spaces and a clubhouse containing a kitchen and 2 restrooms. The wastewater is to be discharged into septic tank/seepage pit disposal systems located in the NW $\frac{1}{4}$ of the SE $\frac{1}{4}$ of Section 10, T3S, R5E, SBB&M.
3. The discharger is reserving areas of sufficient size for possible future 100 percent replacement of the seepage pits.
4. The discharger states that wastewater from a swimming pool and two hot pools is to be periodically discharged onto landscape plantings.
5. There are no domestic wells within 200 feet of the proposed discharge facilities described in Finding Nos. 2 and 3 (above).
6. The Water Quality Control Plan for the West Colorado River Basin was adopted by the Board on April 10, 1975. The Basin Plan contains water quality objectives for the Coachella Hydrologic Subunit.
7. The beneficial uses of the groundwaters of the Coachella Hydrologic Subunit are:
 - a. Municipal supply.
 - b. Industrial supply.
 - c. Agricultural supply

*Revised
by 85-88
8/7/85*

8. The proposed development is located in the Miracle Hill Subarea of the Coachella Hydrologic Subunit. Groundwater at this location is warm and mineralized and is used in hot mineral pools and for landscape irrigation.
9. The Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the proposed discharge.
10. The Board in a public meeting heard and considered all comments pertaining to the proposed discharge.
11. The Riverside County Planning Department has prepared Negative Declaration EA 10440 (filing date July 16, 1979) for this proposed park. The Regional Board has reviewed this Negative Declaration and has determined that this project will not have any significant adverse effects on water quality.

IT IS HEREBY ORDERED, the discharger shall comply with the following:


A. Discharge Specifications


1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage and swimming pool and hot pool wastewater shall be discharged at this location.
3. Wastewater discharged subsurface shall be retained underground with no surfacing.
4. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
5. Septic tank cleanings shall be discharged only by a duly authorized service.
6. Swimming pool and hot pool wastewater shall not be discharged into a sewage disposal system.

B. Provisions

1. Sufficient land area shall be reserved for possible future 100 percent replacement of the seepage pits, until such time as this park is connected to a municipal sewerage system.
2. The subsurface sewerage system should be designed and constructed to facilitate possible connection to the Desert Hot Springs County Water District's community sewerage system upon the projected expansion of the District's sewage treatment plant.
3. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the treatment and discharge of wastes.
4. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
5. Prior to any change of ownership of this mobile home park, the discharger shall:
 - a. Specify as a condition of transfer that the area specified in Provision B.1. (above) remain servient to the park, for the purpose of providing additional subsurface sewage disposal capacity until such time as this park is connected to a municipal sewerage system.
 - b. Notify the succeeding owner, in writing, of the existence of this Order, and forward a copy of said correspondence to the Regional Board.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on September 26, 1979.

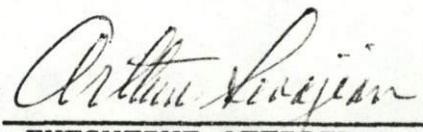
EXECUTIVE OFFICER


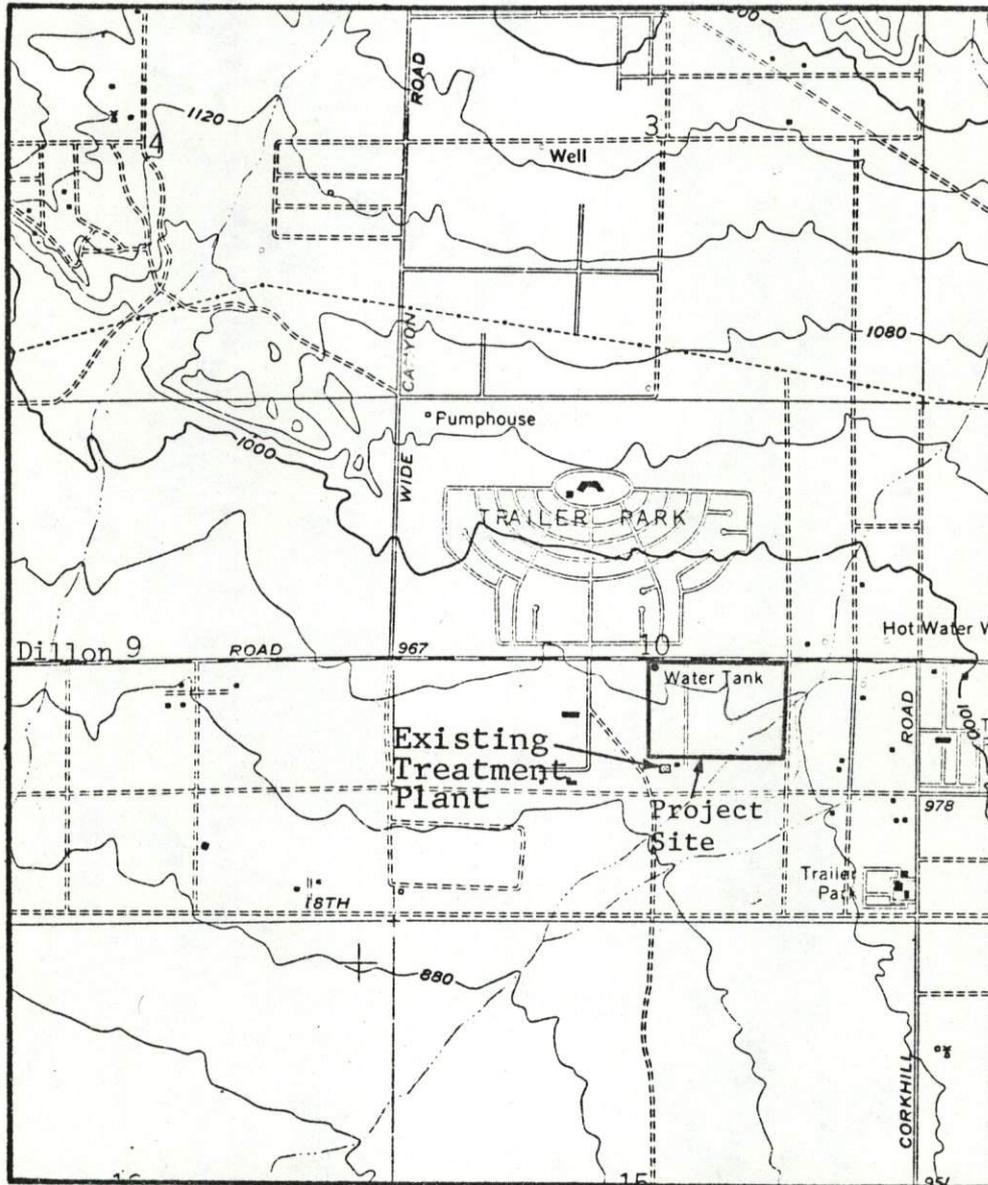


SITE MAP

CARONS EXCLUSIVE SPA
Southeast of Desert Hot Springs - Riverside County
NW 1/4 of the SE 1/4 of Section 10, T3S, R5E, SBB&M
USGS Seven Palms Valley 7.5 min. Topographic Map

Order No. 79-28

DILLON ROAD

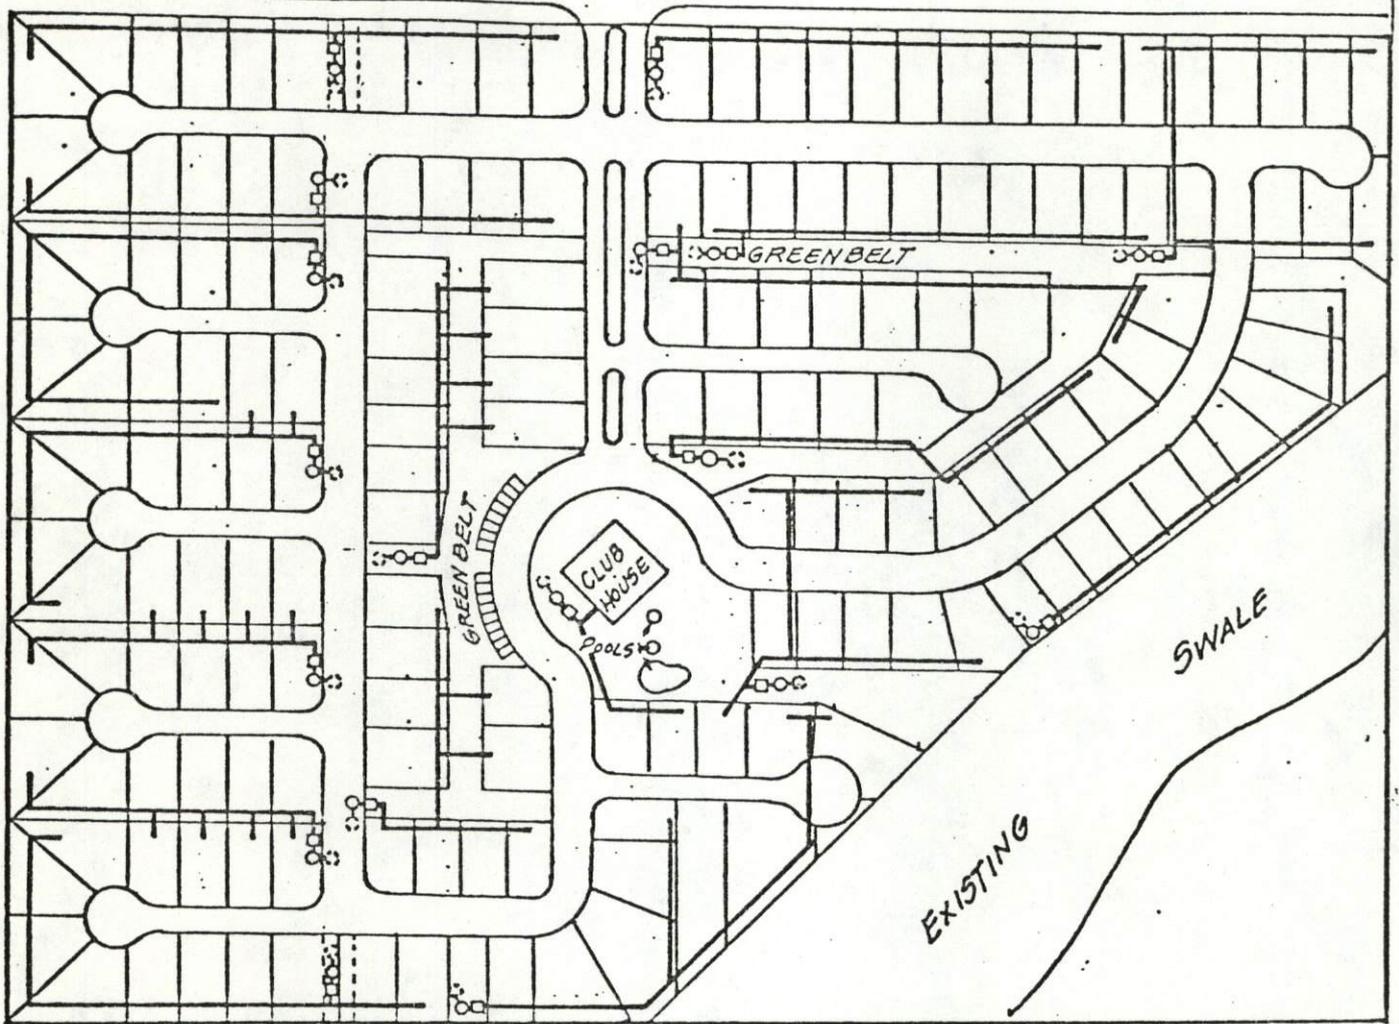

SCALE 1"=200'

CARON'S EXCLUSIVE SPA

DESERT HOT SPRINGS AREA
IN RIVERSIDE COUNTY

LEGEND

- SEPTIC TANK
- SEEPAGE PIT
- ⊕ 100% BACK-UP SEEPAGE PIT AREA

PRELIMINARY SEWAGE DISPOSAL FACILITIES SKETCH