

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

ORDER NO. 86-60

**WASTE DISCHARGE REQUIREMENTS
FOR
FENNER SAFETY ROADSIDE REST AREA
West of Needles - San Bernardino County**

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Caltrans - District 8 (hereinafter also referred to as the discharger), 247 West 3rd Street., P. O. Box 231, San Bernardino, California, 92263, submitted a Report of Waste Discharge, dated April 28, 1986.
2. The discharger proposes to increase the discharge to a maximum of 23,000 gallons-per-day of domestic sewage by expanding the wastewater facilities of an existing roadside rest area that has a westbound and an eastbound comfort station. Wastewater would be discharged into expanded septic tank/leach field disposal systems, which are located in the SW $\frac{1}{4}$ of the NE $\frac{1}{4}$ of Section 29, T8N, R17E, SBB&M.
3. The discharger is reserving areas of sufficient size for possible future 100 percent replacement of the leach fields.
4. There are no domestic wells within 200 feet of the discharge facilities described in Findings No. 2 and 3 (above).
5. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984.
6. The beneficial uses of ground water of the Fenner Subunit as stated in said Plan are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply
7. The Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the proposed discharge.
8. The Board in a public meeting heard and considered all comments pertaining to the proposed discharge.

*Replaced by
97-50057*

9. These waste discharge requirements govern an existing facility, which the discharger has been operating, and therefore is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301 of Title 14, Chapter 3 of the California Administrative Code.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage shall be discharged at this location.
3. Wastewater discharged subsurface shall be retained underground with no surfacing.
4. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
5. Septic tank cleanings shall be discharged only by a duly authorized service.


B. Provisions

1. Sufficient land area shall be reserved for possible future 100 percent replacement of the leach fields, until such time as this complex is connected to a municipal sewerage system.
2. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the treatment and discharge of wastes.
3. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on September 17, 1986.


Executive Officer


CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD -7

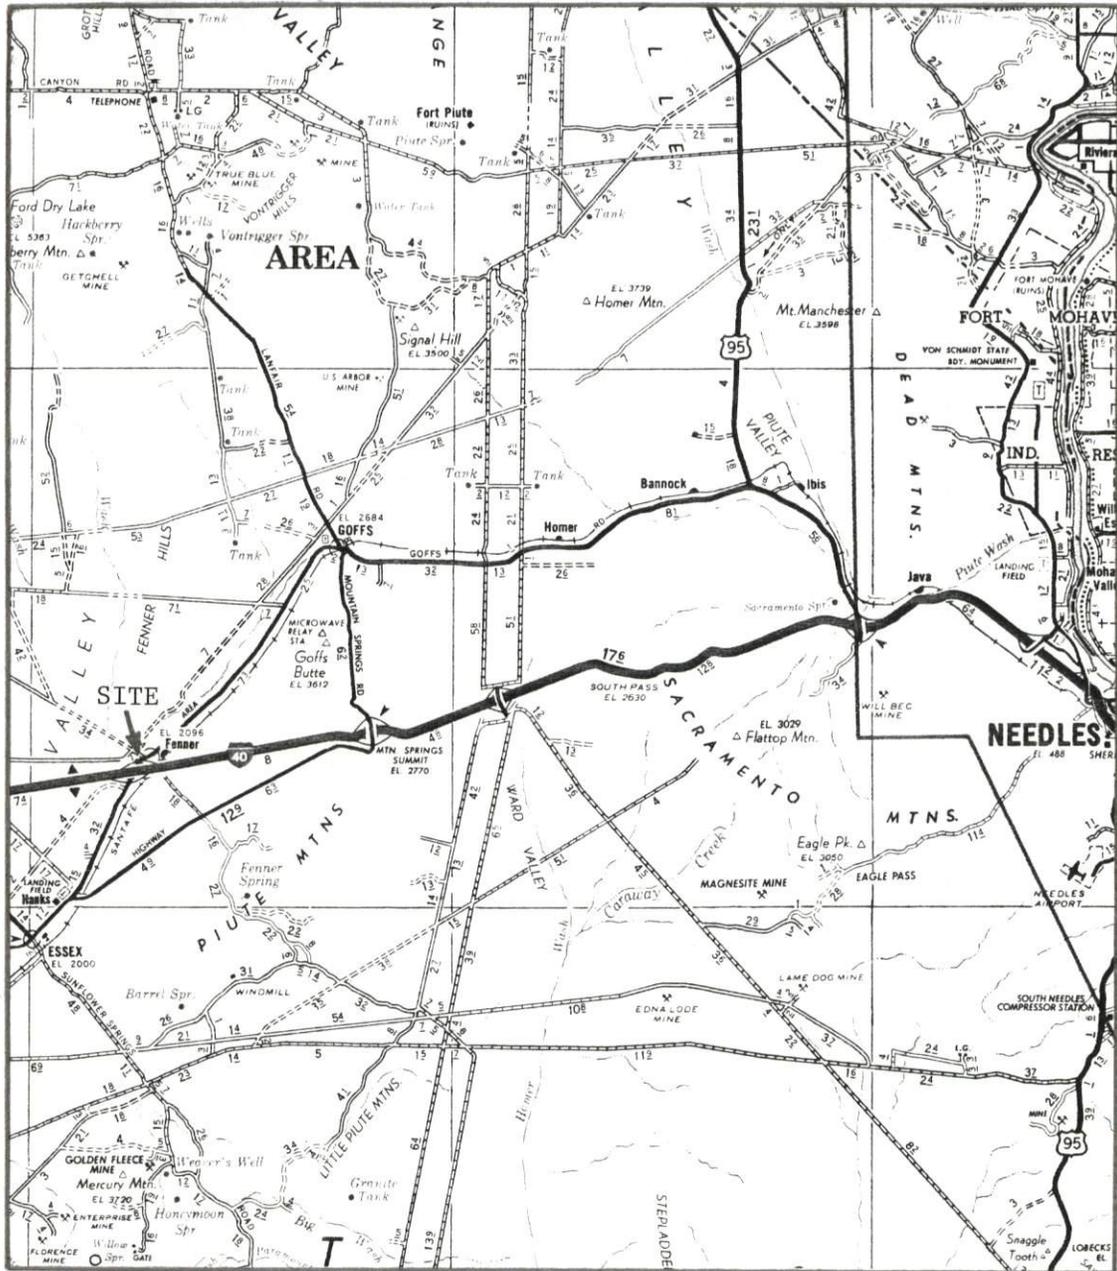

SITE MAP

FENNER SAFETY ROADSIDE REST AREA
 West of Needles - San Bernardino County
 Portion of SW $\frac{1}{4}$, NE $\frac{1}{4}$ of Section 29, T8N, R17E, SBB&M

Order No. 86-60

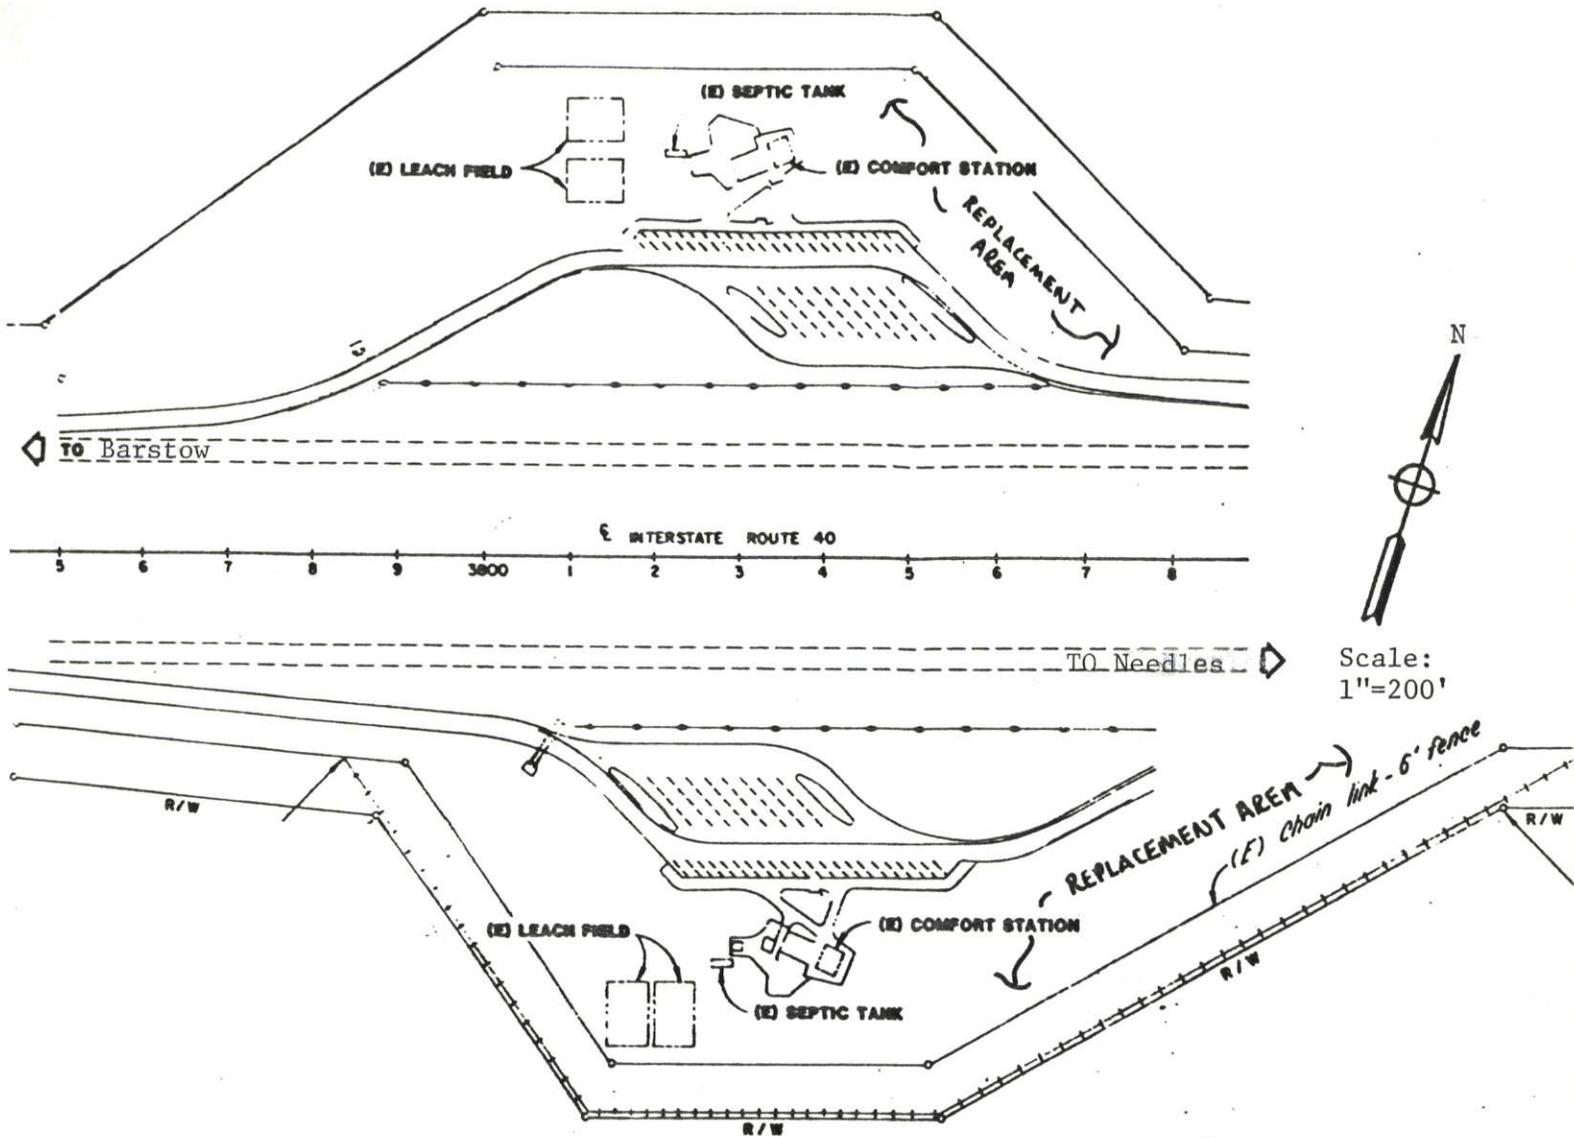

PRELIMINARY SEWAGE DISPOSAL FACILITIES SKETCH

FENNER SAFETY ROADSIDE REST AREA
 West of Needles - San Bernardino County

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 86-60
FOR
FENNER SAFETY ROADSIDE REST AREA
West of Needles - San Bernardino County

Location: Portion of the SW $\frac{1}{4}$ of the NE $\frac{1}{4}$ of Section 29, T8N, R17E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Estimate of maximum daily flow of sewage discharged to the sewerage systems.
2. List any proposed changes in the sewage disposal facilities during the upcoming year.

REPORTING

1. Annual reports are to be submitted by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

2. Immediate reporting of any surfacing of wastewater or other failures of the system by telephone and by a follow-up letter.

Ordered By:

Arthur Sevajian
Executive Officer

Date

June 29, 1987