

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION

ORDER NO. 88-21

WASTE DISCHARGE REQUIREMENTS  
FOR  
LOST LAKE RESORT  
North of Blythe - Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Robert M. Brown (hereinafter also referred to as the discharger), P.O. Box 6246, Lost Lake, California, 92225, submitted on August 28, 1987, a report of waste discharge for an expansion of the park.
2. The discharge from this mobile home and recreational vehicle park has been subject to waste discharge requirements adopted in Board Order No. 86-23. This Order prescribed requirements for a maximum discharge of 30,000 gallons-per-day from 98 mobile home spaces, 52 RV spaces, a laundry room and six (6) restrooms.
3. The discharger is currently discharging a maximum of 68,000 gallons-per-day of domestic sewage from a mobile home and recreational vehicle park consisting of 220 mobile home spaces, 150 RV spaces, a laundry room and 6 (six) restrooms. The wastewater is discharged into 14 septic tank systems that are pumped into 2 (two) lined oxidation basins, which flow into 2 (two) unlined infiltration basins. The park is located in the NE $\frac{1}{4}$  of the SE $\frac{1}{4}$  of Section 8, T2S, R24E, SBB&M.
4. There are no domestic wells within 200 feet of the sewage discharge facilities described in Finding No. 3 (above).
5. The discharger states that the wastewater disposal facilities are more than 200 feet from the high water line of the Colorado River.
6. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984.
7. The Basin Plan delineates the location of discharge to be in the Colorado Hydrologic Unit, which has the following beneficial uses of ground water:
  - a. Municipal supply
  - b. Industrial supply
  - c. Agricultural supply

*Superseded by:  
Board Ord. # 97-042  
5/28/97*

8. The Board has notified the discharger and interested agencies and persons of its intent to revise waste discharge requirements for the discharge.
9. The Board in a public meeting heard and considered all comments pertaining to the discharge.
10. The Regional Board approved on January 27, 1988, Negative Declaration SCH 87092811 for this completed resort expansion in accordance with the California Environmental Quality Act and State Guidelines. The below waste discharge requirements are designed to assure against any significant adverse effects on water quality.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage shall be discharged at this location.
3. A minimum freeboard depth of at least two (2) feet shall be maintained in each basin.
4. Adequate measures shall be taken to assure that unauthorized persons and animal pets are effectively excluded from contact with the discharge.
5. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
6. Treated or untreated sludge, or similar solid waste materials, shall not be discharged to or enter any drainage channels or Colorado River.
7. There shall be no surface flow of wastewater away from the discharge facilities, and there shall be no direct discharge to any drainage channel or to Colorado River.
8. Treatment and disposal by ponding shall be conducted in such a manner that there shall be no stranded or exposed sewage solids.
9. Treatment and discharge of wastewater shall be conducted by technical procedures which will maintain a surface aerobic environment.
10. Infiltration facilities shall be maintained and operated so as to maximize infiltration and minimize the increase in salinity of the infiltrating wastewater.

11. Septic tank cleanings shall be discharged only by a duly authorized service.
12. Standby facilities shall be provided in the event of pump and/or commercial power failure.
13. There shall be no discharge of sewage within 200 feet of the regulated high water line of the Colorado River.

B. Provisions

1. Prior to any modifications in this facility which could result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
2. The discharger shall comply with the attached "Monitoring and Reporting Program No. 88-21", and future revisions thereto, as specified by the Executive Officer.
3. In the event of any change in control or ownership of land or waste disposal facilities owned or controlled by the discharger, the discharger shall:
  - a. Notify the Board of such change; and
  - b. Transmit a copy of this Order to the succeeding owner or operator and file a copy of the transmittal letter with this Board.
4. This Order supersedes Board Order No. 86-23.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on January 27, 1988.

  
Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION**

MONITORING AND REPORTING PROGRAM NO. 88-21  
FOR  
LOST LAKE RESORT  
North of Blythe - Riverside County

Location of Discharge: Portion of NE $\frac{1}{4}$ , SE $\frac{1}{4}$  of Section 8, T2S, R24E, SBB&M

MONITORING

The discharger shall submit the following information in an annual status report:

1. Estimate of average daily flow (gpd) of sewage discharged to basin(s).
2. Number of mobile home and RV spaces, laundry room(s) and restrooms presently discharging to the sewerage system.
3. List of any proposed changes during the coming year.
4. Explain any problems in the sewerage system during the preceding year.


REPORTING

1. Monitoring reports shall be submitted to the Regional Board annually by January 15th of each year to:

California Regional Water Quality Control Board  
Colorado River Basin Region  
73-271 Highway 111, Suite 21  
Palm Desert, CA 92260


2. Report immediately any failure in the sewerage system by telephone and followup by letter.

ORDERED BY:

  
Executive Officer

January 27, 1988  
Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD -7

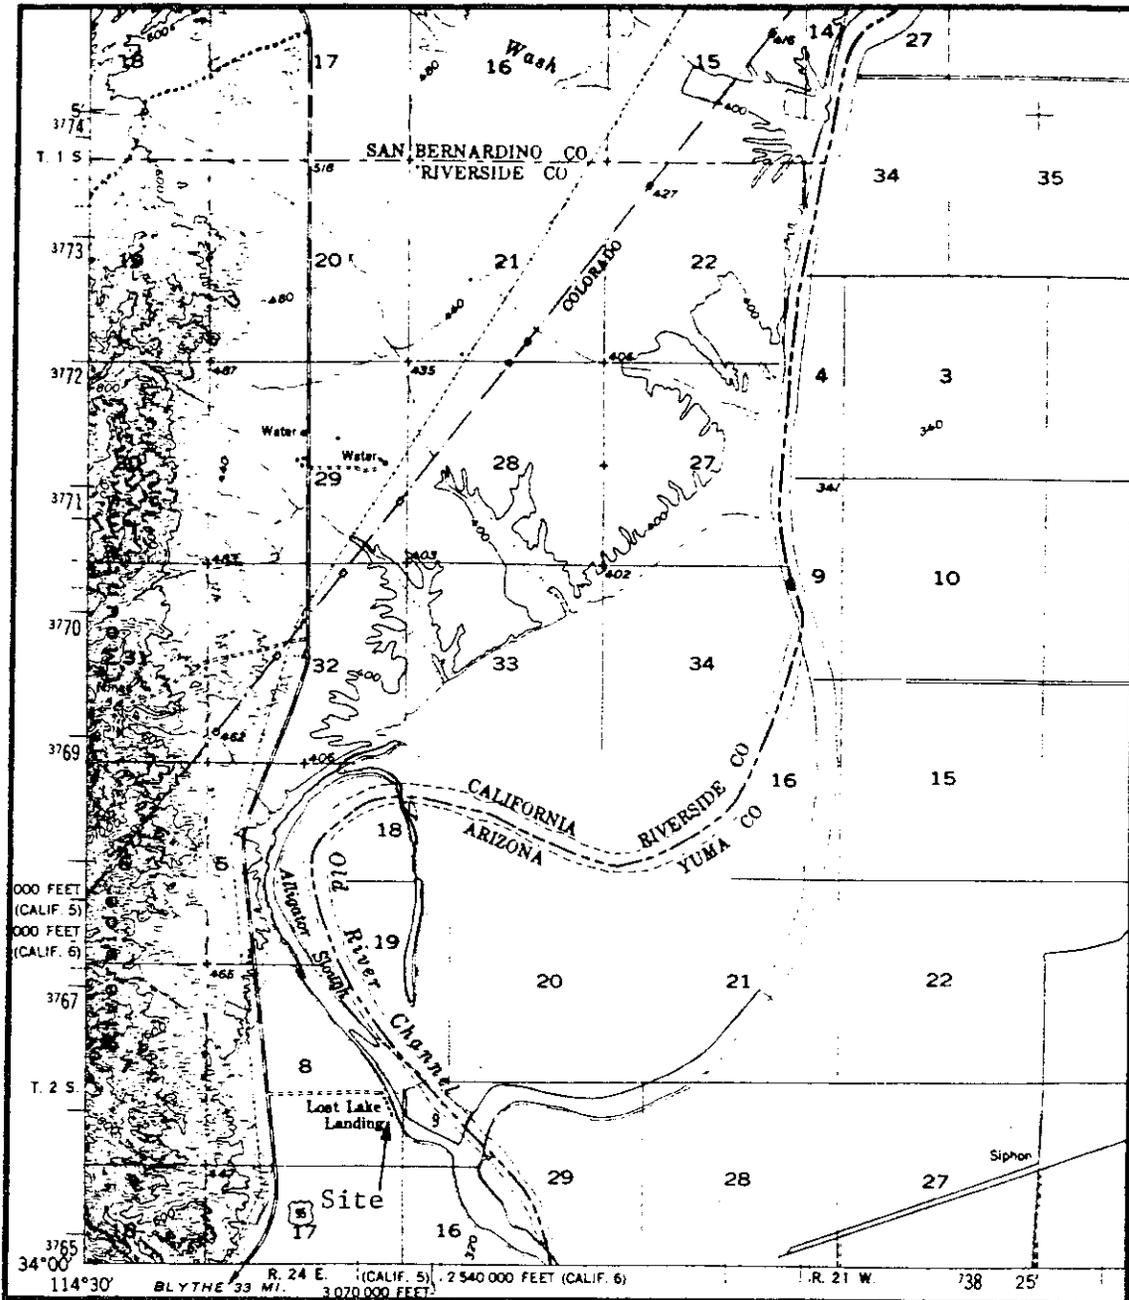

SITE MAP

LOST LAKE RESORT  
 North of Blythe - Riverside County  
 NE $\frac{1}{4}$  of the SE $\frac{1}{4}$  of Section 8, T2S, R24E, SBB&M  
 USGS Parker 15 min. Topographic Map

Order No. 88-21