

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION

ORDER NO. 89-002

WASTE DISCHARGE REQUIREMENTS  
FOR  
RIVER SHORE ESTATES

Northeast of Earp - San Bernardino County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Ray Shidler (hereinafter also referred to as the discharger), P.O. Box 114, Earp, California 92242, supplied the following updated information on the discharge of waste on October 17, 1988:

The discharger is discharging a maximum of 37,000 gallons-per-day of domestic wastewater from a mobile home park having 186 mobile home spaces, a laundry room and two restrooms. The wastewater is discharged into five (5) septic tanks followed by two (2) basins for disposal by evaporation and infiltration. The site is located in the NW 1/4 of the NE 1/4 of Section 10, T1N, R26E, SBB&M.

2. This discharge has been subject to waste discharge requirements adopted in Board Order No. 83-104.
3. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984.
4. There are no domestic wells within 500 feet of the discharge facilities described in Finding No. 1.
5. The beneficial uses of ground water of the Colorado Hydrologic Unit are:
  - a. Municipal supply
  - b. Industrial supply
  - c. Agricultural supply
6. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
7. The Board in a public meeting heard and considered all comments pertaining to the existing discharge.

*3-11-92  
change of  
ownership  
Board Order  
No. 92-024*

*Superseded by  
Board Order # 94-046  
6/29/94*

8. These waste discharge requirements govern the existing facility, which the discharger is currently operating, and therefore is exempt from the provisions of the California Environmental Quality Act in accordance with Section 15301, Chapter 3, Title 14 of the California Code of Regulations.

IT IS HEREBY ORDERED that the discharger shall comply with the following:

A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create pollution or nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic wastewater shall be discharged into the sewage disposal system described in Finding No. 1 (above).
3. A minimum freeboard of two (2) feet shall be maintained in each basin.
4. Treated or untreated sludge or similar solid waste materials shall be disposed only at locations approved by the Regional Board.
5. Adequate measures shall be taken to assure that unauthorized persons and animal pets are effectively excluded from contact with the wastewater.
6. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
7. There shall be no surface flow of wastewater away from the discharge facilities.
8. There shall be no discharge, bypass, or flow of treated or untreated sewage to any irrigation drain or any channel which drains thereto.
9. Disposal by ponding shall be conducted in such a manner that there shall be no stranded or exposed sewage solids.
10. Surface aerobic environment shall be maintained for each basin.
11. Infiltration facilities (basins) shall be maintained and operated so as to maximize infiltration and minimize the increase in salinity of the infiltrating wastewater by evaporation.
12. Standby facilities shall be provided in the event of pump and/or commercial power failure.

B. Provisions


1. The discharger shall comply with "Monitoring and Reporting Program No. 89-002", and future revisions thereto, as specified by the Executive

Officer.

2. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
3. In the event of any change in operation, or in control or ownership of land or waste disposal facilities owned or controlled by the discharger, the discharger shall:
  - a. Notify in writing to this Board of such change; and
  - b. Transmit a copy of this Order to the succeeding owner or operator, and file a copy of the transmittal letter with this Board.

IT IS FURTHER ORDERED that Board Order No. 83-104 be superseded by this Order.

I, Phil Gruenberg, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on January 25, 1989.

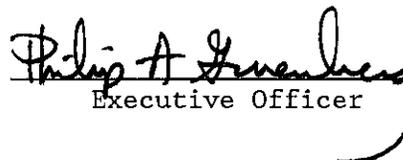  
Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 89-002  
FOR  
RIVER SHORE ESTATES  
Northeast of Earp - Riverside County

Location of Discharge: NW 1/4 of NE 1/4 of Section 10, T1N, R26E, SBB&M

MONITORING

The discharger shall submit an annual report on the following:

1. Estimate of maximum daily flow (gpd) of wastewater discharged to basin(s).
2. Number of spaces presently connected to the sewerage system.
3. List any proposed changes in the sewage disposal facilities during the upcoming year.


REPORTING

1. Annual monitoring reports shall be submitted to the Regional Board by January 15th of each year to:

California Regional Water Quality Control Board  
Colorado River Basin Region  
73-271 Highway 111, Suite 21  
Palm Desert, CA 92260

2. Immediately report to this office by telephone and follow-up by letter any failures of the sewerage system.



ORDERED BY:

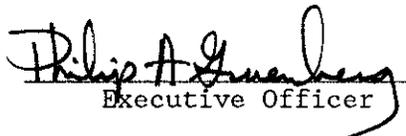  
Executive Officer

January 25, 1989

Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

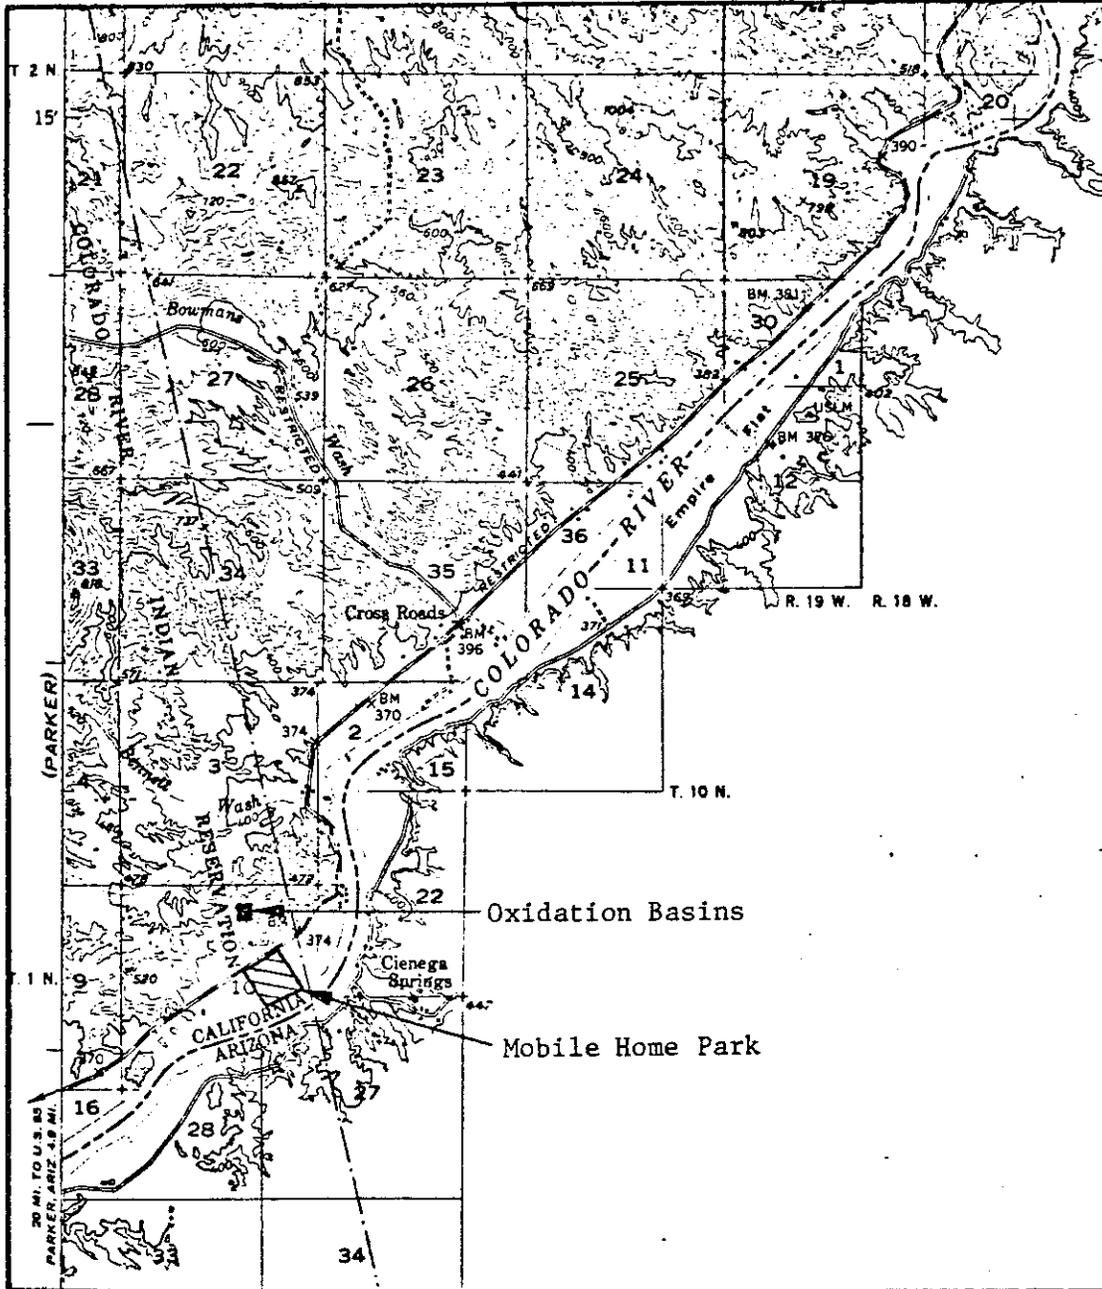

Scale:  
1" = 1 mi.

SITE MAP

RIVER SHORE ESTATES ·  
 Northeast of Earp - Riverside County  
 Portion of the NW 1/4, NE 1/4 of Section 10, T1N, R26E, SBB&M  
 USGS Parker Dam Area 15 min. Topographic Map

Order No. 89-002