

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 90-061

WASTE DISCHARGE REQUIREMENTS
FOR
MOUNT SAN JACINTO WINTER PARK AUTHORITY
West of Palm Springs - Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Mount San Jacinto Winter Park Authority (hereinafter also referred to as the discharger), 1 Tramway Road, Palm Springs, California 92263, submitted updated information on the discharge of waste, dated July 10, 1990.
2. The discharger is discharging a maximum of 7,000 gallons-per-day of domestic sewage from four restrooms and a restaurant at the upper station of the Palm Springs Aerial Tramway. The wastewater is piped from the station to two (2) septic tank/leach field systems located in Long Valley, which is in the NE $\frac{1}{4}$ of Section 23, T4S, R3E, SBB&M.
3. The discharge has been subject to waste discharge requirements adopted in Board Order No. 85-063.
4. The discharger has sufficient area available for possible future 100 percent replacement of the leach fields.
5. The Water Quality Control Plan for the Colorado River Basin Region of California designates the beneficial uses of ground and surface waters in this Region.
6. The location of wastewater disposal is within the Tahquitz Creek watershed, and the beneficial uses of the downstream waters are:
 - a. Ground Water Recharge (GWR)
 - b. Water Contact Recreation (REC I)
 - c. Noncontact Water Recreation (REC II)
 - d. Cold Water Habitat (COLD)
 - e. Wildlife Habitat (WILD)
7. There are no domestic wells within 500 feet of the subsurface discharge facilities described in Finding No. 2 (above).
8. The Board has notified the discharger and all known interested agencies and persons of its intent to update waste discharge requirements for this discharge.
9. The Board in a public meeting heard and considered all comments pertaining to this discharge.

*Replaced by
93-144*

10. In accordance with Section 15301, Chapter 3, Title 14, of the California Code of Regulations, the issuance of these waste discharge requirements, which govern the operation of an existing facility involving negligible or no expansion of use beyond that previously existing, is exempt from the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000 et seq.).

IT IS HEREBY ORDERED, that the discharger shall comply with the following:

A. Discharge Specifications


1. The treatment or disposal of wastes at this facility shall not cause pollution or nuisance as defined in Sections 13050(1) and 13050(m) of Division 7 of the California Water Code.
2. No wastewater other than domestic sewage shall be discharged into the sewage disposal systems described in Finding No. 2 (above).
3. Wastewater shall be discharged subsurface and shall be retained underground with no surfacing.
4. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
5. Sludge from septic tanks shall be disposed of in a manner which will not cause a threat to the public health. The location and disposal method for these wastes shall be reported to the Regional Board at least 30 days prior to removal and discharge at an approved disposal site.

B. Provisions

1. Sufficient land area shall be reserved for possible future 100 percent replacement of the leach lines.
2. The discharger shall comply with "Monitoring and Reporting Program No. 90-061", and future revisions thereto, as specified by the Regional Board's Executive Officer.
3. Prior to any modification of this facility which would result in material change in quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.

IT IS FURTHER ORDERED that Board Order No. 85-063 be superseded by this Board Order.

I, Philip A. Gruenberg, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on September 19, 1990.

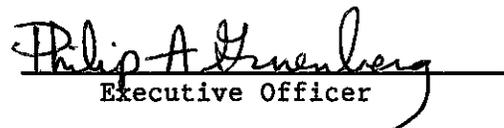
Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 90-061
FOR
MOUNT SAN JACINTO WINTER PARK AUTHORITY
West of Palm Springs - Riverside County

Location of Discharge: Portion of the NE $\frac{1}{4}$ of Section 23, T4S, R3E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Estimate of maximum daily flow of sewage discharged to the upper station sewerage system.
2. List any proposed changes in the sewage disposal facilities during the upcoming year.
3. Explain any surfacing of wastewater or other failures of the system over the past year.

REPORTING

1. Annual reports shall be submitted to the Regional Board by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

2. Report immediately any surfacing of wastewater or other failures of the system by telephone and by a follow-up letter.


ORDERED BY:

Philip A. Gruenberg
Executive Officer

September 19, 1990

Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD -7

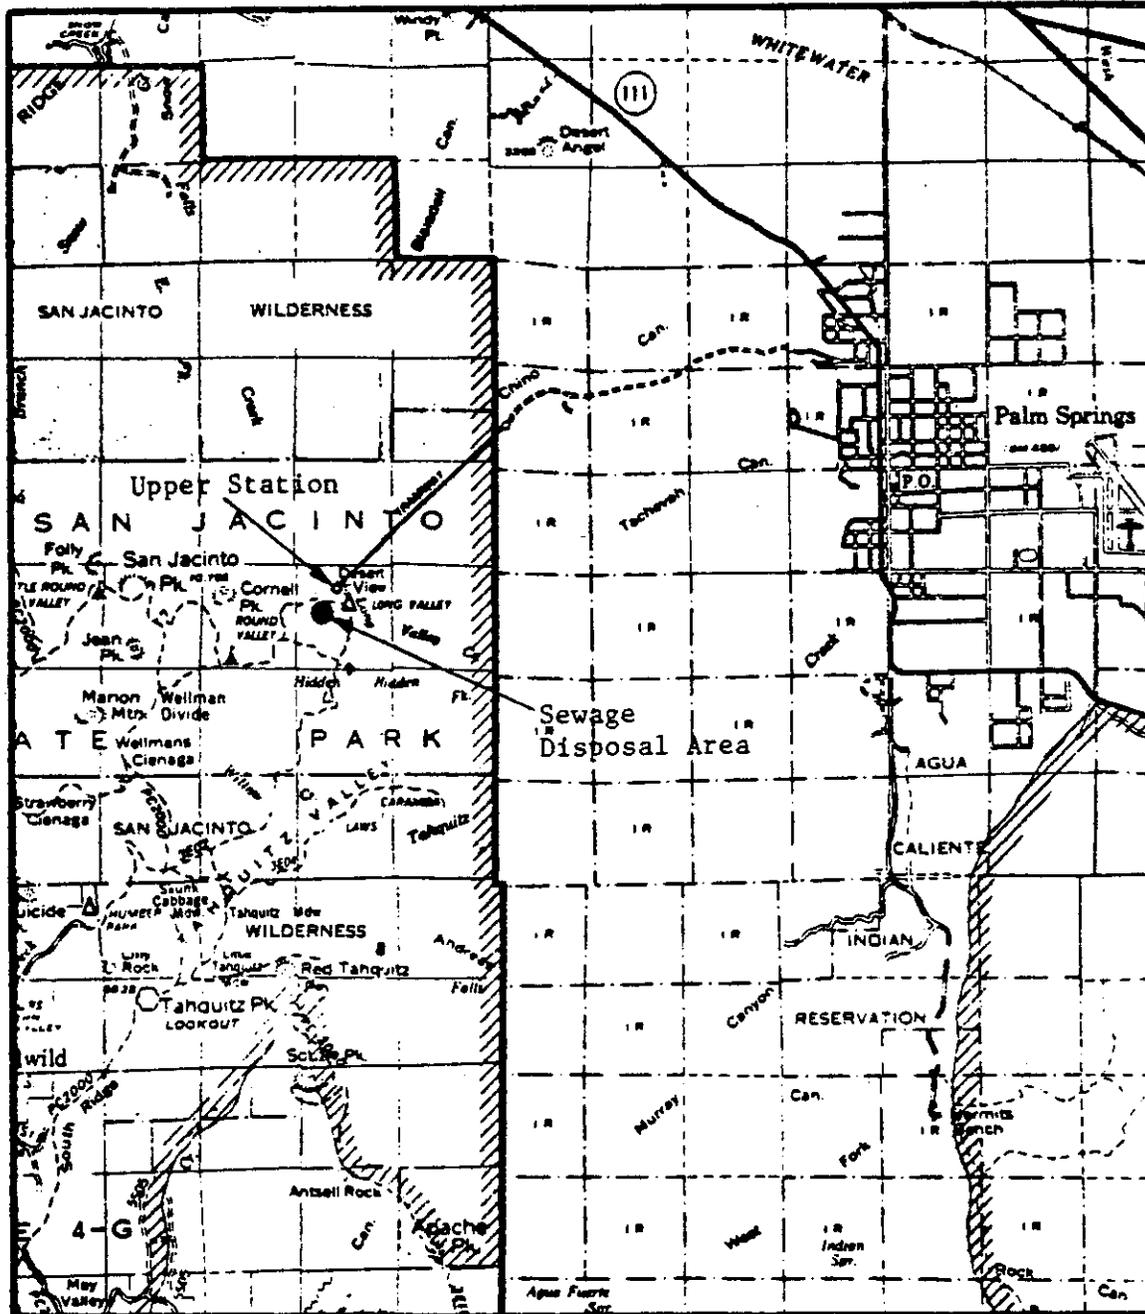


Scale:
1"=2 Miles

SITE MAP

MOUNT SAN JACINTO WINTER PARK AUTHORITY
 West of Palm Springs - Riverside County
 Location of Discharge: Portion of NE $\frac{1}{4}$ of Section 23, T4S, R3E, SBB&M

Upper Palm Springs Aerial Tramway Station

Board Order No. 90-061

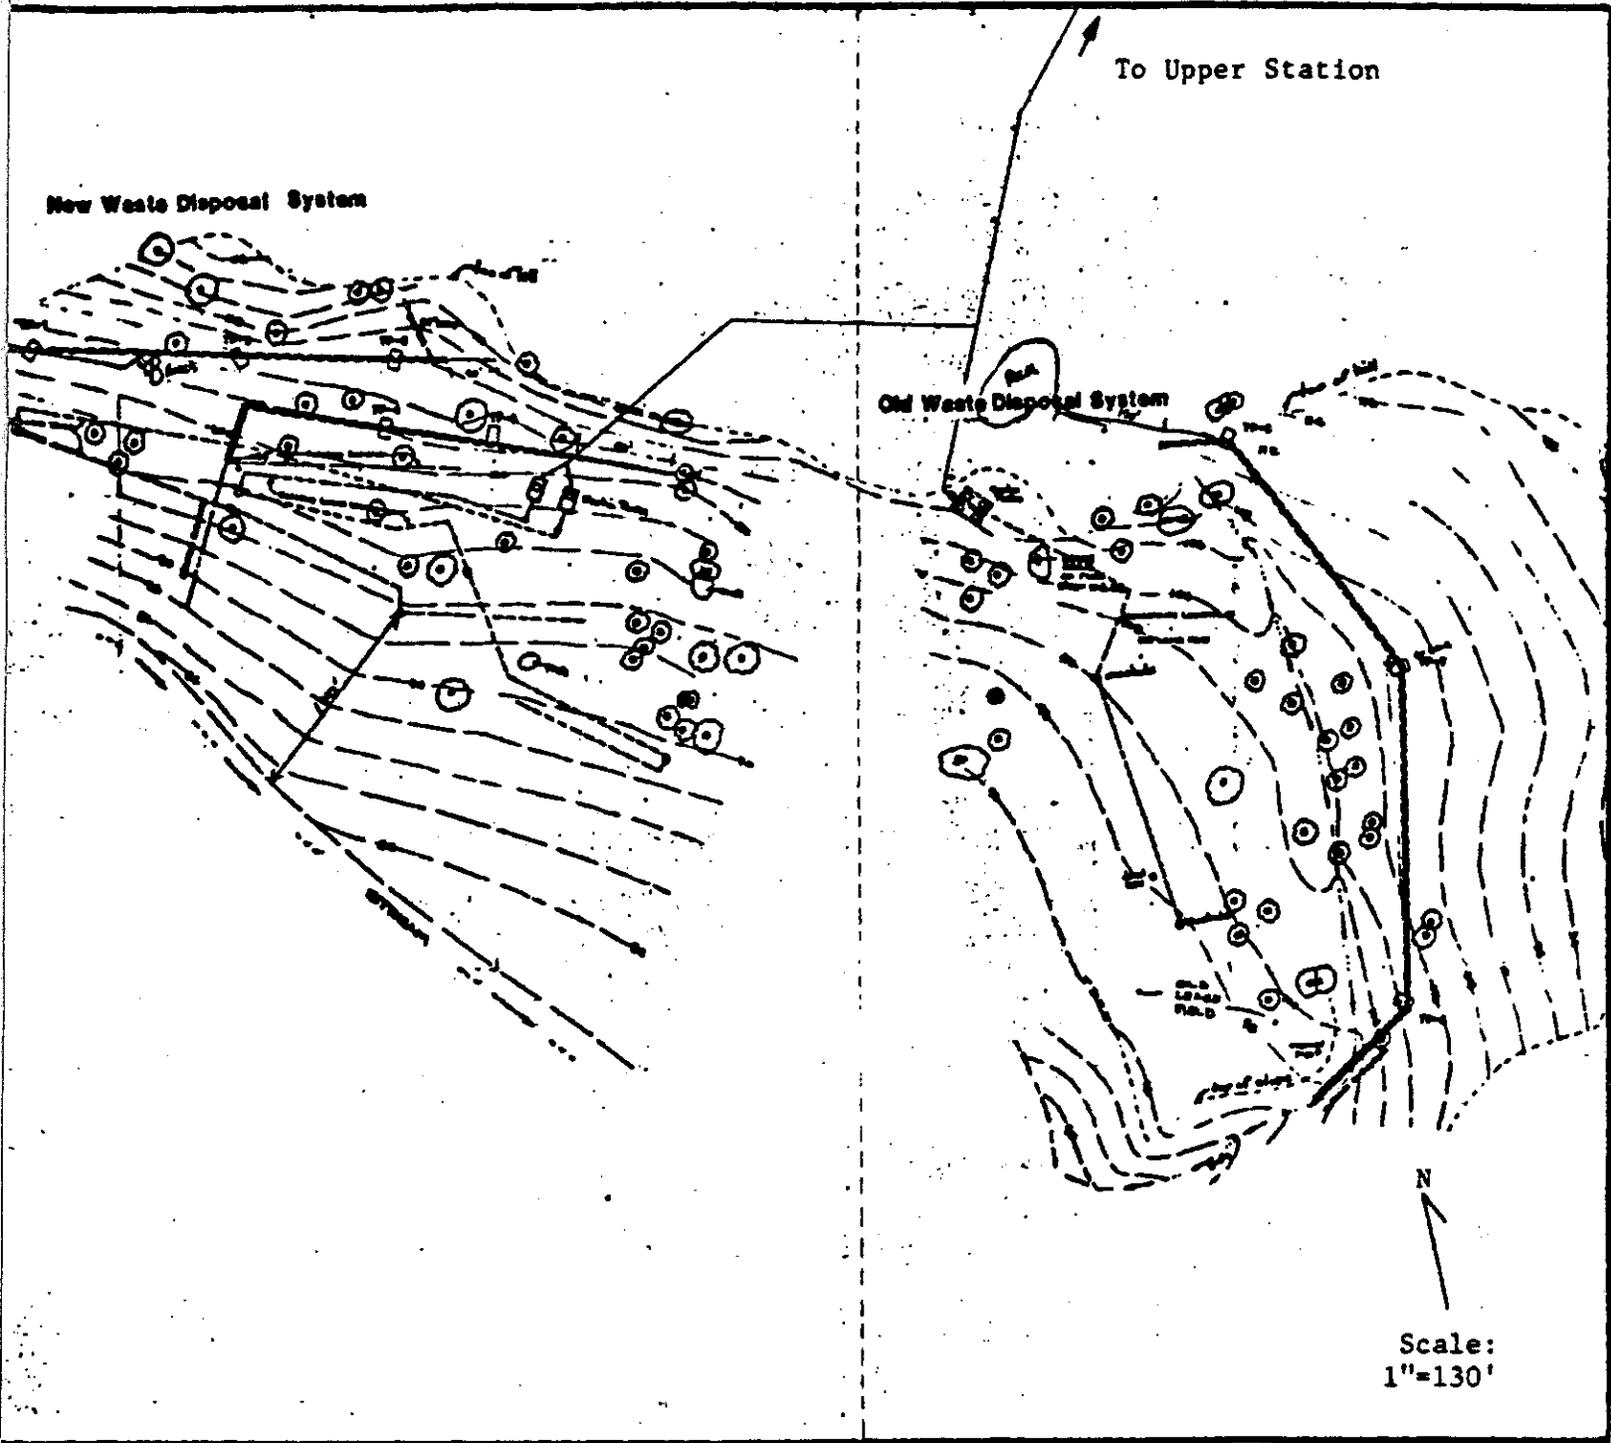

SEWAGE DISPOSAL FACILITIES SKETCH

MOUNT SAN JACINTO WINTER PARK AUTHORITY
West of Palm Springs - Riverside County

Upper Palm Springs Aerial Tramway Station

Board Order No. 90-061