

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION

ORDER NO. 92-001

WASTE DISCHARGE REQUIREMENTS  
FOR  
BOB'S PLAYA RIVIERA  
Northeast of Salton Sea - Imperial County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Bob's Playa Riviera, Bob Granillo, owner and operator (hereinafter also referred to as the discharger), 10-565 Highway 111, North Shore, California, 92254, submitted an updated Report of Waste Discharge, dated October 23, 1991.
2. The discharger is currently discharging a maximum of 3,000 gallons-per-day of domestic sewage from a travel trailer park consisting of 20 travel trailer spaces, two restrooms, a house and a laundry room into a septic tank/leach field disposal system. An additional 180 travel trailer spaces are proposed, which would produce a maximum total discharge of 30,000 gallons-per-day. The wastewater would be discharged for the existing facilities as well as for the expansion through a wet well into a septic tank and pumped to two oxidation basins located about 175 feet west of Highway 111 in the N $\frac{1}{2}$  of the NW $\frac{1}{4}$  of Section 4, T9S, R11E, SBB&M. Upon final Board staff approval of the basins, the leach field system would be abandoned.
3. This discharge has been subject to waste discharge requirements adopted in Board Order No. 87-041.
4. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted May 15, 1991 and designates the beneficial uses of ground and surface waters in this Region.
5. The beneficial uses of ground waters in the East Salton Sea Hydrologic Unit are:
  - a. Municipal supply (MUN)
  - b. Agricultural supply (AGR)

However, shallow ground waters at the discharge location are brackish and are not beneficially used.

6. The Board has notified the discharger and all known interested agencies and persons of its intent to update waste discharge requirements for this discharge.
7. The Board in a public meeting heard and considered all comments pertaining to this discharge.

*Change of  
Ownership  
# 96-011  
1/24/96*

*Rescinded  
1/5/98*

8. The Imperial County Planning Department has certified Negative Declaration EA 77-6-78 (filing date April 26, 1978) for the proposed expansion of this park. The Regional Board has reviewed this Negative Declaration. The below waste discharge requirements are designed to assure against any significant adverse effects on water quality.

IT IS HEREBY ORDERED, that the discharger shall comply with the following:

A. Discharge Specifications

1. The treatment or disposal of wastes at this facility shall not cause pollution or nuisance as defined in Sections 13050(1) and 13050(m) of Division 7 of the California Water Code.
2. No wastewater other than domestic wastewater shall be discharged into the sewage disposal systems described in Finding No. 2, above.
3. A minimum depth of freeboard of two (2) feet shall be maintained at all times in basins.
4. The discharger shall obtain prior written approval from the Regional Board's Executive Officer specifying location and methods of disposal, before disposing of treated or untreated sludge, or similar solid waste materials. In addition, the discharger shall provide the results of any sludge analyses as specified by the Executive Officer.
5. Adequate measures shall be taken to assure that unauthorized persons are effectively excluded from contact with the wastewater.
6. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
7. There shall be no surface flow of wastewater away from the designated disposal areas.
8. There shall be no discharge, bypass, or flow of treated or untreated wastewater to surface waters.
9. Disposal by ponding shall be conducted in such a manner that there shall be no stranded or exposed sewage solids.
10. A surface aerobic environment shall be maintained in each basin.
11. Infiltration facilities (basins) shall be maintained and operated so as to maximize infiltration and minimize the increase in salinity of the infiltrating wastewater by evaporation.
12. Septic tank cleanings shall be discharged at an approved disposal site and only by a duly authorized service.
13. Wastewater discharged subsurface shall be retained underground with no surfacing other than final disposal into the oxidation basins.


14. Facilities shall be available to keep the sewage effluent pumps in operation in the event of commercial power failure.

B. Provisions

1. Sufficient land area shall be reserved for possible future 100 percent replacement of the leach field until such time as this park is connected to a municipal sewerage system.
2. The discharger shall comply with "Monitoring and Reporting Program No. 92-001", and future revisions thereto, as specified by the Regional Board's Executive Officer.
3. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater treated or discharged, or any material change in the location of discharge, the discharger shall report all pertinent information in writing to the Regional Board; and obtain revised requirements before any modifications are implemented.
4. Prior to any change in ownership or management of this operation, the discharger shall transmit a copy of this Board Order to the succeeding owner/operator, and forward a copy of the transmittal letter to the Regional Board.

IT IS FURTHER ORDERED that Board Order No. 87-041 be superseded by this Board Order.

I, Philip A. Gruenberg, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on January 22, 1992.

  
\_\_\_\_\_  
Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 92-001  
FOR  
BOB'S PLAYA RIVIERA  
Northeast of Salton Sea - Imperial County

Location of Discharge: Portion of N $\frac{1}{2}$  of the NW $\frac{1}{4}$  of Section 4, T9S, R11E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Estimate of average daily flow (gpd) of sewage discharged to the leach field or basins.
2. Number of spaces (or residences) presently connected to the sewerage system.
3. List of any proposed changes during the coming year.
4. Explain any problems in the sewerage system during the preceding year.

REPORTING

Annual reports shall be submitted to the Regional Board by January 15th of each year to:


California Regional Water Quality Control Board  
Colorado River Basin Region  
73-271 Highway 111, Suite 21  
Palm Desert, CA 92260

ORDERED BY:

Philip A. Guenberg  
Executive Officer

January 22, 1992

Date

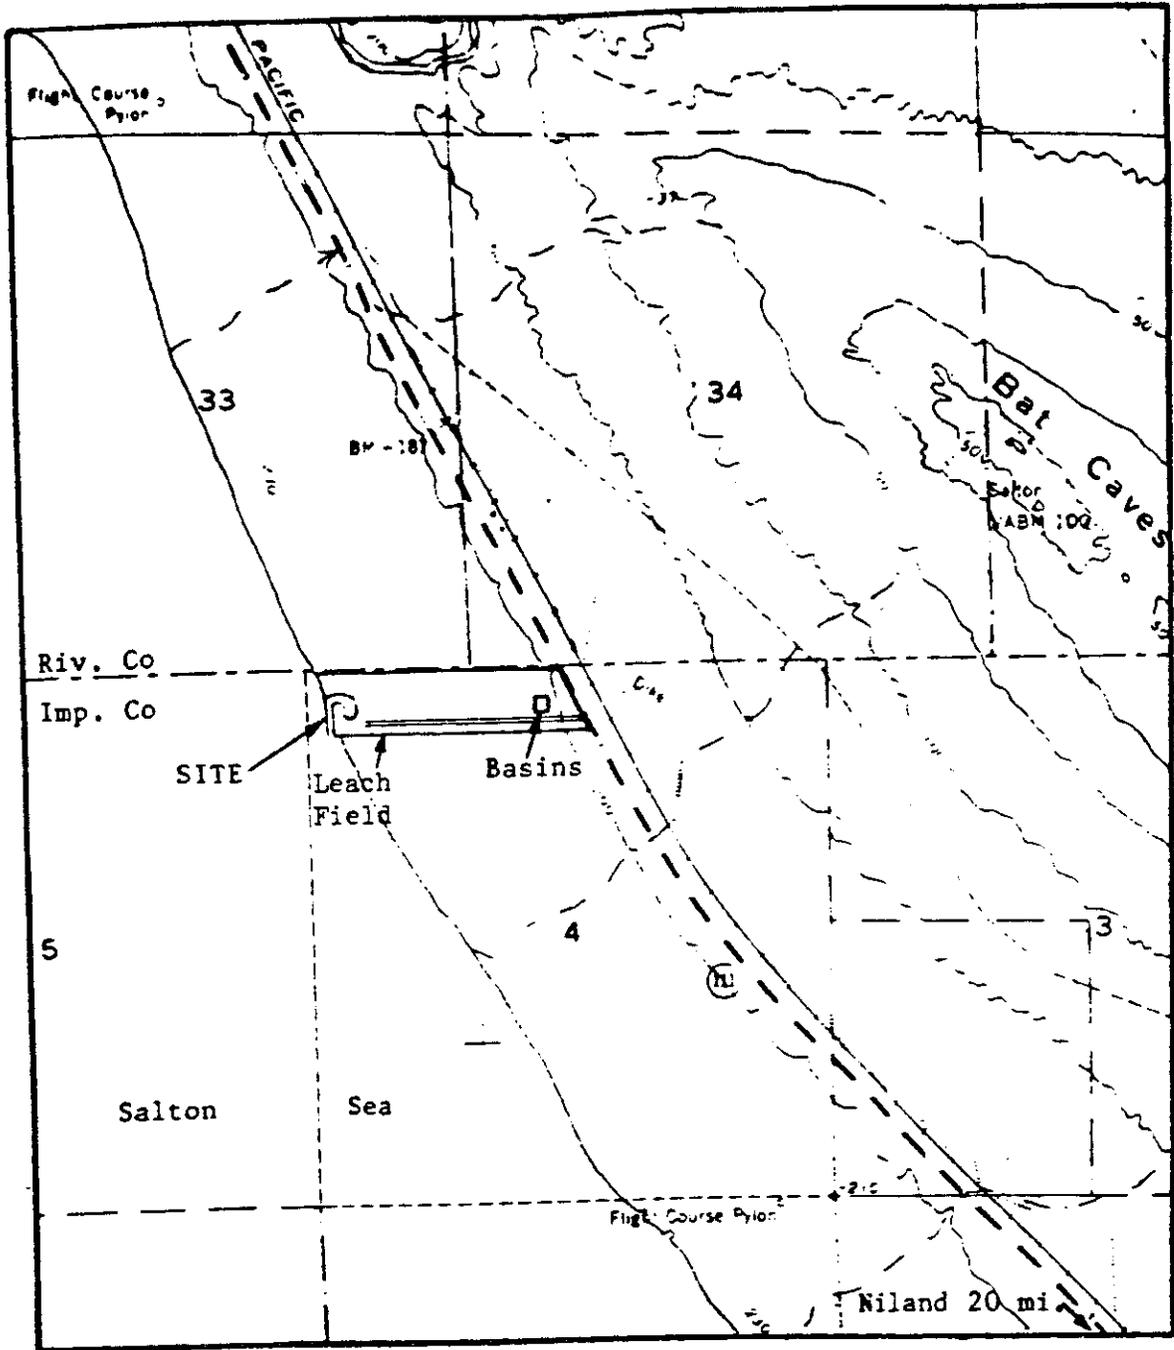

SITE MAP

BOB'S PLAYA RIVIERA  
Northeast of Salton Sea - Imperial County  
N $\frac{1}{2}$  of the NW $\frac{1}{4}$  of Section 4, T9S, R11E, SBB&M  
USGS Durmid 7.5 min. Topographic


Board Order No. 92-001

N ← No Scale

Hwy. 111

Proposed 80 Travel Trailer Spaces (to be constructed in phases)

Sewage Gravity Flow west to concrete wet well and force pump to septic tank and oxidation basins



Proposed Spaces

Existing 20 Spaces

1800'

100% Back-up Area

Leach Field

Septic Tank

Shoreline

Wet Well and Pumps

Restroom & Laundry

House

Store

Marina

Sea Wall

Salton Sea

PRELIMINARY SEWAGE DISPOSAL FACILITIES SKETCH

BOB'S PLAYA RIVIERA

Northeast Shore of Salton Sea - Imperial County