

ATTACHMENT

CARLSBAD SEAWATER DESALINATION PROJECT

SAN DIEGO REGIONAL WATER QUALITY CONTROL BOARD

REGION 9, SAN DIEGO REGION

ORDER NO. R-9-2006-0065

NPDES NO. CA0109223

FLOW, ENTRAINMENT AND IMPINGEMENT MINIMIZATION PLAN

ATTACHMENTS

ATTACHMENT 1 - EPS's 2008 DAILY FLOW DATA

ATTACHMENT 2 - COST ESTIMATE OF SUBSURFACE INTAKE ALTERNATIVES

ATTACHMENT 3 - IMPINGEMENT RESULTS, G1 - TRAVELING SCREEN AND BAR RACK WEEKLY SURVEYS, G2 - HEAT TREATMENT SURVEYS

ATTACHMENT 4 - PROPOSAL FOR INFORMATION COLLECTION CLEAN WATER ACT SECTION 316(B), ENCINA POWER STATION, CABRILLO POWER I LLC, NPDES PERMIT NO. CA0001350, APRIL 1, 2006.

ATTACHMENT 5 - UPDATED IMPINGEMENT AND ENTRAINMENT ASSESSMENT, TENERA ENVIRONMENTAL, MAY 2007.

ATTACHMENT 6 - CARLSBAD DESALINATION FACILITY – ENCINA POWER STATION, SUMMARY OF FISH AND TARGET SHELLFISH LARVAE COLLECTED FOR ENTRAINMENT AND SOURCE WATER STUDIES IN THE VICINITY OF AGUA HEDIONDA LAGOON FROM JUNE 2005 THROUGH MAY 2006.

March 2, 2009

CARLSBAD SEAWATER DESALINATION PROJECT

SAN DIEGO REGIONAL WATER QUALITY CONTROL BOARD

REGION 9, SAN DIEGO REGION

ORDER NO. R-9-2006-0065

NPDES NO. CA0109223

FLOW, ENTRAINMENT AND IMPINGEMENT MINIMIZATION PLAN

ATTACHMENT 1 - EPS's 2008 DAILY FLOW DATA

March 2, 2009

Attachment 1- EPS's 2008 Flow Data

January 2008

Date	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
1/1/2008 0:00	55.07805	58.33641	368.6666	304	0	
1/2/2008 0:00	55.2725	59.08809	368.6668	304	0	
1/3/2008 0:00	55.35299	59.66739	371.4668	304	0	
1/4/2008 0:00	55.80088	59.45156	368.6666	304	0	
1/5/2008 0:00	56.46123	60.02015	368.6668	304	0	
1/6/2008 0:00	56.28431	63.84409	368.6672	304	0	
1/7/2008 0:00	56.22501	60.24764	368.6666	304	0	
1/8/2008 0:00	55.59047	60.71466	368.6666	304	0	
1/9/2008 0:00	55.75674	62.03756	368.6666	304	0	
1/10/2008 0:00	55.75027	62.57749	368.6666	304	0	
1/11/2008 0:00	55.87138	62.14746	417.8601	304	0	
1/12/2008 0:00	55.88246	59.6866	368.6666	304	0	
1/13/2008 0:00	56.24724	60.03067	368.6666	304	0	
1/14/2008 0:00	56.03892	70.03946	368.6666	304	0	
1/15/2008 0:00	55.76051	62.1322	368.6666	304	0	
1/16/2008 0:00	56.15384	61.44526	397.3273	304	0	
1/17/2008 0:00	55.56296	60.90459	437.806	304	0	
1/18/2008 0:00	55.13159	61.85826	368.667	304	0	
1/19/2008 0:00	55.39122	59.99569	368.6671	304	0	
1/20/2008 0:00	55.3815	59.18981	368.6668	304	0	
1/21/2008 0:00	56.17168	60.38311	368.6666	304	0	
1/22/2008 0:00	56.2164	59.68777	337.4108	304	0	
1/23/2008 0:00	56.17308	61.74458	334.1349	304	0	
1/24/2008 0:00	56.05611	60.52076	305.3748	304	0	
1/25/2008 0:00	56.20764	59.84949	299.547	304	-4.453	
1/26/2008 0:00	56.16829	56.51907	150.4457	304	-153.554	
1/27/2008 0:00	56.88367	56.88367	149.7868	304	-154.213	
1/28/2008 0:00	56.6849	57.02176	149.7869	304	-154.213	
1/29/2008 0:00	55.60788	56.71876	149.7868	304	-154.213	
1/30/2008 0:00	55.04952	57.06168	206.3035	304	-97.6965	
1/31/2008 0:00	55.18898	59.77982	293.787	304	-10.213	
			10268.16	9424	-728.556	92.30%

February 2008

Date	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
2/1/2008 0:00	55.57801	59.39231	245.0037	304	58.9963	-
2/2/2008 0:00	56.67244	59.12341	287.997	304	-16.003	-
2/3/2008 0:00	56.40946	58.99786	287.997	304	-16.003	-
2/4/2008 0:00	55.46999	62.97731	287.997	304	-16.003	-
2/5/2008 0:00	54.97696	62.01561	425.3046	304	0	-
2/6/2008 0:00	54.94157	60.8064	585.2242	304	0	-
2/7/2008 0:00	55.8646	60.17717	587.5468	304	0	-
2/8/2008 0:00	56.23401	58.85453	297.5316	304	-6.4684	-
2/9/2008 0:00	56.59497	58.49124	287.997	304	-16.003	-
2/10/2008 0:00	56.81399	58.50042	287.997	304	-16.003	-
2/11/2008 0:00	57.22502	60.06532	287.997	304	-16.003	-
2/12/2008 0:00	57.6266	61.15209	287.997	304	-16.003	-
2/13/2008 0:00	57.55003	61.87146	287.997	304	-16.003	-
2/14/2008 0:00	56.14261	61.15022	288.5891	304	15.4109	-
2/15/2008 0:00	54.88246	58.22489	257.7229	304	46.2771	-
2/16/2008 0:00	55.79207	61.03833	337.4456	304	0	-
2/17/2008 0:00	56.56862	61.65587	443.5468	304	0	-
2/18/2008 0:00	57.08358	57.36781	299.9981	304	-4.0019	-
2/19/2008 0:00	57.61677	57.51239	293.7568	304	10.2432	-
2/20/2008 0:00	57.5015	57.41328	181.5235	304	122.477	-
2/21/2008 0:00	57.32145	57.37921	10.4864	304	293.514	-
2/22/2008 0:00	56.37622	57.15201	0	304	-304	-
2/23/2008 0:00	56.39339	56.8757	0	304	-304	-
2/24/2008 0:00	56.53044	57.31523	0	304	-304	-
2/25/2008 0:00	57.19412	57.45111	0	304	-304	-
2/26/2008 0:00	57.41716	57.59307	0	304	-304	-
2/27/2008 0:00	58.88443	57.97806	0	304	-304	-
2/28/2008 0:00	57.9394	58.28061	0	304	-304	-
2/29/2008 0:00	58.93759	58.95886	0	304	-304	-
			6557.656	8816	3117.41	65%

March 2008

Date	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
3/1/2008 0:00	58.91458	59.1802	0.000	304	-304.000	
3/2/2008 0:00	58.68497	59.26756	0.000	304	-304.000	
3/3/2008 0:00	58.66419	59.45766	0.000	304	-304.000	
3/4/2008 0:00	58.30763	58.99884	0.000	304	-304.000	
3/5/2008 0:00	58.86707	59.38344	0.000	304	-304.000	
3/6/2008 0:00	59.50711	59.66997	0.000	304	-304.000	
3/7/2008 0:00	60.04725	60.04725	0.000	304	-304.000	
3/8/2008 0:00	59.58791	59.58791	0.000	304	-304.000	
3/9/2008 0:00	59.94574	59.94574	0.000	304	-304.000	
3/10/2008 0:00	60.74195	60.74195	0.000	304	-304.000	
3/11/2008 0:00	60.92848	60.92848	0.000	304	-304.000	
3/12/2008 0:00	60.58068	60.58068	0.000	304	-304.000	
3/13/2008 0:00	61.09229	61.09229	0.000	304	-304.000	
3/14/2008 0:00	62.1689	62.1689	1.218	304	-302.782	
3/15/2008 0:00	61.38614	61.5463	0.000	304	-304.000	
3/16/2008 0:00	60.45404	60.80823	0.000	304	-304.000	
3/17/2008 0:00	59.58599	59.7747	0.000	304	-304.000	
3/18/2008 0:00	59.97375	59.97375	0.000	304	-304.000	
3/19/2008 0:00	60.50861	60.50861	0.000	304	-304.000	
3/20/2008 0:00	60.85982	60.85982	12.482	304	-291.518	
3/21/2008 0:00	60.70847	62.56878	152.622	304	-151.379	
3/22/2008 0:00	61.04084	63.49205	149.787	304	-154.213	
3/23/2008 0:00	61.33122	64.11586	149.787	304	-154.213	
3/24/2008 0:00	61.41052	67.0659	149.787	304	-154.213	
3/25/2008 0:00	61.73997	65.85082	242.886	304	-61.114	
3/26/2008 0:00	62.4066	63.52229	299.551	304	-4.449	
3/27/2008 0:00	62.4224	64.60538	299.551	304	-4.449	
3/28/2008 0:00	61.84665	64.88508	299.551	304	-4.449	
3/29/2008 0:00	62.13234	64.5055	299.551	304	-4.449	
3/30/2008 0:00	62.05178	64.29836	305.112	304	1.112	
3/31/2008 0:00	61.79003	65.16395	299.547	304	-4.453	
			2661.431	9424	-6762.569	28%

April 2008

Date	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
4/1/08 12:00 AM	61.42534	65.29865	299.5468	304	-4.4532	
4/2/08 12:00 AM	61.7788	65.00555	299.5468	304	-4.4532	
4/3/08 12:00 AM	61.87854	65.12094	299.5468	304	-4.4532	
4/4/08 12:00 AM	61.21001	65.75201	299.5468	304	-4.4532	
4/5/08 12:00 AM	60.81943	64.37872	299.5468	304	-4.4532	
4/6/08 12:00 AM	61.3461	63.1697	299.5468	304	-4.4532	
4/7/08 12:00 AM	61.62393	66.74051	299.5453	304	-4.4547	
4/8/08 12:00 AM	61.32157	63.42287	299.5424	304	-4.4576	
4/9/08 12:00 AM	61.70842	67.89263	323.5591	304	0	
4/10/08 12:00 AM	61.1647	62.92852	443.5429	304	0	
4/11/08 12:00 AM	61.69075	67.26661	578.4263	304	0	
4/12/08 12:00 AM	61.52929	71.08752	590.7708	304	0	
4/13/08 12:00 AM	61.4532	70.07043	607.3224	304	0	
4/14/08 12:00 AM	62.11076	65.27399	447.8595	304	0	
4/15/08 12:00 AM	62.77756	64.75684	443.5429	304	0	
4/16/08 12:00 AM	62.98117	66.65923	549.3768	304	0	
4/17/08 12:00 AM	63.32564	66.03699	587.5429	304	0	
4/18/08 12:00 AM	62.86544	65.64173	587.5429	304	0	
4/19/08 12:00 AM	61.79207	63.10685	445.9535	304	0	
4/20/08 12:00 AM	61.89238	68.48481	376.6715	304	0	
4/21/08 12:00 AM	62.14897	67.89709	619.0527	304	0	
4/22/08 12:00 AM	62.4975	66.05768	652.6207	304	0	
4/23/08 12:00 AM	63.06746	66.09991	720.1985	304	0	
4/24/08 12:00 AM	63.78792	66.80898	689.4841	304	0	
4/25/08 12:00 AM	64.28423	67.96157	632.4067	304	0	
4/26/08 12:00 AM	64.92619	66.76136	582.0537	304	0	
4/27/08 12:00 AM	65.34881	67.19794	528.8038	304	0	
4/28/08 12:00 AM	65.12825	69.85673	450.1709	304	0	
4/29/08 12:00 AM	65.45698	70.18975	505.6866	304	0	
4/30/08 12:00 AM	64.23721	67.25736	472.293	304	0	
			14231.25	9120	-35.6315	99.60%

May 2008

Date	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
5/1/2008 0:00	64.61558	66.509	444.3535	304	0	
5/2/2008 0:00	65.39342	69.26369	442.3814	304	0	
5/3/2008 0:00	65.71856	66.70947	392.1693	304	0	
5/4/2008 0:00	65.96294	68.63574	299.5372	304	-4.4628	
5/5/2008 0:00	65.74392	69.31657	241.6122	304	-62.3878	
5/6/2008 0:00	64.66403	66.57507	288.0376	304	-15.9624	
5/7/2008 0:00	64.34969	66.80865	355.3748	304	51.3748	
5/8/2008 0:00	64.48176	67.32543	349.7588	304	0	
5/9/2008 0:00	64.17638	66.88145	330.7442	304	0	
5/10/2008 0:00	65.61623	69.89885	195.8734	304	-108.1266	
5/11/2008 0:00	66.31684	72.06525	149.7774	304	-154.2226	
5/12/2008 0:00	65.63977	71.15765	149.7774	304	-154.2226	
5/13/2008 0:00	66.31445	71.58556	239.2173	304	-64.7827	
5/14/2008 0:00	67.16641	70.84717	299.5372	304	-4.4628	
5/15/2008 0:00	68.25648	73.79187	360.6296	304	0	
5/16/2008 0:00	69.3455	73.49152	368.6576	304	0	
5/17/2008 0:00	70.40887	75.16502	368.6632	304	0	
5/18/2008 0:00	71.74605	75.75825	368.6666	304	0	
5/19/2008 0:00	72.18816	75.67088	405.4915	304	0	
5/20/2008 0:00	70.85508	73.82998	362.9068	304	0	
5/21/2008 0:00	69.78146	71.3932	362.9629	304	0	
5/22/2008 0:00	68.56917	68.56917	339.9668	304	0	
5/23/2008 0:00	66.84357	66.84357	295.7311	304	-8.2689	
5/24/2008 0:00	66.15652	66.15652	293.787	304	-10.213	
5/25/2008 0:00	66.88851	66.88851	111.9299	304	-192.0701	
5/26/2008 0:00	67.22431	67.22431	0	304	-304	
5/27/2008 0:00	67.99783	67.99783	0.001116	304	-303.998884	
5/28/2008 0:00	67.78217	67.78217	0	304	-304	
5/29/2008 0:00	67.99413	67.99413	68.06091	304	-235.93909	
5/30/2008 0:00	68.06082	69.87752	236.917	304	-67.083	
5/31/2008 0:00	68.70628	69.60764	299.5424	304	-4.4576	
			8422.066	9424	-1947.286074	79.30%

June 2008

Date	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
6/1/08 0:00	68.56467	70.92802	299.5424	304	-4.4576	
6/2/08 0:00	68.78783	72.44921	299.5424	304	-4.4576	
6/3/08 0:00	68.65149	72.28214	299.5424	304	-4.4576	
6/4/08 0:00	67.63558	71.31238	299.5424	304	-4.4576	
6/5/08 0:00	67.77032	70.54779	299.5424	304	-4.4576	
6/6/08 0:00	68.41267	71.50294	299.5424	304	-4.4576	
6/7/08 0:00	68.22495	72.54205	306.9591	304	0	
6/8/08 0:00	68.40237	71.56978	476.9141	304	0	
6/9/08 0:00	68.24685	75.53003	587.5429	304	0	
6/10/08 0:00	67.8114	72.05092	587.5429	304	0	
6/11/08 0:00	67.98354	72.70866	587.5429	304	0	
6/12/08 0:00	69.11913	72.54916	587.5429	304	0	
6/13/08 0:00	68.53925	70.55152	446.4762	304	0	
6/14/08 0:00	68.03593	69.17938	443.5429	304	0	
6/15/08 0:00	67.49313	67.49313	411.1665	304	0	
6/16/08 0:00	67.98725	69.18384	437.7859	304	0	
6/17/08 0:00	68.98224	72.43056	437.786	304	0	
6/18/08 0:00	69.30067	75.12554	437.7862	304	0	
6/19/08 0:00	69.74646	76.93282	488.3961	304	0	
6/20/08 0:00	71.57615	78.35528	587.5473	304	0	
6/21/08 0:00	73.03625	79.85528	587.5543	304	0	
6/22/08 0:00	74.22292	79.7974	587.5566	304	0	
6/23/08 0:00	74.91967	79.0774	587.5567	304	0	
6/24/08 0:00	74.11199	75.88902	441.4715	304	0	
6/25/08 0:00	73.01502	75.67887	541.5715	304	0	
6/26/08 0:00	72.65965	76.38613	587.5566	304	0	
6/27/08 0:00	73.28844	73.28844	296.1609	304	-7.8391	
6/28/08 0:00	73.29789	76.51698	540.0733	304	0	
6/29/08 0:00	72.25826	76.6291	587.5468	304	0	
6/30/08 0:00	70.15701	75.33709	587.5468	304	0	
			13966.38	9120	-34.5847	99.60%

July 2008

time	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
7/1/08 0:00	69.26075	69.34013	444.5124	304		
7/2/08 0:00	66.9312	68.09121	437.7871	304		
7/3/08 0:00	66.55471	69.51628	534.4029	304		
7/4/08 0:00	68.28378	68.28378	302.8804	304	-1.1196	
7/5/08 0:00	68.59873	68.59873	293.7874	304	-10.2126	
7/6/08 0:00	68.71511	68.71511	293.787	304	-10.213	
7/7/08 0:00	68.90102	75.0793	532.7188	304		
7/8/08 0:00	68.41464	72.54078	791.1448	304		
7/9/08 0:00	68.51984	73.51691	786.2287	304		
7/10/08 0:00	69.72729	72.11263	696.0239	304		
7/11/08 0:00	70.61313	71.96081	547.5894	304		
7/12/08 0:00	71.52317	73.29843	440.6471	304		
7/13/08 0:00	72.12312	74.10944	341.3943	304		
7/14/08 0:00	71.44798	74.4016	580.2341	304		
7/15/08 0:00	71.60821	75.29295	587.5508	304		
7/16/08 0:00	70.81606	74.24728	587.5508	304		
7/17/08 0:00	69.27651	70.71427	587.5508	304		
7/18/08 0:00	69.26743	72.15658	587.5508	304		
7/19/08 0:00	70.81091	70.81091	301.519	304	-2.481	
7/20/08 0:00	71.9041	71.9041	293.7911	304	-10.2089	
7/21/08 0:00	72.51208	72.51208	293.791	304	-10.209	
7/22/08 0:00	72.4714	73.71244	293.791	304	-10.209	
7/23/08 0:00	73.04682	73.89774	461.5403	304		
7/24/08 0:00	73.1693	77.17729	587.5508	304		
7/25/08 0:00	73.27043	77.91094	587.5508	304		
7/26/08 0:00	73.03407	74.44376	449.0009	304		
7/27/08 0:00	73.43362	74.48878	443.5509	304		
7/28/08 0:00	73.39298	74.49374	443.5509	304		
7/29/08 0:00	73.20356	73.91309	443.5509	304		
7/30/08 0:00	73.36878	76.53268	391.8008	304		
7/31/08 0:00	73.52863	77.22065	544.2435	304		
			14908.57	9424	-54.6531	99.40%

August 2008

Date	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
8/1/2008 0:00	73.87272	82.01569	447.3778	304	0	
8/2/2008 0:00	72.63963	73.1339	405.0647	304	0	
8/3/2008 0:00	72.83848	72.83848	398.0869	304	0	
8/4/2008 0:00	73.93726	77.90284	647.3771	304	0	
8/5/2008 0:00	74.64707	78.43299	781.1832	304	0	
8/6/2008 0:00	75.12785	79.50541	753.5826	304	0	
8/7/2008 0:00	74.78503	78.91151	713.9354	304	0	
8/8/2008 0:00	74.46336	78.45973	579.1943	304	0	
8/9/2008 0:00	75.17652	75.17652	441.5101	304	0	
8/10/2008 0:00	74.86446	74.86446	437.7942	304	0	
8/11/2008 0:00	73.79217	75.0275	474.815	304	0	
8/12/2008 0:00	71.84259	74.34873	519.7842	304	0	
8/13/2008 0:00	70.82098	73.64205	491.3175	304	0	
8/14/2008 0:00	69.89922	73.54463	587.5508	304	0	
8/15/2008 0:00	69.68029	72.57944	585.8342	304	0	
8/16/2008 0:00	70.53196	74.55497	587.5508	304	0	
8/17/2008 0:00	70.8702	76.42634	587.5485	304	0	
8/18/2008 0:00	70.44783	70.75332	578.2968	304	0	
8/19/2008 0:00	69.49757	71.16972	587.5468	304	0	
8/20/2008 0:00	69.85083	72.20028	567.0242	304	0	
8/21/2008 0:00	70.51065	72.12764	437.7871	304	0	
8/22/2008 0:00	71.26172	73.29593	437.7871	304	0	
8/23/2008 0:00	71.60268	74.44488	437.7892	304	0	
8/24/2008 0:00	71.68455	75.06197	437.791	304	0	
8/25/2008 0:00	71.34303	75.53971	530.2989	304	0	
8/26/2008 0:00	72.20048	76.98933	587.5508	304	0	
8/27/2008 0:00	72.63307	78.15834	587.5508	304	0	
8/28/2008 0:00	72.24301	78.73959	587.5508	304	0	
8/29/2008 0:00	71.90331	78.8375	587.5508	304	0	
8/30/2008 0:00	72.32967	77.50846	587.5509	304	0	
8/31/2008 0:00	73.13903	74.69556	448.6342	304	0	
			16840.217	9424	0	100.00%

September 2008

time	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
9/1/2008 0:00	73.46597	77.41521	498.907	304	0	
9/2/2008 0:00	73.70034	82.81483	676.4471	304	0	
9/3/2008 0:00	73.8959	82.80732	714.6807	304	0	
9/4/2008 0:00	73.71344	82.97657	713.7727	304	0	
9/5/2008 0:00	73.26717	81.90447	716.7726	304	0	
9/6/2008 0:00	72.00927	78.75995	695.7285	304	0	
9/7/2008 0:00	71.18194	75.43146	657.8719	304	0	
9/8/2008 0:00	71.86323	75.53347	644.7444	304	0	
9/9/2008 0:00	72.73914	77.73425	622.1209	304	0	
9/10/2008 0:00	72.63593	79.37876	606.7407	304	0	
9/11/2008 0:00	71.98448	79.31849	587.5605	304	0	
9/12/2008 0:00	70.60006	74.95802	587.7325	304	0	
9/13/2008 0:00	69.17329	71.64708	594.3686	304	0	
9/14/2008 0:00	68.17056	72.08846	530.2965	304	0	
9/15/2008 0:00	67.61982	73.11609	587.5546	304	0	
9/16/2008 0:00	67.32845	70.83434	587.5508	304	0	
9/17/2008 0:00	69.01248	73.38031	587.5508	304	0	
9/18/2008 0:00	69.98489	75.77675	587.554	304	0	
9/19/2008 0:00	70.20558	75.23483	587.5605	304	0	
9/20/2008 0:00	68.91873	71.71415	587.5605	304	0	
9/21/2008 0:00	68.47094	71.67462	587.5587	304	0	
9/22/2008 0:00	68.51076	73.10765	587.5567	304	0	
9/23/2008 0:00	69.08582	76.36146	587.5566	304	0	
9/24/2008 0:00	69.59718	78.22449	587.5566	304	0	
9/25/2008 0:00	69.92791	78.00694	587.5566	304	0	
9/26/2008 0:00	70.07438	76.0927	587.5566	304	0	
9/27/2008 0:00	69.37527	74.80439	587.5582	304	0	
9/28/2008 0:00	67.21702	72.6103	587.5605	304	0	
9/29/2008 0:00	65.93478	72.17042	587.5566	304	0	
9/30/2008 0:00	65.90041	73.16554	587.5566	304	0	
			18248.65	9120	0	100%

October 2008

time	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
10/1/2008 0:00	66.88644	73.66633	568.4257	304	0	
10/2/2008 0:00	67.38724	70.33056	649.9763	304	0	
10/3/2008 0:00	68.86626	71.86623	465.2539	304	0	
10/4/2008 0:00	69.31333	70.5933	548.2203	304	0	
10/5/2008 0:00	68.69636	71.28494	465.5761	304	0	
10/6/2008 0:00	67.70061	71.8491	448.6005	304	0	
10/7/2008 0:00	67.33462	73.99841	581.3925	304	0	
10/8/2008 0:00	67.96429	75.83421	656.6758	304	0	
10/9/2008 0:00	68.29241	74.037	786.8566	304	0	
10/10/2008 0:00	69.04738	74.15051	732.7805	304	0	
10/11/2008 0:00	67.91972	72.38598	591.4966	304	0	
10/12/2008 0:00	66.43777	70.49062	471.434	304	0	
10/13/2008 0:00	65.33334	70.81139	608.0908	304	0	
10/14/2008 0:00	64.30106	70.07391	720.1362	304	0	
10/15/2008 0:00	63.81651	68.756	718.8624	304	0	
10/16/2008 0:00	63.45768	68.58735	649.7229	304	0	
10/17/2008 0:00	63.0916	69.186	587.3802	304	0	
10/18/2008 0:00	64.30014	67.53129	443.5468	304	0	
10/19/2008 0:00	64.32057	68.45527	443.547	304	0	
10/20/2008 0:00	64.17648	70.24873	360.9469	304	0	
10/21/2008 0:00	63.99141	69.0218	299.5444	304	-4.4556	
10/22/2008 0:00	64.70663	73.87731	299.5468	304	-4.4532	
10/23/2008 0:00	64.75873	71.91666	299.5468	304	-4.4532	
10/24/2008 0:00	64.0321	71.23408	299.5468	304	-4.4532	
10/25/2008 0:00	63.61649	67.47097	299.5497	304	-4.4503	
10/26/2008 0:00	64.33142	68.82366	322.2509	304	0	
10/27/2008 0:00	64.35463	72.85677	463.8752	304	0	
10/28/2008 0:00	64.39629	74.90448	506.9115	304	0	
10/29/2008 0:00	64.90869	76.22089	506.9114	304	0	
10/30/2008 0:00	66.0414	75.43958	461.6366	304	0	
10/31/2008 0:00	66.21015	71.72424	414.9231	304	0	
			15673.17	9424	-22.2655	99.80%

November 2008

time	PLNTCWO	PLNTCWI	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
11/1/2008 0:00	66.6207	78.00092	312.771	304	8.771	
11/2/2008 0:00	67.29136	73.00135	299.5447	304	-4.4553	
11/3/2008 0:00	65.86248	73.33528	323.7018	304	0	
11/4/2008 0:00	64.83785	76.49862	437.7816	304	0	
11/5/2008 0:00	63.45343	75.2961	449.7746	304	0	
11/6/2008 0:00	62.66989	72.74438	422.0697	304	0	
11/7/2008 0:00	62.69248	71.74911	471.5352	304	0	
11/8/2008 0:00	62.97219	65.98486	379.9033	304	0	
11/9/2008 0:00	62.81376	67.29513	322.5084	304	0	
11/10/2008 0:00	61.96257	67.78148	299.5468	304	-4.4532	
11/11/2008 0:00	61.83131	72.95371	304.4149	304	0	
11/12/2008 0:00	62.10519	71.28798	299.5468	304	-4.4532	
11/13/2008 0:00	61.92614	66.74232	379.9802	304	0	
11/14/2008 0:00	61.95608	71.13152	443.5468	304	0	
11/15/2008 0:00	61.94434	66.85366	433.3043	304	0	
11/16/2008 0:00	61.55023	65.57481	443.547	304	0	
11/17/2008 0:00	61.71801	67.37799	457.7726	304	0	
11/18/2008 0:00	61.67519	68.87621	536.5715	304	0	
11/19/2008 0:00	62.4016	69.67127	656.6765	304	0	
11/20/2008 0:00	62.46395	67.27613	656.6799	304	0	
11/21/2008 0:00	62.36002	69.6424	644.7799	304	0	
11/22/2008 0:00	62.51728	68.54761	622.6329	304	0	
11/23/2008 0:00	62.75745	67.7694	599.2608	304	0	
11/24/2008 0:00	62.50464	69.51618	458.6566	304	0	
11/25/2008 0:00	62.73479	67.16589	433.4379	304	0	
11/26/2008 0:00	62.55614	65.51408	446.8938	304	0	
11/27/2008 0:00	62.36171	64.90089	443.5605	304	0	
11/28/2008 0:00	62.01764	66.14619	304.8605	304	0	
11/29/2008 0:00	61.64797	66.4062	299.5605	304	-4.4395	
11/30/2008 0:00	62.17727	65.78579	399.7512	304	0	
			12984.57	9120	-9.0302	99.90%

December 2008

Date	PLNTCWI	PLNTCWO	PLNTFCW	Required Flow	Deficit	% CDP Needs Met
12/1/2008 0:00	61.94685	68.25079	581.8007	304	0	
12/2/2008 0:00	62.20314	68.68632	570.4798	304	0	
12/3/2008 0:00	62.00037	69.35277	554.7913	304	0	
12/4/2008 0:00	62.13548	70.41676	615.83	304	0	
12/5/2008 0:00	61.94967	68.59374	725.7966	304	0	
12/6/2008 0:00	61.50977	67.91967	725.7966	304	0	
12/7/2008 0:00	61.93102	68.59146	694.0562	304	0	
12/8/2008 0:00	61.29079	68.58578	696.1841	304	0	
12/9/2008 0:00	60.32462	71.05241	725.7966	304	0	
12/10/2008 0:00	59.89472	68.49173	723.4006	304	0	
12/11/2008 0:00	59.97142	70.50692	721.3646	304	0	
12/12/2008 0:00	60.50012	68.73678	724.4446	304	0	
12/13/2008 0:00	60.47525	67.53049	709.0979	304	0	
12/14/2008 0:00	58.65944	67.55898	722.9084	304	0	
12/15/2008 0:00	58.11467	71.72564	764.1207	304	0	
12/16/2008 0:00	58.1417	68.89165	741.4246	304	0	
12/17/2008 0:00	56.70695	66.76089	726.5045	304	0	
12/18/2008 0:00	56.06829	67.80674	695.3405	304	0	
12/19/2008 0:00	56.03612	68.61907	691.2405	304	0	
12/20/2008 0:00	56.19368	67.29748	676.0798	304	0	
12/21/2008 0:00	56.626	64.3372	675.1315	304	0	
12/22/2008 0:00	56.88247	66.06559	794.9113	304	0	
12/23/2008 0:00	56.51031	64.44772	747.3035	304	0	
12/24/2008 0:00	56.03827	62.37111	673.3627	304	0	
12/25/2008 0:00	56.70229	60.3209	677.6148	304	0	
12/26/2008 0:00	55.74463	60.77301	475.6706	304	0	
12/27/2008 0:00	54.36066	58.67835	443.5509	304	0	
12/28/2008 0:00	54.40261	58.84012	458.5671	304	0	
12/29/2008 0:00	54.86269	60.0157	512.6716	304	0	
12/30/2008 0:00	55.36657	61.55184	512.6716	304	0	
12/31/2008 0:00	55.69797	60.36811	483.2073	304	0	
			20241.12	9424	0	100%

2008 Summary								
Month	EPS Flow (MG)	Required Flow for CDP (MG)	CDP Flow Not Met By EPS (MG)*	% CDP Needs Met**	# days deficit between 0.1-10.9 mgd	# days deficit between 11-100 mgd	# days deficit between 101-200 mgd	# days deficit between 201-304 mgd
January	10268	9424	728.5	92.30%	2	1	4	0
February	6558	8816	3117.4	65.00%	3	11	1	9
March	2661	9424	6762.6	28.00%	6	1	4	20
April	14231	9120	35.6	99.60%	8	0	0	0
May	8422	9424	1947.3	79.30%	5	5	4	4
June	13966	9120	34.6	99.60%	7	0	0	0
July	14909	9424	54.6	99.40%	7	0	0	0
August	16840	9424	0	100.00%	0	0	0	0
September	18248	9120	0	100.00%	0	0	0	0
October	15673	9424	22.3	99.80%	5	0	0	0
November	12984	9120	9	99.90%	5	0	0	0
December	20241	9424	0	100.00%	0	0	0	0
Total	155001	111264	12711.9		48	18	13	33
Average				88.58%				
<p>*While the EPS monthly flow exceeded the monthly requirements of the desalination facility, on a daily basis this was not always the case. This figure represents the amount of additional flow required in each month during 2008 to maintain a continuous 304 MGD flow the desalination facility. See monthly data sheets for the details.</p> <p>** Calculated as follows: % Desalination Plant Needs Met = (1-D/C)100</p>								

CARLSBAD SEAWATER DESALINATION PROJECT

SAN DIEGO REGIONAL WATER QUALITY CONTROL BOARD

REGION 9, SAN DIEGO REGION

ORDER NO. R-9-2006-0065

NPDES NO. CA0109223

FLOW, ENTRAINMENT AND IMPINGEMENT MINIMIZATION PLAN

ATTACHMENT 2 - COST ESTIMATE OF SUBSURFACE INTAKE ALTERNATIVES

March 2, 2009

304 MDG Intake Cost Estimates - October 2007

VERTICAL BEACH WELLS

Total Capacity =	304 MGD
Individual Intake Well Capacity =	1.5 MGD
Duty Number of Intake Wells Needed =	203
Additional Standby Intakes Needed @ 25 % =	51
Total Intake Wells Needed =	253
Minimum Distance Between Wells (Best Case)=	150 ft
Length of Beach Occupied by Wells =	7.2 miles
Land Needed to Install Wells & Support Facilities	8.6 acres
Cost of Installation of Individual Well =	\$ 1,200,000 per well
Total Costs of Well Installation =	\$ 304,000,000
Cost of Seawater Conveyance Pipelines @US\$500/ft =	\$ 18,925,000
Cost of Intake Booster Pump Stations - =	\$ 30,400,000
Cost of Electrical Power Supply for Well Pumps =	\$ 50,160,000
Total Construction (Direct) Costs =	\$ 403,485,000
Indirect Costs	
Acquisition of Land to Install Wells & Support Struct. =	\$ 4,304,408
Engineering, Design and Procurement @ 25 % =	\$ 100,871,250
Environmental Mitigation Costs @ 15 % =	\$ 60,522,750
Contingency @ 20 % =	\$ 80,697,000
TOTAL INDIRECT COSTS	\$ 246,395,407.71
TOTAL PROJECT EPC COSTS =	\$ 649,880,408

SLANT WELLS - Similar to Dana Point Desal Plant

Total Capacity =	304 MGD
Individual Intake Well Capacity =	5 MGD
Duty Number of Intake Wells Needed =	61
Additional Standby Intakes Needed @ 25 % =	15
Total Intake Wells Needed =	76
Minimum Distance Between Wells (Best Case)=	300 ft
Length of Beach Occupied by Wells =	4.3 miles
Land Needed to Install Wells & Support Facilities	17.4 acres
Cost of Installation of Individual Well =	\$ 2,400,000 per well
Total Costs of Well Installation =	\$ 182,400,000
Cost of Seawater Conveyance Pipelines @US\$500/ft =	\$ 11,250,000
Cost of Intake Booster Pump Stations - =	\$ 30,400,000
Cost of Electrical Power Supply for Well Pumps =	\$ 31,920,000
Total Construction (Direct) Costs =	\$ 255,970,000
Indirect Costs	
Acquisition of Land to Install Wells & Support Struct. =	\$ 8,723,600
Engineering, Design and Procurement @ 25 % =	\$ 63,992,500
Environmental Mitigation Costs @ 15 % =	\$ 38,395,500
Contingency @ 20 % =	\$ 51,194,000
TOTAL INDIRECT COSTS	\$ 162,305,600
TOTAL PROJECT EPC COSTS =	\$ 418,275,600

HORIZONTAL RANNEY WELLS

Total Capacity = 304 MGD

Individual Intake Well Capacity = 5 MGD

Duty Number of Intake Wells Needed = 61

Additional Standby Intakes Needed @ 25 % = 15

Total Intake Wells Needed = 76

Minimum Distance Between Wells (Best Case)= 400 ft

Length of Beach Occupied by Wells = 5.7 miles

Land Needed to Install Wells & Support Facilities 17.4 acres

Cost of Installation of Individual Well = \$ 2,500,000 per well

Total Costs of Well Installation = \$ 190,000,000

Cost of Seawater Conveyance Pipelines @US\$500/ft = \$ 15,000,000

Cost of Intake Booster Pump Stations - = \$ 30,400,000

Cost of Electrical Power Supply for Well Pumps = \$ 33,060,000

Total Construction (Direct) Costs = \$ 268,460,000

Indirect Costs

Acquisition of Land to Install Wells & Support Struct. = \$ 8,723,600

Engineering, Design and Procurement @ 25 % = \$ 67,115,000

Environmental Mitigation Costs @ 15 % = \$ 40,269,000

Contingency @ 20 % = \$ 53,692,000

TOTAL INDIRECT COSTS \$ 169,799,600

TOTAL PROJECT EPC COSTS = \$ 438,259,600

SUBSURFACE INFILTRATION GALLERY (FUKUOKA TYPE INTAKE)

Total Capacity =	304 MGD
Capacity of Individual Intake Galleries =	101.3 MGD
Duty Intake Galleries Needed =	3
Additional Standby Intakes Needed @ 0 % =	0
Total Intake Galleries Needed =	3
Length x Width x Depth Each Gallery =	5280x400x15 ft
Total Length of Intake System =	3.0 miles
Land Needed to Install Wells & Support Facilities	17.9 acres
Cost of Installation of Individual Gallery =	\$ 120,000,000 per 100 MGD gallery
Total Costs of Gallery Installation =	\$ 360,000,000
Cost of Seawater Conv. Pipelines @US\$500/ft =	\$ 7,922,606
Cost of Intake Booster Pump Stations - =	\$ 12,160,000
Cost of Electrical Power Supply for Well Pumps =	\$ 18,608,000
Total Construction (Direct) Costs =	\$ 398,690,606
Indirect Costs	
Acquisition of Land to Install Intake & Support Struct. =	\$ 8,956,114
Engineering, Design and Procurement @ 25 % =	\$ 99,672,652
Environmental Mitigation Costs @ 15 % =	\$ 59,803,591
Contingency @ 20 % =	\$ 79,738,121
TOTAL INDIRECT COSTS	\$ 248,170,478
TOTAL PROJECT EPC COSTS =	\$ 646,861,084

NEW OPEN INTAKE - 1,000 FT INTAKE LINE W/ LOW-VELOCITY INTAKE STRUCTURE

Total Capacity = 304 MGD

Length of Intake Pipe = 1000 ft

Land Needed to Install Wells & Support Facilities 2.3 acres

Cost of Installation of Intake Pipe @ US\$45,000/ft = \$ 45,000,000

Cost of Construction of Ocean Intake Structure = \$ 10,500,000

Cost of New Intake Screens = \$ 8,000,000

Cost of New Intake Pump Station = \$ 24,320,000

Cost of Power Supply for New Pump Station = \$ 5,223,000

Total Construction (Direct) Costs = \$ 93,043,000

Indirect Costs

Acquisition of Land to Install Intake & Support Struct. = \$ 1,147,842

Engineering, Design and Procurement @ 25 % = \$ 23,260,750

Environmental Mitigation @ 15 % = \$ 13,956,450

Contingency @ 20 % = \$ 18,608,600

TOTAL INDIRECT COSTS \$ 56,973,642.06

TOTAL PROJECT EPC COSTS = \$ 150,016,642

CARLSBAD SEAWATER DESALINATION PROJECT

SAN DIEGO REGIONAL WATER QUALITY CONTROL BOARD

REGION 9, SAN DIEGO REGION

ORDER NO. R-9-2006-0065

NPDES NO. CA0109223

FLOW, ENTRAINMENT AND IMPINGEMENT MINIMIZATION PLAN

**ATTACHMENT 3 - IMPINGEMENT RESULTS, G1 - TRAVELING SCREEN
AND BAR RACK WEEKLY SURVEYS, G2 - HEAT TREATMENT SURVEYS**

March 2, 2009

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA001
Sample Count: 19

Survey Date: June 24 - 25, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Cymatogaster aggregata</i>	shiner surfperch	186	40-84	1.3-15.3	729.7
<i>Engraulis mordax</i>	northern anchovy	46	37-90	0.4-10.5	69.2
<i>Heterostichus rostratus</i>	giant kelpfish	8	81-113	4.1-8.2	47.9
<i>Heterostichus</i> spp.	kelpfish	7	81-118	4.0-12.2	47.8
<i>Anchoa compressa</i>	deepbody anchovy	6	31-107	0.1-11.6	13.7
Engraulidae	anchovies	4	-	1.6	1.6
<i>Atherinops affinis</i>	topsmelt	3	54-115	0.9-18.8	25.5
<i>Porichthys myriaster</i>	specklefin midshipman	3	300-378	210	210.0
unidentified fish	unid. fish	3	34	0.5-2.0	4.4
<i>Hyporhamphus rosae</i>	California halfbeak	2	111-125	10.9-11.7	22.6
<i>Paralabrax</i> spp.	sand bass	2	33-55	0.7-2.0	2.7
<i>Anchoa delicatissima</i>	slough anchovy	1	-	3.0	2.8
Atherinopsidae	silverside	1	46	1.0	1.0
<i>Hypsoblennius</i> spp.	blennies	1	252	267	267.0
<i>Pleuronichthys verticalis</i>	hornyhead turbot	1	291	227	226.5
<i>Sphyræna argentea</i>	California barracuda	1	136	0.8	0.8
<i>Syngnathus leptorhynchus</i>	bay pipefish	1	290	9.7	9.7
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	9	253-410	143-521	1,984.7
<i>Urolophus halleri</i>	round stingray	2	285-337	244-444	688.0
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	7	15-34	2.0-18.0	66.1
Total:		294			

Survey: EPSIA002
Sample Count: 19

Survey Date: June 30 - July 1, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Cymatogaster aggregata</i>	shiner surfperch	242	40-115	1.6-31.0	957.0
<i>Roncador stearnsi</i>	spotfin croaker	51	33-205	0.6-106	260.4
<i>Engraulis mordax</i>	northern anchovy	36	35-103	0.2-14.0	57.6
<i>Heterostichus rostratus</i>	giant kelpfish	33	74-128	3.4-16.0	209.8
<i>Atherinops affinis</i>	topsmelt	29	34-115	0.5-15.2	117.3
<i>Strongylura exilis</i>	California needlefish	5	95-142	0.6-2.0	6.1
<i>Hypsopsetta guttulata</i>	diamond turbot	3	104-140	27.7-79.4	173.4
<i>Porichthys myriaster</i>	specklefin midshipman	3	250-305	160-312	633.0
<i>Anchoa delicatissima</i>	slough anchovy	2	65	1.1-3.1	4.2
<i>Paralichthys californicus</i>	California halibut	2	55-95	2.9-11.5	14.4
<i>Sphyræna argentea</i>	California barracuda	2	78-85	2.0-3.6	5.6
<i>Anchoa compressa</i>	deepbody anchovy	1	43	2.2	2.2
<i>Paralabrax nebulifer</i>	barred sand bass	1	230	312	312.0
<i>Seriphus politus</i>	queenfish	1	102	15.7	15.7
unidentified fish	unid. fish	1	-	0.1	0.1
unidentified fish, damaged	unid. damaged fish	1	-	0.4	0.4
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	5	224-505	112-600	1,505.6
<i>Myliobatis californica</i>	bat ray	1	295	392.0	391.5
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	5	19-47	5.7-47.6	96.3
<i>Octopus</i> spp.	octopus	1	-	10.1	10.1
Total:		425			

Impingement Results

Encina Power Station Impingement Abundance: : Traveling Screen and Bar Rack Survey Data

Survey: EPSIA003
Sample Count: 19

Survey Date: July 07 - 08, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Cymatogaster aggregata</i>	shiner surfperch	83	45-66	2.5-7.0	363.0
<i>Roncador stearnsi</i>	spotfin croaker	31	35-52	0.7-2.0	40.1
<i>Heterostichus rostratus</i>	giant kelpfish	29	75-123	3.2-14.9	181.2
<i>Anchoa compressa</i>	deepbody anchovy	17	35-99	0.9-10.5	64.1
<i>Strongylura exilis</i>	California needlefish	13	75-135	0.3-9.5	64.4
<i>Engraulis mordax</i>	northern anchovy	9	42-46	0.5-1.3	6.5
<i>Atherinops affinis</i>	topsmelt	4	60-110	2.2-28.8	43.4
<i>Anchoa delicatissima</i>	slough anchovy	3	-	1.3	1.3
<i>Paralichthys californicus</i>	California halibut	3	43-63	1.5-3.8	7.3
<i>Engraulidae</i>	anchovies	2	-	1.2	1.2
<i>Porichthys myriaster</i>	specklefin midshipman	2	249-270	200-250	450.0
<i>Anchoa</i> spp.	anchovy	1	65	2.5	2.5
<i>Chelotrema saturnum</i>	black croaker	1	48	1.8	1.8
<i>Gibbonsia montereyensis</i>	crevice kelpfish	1	88	8.3	8.3
<i>Hypsopsetta guttulata</i>	diamond turbot	1	285	400	400.0
<i>Sardinops sagax</i>	Pacific sardine	1	35	0.4	0.4
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	7	225-293	165-375	1,715.1
<i>Myliobatis californica</i>	bat ray	1	245	240	239.5
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	6	26-34.5	6.2-12.1	54.0
Total:		215			

Survey: EPSIA004
Sample Count: 19

Survey Date: July 14 - 15, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Engraulis mordax</i>	northern anchovy	228	34-109	0.4-11.0	186.9
<i>Cymatogaster aggregata</i>	shiner surfperch	191	45-228	2.3-326	1,327.3
<i>Atherinops affinis</i>	topsmelt	126	45-139	0.8-26.9	472.1
<i>Heterostichus rostratus</i>	giant kelpfish	119	57-137	1.5-19.6	834.0
<i>Roncador stearnsi</i>	spotfin croaker	38	37-226	0.8-149	306.5
<i>Anchoa delicatissima</i>	slough anchovy	28	33-42	0.2-1.5	24.4
<i>Seriphus politus</i>	queenfish	25	35-60	0.7-3.3	41.7
<i>Strongylura exilis</i>	California needlefish	17	84-375	0.6-45.4	91.8
<i>Sardinops sagax</i>	Pacific sardine	15	35-59	0.4-2.3	15.4
<i>Anchoa compressa</i>	deepbody anchovy	10	60-116	2.5-22.5	76.1
<i>Porichthys myriaster</i>	specklefin midshipman	7	164-354	53.3-369.3	1,692.9
<i>Paralichthys californicus</i>	California halibut	5	41-99	1.3-10.6	32.5
<i>Syngnathus</i> spp.	pipefishes	4	103-179	0.8-4.2	11.6
<i>Hypsopsetta guttulata</i>	diamond turbot	1	145	79.1	79.1
<i>Scomber japonicus</i>	Pacific mackerel	1	63	2.2	2.2
<i>Symphurus atricauda</i>	California tonguefish	1	90	7.3	7.3
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	20	268-421	179-600	5,135.9
<i>Urolophus halleri</i>	round stingray	1	85	29.7	29.7
<i>Myliobatis californica</i>	bat ray	5	248-317	236.7-531.3	2,010.0
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	3	21-33	5.8-16.1	32.7
<i>Octopus</i> spp.	octopus	1	-	239.4	239.4
Total:		846			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA005
Sample Count: 19

Survey Date: July 21 - 22, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Cymatogaster aggregata</i>	shiner surfperch	70	51-71	3.5-10.0	459.0
<i>Sardinops sagax</i>	Pacific sardine	64	40-68	0.5-4.0	90.5
<i>Engraulis mordax</i>	northern anchovy	35	41-106	0.5-9.6	35.1
<i>Seriphus politus</i>	queenfish	20	36-499	0.9-97.6	160.4
<i>Heterostichus rostratus</i>	giant kelpfish	13	81-116	3.6-12.5	93.9
<i>Atherinops affinis</i>	topsmelt	9	54-129	0.8-20.1	56.6
<i>Roncador stearnsi</i>	spotfin croaker	9	46-76	2.4-7.7	35.2
<i>Porichthys myriaster</i>	specklefin midshipman	6	233-378	132-600	1,766.6
<i>Anchoa delicatissima</i>	slough anchovy	5	45	0.6	4.5
<i>Cheilotrema saturnum</i>	black croaker	5	43-52	1.3-2.3	9.3
<i>Syngnathus</i> spp.	pipefishes	4	137-207	0.8-3.8	8.0
<i>Anchoa compressa</i>	deepbody anchovy	3	80-116	5.9-19.9	32.7
<i>Atractoscion nobilis</i>	white seabass	2	79-83	7.6-11.4	19.0
<i>Hypsopsetta guttulata</i>	diamond turbot	2	141-163	73-124	196.7
unidentified fish	unid. fish	2	50-58	1.4-1.6	3.0
<i>Paralichthys californicus</i>	California halibut	1	54	2.2	2.2
<i>Scomber japonicus</i>	Pacific mackerel	1	89	7.8	7.8
<i>Strongylura exilis</i>	California needlefish	1	377	39.3	39.3
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	11	273-618	191-1212	4,244.2
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	3	21-42	2.2-14.8	21.1
Total:		266			

Survey: EPSIA006
Sample Count: 19

Survey Date: July 28 - 29, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Seriphus politus</i>	queenfish	95	41-240	1.1-156	530.0
<i>Cymatogaster aggregata</i>	shiner surfperch	53	52-109	2.2-25.5	341.2
<i>Heterostichus rostratus</i>	giant kelpfish	23	45-116	1.9-12.9	130.0
<i>Engraulis mordax</i>	northern anchovy	22	41-93	0.4-7.8	28.0
<i>Atherinops affinis</i>	topsmelt	17	55-107	1.2-11.9	86.1
<i>Strongylura exilis</i>	California needlefish	11	76-372	0.4-55.7	90.4
<i>Porichthys myriaster</i>	specklefin midshipman	8	285-380	226-410	2,608.8
<i>Anchoa delicatissima</i>	slough anchovy	4	65-84	3.4-6.5	17.9
<i>Sardinops sagax</i>	Pacific sardine	3	55-72	1.5-5.1	9.4
<i>Anchoa</i> spp.	anchovy	2	-	7.4	7.4
<i>Paralichthys californicus</i>	California halibut	2	87-114	8.6-16.3	24.9
<i>Anchoa compressa</i>	deepbody anchovy	1	66	2.9	2.9
<i>Cheilotrema saturnum</i>	black croaker	1	50	2.9	2.9
<i>Sphyrna argentea</i>	California barracuda	1	45	0.3	0.3
<i>Syngnathus</i> spp.	pipefishes	1	175	1.1	1.1
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	8	265-368	160-410	1,898.7
<i>Urolophus halleri</i>	round stingray	2	160-170	217-278	495.0
<i>Myliobatis californica</i>	bat ray	1	254	204.3	204.3
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	2	25-42	8.4-24.1	32.5
Total:		257			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA007
Sample Count: 19

Survey Date: August 04 - 05, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Seriphus politus</i>	queenfish	19	43-80	1.4-6.3	63.0
<i>Atherinops affinis</i>	topsmelt	13	57-100	0.9-9.8	38.0
<i>Cymatogaster aggregata</i>	shiner surfperch	11	55-99	2.9-21.1	77.4
<i>Heterostichus rostratus</i>	giant kelpfish	3	83-115	5.1-11.4	26.6
<i>Porichthys myriaster</i>	specklefin midshipman	3	294-309	242-331	872.5
<i>Hypsopsetta guttulata</i>	diamond turbot	2	139-270	69.5-282.5	352.0
<i>Strongylura exilis</i>	California needlefish	2	62-131	0.1-1.1	1.2
<i>Anchoa compressa</i>	deepbody anchovy	1	104	15.9	15.9
<i>Anchoa delicatissima</i>	slough anchovy	1	92	9.4	9.4
<i>Engraulis mordax</i>	northern anchovy	1	70	4.0	4.0
<i>Sardinops sagax</i>	Pacific sardine	1	57	1.4	1.4
Sciaenidae unid.	croaker	1	25	0.1	0.1
<i>Syngnathus</i> spp.	pipefishes	1	186	1.4	1.4
unidentified fish	unid. fish	1	315	700	700.0
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	7	252-296	133-213	1,250.8
<i>Myliobatis californica</i>	bat ray	3	240-250	175.4-183.9	537.3
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	1	25	6.3	6.3
<i>Loxorhynchus crispatus</i>	moss crab	1	7.3	1.1	1.1
Total:		72			

Survey: EPSIA008
Sample Count: 19

Survey Date: August 11 - 12, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Atherinops affinis</i>	topsmelt	375	37-156	0.5-40.8	1,068.2
<i>Cymatogaster aggregata</i>	shiner surfperch	97	56-109	5.1-29.4	895.0
<i>Anchoa compressa</i>	deepbody anchovy	43	64-169	3.1-19.9	426.7
<i>Seriphus politus</i>	queenfish	28	35-167	1.0-62.1	239.2
<i>Heterostichus rostratus</i>	giant kelpfish	24	73-137	2.9-21.6	175.2
<i>Sardinops sagax</i>	Pacific sardine	17	59-92	2.5-9.3	65.8
<i>Syngnathus</i> spp.	pipefishes	16	145-210	0.5-2.8	23.3
<i>Engraulis mordax</i>	northern anchovy	12	54-95	1.7-7.7	37.6
<i>Strongylura exilis</i>	California needlefish	12	78-297	0.8-20.2	59.6
<i>Porichthys myriaster</i>	specklefin midshipman	9	53-309	1.9-306.2	1,556.9
<i>Leuresthes tenuis</i>	California grunion	8	52-71	1.4-2.9	17.9
<i>Anchoa delicatissima</i>	slough anchovy	2	75-101	4.6-11.1	15.7
<i>Cheilotrema saturnum</i>	black croaker	2	62-119	3.7-20.7	24.4
<i>Hypsopsetta guttulata</i>	diamond turbot	2	91-202	8.4-190	198.1
<i>Anisotremus davidsonii</i>	sargo	1	243	341.2	341.2
<i>Hyperprosopon argenteum</i>	walleye surfperch	1	153	96.9	96.9
<i>Paralabrax</i> spp.	sand bass	1	32	0.9	0.9
<i>Pleuronichthys verticalis</i>	hornyhead turbot	1	152	97.3	97.3
<i>Roncadora stearnsi</i>	spotfin croaker	1	164	57.1	57.1
Sciaenidae unid.	croaker	1	38	2.7	2.7
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	8	259-341	150-297	1,595.1
<i>Urolophus halleri</i>	round stingray	8	124-242	133-600	2,290.9
<i>Myliobatis californica</i>	bat ray	9	230-315	111.6-404.8	2,602.8
<i>Platyrrhinoidis triseriata</i>	thornback	1	53	10.2	10.2
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	3	25.3-36	8.0-21.1	38.7
<i>Loxorhynchus crispatus</i>	moss crab	1	11	0.8	0.8
<i>Hemigrapsus oregonensis</i>	yellow shore crab	2	18-20	0.9-2.8	3.7
<i>Pella tumida</i>	dwarf teardrop crab	1	13	1.9	1.9
Total:		686			

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA009
Sample Count: 19

Survey Date: August 18 - 19, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Atherinops affinis</i>	topsmelt	18	56-124	1.7-15.8	81.2
<i>Heterostichus rostratus</i>	giant kelpfish	14	66-158	3.4-33.2	122.2
<i>Strongylura exilis</i>	California needlefish	13	87-170	0.4-3.7	28.3
<i>Sardinops sagax</i>	Pacific sardine	10	65-85	3.0-9.4	90.6
<i>Cymatogaster aggregata</i>	shiner surfperch	5	57-75	5.0-11.3	41.6
<i>Seriphus politus</i>	queenfish	5	57-70	3.5-5.5	22.9
<i>Anchoa delicatissima</i>	slough anchovy	2	70-71	3.6-4.4	8.0
<i>Hermosilla azurea</i>	zebra perch	2	53-260	4.8-600	604.8
<i>Paralichthys californicus</i>	California halibut	2	81-103	6.9-16.0	22.9
<i>Porichthys myriaster</i>	specklefin midshipman	2	75-268	5.5-200	205.5
unidentified fish	unid. fish	2	37-44	2.1-2.6	4.7
<i>Hypsoblennius gemilis</i>	bay blenny	1	95	14.7	14.7
<i>Hypsopsetta guttulata</i>	diamond turbot	1	136	57.9	57.9
<i>Leuresthes tenuis</i>	California grunion	1	146	19.9	19.9
<i>Syngnathus</i> spp.	pipefishes	1	184	2.5	2.5
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	2	270-288	162-190	352.2
<i>Urolophus halleri</i>	round stingray	2	133-230	95-123	218.0
<i>Myliobatis californica</i>	bat ray	1	340	550	550.0
<i>Ophichthus zophochir</i>	yellow snake eel	1	420	51.8	51.8
<i>Platyrrhinoidis triseriata</i>	thornback	1	630	1,500	1,500.0
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	2	22-30	6.1-15.6	21.7
<i>Pyromaia tuberculata</i>	tuberculate pea crab	1	15	3.2	3.2
<i>Octopus</i> spp.	octopus	-	-	-	-
Total:		89			

Survey: EPSIA010
Sample Count: 19

Survey Date: August 25 - 26, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Anchoa compressa</i>	deepbody anchovy	24	39-115	0.7-16.1	110.5
<i>Seriphus politus</i>	queenfish	13	46-121	1.5-20.2	80.6
<i>Atherinops affinis</i>	topsmelt	9	64-133	2.1-17.0	68.0
<i>Heterostichus rostratus</i>	giant kelpfish	9	74-125	3.1-15.8	60.8
<i>Sardinops sagax</i>	Pacific sardine	8	-	8.0	36.8
<i>Cymatogaster aggregata</i>	shiner surfperch	7	64-80	6.3-11.3	60.7
<i>Leuresthes tenuis</i>	California grunion	6	59-81	1.6-3.4	13.4
<i>Engraulis mordax</i>	northern anchovy	3	54-56	1-1.8	4.4
<i>Porichthys myriaster</i>	specklefin midshipman	3	275-314	180-350	725.8
<i>Hermosilla azurea</i>	zebra perch	2	35-70	1.1-8.1	9.2
<i>Hypsopsetta guttulata</i>	diamond turbot	2	188-216	39.1-254	293.4
<i>Strongylura exilis</i>	California needlefish	2	105-508	1.2-290	291.2
<i>Paralabrax nebulifer</i>	barred sand bass	1	57	2.6	2.6
<i>Roncador stearnsi</i>	spotfin croaker	1	280	500	500.0
unidentified fish	unid. fish	1	-	20.1	20.1
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	3	260-300	145-220	546.2
<i>Urolophus halleri</i>	round stingray	3	125-147	89.4-148	353.4
<i>Myliobatis californica</i>	bat ray	2	208-240	148-185	332.4
<i>Rhinobatos productus</i>	shovelnose guitarfish	1	410	300	300.0
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	4	18.5-39	0.8-24.3	25.1
<i>Lophopanopeus</i> spp.	black-clawed crabs	1	14	1.3	1.3
Total:		105			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA011
Sample Count: 19

Survey Date: September 01 - 02, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Heterostichus rostratus</i>	giant kelpfish	10	80-97	3.8-10.1	60.6
<i>Anchoa delicatissima</i>	slough anchovy	4	60-73	2.1-4.0	10.4
<i>Leuresthes tenuis</i>	California grunion	4	65-112	2.2-13.5	25.7
<i>Seriphus politus</i>	queenfish	3	55-63	2.3-5.9	11.9
<i>Cymatogaster aggregata</i>	shiner surfperch	2	68-70	8.2-8.9	17.1
<i>Paralichthys californicus</i>	California halibut	2	59-118	3.1-25.8	28.9
<i>Anchoa compressa</i>	deepbody anchovy	1	79	7.4	7.4
<i>Paralabrax</i> spp.	sand bass	1	39	1.1	1.1
<i>Porichthys myriaster</i>	specklefin midshipman	1	400	550	550.0
<i>Sardinops sagax</i>	Pacific sardine	1	75	3.6	3.6
<i>Strongylura exilis</i>	California needlefish	1	-	1.8	1.8
<i>Syngnathus</i> spp.	pipefishes	1	152	0.6	0.6
unidentified fish, damaged	unid. damaged fish	1	-	137.4	137.4
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	1	327	233.3	233.3
<i>Myliobatis californica</i>	bat ray	1	340	400	400.0
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	1	25	4.0	4.0
<i>Taliepus nuttallii</i>	globose kelp crab	1	11	0.7	0.7
Total:		36			

Survey: EPSIA012
Sample Count: 19

Survey Date: September 08 - 09, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Anchoa compressa</i>	deepbody anchovy	93	42-94	0.2-12.3	301.0
<i>Leuresthes tenuis</i>	California grunion	43	54-73	1.0-5.0	94.7
<i>Seriphus politus</i>	queenfish	29	32-155	0.6-53.0	218.0
<i>Heterostichus rostratus</i>	giant kelpfish	24	60-122	2.1-16.2	172.7
<i>Engraulis mordax</i>	northern anchovy	15	52-71	1.2-4.1	29.5
<i>Cymatogaster aggregata</i>	shiner surfperch	7	53-95	4.9-25.0	79.0
<i>Porichthys notatus</i>	plainfin midshipman	5	53-400	1.6-420	723.6
<i>Sphyræna argentea</i>	California barracuda	5	48-73	0.6-3.3	10.2
<i>Xenistius californiensis</i>	salema	4	31-55	0.7-2.3	4.9
<i>Paralabrax nebulifer</i>	barred sand bass	3	46-124	2.0-28.4	43.5
<i>Sardinops sagax</i>	Pacific sardine	3	68-75	3.5-4.1	11.2
<i>Cheilotrema saturnum</i>	black croaker	2	35-55	1.2-4.3	5.5
<i>Phanerodon furcatus</i>	white surfperch	2	85-93	19.7-20.0	39.7
<i>Porichthys myriaster</i>	specklefin midshipman	2	54-360	1.8-410	411.8
<i>Atherinops affinis</i>	topsmelt	1	103	9.9	9.9
<i>Hypsopsetta guttulata</i>	diamond turbot	1	231	380	380.0
<i>Paralichthys californicus</i>	California halibut	1	105	19.0	19.0
<i>Pleuronectiformes</i> unid.	flatfishes	1	-	54.7	54.7
<i>Roncadora stearnsi</i>	spotfin croaker	1	250	380	380.0
<i>Strongylura exilis</i>	California needlefish	1	138	2.0	2.0
<i>Syngnathus</i> spp.	pipefishes	1	133	0.9	0.9
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	4	254-599	137-265	708.2
<i>Myliobatis californica</i>	bat ray	1	-	110	110.0
<i>Urolophus halleri</i>	round stingray	1	-	200	200.0
INVERTEBRATES					
<i>Hemigrapsus oregonensis</i>	yellow shore crab	1	18	2.5	2.5
Total:		251			

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA013

Survey Date: September 15 - 16, 2004

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	24	55-100	5.1-29.6	216.5
<i>Leuresthes tenuis</i>	California grunion	15	48-124	0.9-15.8	72.3
<i>Anchoa delicatissima</i>	slough anchovy	10	40-70	0.5-3.5	22.4
<i>Anchoa compressa</i>	deepbody anchovy	9	58-86	2.0-5.7	30.9
<i>Heterostichus rostratus</i>	giant kelpfish	8	82-124	3.4-15.8	59.2
<i>Sphyræna argentea</i>	California barracuda	4	81-90	2.8-3.6	13.3
<i>Trachurus symmetricus</i>	jack mackerel	4	36-40	0.6-0.9	3.0
<i>Atherinops affinis</i>	topsmelt	3	79-101	3.9-9.8	19.5
<i>Strongylura exilis</i>	California needlefish	3	184-410	4.0-64.8	89.5
<i>Porichthys myriaster</i>	specklefin midshipman	2	57-229	1.8-247	248.8
<i>Sardinops sagax</i>	Pacific sardine	2	67-73	3.1-3.2	6.3
<i>Seriophilus politus</i>	queenfish	2	71-73	4.0-5.2	9.2
<i>Xenistius californiensis</i>	salema	2	37-40	0.8-1.2	2.0
<i>Brachyistius frenatus</i>	kelp surfperch	1	95	28.9	28.9
<i>Cheilotrema saturnum</i>	black croaker	1	43	0.6	0.6
<i>Engraulis mordax</i>	northern anchovy	1	72	2.6	2.6
<i>Paralichthys californicus</i>	California halibut	1	60	3.1	3.1
<i>Umbrina roncadore</i>	yellowfin croaker	1	37	1.0	1.0
unidentified fish, damaged	unid. damaged fish	1	-	20.3	20.3
<u>SHARKS/RAYS</u>					
<i>Myliobatis californica</i>	bat ray	2	299-422	201-298	499.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	5	30-58	2.5-17.5	33.2
<i>Pachygrapsus crassipes</i>	striped shore crab	2	18-35	0.5-24.8	25.3
<i>Pugettia</i> spp.	kelp crabs	1	22	4.1	4.1
Total:		104			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA014
Sample Count: 19

Survey Date: September 22 - 23, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Anchoa compressa</i>	deepbody anchovy	52	22-94	0.8-9.3	119.4
<i>Seriplus politus</i>	queenfish	34	22-82	0.1-8.4	102.1
<i>Leuresthes tenuis</i>	California grunion	20	49-115	1.0-17.1	89.4
<i>Cymatogaster aggregata</i>	shiner surfperch	17	56-90	5.6-18.3	162.5
<i>Anchoa delicatissima</i>	slough anchovy	5	50-76	1.8-4.0	12.3
<i>Sardinops sagax</i>	Pacific sardine	4	62-80	2.8-10.6	20.3
<i>Anisotremus davidsonii</i>	sargo	3	42-72	1.9-10.6	16.9
<i>Heterostichus rostratus</i>	giant kelpfish	3	90-98	5.2-7.3	17.7
<i>Roncador stearnsi</i>	spotfin croaker	3	90-93	9.6-17.7	42.3
<i>Xenistius californiensis</i>	salema	3	30-41	0.6-1.9	4.2
<i>Atractoscion nobilis</i>	white seabass	2	36-75	0.5-3.4	3.9
<i>Cheilopogon pinnatibarbus</i>	spotted flyingfish	2	310-313	291-310	601.1
<i>Cheilotrema saturnum</i>	black croaker	2	62-87	5.9-14.4	20.3
<i>Engraulis mordax</i>	northern anchovy	2	57-58	1.1-1.5	2.6
<i>Paralabrax nebulifer</i>	barred sand bass	2	43-50	1.5-3.0	4.5
<i>Sphyræna argentea</i>	California barracuda	2	72-111	2.3-8.3	10.6
<i>Strongylura exilis</i>	California needlefish	2	118-225	1.7-12.5	14.2
<i>Umbrina roncadore</i>	yellowfin croaker	2	50-55	2.5-3.6	6.1
<i>Atherinopsis californiensis</i>	jacksmelt	1	125	22.1	22.1
<i>Menticirrhus undulatus</i>	California corbina	1	108	18.9	18.9
<i>Oxylebius pictus</i>	painted greenling	1	66	4.8	4.8
<i>Porichthys myriaster</i>	specklefin midshipman	1	163	41.2	41.2
<i>Syngnathus</i> spp.	pipefishes	1	505	50.0	50.0
<u>SHARKS/RAYS</u>					
<i>Gymnura marmorata</i>	California butterfly ray	1	340	330	330.0
<i>Myliobatis californica</i>	bat ray	1	297	375	375.0
<u>INVERTEBRATES</u>					
<i>Loligo opalescens</i>	market squid	3	75-129	7.4-10.8	26.2
<i>Callinectes</i> spp.	crab	1	26	13.8	13.8
<i>Pachygrapsus crassipes</i>	striped shore crab	1	28	10.1	10.1
<i>Pyromaia tuberculata</i>	tuberculate pea crab	1	12	-	-
Total:		173			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA015

Survey Date: September 29 - 30, 2004

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Seriphus pollus</i>	queenfish	28	35-78	0.5-7.0	77.4
<i>Leuresthes tenuis</i>	California grunion	16	57-150	1.5-36.0	136.0
<i>Engraulis mordax</i>	northern anchovy	11	33-116	0.2-14.0	24.7
<i>Anchoa compressa</i>	deepbody anchovy	10	45-81	0.5-5.0	22.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	10	49-85	2.0-15.0	80.5
<i>Xenistius californiensis</i>	salema	10	35-63	0.5-4.0	19.5
<i>Anchoa delicatissima</i>	slough anchovy	5	56-77	1.0-5.0	14.0
<i>Anisotremus davidsonii</i>	sargo	4	38-58	1.0-5.0	9.5
<i>Heterostichus rostratus</i>	giant kelpfish	4	95-121	4.0-22.0	45.0
<i>Sphyræna argentea</i>	California barracuda	4	88-115	4.0-10.0	24.0
<i>Strongylura exilis</i>	California needlefish	4	139-325	0.7-42.0	54.7
<i>Atherinops affinis</i>	topsmelt	2	64-78	3.0-6.0	9.0
<i>Embiotoca jacksoni</i>	black surfperch	2	164-175	170-200	370.0
<i>Paralichthys californicus</i>	California halibut	2	120-133	20.0-35.0	55.0
<i>Sardinops sagax</i>	Pacific sardine	2	71-75	2.0-3.5	5.5
<i>Atherinopsis californiensis</i>	jacksmelt	1	181	47.0	47.0
<i>Atractoscion nobilis</i>	white seabass	1	145	45.0	45.0
<i>Genyonemus lineatus</i>	white croaker	1	100	2.1	2.1
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	81	10.5	10.5
<i>Peprilus simillimus</i>	Pacific butterfish	1	130	50.0	50.0
<i>Roncador stearnsi</i>	spotfin croaker	1	115	20.0	20.0
<u>SHARKS/RAYS</u>					
<i>Gymnura marmorata</i>	California butterfly ray	1	292	190	190.0
<i>Urolophus halleri</i>	round stingray	1	272	270	270.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	7	18-33	2.5-9.0	36.2
<i>Cancer antennarius</i>	brown rock crab	2	11-25	0.2-1.7	1.9
<i>Lophopanopeus frontalis</i>	molarless crested crab	2	11-13	0.4	0.8
<i>Cancer productus</i>	red rock crab	1	26	3.4	3.4
<i>Loligo opalescens</i>	market squid	1	70	7.0	7.0
<i>Panulirus interruptus</i>	California spiny lobster	1	-	66.0	66.0
<i>Pyromaia tuberculata</i>	tuberculate pea crab	1	9	0.6	0.6
Total:		137			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA016
Sample Count: 19

Survey Date: October 06 - 07, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinopsidae</i>	silverside	57	48-130	0.5-20.8	289.5
<i>Seriplus politus</i>	queenfish	47	35-98	1.0-14.8	222.3
<i>Anchoa compressa</i>	deepbody anchovy	35	45-95	1.0-10.7	141.8
<i>Cymatogaster aggregata</i>	shiner surfperch	19	57-82	5.0-13.7	175.2
<i>Engraulis mordax</i>	northern anchovy	17	50-103	1.2-8.9	30.5
<i>Xenistius californiensis</i>	salema	17	27-58	0.5-4.0	22.6
<i>Anchoa delicatissima</i>	slough anchovy	5	53-85	1.0-6.0	14.0
<i>Sphyræna argentea</i>	California barracuda	4	96-435	3.0-110	139.9
<i>Porichthys myriaster</i>	specklefin midshipman	3	87-390	7.2-460	822.2
<i>Heterostichus rostratus</i>	giant kelpfish	2	72-275	1.0-195	196.0
<i>Paralichthys californicus</i>	California halibut	2	128-133	39.0-40.0	79.0
<i>Strongylura exilis</i>	California needlefish	2	73-82	0.3	0.7
<i>Leuresthes tenuis</i>	California grunion	1	68	2.0	2.0
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	29	1.5	1.5
<i>Sardinops sagax</i>	Pacific sardine	1	66	3.0	3.0
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	3	60-154	13.6-195	368.6
<i>Myliobatis californica</i>	bat ray	2	294	400	400.0
<u>INVERTEBRATES</u>					
<i>Loligo opalescens</i>	market squid	11	47-66	4.0-10.0	70.6
<i>Portunus xantusii</i>	Xantus' swimming crab	10	10-50	0.5-9.0	38.9
<i>Taliepus nuttallii</i>	globose kelp crab	2	5-6	0.5	1.0
<i>Cancer</i> spp.	cancer crabs	1	24	2.6	2.6
<i>Pachygrapsus crassipes</i>	striped shore crab	1	12	2.5	2.5
<i>Pachygrapsus</i> spp.	shore crab	1	15	0.9	0.9
<i>Pugettia producta</i>	northern kelp crab	1	8	-	-
<i>Pyromaia tuberculata</i>	tuberculate pea crab	1	6	-	-
Total:		246			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA017

Survey Date: October 13 - 14, 2004

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinopsidae</i>	silverside	5	55-65	1.2-3.0	2.0
<i>Atractoscion nobilis</i>	white seabass	2	252	140-144	1.2
<i>Engraulis mordax</i>	northern anchovy	2	48-51	1.2	2.4
<i>Serphus politus</i>	queenfish	2	43-65	1.1-3.9	1.3
<i>Anchoa compressa</i>	deepbody anchovy	1	56	2.0	4.6
<i>Anchoa delicatissima</i>	slough anchovy	1	58	1.2	3.1
<i>Cymatogaster aggregata</i>	shiner surfperch	1	74	8.1	8.1
<i>Sardinops sagax</i>	Pacific sardine	1	77	3.1	11.9
unidentified fish	unid. fish	1	-	4.6	284.0
<i>Xenistius californiensis</i>	salema	1	44	1.3	5.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	20	23-41	2.6-12.9	113.4
<i>Pugettia producta</i>	northern kelp crab	1	80	5.4	5.4
<i>Talipes nuttallii</i>	globose kelp crab				
Total:		38			

Survey: EPSIA018

Survey Date: October 20 - 21, 2004

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinopsidae</i>	silverside	114	52-193	1.4-32.0	905.9
<i>Serphus politus</i>	queenfish	35	28-77	0.4-7.1	61.0
<i>Xenistius californiensis</i>	salema	32	30-50	0.4-2.0	30.0
<i>Anchoa compressa</i>	deepbody anchovy	18	40-68	1.3-3.7	41.0
<i>Engraulis mordax</i>	northern anchovy	16	54-70	1.8-4.0	42.6
<i>Brachystilus frenatus</i>	kelp surfperch	14	62-102	6.0-25.0	135.6
<i>Atractoscion nobilis</i>	white seabass	4	223-243	135.2-185.0	640.2
<i>Lepomis cyanellus</i>	green sunfish	4	104-126	26.0-68.0	194.7
<i>Ameiurus natalis</i>	yellow bullhead	3	162-175	65.0-80.0	220.0
<i>Paralichthys californicus</i>	California halibut	3	110-151	21.0-45.0	111.0
<i>Strongylura exilis</i>	California needlefish	3	370-397	67.0-84.0	221.0
<i>Acanthogobius flavimanus</i>	yellowfin goby	2	115-148	18.0-37.2	55.2
<i>Anisotremus davidsonii</i>	sargo	2	44-69	1.8-7.0	8.8
<i>Anchoa</i> spp.	anchovy	1	-	6.8	6.8
<i>Cymatogaster aggregata</i>	shiner surfperch	1	84	7.5	7.5
<i>Hypsopsetta guttulata</i>	diamond turbot	1	125	53.0	53.0
<i>Paralabrax clathratus</i>	kelp bass	1	48	2.0	2.0
<i>Portichthys myriaster</i>	specklefin midshipman	1	47	1.0	1.0
<i>Sardinops sagax</i>	Pacific sardine	1	65	3.0	3.0
<i>Sphyræna argentea</i>	California barracuda	1	72	2.0	2.0
<u>SHARKS/RAYS</u>					
<i>Myliobatis californica</i>	bat ray	1	300	200	200.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	6	21-46	2.1-12.4	38.4
<i>Pugettia producta</i>	northern kelp crab	6	4-15	0.1-1.4	2.8
<i>Loxorhynchus</i> spp.	spider crabs	2	5	0.1-0.5	0.6
Brachyuran unid.	unidentified crab	1	8	0.4	0.4
Caridean unid.	unidentified shrimp	1	159	28.0	28.0
Total:		274			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA019
Sample Count: 13

Survey Date: October 27 - 28, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
Atherinopsidae	silverside	64	52-134	1.0-27.0	256.5
Xenistius californiensis	salema	41	19-45	0.3-1.7	43.8
Seriphus politus	queenfish	32	32-78	1.3-6.4	94.4
Lepomis cyanellus	green sunfish	10	95-117	30.5-77.5	442.8
Micropterus salmoides	large mouth bass	9	49-57	2.4-3.4	26.9
Cymatogaster aggregata	shiner surfperch	8	63-82	5.9-11.6	66.0
Engraulis mordax	northern anchovy	8	59-64	2.1-2.7	19.0
Strongylura exilis	California needlefish	5	392-577	70.0-230	635.0
Anchoa delicatissima	slough anchovy	4	42-66	1.7-7.1	22.2
Lepomis macrochirus	bluegill	3	34-121	1.8-55.5	111.3
Anchoa compressa	deepbody anchovy	2	60-77	2.5-5.7	8.2
Paralichthys californicus	California halibut	2	42-44	1.2-1.3	2.5
Phanerodon furcatus	white surfperch	2	89-119	13.5-27.4	40.9
Sphyræna argentea	California barracuda	2	48-63	0.9-1.6	2.5
Tilapia spp.	tilapia	2	27-46	2.4-4.2	6.6
Trachurus symmetricus	jack mackerel	2	37-38	1.1	2.2
Rhacochilus vacca	pile surfperch	1	263	465	465.0
Heterostichus rostratus	giant kelpfish	1	96	5.4	5.4
Porichthys myriaster	specklefin midshipman	1	342	221	221.0
Porichthys notatus	plainfin midshipman	1	385	460	460.0
Syngnathus spp.	pipefishes	1	161	1.3	1.3
unidentified fish, damaged	unid. damaged fish	1	-	16.0	16.0
<u>SHARKS/RAYS</u>					
Gymnura marmorata	California butterfly ray	4	272-550	165-1,100	1,775.0
<u>INVERTEBRATES</u>					
Portunus xantusii	Xantus' swimming crab	31	7-41	0.9-13.9	195.5
Octopus bimaculatus	California two-spot octopus	4	-	5.2-25.3	58.1
Loxorhynchus crispatus	moss crab	1	7	0.3	0.3
Pugettia spp.	kelp crabs	1	2	0.1	0.1
Total:		243			

Survey: EPSIA020
Sample Count: 13

Survey Date: November 03 - 04, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
Anchoa compressa	deepbody anchovy	35	37-85	0.9-7.1	101.6
Engraulis mordax	northern anchovy	30	57-76	1.9-4.6	85.8
Atherinopsidae	silverside	20	50-147	1.1-33.0	148.5
Seriphus politus	queenfish	9	34-66	0.8-4.3	19.8
Xenistius californiensis	salema	2	37-42	0.9-1.3	2.1
Cymatogaster aggregata	shiner surfperch	1	70	8.7	8.7
Trachurus symmetricus	jack mackerel	1	-	2.0	2.0
<u>SHARKS/RAYS</u>					
Gymnura marmorata	California butterfly ray	1	304	120	120.0
<u>INVERTEBRATES</u>					
Portunus xantusii	Xantus' swimming crab	8	21-29	3.8-9.7	58.4
Brachyuran unid.	unidentified crab	1	17	2.8	2.8
Crangon spp.	bay shrimp	1	107	20.9	20.9
Loligo opalescens	market squid	1	-	-	-
Rhithropanopeus harrisi	Harris' mud crab	1	30	18.0	18.0
Total:		111			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA021

Survey Date: November 10 - 11, 2004

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Atherinopsidae</i>	silverside	14	62-164	2.0-21.3	76.0
<i>Seriphus politus</i>	queenfish	5	46-82	1.4-7.1	13.9
<i>Scorpaena guttata</i>	spotted scorpionfish	1	110	38.0	38.0
<i>Xenistius californiensis</i>	salema	1	40	1.1	1.1
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	26	15-60	0.9-15.7	193.5
<i>Pachygrapsus crassipes</i>	striped shore crab	2	12-27	0.5	0.5
<i>Cycloanthops novemdentatus</i>	ninetooth pebble crab	1	19	2.6	2.6
Total:		50			

Survey: EPSIA022

Survey Date: November 17 - 18, 2004

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Atherinopsis californiensis</i>	jacksmelt	29	45-146	0.8-33.0	123.9
<i>Seriphus politus</i>	queenfish	18	37-89	0.8-11.1	41.6
<i>Atherinops affinis</i>	topsmelt	4	70-124	2.5-17.6	27.3
<i>Hyperprosopon argenteum</i>	walleye surfperch	2	135-160	61.5-101	162.0
<i>Paralichthys californicus</i>	California halibut	2	49-132	1.8-35.6	37.3
<i>Anchoa compressa</i>	deepbody anchovy	1	66	3.5	3.5
<i>Cheilotrema saturnum</i>	black croaker	1	127	38.6	38.6
<i>Leuresthes tenuis</i>	California grunion	1	63	1.7	1.7
<i>Sarda chiliensis</i>	Pacific bonito	1	336	500	500.0
<i>Xenistius californiensis</i>	salema	1	48	2.0	2.0
SHARKS/RAYS					
<i>Urolophus halleri</i>	round stingray	1	80	27.7	27.7
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	9	16-36	2.0-17.0	68.4
<i>Pachygrapsus crassipes</i>	striped shore crab	3	32-35	15.0-18.8	49.5
Total:		73			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA023

Survey Date: November 22 - 23, 2004

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Leuresthes tenuis</i>	California grunion	12	59-155	1.6-31.2	70.1
<i>Seriphus politus</i>	queenfish	11	30-82	0.7-6.7	22.3
<i>Anchoa compressa</i>	deepbody anchovy	5	55-70	1.5-4.8	12.9
<i>Atherinopsis californiensis</i>	jacksmelt	3	62-160	2.3-45.3	56.1
<i>Atractoscion nobilis</i>	white seabass	2	255-291	200-302	502.1
<i>Engraulis mordax</i>	northern anchovy	2	65	2.0-2.9	4.9
<i>Hypsoblennius</i> spp.	blennies	1	50	3.5	3.5
<i>Menticirrhus undulatus</i>	California corbina	1	72	5.1	5.1
<i>Micrometrus minimus</i>	dwarf surfperch	1	70	8.3	8.3
<i>Paralabrax clathratus</i>	kelp bass	1	40	1.7	1.7
<i>Paralichthys californicus</i>	California halibut	1	50	1.7	1.7
unidentified fish, damaged	unid. damaged fish	1	250	200	200.0
<i>Xenistius californiensis</i>	salema	1	47	1.8	1.8
<u>SHARKS/RAYS</u>					
<i>Myliobatis californica</i>	bat ray	1	400	460	460.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	34	18-46	2.4-18.2	154.9
<i>Cancer magister</i>	dungeness crab	1	-	-	-
<i>Pugettia richii</i>	cryptic kelp crab	1	12	1.3	1.3
<i>Pugettia</i> spp.	kelp crabs	1	-	-	-
Total:		80			

Survey: EPSIA024

Survey Date: December 01 - 02, 2004

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Anchoa compressa</i>	deepbody anchovy	801	50-112	0.7-12.1	2,471.4
<i>Xenistius californiensis</i>	salema	514	40-60	1.1-5.3	1,404.0
<i>Seriphus politus</i>	queenfish	320	29-100	0.5-19.3	1,941.7
<i>Cymatogaster aggregata</i>	shiner surfperch	212	61-94	5.1-18.1	2,343.6
<i>Leuresthes tenuis</i>	California grunion	65	31-125	0.3-18.5	265.2
unidentified fish, damaged	unid. damaged fish	6	-	-	-
<i>Anisotremus davidsonii</i>	sargo	4	51-70	2.9-8.3	22.5
<i>Atherinops affinis</i>	topsmelt	4	57-118	1.2-14.2	19.2
<i>Atherinopsis californiensis</i>	jacksmelt	4	63-108	2.2-10.5	19.8
<i>Sardinops sagax</i>	Pacific sardine	3	82-91	4.8-7.5	17.2
<i>Genyonemus lineatus</i>	white croaker	1	115	30.0	30.0
<i>Heterostichus rostratus</i>	giant kelpfish	1	65	5.3	5.3
<i>Hypsoblennius gentilis</i>	bay blenny	1	56	2.6	2.6
<i>Hypsoblennius gilberti</i>	rockpool blenny	1	70	4.3	4.3
<i>Menticirrhus undulatus</i>	California corbina	1	74	5.0	5.0
<i>Paralichthys californicus</i>	California halibut	1	160	60.1	60.1
<i>Sphyrna argentea</i>	California barracuda	1	115	7.4	7.4
<i>Strongylura exilis</i>	California needlefish	1	462	115.1	115.1
<i>Syngnathus</i> spp.	pipefishes	1	249	3.0	3.0
<i>Umbrina roncadore</i>	yellowfin croaker	1	67	5.4	5.4
<u>SHARKS/RAYS</u>					
<i>Platyrrhinoidis triseriata</i>	thornback	2	181-192	305-342	647.0
<i>Urolophus halleri</i>	round stingray	2	149-155	183-210	393.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	13	20-65	2.7-23.6	110.9
<i>Loligo opalescens</i>	market squid	4	88-114	-	-
<i>Pachygrapsus crassipes</i>	striped shore crab	3	6-35	0.2-19.5	31.3
<i>Pugettia</i> spp.	kelp crabs	1	9	0.3	0.3
Total:		1,968			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA025
Sample Count: 19

Survey Date: December 08 - 09, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Leuresthes tenuis</i>	California grunion	96	49-130	1.1-26.5	440.8
<i>Seriophilus politus</i>	queenfish	90	27-175	0.5-58.9	512.7
<i>Anchoa compressa</i>	deepbody anchovy	71	53-111	0.9-12.6	223.8
<i>Xenistius californiensis</i>	salema	23	20-70	0.9-5.6	51.4
<i>Cymatogaster aggregata</i>	shiner surfperch	16	65-105	7.1-25.1	223.8
<i>Sardinops sagax</i>	Pacific sardine	10	73-108	3.7-13.3	70.9
<i>Atherinops affinis</i>	topsmelt	7	63-140	2.2-11.0	30.7
unidentified fish, damaged	unid. damaged fish	4	-	14.8	14.8
<i>Strongylura exilis</i>	California needlefish	2	455-482	120-125	245.0
<i>Chromis punctipinnis</i>	blacksmith	1	105	27.0	27.0
<i>Micrometrus minimus</i>	dwarf surfperch	1	54	4.4	4.4
<i>Paralichthys integriceps</i>	reef finspot	1	65	3.7	3.7
SHARKS/RAYS					
<i>Myliobatis californica</i>	bat ray	1	305	400	400.0
<i>Platyrrhinoides triseriata</i>	thornback	1	490	650	650.0
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	14	23-60	3.0-19.0	101.5
<i>Pachygrapsus crassipes</i>	striped shore crab	4	5-40	0.1-20.9	29.7
<i>Pugettia</i> spp.	kelp crabs	2	10-13	0.4-1.1	1.5
<i>Octopus</i> spp.	octopus	1	-	200	200.0
<i>Pyromaia tuberculata</i>	tuberculate pea crab	1	22	2.3	2.3
Total:		346			

Survey: EPSIA026
Sample Count: 19

Survey Date: December 15 - 16, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Leuresthes tenuis</i>	California grunion	99	20-124	0.6-21.2	341.8
<i>Seriophilus politus</i>	queenfish	44	47-102	1.4-13.5	268.2
<i>Xenistius californiensis</i>	salema	28	38-57	1.1-3.5	55.3
<i>Cymatogaster aggregata</i>	shiner surfperch	11	64-83	7.8-16.5	112.9
<i>Atractoscion nobilis</i>	white seabass	8	229-295	150-310	1,655.0
<i>Engraulis mordax</i>	northern anchovy	6	38-109	0.5-13.6	24.1
<i>Anchoa compressa</i>	deepbody anchovy	5	55-92	1.0-8.6	15.4
<i>Atherinops affinis</i>	topsmelt	2	53-84	1.4-6.2	7.6
<i>Chromis punctipinnis</i>	blacksmith	1	39	1.0	1.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	1	140	75.4	75.4
<i>Sardinops sagax</i>	Pacific sardine	1	86	4.1	4.1
<i>Umbrina roncadore</i>	yellowfin croaker	1	94	9.7	9.7
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	15	25-83	3.6-11.0	103.1
<i>Pachygrapsus crassipes</i>	striped shore crab	3	9-42	0.5-28.0	33.6
<i>Loligo opalescens</i>	market squid	1	52	24.1	24.1
<i>Pugettia</i> spp.	kelp crabs	1	9	0.5	0.5
Total:		227			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA027
Sample Count: 19

Survey Date: December 20 - 21, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Seriophilus politus</i>	queenfish	25	23-95	0.5-11.7	102.4
<i>Anchoa compressa</i>	deepbody anchovy	16	40-112	0.8-14.3	93.7
<i>Leuresthes tenuis</i>	California grunion	10	57-113	1.5-10.3	37.5
<i>Atherinopsis californiensis</i>	jacksmelt	6	62-133	2.4-23.6	37.3
<i>Atherinopsidae</i>	silverside	3	73-105	2.3-8.3	13.5
<i>Sardinops sagax</i>	Pacific sardine	2	80-89	4.5-5.7	10.2
<i>Anchoa delicatissima</i>	slough anchovy	1	68	3.3	3.3
<i>Atractoscion nobilis</i>	white seabass	1	290	265	265.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	1	169	115	115.0
<i>Xenistius californiensis</i>	salema	1	37	1.0	1.0
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	17	23-61	2.8-19.6	166.1
<i>Cancer</i> spp.	cancer crabs	1	26	28.0	28.0
<i>Pachygrapsus crassipes</i>	striped shore crab	1	15	2.2	2.2
<i>Pugettia</i> spp.	kelp crabs	1	11	1.4	1.4
		Total:	86		

Survey: EPSIA028
Sample Count: 19

Survey Date: December 29 - 30, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Atherinopsidae</i>	silverside	721	43-145	1.2-28.2	2,746.2
<i>Xenistius californiensis</i>	salema	283	39-59	0.5-3.0	529.6
<i>Anchoa compressa</i>	deepbody anchovy	57	19-105	0.3-10.0	204.5
<i>Cymatogaster aggregata</i>	shiner surfperch	29	70-110	7.9-21.3	409.1
<i>Sardinops sagax</i>	Pacific sardine	21	72-85	2.8-5.2	83.7
<i>Seriophilus politus</i>	queenfish	8	40-140	0.9-31.6	67.2
<i>Strongylura exilis</i>	California needlefish	5	400-508	79.4-160	532.0
<i>Paralabrax clathratus</i>	kelp bass	2	45-73	1.7-7.2	8.9
<i>Syngnathus</i> spp.	pipefishes	2	171-194	1.4-2.4	3.8
<i>Atherinops affinis</i>	topsmelt	1	-	-	-
Chub unid.	unid. chub	1	75	7.3	7.3
<i>Citharichthys stigmatæus</i>	speckled sanddab	1	69	4.6	4.6
<i>Hypsopsetta guttulata</i>	diamond turbot	1	225	250	250.0
<i>Lepomis</i> spp.	sunfishes	1	102	29.9	29.9
<i>Micrometrus minimus</i>	dwarf surfperch	1	56	4.5	4.5
<i>Paralichthys californicus</i>	California halibut	1	65	3.0	3.0
<i>Phanerodon furcatus</i>	white surfperch	1	69	9.4	9.4
<i>Porichthys myriaster</i>	specklefin midshipman	1	73	3.3	3.3
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	6	337-478	425-1,100	4,395.0
<i>Myliobatis californica</i>	bat ray	3	321-500	255-500	1,135.0
INVERTEBRATES					
<i>Cancer</i> spp.	cancer crabs	18	16-33	0.1-2.3	18.7
<i>Pachygrapsus crassipes</i>	striped shore crab	8	10-31	0.2-9.5	26.8
<i>Portunus xantusii</i>	Xantus' swimming crab	8	21-58	0.2-24.9	55.4
<i>Pugettia</i> spp.	kelp crabs	5	5-22	0.1-4.1	7.4
<i>Loligo opalescens</i>	market squid	3	78-100	19.4-34.7	80.8
<i>Talipes nuttallii</i>	globose kelp crab	2	7-8	0.2-0.5	0.7
Brachyuran unid.	unidentified crab	1	-	-	-
		Total:	1,191		

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA029

Survey Date: January 05 - 06, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Atherinops affinis</i>	topsmelt	344	48-137	0.9-33.5	2,151.8
<i>Leuresthes tenuis</i>	California grunion	60	53-159	1.2-36.4	361.6
<i>Xenistius californiensis</i>	salema	42	41-55	1.1-3.3	80.9
<i>Cymatogaster aggregata</i>	shiner surfperch	14	78-100	6.5-27.2	240.6
<i>Anchoa delicatissima</i>	slough anchovy	10	55-81	1.6-4.4	24.8
<i>Strongylura exilis</i>	California needlefish	10	408-563	90.0-270	1,620.0
unidentified fish, damaged	unid. damaged fish	10	50-65	0.4-2.4	26.5
<i>Sardinops sagax</i>	Pacific sardine	7	44-88	0.7-4.7	25.1
<i>Anisotremus davidsonii</i>	sargo	4	48-81	2.5-11.6	30.1
<i>Anchoa compressa</i>	deepbody anchovy	3	60-100	2.0-12.2	23.7
<i>Seriphus politus</i>	queenfish	3	44-144	1.2-34.0	40.4
<i>Atractoscion nobilis</i>	white seabass	2	270	85.0-180	265.0
<i>Engraulis mordax</i>	northern anchovy	2	42-45	0.6	1.3
<i>Paralabrax clathratus</i>	kelp bass	2	62-64	2.8-5.1	7.9
<i>Phanerodon furcatus</i>	white surfperch	2	179-224	115-240	355.2
<i>Hyperprosopon argenteum</i>	walleye surfperch	1	98	20.7	20.7
<i>Hyperprosopon</i> spp.	surfperch	1	165	115	115.0
<i>Hypsopsetta guttulata</i>	diamond turbot	1	28	0.5	0.5
<i>Lepomis macrochirus</i>	bluegill	1	114	45.0	45.0
<i>Lepomis</i> spp.	sunfishes	1	106	35.6	35.6
<i>Symphurus atricauda</i>	California tonguefish	1	92	8.1	8.1
<i>Syngnathus</i> spp.	pipefishes	1	248	4.5	4.5
SHARKS/RAYS					
<i>Myliobatis californica</i>	bat ray	2	274-307	320-410	730.0
<i>Ophichthus zophochir</i>	yellow snake eel	2	489-520	120	240.0
<i>Gymnura marmorata</i>	California butterfly ray	1	465	648	648.0
<i>Platyrrhinoidis triseriata</i>	thornback	1	-	178.0	177.9
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	22	19-55	2.6-19.7	198.2
<i>Pachygrapsus crassipes</i>	striped shore crab	5	10-31	0.4-10.2	18.7
<i>Pugettia</i> spp.	kelp crabs	3	7-25	1.1-6.1	8.7
<i>Callinassa californiensis</i>	ghost shrimp	2	41-49	1.0-1.9	2.9
<i>Cancer jordani</i>	hairy rock crab	2	21-30	1.3-5.8	7.1
<i>Octopus</i> spp.	octopus	2	-	20.4-114.8	135.2
<i>Cancer antennarius</i>	brown rock crab	1	21	2.3	2.3
<i>Cancer productus</i>	red rock crab	1	37	10.5	10.5
<i>Pugettia producta</i>	northern kelp crab	1	15	1.5	1.5
<i>Taliepus nuttallii</i>	globose kelp crab	1	10	0.5	0.5
Total:		568			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA030

Survey Date: January 12 - 13, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Atherinops affinis</i>	topsmelt	2,551	35-184	0.5-67.1	23,391.9
<i>Anchoa delicatissima</i>	slough anchovy	861	38-127	0.9-17.0	2,654.2
<i>Hyperprosopon argenteum</i>	walleye surfperch	460	57-195	4.0-128	18,405.7
<i>Anchoa compressa</i>	deepbody anchovy	222	50-122	1.1-20.8	2,131.7
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	181	43-240	1.4-310	1,596.9
<i>Cymatogaster aggregata</i>	shiner surfperch	118	38-136	1.9-54.9	2,175.8
<i>Seriphys politus</i>	queenfish	86	37-225	0.7-165	773.4
<i>Paralabrax clathratus</i>	kelp bass	79	44-154	1.0-70.0	526.4
<i>Micrometrus minimus</i>	dwarf surfperch	47	54-91	4.0-19.8	484.8
<i>Menticirrhus undulatus</i>	California corbina	39	58-341	3.0-580	1,599.6
<i>Phanerodon furcatus</i>	white surfperch	38	83-227	13.9-350	2,830.4
<i>Paralabrax nebulifer</i>	barred sand bass	33	43-88	1.2-35.0	185.7
<i>Amphistichus argenteus</i>	barred surfperch	32	68-195	8.6-220	1,242.5
<i>Paralichthys californicus</i>	California halibut	28	45-255	1.1-261	593.3
<i>Sardinops sagax</i>	Pacific sardine	28	73-180	2.5-65.0	364.7
<i>Xenistius californiensis</i>	salema	26	36-74	0.6-6.5	45.0
<i>Anisotremus davidsonii</i>	sargo	21	51-244	2.0-370	834.4
<i>Hypsopsetta guttulata</i>	diamond turbot	15	22-240	14.1-310	2,128.0
<i>Roncador stearnsi</i>	spotfin croaker	15	51-421	2.0-1,500	5,531.5
<i>Atractoscion nobilis</i>	white seabass	12	127-316	26.4-350	2,846.4
<i>Fundulus parvipinnis</i>	California killifish	9	49-79	1.8-7.1	48.0
<i>Engraulis mordax</i>	northern anchovy	8	65-86	1.4-5.5	26.7
<i>Umbrina roncadore</i>	yellowfin croaker	7	55-298	3.1-355	398.5
Chub unid.	unid. chub	4	62-81	4.5-7.6	24.5
<i>Heterostichus rostratus</i>	giant kelpfish	4	98-161	8.7-28.5	70.9
<i>Citharichthys stigmaeus</i>	speckled sanddab	3	49-65	1.5-3.6	6.6
<i>Hermosilla azurea</i>	zebra perch	3	66-71	7.3-11.9	27.3
<i>Sphyræna argentea</i>	California barracuda	3	198-224	55.4-68.5	181.4
<i>Albula vulpes</i>	bonefish	2	320-340	590-602	1,192.0
Ictaluridae	unid. catfish	2	162-177	55.0-100.5	155.5
<i>Citharichthys sordidus</i>	Pacific sanddab	1	50	0.5	0.5
<i>Cynoscion parvipinnis</i>	shortfin corvina	1	412	900	900.0
<i>Rhacochilus vacca</i>	pile surfperch	1	176	160	160.0
<i>Geryonemus lineatus</i>	white croaker	1	43	1.0	1.0
<i>Hypsoblennius gentilis</i>	bay blenny	1	65	5.0	5.0
<i>Hypsoblennius gilberti</i>	rockpool blenny	1	65	5.0	5.0
<i>Scorpaena guttata</i>	spotted scorpionfish	1	110	38.0	38.0
<i>Strongylura exilis</i>	California needlefish	1	716	90.0	90.0
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	33	275-525	185-1,520	24,459.0
<i>Urolophus halleri</i>	round stingray	10	146-206	180-630	3,834.0
<i>Ophichthus zophochir</i>	yellow snake eel	6	526-800	115-600	1,920.0
<i>Mustelus californicus</i>	gray smoothhound	3	442-687	300-1,100	1,850.0
<i>Myliobatis californica</i>	bat ray	3	355-447	640-1,300	3,240.0
<i>Platyrrhinoidis triseriata</i>	thornback	1	186	550	550.0
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	73	13-58	1.5-42.0	492.1
<i>Octopus</i> spp.	octopus	10	-	40.0-700	2,011.5
<i>Pachygrapsus crassipes</i>	striped shore crab	5	11-35	0.5-9.0	25.7
<i>Cancer productus</i>	red rock crab	2	32-33	4.2-6.0	10.2
<i>Cancer antennarius</i>	brown rock crab	1	36	7.2	7.2
<i>Lophopanopeus</i> spp.	black-clawed crabs	1	80	8.0	8.0
<i>Pandalus platyceros</i>	spot shrimp	1	55	1.8	1.8
<i>Pugettia richii</i>	cryptic kelp crab	1	28	11.0	11.0
<i>Sicyonia ingentis</i>	Ridgeback rock shrimp	1	-	16.0	16.0
Total:		5,096			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA031

Survey Date: January 19 - 20, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinops affinis</i>	topsmelt	492	50-179	1.0-30.0	2,256.5
<i>Sardinops sagax</i>	Pacific sardine	32	55-127	2.5-15.5	180.4
<i>Atractoscion nobilis</i>	white seabass	18	80-235	40.0-160	1,521.0
<i>Anchoa delicatissima</i>	slough anchovy	12	55-79	1.0-5.0	29.7
<i>Anchoa compressa</i>	deepbody anchovy	8	60-96	2.5-10.0	36.0
<i>Cymatogaster aggregata</i>	shiner surfperch	6	69-110	9.0-35.0	103.0
<i>Xenistius californiensis</i>	salema	5	39-55	1.0-3.0	10.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	4	106-141	33.0-72.0	189.0
<i>Paralabrax clathratus</i>	kelp bass	4	53-66	3.0-6.0	20.0
<i>Anisotremus davidsonii</i>	sargo	2	55	2.5-7.0	9.5
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	2	65-79	4.5-9.5	14.0
<i>Paralabrax nebulifer</i>	barred sand bass	2	63-75	4.0-8.0	12.0
<i>Seriphus politus</i>	queenfish	2	47-74	1.0-5.0	6.0
<i>Citharichthys stigmatæus</i>	speckled sanddab	1	38	1.0	1.0
<i>Hypsoblennius</i> spp.	blennies	1	70	7.0	7.0
<i>Hypsopsetta guttulata</i>	diamond turbot	1	253	350	350.0
<i>Leuresthes tenuis</i>	California grunion	1	91	5.0	5.0
<i>Micrometrus minimus</i>	dwarf surfperch	1	67	7.5	7.5
<i>Pleuronichthys ritteri</i>	spotted turbot	1	70	6.5	6.5
<u>SHARKS/RAYS</u>					
<i>Myliobatis californica</i>	bat ray	2	182-404	460-850	1,310.0
<i>Platyrrhinoidis triseriata</i>	thornback	2	159-349	200-260	460.0
<i>Gymnura marmorata</i>	California butterfly ray	1	392	380	380.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	40	12-60	1.0-22.0	286.0
<i>Pachygrapsus crassipes</i>	striped shore crab	5	12-33	1.0-10.0	24.5
<i>Blepharipoda occidentalis</i>	spiny mole crab	1	24	9.0	9.0
<i>Cancer productus</i>	red rock crab	1	35	7.0	7.0
<i>Octopus bimaculatus</i>	California two-spot octopus	1	80	110	110.0
<i>Pugettia</i> spp.	kelp crabs	1	32	7.5	7.5
Total:		649			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA032

Survey Date: January 26 - 27, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinops affinis</i>	topsmelt	243	46-277	1.0-65.0	1,435.4
<i>Anchoa compressa</i>	deepbody anchovy	16	70-111	3.0-15.0	146.9
<i>Seriphus politus</i>	queenfish	11	35-96	1.0-13.0	75.5
<i>Atractoscion nobilis</i>	white seabass	9	159-284	50.0-210	722.0
<i>Cymatogaster aggregata</i>	shiner surfperch	5	62-110	7.0-38.0	86.0
<i>Hypsopsetta guttulata</i>	diamond turbot	3	162-225	85.0-310	615.0
<i>Sardinops sagax</i>	Pacific sardine	3	79-145	5.0-29.0	56.0
<i>Xenistius californiensis</i>	salema	3	38-52	1.5-3.0	6.5
<i>Phanerodon furcatus</i>	white surfperch	2	87-95	16.0-23.0	39.0
<i>Anchoa delicatissima</i>	slough anchovy	1	61	2.0	2.0
<i>Heterostichus rostratus</i>	giant kelpfish	1	75	3.1	3.1
<i>Hyperprosopon argenteum</i>	walleye surfperch	1	98	21.0	21.0
<i>Micrometrus minimus</i>	dwarf surfperch	1	74	16.0	16.0
<i>Paralabrax clathratus</i>	kelp bass	1	-	0.5	0.5
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	65	5.5	5.5
unidentified fish, damaged	unid. damaged fish	1	182	70.0	70.0
<u>SHARKS/RAYS</u>					
<i>Myliobatis californica</i>	bat ray	2	309-395	400-490	890.0
<i>Gymnura marmorata</i>	California butterfly ray	1	365	390	390.0
<i>Torpedo californica</i>	Pacific electric ray	1	311	3,750.0	3,750.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	30	24-51	1.5-23.5	325.0
<i>Pachygrapsus crassipes</i>	striped shore crab	4	12-50	2.0-18.0	42.0
<i>Cancer</i> spp.	cancer crabs	2	28-32	2.0-3.0	5.0
<i>Cancer productus</i>	red rock crab	1	35	5.0	5.0
Caridean unid.	unidentified shrimp	1	-	7.0	7.0
<i>Panulirus interruptus</i>	California spiny lobster	1	-	30.0	30.0
Total:		345			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA033
Sample Count: 19

Survey Date: February 20 - 03, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinops affinis</i>	topsmelt	189	38-325	0.5-270	1,381.3
<i>Sardinops sagax</i>	Pacific sardine	19	66-124	4.8-16.0	153.7
<i>Anchoa compressa</i>	deepbody anchovy	10	62-116	3.0-16.0	70.5
<i>Xenistius californiensis</i>	salema	6	45-59	1.0-4.0	11.5
<i>Hyperprosopon argenteum</i>	walleye surfperch	5	122-165	50.0-100	339.6
<i>Syngnathus</i> spp.	pipefishes	4	162-224	1.1-4.0	9.3
<i>Anisotremus davidsonii</i>	sargo	3	57-69	4.0-7.0	17.5
<i>Micrometrus minimus</i>	dwarf surfperch	2	62-67	7.5-9.0	16.5
<i>Anchoa delicatissima</i>	slough anchovy	1	75	5.0	5.0
<i>Atractoscion nobilis</i>	white seabass	1	307	360	360.0
<i>Cymatogaster aggregata</i>	shiner surfperch	1	77	10.0	10.0
<i>Rhacochilus vacca</i>	pile surfperch	1	214	280	280.0
<i>Paralabrax clathratus</i>	kelp bass	1	65	5.6	5.6
<i>Peprilus simillimus</i>	Pacific butterfish	1	79	11.0	11.0
<i>Phanerodon furcatus</i>	white surfperch	1	87	15.0	15.0
<i>Sarda chiliensis</i>	Pacific bonito	1	362	510	510.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	17	20-58	2.0-18.0	137.8
<i>Pugettia</i> spp.	kelp crabs	4	6-23	0.4-9.0	11.9
<i>Cancer jordani</i>	hairy rock crab	1	33	8.5	8.5
<i>Cancer productus</i>	red rock crab	1	56	17.0	17.0
<i>Dosidicus gigas</i>	jumbo squid	1	625	500	500.0
<i>Pachygrapsus crassipes</i>	striped shore crab	1	10	0.2	0.2
<i>Podochela hemphilli</i>	Hemphill's kelp crab	1	20	3.0	3.0
Total:		272			

Survey: EPSIA034
Sample Count: 13

Survey Date: February 09 - 10, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinops affinis</i>	topsmelt	115	58-302	2.0-205	903.8
<i>Anchoa delicatissima</i>	slough anchovy	25	39-98	0.3-9.5	60.9
<i>Anchoa compressa</i>	deepbody anchovy	17	73-112	3.0-17.0	192.2
<i>Seriphus politus</i>	queenfish	16	45-112	1.0-20.0	82.7
<i>Cymatogaster aggregata</i>	shiner surfperch	14	70-113	11.0-31.0	251.6
<i>Umbra roncadore</i>	yellowfin croaker	8	74-96	7.0-14.5	82.5
<i>Atractoscion nobilis</i>	white seabass	5	190-265	70.0-245	675.0
<i>Engraulis mordax</i>	northern anchovy	5	42-89	1.0-5.5	14.4
<i>Xenistius californiensis</i>	salema	5	50-60	2.0-3.5	13.9
<i>Hyperprosopon argenteum</i>	walleye surfperch	4	101-135	45.0-70.0	235.0
<i>Sardinops sagax</i>	Pacific sardine	2	108-111	9.0-12.0	21.0
<i>Hypsopsetta guttulata</i>	diamond turbot	1	206	270	270.0
<i>Paralabrax clathratus</i>	kelp bass	1	65	5.0	5.0
<i>Paralabrax nebulifer</i>	barred sand bass	1	51	2.0	2.0
<i>Paralichthys californicus</i>	California halibut	1	94	13.0	13.0
<i>Roncadore stearnsi</i>	spotfin croaker	1	57	3.0	3.0
<i>Syngnathus</i> spp.	pipefishes	1	163	0.6	0.6
unidentified fish, damaged	unid. damaged fish	1	-	100	100.0
<u>SHARKS/RAYS</u>					
<i>Myliobatis californica</i>	bat ray	2	272-530	305-2,000	2,305.0
<i>Ophichthus zophochir</i>	yellow snake eel	1	638	295	295.0
<i>Urolophus halleri</i>	round stingray	1	140	170	170.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	14	16-78	3.0-14.0	99.6
<i>Pachygrapsus crassipes</i>	striped shore crab	3	8-18	0.4-3.0	4.9
<i>Cancer productus</i>	red rock crab	2	33-49	12.0-17.0	29.0
Total:		246			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA035

Survey Date: February 16 - 17, 2005

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Anchoa compressa</i>	deepbody anchovy	5	-	40.2	40.2
<i>Seriphus politus</i>	queenfish	5	44-52	3.0	15.0
<i>Atherinops affinis</i>	topsmelt	4	-	8.7	8.7
<i>Hyperprosopon argenteum</i>	walleye surfperch	2	131-134	45.0-81.0	126.0
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	2	-	14.6	14.6
<i>Paralabrax nebulifer</i>	barred sand bass	2	50-84	3.2-14.0	17.2
<i>Atherinopsis californiensis</i>	jacksmelt	1	273	160	160.0
<i>Hypsoblennius jenkinsi</i>	mussel blenny	1	57	4.3	4.3
<i>Porichthys myriaster</i>	specklefin midshipman	1	380	800	800.0
<u>INVERTEBRATES</u>					
<i>Pachygrapsus</i> spp.	shore crab	417	-	50.0	871.0
<i>Pachygrapsus crassipes</i>	striped shore crab	274	3-37	0.5-21.5	768.5
<i>Cancer productus</i>	red rock crab	13	10-55	1.0-22.0	130.1
<i>Portunus xantusii</i>	Xantus' swimming crab	7	20-35	2.0-7.0	30.0
Brachyuran unid.	unidentified crab	1	-	150-200	350.0
<i>Pugettia producta</i>	northern kelp crab	1	22	3.5	3.5
<i>Pugettia</i> spp.	kelp crabs	1	-	0.5	0.5
Total:		737			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA036

Survey Date: February 23 - 24, 2005

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Anchoa compressa</i>	deepbody anchovy	306	54-120	2.0-21.0	3,203.2
<i>Atherinops affinis</i>	topsmelt	304	57-171	1.2-54.7	4,887.9
<i>Cymatogaster aggregata</i>	shiner surfperch	189	72-188	8.9-61.0	5,211.9
Chub unid.	unid. chub	91	62-164	3.0-100	845.5
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	88	43-315	2.0-670	1,318.9
<i>Paralabrax nebulifer</i>	barred sand bass	64	42-94	2.0-15.0	439.8
<i>Hyperprosopon argenteum</i>	walleye surfperch	36	110-164	36.0-116.4	2,564.4
Ictaluridae	unid. catfish	33	124-259	60.0-300	4,123.0
<i>Fundulus parvipinnis</i>	California killifish	31	66-91	4.0-12.0	235.5
<i>Anchoa delicatissima</i>	slough anchovy	24	57-74	2.0-5.0	73.5
<i>Seriphus politus</i>	queenfish	21	49-172	2.0-79.0	410.5
<i>Lepomis macrochirus</i>	bluegill	16	42-135	2.0-86.9	513.7
<i>Lepomis cyanellus</i>	green sunfish	15	47-168	3.0-138	532.0
<i>Anisotremus davidsonii</i>	sargo	10	53-81	3.5-13.0	68.4
<i>Hypsopsetta guttulata</i>	diamond turbot	7	25-233	0.8-260	956.8
<i>Paralichthys californicus</i>	California halibut	6	47-221	1.5-170	200.8
<i>Atractoscion nobilis</i>	white seabass	4	239-432	155-260	775.0
<i>Pylodictis olivaris</i>	flathead catfish	4	158-210	90.0-170	480.0
<i>Chromis punctipinnis</i>	blacksmith	3	55-101	4.0-21.0	32.0
<i>Phanerodon furcatus</i>	white surfperch	3	156-191	85.8-180	385.8
unidentified fish, damaged	unid. damaged fish	3	40-95	1.0-60.0	62.5
<i>Paralabrax clathratus</i>	kelp bass	2	65-90	5.0-14.0	19.0
<i>Ameiurus nebulosus</i>	brown bullhead	1	149	100	100.0
<i>Citharichthys stigmatæus</i>	speckled sanddab	1	45	3.0	3.0
<i>Embiotoca jacksoni</i>	black surfperch	1	225	370	370.0
<i>Heterostichus rostratus</i>	giant kelpfish	1	183	50.0	50.0
<i>Lepomis</i> spp.	sunfishes	1	141	130	130.0
<i>Micrometrus minimus</i>	dwarf surfperch	1	57	5.0	5.0
<i>Micropterus dolomieu</i>	smallmouth bass	1	186	150	150.0
<i>Pleuronectiformes</i> unid.	flatfishes	1	38	0.5	0.5
<i>Syngnathus</i> spp.	pipefishes	1	105	1.0	1.0
<i>Xenistius californiensis</i>	salema	1	48	1.8	1.8
<u>SHARKS/RAYS</u>					
<i>Ophichthus zophochir</i>	yellow snake eel	4	549-769	150-450	1,380.0
<u>INVERTEBRATES</u>					
<i>Octopus</i> spp.	octopus	17	17-117	16.0-520	3,170.0
<i>Portunus xantusii</i>	Xantus' swimming crab	15	11-52	1.3-14.0	73.8
<i>Pachygrapsus crassipes</i>	striped shore crab	6	11-22	1.0-4.0	13.0
<i>Octopus bimaculatus</i>	California two-spot octopus	3	90-95	240-370	940.0
<i>Blepharipoda occidentalis</i>	spiny mole crab	1	18	3.0	3.0
Total:		1,316			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA037

Survey Date: March 02 - 03, 2005

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Seriphus politus</i>	queenfish	18	47-74	1.2-5.5	45.4
<i>Atherinops affinis</i>	topsmelt	8	65-112	0.4-13.7	55.7
<i>Roncador stearnsi</i>	spotfin croaker	5	70-550	5.5-1,700	3,024.6
<i>Anchoa compressa</i>	deepbody anchovy	3	64-98	3.0-8.6	20.0
<i>Phanerodon furcatus</i>	white surfperch	3	79-175	10.9-130.8	179.1
<i>Citharichthys stigmatæus</i>	speckled sanddab	2	60-68	3.4-4.0	7.4
<i>Anisotremus davidsonii</i>	sargo	1	61	4.5	4.5
<i>Cymatogaster aggregata</i>	shiner surfperch	1	107	26.5	26.5
<i>Dorosoma petenense</i>	threadfin shad	1	69	3.4	3.4
<i>Hypsopsetta guttulata</i>	diamond turbot	1	215	226	226.0
<i>Micrometrus minimus</i>	dwarf surfperch	1	69	7.9	7.9
<i>Paralabrax nebulifer</i>	barred sand bass	1	65	5.7	5.7
<i>Paralichthys californicus</i>	California halibut	1	128	30.3	30.3
<i>Syngnathus</i> spp.	pipefishes	1	127	0.5	0.5
unidentified fish, damaged	unid. damaged fish	1	-	1.2	1.2
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	13	19-48	1.3-15.2	84.2
<i>Pachygrapsus crassipes</i>	striped shore crab	6	8-42	0.6-48.5	73.9
<i>Octopus</i> spp.	octopus	1	95	266.5	266.5
Total:		68			

Survey: EPSIA038

Survey Date: March 09 - 10, 2005

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Seriphus politus</i>	queenfish	36	45-80	1.7-7.4	124.6
<i>Atherinops affinis</i>	topsmelt	25	60-152	2.0-33.5	299.9
<i>Cymatogaster aggregata</i>	shiner surfperch	17	76-119	12.0-35.5	350.7
<i>Hypsopsetta guttulata</i>	diamond turbot	10	185-235	160-281	2,126.3
<i>Paralabrax clathratus</i>	kelp bass	6	49-65	2.2-5.6	22.9
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	5	43-80	2.0-11.1	33.2
<i>Paralabrax nebulifer</i>	barred sand bass	4	50-83	2.5-14.1	27.5
<i>Anchoa compressa</i>	deepbody anchovy	3	90-110	9.1-12.8	34.7
<i>Roncador stearnsi</i>	spotfin croaker	3	67-81	4.8-9.5	20.4
<i>Anchoa delicatissima</i>	slough anchovy	2	58-62	2.3-2.8	5.1
<i>Atherinopsis californiensis</i>	jacksmelt	2	110-158	14.8-31.8	46.6
<i>Engraulis mordax</i>	northern anchovy	2	35-38	0.3-0.5	0.8
<i>Anisotremus davidsonii</i>	sargo	1	56	3.9	3.9
<i>Citharichthys stigmatæus</i>	speckled sanddab	1	60	5.2	5.2
<i>Fundulus parvipinnis</i>	California killifish	1	65	4.9	4.9
<i>Gillichthys mirabilis</i>	longjaw mudsucker	1	125	34.4	34.4
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	1	98	15.1	15.1
<i>Micrometrus minimus</i>	dwarf surfperch	1	64	7.3	7.3
<i>Peprilus simillimus</i>	Pacific butterfish	1	85	13.8	13.8
<i>Phanerodon furcatus</i>	white surfperch	1	123	35.9	35.9
<i>Porichthys myriaster</i>	specklefin midshipman	1	330	500	500.0
<i>Sardinops sagax</i>	Pacific sardine	1	114	8.9	8.9
unidentified fish	unid. fish	1	39	0.9	0.9
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	2	347-423	362-671	1,032.7
<i>Platyrrhinoidis triseriata</i>	thornback	2	196-395	365-371	735.8
<i>Myliobatis californica</i>	bat ray	1	343	647.0	647.3
<i>Urolophus halleri</i>	round stingray	1	180	448.0	447.7
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	66	16-46	1.1-9.4	260.7
<i>Pachygrapsus crassipes</i>	striped shore crab	5	10-40	0.5-36.8	49.7
<i>Pyromaia tuberculata</i>	tuberculate pea crab	2	5-8	0.2-0.4	0.6
<i>Octopus</i> spp.	octopus	1	90	319.5	319.5
Total:		206			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA039

Survey Date: March 16 - 17, 2005

Sample Count: 13

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinops affinis</i>	topsmelt	6	76-138	4.2-28.4	138.6
<i>Anchoa delicatissima</i>	slough anchovy	3	63-72	2.7-3.8	9.5
<i>Cymatogaster aggregata</i>	shiner surfperch	3	40-120	1.4-45.6	83.4
<i>Roncador stearnsi</i>	spotfin croaker	3	57-71	4.7-7.1	17.8
<i>Serphus polius</i>	queenfish	3	55-65	2.0-3.7	9.3
<i>Hypsopsetta guttulata</i>	diamond turbot	2	210-235	233-281	513.5
<i>Anchoa compressa</i>	deepbody anchovy	1	58	1.7	1.7
<i>Brachyistius frenatus</i>	kelp surfperch	1	80	17.0	17.0
<i>Fundulus parvipinnis</i>	California killifish	1	70	5.4	5.4
<i>Hyperprosopon argenteum</i>	walleye surfperch	1	129	51.2	51.2
<i>Leuresthes tenuis</i>	California grunion	1	74	3.1	3.1
<i>Lyopsetta exilis</i>	slender sole	1	124	25.9	25.9
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	54	2.7	2.7
<i>Paralabrax nebulifer</i>	barred sand bass	1	62	3.9	3.9
<i>Syngnathus</i> spp.	pipefishes	1	190	1.8	1.8
<i>Xenistius californiensis</i>	salema	1	53	2.8	2.8
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	10	21-44	1.0-11.3	30.8
<i>Pachygrapsus crassipes</i>	striped shore crab	6	10-28	1.1-8.4	31.2
Total:		46			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA040

Survey Date: March 23 - 24, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinops affinis</i>	topsmelt	77	60-155	2.0-50.2	776.2
<i>Cymatogaster aggregata</i>	shiner surfperch	62	33-123	0.8-41.6	1,385.7
<i>Seriophus politus</i>	queenfish	31	35-111	1.3-14.0	155.4
<i>Anchoa compressa</i>	deepbody anchovy	25	54-80	1.6-5.4	73.2
<i>Anchoa delicatissima</i>	slough anchovy	14	55-70	2.3-3.7	40.6
<i>Roncador stearnsi</i>	spotfin croaker	9	64-83	3.0-12.4	57.6
<i>Syngnathus</i> spp.	pipefishes	9	183-235	1.6-3.5	22.0
<i>Strongylura exilis</i>	California needlefish	6	330-538	37.5-181	592.8
<i>Genyonemus lineatus</i>	white croaker	4	31-34	0.6	2.7
<i>Leuresthes tenuis</i>	California grunion	4	70-104	3.3-9.2	20.9
<i>Paralabrax nebulifer</i>	barred sand bass	4	59-64	3.8-5.2	18.3
<i>Hypsopsetta guttulata</i>	diamond turbot	3	205-224	184.4-203.0	574.8
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	3	60-105	3.3-18.8	28.6
<i>Phanerodon furcatus</i>	white surfperch	3	41-166	8.8-87.7	116.2
<i>Anisotremus davidsonii</i>	sargo	2	55-59	4.3-5.0	9.3
<i>Chromis punctipinnis</i>	blacksmith	2	119-125	32.7-35.0	67.7
<i>Hyperprosopon argenteum</i>	walleye surfperch	2	39-177	1.5-190	191.1
<i>Paralabrax clathratus</i>	kelp bass	2	74-76	5.6-8.0	13.6
Pleuronectiformes unid.	flatfishes	2	55-60	3.2-3.7	6.9
<i>Citharichthys stigmaeus</i>	speckled sanddab	1	60	2.9	2.9
<i>Engraulis mordax</i>	northern anchovy	1	87	3.9	3.9
<i>Fundulus parvipinnis</i>	California killifish	1	66	5.2	5.2
<i>Hypsoblennius gilberti</i>	rockpool blenny	1	70	6.3	6.3
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	53	2.6	2.6
<i>Pepilius simillimus</i>	Pacific butterfish	1	87	14.3	14.3
<i>Pleuronichthys verticalis</i>	hornyhead turbot	1	138	68.9	68.9
<i>Porichthys myriaster</i>	specklefin midshipman	1	370	350	350.0
<i>Umbrina roncadore</i>	yellowfin croaker	1	70	5.4	5.4
unidentified fish	unid. fish	1	156	77.6	77.6
unidentified fish, damaged	unid. damaged fish	1	65	1.6	1.6
<i>Xenistius californiensis</i>	salema	1	51	2.9	2.9
<u>SHARKS/RAYS</u>					
<i>Ophichthus zophochir</i>	yellow snake eel	2	750-752	393-457	849.4
<i>Urolophus halleri</i>	round stingray	2	119-120	95.2-98.0	193.2
<i>Gymnura marmorata</i>	California butterfly ray	1	395	185.0	185.0
<i>Rhinobatos productus</i>	shovelnose guitarfish	1	775	1,800.0	1,800.0
<u>INVERTEBRATES</u>					
<i>Portunus xanthusii</i>	Xantus' swimming crab	56	9-46	0.9-19.0	200.2
<i>Pachygrapsus crassipes</i>	striped shore crab	9	15-40	1.0-31.9	95.6
Total:		347			

Impingement Results

Encina Power Station Impingement Abundance: Travelling Screen and Bar Rack Survey Data

Survey: EPSIA041
Sample Count: 19

Survey Date: March 30 - 31, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinops affinis</i>	topsmeit	85	58-135	2.5-21.7	552.4
<i>Seriphus politus</i>	queenfish	44	40-130	1.8-33.4	258.7
<i>Cymatogaster aggregata</i>	shiner surfperch	36	32-125	0.6-43.9	798.4
<i>Anchoa compressa</i>	deepbody anchovy	13	65-111	1.6-17.3	98.9
<i>Paralabrax nebulifer</i>	barred sand bass	11	49-75	2.4-8.6	50.9
<i>Hyperprosopon argenteum</i>	walleye surfperch	8	27-43	0.5-1.8	10.8
<i>Anchoa delicatissima</i>	slough anchovy	5	58-69	2.0-3.4	13.3
<i>Anisotremus davidsonii</i>	sargo	5	54-68	3.8-7.0	26.7
<i>Embiotoca jacksoni</i>	black surfperch	5	46-64	3.0-6.8	20.5
<i>Leuresthes tenuis</i>	California grunion	5	64-131	1.2-17.0	43.3
<i>Umbrina roncadore</i>	yellowfin croaker	5	65-108	4.8-20.0	45.2
<i>Paralichthys californicus</i>	California halibut	2	70-176	2.2-33.7	35.9
<i>Phanerodon furcatus</i>	white surfperch	2	41-50	1.8-2.5	4.3
<i>Genyonemus lineatus</i>	white croaker	1	45	1.6	1.6
<i>Hypsoblennius gentilis</i>	bay blenny	1	42	1.6	1.6
<i>Menticirrhus undulatus</i>	California corbina	1	262	277.5	277.5
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	80	9.6	9.6
<i>Roncadore stearnsi</i>	spotfin croaker	1	77	7.5	7.5
<i>Strongylura exilis</i>	California needlefish	1	324	26.3	26.3
<i>Syngnathus spp.</i>	pipefishes	1	207	3.6	3.6
<i>Xenistius californiensis</i>	salema	1	55	3.1	3.1
<u>SHARKS/RAYS</u>					
<i>Gymnura marmorata</i>	California butterfly ray	2	330-398	305-550	855.2
<i>Urolophus halleri</i>	round stingray	2	104-108	56.0-62.1	118.1
<i>Platyrrhinoidis triseriata</i>	thornback	1	279	1,500.0	1,500.0
<i>Rhinobatos productus</i>	shovelnose guitarfish	1	1126	4,400.0	4,400.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	20	15-58	0.9-16.8	77.1
<i>Pachygrapsus crassipes</i>	striped shore crab	17	5-40	0.3-31.9	85.4
Total:		277			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA042

Survey Date: April 6 - 7, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	29	42-131	3.0-65.2	732.7
<i>Atherinops affinis</i>	topsmelt	23	60-127	3.0-24.0	238.0
<i>Seriphus politus</i>	queenfish	17	55-81	4.0-10.0	94.5
<i>Hyperprosopon argenteum</i>	walleye surfperch	6	40-161	2.0-100	204.0
<i>Anchoa compressa</i>	deepbody anchovy	4	68-78	4.0-6.5	19.0
<i>Atherinopsis californiensis</i>	jacksmelt	4	75-252	5.0-140	177.0
<i>Leuresthes tenuis</i>	California grunion	4	78-151	3.8-28.0	58.8
<i>Embiotoca jacksoni</i>	black surfperch	3	53-218	4.5-452	464.0
<i>Porichthys myriaster</i>	specklefin midshipman	3	370-410	800-1,250	2,950.0
<i>Paralabrax nebulifer</i>	barred sand bass	2	50-56	3.0-4.0	7.0
<i>Amphistichus argenteus</i>	barred surfperch	1	42	2.0	2.0
<i>Anchoa delicatissima</i>	slough anchovy	1	63	3.5	3.5
<i>Anisotremus davidsonii</i>	sargo	1	68	8.5	8.5
<i>Chromis punctipinnis</i>	blacksmith	1	95	18.5	18.5
<i>Engraulis mordax</i>	northern anchovy	1	57	2.5	2.5
<i>Genyonemus lineatus</i>	white croaker	1	110	21.0	21.0
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	65	7.0	7.0
<i>Sardinops sagax</i>	Pacific sardine	1	128	19.5	19.5
<i>Strongylura exilis</i>	California needlefish	1	345	45.0	45.0
<i>Syngnathus leptorhynchus</i>	bay pipefish	1	208	4.0	4.0
<i>Xenistius californiensis</i>	salema	1	52	4.0	4.0
<u>SHARKS/RAYS</u>					
<i>Gymnura marmorata</i>	California butterfly ray	2	415-462	600-1,050	1,650.0
<i>Urolophus halleri</i>	round stingray	1	168	420	420.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	40	17-70	1.5-20.0	300.0
<i>Pachygrapsus crassipes</i>	striped shore crab	8	17-32	3.0-13.5	43.0
Hippolytidae unid.	hippolytid shrimps	1	-	-	-
Total:		158			

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA043

Survey Date: April 13 - 14, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	93	48-143	6.9-59.8	1,565.9
<i>Atherinops affinis</i>	topsmelt	35	65-155	3.0-39.9	415.6
<i>Anisotremus davidsonii</i>	sargo	13	40-91	3.9-25.2	127.2
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	10	65-263	3.9-259.1	398.9
<i>Anchoa compressa</i>	deepbody anchovy	9	80-120	6.6-22.5	123.9
<i>Leuresthes tenuis</i>	California grunion	6	110-160	7.6-23.1	83.4
<i>Hyperprosopon argenteum</i>	walleye surfperch	5	40-50	1.6-2.5	10.1
<i>Atherinopsis californiensis</i>	jacksmelt	3	194-325	61.4-223	462.1
<i>Paralabrax clathratus</i>	kelp bass	3	65-75	3.2-5.6	12.5
<i>Seriphus politus</i>	queenfish	3	61-84	3.5-7.7	15.2
<i>Chromis punctipinnis</i>	blacksmith	2	154-156	106.6-143.1	249.7
<i>Embiotoca jacksoni</i>	black surfperch	2	56-58	4.3-4.4	8.7
<i>Girella nigricans</i>	opaleye	2	140-190	86.0-260.1	346.1
<i>Hermosilla azurea</i>	zebra perch	2	73-255	10.9-445	455.9
<i>Hypsopsetta guttulata</i>	diamond turbot	2	155-198	107.3-185.1	292.4
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	2	58-66	3.5	7.0
<i>Porichthys myriaster</i>	specklefin midshipman	2	263-352	271-673	943.5
<i>Roncador stearnsi</i>	spotfin croaker	2	80-222	9.5-174.1	183.6
<i>Anchoa delicatissima</i>	slough anchovy	1	70	3.8	3.8
<i>Genyonemus lineatus</i>	white croaker	1	169	92.6	92.6
<i>Heterostichus rostratus</i>	giant kelpfish	1	88	4.9	4.9
<i>Hypsoblennius gentilis</i>	bay blenny	1	58	4.7	4.7
<i>Hypsoblennius jenkinsi</i>	mussel blenny	1	91	13.0	13.0
<i>Paralabrax nebulifer</i>	barred sand bass	1	221	266.7	266.7
<i>Paralichthys californicus</i>	California halibut	1	107	18.2	18.2
<i>Phanerodon furcatus</i>	white surfperch	1	213	215.1	215.1
<i>Umbrina roncadore</i>	yellowfin croaker	1	60	4.6	4.6
unidentified fish, damaged	unid. damaged fish	1	-	91.8	91.8
<i>Xenistius californiensis</i>	salema	1	50	2.4	2.4
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	9	96-198	37.6-521.1	2,298.0
<i>Gymnura marmorata</i>	California butterfly ray	2	365-393	443.8-512.9	956.7
<i>Myliobatis californica</i>	bat ray	2	352-354	673-790	1,463.2
<u>INVERTEBRATES</u>					
<i>Pachygrapsus crassipes</i>	striped shore crab	170	7-31	0.3-14.8	544.1
<i>Portunus xantusii</i>	Xantus' swimming crab	13	18-51	1.5-19.2	85.9
<i>Cancer productus</i>	red rock crab	1	19	-1.4	1.4
Total:		404			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA044

Survey Date: April 20 - 21, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	32	43-122	1.9-31.8	477.6
<i>Anchoa compressa</i>	deepbody anchovy	16	65-119	3.2-18.7	159.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	11	41-225	1.7-275.3	465.4
<i>Anisotremus davidsonii</i>	sargo	7	60-75	4.8-9.0	46.8
<i>Atherinops affinis</i>	topsmelt	7	73-133	3.7-23.3	112.1
<i>Seriphus politus</i>	queenfish	6	68-99	4.7-15.7	48.3
<i>Anchoa delicatissima</i>	slough anchovy	4	65-74	2.6-4.9	14.9
<i>Porichthys myriaster</i>	specklefin midshipman	2	270-335	227-482	708.8
<i>Cheilopogon pinnatibarbus</i>	spotted flyingfish	1	114	2.9	2.9
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	1	65	4.6	4.6
<i>Leuresthes tenuis</i>	California grunion	1	110	11.0	11.0
<i>Paralabrax nebulifer</i>	barred sand bass	1	50	2.3	2.3
<i>Phanerodon furcatus</i>	white surfperch	1	36	1.0	1.0
<i>Porichthys</i> spp.	midshipman	1	-	200	200.0
<i>Roncador stearnsi</i>	spotfin croaker	1	77	8.6	8.6
<i>Strongylura exilis</i>	California needlefish	1	390	57.9	57.9
unidentified fish, damaged	unid. damaged fish	1	-	200	200.0
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	2	100	63.3-150	213.3
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	12	18-40	1.5-13.7	65.9
<i>Pachygrapsus crassipes</i>	striped shore crab	10	4-50	0.2-53.0	82.5
<i>Octopus</i> spp.	octopus	1	-	139.7	139.7
Total:		119			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA045

Survey Date: April 27 - 28, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Cymatogaster aggregata</i>	shiner surfperch	63	39-122	1.2-42.0	810.1
<i>Atherinops affinis</i>	topsmelt	10	78-136	6.1-23.7	135.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	5	39-115	1.1-49.3	103.2
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	4	70-80	4.9-7.7	27.5
<i>Paralabrax nebulifer</i>	barred sand bass	4	53-91	4.4-14.0	28.4
<i>Anchoa compressa</i>	deepbody anchovy	3	80-100	2.3-13.3	21.9
<i>Anchoa delicatissima</i>	slough anchovy	2	61-97	2.9-9.1	12.0
<i>Anisotremus davidsonii</i>	sargo	2	63-72	5.7-10.3	16.0
<i>Paralabrax clathratus</i>	kelp bass	2	61-76	5.1-8.1	13.2
<i>Mugil cephalus</i>	striped mullet	1	57	3.4	3.4
<i>Paralichthys californicus</i>	California halibut	1	101	14.6	14.6
<i>Peprilus simillimus</i>	Pacific butterfish	1	47	2.2	2.2
<i>Porichthys myriaster</i>	specklefin midshipman	1	252	190.0	189.5
<i>Seriphus politus</i>	queenfish	1	71	6.9	6.9
<i>Xenistius californiensis</i>	salema	1	70	7.6	7.6
SHARKS/RAYS					
<i>Myliobatis californica</i>	bat ray	1	566	2,500.0	2,500.0
INVERTEBRATES					
<i>Portunus xantusii</i>	Xantus' swimming crab	6	19-33	1.8-4.9	18.1
<i>Pachygrapsus crassipes</i>	striped shore crab	2	11-12	2.9-3.4	6.3
		Total:	110		

Survey: EPSIA046

Survey Date: May 4 - 5, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Cymatogaster aggregata</i>	shiner surfperch	169	29-148	0.6-78.6	1,251.5
<i>Anchoa compressa</i>	deepbody anchovy	35	48-100	1.5-13.7	145.2
<i>Atherinops affinis</i>	topsmelt	23	60-126	2.0-26.0	211.4
<i>Hyperprosopon argenteum</i>	walleye surfperch	14	48-157	2.2-94.9	162.4
<i>Seriphus politus</i>	queenfish	6	60-91	2.6-10.3	38.0
<i>Leuresthes tenuis</i>	California grunion	5	71-112	3.5-17.4	37.3
<i>Paralabrax nebulifer</i>	barred sand bass	5	61-80	4.7-11.6	38.1
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	4	75-82	9.1-90.0	122.6
<i>Sebastes atrovirens</i>	kelp rockfish	4	68-90	5.6-16.4	39.8
<i>Paralichthys californicus</i>	California halibut	3	22-80	6.2-9.3	21.9
<i>Citharichthys stigmatæus</i>	speckled sanddab	2	70-79	5.5-6.4	11.9
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	2	73-84	5.3-7.3	12.6
<i>Porichthys myriaster</i>	specklefin midshipman	2	80-82	9.9-12.1	22.0
<i>Anisotremus davidsonii</i>	sargo	1	64	7.4	7.4
<i>Heterostichus rostratus</i>	giant kelpfish	1	85	2.9	2.9
<i>Strongylura exilis</i>	California needlefish	1	400	66.0	66.0
SHARKS/RAYS					
<i>Gymnura marmorata</i>	California butterfly ray	1	555	1,508.0	1,508.0
<i>Ophichthus zophochir</i>	yellow snake eel	1	-	17.8	17.8
<i>Urolophus halleri</i>	round stingray	1	204	525	525.0
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	4	10-30	1.3-4.8	9.2
<i>Portunus xantusii</i>	Xantus' swimming crab	3	40-50	2.2-11.9	19.4
		Total:	287		

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA047
Sample Count: 19

Survey Date: May 11 - 12, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	89	33-112	0.7-39.2	1,120.1
<i>Phanerodon furcatus</i>	white surfperch	30	30-161	0.7-90.6	179.2
<i>Atherinops affinis</i>	topsmelt	20	45-145	0.7-74.5	232.0
<i>Anchoa compressa</i>	deepbody anchovy	11	75-110	4.1-15.2	103.7
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	9	68-94	5.7-15.7	82.5
<i>Seriphus politus</i>	queenfish	8	71-91	4.6-12.5	64.5
<i>Amphistichus argenteus</i>	barred surfperch	4	53-62	3.7-6.0	18.1
<i>Hyperprosopon argenteum</i>	walleye surfperch	3	50-138	2.8-65.0	72.6
<i>Leuresthes tenuis</i>	California grunion	3	64-140	2.3-17.8	25.7
<i>Porichthys myriaster</i>	specklefin midshipman	3	179-422	258-1,141	1,729.3
<i>Xenistius californiensis</i>	salema	3	56-70	3.7-7.4	18.1
<i>Anchoa delicatissima</i>	slough anchovy	2	60	2.3-2.4	4.7
<i>Strongylura exilis</i>	California needlefish	2	465-509	105-181	286.0
<i>Anisotremus davidsonii</i>	sargo	1	66	8.7	8.7
<i>Engraulis mordax</i>	northern anchovy	1	40	0.7	0.7
<i>Hypsoblennius gentilis</i>	bay blenny	1	40	1.5	1.5
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	73	6.9	6.9
<i>Paralabrax nebulifer</i>	barred sand bass	1	76	8.7	8.7
<i>Symgnathus leptorhynchus</i>	bay pipefish	1	223	2.9	2.9
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	7	119-250	100-541	2,377.5
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	6	15-56	2.1-21.8	43.0
<i>Pachygrapsus crassipes</i>	striped shore crab	4	12-36	1.3-27.9	59.8
<i>Octopus spp.</i>	octopus	1	110	226.0	225.6
Total:		211			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA048

Survey Date: May 18 - 19, 2005

Sample Count: 19

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	211	30-127	0.5-34.9	782.1
<i>Phanerodon furcatus</i>	white surfperch	21	31-72	0.8-7.1	66.6
<i>Anchoa compressa</i>	deepbody anchovy	11	62-116	2.8-18.1	102.1
<i>Hyperprosopon argenteum</i>	walleye surfperch	11	33-117	0.8-31.2	69.0
<i>Atherinops affinis</i>	topsmelt	9	31-134	7.6-24.5	138.8
<i>Porichthys myriaster</i>	specklefin midshipman	9	245-315	167-392	2,419.8
<i>Paralabrax nebulifer</i>	barred sand bass	4	65-73	4.4-7.2	23.5
<i>Seriphys politus</i>	queenfish	4	70-83	4.8-8.4	25.2
<i>Roncador stearnsi</i>	spotfin croaker	3	59-76	3.5-7.4	16.9
<i>Anchoa delicatissima</i>	slough anchovy	2	65-77	3.4-4.8	8.2
<i>Heterostichus rostratus</i>	giant kelpfish	2	63-87	1.7-4.0	5.7
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	2	68-69	6.2-6.7	12.9
<i>Anchoa</i> spp.	anchovy	1	-	1.8	1.8
<i>Anisotremus davidsonii</i>	sargo	1	74	10.3	10.3
<i>Atractoscion nobilis</i>	white seabass	1	155	37.2	37.2
<i>Citharichthys stigmatæus</i>	speckled sanddab	1	63	3.6	3.6
<i>Hypsopsetta guttulata</i>	diamond turbot	1	53	3.6	3.6
<i>Leuresthes tenuis</i>	California grunion	1	40	0.7	0.7
<i>Paralichthys californicus</i>	California halibut	1	50	1.5	1.5
<i>Strongylura exilis</i>	California needlefish	1	470	145.0	145.2
<i>Syngnathus leptorhynchus</i>	bay pipefish	1	221	1.9	1.9
<i>Umbrina roncadore</i>	yellowfin croaker	1	95	14.1	14.1
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	13	74-200	23.7-504	3,456.7
<u>INVERTEBRATES</u>					
<i>Pachygrapsus crassipes</i>	striped shore crab	11	12-24	1.2-9.7	42.6
<i>Portunus xantusii</i>	Xantus' swimming crab	5	25-45	3.9-11.2	40.1
<i>Cancer productus</i>	red rock crab	1	24	2.2	2.2
<i>Loxorhynchus crispatus</i>	moss crab	1	5	0.2	0.2
<i>Pugettia producta</i>	northern kelp crab	1	20	5.2	5.2
<i>Pugettia</i> spp.	kelp crabs	1	23	6.3	6.3
Total:		332			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA049
Sample Count: 19

Survey Date: May 25 - 26, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	94	33-110	0.9-30.1	539.1
<i>Seriphus politus</i>	queenfish	20	55-94	2.9-11.8	160.7
<i>Anchoa compressa</i>	deepbody anchovy	18	66-160	2.8-20.5	194.0
<i>Atherinops affinis</i>	topsmelt	14	47-132	1.0-32.8	151.8
<i>Phanerodon furcatus</i>	white surfperch	7	50-75	2.9-6.6	31.8
<i>Hyperprosopon argenteum</i>	walleye surfperch	6	55-147	3.6-88.1	184.8
<i>Porichthys myriaster</i>	specklefin midshipman	6	73-311	5.8-425	994.7
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	5	73-95	7.7-15.4	54.1
<i>Roncador stearnsi</i>	spotfin croaker	5	90-337	13.3-780	840.5
<i>Amphistichus argenteus</i>	barred surfperch	3	54-70	4.7-6.8	18.1
<i>Anchoa delicatissima</i>	slough anchovy	2	61-63	2.7-3.1	5.8
<i>Strongylura exilis</i>	California needlefish	2	281-367	22.8-58.4	81.2
<i>Anisotremus davidsonii</i>	sargo	1	81	11.9	11.9
<i>Rhacochilus vacca</i>	pile surfperch	1	71	10.1	10.1
<i>Embiotoca jacksoni</i>	black surfperch	1	65	7.1	7.1
<i>Engraulis mordax</i>	northern anchovy	1	77	3.3	3.3
<i>Paralabrax clathratus</i>	kelp bass	1	65	4.8	4.8
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	62	4.3	4.3
<i>Paralabrax nebulifer</i>	barred sand bass	1	111	30.4	30.4
<i>Parallchthys californicus</i>	California halibut	1	117	22.2	22.2
<i>Sardinops sagax</i>	Pacific sardine	1	165	47.7	47.7
<i>Syngnathus</i> spp.	pipefishes	1	85	0.2	0.2
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	2	119-176	87.3-378	465.1
<i>Gymnura marmorata</i>	California butterfly ray	1	395	581	580.9
<u>INVERTEBRATES</u>					
<i>Pachygrapsus crassipes</i>	striped shore crab	13	10-40	0.4-40.0	82.6
<i>Portunus xantusii</i>	Xantus' swimming crab	5	23-29	1.1-5.7	18.2
<i>Cancer productus</i>	red rock crab	2	26-30	2.5-3.7	6.2
Total:		215			

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA050
Sample Count: 19

Survey Date: June 1 - 2, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	140	27-110	1.2-29.4	693.4
<i>Phanerodon furcatus</i>	white surfperch	19	51-78	3.1-8.7	115.6
<i>Atherinops affinis</i>	topsmelt	11	86-130	4.6-26.9	105.4
<i>Anchoa compressa</i>	deepbody anchovy	9	76-105	4.8-14.2	90.2
<i>Porichthys myriaster</i>	specklefin midshipman	6	240-280	134-281	1,152.8
<i>Seriphys politus</i>	queenfish	6	38-81	0.7-7.6	17.7
<i>Anchoa delicatissima</i>	slough anchovy	5	35-67	0.8-3.2	8.2
<i>Hyperprosopon argenteum</i>	walleye surfperch	5	51-60	3.6-5.3	22.8
<i>Paralichthys californicus</i>	California halibut	4	40-155	2.9-41.1	106.3
<i>Citharichthys stigmæus</i>	speckled sanddab	3	41-71	1.0-5.7	10.5
<i>Paralabrax clathratus</i>	kelp bass	3	57-75	3.8-6.2	15.8
<i>Genyonemus lineatus</i>	white croaker	2	82-86	9.0-10.7	19.7
<i>Heterostichus rostratus</i>	giant kelpfish	2	75-122	2.8-12.0	14.8
<i>Paralabrax nebulifer</i>	barred sand bass	2	63	4.2-5.9	10.1
<i>Atractoscion nobilis</i>	white seabass	1	441	980	980.0
<i>Hypsopsetta guttulata</i>	diamond turbot	1	55	3.0	3.0
<i>Leuresthes tenuis</i>	California grunion	1	51	1.1	1.1
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	250	293.0	292.5
<i>Sardinops sagax</i>	Pacific sardine	1	40	1.0	1.0
<u>SHARKS/RAYS</u>					
<i>Gymnura marmorata</i>	California butterfly ray	2	226-339	119-274	393.0
<i>Urolophus halleri</i>	round stingray	2	171-297	276-460	735.7
<i>Myliobatis californica</i>	bat ray	1	940	975	975.0
<i>Rhinobatos productus</i>	shovelnose guitarfish	1	374	160.8	160.8
<u>INVERTEBRATES</u>					
<i>Pachygrapsus crassipes</i>	striped shore crab	10	12-25	1.5-3.6	26.9
<i>Pyromaia tuberculata</i>	tuberculate pea crab	4	10-18	1.0-3.3	7.8
<i>Portunus xantusii</i>	Xantus' swimming crab	2	30-37	3.9-8.6	12.5
<i>Cancer</i> spp.	cancer crabs	1	28	3.0	3.0
Majidae	spider crabs	1	13	1.8	1.8
<i>Pugettia</i> spp.	kelp crabs	1	11	0.9	0.9
Total:		247			

Impingement Results

Encina Power Station Impingement Abundance: Traveling Screen and Bar Rack Survey Data

Survey: EPSIA051
Sample Count: 19

Survey Date: June 8 - 9, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	129	30-93	1.1-19.1	491.1
<i>Atherinops affinis</i>	topsmelt	28	18-209	0.8-51.2	366.3
<i>Anchoa compressa</i>	deepbody anchovy	14	24-82	0.4-7.3	28.5
<i>Paralichthys californicus</i>	California halibut	11	50-128	2.1-30.3	163.3
<i>Engraulis mordax</i>	northern anchovy	10	36-110	0.2-10.5	19.9
<i>Seriphus politus</i>	queenfish	10	68-110	4.6-19.2	95.4
<i>Porichthys myriaster</i>	specklefin midshipman	7	235-413	156-739	1,796.8
<i>Phanerodon furcatus</i>	white surfperch	4	48-67	3.2-7.6	19.6
<i>Amphistichus argenteus</i>	barred surfperch	3	60-74	5.5-10.9	25.7
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	3	81-85	8.5-13.7	35.3
<i>Strongylura exilis</i>	California needlefish	3	368-534	42.3-225	430.6
<i>Heterostichus rostratus</i>	giant kelpfish	2	80-95	3.6-6.0	9.6
<i>Sardinops sagax</i>	Pacific sardine	2	131-132	23.7-25.6	49.3
<i>Anchoa</i> spp.	anchovy	1	-	8.5	8.5
<i>Hyperprosopon argenteum</i>	walleye surfperch	1	57	4.2	4.2
<i>Hypsoblennius gentilis</i>	bay blenny	1	69	6.4	6.4
<i>Hypsopsetta guttulata</i>	diamond turbot	1	54	3.7	3.7
<u>SHARKS/RAYS</u>					
<i>Myliobatis californica</i>	bat ray	2	206-255	188-290	477.8
<i>Ophichthus zophochir</i>	yellow snake eel	1	787	595.0	594.6
<u>INVERTEBRATES</u>					
<i>Pachygrapsus crassipes</i>	striped shore crab	5	18-20	0.9-5.5	13.0
Total:		239			

Survey: EPSIA052
Sample Count: 19

Survey Date: June 15 - 16, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	19	45-109	2.2-25.2	105.4
<i>Engraulis mordax</i>	northern anchovy	4	59-67	1.0-2.6	7.4
<i>Porichthys myriaster</i>	specklefin midshipman	3	230-290	142-243	594.3
<i>Atherinops affinis</i>	topsmelt	2	90-95	4.5-5.3	9.8
<i>Heterostichus rostratus</i>	giant kelpfish	2	61-95	1.3-5.6	6.9
<i>Anchoa compressa</i>	deepbody anchovy	1	-	4.2	4.2
<i>Atractoscion nobilis</i>	white seabass	1	340	411	411.0
<i>Citharichthys stigmaeus</i>	speckled sanddab	1	70	4.9	4.9
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	1	300	761.0	761.4
<i>Phanerodon furcatus</i>	white surfperch	1	60	5.8	5.8
<i>Seriphus politus</i>	queenfish	1	50	1.6	1.6
<u>INVERTEBRATES</u>					
<i>Pachygrapsus crassipes</i>	striped shore crab	7	15-27	0.5-6.6	18.4
<i>Portunus xantusii</i>	Xantus' swimming crab	1	35	6.1	6.1
Total:		45			

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS001

Survey Date: July 03-04, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	6,554	47-115	2.9-31.1	31,301.3
<i>Anchoa compressa</i>	deepbody anchovy	6,439	65-120	2.2-20.5	61,726.7
<i>Atherinops affinis</i>	topsmelt	5,061	52-108	1.1-15.0	16,090.2
<i>Sardinops sagax</i>	Pacific sardine	4,401	47-106	0.8-8.5	8,798.2
<i>Heterostichus rostratus</i>	giant kelpfish	532	47-122	1.1-19.4	3,587.8
<i>Atractoscion nobilis</i>	white seabass	75	108-366	19.0-650	16,045.0
<i>Girella nigricans</i>	opaleye	72	44-221	3.0-390	6,223.0
<i>Seriphus politus</i>	queenfish	54	83-188	8.0-80.0	2,293.0
<i>Strongylura exilis</i>	California needlefish	53	102-630	1.0-480	806.0
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	49	100-358	30.0-980	8,941.7
<i>Embiotoca jacksoni</i>	black surfperch	39	82-197	17.0-270	1,754.0
<i>Porichthys myriaster</i>	specklefin midshipman	28	124-403	140-820	8,733.0
<i>Chromis punctipinnis</i>	blacksmith	26	65-163	6.0-140	720.0
<i>Hypsoblennius gentilis</i>	bay blenny	26	40-91	3.0-25.0	354.3
<i>Syngnathus</i> spp.	pipefishes	25	128-251	1.0-3.0	29.3
<i>Hypsoblennius</i> spp.	blennies	23	35-54	1.0-3.0	46.7
<i>Ophichthus zophochir</i>	yellow snake eel	14	488-790	110-650	4,750.0
<i>Roncador stearnsi</i>	spotfin croaker	12	80-145	11.0-48.0	395.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	8	78-150	12.0-60.0	366.0
<i>Paralabrax nebulifer</i>	barred sand bass	8	119-252	40.0-320	819.0
<i>Hypsopsetta guttulata</i>	diamond turbot	4	195-228	210-300	980.0
<i>Hypsypops rubicundus</i>	garibaldi	3	122-169	73.0-230	523.0
<i>Trachurus symmetricus</i>	jack mackerel	3	111-142	17.0-40.0	78.0
<i>Umbrina roncadore</i>	yellowfin croaker	2	137-150	43.0-61.0	104.0
<i>Xenistius californiensis</i>	salema	2	88-98	17.0-60.0	77.0
<i>Anisotremus davidsonii</i>	sargo	1	130	44.0	44.0
<i>Cheilotrema saturnum</i>	black croaker	1	48	3.0	3.0
<i>Paraclinus integripinnis</i>	reef finspot	1	49	3.0	3.0
<i>Paralabrax clathratus</i>	kelp bass	1	157	82.0	82.0
<i>Pleuronichthys ritteri</i>	spotted turbot	1	152	98.0	98.0
Scorpaenidae	scorpionfishes	1	122	62.0	62.0
<i>Sphyrna argentea</i>	California barracuda	1	91	5.0	5.0
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	439	125-230	100-700	118,655.1
<i>Myliobatis californica</i>	bat ray	64	221-660	140-4,700	29,566.1
<i>Gymnura marmorata</i>	California butterfly ray	12	240-550	120-950	4,321.8
<i>Mustelus californicus</i>	gray smoothhound	1	575	520	520.0
<i>Triakis semifasciata</i>	leopard shark	1	411	260	260.0
<u>INVERTEBRATES</u>					
<i>Pachygrapsus crassipes</i>	striped shore crab	49	32-46	22.0-45.0	269.0
<i>Octopus</i> spp.	octopus	20	-	2,500.0	2,500.0
<i>Pyromaia tuberculata</i>	tuberculate pea crab	19	-	-	-
<i>Panulirus interruptus</i>	California spiny lobster	1	176	120	120.0
<i>Pugettia</i> spp.	kelp crabs	1	42	26.0	26.0
Total:		24,127			

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS002

Survey Date: August 28, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Anchoa compressa</i>	deepbody anchovy	5,324	72-120	5.9-20.9	59,754.9
<i>Atherinops affinis</i>	topsmelt	3,201	51-100	1.0-10.6	17,701.4
<i>Cymatogaster aggregata</i>	shiner surfperch	2,801	56-104	5.0-24.5	28,011.1
<i>Sardinops sagax</i>	Pacific sardine	1,206	65-130	1.8-25.0	7,355.5
<i>Leuresthes tenuis</i>	California grunion	998	43-115	0.8-10.4	2,058.8
<i>Heterostichus rostratus</i>	giant kelpfish	299	78-185	2.9-53.6	3,440.4
<i>Seriphus politus</i>	queenfish	265	65-225	2.3-172.3	12,690.8
<i>Atractoscion nobilis</i>	white seabass	64	115-265	40.4-260.7	7,425.4
<i>Cheilotrema saturnum</i>	black croaker	38	64-155	4.8-53.2	617.9
<i>Strongylura exilis</i>	California needlefish	27	109-478	1.0-145.2	1,624.8
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	20	43-335	1.5-925	7,724.0
<i>Hypsoblennius jenkinsi</i>	mussel blenny	18	39-95	0.8-14.7	97.8
Sciaenidae unid.	croaker	17	120-200	32.8-138.0	1,212.0
<i>Chromis punctipinnis</i>	blacksmith	15	55-165	7.0-105	458.8
<i>Girella nigricans</i>	opaleye	14	55-211	4.5-321	1,567.7
<i>Scomber japonicus</i>	Pacific mackerel	14	67-187	14.5-86.8	650.0
<i>Hermosilla azurea</i>	zebra perch	13	35-68	1.1-8.7	41.8
<i>Hypsoblennius gentilis</i>	bay blenny	11	42-95	1.4-15.5	99.5
<i>Paralabrax nebulifer</i>	barred sand bass	11	160-278	82.3-490	2,866.9
<i>Syngnathus</i> spp.	pipefishes	11	154-208	1.0-2.0	16.0
<i>Ophichthus zophochir</i>	yellow snake eel	10	262-900	7.6-750	4,045.4
<i>Hypsoblennius gilberti</i>	rockpool blenny	8	55-101	3.2-29.4	77.1
<i>Paralichthys californicus</i>	California halibut	8	201-322	142-600	2,482.0
<i>Embiotoca jacksoni</i>	black surfperch	7	70-345	15.0-500	1,049.7
<i>Hypsoblennius</i> spp.	blennies	7	45-85	1.3-10.5	20.6
<i>Anisotremus davidsonii</i>	sargo	6	38-180	1.0-142	389.3
<i>Paralabrax</i> spp.	sand bass	6	43-75	1.5-5.8	18.5
<i>Xenistius californiensis</i>	salema	6	87-132	11.4-34.5	117.0
Atherinopsidae	silverside	5	47-55	1.1-2.9	11.3
<i>Pleuronichthys ritteri</i>	spotted turbot	5	197-220	200-250	1,158.0
<i>Seriola lalandi</i>	yellowtail jack	4	33-99	1.0-32.0	56.0
<i>Sphyrna argentea</i>	California barracuda	4	245-268	55.9-78.2	272.6
<i>Trachurus symmetricus</i>	jack mackerel	4	90-160	7.1-46.8	105.6
<i>Engraulis mordax</i>	northern anchovy	3	64-65	1.8-2.2	5.9
<i>Porichthys myriaster</i>	specklefin midshipman	3	255-328	151-260	586.0
<i>Umbrina roncadore</i>	yellowfin croaker	2	150-165	43.9-63.3	107.2
unidentified fish, damaged	unidentified damaged fish	2	165-308	21.6-200	221.6
<i>Hyperprosopon argenteum</i>	walleye surfperch	1	140	64.2	64.2
<i>Menticirrhus undulatus</i>	California corbina	1	510	1,600.0	1,600.0
<i>Paralabrax clathratus</i>	kelp bass	1	138	48.6	48.6
<i>Peprilus simillimus</i>	Pacific butterfish	1	117	33.4	33.4
SHARKS/RAYS					
<i>Urolophus halleri</i>	round stingray	198	198-355	75.0-412	39,361.7
<i>Myliobatis californica</i>	bat ray	31	230-484	200-900	12,310.0
<i>Gymnura marmorata</i>	California butterfly ray	3	265-460	120-700	1,220.0
<i>Mustelus californicus</i>	gray smoothhound	2	805-905	1,400-1,600	3,000.0
<i>Dasyatis dipterura</i>	diamond stingray	1	274	850	850.0

(table continued)

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS002 (continued)

Survey Date: August 28, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
INVERTEBRATES					
<i>Lophopanopeus spp.</i>	black-clawed crabs	26	10-16	0.3-1.8	27.1
<i>Octopus spp.</i>	octopus	17	27-470	1.1-450	1,851.3
<i>Pachygrapsus crassipes</i>	striped shore crab	15	17-35	2.3-24.1	139.7
<i>Panulirus interruptus</i>	California spiny lobster	6	180-211	125-229	944.9
<i>Cancer spp.</i>	cancer crabs	5	21-32	1.7-6.2	16.9
<i>Pugettia producta</i>	northern kelp crab	2	12.5-25	1.3-8.7	10.0
<i>Pandalus spp.</i>	unidentified shrimp	1	42	0.7	0.7
Total:		14,768			

Impingement Results

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS003

Survey Date: October 23, 2004

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Atherinopsis californiensis</i>	jacksmelt	4,450	59-150	1.7-37.9	44,009.9
<i>Leuresthes tenuis</i>	California grunion	4,296	56-124	1.5-22.5	25,732.5
<i>Anchoa compressa</i>	deepbody anchovy	1,694	67-114	3.7-19.8	20,669.4
<i>Xenistius californiensis</i>	salema	718	40-68	1.4-7.7	1,510.9
<i>Cymatogaster aggregata</i>	shiner surfperch	512	58-96	4.5-20.5	6,092.9
<i>Sardinops sagax</i>	Pacific sardine	507	65-242	3.2-150	6,274.8
<i>Cheilotrema saturnum</i>	black croaker	249	93-132	16.8-61.5	8,408.2
<i>Paralabrax nebulifer</i>	barred sand bass	207	55-173	4.5-160.7	4,308.5
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	188	45-170	2.1-122.3	3,038.3
<i>Anisotremus davidsonii</i>	sargo	185	54-95	2.6-28.8	1,974.4
<i>Paralabrax clathratus</i>	kelp bass	128	28-96	0.6-23.2	876.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	116	90-152	30.6-118.5	8,891.7
<i>Atractoscion nobilis</i>	white seabass	100	140-264	90.0-320	18,017.0
<i>Hypsoblennius</i> spp.	blennies	83	-	-	422.0
<i>Hypsoblennius jenkinsi</i>	mussel blenny	65	30-80	2.0-16.0	332.0
<i>Engraulis mordax</i>	northern anchovy	59	64-82	2.4-4.9	194.9
<i>Heterostichus rostratus</i>	giant kelpfish	58	80-200	5.1-79.4	1,531.1
<i>Medialuna californiensis</i>	halfmoon	49	43-117	2.5-54.6	1,278.5
<i>Seriphus politus</i>	queenfish	43	40-160	1.0-80.0	1,428.0
<i>Hermosilla azurea</i>	zebra perch	36	37-71	1.7-11.4	216.0
<i>Sphyræna argentea</i>	California barracuda	36	135-233	16.9-74.4	1,250.4
<i>Girella nigricans</i>	opaleye	24	49-256	2.8-740	6,270.3
<i>Seriola lalandi</i>	yellowtail jack	17	80-194	7.8-145.7	922.3
<i>Strongylura exilis</i>	California needlefish	17	400-574	80.0-360	2,650.0
<i>Ophichthus zophochir</i>	yellow snake eel	13	560-790	170-520	4,589.0
<i>Phanerodon furcatus</i>	white surfperch	11	69-120	8.6-39.3	195.0
<i>Chromis punctipinnis</i>	blacksmith	10	47-83	6.1-13.1	96.2
<i>Hyperprosopon</i> spp.	surfperch	7	-	-	552.0
<i>Embiotoca jacksoni</i>	black surfperch	6	78-163	13.7-171.1	525.3
<i>Fundulus parvipinnis</i>	California killifish	3	-	-	6.9
<i>Menticirrhus undulatus</i>	California corbina	3	210-340	110-550	860
<i>Amphistichus argenteus</i>	barred surfperch	1	96	25.4	25.4
<i>Hyporhamphus rosae</i>	California halfbeak	1	-	-	-
<i>Mugil cephalus</i>	striped mullet	1	152	53.9	53.9
<i>Pleuronichthys ritteri</i>	spotted turbot	1	185	180	180.0
<i>Sarda chiliensis</i>	Pacific bonito	1	340	540	540.0
<i>Scomber japonicus</i>	Pacific mackerel	1	250	230	230.0
<i>Trachurus symmetricus</i>	jack mackerel	1	144	39.6	39.6
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	55	230-350	130-560	13,610.0
<i>Myliobatis californica</i>	bat ray	4	280-480	320-1,700	2,930.0
<i>Mustelus californicus</i>	gray smoothhound	1	790	1,500.0	1,500.0
<u>INVERTEBRATES</u>					
<i>Pachygrapsus crassipes</i>	striped shore crab	375	20-40	1.5-10.1	2,489.6
<i>Octopus bimaculatus</i>	California two-spot octopus	74	-	2.1-230	2,805.9
<i>Octopus</i> spp.	octopus	36	-	1,562.0	1,562.0
<i>Cancer antennarius</i>	brown rock crab	18	-	18.0	18.0
<i>Cancer productus</i>	red rock crab	11	15-55	1.2-10.5	40.0
<i>Pilumnus spinohirsutus</i>	retiring hairy crab	4	9-23	0.6-2.5	4.6
<i>Pugettia producta</i>	northern kelp crab	4	21-28	1.7-4.3	11.3
<i>Portunus xantusii</i>	Xantus' swimming crab	2	45	4.0-6.1	10.1
<i>Panulirus interruptus</i>	California spiny lobster	1	21	8.1	8.1
Total:		14,482			

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS004

Survey Date: February 13-14, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Atherinops affinis</i>	topsmelt	3,847	62-151	1.5-90.0	17,444.3
Atherinopsidae	silverside	2,100	-	-	8,650.0
<i>Hyperprosopon argenteum</i>	walleye surfperch	1,828	110-177	34.9-135	80,128.0
<i>Atractoscion nobilis</i>	white seabass	1,375	104-352	65.5-600	289,213.3
<i>Anchoa compressa</i>	deepbody anchovy	643	58-122	1.9-18.8	5,786.5
<i>Xenistius californiensis</i>	salema	602	43-70	1.4-10.0	2,102.3
<i>Sardinops sagax</i>	Pacific sardine	437	45-184	1.6-71.0	3,190.0
<i>Paralabrax nebulifer</i>	barred sand bass	416	50-127	2.4-43.4	3,323.5
<i>Cymatogaster aggregata</i>	shiner surfperch	343	11-134	1.1-72.8	10,082.7
<i>Leuresthes tenuis</i>	California grunion	330	56-82	1.4-4.8	706.0
<i>Paralabrax clathratus</i>	kelp bass	293	53-102	2.2-20.5	2,397.8
<i>Hypsoblennius gentilis</i>	bay blenny	288	38-102	1.3-23.7	1,334.3
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	271	43-265	1.4-440	3,222.3
<i>Anisotremus davidsonii</i>	sargo	195	49-352	3.4-1,300	33,558.2
<i>Girella nigricans</i>	opaleye	171	28-240	1.6-510	2,674.8
<i>Seriphus politus</i>	queenfish	57	38-292	0.1-225	641.0
<i>Atherinopsis californiensis</i>	jacksmelt	18	112-299	10.9-210	1,142.0
<i>Roncador stearnsi</i>	spotfin croaker	13	238-555	300-3,400	13,831.0
<i>Hypsopsetta guttulata</i>	diamond turbot	12	36-246	1.0-350	2,694.6
<i>Syngnathus</i> spp.	pipefishes	12	146-233	0.3-4.4	20.5
<i>Chromis punctipinnis</i>	blacksmith	11	46-102	2.2-79.5	179.2
<i>Ophichthus zophochir</i>	yellow snake eel	11	394-758	32.7-470	3,222.7
<i>Embiotoca jacksoni</i>	black surfperch	10	105-255	40.9-600	1,403.2
<i>Amphistichus argenteus</i>	barred surfperch	9	96-227	27.3-377.6	680.4
<i>Heterostichus rostratus</i>	giant kelpfish	9	90-225	5.1-110.0	322.1
<i>Genyonemus lineatus</i>	white croaker	8	80-95	8.2-14.3	68.8
<i>Anchoa delicatissima</i>	slough anchovy	7	51-60	0.9-1.9	9.7
Chub, unid.	unid. chub	7	68-81	4.5-7.8	43.7
<i>Hermosilla azurea</i>	zebra perch	7	50-365	2.8-590	2,481.3
<i>Brachyistius frenatus</i>	kelp surfperch	6	76-120	11.0-55.8	198.4
<i>Engraulis mordax</i>	northern anchovy	6	80-125	3.8-15.2	54.1
<i>Pleuronichthys ritteri</i>	spotted turbot	5	200-230	215-250	1,145.0
<i>Mugil cephalus</i>	striped mullet	4	345-400	800-1,100	3,800.0
<i>Phanerodon furcatus</i>	white surfperch	4	112-126	37.7-55.0	190.4
<i>Umbrina roncadore</i>	yellowfin croaker	4	185-280	70.0-300	730.0
<i>Paraclinus integripinnis</i>	reef finspot	3	58-70	2.0-4.0	9.2
<i>Paralichthys californicus</i>	California halibut	3	222-350	113-700	1,433.0
<i>Sphyrnaea argentea</i>	California barracuda	3	167-222	21.9-65.0	127.6
<i>Trachurus symmetricus</i>	jack mackerel	3	95-110	10.0-17.0	42.4
<i>Fundulus parvipinnis</i>	California killifish	2	7.5-7.8	0.4	0.8
<i>Porichthys myriaster</i>	specklefin midshipman	2	395-396	820-900	1,720.0
<i>Strongylura exilis</i>	California needlefish	2	480-490	120-150	270.0
<i>Albula vulpes</i>	bonefish	1	380	900	900.0
<i>Citharichthys</i> spp.	sanddabs	1	-	3.4	3.4
<i>Medialuna californiensis</i>	halfmoon	1	234	410	410.0
<i>Sarda chiliensis</i>	Pacific bonito	1	-	0.1	0.1
Scorpaenidae	scorpionfishes	1	44	1.9	1.9
unidentified fish, damaged	unidentified damaged fish	-	-	-	1,543.2

(table continued)

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS004 (continued)

Survey Date: February 13-14, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	10	135-245	101-530	2,576.1
<i>Myliobatis californica</i>	bat ray	4	335-460	200-1,500	3,130.0
<i>Gymnura marmorata</i>	California butterfly ray	2	430-450	800	1,600.0
<u>INVERTEBRATES</u>					
<i>Portunus xantusii</i>	Xantus' swimming crab	44	20-67	1.1-34.4	337.5
<i>Cancer jordani</i>	hairy rock crab	18	28-47	3.2-16.3	85.5
<i>Octopus bimaculatus</i>	California two-spot octopus	11	19-180	12-590	2,424.3
<i>Pachygrapsus crassipes</i>	striped shore crab	9	13-23	1.0-4.4	16.6
<i>Cancer antennarius</i>	brown rock crab	8	40-50	14.9-27.8	138.2
<i>Cancer magister</i>	dungeness crab	1	50	18.1	18.1
Caridean unid.	unidentified shrimp	1	-	-	-
<i>Octopus spp.</i>	octopus	1	30	300	300.0
<i>Pandalus spp.</i>	unidentified shrimp	1	12	2.3	2.3
<i>Panulirus interruptus</i>	California spiny lobster	1	93	150	150.0
<i>Pugettia producta</i>	northern kelp crab	1	17	1.8	1.8
Total:		13,494			

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS005

Survey Date: April 10, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
<u>FISHES</u>					
<i>Cymatogaster aggregata</i>	shiner surfperch	2,372	90-120	18.0-46.0	93,799.4
<i>Leuresthes tenuis</i>	California grunion	1,443	75-145	3.5-37.9	12,351.6
<i>Anchoa compressa</i>	deepbody anchovy	1,112	58-120	2.0-21.0	10,598.8
<i>Paralabrax nebulifer</i>	barred sand bass	508	54-97	2.6-98.0	4,270.9
<i>Seriphus politus</i>	queenfish	306	56-152	3.1-49.6	2,284.2
<i>Hyperprosopon argenteum</i>	walleye surfperch	298	101-167	30.2-119	19,132.6
<i>Paralabrax clathratus</i>	kelp bass	181	50-94	3.4-18.3	1,546.0
<i>Anisotremus davidsonii</i>	sargo	180	55-100	3.6-30.3	22,582.2
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	139	50-185	3.0-140.3	2,564.2
<i>Hypsoblennius jenkinsi</i>	mussel blenny	92	25-90	1.1-11.6	516.3
<i>Umbrina roncadore</i>	yellowfin croaker	90	73-290	7.4-474.2	20,568.5
<i>Xenistius californiensis</i>	salema	90	50-74	2.1-7.4	409.2
<i>Girella nigricans</i>	opaleye	72	33-197	1.4-309	13,859.1
<i>Hypsopsetta guttulata</i>	diamond turbot	51	75-260	11.2-424	11,199.9
<i>Hypsoblennius gentilis</i>	bay blenny	27	65-105	4.5-23.5	172.7
<i>Porichthys myriaster</i>	specklefin midshipman	24	320-440	100-1,300	20,380.0
<i>Amphistichus argenteus</i>	barred surfperch	19	110-130	26.2-66.4	1,562.7
<i>Chromis punctipinnis</i>	blacksmith	12	60-115	6.4-41.2	294.7
<i>Brachyistius frenatus</i>	kelp surfperch	9	95-145	20.9-65.7	324.9
<i>Strongylura exilis</i>	California needlefish	9	336-490	45.5-148.4	733.3
<i>Engraulis mordax</i>	northern anchovy	7	67-120	2.9-16.5	41.6
<i>Hermosilla azurea</i>	zebra perch	6	104-249	16.2-535	778.7
<i>Syngnathus</i> spp.	pipefishes	5	160-340	1.4-12.5	20.4
<i>Roncadore stearnsi</i>	spotfin croaker	4	85-285	10.5-407	574.8
<i>Atractoscion nobilis</i>	white seabass	3	251-320	211-440	1,010.5
<i>Embiotoca jacksoni</i>	black surfperch	3	55-138	5.0-103	199.6
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	3	60-65	3.0-5.0	12.9
<i>Medialuna californiensis</i>	halfmoon	3	117-147	43.6-77.6	175.5
<i>Trachurus symmetricus</i>	jack mackerel	3	115-430	15.9-270	360.5
<i>Ophichthus zophochir</i>	yellow snake eel	2	379-664	29.4-319	348.7
<i>Citharichthys stigmaeus</i>	speckled sanddab	1	115	29.5	29.5
<i>Fundulus parvipinnis</i>	California killifish	1	53	3.2	3.2
<i>Genyonemus lineatus</i>	white croaker	1	79	10.0	10.0
<i>Halichoeres semicinctus</i>	rock wrasse	1	124	32.5	32.5
<i>Heterostichus rostratus</i>	giant kelpfish	1	176	46.1	46.1
<i>Menticirrhus undulatus</i>	California corbina	1	305	430	430.0
<i>Phanerodon furcatus</i>	white surfperch	1	115	56.0	56.0
<i>Pleuronichthys ritteri</i>	spotted turbot	1	175	163.7	163.7
<i>Pleuronichthys verticalis</i>	hornyhead turbot	1	55	3.7	3.7
<u>SHARKS/RAYS</u>					
<i>Urolophus halleri</i>	round stingray	25	100-450	50.0-634	8,199.8
<i>Gymnura marmorata</i>	California butterfly ray	12	256-568	150-1,714	6,682.1
<i>Myliobatis californica</i>	bat ray	6	258-420	230-2,189	5,049.5
<i>Heterodontus francisci</i>	horn shark	1	460	850	850.0
<i>Mustelus californicus</i>	gray smoothhound	1	975	1,800.0	1,800.0

(table continued)

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS005 (continued)

Survey Date: April 10, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
INVERTEBRATES					
<i>Pachygrapsus crassipes</i>	striped shore crab	38	8-43	0.1-45.1	125.2
<i>Cancer spp.</i>	cancer crabs	31	20-30	1.2-3.4	70.4
<i>Portunus xantusii</i>	Xantus' swimming crab	13	20-50	2.1-18.1	95.4
<i>Octopus bimaculatus</i>	California two-spot octopus	6	25-80	5.6-100	233.7
<i>Pugettia producta</i>	northern kelp crab	2	20-30	4.0-11.5	15.5
<i>Cancer antennarius</i>	brown rock crab	1	46	14.2	14.2
<i>Crangon nigromaculata</i>	spotted bay shrimp	1	60	3.7	3.7
Total:		7,219			

Encina Power Station Impingement Abundance: Heat Treatment Survey Data

Survey: EPSTS006

Survey Date: June 05, 2005

Taxon	Common Name	Survey Count	Length Range (mm)	Weight Range (g)	Total Weight (g)
FISHES					
<i>Anchoa compressa</i>	deepbody anchovy	8,144	29-130	1.3-24.3	95,729.6
<i>Cymatogaster aggregata</i>	shiner surfperch	5,779	37-100	1.1-28.1	50,780.1
<i>Atherinops affinis</i>	topsmelt	3,587	30-105	0.2-12.5	16,261.1
<i>Paralabrax maculatofasciatus</i>	spotted sand bass	869	52-204	3.2-255	82,072.6
<i>Paralabrax nebulifer</i>	barred sand bass	843	60-115	5.4-42.0	17,169.5
<i>Anisotremus davidsonii</i>	sargo	396	44-135	1.2-42.6	9,980.1
<i>Paralabrax clathratus</i>	kelp bass	372	45-136	2.1-63.1	8,328.2
<i>Hyperprosopon argenteum</i>	walleye surfperch	296	20-159	0.3-300	16,851.8
<i>Seriphus politus</i>	queenfish	204	26-170	2.1-105	2,053.4
<i>Porichthys myriaster</i>	specklefin midshipmar	161	190-440	49.3-1,085	35,440.5
<i>Xenistius californiensis</i>	salema	159	45-175	4.7-60.5	1,937.9
<i>Hypsoblennius gentilis</i>	bay blenny	88	50-100	2.4-19.0	853.0
<i>Chromis punctipinnis</i>	blacksmith	77	60-186	8.0-100	2,682.2
<i>Roncador stearnsi</i>	spotfin croaker	77	85-140	15.1-55.2	2,359.5
<i>Strongylura exilis</i>	California needlefish	50	260-543	28.4-294	5,815.3
<i>Hypsopsetta guttulata</i>	diamond turbot	45	121-300	146-374	9,509.2
<i>Phanerodon furcatus</i>	white surfperch	37	60-100	5.0-23.1	381.5
<i>Umbrina roncadore</i>	yellowfin croaker	29	95-125	16.3-42.7	889.7
<i>Sardinops sagax</i>	Pacific sardine	27	70-178	1.8-56.5	648.0
<i>Engraulis mordax</i>	northern anchovy	17	36-129	0.7-19.4	77.5
<i>Menticirrhus undulatus</i>	California corbina	11	125-388	30.4-806	2,034.7
<i>Fundulus parvipinnis</i>	California killifish	10	-	-	30.2
<i>Paralichthys californicus</i>	California halibut	10	72-264	6.7-172	854.2
<i>Heterostichus rostratus</i>	giant kelpfish	9	60-203	1.1-75.2	160.8
<i>Amphistichus argenteus</i>	barred surfperch	5	60-160	6.2-75.2	259.3
<i>Embiotoca jacksoni</i>	black surfperch	4	65-155	15.2-151	435.1
<i>Syngnathus</i> spp.	pipefishes	3	20-217	0.4-1.8	3.8
<i>Brachyistius frenatus</i>	kelp surfperch	2	115-130	23.1-51.9	75.0
<i>Girella nigricans</i>	opaleye	2	160-180	87.6-140.9	228.5
<i>Hypsypops rubicundus</i>	garibaldi	2	222-232	668-705	1,373.7
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	2	75	5.2-8.3	13.5
<i>Sphyræna argentea</i>	California barracuda	2	95-105	4.7-6.6	11.3
<i>Atractoscion nobilis</i>	white seabass	1	252	345.0	344.8
<i>Ophichthus zophochir</i>	yellow snake eel	1	650	347	347.0
<i>Pleuronichthys verticalis</i>	hornyhead turbot	1	197	248.0	247.7
<i>Trachurus symmetricus</i>	jack mackerel	1	200	75.8	75.8
Zoarcidae	eelpouts	1	152	17.1	17.1
SHARKS/RAYS					
<i>Urolophus halleri</i>	round stingray	363	105-239	54.3-800	118,389.8
<i>Gymnura marmorata</i>	California butterfly ray	41	244-609	182-1,629	22,997.3
<i>Myliobatis californica</i>	bat ray	23	226-649	205-1,925	15,585.9
<i>Mustelus californicus</i>	gray smoothhound	17	460-882	225-2,100	13,056.0
<i>Dasyatis dipterura</i>	diamond stingray	1	275	618.0	617.6
<i>Triakis semifasciata</i>	leopard shark	1	455	428.0	428.4
INVERTEBRATES					
<i>Cancer productus</i>	red rock crab	491	10-55	1.8-12.8	2,835.9
<i>Pachygrapsus crassipes</i>	striped shore crab	8	19-29	3.7-10.5	61.3
Majidae	spider crabs	6	10-15	2.1-5.2	20.2
<i>Octopus</i> spp.	octopus	2	20-45	9.7-86.2	95.9
<i>Pugettia producta</i>	northern kelp crab	2	22-30	2.4-5.4	7.8

Total: 22,279

CARLSBAD SEAWATER DESALINATION PROJECT

SAN DIEGO REGIONAL WATER QUALITY CONTROL BOARD

REGION 9, SAN DIEGO REGION

ORDER NO. R-9-2006-0065

NPDES NO. CA0109223

FLOW, ENTRAINMENT AND IMPINGEMENT MINIMIZATION PLAN

**ATTACHMENT 4 - PROPOSAL FOR INFORMATION COLLECTION CLEAN
WATER ACT SECTION 316(B), ENCINA POWER STATION, CABRILLO
POWER I LLC, NPDES PERMIT NO. CA0001350, APRIL 1, 2006.**

March 2, 2009

**PROPOSAL FOR INFORMATION COLLECTION
CLEAN WATER ACT SECTION 316(B)**

**ENCINA POWER STATION
CABRILLO POWER I LLC**

NPDES PERMIT No. CA0001350


Project No. 1009704003

April 1, 2006

Prepared for:

**Cabrillo Power I LLC
4600 Carlsbad Boulevard
Carlsbad, CA 92008**

Prepared by:


Shaw Shaw Environmental & Infrastructure, Inc.
3347 Michelson Drive, Suite 200
Irvine, CA 92612-1692


 **TENERA** Environmental
Tenera Environmental
141 Suburban Rd.
Suite A2
San Luis Obispo, CA 93401

Table of Contents

List of Figures.....	ii
List of Tables.....	ii
List of Attachments.....	iii
Acronyms and Abbreviations.....	iii
1.0 Introduction.....	1-1
1.1 Regulatory Applicability.....	1-2
1.2 Purpose.....	1-3
2.0 Facility Description.....	2-1
2.1 Facility Location.....	2-1
2.2 Source Water Body Description.....	2-2
2.2.1 Physical Characteristics.....	2-3
2.2.2 Agua Hedionda Lagoon Ecological Characteristics.....	2-4
2.2.3 Pacific Ocean Ecological Resources.....	2-5
2.3 Cooling Water Intake Structure Design.....	2-6
2.4 Cooling Water Intake Structure Operation.....	2-8
2.5 Calculation Baseline.....	2-9
3.0 Historical Studies.....	3-1
3.1 EPS Impingement Mortality and Entrainment Characterization Studies.....	3-1
3.1.1 1980 EPS 316(b) Demonstration.....	3-1
3.1.1.1 Entrainment.....	3-1
3.1.1.2 Impingement.....	3-5
3.1.2 1997 EPS Supplemental 316(b) Assessment Report.....	3-7
3.1.3 2004-2005 EPS 316(b) Demonstration.....	3-8
3.2 Survey of Ecological Resources of Agua Hedionda Lagoon (MEC Analytical Systems, Inc., 1995).....	3-9
4.0 Agency Consultations.....	4-1
5.0 Evaluation of Intake Technology Alternatives.....	5-1
5.1 Technologies Selected For Further Evaluation.....	5-2
5.1.1 Fish Screens, Fish Handling, and Return Systems.....	5-2
5.1.2 New Fine Mesh Screening Structure.....	5-3
5.2 Technologies Considered Infeasible and Eliminated From Further Evaluation.....	5-4
5.2.1 Replacement of Existing Traveling Screens with Fine Mesh Screens.....	5-4
5.2.2 Cylindrical Wedge-Wire Screens – Fine Slot Width.....	5-4
5.2.3 Fish Barrier Net.....	5-5
5.2.4 Aquatic Filter Barrier.....	5-5
5.2.5 Fine Mesh Dual Flow Screens.....	5-6
5.2.6 Modular Inclined Screens.....	5-7
5.2.7 Angled Screen System – Fine Mesh.....	5-8
5.2.8 Behavior Barriers.....	5-8
6.0 Evaluation of Operational Measures.....	6-1
6.1 Circulating Water Flow Reduction / Caps.....	6-1

Table of Contents (continued)

6.2	Variable Speed Drives For Circulating Water Pumps.....	6-2
6.3	Heat Treatment Operational Changes	6-2
7.0	Evaluation of Restoration Alternatives.....	7-1
7.1	Potential Restoration Measures	7-1
7.2	Project Selection Criteria.....	7-2
8.0	Other Compliance Options for EPS	8-1
8.1	Site-Specific Determination of BTA	8-1
8.1.1	Cost/Cost Test	8-2
8.1.2	Cost/Benefit Test.....	8-2
8.1.3	Evaluation of a Site-Specific BTA.....	8-4
8.2	Trading For Cooperative Mitigation Solutions	8-4
9.0	Impingement Mortality & Entrainment Sampling.....	9-1
9.1	Assessment of Cooling Water Intake System Effects.....	9-1
9.2	Target Species.....	9-3
9.3	Impingement	9-4
9.4	Entrainment.....	9-5
10.0	Summary	10-1
10.1	Evaluation of IM&E Reduction Measures.....	10-1
10.2	Impingement Mortality & Entrainment Sampling Plan	10-1
10.3	Agency Review of PIC	10-2
11.0	References	11-1

List of Figures

- Figure 2-1 Encina Power Station Location Map
 Figure 9-1 Location of EPS Entrainment (E1) and Source Water Stations (L1 through L4, and N1 through N5).

List of Tables

- Table 1-1 IM&E Performance Standards for Phase II Facilities
 Table 2-1 Design Characteristics of EPS Cooling Water Intake Structure
 Table 3-1 Critical Species Studied During 1979-1980
 Table 3-2 Average Annual Densities of the Ten Most Abundant Ichthyoplankton Taxa per 100 m³ (26,417 gal) In Source Water (lagoon and offshore stations combined) & Entrainment (pump sampling) Collections for 335µ Mesh Nets During 1979
 Table 3-3 Average Daily Entrainment Estimates at EPS Based On Daily Plant Circulating Water Flow of 795 MGD

Table of Contents (continued)

Table 3-4	Impingement Summary Of Fishes Collected During Normal And Heat Treatment Surveys Conducted From January 1979 To January 1980 at the EPS
Table 3-5	Mean Density per m ² and Percent Composition Of Fish Species Collected In Aqua Hedionda Lagoon During Two Surveys By Benthic Trawl, Beach Seine, And Otter Trawl
Table 4-1	Technical Advisory Group Meetings Held on Impingement Mortality and Entrainment Studies at EPS
Table 5-1	Fish Protection Technologies

List of Attachments

Attachment A	Structural Design Drawings
Attachment B	Correspondence Related to 316(b) Issues
Attachment C	Impingement Mortality & Entrainment Characterization Study Sampling Plan

Acronyms and Abbreviations

AEL	Adult Equivalent Loss
AFC	Application for Certification
AHL	Agua Hedionda Lagoon
amsl	above mean sea level
BTA	Best Technology Available
CCC	California Coastal Commission
CDFG	California Department of Fish & Game
CDS	Comprehensive Demonstration Study
CEC	California Energy Commission
CEQA	California Environmental Quality Act
CFR	Code of Federal Regulations
cfs	cubic feet per second
CWA	Clean Water Act
CWIS	Cooling Water Intake Structure
DCTP	Design & Construction Technology Plan
E	entrainment
EAM	Equivalent Adult Model
EPA	Environmental Protection Agency
EPRI	Electric Power Research Institute
EPS	Encina Power Station
ETM	Empirical Transport Model
FH	Fecundity Hindcasting
F&WS	Fish and Wildlife Service

Acronyms and Abbreviations (continued)

fps	feet per second
gpm	gallons per minute
HEA	Habitat Equivalency Analysis
hrs	hours
IM&E	Impingement Mortality and/or Entrainment
JWPCP	Joint Water Pollution Control Plant
MBC	MBC Applied Environmental Sciences
MGD	million gallons per day
mi	miles
min	minute
MLES	Marine Life Exclusion System
MLLW	mean lower low water
mm	millimeter
MW	megawatt
N	North
NMFS	National Marine Fisheries Service
NOAA	National Oceanic & Atmospheric Administration
NPDES	National Pollutant Discharge Elimination System
NRDA	National Resources Defense Council
O&M	Operation and Maintenance
OBGS	Ormond Beach Generating Station
PIC	Proposal for Information Collection
psig	pounds per square inch gauge
QA/QC	Quality Assurance/Quality Control
RP	Restoration Plan
SAP	sampling and analysis plan
SCE	Southern California Edison
SDG&E	San Diego Gas and Electric Company
SDRWQCB	San Diego Regional Water Quality Control Board
SGS	Scattergood Generating Station
TAG	Technical Advisory Group
TDD	Technical Development Document
TIOP	Technology Installation & Operation Plan
USFWS	U.S. Fish & Wildlife Service
W	West
y ³	cubic yard
°F	degrees Fahrenheit

1.0 Introduction

Section 316(b) of the Clean Water Act (CWA) requires that the location, design, construction, and capacity of cooling water intake structures (CWIS) reflect the best technology available (BTA) to minimize adverse environmental impacts due to the impingement (IM) of aquatic organisms (i.e., fish, shellfish, and other forms of aquatic life) on intake structures and the entrainment (E) of eggs and larvae through cooling water systems. On July 9, 2004, the U.S. Environmental Protection Agency (EPA) promulgated regulations in the Federal Register applicable to large existing power plants (Phase II facilities) that use large amounts of cooling water. These regulations, published in the Code of Federal Regulations (CFR) Chapter 40 Part 125 Subpart J, became effective on September 7, 2004.

The Phase II regulations establish performance standards for CWIS of existing power plants that withdraw more than 50 million gallons per day (MGD) of surface waters and use more than 25 percent of the withdrawn water for cooling purposes. The new rule requires all large existing power plants to reduce impingement mortality by 80 – 95 percent and to reduce the number of smaller aquatic organisms drawn through the cooling system by 60 – 90 percent. The water body type on which the facility is located, the capacity utilization rate, and the magnitude of the design intake flow relative to the waterbody flow determine whether a facility will be required to meet the performance standards for IM or both IM&E. The final rule allows these performance standards to be met through using a combination of the existing intake design, additional intake technologies, operational modifications, and using restoration measures. This approach also provides flexibility by allowing site-specific performance standards, if economic conditions do not justify the full cost of meeting the standards.

The EPA 316(b) Phase II rule requires that each affected facility develop and submit a *Proposal for Information Collection (PIC)* to the applicable permitting agency prior to implementation of data collection activities. The PIC must include the following key elements:

- A description of the proposed and/or implemented technologies, operational measures, and/or restoration measures to help develop a compliance strategy to meet the performance standards;
- A description of any historical studies characterizing IM&E and/or the physical and biological conditions in the vicinity of the CWIS and their relevance to the proposed study;
- A summary of any past or ongoing consultations with regulatory agencies and other stakeholders that are relevant to the study; and

- A sampling and analysis plan (SAP) for any new field studies needed to estimate IM&E.

This PIC serves as a study plan for a Comprehensive Demonstration Study (CDS), which provides the information to:

- Determine the baseline calculations of IM&E to be compared with performance standards;
- Evaluate combinations of technologies, operational measures and/or restoration measures, which may be implemented to meet the performance standards; and
- Evaluate whether a site-specific BTA determination is warranted and can be justified using a cost/cost or cost/benefit test.

1.1 Regulatory Applicability

The Encina Power Station (EPS) is located adjacent to the *Agua Hedionda Lagoon* (or AHL) on the Pacific Ocean. Because of its location near the ocean, the facility is subject to the following national performance standards (Table 1-1) for the reduction of IM&E resulting from the operation of the CWIS:

Table 1-1
IM&E Performance Standards for Phase II Facilities

Standard	Reduction Requirement
Impingement mortality	80 - 95%
Entrainment	60 - 90%

The EPA 316(b) Phase II rule generally requires that facilities subject to the rule submit the CDS with the application for renewal of the National Pollutant Discharge Elimination System (NPDES) permit. Facilities with NPDES permits expiring prior to July 9, 2008 may request an extension for submittal of the CDS no later than January 7, 2008. The current EPS NPDES permit has expired on February 5, 2005. A timely application for renewal was submitted to the San Diego Regional Water Quality Control Board (SDRWQCB) on June 23, 2004. The EPS has submitted a letter to the SDRWQCB on January 6, 2005 requesting the following schedule for submittal of the two reports required under the EPA 316(b) Phase II Rule:

- Proposal for Information Collection – submittal due April 1, 2006
- Comprehensive Demonstration Study – submittal due January 7, 2008

1.2 Purpose

The purpose of this document is to meet or exceed the requirement for the preparation and submittal of the PIC in accordance with 40 CFR 125.95(b)(1). This Plan is being submitted for agency review and comment in advance of implementation. However, information collection activities may be initiated prior to receipt of agency comments.

2.0 Facility Description

The EPS has been owned and operated by Cabrillo Power I LLC (Cabrillo) since May 22, 1999. The power plant was previously owned by San Diego Gas and Electric Company (SDG&E).


The EPS is a fossil-fueled steam electric power generating station that began operation in 1954. Thermal energy provided by the combustion of the fossil-fuels is used to generate steam to drive five steam turbine generators. The plant also has one air-cooled gas turbine generator achieving a combined nominal thermal energy output capacity for the plant of 939 megawatts. Waste heat generated at EPS is discharged to the Pacific Ocean. The combined cooling and service water design flow is 857.29 MGD.

Cooling water is withdrawn from the Pacific Ocean via the AHL. The cooling water intake structure complex is located approximately 2200 feet from the ocean inlet to the lagoon. Variations in the water surface due to tide range from a low of -3.52 feet to a high of +4.79 feet [elevation "0" being mean sea level, (msl)], based on measurements made by Coastal Environments (2005). The intake structure is located in the lagoon, in front of the generating units.

2.1 Facility Location

The EPS is located at 4600 Carlsbad Boulevard, in the southwest area of the City of Carlsbad, California, adjacent to the AHL on the Pacific Ocean in Section 18, Township 12 South, Range 4 West of the San Bernardino Baseline Meridian. Figure 2-1 depicts the location of the facility and the location of the cooling water intake and discharge points relative to the shoreline.

Figure 2-1
Encina Power Station Location Map



2.2 Source Water Body Description

The environmental setting of AHL, the primary source water body for the EPS, is discussed in detail in Bradshaw et al (1976), SDG&E (1980), and summarized in EA Engineering, Science and Technology (1997). The following is a description of the physical and ecological characteristics of the AHL, on which the EPS is located.

2.2.1 Physical Characteristics

Agua Hedionda is the third largest watershed within the Carlsbad Hydrologic Unit. The watershed, dominated by Agua Hedionda Creek, extends approximately 10.62 miles (mi) inland from the coast and is about 18,837 acres in area, comprising 14 percent of the Carlsbad Hydrologic Unit. Agua Hedionda Creek originates on the southwestern slopes of the San Marcos Mountains in west central San Diego County and discharges into the Pacific Ocean via AHL. The highest elevation within the watershed is 1,500 feet above mean sea level (amsl), located in the San Marcos Mountains.

The EPS is located on the AHL, which is a man-enhanced coastal lagoon that extends 1.7 mi inland and is up to 0.5 mi wide. The lagoon is located along the Pacific Coast in San Diego County approximately 26 mi north of the City of San Diego. The lagoon was constructed in 1954 to provide cooling water for the power plant. The construction enhancement involved a permanent opening of the connection of the lagoon with the ocean. Prior to this, the lagoon was ephemerally connected to the ocean when creek flows were high. A railroad trestle and the Interstate Highway 5 bridge separate AHL into three interconnected segments: an Outer, Middle, and Inner lagoon. The surface areas of the Outer, Middle, and Inner lagoons are 53, 24, and 190 acres, respectively based on measurements made by Coastal Environments (2005). The lagoon is separated from the ocean by Carlsbad Boulevard and a narrow inlet 151 feet wide and 9 feet deep at the northwest end of the Outer Lagoon that passes under the highway and allows tidal exchange of water with the ocean.

Circulation and input into AHL is dominated by semi-diurnal tides that bring approximately 1,454 acre feet of seawater through the entrance to the Outer Lagoon on flood tides based on measurements made by Coastal Environments (2005). Approximately half of this tidal volume flows into the Middle and Inner lagoons. On ebb tides this same tidal volume flows out through the entrance to the ocean. As a result of this tidal flushing, the lagoon is largely a marine environment. Although freshwater can enter the lagoon through Agua Hedionda Creek, which drains an 18,500 acre watershed, for most of the year freshwater flow is minimal. Heavy rainfall in the winter can increase freshwater flows, reducing salinity, especially in the Inner Lagoon. The lagoon system is kept open to the ocean by routine dredging of the Outer Lagoon and the channel to the ocean.

Bottom sediments in the lagoon reflect the speed and location of the periodic tidal currents. The Outer Lagoon sediments consist of coarser gravel and sands in areas of highest current velocities. The Middle Lagoon consists of an inter-tidal zone largely comprised of mud. The largest water body segment, the Inner Lagoon, consists of mostly finer sands, silt, and clay with organic detritus, especially at the far eastern end of the lagoon. Some narrow sand beaches and rock rip-rap substrate are also present in the Inner Lagoon.

AHL is tidally flushed through the small inlet in the Outer Lagoon by waters from the Pacific Ocean. The physical oceanographic processes of the southern California Bight that influence the lagoon includes, the tides, currents, winds, swell, temperature, dissolved oxygen, salinity, nutrients. These are most affected by the daily tidal exchange of coastal seawater. Near the mouth of the lagoon the mean tide range is 3.7 feet with a diurnal range of 5.3 feet. Waves breaking on the shore generally range in height from 2 to 4 feet, although larger waves (6 to 10 feet) are not uncommon. Larger waves exceeding 15 feet occur infrequently and are usually associated with winter storms. Surface water in the local area ranges from a minimum of 57 degrees Fahrenheit (°F) to a maximum of 72°F with an average annual temperature between 63°F and 66°F.

2.2.2 Agua Hedionda Lagoon Ecological Characteristics

The AHL is listed by the State of California as a Section 303(d) impaired waterbody largely due to sedimentation/siltation and coliform contamination resulting from multiple non-point source discharges in Agua Hedionda watershed. Sedimentation of the lagoon can occur both from sediment flows within the watershed and from tidal flows from the Pacific Ocean. The bacterial contamination is likely from multiple sources within the watershed.

In November of 2000, the U. S. Fish and Wildlife Service (F&WS), under the Endangered Species Act of 1973, as amended, designated AHL as critical habitat for the tidewater goby (*Eucyclogobius newberryi*), a federally listed endangered species. However, no tidewater gobies have been observed in the AHL since the 1950's when the lagoon was originally dredged as the power plant cooling water source and the lagoon is no longer viable habitat for the species. Based on that fact, Cabrillo Power I LLC filed for declaratory and injunctive relief in federal district court on August 31, 2001, against the F&WS for failing to base the AHL and Creek critical habitat designation on best scientific data and failing to analyze the economic and other impacts of the designation. On February 28, 2003, based upon a stipulated settlement, the United States District Court ordered that the tidewater goby critical habitat designation for AHL and Creek be vacated without prejudice.

Land use within the watershed is dominated by urban development. Natural habitats are scattered and occur in a matrix of agricultural and urban development, however, several relatively large patches of native vegetation occur in the eastern portion of the watershed and in the central area just inland from AHL.

A study on the ecological resources of Agua Hedionda showed that it has good water quality and supports diverse benthic infauna, bird, and fish communities (MEC Analytical 1995). Eelgrass was found in all three lagoon segments, but was limited in the Inner Lagoon to depths above approximately -6.5 feet mean lower low water (MLLW) because water turbidity reduced penetration of light for photosynthesis in deeper areas. The eelgrass beds provide a valuable

habitat for benthic organisms that are fed upon by birds and fishes. Although eelgrass beds were less well developed in areas of the Inner Lagoon, it was found to provide a wider range of habitats, including mud flats, salt marsh, and seasonal ponds than elsewhere in Agua Hedionda. As a result, bird and fish diversity was highest in the Inner Lagoon.

A total of 35 species of fishes was found during the 1994 and 1995 sampling conducted by MEC (MEC Analytical 1995). The Middle and Inner lagoons had more species and higher abundances than the Outer Lagoon. During the 1995 survey, only four species were collected in the Outer Lagoon, compared to 14 to 18 species in the Middle and Inner lagoons. Silversides (Atherinopsidae) and gobies (Gobiidae) were the most abundant fishes collected. Silversides, including jacksmelt and topsmelt, that occur in large schools in shallow waters where water temperatures are warmest were most abundant in the shallower Middle and Inner lagoons. Gobies were most abundant in the Inner Lagoon, which has large shallow mudflat areas that are their preferred habitat.

An impingement and entrainment study was conducted at EPS in 1979-1980 (SDG&E 1980). In the impingement study, fishes and invertebrates were collected and quantified from the traveling screens and bar rack system of the power plant. Seventy-six species of fishes, 45 species of macroinvertebrates, and 7 species of algae and marine plants were impinged. There were also seven thermal treatments (intake tunnel heat shock treatments) sampled during the year and 90 percent of the fishes collected consisted of nine species: deepbody anchovy, topsmelt, northern anchovy, shiner surfperch, California grunion, walleye surfperch, queenfish, round stingray, and giant kelpfish.

The recent assessment of the ecological resources of Agua Hedionda (MEC Analytical 1995) did not find any tidewater gobies (*Eucyclogobius newberryi*). This federally endangered species was once recorded as occurring in the lagoon prior to construction of the Outer Lagoon in the early 1950s. The present marine-influenced environment in the lagoon would not tend to support tidewater gobies because they prefer brackish water habitats. No listed fish species were collected in the recent study.

2.2.3' Pacific Ocean Ecological Resources

The outer coast has a diversity of marine habitats and includes zones of intertidal sandy beach, subtidal sandy bottom, rocky shore, subtidal cobblestone, subtidal mudstone and water column. Organisms typical of sandy beaches include polychaetes, sand crabs, isopods, amphipods, and clams. California grunion utilize the beaches around EPS during spawning season from March through August. Numerous infaunal species occur in subtidal sandy bottoms with mollusks, polychaetes, arthropods, and echinoderms comprising the dominant invertebrate fauna. Typical fishes in the sandy subtidal include queenfish, white croaker, several surfperch species, speckled sanddab, and California halibut. Also, California spiny lobster and *Cancer* spp. crabs forage over

the sand. Many of the typically outer coast species can occasionally occur within AHL, carried by incoming tidal currents.

The rocky habitat at the discharge canal and on offshore reefs supports various kelps and invertebrates including barnacles, snails, sea stars, limpets, sea urchins, sea anemones, and mussels. Giant kelp (*Macrocystis*) forests are an important community in the area offshore from Agua Hedionda. Kelp beds provide habitat for a wide variety of invertebrates and fishes. The water column and kelp beds are known to support many fish species, including northern anchovy, jack smelt, queenfish, white croaker, garibaldi, rockfishes, kelp bass, white seabass, surfperches, and halibut.

Marine-associated wildlife that occur in the Pacific waters off AHL are numerous and include birds such as brown pelican, surf scoter, cormorants, western grebe, gulls, terns and loons. Marine mammals, including porpoise, sea lions, and migratory gray whales, also frequent the adjacent coastal area.

2.3 Cooling Water Intake Structure Design

Cooling water is withdrawn from the Pacific Ocean via the AHL. The CWIS complex is located approximately 2,200 feet from the ocean inlet to the lagoon. The intake structure is located on the lagoon, to the north of the generating units as shown on Figure A-1 included in Appendix A.

As the water flows into the intake structure, it passes through trash racks made up of metal bars spaced about 3½ inches apart, which prevent passage of large debris into the intake. The trash rack inlet structure is shown on Figure A-2 included in Appendix A. The intake downstream of the trash rack tapers into two, 12-foot wide intake tunnels. From these tunnels, the cooling water enters four six-foot wide conveyance tunnels. Cooling water for conveyance tunnels 1 and 2 passes through one of two vertical traveling screens to prevent fish, grass, kelp, and debris from entering pump intakes for generating units 1, 2, and 3.

Conveyance tunnels 3 and 4 carry cooling water to the intakes for generating units 4 and 5, respectively. Traveling water screens are located at the intake of pump 4 and the intake of pump 5. A detailed plan layout of the entire tunnel system is shown on Figure A-1 included in Appendix A.

Each cooling water intake consists of two circulating water pumps and one or two service pumps. During normal operation, one circulating water pump serves each half of the condenser, so when a unit is generating power, both pumps are in operation.

There are a total of seven traveling screens that remove any debris which has passed through the trash racks. Two screens service the combined flows of generating Units 1, 2, and 3. Unit 4 has two traveling water screens, while Unit 5 has three traveling water screens. The screens are

conventional through-flow, vertically rotating, single entry, band-type screens, mounted in the screen wells of the intake channels. Each screen consists of a series of baskets or screen panels attached to a chain drive. Since the screens are designed to prevent the passage of particles large enough to clog the condenser tubes, the screening surface is made of 3/8-inch meshed stainless steel wire, with the exception of Unit 5 screens, which have 5/8-inch square openings. Cooling water passes through the wire mesh screening surface and floating or suspended matter is retained on the screens. The screens rotate automatically when the debris buildup causes a predetermined pressure differential across the screen (or the difference in sea water level before and after the screen increases to a set level). As the screens revolve, the material is lifted from the front of the intake screenwell by the upward travel of the baskets. The screens travel 3 feet per minute, making one complete revolution in about 20 minutes. A screen wash system in the traveling screen structure provides water (sea water from the intake tunnel) to wash the debris from the traveling screen. At the head of the screen, matter is removed from the baskets by a spray of water, which is evenly distributed over the entire basket width. The jet spray washes the accumulated material into a trough and the trough conveys the debris into debris collection baskets. Accumulated organic debris is discharged to the outfall structure.

Characteristics and specifications of the CWIS are presented in Table 2-1.

Table 2-1
Design Characteristics of EPS Cooling Water Intake Structure

	<u>Unit 1</u>	<u>Unit 2</u>	<u>Unit 3</u>	<u>Unit 4</u>	<u>Unit 5</u>
Latitude	33° 08' 16" N	33° 08' 16" N	33° 08' 16" N	33° 08' 16" N	33° 08' 16" N
Longitude	117° 20' 16" W	117° 20' 16" W	117° 20' 16" W	117° 20' 16" W	117° 20' 16" W
Number of circulating water pumps	2	2	2	2	2
Pump capacity (per pump)	24,000 gpm	24,000 gpm	24,000 gpm	100,000 gpm	104,000 gpm
Service water	3000 gpm	3000 gpm	6000 gpm	13,000 gpm	18,200 gpm
Trash bar opening	3 ½ inch	3 ½ inch	3 ½ inch	3 ½ inch	3 ½ inch
Number of traveling water screens	2 (shared)	2 (shared)	2 (shared)	2	3
Screen type	Standard through flow	Standard through flow	Standard through flow	Standard through flow	Standard through flow
Screen mesh opening	3/8 inch	3/8 inch	3/8 inch	3/8 inch	5/8 inch
Screen height (in water, high tide)	24.8 feet	24.8 feet	24.8 feet	24.8 feet	24.8 feet
Approach velocity (low tide)	1.2 fps	1.2 fps	1.2 fps	1.6 fps	1.1 fps
Through-screen velocity (low tide)	2.1 fps	2.1 fps	2.1 fps	2.9 fps	2.0 fps
Screen rotation	Automatic on ΔP	Automatic on ΔP	Automatic on ΔP	Automatic on ΔP	Automatic on ΔP
Screen wash pressure	70 psig	70 psig	70 psig	70 psig	70 psig

2.4 Cooling Water Intake Structure Operation

During normal operation, one circulating water pump serves each half of the condenser, so when a unit is generating power, both pumps are in operation.

Traveling water screens normally are set on automatic, starting up when the differential pressure across the screen exceeds the set point. At the beginning of each work shift (0600, 1800), the screens are turned on and the automatic start is checked to ascertain that the screens are functioning properly.

The plant produces its own sodium hypochlorite electrolytically from seawater for use in chlorination of the cooling water system. A bromide additive (sodium bromide), which reacts

with chlorine to form hypobromous acid, and a bio-dispersant are also used with the sodium hypochlorite as enhancers.

The treatment solution is injected to the channel immediately upstream of the once-through cooling water and saltwater service pump suctions for each unit. Each injection point is individually controlled. Chlorination is conducted for about five minutes per hour per unit on a timed cycle each day. This method of chlorination results in a minimal chlorine residual in the cooling water being discharged to the ocean.

The intake tunnels are thermally treated (tunnel re-circulation) approximately every five weeks. Encrusting organisms in the early stages of development are small enough to pass through the trash racks and screens and enter the intake tunnels, attach themselves to the tunnel walls, traveling water screens, and other parts of the cooling-water system. If not removed, the encrusting organisms grow and accumulate at a rate of approximately 1000 yd³ over a six-month period. These accumulations restrict the flow of cooling water to and through the condensers, causing a rise in the condenser operating temperature and the temperature of the discharged circulating water. A thermal tunnel re-circulation treatment process prevents encrusting organisms from developing to any significant size or quantity. The treatment causes the encrusting organisms to release from the surfaces and wash through the condensers to the ocean with the circulating water discharge, reducing the need for maintenance outages for normal cleaning of the circulating water inlet tunnels and condensers. This practice also helps to maintain the lowest possible temperature rise across the condensers, thereby improving plant efficiency and reducing thermal load to the ocean.

Thermal treatment is performed by restricting the flow of cooling water from the lagoon and re-circulating the condenser discharge water through the conveyance tunnels and condensers until an inlet water temperature of approximately 105°F is attained. Maintaining a temperature of 105°F in the intake tunnels for approximately two hours has proven to be effective in removing encrusting organisms. The total time required for the thermal treatment operation, including temperature buildup and cool down, is approximately six hours.

2.5 Calculation Baseline

EPA, in its 316(b) Phase II rule for existing facilities, requires reductions in IM&E when compared against a "calculation baseline." This calculation baseline is the level of IM&E that would occur if the CWIS were designed with the following characteristics:

- Once-through cooling system;
- Opening of CWIS located at, and the face of the traveling screens is oriented parallel to, the shoreline near the surface of the source waterbody;

- Conventional traveling screens with 3/8 inch mesh; and
- No structural or operational controls to reduce IM&E.

The EPS intake system is equivalent in terms of entrainment of aquatic organisms and impingement of organisms on screens to the baseline shoreline intake with no fish protection features defined by the Environmental Protection Agency in the new Section 316(b) Phase II Existing Facilities Rule (National Pollutant Discharge Elimination System-Final Regulations). The EPS CWIS design has a few deviations from these baseline conditions. The traveling water screens on Unit 5 have 5/8" screens and each of the 7 sets of traveling water screens are set well back from the shoreline of the lagoon. The recent IM&E study performed at the EPS will provide the necessary information for determining a representative calculation baseline for the station.

3.0 Historical Studies

EPA Phase II 316(b) regulations [40 CFR 125.95(b)(1)(ii)] require that the PIC includes a list and description of any historical studies characterizing IM&E, as well as physical and biological conditions in the vicinity of the facility CWIS. The following sections provide a summary of previous entrainment and impingement studies conducted at the EPS and within AHL.

The following sections also present a discussion of the relevance of the data to the current conditions and the IM&E studies at the EPS.

3.1 EPS Impingement Mortality and Entrainment Characterization Studies

The following sections summarize previous IM&E characterization studies performed at the EPS.

3.1.1 1980 EPS 316(b) Demonstration

In 1980, SDG&E owned and operated the EPS (SDG&E, 1980). A 316(b) demonstration was conducted for the facility (SDG&E 1980) as required at the time by the SDRWQCB. The study included descriptions of the facility, descriptions of the physical and biological environment of AHL and surroundings, studies of entrainment, impingement, and entrainment survival at the plant, and an environmental impact assessment that also evaluated the feasibility of alternative intake technologies to reduce IM&E.

A list of taxa ("critical species") that included 16 fishes, 11 ichthyoplankton, and one zooplankter, were selected based on six criteria and approved by the SDRWQCB for detailed study during the program (Table 3-1). Some additional species that were found to be common in the subsequent sampling were also added to the list. The report reviewed the life histories of the critical species.

3.1.1.1 Entrainment

A one-year entrainment and source water characterization study was conducted beginning in 1979 as part of the 316(b) demonstration studies at the EPS. Plankton samples were collected monthly at five offshore stations using 505 and 335 micron mesh nets attached to a 2 feet diameter bongo net system. Collections were also made monthly in the Middle and Upper lagoon segments and every two weeks in the Outer Lagoon using 1.6 feet diameter nets (505 and 335 micron mesh size). The procedures specified the use of a depressor weight connected to the towing apparatus but there was no indication at what depths the plankton samples were typically taken. Tows were targeted at 10 minutes at a speed of 1.5 to 2 knots. Entrainment samples were also collected every two weeks using a plankton pumping system in front of the intakes.

Although most samples were collected during daylight hours some samples were occasionally taken in the evening or early morning hours.

Table 3-1
Critical Species Studied During 1979-1980

"Critical Species"	Common Name
<i>Adult fishes</i>	
<i>Engraulis mordax</i>	northern anchovy
<i>Atherinops affinis</i>	topsmelt
<i>Paralabrax clathratus</i>	kelp bass
<i>Paralabrax maculatofasciatus</i>	potted sand bass
<i>Paralabrax nebulifer</i>	barred sand bass
<i>Cynoscion nobilis</i>	white seabass
<i>Menticirrhus undulatus</i>	California corbina
<i>Seriophus politus</i>	queenfish
<i>Amphistichus argenteus</i>	barred surfperch
<i>Hyperprosopon argenteum</i>	walleye surfperch
<i>Semicossyphus pulcher</i>	California sheephead
<i>Mugil cephalus</i>	striped mullet
<i>Citharichthys sordidus</i>	Pacific sanddab
<i>Paralichthys californicus</i>	California halibut
<i>Pleuronichthys verticalis</i>	hornyhead turbot
<i>Heterostichus rostratus</i>	giant kelpfish
<i>Ichthyoplankton</i>	
<i>Anchoa compressa</i>	deepbody anchovy
<i>Engraulis mordax</i>	northern anchovy
Cottidae	sculpins
Serranidae	sea basses
Sciaenidae	croakers
<i>Coryphopterus nicholsi</i>	blackeye goby
Gobiidae	gobies
<i>Citharichthys stigmaeus</i>	spotted sanddab
<i>Paralichthys californicus</i>	California halibut
Pleuronectidae	righteye flounders
<i>Hypsopsetta guttulata</i>	diamond turbot
Atherinopsidae	silversides
<i>Zooplankton</i>	
<i>Acartia tonsa</i>	copepods

Anchovies (primarily deep body and northern) were the most abundant larval forms in both the source water and entrainment samples, followed by croakers and sanddabs (Table 3-2). There were fewer fish eggs and more goby larvae in the entrainment samples whereas kelp and sand bass larvae were substantially more abundant in the combined source water samples from the Lagoon and offshore. Overall the average composition between the entrainment and source water data sets were very similar for the ten most abundant taxa. Only English sole, *Parophrys vetulus*, larvae were among the top ten entrainment taxa not represented in the top ten source water taxa.

Table 3-2

Average Annual Densities of the Ten Most Abundant Ichthyoplankton Taxa per 100 m³ (26,417 gal) In Source Water (lagoon and offshore stations combined) & Entrainment (pump sampling) Collections for 335μ Mesh Nets During 1979

	Taxon	Source Water	Entrainment
anchovies	Engraulidae	952.7	855.2
croakers	Sciaenidae	341.7	400.6
speckled sanddab	<i>Citharichthys</i> sp.	73.2	82.7
fish eggs	unidentified fish egg	33.8	20.2
gobies	Gobiidae	29.2	42.9
silversides	Atherinidae	8.3	10.8
wrasses	Labridae	6.4	4.0
combtooth blennies	<i>Hypsoblennius</i> sp.	6.1	5.7
sea basses	Serranidae	5.1	0.9
rockfishes	<i>Sebastes</i> sp.	2.8	2.5
English sole	<i>Parophrys vetulus</i>	0	1.9

Note: English Sole not collected in source waterbody.

Entrainment losses were calculated for each two-week sampling interval by multiplying the average plankton densities at the intake by the volume of cooling water drawn through the plant during that period. Annual, monthly, and daily rates were estimated by averaging the entrainment estimates for all sampling periods and calculating values for the indicated duration. Annual estimates for total zooplankton entrainment were 7.4×10^9 (505μ net data) and 30.9×10^9 (335μ net data) individuals. The copepod *Acartia tonsa* was the most abundant species in the entrainment collections (Table 3-3).

Annual estimates of the abundance of ichthyoplankton entrained through the power plant were 4.15×10^9 (505 μ net data) and 6.66×10^9 (335 μ net data) individuals per year. Fish eggs comprised 98 percent and 86 percent of the total annual ichthyoplankton entrainment using the 505 μ and 335 μ net estimates, respectively. Through-plant entrainment mortality was assumed to be 100% for larvae and 60% for eggs based on survival experiments that were conducted. The report presented average annual densities of the critical species by net type and daily entrainment estimates for selected plankton groups (Table 3-3).

Table 3-3
Average Daily Entrainment Estimates at EPS Based On Daily Plant Circulating Water Flow of 795 MGD

Plankton Group	Daily Entrainment		Mean Percent
	335 μ	505 μ	of Total
<i>Acartia tonsa</i> (copepod)	4.77×10^7	7.63×10^6	41.2%
fish eggs	1.57×10^7	1.11×10^7	19.9%
Decapoda	1.32×10^7	4.44×10^6	13.1%
other Copepoda	8.47×10^6	2.16×10^6	7.9%
other Crustacea	6.95×10^6	2.70×10^6	7.2%
other Zooplankton	5.68×10^6	4.55×10^5	4.6%
Chaetognatha	1.83×10^6	1.56×10^5	2.5%
fish larvae	2.52×10^6	2.46×10^5	2.1%
Mysidacea	6.70×10^5	1.34×10^5	1.5%
			100.0%

Entrainment impacts were assessed by qualitative comparisons of entrainment losses to the estimated numbers of larvae in nearby source waters, comparisons of additional power plant mortality to natural mortality rates, entrainment probabilities based on current studies, and primary productivity studies. It was concluded that the entrainment of 1.82×10^7 fish larvae and eggs daily was small compared to the egg and larval concentrations measured in monthly plankton tows in the source water body. It was estimated that average daily losses of planktonic organisms amounted to about 0.2% of the plankton available within one day's travel time from the power plant by current transport. At the seaward entrance to AHL, a water parcel was estimated to have a 34% probability of entering the lagoon. The 10% probability of entrainment isopleth was calculated to lie near the northern and eastern extremities of AHL, and the 70% and 90% entrainment probability isopleths were calculated to be near the intakes and well within the

southern third of the Outer Lagoon. The modeled isopleths shifted toward the seaward entrance on a flood tide and toward the Middle Lagoon on an ebb tide. Using the 70% entrainment probability isopleth to define intake effects, it was shown that the maximum extent of intake effects was about 1000 feet into the southern end of the Outer Lagoon segment. With natural mortality rates assumed to be 99% for egg and larval stages of most marine fish species it was concluded that additional mortality from the EPS was not significant. There was no modeling of entrainment impacts on larvae using demographic or proportional loss models. It was also concluded, based on results of light-dark bottle experiments, that entrainment effects on source water primary productivity were negligible.

3.1.1.2 Impingement

Impingement of fishes and invertebrates on the traveling screens and bar rack system of the EPS were monitored daily during normal operations for 336 consecutive days in 1979. The main method was to obtain abundance and weights from samples accumulated over two 12-hour periods (daylight and night) each day for all three screening systems at the plant. During this period there were a total of 79,662 fishes from 76 taxonomic categories weighing a total of 3,076 lbs collected (Table 3-4). The six highest-ranking fishes by numbers impinged were queenfish, deepbody anchovy, topsmelt, California grunion, northern anchovy, and shiner surfperch. These are all open water forms that occur in schools. These six species represented 82% of all fishes impinged during normal operations sampling.

There were also seven heat treatments conducted during the study period. Heat treatments are operational procedures designed to eliminate mussels, barnacles, and other fouling organisms growing in the cooling water conduit system. During a heat treatment, heated effluent water from the discharge is redirected to the intake conduit via cross-connecting tunnels until the water temperature rises to approximately 105°F in the screenwell area. This water temperature is maintained for at least one hour, during which time all biofouling organisms, as well as fishes and invertebrates living within the cooling water system, succumb to the heated water. During heat treatment surveys, all material impinged onto the traveling screens are removed from the forebay. Fishes and macroinvertebrates were separated from incidental debris, identified, and counted. During the 1979 studies, the total weight of fishes impinged during these operations was 5,340 lb (Table 3-4). Over 90% of the fishes collected consisted of nine species: deepbody anchovy, topsmelt, northern anchovy, shiner surfperch, California grunion, walleye surfperch, queenfish, round stingray, and giant kelpfish. The numbers of fishes resident in the tunnels during heat treatments was greatest in winter and least in summer.

Macroinvertebrates that ranked high in the total numbers impinged included yellow crab (*Cancer anthonyi*) with 2,540 individuals, swimming crab (*Portunus xantusii*) with 884, lined shore crab (*Pachygrapsus crassipes*) with 866, and market squid (*Loligo opalescens*) with 522. The yellow crab and market squid both have commercial fishery value whereas the other two species are

small and are not fished commercially. California spiny lobster, the most valuable invertebrate in the local commercial fishery, was rare in the samples with only two individuals impinged during the entire year-long study period.

Table 3-4
Impingement Summary Of Fishes Collected During Normal And Heat Treatment Surveys
Conducted From January 1979 To January 1980 at the EPS

Common Name	Scientific Name	Normal		Heat Treatment	
		Count	Weight (lb [kg])	Count	Weight (lb [kg])
queenfish	<i>Scorpaenopsis diabolus</i>	18,681	201 (91.3)	3,483	212 (96.3)
deepbody anchovy	<i>Anchoa compressa</i>	13,299	142 (64.3)	23,142	402 (182.2)
topsmelt	<i>Atherinops affinis</i>	10,915	248 (112.3)	21,788	366 (166.1)
California grunion	<i>Leuresthes tenuis</i>	8,583	75 (33.8)	9,671	180 (81.7)
northern anchovy	<i>Engraulis mordax</i>	7,434	32 (14.6)	19,567	207 (94.0)
shiner surfperch	<i>Cymatogaster aggregata</i>	6,545	118 (53.3)	12,326	607 (275.5)
walleye surfperch	<i>Hyperprosopon argenteum</i>	1,877	111 (50.4)	8,305	1153 (522.8)
white surfperch	<i>Phanderodon furcatus</i>	1,751	37 (17.0)	604	19 (8.6)
round stingray	<i>Urolophus halleri</i>	1,686	410 (185.9)	1,685	891 (404.2)
California halibut	<i>Paralichthys californicus</i>	1,215	126 (57.1)	329	117 (53.0)
all others		7,676	1,577 (715.2)	7,200	1,366 (619.7)
Total		79,662	3,076 (1,395.2)	108,102	5,340 (2,422.4)

Note: The top 10 species by number are listed.

Impacts caused by impingement were assessed by comparing the numbers and biomass of fishes lost to plant operations to the abundance and biomass of fishes resident in the nearby source waters of AHL, nearshore habitats, and the San Diego coastal area. Samples of adult and juvenile fishes in the nearby source water were collected monthly with beach seines, otter trawls and gill nets. Seventeen of the 27 fish species were taken by all three types of gear. The role of gear selectivity in determining actual population sizes of the critical species was recognized. The ten most abundant species collected by all types of gear were California grunion (49%), topsmelt (17%), deepbody anchovy (7%), slough anchovy (6%), northern anchovy (3%), queenfish (3%), walleye surfperch (2%), speckled sanddab (2%), shiner surfperch (1%), and California halibut (1%). Most of the species removed by the power plant are widespread along the southern California and Baja California coasts and losses were small relative to these populations. On a local scale, it was calculated that the average daily power plant removal, including normal operations and heat treatment operations averaged throughout the year, was about 0.02% of the

estimated standing crop in the local study area that extended along a shoreline distance of 3.6 miles out to a depth of 60 feet (1,211 acres). The removals also represented about 0.07% of local commercial fish landings by weight (excluding tuna) from the area between San Clemente and the Mexican border, and less than 7% of the recreational fishing landings by numbers annually in the area between Dana Point and the Mexican border.

3.1.2 1997 EPS Supplemental 316(b) Assessment Report

The SDRWQCB issued Order 94-58 in 1994 requiring SDG&E to conduct additional analyses of data from the 316(b) study conducted in 1979-1980 (EA Science and Technology, 1997). The supplemental analyses were completed in 1997. The purpose of the study was to further evaluate the effects of the EPS cooling water intake on the designated beneficial uses of AHL and the Southern California Bight using additional analysis methods. The three Special Conditions of the Order were:

1. Analysis of Family-Specific Entrainment Losses of Fish Eggs and Larvae—*Analysis shall include the estimated monthly and annual entrainment losses for each ichthyoplankton RIF (Representative Important Families) (i.e. identify the specific fish larvae and egg removals for each ichthyoplankton family considered in this study).*
2. Estimation of Combined Impingement Losses for Each of the Target Species—*The specific ichthyoplankton losses shall be evaluated using such factors as the importance of that species in food web structure, natural mortality, and plant selectivity for that species, and potential mitigating factors to reduce the kill of that species.*
3. Estimation of Annual Equivalent Adult Losses From Both Entrainment And Impingement—*Ichthyoplankton losses shall be evaluated using such factors as the importance of that species in the marine food web and its importance as a commercial or recreational species. This assessment shall include the use of a time reference for impact assessment longer than the 1-day entrainment zone. SDG&E may use the existing zone. SDG&E may use the existing data collected during the original demonstration project, but shall propose an alternative approach to assess the long-term effect of plankton removal.*

Estimates of loss were calculated for 17 selected species that included the original 16 "critical species" identified in the original 316(b) report and also tidewater goby, the only endangered aquatic species likely to occur in the area. Estimates of adult equivalent loss were calculated for the three representative species with the highest estimates of entrainment or impingement loss: northern anchovy, topsmelt, and queenfish. The modeling uses life stage-specific estimates of

total mortality and yields estimates of the number of individual adult fishes which would have resulted from the young lost to entrainment and impingement under the conservative assumption of equal survival.

In order to put the entrainment losses in perspective and evaluate the magnitude of potential impacts, the report considered the life history characteristics of each target species (reproductive ability, geographic distribution, migratory capabilities) as well as estimates of current population size or harvest by commercial or sport fishermen. Although the original report touched on these topics, the 1997 report went into greater detail to evaluate potential impacts. Impacts were considered at three levels: individual population, overall community, and designated beneficial uses of the source waterbody.

The report concluded that the potential for adverse impacts from the EPS CWIS on individual target species was small compared to the sizes of the existing populations and the effects of fisheries. It similarly concluded that operation of the EPS cooling water intake has not, and will not, adversely affect the continued maintenance of balanced aquatic communities or designated beneficial uses of AHL or the Pacific Ocean in the vicinity of the EPS. Finally, the report stated that since the existing intake is not causing any adverse environmental impacts as defined under the CWA 316(b) guidelines that were in effect in 1997, it should be designated as best technology available.

3.1.3 2004-2005 EPS 316(b) Demonstration

In 2004 the EPS initiated new IM&E studies prior to the publication of the new Phase II rules to take advantage of sampling synergies associated with the permitting of a desalination facility planned for construction on the EPS property. A study plan for the desalination facility studies was submitted to the San Diego Regional Water Quality Control Board (SDRWQCB) staff. The desalination facility study plan was designed to provide information on the larval fish and target invertebrates contained in the source of feedwater for the desalination facility, which is the power plant's cooling water discharge, that would be at risk to entrainment by the desalination plant, and information on the larval fish and target invertebrates contained in the power plant's source waterbody and intake flows. Data being collected for the desalination facility on the power plant's source population of entrainable larval fish and target invertebrates was similar to the information required under the new Phase II rules.

A plan for IM&E studies that directly addressed the requirement of 316(b) was submitted to the San Diego Regional Water Quality Control Board in September 2004 following the final publication of the new Rules in July 2004. The IM&E study plan was submitted as a first step in the facility's compliance with the new Phase II rule. The study plan was reviewed by the Board staff and their consultants, Tetra Tech Inc., and was approved contingent on certain comments and questions. Comments on the study plan were resolved and the studies continued through

June 2005 under the direction of a Technical Advisory Group comprised of staff from the Board, state and federal resource agencies, EPS, and their consultants. A summary of the 2004-2005 IM&E studies is presented in Section 9.0. The final report on the studies is being prepared and will be submitted as part of the CDS.

3.2 Survey of Ecological Resources of Agua Hedionda Lagoon (MEC Analytical Systems, Inc., 1995)

A series of field studies was completed in 1995 in AHL to characterize ecological resources of the lagoon prior to a proposed maintenance dredging project. The study delineated the extent of eelgrass and saltmarsh habitats in the lagoon, and provided quantitative information on the distribution and abundance of birds, fishes and benthic invertebrates. The studies occurred over a 14-month period from April 1994 to June 1995.

The fish surveys were conducted during two different seasons, spring and summer. A total of 29 species of fishes were collected during the two surveys (Table 3-5). Fewer taxa occurred in the Outer Lagoon compared to the Middle and Inner lagoons. The species composition recorded was indicative of the proximity of each lagoon segment to the outer coast with a higher proportion of nearshore species found in the Outer Lagoon samples and more estuarine/bay species in the Inner Lagoon. Mean total densities ranged from 0.016 fish per m^2 (10.76 feet²) in the Outer Lagoon in April 1995 to 7.90 per m^2 (10.76 feet²) in the east Inner Lagoon, also in April 1995. Overall densities were higher in the April than July for all lagoon segments. Silversides and gobies comprised over 90% of the individuals collected. The high densities recorded in the spring survey were due to recruitment of juveniles.

Although 29 species of fishes were found in the 1994-1995 surveys by MEC Analytical Systems, earlier studies (Bradshaw et al. 1976) reported a total of 42 species from occasional surveys and from intake screen collections from the power plant. A similar distribution pattern of increased diversity in the Inner Lagoon compared to the Outer Lagoon was also found in the SDG&E study. MEC Analytical Systems (1995) noted a lower abundance of California halibut in the lagoon than in previous surveys. California halibut were one of the most abundant species reported by Bradshaw and Estberg (1973), and were only collected in the Inner Lagoon in their survey. Studies by Kramer (1990) demonstrated the importance of the Middle and Inner lagoons as nursery habitat for California halibut.

Table 3-5

Mean Density per m² and Percent Composition Of Fish Species Collected In Aqua Hedionda Lagoon During Two Surveys By Benthic Trawl, Beach Seine, And Otter Trawl

Species	Common Name	AHL Mean	Percent
Gobiidae (< 25 mm)	gobies (< 25 mm)	0.550	31.54
Atherinopsidae (< 25 mm)	silversides (< 25 mm)	0.520	29.80
<i>Atherinops affinis</i>	topsmelt	0.325	18.64
Gobiidae	goby, unid.	0.076	4.33
<i>Acanthogobius flavimanus</i>	yellowfin goby	0.050	2.87
<i>Hypsopsetta guttulata</i>	diamond turbot	0.040	2.30
<i>Clevelandia ios</i>	arrow goby	0.037	2.15
<i>Quietula y-cauda</i>	shadow goby	0.021	1.21
<i>Fundulus parvipinnis</i>	California killifish	0.019	1.06
<i>Cymatogaster aggregata</i>	shiner surfperch	0.013	0.75
<i>Syngnathus</i> sp.	pipefish, unid.	0.013	0.75
<i>Heterostichus rostratus</i>	giant kelpfish	0.013	0.74
<i>Paralichthys californicus</i>	California halibut	0.012	0.70
<i>Gillichthys mirabilis</i>	longjaw mudsucker	0.012	0.67
<i>Leptocottus armatus</i>	staghorn sculpin	0.010	0.54
<i>Paralabrax maculatofasciatus</i>	spotted sandbass	0.009	0.52
<i>Syngnathus auliscus</i>	barred pipefish	0.005	0.28
<i>Engraulis mordax</i>	northern anchovy	0.005	0.27
<i>Hypsoblennius gentilis</i>	bay blenny	0.004	0.22
<i>Ilypnus gilberti</i>	cheekspot goby	0.004	0.20
<i>Syngnathus leptorhynchus</i>	bay pipefish	0.003	0.19
<i>Seriophus politus</i>	queenfish	0.003	0.17
<i>Anchoa compressa</i>	deepbody anchovy	0.002	0.10
<i>Mustelus californicus</i>	grey smoothhound shark	*	
<i>Gymnura marmorata</i>	California butterfly ray	*	
<i>Paralabrax clathratus</i>	kelp bass	*	
<i>Micropterus dolomieu</i>	small mouth bass	*	
<i>Umbrina roncadore</i>	yellowfin croaker	*	
<i>Sphyrna argentea</i>	California barracuda	*	
<i>Citharichthys stigmaeus</i>	speckled sanddab	*	

Table 3-5 (Continued)
Mean Density per m² and Percent Composition Of Fish Species Collected In Aqua
Hedionda Lagoon During Two Surveys By Benthic Trawl, Beach Seine, And Otter Trawl.

Species	Common Name	AHL Mean	Percent
<i>Pleuronichthys ritteri</i>	spotted turbot	*	
<i>Symphurus atricauda</i>	California tonguefish	*	

*Indicates species with no quantitative summary data included in report (from MEC 1995, Table 3.5).

MP = 10.76 feet

Tidewater gobies (*Eucyclogobius newberryi*) were collected from AHL historically, but were not found in the 1994–1995 sampling. It is thought that the dredging and opening of the lagoon to higher saline marine waters in the 1950s significantly affected the tidewater goby population, which is adapted to primarily brackish water conditions.

A total of 143 macroinvertebrate taxa were collected with beam trawls in AHL during the MEC study. Very few of these taxa would be susceptible to impingement from EPS because of their primarily benthic habitat requirements. The most abundant taxa included the cockle (*Laevicardium substriatum*), a non-native mussel (*Musculista senhousi*); bubble snails (*Acteocina inculta*, *Bulla gouldiana*, *Haminaea vesicular*), mud dwelling snails, and several species of small crustaceans including amphipods, isopods, mysids, and shrimps. Differences in abundance of several taxa among the three lagoon segments was noted in the sampling and was attributed mainly to predominantly coarser sediments in the Outer Lagoon and finer sediments in the eastern inner portion of the Inner Lagoon.

A total 76 infaunal taxa was collected using a small coring apparatus with the sediments sieved through a 0.04 inches mesh screen. It was concluded that benthic infaunal populations were generally more diverse and abundant in the eelgrass beds than in non-vegetated sediments or in areas where currents deposited littoral sands.

Speckled scallop, *Argopecten circularis*, is a protected species that was known to occur in AHL. Only one individual was collected by MEC during the 1994-95 studies. The species had been studied previously by the California Department of Fish and Game (CDF&G) at AHL from March 1984 to October 1986 to obtain basic life history data (Haaker et al. 1988). Monthly samples of scallops were collected, measured, and released to obtain length frequency data for estimates of growth, life span, and spawning period. In 1984 large concentrations of speckled scallops were found on the sand-silt bottom of the lagoon, closely associated with eelgrass. During the course of the study the numbers of scallops declined, until their virtual disappearance at the end of 1986. Monthly length frequency plots from 24,375 scallop measurements indicate that this is a rapidly growing species with a short life span.

Special studies were done in conjunction with the new IM&E studies done in 2004 and 2005 to supplement the information on fishes provided in the MEC report. The MEC studies did not include sampling of mudflats in the Inner Lagoon and rocky habitat in the Outer Lagoon. The fishes in these two habitats produce large numbers of larvae at risk to entrainment. The data from these studies will be combined with data from the MEC study to provide more accurate estimates of the populations of fishes in the lagoon that will help provide some context for the estimates of EPS entrainment.

4.0 Agency Consultations

As required by the EPA 316(b) Phase II regulation [40 CFR 125.95 (b)(1)(iii)], a summary of any past and ongoing consultations with federal and state Fish and Wildlife Agencies relevant to the development of the PIC for this facility is presented in this section. All communications related to the IM&E issues at the EPS have been conducted through the SDRWQCB with federal and state resource agencies providing input on the IM&E studies as described below.

IM&E studies at EPS were started in June 2004 prior to the publication of the new Phase II rules to take advantage of entrainment sampling that was being done as part of the permitting for a desalination facility planned for construction on the EPS property. A plan for IM&E studies that directly addressed the requirements of 316(b) under the new Phase II rule was submitted to the San Diego Regional Water Quality Control Board on September 2, 2004. The IM&E study plan was submitted as a first step in the facility's compliance with the new Phase II rule. The study plan was reviewed by the Board staff and their consultants, Tetra Tech Inc., and was approved contingent on certain comments and questions that did not affect the sampling procedures being used in the studies. A copy of the September 30, 2004 Tetra Tech review of the study is included as in Attachment B. A copy of the EPS response to the Tetra Tech comments, dated January 10, 2005 is included in Attachment B.

One of the recommendations of the Tetra Tech review was that the SDRWQCB staff and other resource agencies be involved in approving certain aspects of the study including the selection of the target organism that would be used in the final assessment of cooling water system effects. In response to these comments a Technical Advisory Group (TAG) was formed to provide guidance on the IM&E studies. The TAG consists of staff from the SDRWQCB, the National Marine Fisheries Service, the CDF&G, the EPS and their consultants, Tenera Environmental and Dr. Scott Jenkins, an oceanographer from the University of California, San Diego Scripps Institute of Oceanography. The functions of the TAG included the following:

- providing input and review on selection of target organisms for assessment;
- providing input and review on the definition of the source water for entrainment assessment modeling;
- providing input on special studies and other data sources that may be available for assessing source water populations; and
- providing review on reports.

The SDRWQCB and resource agencies' staff participated in three TAG meetings in March, June and in September of 2005. Details on discussion topics of PICs and conclusions from each

meeting are presented in Table 4-1. Based on preliminary analyses of the IM&E data, a suite of target fishes and shellfishes for detailed analysis in the IM&E Characterization Study Final Report were selected by the TAG at the September 2005 meeting.

On January 6, 2005, EPS submitted a letter to the SDRWQCB requesting a schedule for submittal of information required to comply with the EPA 316(b) Phase II rule. The letter requested a schedule for submittal of the PIC on April 1, 2006 and for submittal of the CDS on January 7, 2008. A copy of the subject correspondence is included in Attachment B.

Table 4-1
Technical Advisory Group Meetings Held on Impingement Mortality and Entrainment Studies at EPS

Date	Attendees	Discussion Topics	Conclusions
March 14, 2005	Tim Hemig, Sheila Henika - EPS John Steinbeck, David Mayer - Tenera John Phillips, Peter Michael - SDRWQCB Bob Hoffman - NMFS Bill Paznokas - CDF&G	Discussion of study design, assessment models, and methods for defining the source water for the study. Description of special studies on fishes of Agua Hedionda Lagoon that will help fill in data gaps from previous studies.	Agency representatives agreed with the sampling design since it follows the same model used for the South Bay Power Plant and Huntington Beach Generating Station studies.
June 13, 2005	Tim Hemig, Sheila Henika - EPS John Steinbeck, David Mayer - Tenera John Phillips, Paul Richter - SDRWQCB Bob Hoffman - NMFS Bill Paznokas - CDF&G Scott Jenkins - Scripps	Updates on impingement and entrainment sampling, and special studies. Presentation of population model for source water target organisms that accounts for the reduced residency time in Agua Hedionda Lagoon which limits the period of time that larvae are exposed to entrainment.	Agency representatives agreed with the need for more complicated population model and approach used for special studies
Sept. 29, 2005	Tim Hemig, Sheila Henika - EPS John Steinbeck, David Mayer, John Hedgepeth - Tenera Charles Cheng - SDRWQCB Bob Hoffman - NMFS Bill Paznokas - CDF&G Scott Jenkins - Scripps	Presentation of preliminary impingement and entrainment sampling results and recommendations for target organisms that will be analyzed in final report. Presentation of results from studies on the hydrodynamics of AH Lagoon and the use of the results in assessment models.	Agreement on target organisms that will be analyzed in detail for cooling water system effects in the final report.

5.0 Evaluation of Intake Technology Alternatives

The EPA Phase II 316(b) regulation requires in 40 CFR 125.95(b)(1)(i) that the PIC include a description of technologies which will be evaluated further to determine feasibility of implementation and effectiveness in meeting IM&E performance standards at the facility. The EPS CWIS, being located on a tidal/estuarine waterbody, must meet the performance standards for reduction in both IM&E.

A preliminary screening of technologies has been conducted to determine which alternatives offer the greatest potential for application at the EPS facility and therefore warrant further evaluation. Technologies have been screened based upon feasibility for implementation at the facility, biological effectiveness (i.e. ability to achieve reductions in both IM&E), and cost of implementation (including capital, installation, and annual operations and maintenance costs). Table 5-1 includes a list of technologies for which a preliminary screening was conducted.

Table 5-1
Fish Protection Technologies

Technology	Fish Protection Potential	
	Impingement Mortality	Entrainment
Modified traveling screens with fish return	Yes	No
Replacement of existing traveling screens with fine mesh screens	Yes	Yes
New fine mesh screening structure	Yes	Yes
Cylindrical wedge-wire screens – fine slot width	Yes	Yes
Fish barrier net	Yes	No
Aquatic filter barrier (e.g. Gunderboom)	Yes	Yes
Fine mesh dual flow screens	Yes	Yes
Modular inclined screens	Yes	No
Angled screen system – fine mesh	Yes	Yes
Behavior barriers (e.g. light, sound, bubble curtain)	Maybe	No

In a cursory analysis of the industry costs of implementing the new 316(b) Performance Rule, the EPA has selected retrofit of Fish Screens and a Fish Handling and Return Systems as an applicable technology for the EPS intake system.

The technologies selected for further consideration, which address both impingement and entrainment, as well as those determined not to warrant further consideration are discussed below.

5.1 Technologies Selected For Further Evaluation

A technology, which may be feasible for achieving performance standards, in whole or in part, for reduction in IM&E will be evaluated on the basis of the following:

- Ability to achieve required reductions in both IM&E for all species, taking into account variations in abundance of all life stages;
- Feasibility of implementation at the facility;
- Cost of implementation (including installed costs and annual O&M costs); and
- Impact upon facility operations.

The evaluation will involve the following:

- Comprehensive review of facility CWIS design and operation;
- Engineering design of proposed CWIS upgrades and/or equipment replacements;
- Development of design drawings;
- Analysis of capital and installation costs; and
- Assessment of level of IM&E reductions expected.

After reviewing the site conditions, the following design and construction technologies were selected for further evaluation for the feasibility of implementation to meet, in whole or in part, IM&E reduction standards:

- Modified traveling screens with fish return
- New fine mesh screening structure

5.1.1 Fish Screens, Fish Handling, and Return Systems

Traveling screens that are modified to enhance fish survival are designed with the latest fish removal features, including the Fletcher type buckets on the screen baskets, dual pressure spray systems (low pressure to remove fish, and high pressure to remove remaining debris), and separate sluicing systems for discarding trash and returning the impinged fish back to the water body. Impingement survival may be improved with the use of continuously operating modified traveling water screens. A fish return system is required as part of this system to transport fish washed from the screens alive back to the water body to a location where they would not be subject to re-entrainment into the intake.

Installation of modified Ristroph traveling screens at the EPS CWIS would consist of replacing the existing traveling water screens within the tunnel system with the screens as described above. A fish return system would be installed to return fish collected on the traveling water screens to the lagoon. The replacement screens would be equipped with the same 3/8 inch mesh size as the existing traveling screens.

The feasibility of replacing the existing traveling screens at the EPS CWIS with modified Ristroph traveling screens with conventional 3/8 inch mesh, fish handling and fish return systems will be evaluated. The evaluation will include an assessment of the additional reduction in IM that may be expected through implementation of this technology. Additionally, the feasibility of transporting the collected fish back to a location that would be an appropriate habitat and not result in likely re-entrainment into the intake will be assessed.

5.1.2 New Fine Mesh Screening Structure

Fine mesh traveling water screens have been tested and found to retain and collect fish larvae alive with some success. Fine mesh traveling water screens have been installed at a few large-scale steam electric cooling intakes including marine applications at Big Bend Station in Tampa, Florida (EPRI, 1986), and at an operating nuclear generating station at Prairie Island on the Mississippi River (Kuhl, 1988). Results from field studies of fine-mesh traveling water screens generally show higher survival at lower approach velocities and with shorter impingement duration (EPRI, 1986). In addition, many regulatory agencies have in the past adopted an expectation that traveling water screen approach velocities should be 0.5 feet per second (fps) or less. The National Pollutant Discharge Elimination System - Final Regulations to Establish Requirements for Cooling Water Intake Structures at Phase II Facilities in Section VII A states a maximum through screen design intake velocity of 0.5 fps as the acceptable design standard. This would require a screen approach velocity of 0.25 fps or less depending on the percent open area of the screen mesh used.

Application of fine mesh traveling water screen technology for EPS would likely require a complete new screen structure constructed at the south shore of the lagoon, including both trash racks and fine mesh traveling screen systems and fish collection and return systems; and would replace the existing trash rack structure with a much larger screening structure. It appears that there may be adequate space at the shore for a new fine mesh screen structure, but additional evaluation is still necessary. The approach velocities to the existing traveling screens, as discussed in subsection 2.3 above, are currently well above 0.5 fps and adding sufficient additional screens to the intake tunnel system to reduce approach velocities to 0.5 fps or less would require major modifications to the tunnel system, which may not be feasible. Additionally, an appropriate and suitable location to return collected fish, shellfish, and their eggs and larvae

would have to be identified, as well as an assessment of the feasibility of constructing such a return system.

Design layouts and cost estimates for implementation and operation and maintenance will be developed for the above described fine mesh screen structure, as part of the CDS evaluation.

5.2 Technologies Considered Infeasible and Eliminated From Further Evaluation

5.2.1 Replacement of Existing Traveling Screens with Fine Mesh Screens

As discussed above in section 5.1.2, simple replacement of the existing traveling screens in the tunnel system with fine mesh Ristroph screens is not feasible due to high screen approach velocities. Therefore, further evaluation of this technology for implementation at the EPS CWIS will not be conducted.

5.2.2 Cylindrical Wedge-Wire Screens – Fine Slot Width

Wedge-wire screens are passive intake systems, which operate on the principle of achieving very low approach velocities at the screening media. Wedge-wire screens installed with small slot openings may enable a facility to meet performance standards for both IM&E. The wedge-wire screen is an EPA-approved technology for compliance with the EPA 316(b) Phase II rule provided the following conditions exist:

- The cooling water intake structure is located in a freshwater river or stream;
- The cooling water intake structure is situated such that sufficient ambient counter currents exist to promote cleaning of the screen face;
- The through screen design intake velocity is 0.5 fps or less;
- The slot size is appropriate for the size of eggs, larvae, and juveniles of any fish and shellfish to be protected at the site; and
- The entire main condenser cooling water flow is directed through the technology.

Wedge-wire screens are designed to be placed in a water body where significant prevailing ambient cross flow current velocities (≥ 1 fps) exist. This cross flow allows organisms that would otherwise be impinged on the wedge-wire intake to be carried away with the flow. An integral part of a typical wedge-wire screen system is an air burst back-flush system, which directs a charge of compressed air to each screen unit to blow off debris and impinged organisms back into the water body where they would be carried away from the screen unit by the ambient cross flow currents.

The EPS CWIS, located on the tidal AHL would not meet the first two EPA criteria discussed above. The intake is not located on a freshwater river and there are not sufficient ambient crosscurrents in the lagoon to sweep organisms and debris away from the screen units. Debris and organisms back-flushed from the screens would immediately re-impinge on the screens following the back-flush cycle because the principal water current in the outer lagoon would be the station intake flow toward the screen units. For these reasons, wedge-wire screen technology is not considered feasible for application at the EPS.

5.2.3 Fish Barrier Net

A fish net barrier, as it would be applied to a power station intake system, is a mesh curtain installed in the source water body in front of intake structures such that all flow to the intakes passes through the net, blocking entrance to the intake of all aquatic life forms large enough to be blocked by the net mesh. The net barrier is sized large enough to have very low approach and through net velocities to preclude impingement of juvenile fish with limited swimming ability. The mesh size must be large enough to preclude excessive fouling during normal station operation while at the same time small enough to effectively block entrainment of organisms into the intake system. These conditions typically limit the mesh size such that adult and a percentage of juvenile fish can be blocked. The mesh is not fine enough to block most larvae and eggs. The fish net barrier could potentially meet the performance requirements of the EPA Phase II Existing Facilities Rule for impingement; however, it would not meet the performance requirements for reduction of entrainment of eggs and larvae.

The fish net barrier technology is still experimental, with very few successful installations at power station intakes. Using a 20 gpm/ft² design loading rate, a net area of approximately 30,000 feet² would be required for EPS. Maintaining such a large net moored in the lagoon is not practical. In addition, the fish barrier is a passive screening device, which is subject to fouling and has no means for self-cleaning. This technology would be rapidly clogged due to fouling. The services of a diving contractor would be required to remove the net for cleaning onshore and to replace the fouled net with a clean net on each cleaning cycle. For these reasons, this technology is not practically feasible for implementation at EPS and further evaluation is not warranted.

5.2.4 Aquatic Filter Barrier

An aquatic filter barrier system, such as the Gunderboom Marine Life Exclusion System (MLES)TM (Gunderboom), is a moored water permeable barrier with fine mesh openings that is designed to prevent both impingement and entrainment of ichthyoplankton and juvenile aquatic life. An integral part of the MLES is an air-burst back flush system similar in concept to the air burst system used with wedge-wire screen systems to back flush impinged organisms and debris into the water body to be carried away by ambient cross currents.

A MLES has been installed and tested at the Lovett Station on the Hudson River. This test installation was applied to a cooling system of significantly smaller capacity than the EPS intake system and in a very different environment on the Hudson River, as opposed to the lagoon intake of the EPS.

Although the MLES has much smaller mesh openings and will block fish eggs and larvae from being entrained into the intake, these smaller organisms will be impinged permanently on the barrier due to the lack of cross currents to carry them away. This system therefore offers no significant advantage over other technologies such as the fish net barrier concept and would offer no biological improvement over the barrier net design. For these reasons, this technology is not practically feasible for implementation at EPS and further evaluation is not warranted.

5.2.5 Fine Mesh Dual Flow Screens

A modified dual flow traveling water screen is similar to the through flow design, but the screen would be turned 90 degrees so that its two faces would be parallel to the incoming water flow. When equipped with fine mesh screening media, the average 0.5 fps approach velocity to the screen face would have to be met by the dual flow screen design. Water flow enters the dual flow screen through both the ascending and the descending screen faces, and then flows out between the two faces. All of the fish handling features of the Ristroph screen design would be incorporated in the dual flow screen design. However, the dual flow screen configuration has been shown to produce low survival rates for fish larvae. This is because of the longer impingement time endured by organisms impinged on the descending face of the screen. This longer impingement time is suspected to result in higher mortality rates than similar fine mesh screens with a flow through screen design.

The primary advantage of this screen configuration is the elimination of debris carryover into the circulating water system. Also, because both ascending and descending screen faces are utilized, there is greater screening area available for a given screen width than with the conventional through-flow configuration. However, the flow pattern and therefore the velocity distribution along the screen face is not uniform and is concentrated toward the back or downstream end of the screen. The dual flow screen can also create adverse flow conditions in the approach flow to the circulating water pumps. The flow exiting the dual flow screens is turbulent with an exit velocity of greater than 3 fps. Modifications to the pump bays downstream of the screens, usually in the form of baffles to break up and laterally distribute the concentrated flow prior to reaching the circulating water pumps, are usually required. This would not be the case for EPS if a new fine mesh dual flow screen structure were constructed at the lagoon, similar to the through flow fine mesh screen structure discussed in Section 5.1 above.

For similar reasons, as discussed above for through flow fine mesh screens, implementation of this technology to the EPS CWIS would require an entirely new screen structure similar to the fine mesh through flow screen structure discussed in Section 5.1 above. The dual flow fine mesh screen configuration offers no advantages in terms reduction of impingement and entrainment mortality as compared to through flow fine mesh traveling screens discussed above and in fact would probably not perform as well as the through flow design. The design concept for the dual flow screen structure would be similar to the through flow fine mesh screen structure with trash racks, coarse mesh traveling screens and fine mesh traveling screens in each screen train. The implementation cost and operation and maintenance costs for this facility would be of the same order of magnitude as for the through flow screen structure. Dual flow screen technology does not offer a significant performance or cost advantage as compared with through flow screen technology. Therefore, further evaluation of this technology for the EPS is not warranted.

5.2.6 Modular Inclined Screens

Modular Inclined Screen (MIS) is a fish protection technology for water intakes developed and tested by the Electric Power Research Institute (EPRI) (Amaral, 1994). This technology was developed specifically to bypass fish around turbines at hydro-electric stations. The MIS is a modular design including an inclined section of wedge-wire screen mounted on a pivot shaft and enclosed within a modular structure. The pivot shaft enables the screen to be tilted to back-flush debris from the screen. The screen is enclosed within a self-contained module, designed to provide a uniform velocity distribution along the length of the screen surface. Transition guide walls taper in along the downstream third of the screen, which guide fish to a bypass flume. A full size prototype module would be capable of screening up to 800 cfs (360,000 gpm) at an approach velocity of 10 fps.

The MIS design underwent hydraulic model studies and biological effectiveness testing at Alden Research Laboratory to refine the hydraulic design and test its capability to divert fish alive. Eleven species of freshwater fish were tested including Atlantic salmon smolt, coho salmon, Chinook salmon, brown trout, rainbow trout, blueback herring, American shad and others. After some refinements in the design were made during this testing, the results showed that most of these species and sizes of fish can be safely diverted (Amaral, 1994).

Following laboratory testing the MIS design was field tested at the Green Island Hydroelectric Project on the Hudson River in New York in the fall of 1995 (Shires, 1996). In addition to the MIS, the effectiveness of a strobe light system was also studied to determine its ability to divert blueback herring from the river to the MIS. Results for rainbow trout, golden shiner and blueback herring, which were released directly into the MIS module were similar to the laboratory test results in terms of fish survivability. The limited amount of naturally entrained blueback herring did not allow reliable evaluation of test results (Amaral, 1994).

The MIS technology, as tested, does not address entrainment of eggs and larvae. Also, this technology has never been tested for, or installed in, a power station with a seawater intake system. Further research would be required to evaluate the efficacy of this technology for application to a seawater intake system. MIS is not a suitable and proven technology, at this time, for retrofit to the EPS intake system. Therefore, further evaluation of this technology for the EPS is not warranted.

5.2.7 Angled Screen System – Fine Mesh

Angled screens are a special application of through-flow screens where the screen faces are arranged at an angle of approximately 25 degrees to the incoming flow. The conventional through-flow screen arrangement would place the screen faces normal or 90 degrees to the incoming flow. The objective of the angled-screen arrangement is to divert fish to a fish bypass system without impinging them on the screens. Most fish would not be lifted out of the water but would be diverted back to the receiving water by screw-type centrifugal or jet pumps. Using fine screen mesh on the traveling screens minimizes entrainment, but increases potential for impingement of organisms that would have otherwise passed through the condenser.

Application of this technology would require construction of new angled screen structure at the south shore of the lagoon similar to the fine mesh screen structure discussed above in Section 5.1. The angled screen facility would not provide a significant performance advantage in terms of reducing IM&E as compared to the proposed fine mesh screen structure as presented above and would be at least as large and a significantly more complex structure. This facility would be potentially more costly to implement and maintain than the fine mesh screen facility. Therefore, further evaluation of this technology for the EPS is not warranted.

5.2.8 Behavior Barriers

A behavioral barrier relies on avoidance or attraction responses of the target aquatic organisms to a specific stimulus to reduce the potential of entrainment or impingement. Most of the stimuli tested to date are intended to repulse the organism from the vicinity of the intake structure. Nearly all the behavioral barrier technologies are considered to be experimental or limited in effectiveness to a single target species. There are a large number of behavioral barriers that have been evaluated at other sites, and representative examples these are discussed separately below.

Offshore Intake Velocity Cap – This is a behavioral technology associated with a submerged offshore intake structure(s). The velocity cap redirects the area of water withdrawal for an offshore intake located at the bottom of the water body. The cap limits the vertical extent of the offshore intake area of withdrawal and avoids water withdrawals from the typically more productive aquatic habitat closer to the surface of the water body.

This technology operates by redirecting the water withdrawal laterally from the intake (rather than vertically from an intake on the bottom), and as a result, water entering the intake is accelerated laterally and more likely to provide horizontal velocity cues that allow fish to respond and move away from the intake. Potentially entrainable fish are able to identify these changes in water velocity as a result of their lateral line sensory system and are able to respond and actively avoid the highest velocity areas near the mouth of the intake structure.

This technology reduces impingement of fish by stimulating a behavioral response. The technology does not necessarily reduce entrainment, except when the redirected withdrawal takes water from closer to the bottom of the water body and where that location has lower plankton abundance.

Application of this technology to the EPS CWIS, to be fully effective, would require development of an entirely new intake system with a submerged intake structure and connecting intake conduit system installed out into the Pacific Ocean similar to the offshore intake system at the El Segundo Generating Station (Weight, 1958). This is not a practically feasible consideration for the EPS. Also, this technology would probably not be capable of meeting the performance requirements of the EPA Phase II Existing Facilities Rule for reduction of entrainment of larvae, eggs and plankton. Therefore, this technology is not potentially applicable for the EPS CWIS and further evaluation of this technology is not warranted.

Air Bubble Curtain – Air bubble curtains have been tested alone and in combination with strobe lights to elicit an avoidance response in fish that might otherwise be drawn into the cooling water intake. Generally, results of testing the bubble curtain have been poor (EPRI, 1986). Tests have been conducted with smelt, alewife, striped bass, white perch, menhaden, spot, gizzard shad, crappie, freshwater drum, carp, yellow perch, and walleye. Many species exhibited some avoidance response to the air bubble or the combination air bubble and light combination. However, there has been little if no testing of species common to the AHL.

This technology has some potential to enhance fish avoidance response in some species of fish. However, there is no reliable data for the species that are subject to impingement at the EPS and no way to estimate what type of reaction fish would have to the existing intake with the addition of a bubble curtain. Unless some type of testing were conducted, this technology does not appear suitable for the EPS. As a result, there is no basis to recommend an air curtain as an enhancement to reduce impingement or entrainment at the EPS CWIS. Therefore, further evaluation of this technology for the EPS is not warranted.

Strobe Lights – There has been a great deal of research with this stimulus over the last 15 years to guide fish away from intake structures. The Electric Power Research Institute has co-funded a series of research projects (EPRI 1988, EPRI 1990, EPRI 1992) and reviewed the results of

research in this field by others (EPRI 1986, EPRI 1999). In both laboratory studies and field applications strobe lights were shown to effectively move selected species of fish away from the flashing lights. Most of the studies conducted to date have been with riverine fish species and for projects associated with hydroelectric generating facilities. One early study was conducted at the Roseton Generating Facility on the Hudson River in New York, another study was conducted on Lake Cayuga in New York, and others for migratory stages of Atlantic and Pacific salmon. Few species similar to those occurring in the AHL have been tested for avoidance response either in the lab or in actual field studies.

Laboratory testing was done for an application of strobe lights for the San Onofre Nuclear Generating Facility. Testing was conducted for white croaker, Pacific sardine and northern anchovy. Limited availability of test specimens and limited testing demonstrated no conclusive results and the California Coastal Commission (2000) found this device not useful at this station.

Before strobe lights could be seriously considered for use at the EPS CWIS, a series of lab and or field studies on their effectiveness for the species most likely to be entrained into the EPS CWIS would need to be completed. Based on studies of strobe lights conducted to date, it is likely that these studies would show differential effectiveness based on background light conditions (day vs. night), ambient seawater turbidity, and most likely there would also be great differences in species specific response. As a result there is no basis to recommend these strobe lights as an enhancement to reduce impingement or entrainment at the EPS CWIS. Therefore, further evaluation of this technology for the EPS is not warranted.

Other Lighting – Incandescent and mercury vapor lights have also been tested as a behavioral stimulus to direct fish away from an intake structure. Mercury lights have generally been tested as a means of drawing fish to a safe bypass of the intake structure as generally the light has an attractive effect on fish. Tests have not demonstrated a uniform and clearly repeatable pattern of attraction for all fish species. The mercury lights have been somewhat effective in attracting European eel, Atlantic salmon, and Pacific salmon. But results with other species including American shad, blue back herring and alewife had more variable results. One test with different life stages of Coho salmon shows both attraction and repulsion from the mercury light for the different life stages of the coho.

Testing with incandescent, sodium vapor and fluorescent lamps was more limited but also had variable and species specific results.

Other lighting systems, as with most all the behavioral barrier alternatives, have not been tested with the species of fish common in AHL. As a result, there is no basis to recommend these lights systems as an enhancement to reduce impingement or entrainment at the EPS CWIS. Therefore, further evaluation of this technology for the EPS is not warranted.

)) Sound - Sound has also been extensively tested in the last 15 years as a method to alter fish impingement rates at water intake structures. Three basic groups of sound systems including percussion devices (hammer, or poppers), transducers with a wide range of frequency output, and low frequency or infrasound generators, have all been tested on a variety of fish species.

Of all the recently studied behavioral devices the sound technology has demonstrated some clear success with at least one group of fish species. Clupeids, such as alewife, demonstrate a clear repulsion to a specific range of high frequency sound. A device has been installed in the Fitzpatrick Nuclear Generating station on Lake Ontario in New York State, which has been effective in reducing impingement of landlocked alewives. The results were repeated with alewife at a coastal site in New Jersey. Similar results with a high frequency generator also reported a strong avoidance response for another clupeid species, the blue back herring, in a reservoir in South Carolina. Testing of this high frequency device on many other species including weakfish, spot, Atlantic croaker, bay anchovy, American shad, blue back herring, alewife, white perch, and striped bass only demonstrated a similar and strong avoidance response by American shad and blue back herring.

Alewife and sockeye salmon have also been reported to be repelled by a hammer percussion device at another facility. But testing of this same device at other facilities with alewife did not yield similar results.

Although high frequency sound has potential for eliciting an avoidance response by the Alosid family of fish species, there is no data to demonstrate a clear avoidance response for the species of fish common to the AHL. Therefore there is no basis to recommend sound as a method to reduce impingement of fish at the EPS CWIS. Therefore, further evaluation of this technology for the EPS is not warranted.

6.0 Evaluation of Operational Measures

The EPA 316(b) Phase II regulation [40 CFR 125.95(b)(1)(i)] requires that the PIC should include a description of operational measures which will be evaluated further to determine feasibility of implementation and effectiveness in meeting IM&E performance standards at the facility. A preliminary screening of such measures has been conducted to determine those which offer the greatest potential for application at the facility and therefore warrant further evaluation. Operational measures have been screened based upon feasibility for implementation at the facility, biological effectiveness (i.e. ability to achieve reductions in IM&E), and cost of implementation (including additional power requirements and loss in generating capacity and unit availability).

Several operational measures have been proven effective in reducing IM&E at CWIS. Such measures include:

- CWIS flow reductions (e.g. capping capacity utilization rate)
- Variable speed drives for CWIS pumps
- Other cooling water efficiency improvements

The following is a discussion of operational measures for which further evaluation will be conducted in the CDS to determine their potential for reducing IM&E at EPS. The results of the evaluation of such measures will be utilized to develop the plan for implementation of technologies, operational and/or restoration measures that will be proposed to achieve IM&E performance standards at the facility. Upon selection of the most appropriate operational measures, engineering design calculations and drawings, as well as estimates of expected reductions in IM&E and a schedule for implementation will be developed. This information will become part of the Design and Construction Technology Plan (DCTP) (or Site-Specific Technology Plan in the event that the facility chooses to seek a site-specific determination of BTA) and Technology Installation and Operation Plan (TIOP) that will be included in the CDS to be submitted for the facility. The DCTP explains the intake technologies or operational measures selected for use at EPS to meet the E&I performance standards for the Phase II Rule. The compliance with the performance standards will be measured and monitored through documentation of the TIOP.

6.1 Circulating Water Flow Reduction / Caps

Circulating water flow caps are an operational control measure which would include administratively limiting the total withdrawal of cooling water from the AHL to an agreed upon value. The flow reductions may be scheduled for periods of the year when entrainment or impingement are highest to achieve a greater reduction to impingement and entrainment. Any

reduction in flow reduces both entrainment and impingement effects associated with the operation of the plant. If flow reductions are concentrated during the seasons of the year that plankton life stages of species of concern are present, the overall seasonal reductions in fisheries impacts can greatly exceed the quantity of the flow reduction. Utilizing variable speed drive technology on the circulating water pumps could be an effective means of controlling total annual flow withdrawal.

6.2 Variable Speed Drives For Circulating Water Pumps

Variable-speed drives for circulating water pumps allow reduction in cooling water flow during periods when the unit is not operating at full-rated capacity, or during known periods of high entrainment. With this technology it would be possible to vary the speed of the motor from 10% to 100% and reduce the cooling water intake flow by up to 90%. Any reduction in flow reduces both entrainment and impingement effects associated with the operation of the plant. The lower pumping capacity allows for a lower approach velocity at the traveling screens and reduces the number of entrainable organisms drawn into the cooling water system. In addition, if flow reductions are concentrated during the seasons of the year that plankton life stages of species of concern are present, the overall seasonal reductions in fisheries impacts can greatly exceed the quantity of the flow reduction. The installation of variable speed drives will be evaluated further to determine the effectiveness in reducing IM&E at the EPS CWIS.

6.3 Heat Treatment Operational Changes

Potential operational and procedural enhancements to reduce impingement during heat treatment events will also be evaluated. In the CDS, EPS will evaluate a couple of alternative biofouling control measures that might reduce the number, or eliminate the need for, heat treatments in the intake tunnels. In addition, EPS will also evaluate a couple of modifications of the existing heat treatment procedures that might reduce the numbers of fish impinged during these events, but still provide effective heat treatment removal of fouling organisms in the intake and intake tunnels.

7.0 Evaluation of Restoration Alternatives

The EPA Phase II 316(b) regulation [40 CFR 125.95(b)(1)(i)] allows the consideration of restoration measures as one of the options that may be implemented, either alone or in combination with technology and/or operational measures, to achieve performance standards for reduction in IM&E losses. Facilities may propose restoration measures that will result in increases in the numbers of fishes and shellfishes in the waterbody that would be similar to those achieved with meeting performance standards through the implementation of technologies and/or operational measures. EPS will conduct an evaluation of potential restoration measures that may be implemented in the event that it is determined that meeting performance standards through the implementation of technologies and/or operational measures alone is less feasible, less cost-effective, or less environmentally desirable than use of restoration measures.

7.1 Potential Restoration Measures

This section introduces the type of habitat restoration projects that could potentially be used to offset IM&E losses at EPS. The offsets that will later be calculated for each project will be based on a numerical comparison of IM&E losses resulting from the operation of EPS, and the expected production of equivalent adults of the affected species resulting from the restoration efforts using various habitat models.

Any specific conservation, enhancement, or restoration project that is to be used for this purpose should have a nexus (i.e. relationship between the environmental impacts and the proposed project) to the impingement and entrainment effects of the power plant. The projects that will be evaluated to offset potential EPS IM&E losses fall into three general categories:

- Projects that would directly restore or enhance habitat in AHL;
- Projects that would preserve, restore, or enhance the AHL watershed; and
- Projects that enhance the nearshore coastal environment in the vicinity of EPS Power Station.

The following is a list of some of the potential restoration measures, in each of the above categories, which will be evaluated to determine their feasibility of implementation, and potential efficacy in meeting IM&E performance standards at the EPS:

I. Restoration or Enhancement of AHL

- Invasive species removal and prevention
- Restoration of historic sediment elevations to promote reestablishment of eelgrass beds
- Enhancement of AHL State Reserve
- Marine fish hatchery enhancement
- Community outreach soliciting public agency and landowner participation

II. Restoration or Enhancement of Agua Hedionda Watershed

- Erosion control projects along upland watercourses
- Construction of catchment basins, swales, and other sediment containment features
- Land acquisition for purposes of creating conservation easements
- Minimizing runoff from development activities
- Restoration of floodplain habitat
- Invasive species removal and prevention

III. Restoration or Enhancement of Nearshore Coastal Areas

- Marine fish hatchery stocking program
- Artificial reef development
- Marine Protected Area establishment
- Kelp bed enhancement

The "value" of the ecological services or benefits that will result from implementation of any of these restoration projects will be assessed using various habitat models to demonstrate that the ecological "credits" gained through restoration will outweigh the ecological "debits" caused by the IM&E losses. A preliminary screening of these potential restoration measures will be conducted to determine which projects warrant further evaluation. Selected projects will be evaluated further based upon the criteria described below.

7.2 Project Selection Criteria

A set of restoration project selection criteria has been developed to aid in the evaluation of potential projects. The project selection criteria include:

- Location
- Nexus to EPS IM&E effects
- Basic need or justification for project
- Nature and extent of ecological benefits
- Stakeholder acceptance
- Consistency with ongoing resource agency work and environmental planning

- Administrative considerations
- Implementation costs
- Cost effectiveness
- Ability to measure performance
- Success of comparable projects
- Length of time before benefits accrue
- Technical feasibility
- Opportunities for leveraging of funds/availability of matching funds
- Legal requirements (e.g., permits, access)
- Likely duration of benefits

Depending on the nature of a particular project, the relative importance and weighting of these criteria may vary. As a general proposition, however, projects will be selected so as to maximize the ecological benefits to AHL and adjacent nearshore areas. This process will ensure that the most effective projects are assigned the highest priority.

8.0 Other Compliance Options for EPS

Two additional compliance alternatives that EPS may pursue in the course of developing the most appropriate CDS for the EPS CWIS include a site-specific determination of BTA and a trading approach for cooperative restoration solutions. The site-specific determination option would be undertaken if the implementation of some combination of an intake technology, operation change or restoration is significantly greater in cost than that estimated by US EPA or the costs are significantly greater than the benefits of such measures. The trading program compliance alternative would involve EPS teaming with other water users in the area to develop a more comprehensive solution to reduce or mitigate for IM&E with a cooperatively funded technology or restoration alternative. EPS has no specific plans and has not developed potential teaming partners to pursue this compliance alternative at this time. However, EPS will remain open to exploring this compliance alternative if the right opportunity is identified prior to submittal of the CDS.

8.1 Site-Specific Determination of BTA

The intent of the EPS approach to compliance is to meet the entrainment and impingement performance standards established by the EPA when the new rule was promulgated. That is, EPS hopes to demonstrate that the EPS intake has reduced the effects of entrainment by 60 to 90% and reduced the effects of station operation on impingement mortality by 80 to 95% from the calculation baseline. However, EPS also recognizes that if the costs of reaching these goals cannot reasonably be achieved that the EPA 316(b) Phase II regulation allows a somewhat lower IM&E reduction standard. Specifically the new rule would allow EPS to demonstrate that the EPS facility is eligible for a site-specific determination of BTA to minimize IM&E and that EPS has selected, installed, and is properly operating and maintaining, or will install and properly operate and maintain, design and construction technologies, operational measures, and/or restoration measures that the Director has determined to be the BTA to minimize adverse environmental impact of the EPS cooling water operations.

This compliance alternative allows the EPS facility to request a site-specific determination of BTA for minimizing IM&E if EPS can demonstrate that the costs for compliance with the new rule are significantly greater than those considered by EPA in the development of the rule (cost/cost test) or that the costs associated with compliance are significantly greater than the benefits (cost/benefit test) that would accrue to the environment.

8.1.1 Cost/Cost Test

If EPS chooses to seek a site-specific determination of BTA, a cost/cost test will be performed to compare the cost of implementing options to achieve full compliance with the 316(b) Phase II standards to costs estimated by the EPA for the EPS facility for achieving full compliance. In the 316 (b) Phase II rule, the EPA has assumed that the EPS facility would add a fish handling and return system to the existing traveling water screen system. There was no expectation in that recommendation that the EPS facility would need to meet the entrainment performance standards. Therefore EPA has projected compliance capital costs for the EPS facility of \$2,841,330 (Federal Register, Vol. 69 – 7/9/2004, page 41677 – see Facility ID# AUT0625). This same source cites an expected existing baseline O&M annual cost of \$104,168 and a post construction O&M annual cost of \$380,113 for EPS.

If pursuit of this compliance option is justified, EPS will conduct its evaluation following a three-step method, as follows:

1. Identification of feasible options for achieving full compliance (e.g. combinations of engineering, operational, and restoration actions);
2. Estimation of the dollar costs of implementing these actions (including capital, O&M, and lost generation revenue due to extended outages); and
3. Comparison of the total estimated cost of compliance based upon the compliance options identified with EPA's estimated cost of compliance for the facility in question.

One thing that has not been fully resolved by EPA is what constitutes "significant" compared to the costs that EPA projected for the EPS. EPS will develop its perspective on what constitutes significant during the development of the CDS. It is likely that significance will be judged from the perspective of the capital and operating costs and revenues from the operation of EPS.

8.1.2 Cost/Benefit Test

A cost/benefit test may also be performed for EPS to compare the total costs of achieving compliance with the environmental benefits through implementation of the required technologies, operational, and/or restoration measures. Costs are the sum of direct costs and the indirect costs of any intake, operational or restoration mitigation actions. Direct costs include the costs of implementing compliance alternatives, including capital, O&M, and lost generation revenue due to extended outages. Indirect costs include any costs associated with impairment of navigation, higher energy prices, and negative ecological effects of the mitigation actions on the waterbody. An initial phase of the cost/benefit test will identify whether any of these indirect cost elements are relevant at the EPS. The cost/benefit test would specify the nature of the relevant direct and indirect cost components at the facility.

The benefits arise from reducing IM&E by the full amount of the 316(b) Phase II rule's performance standard relative to baseline conditions. The economic benefits of reductions in IM&E have been specified by the EPA in its evaluation of the national benefits of the rule. The classes of benefits identified by EPA in its assessment include direct use benefits (e.g. those from commercial and recreational fishing), indirect use benefits (e.g. increased forage organisms), and existence, or passive use benefits (e.g. improved biodiversity). These benefits are based on standard definitions of value used by economists in cost/benefit analysis. Methods for quantifying benefits to commercial and recreational fishing and other changes in natural resources have been widely employed by environmental and natural resource economists over the past several decades.

The exact nature of the data and methods required for a cost/benefit analysis will vary depending upon the magnitude of the potential IM&E effects on a local and regional scale, the availability of existing economic benefit studies that may be applied, as well as the comments of the regulators and natural resource agencies involved with reviewing this PIC. These can vary widely and will not really be well understood until the results of the IM&E study are complete. When the IM&E study is complete, the numbers of each species affected by operation of the intake can be quantified, and then a value for each species affected by IM&E at the EPS CWIS can be developed.

The benefit studies would be undertaken using a phased approach. Following an initial scoping phase to determine the approach to conducting a cost/benefit analysis, an outline of a benefits assessment approach will be determined. EPS will develop an approach to conducting a benefits valuation for use in supporting a site-specific determination of BTA if that becomes the selected approach for meeting compliance with the new rule. The approach will address the following requirements for such a study as outlined in the Phase II rule:

1. Description of the methodologies to be used to value commercial, recreational, and other ecological benefits;
2. Documentation of the basis for any assumptions and quantitative estimates; and
3. Analysis of the effects of significant sources of uncertainty.

If restoration is a component of the compliance approach, the ability of the restoration project(s) to generate benefits to offset impingement and/or entrainment effects must be demonstrated. This requires specification of a metric that can be used to quantify restoration benefits in a manner comparable to entrainment and impingement effects in the ecosystem.

Habitat assessment methods will be used for assessing the relative value of restoration actions. The approach taken will be to:

1. Identify the key species of concern affected by the facility;
2. Identify critical factors or habitat needs for those species;
3. Identify technically feasible and cost-effective restoration actions that address such critical factors and needs factors; and
4. Choose an appropriate ecological metric for scaling effects of mitigation and/or enhancing habitat needs within the adjacent ecosystem or area.

For example, if it is determined that the restoration project needs to compensate for entrainment of a species for which spawning habitat is a limiting factor, then creation of sufficient new spawning habitat to increase the population by the amount of entrainment would be required for full compliance with the Rule. This would then translate to acreage of created habitat with certain required structural characteristics.

If entrainment losses are of key concern, and the population of associated fish is of less concern, then biomass could also serve as the metric. The present value of the entrained biomass would be computed as the ecological debit. Then, a wetland or other habitat creation project could be scaled in size to produce the equivalent present value of biomass from the primary productivity of the wetland or new habitat.

8.1.3 Evaluation of a Site-Specific BTA

The 316(b) Phase II Rule allows facilities to seek site-specific determinations of BTA if it can be demonstrated that the costs of achieving full compliance with the IM&E performance criteria at a facility are either:

1. Significantly greater than those considered by the EPA in development of the rule (cost/cost test), or
2. Significantly greater than the net environmental benefits to be achieved (cost/benefit test).

If either of these methods is implemented, EPS may propose this as the compliance approach if the costs are significantly higher than either the expected costs at the time the rule was promulgated or, for the amount of benefits that would be derived.

8.2 Trading For Cooperative Mitigation Solutions

In the preamble to the EPA 316(b) Phase II rule, as published in the Federal Register (Vol. 69, No. 131, pgs 41576 - 41693), there is a discussion of the role of trading under the rule (VII. F.2). The preamble describes how trading "...raises complex issues on how to establish appropriate

units of trade and how to measure these units effectively given the dynamic nature of the populations of aquatic organisms subject to impingement mortality and entrainment." However, EPA suggests that delegated authorities responsible for implementing the 316(b) Phase II rule wishing to develop trading options "...would be best off focusing on programs based on metric of compatibility between fish and shellfish gains and losses among trading facilities.". This section of the rule also states that if the delegated NPDES authority can demonstrate to the EPA Administrator that they have adopted a NPDES program within a watershed that provides for comparable reductions in IM&E, then the EPA Administrator must approve such alternative compliance alternative requirements.

EPS may consider a watershed-approach trading program as a possible compliance alternative if the right combination of coastal water users identify mutual goals for achieving compliance, either in whole or in part, with the new rule. EPS has not developed any specific alliance of water dependent organizations to implement such a watershed-approach trading compliance alternative. However, EPS expects that after field studies have characterized CWIS effects, that restoration may be the most feasible and cost-effective measure to meet the performance standards. This might be done alone, or in combination with other intake technologies or operational modifications. However, it might well be that different technologies implemented to achieve CWIS compliance at different electric generating facilities may result in mutual benefits for the regional ecosystem. If mutual benefits of mitigation are identified among different generating facilities, then EPS would then consider establishing a trading program with other generating facilities to achieve the lowest cost, most comprehensive and effective method to comply with the new 316 b rule.

EPS will remain open to seeking comprehensive solutions to the IM&E issues in the region and develop a plan for compliance with the possible cooperation of other water users such that the issue is addressed in the most comprehensive manner for the regional ecosystem.

9.0 Impingement Mortality & Entrainment Sampling

An IM&E sampling program was conducted to characterize the fishes and shellfishes affected by impingement and entrainment by the CWIS at the EPS. The data from the study will be used in calculating baseline levels of IM&E against which compliance with performance standards will be measured. A detailed IM&E sampling plan was developed for the IM&E studies (Attachment C) and was previously submitted to the SDRWQCB in August 2004. The sampling plan was approved by the SDRWQCB and the sampling was done for one year starting in June 2004 and continued into June 2005. The report is in the final stages of preparation.

As required in 40 CFR 125.95(b)(3), the results of the IM&E sampling program will be summarized in a report submitted as part of the CDS that includes the following:

- Taxonomic identifications of all life stages of fishes, shellfishes, and any threatened or endangered species collected in the vicinity of the CWIS and are susceptible to IM&E;
- Characterization of all life stages of the target taxa in the vicinity of the CWIS and a description of the annual, seasonal, and diel variations in IM&E; and
- Documentation of the current level of IM&E of all life stages of the target taxa.

The goal of the study was to characterize the fishes and shellfishes affected by impingement and entrainment by the EPS CWIS. The studies examined losses at the EPS resulting from impingement of juvenile and adult fishes and macroinvertebrates on traveling screens during normal operations and during heat treatment operations and entrainment of ichthyoplankton and invertebrates into the cooling water intake system. The sampling methodologies and analysis techniques were derived from recent impingement and entrainment studies conducted for the AES Huntington Beach Generating Station (MBC and Tenera 2005), and the Duke Energy South Bay Power Plant (Tenera 2004). The studies at Huntington Beach were performed as part of the CEC California Environmental Quality Act (CEQA) process for permitting power plant modernization projects, while the South Bay project was for 316(b) compliance.

9.1 Assessment of Cooling Water Intake System Effects

Considerable effort among regulatory agencies and the scientific community has been expended on the evaluation of power plant intake effects over the past three decades. Power plant intake effects occur due to impingement of larger organisms onto the intake screens and entrainment of smaller organisms through the CWIS that are smaller than the screen mesh on the intake screens. For the purposes of the EPS study we assumed that both processes lead to mortality of all impinged and entrained organisms. The variety of approaches developed to assess the CWIS

impacts reflects the many differences in power plant locations and resource settings (MacCall et al. 1983). The various approaches have been divided into those that offer a judgment on the presence or absence of impact and those that describe the sensitivity of populations to varying operational conditions. These efforts have helped to establish the context for the modeling approaches being used to estimate impingement and entrainment effects at the EPS.

Impact assessment approaches that will be used in the analysis of the entrainment data include:

- Adult-Equivalent Loss (*AEL*) (Horst, 1975; Goodyear, 1978);
- Fecundity Hindcasting (*FH*) proposed by Alec MacCall, NOAA/NMFS, and is related to the adult-equivalent loss approach; and
- Empirical Transport Model (*ETM*), which is similar to the approach described by MacCall et al. (1983), and used by Parker and DeMartini (1989).

The application of several models to estimate power plant effects is not unique (Murdoch et al. 1989; PSE&G 1993; Tenera 2000a; Tenera 2000b). Equivalent Adult Modeling (*AEL* and *FH*) is an accepted method that has been used in many 316(b) demonstrations (PSE&G 1993; Tenera 2000a; Tenera 2000b). The advantage of demographic models like *AEL* and *FH* is that they translate losses into adult fishes that are familiar units to resource managers. Estimates of entrainment losses from these demographic models can be combined with estimated losses to adult and juvenile organisms due to impingement to provide combined estimates of cooling water system effects. The U.S. Fish and Wildlife Service proposed the empirical transport model (*ETM*) to estimate mortality rates resulting from cooling water withdrawals at power plants (Boreman et al. 1978, 1981). The *ETM* estimates the conditional mortality due to entrainment while accounting for spatial and temporal variability in distribution and vulnerability of each life stage to power plant withdrawals. The *ETM* provides an estimate of power plant effects that may be less subject to inter-annual variation than demographic model estimates. It also provides an estimate of population-level effects not provided by demographic approaches. But the *ETM* calculations require information about the composition and abundance of larval organism from the source water, necessitating the collection of samples from additional stations. A description of each of these models and how they will be used to evaluate data collected in the IM&E study is included in the study plan (Attachment C).

The assessment approach used in the final report in the CDS for the EPS will also depend upon the facility's baseline calculations and its method(s) of compliance with the 316(b) Phase II performance standards for reductions in impingement mortality and entrainment. Compliance at EPS may be achieved by implementing either singly, or in combination the following: technological or operational changes to the CWIS (TIOP), restoration methods, or site-specific BTA standards. To demonstrate compliance through the TIOP it is only necessary to analyze

impingement and entrainment data to determine baseline levels and assess those levels against the improvements achieved through the implementation of the TIOP. In the case where restoration is limited to only commercially or recreationally important species (use species), impingement and entrainment data may also be adequate to assess the levels of restoration necessary to offset impingement and entrainment losses, assuming that scientifically valid population models exist for the species providing the lost benefits. In assessing compliance with the performance standard in whole or in part through restoration of habitat to include non-recreational and non-commercial species (non-use species) in addition to the losses of use species it is necessary to assess the impingement and entrainment losses also from the source water using a combination of assessment methods to determine the commensurate level of restoration. The same source water and entrainment data, and assessment methods would also be used to determine a site-specific BTA standard based on cost-benefit analysis of entrainment losses to all use and non-use species. Source water data would not be necessary for cost-benefit analysis based simply on the value of use species losses.

9.2 Target Species

Analysis of CWIS effects will be done on the most abundant organisms in the samples, and commercially or recreationally important species from entrainment and impingement samples. All fishes and shellfishes during the impingement sampling were identified and up to fifty individuals of each species of fishes, crabs, shrimp, lobsters, octopus, and squid were measured and weighed. In instances where more than fifty individual of any one species were collected, the first fifty were measured and the rest were counted and then weighted as a group. All other invertebrates were recorded as present. The following marine organisms were sorted, identified and enumerated from entrainment intake and source water plankton samples:

Vertebrates:

- Fishes (all life stages beyond egg)

Invertebrates:

- Rock crab megalopal larvae (*Cancer* spp.)
- California spiny lobster phyllosoma larvae (*Panulirus interruptus*)

These groups were also analyzed in most of the recent entrainment studies in southern California, including the AES Huntington Beach Generating Station. Fishes and rock crab larvae were selected because of their respective ecological roles or commercial and/or recreational fisheries importance. The California spiny lobster was selected because of its commercial and/or recreational importance in the area.

The organisms analyzed will be limited to taxa that are sufficiently abundant to provide reasonable assessment of impacts. For the purposes of this study plan, we will limit the analysis to the most abundant taxa that comprise 90 percent of all larvae entrained and/or juveniles and adults impinged by the EPS. The most abundant organisms are used in the assessment because they provide the most robust and reliable estimates of CWIS effects. Since the most abundant organisms may not necessarily be the organisms that experience the greatest effects on the population level, the data will be examined carefully before the final selection of target species to determine if additional species should be included in the assessment. This may include commercially or recreationally important species, and species with limited habitats.

9.3 Impingement

The following is a summary of the methods used to collect impingement samples at the EPS. More complete details are included in the attached 316(b) Cooling Water Intake Effects Entrainment and Impingement Sampling Plan (Attachment C). Sampling was completed during both normal operations periods and tunnel recirculation (heat treatment) events.

Each normal operations impingement survey was conducted over a 24-hour period one day each week from mid June 2004 through mid June 2005. Prior to each survey any accumulated debris and organisms on the bar racks and traveling screens was removed and discarded. Each 24-hour survey was divided into six 4-hour cycles. The traveling screens at EPS take approximately 30-35 minutes to complete a complete rotation and washing. The traveling screens generally remained stationary for a period of about 3.5 hours and then are rotated and washed for 30-35 minutes depending on traveling screen rotation speed. All impinged material rinsed from the traveling screens was rinsed into its respective collection basket. The impinged material was removed from these baskets and all organisms removed from the debris. Due to the design of the intake traveling screens, there are three collection basket assemblies, one for Units 1-3, one for Unit 4, and one for Unit 5. All impinged material from each set of screens was processed and recorded separately. Length and weight of up to 50 individual of each taxa of impinged fishes, crabs, lobsters, shrimp, gastropods, some pelecypods, octopus, and squid were recorded. If more than 50 individuals of any taxa were impinged on any set of screens during a single cycle, this extra group was counted and its total bulk weight was determined and recorded. All other invertebrates were recorded as present when observed. The amount and general identity of the debris collected during each screen cycle was also recorded. The number of circulating water pumps in operation during each survey, obtained from operator logs was used to calculate the volume of water passing through the traveling screens during each survey. The number of screens rotated during each cycle was also recorded during the screen washing periods.

EPS conducts tunnel recirculations to control biofouling organisms growing on the intake conduits. During these events, all impinged organism washed off the traveling screens and rinsed into the collection baskets were removed from debris and identified, counted, and measured using the same procedures used during the normal operations surveys. A total of six tunnel recirculations took place during this 2004-2005 study period.

The abundance and biomass of the organisms impinged during the once per week normal operations sampling will be used to estimate the impingement for the entire year by first estimating the weekly impingement. This is done by combining the information on the impinged organisms with the total circulating water flow for the period between surveys. These weekly estimates are then combined to estimate the annual impingement rate during normal operations. All organism impinged during tunnel recirculation events are combined with those impinged during normal operations to generate an estimate of the overall annual impingement of the CWS.

9.4 Entrainment


The following is a summary of the methods used to collect entrainment and source water plankton samples at the EPS. More complete details are included in the attached 316(b) Cooling Water Intake Effects Entrainment and Impingement Sampling Plan (Attachment C).

Sampling to determine the composition and abundance of larval fishes, *Cancer* spp. megalopae, and spiny lobster larvae at the EPS intake structure and in the local vicinity began in June 2004. The sampling was completed monthly thereafter, with the final sampling being completed in May 2005. Samples during each of these monthly surveys were collected over a 24-hour period, with sampling being divided into four 6-hour periods. Sampling was conducted near the intake structure to estimate larval entrainment, and at eight nearby stations in two sub-areas (~~three~~ *Four* stations in the AHL and five stations in the nearshore) to estimate larvae in the source water (Figure 7-1).

The samples at the entrainment location (E1), at all the nearshore stations (N#), and at the Outer Lagoon station (L1) were collected using a bongo net frame equipped with two 0.71 m (2.33 feet) diameter opening with attached 335 μ m (0.013 in) mesh plankton nets and codends. Each net had a calibrated flowmeter that was used to determine the volume of water filtered during sample collection. Samples were collected by first lowering the frame and nets from the surface to as close to the bottom as practical without contacting it, and then moving the boat forward and retrieving the nets at an oblique angle. The target volume of the combined volume filter through both nets was at least 2,120 feet³ (60 m³). After retrieving the nets from the water, all collected material was rinsed into the codend. The collected material from both nets was placed into a labeled jar and preserved.

Due to the shallow depths in the vicinity of the Middle (L2) and Inner Lagoon (L3 and L4) stations, especially during low tides, samples at these stations were collected using a different sampling protocol. These stations are sampled using a single plankton net and frame attached to the bow of a small boat that pushes the net through the water and collects a sample from approximately the upper 1 meter of water. By placing the net on the bow of the boat, the net collects a sample from undisturbed water. The collected material was rinsed into the codend and then placed into a labeled jar and preserved.

Figure 9-1
Location of EPS Entrainment (E1) and Source Water Stations (L1 through L4, and N1 through N5).



10.0 Summary

This PIC has been prepared in accordance with 40 CFR 125.95(b)(1) and is being submitted to the SDRWQCB prior to implementation of information collection activities. The following is a brief summary of the information collection activities described in this document that will be undertaken to support the development of the CDS, the plan for compliance with IM&E performance standards outlined in the EPA 316(b) Phase II Rule.

10.1 Evaluation of IM&E Reduction Measures

The EPS has selected several intake technologies, operational measures, and restoration measures that will be evaluated to determine effectiveness and feasibility of implementation, either alone or in combination, to achieve the required reductions in IM&E. In summary, these include the following:

Intake Technologies:

- Modified traveling screens with fish return
- New fine mesh screening structure

Operational Measures:

- Circulating water flow reductions / caps
- Variable speed drives for circulating water pumps
- Heat Treatment Operational Changes

Restoration Measures:

- Restoration or Enhancement of AHL (various)
- Restoration or Enhancement of Agua Hedionda Watershed (various)
- Restoration or Enhancement of Nearshore coastal projects (various)

Preliminary assessments of these IM&E reduction measures will be conducted to determine those which warrant further evaluation. A more detailed evaluation of those measures will be conducted and a combination of the most feasible measures proposed to meet IM&E performance standards will be presented in the CDS.

10.2 Impingement Mortality & Entrainment Sampling Plan

The IM&E Characterization Study Plan that was the basis for the 2004-2005 EPS IM&E Study is included in Attachment C. The study plan described the collection, analysis, and evaluation methodologies for the twelve months of impingement and entrainment sampling data at the EPS.

The following are the main components of the sampling effort:

Impingement:

1. Weekly impingement sampling at each CWIS during normal plant operations
2. Impingement sampling at the CWIS during each heat treatment cycle

Entrainment:

1. Monthly entrainment sampling at the CWIS
2. Source waterbody sampling at five near shore source water locations and four lagoon source water locations

The characterization study plan also describes the sampling, quality assurance / quality control (QA/QC), and data management procedures that will be used in the study. Results of the study will be used to:

1. Determine the current level of IM&E occurring at the CWIS.
2. Compare the level of IM&E occurring due to the location, design, and operation of each existing CWIS with that which would occur if the CWIS were designed as a "calculation baseline" intake.
3. Determine the additional level of reduction in IM&E that would be required to meet performance standards.
4. Assist in the determination of the most feasible combination of intake technologies, operational measures, and/or restoration measures that may be implemented to reduce IM&E to vulnerable species.

10.3 Agency Review of PIC

As required by the EPA 316(b) Phase II regulation, this PIC is being submitted in accordance with the schedule requested by EPS in a letter dated January 6, 2005 to the SDRWQCB. The regulation requires that the SDRWQCB "*provide their comments expeditiously (i.e. within 60 days) to allow facilities time to make response modifications in their information collection plans*" (Federal Register, Vol. 69, No. 131, Pg. 41635). EPS has completed the IM&E sampling following its approved plan (Attachment C) and is working toward completing the final study report. The EPS PIC represents the rest of the requirement information to comply with the PIC requirements of Phase II 316(b) and EPS respectfully requests that SCRWQCB approve the PIC within 60 days such that work may begin on the CDS in order to meet the January 8, 2008 due date.

11.0 References

- Boreman, J., C.P. Goodyear, and S.W. Christensen, 1978. *An Empirical Transport Model For Evaluating Entrainment Of Aquatic Organism By Power Plants*. United States Fish and Wildlife Service. FWS/OBS-78/90, Ann Arbor, MI.
- Boreman, J., C.P. Goodyear, and S.W. Christensen, 1981. *An Empirical Methodology For Estimating Entrainment Losses At Power Plants Sited On Estuaries*. Trans. Amer. Fish. Soc. 110:253-260.
- Bradshaw, J. S. and G. N. Estberg, 1973. *An Ecological Study of the Subtidal Marine Life of Agua Hedionda Lagoon*. Environmental Studies of the University of San Diego. Submitted to SDG&E, Part 1, 99 pp; Part 2. 123 pp.
- Bradshaw, J. S. B. Browning, K. Smith, and J. Speth, 1976. *The Natural Resources of Agua Hedionda Lagoon*. U. S. Fish and Wildlife Service. Coastal Wetland Series #16. 109 pp.
- Coastal Environments, Inc, 2005. *Agua Hedionda Lagoon Hydrodynamics Studies*. Prepared for Tencera Environmental by Coastal Environments, La Jolla, CA. 34 pp. + Appendices.
- EA Engineering, Science, and Technology, 1997. *Encina Power Plant Supplemental 316(b) Assessment Report*. Prepared for San Diego Gas and Electric Company.
- EPRI (Electric Power Research Institute), 1986. *Assessment Of Downstream Migrant Fish Protection Technologies For Fish Protection*. Prepared by Stone & Webster for EPRI. Report AP-4711. September.
- EPRI, 1986. *Assessment of Downstream Migrant Fish Protection Technologies for Hydroelectric Application*. EPRI Report No. 2694-1.
- EPRI, 1988. *Field Testing of Behavioral Barriers for Fish Exclusion at Cooling Water Intake Systems*. Central Hudson Gas & Electric Company – Roseton Generating Station. Prepared by Lawler, Matuskey & Skelly Engineers. Report CS-5995, September.
- EPRI, 1990. *Fish Protection Systems for Hydro Plants. Test Results*. Prepared by Stone & Webster. EPRI Report GS-6712. February.
- EPRI, 1992. *Evaluation of Strobe Lights for Fish Diversion at the York Haven Hydroelectric Project*. Prepared by Stone & Webster. Report TR-101703; November.
- EPRI, 1999. *Status Report on Fish Protection at Cooling Water Intakes*. Prepared by Alden Research Laboratory. Report TR-114013. November.
- Federal Register/Vol. 69, No. 131/Friday, July 9, 2004/Rules and Regulatory. *National Pollutant Discharge Elimination System-Final Regulations to Establish Requirements for Cooling Water Intake Structures at Phase II Existing Facilities*. July.

Goodyear, C.P., 1978. *Entrainment Impact Estimates Using The Equivalent Adult Approach*. U.S. Fish Wild. Ser. Rep. FWS/OBS-78/65. Ann Arbor, Mich.

Haaker P. L., J. M. Duffy, K. C. Henderson, and D. O. Parker, 1988. *The Speckled Scallop, Argopecten Circularis, In Aqua Hedionda Lagoon, San Diego County, California*. California Department of Fish and Game Technical Report.

Horst, T.J., 1975. *The Assessment Of Impact Due To Entrainment Of Ichthyoplankton*. Pp. 107-118 in: S.B. Saila (ed.), *Fisheries and Energy Production: A Symposium*. D.C. Heat and Co., Lexington, Mass.

Kramer, S.H., 1990. *Habitat Specificity and Ontogenetic Movements of Juvenile California Halibut, Paralichthys Californicus, and Other Flatfishes in Shallow Waters of Southern California*. Southwest Fisheries Science Center, National Marine Fisheries Service, NOAA.

Kuhl, G.M., and K.N. Mueller, 1988. *Prairie Island Nuclear Generating Plant Environmental Monitoring Program 11988 Annual Report; Fish Mesh Vertical Traveling Screens Impingement Survival Study*. Northern States, Power Company, Minneapolis, MN.

MBC Applied Environmental Sciences and Tenera Environmental. 2005. AES Huntington Beach L.L.C. *Generating Station Entrainment and Impingement Study: Final Report*. Prepared for AES Huntington Beach L.L.C. and the California Energy Commission. April. 2005. 224 p. + Appendices.

MEC Analytical Systems, 1995. 1994 and 1995. *Field Survey Report Of The Ecological Resources Of Agua Hedionda Lagoon*. Submitted to San Diego Gas and Electric Company. 47 pp. + Appendices.

Monitoring Program, 1988 Annual Report: Fine-mesh Vertical Traveling Screens Impingement Survival Study. Prepared for Northern States Power Company.

Gunderboom Promotional Brochure.

MacCall, A.D., K.R. Parker, R. Leithiser, and B. Jesse, 1983. *Power Plant Impact Assessment: A Simple Fishery Production Model Approach*. Fishery Bulletin U.S. 81(3):613-619.

Murdoch, W.W., R.C. Fay, and B.J. Mechalas, 1989. *Final Report of the Marine Review Committee to the California Coastal Commission*, MRC Doc. No. 89-02, 346 p.

Parker, K.R. and E. DeMartini, 1989.. *Adult-equivalent loss. Technical Report to the California Coastal Commission, Marine Review Committee, Inc.* 56 p.

P. F. Shires, E. P. Taft, 1996. *Evaluation of the Modular Inclined Screen (MIS) at the Green Island Hydroelectric Project: 1995 Test Results*. Electric Power Research Institute (EPRI) Report TR-104498; May.

Public Service Electric and Gas Company. 1993. Appendix I—Modeling. Permit No. NJ0005622. Prepared by Lawler, Matusky, and Skelly Engineers, Pearl River, NY. Comments on NJPDES Draft. 82 p.

San Diego Gas and Electric (SDG&E). 1980. *Encina Power Plant Cooling Water Intake System Demonstration*. Prepared for California Regional Water Quality Control Board, San Diego Region. December 1980.


S. V. Amaral, F. C. Winchell, T. C. Cook, E. P. Taft; 1994. *Biological Evaluation of a Modular Inclined Screen for Protecting Fish at Water Intakes*; Electric Power Research Institute (EPRI) Report TR-104121; May.


Tenera Environmental. 2000a. *Diablo Canyon Power Plant: 316(b) Demonstration Report*. Prepared for Pacific Gas and Elec. Co., San Francisco, CA. Doc. No. E9-055.0.

Tenera Environmental. 2000b. *Moss Landing Power Plant Modernization Project: 316(b) Resource Assessment*. Prepared for Duke Energy Moss Landing, L.L.C., Oakland, CA.

Weight, R.H., 1958. *Ocean Cooling Water System for 800 MW Power Station*, Journal of the Power Division, Proceedings of the American Society of Civil Engineers, Dec 1958.

Attachment A
Structural Design Drawings

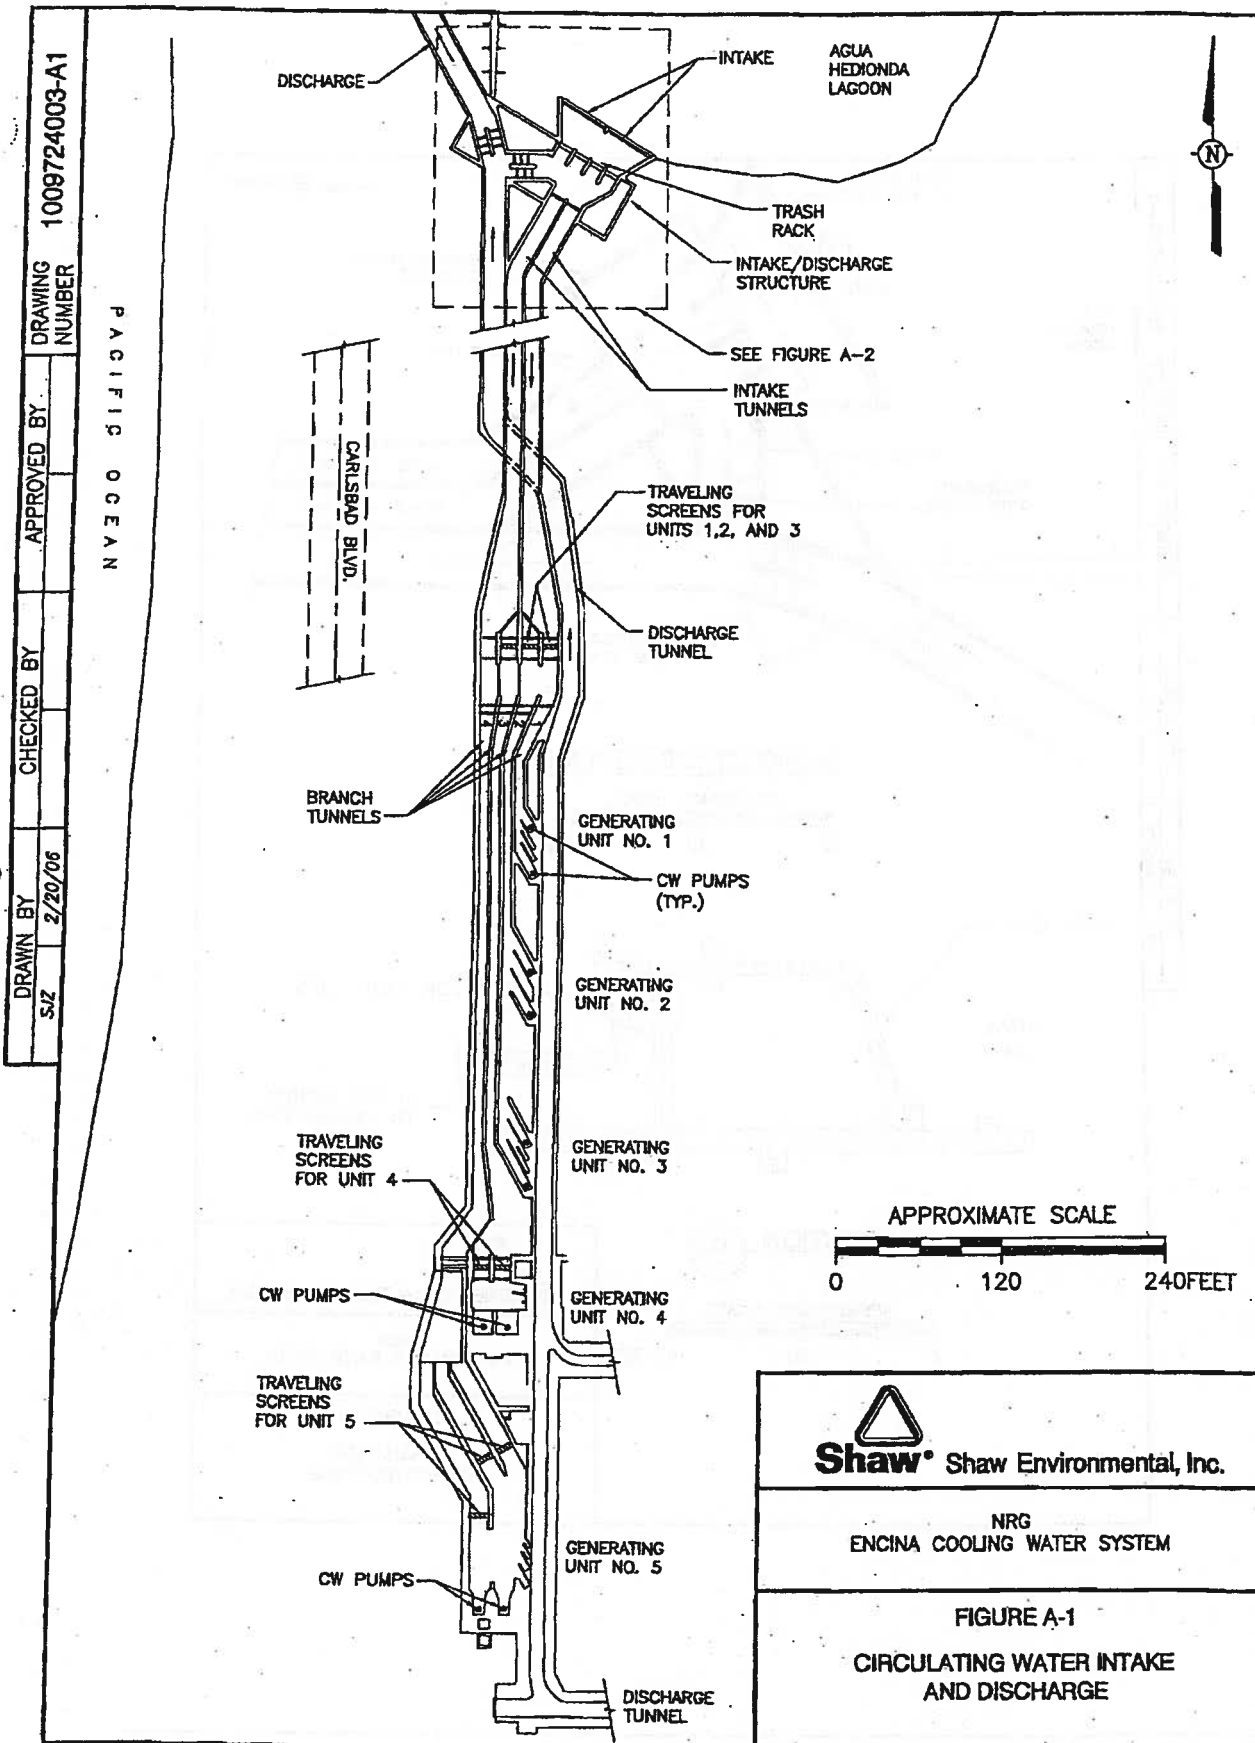

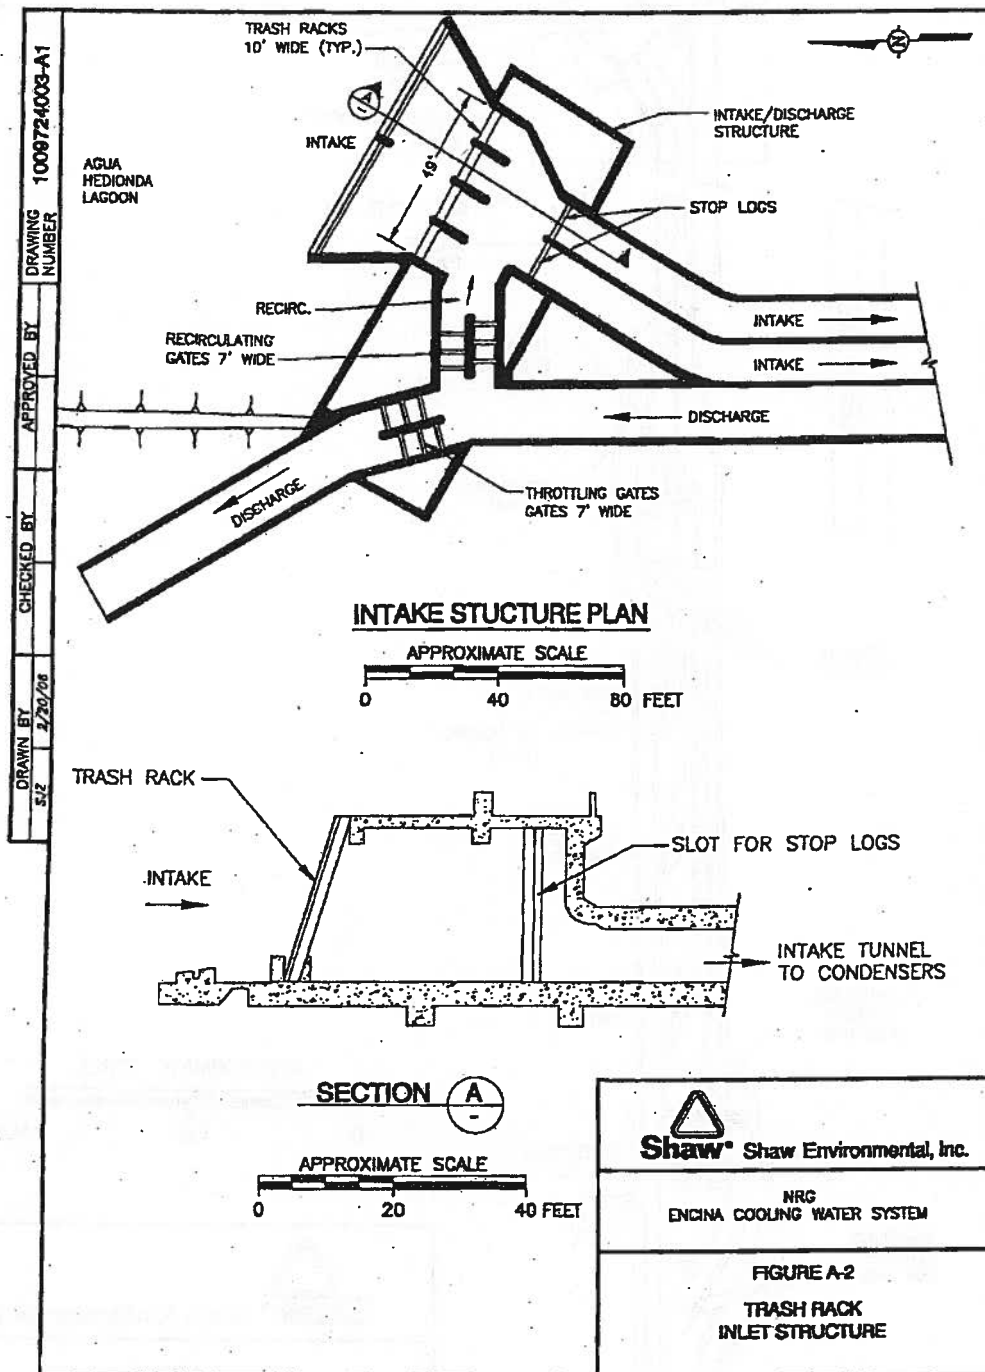

Encina Power Station
4500 Carlsbad Boulevard
Carlsbad, CA 92008-4301

Direct: (760) 268-4000
Fax: (760) 268-4026

NRG CABRILLO POWER OPERATIONS INC.

January 10, 2005

Mr. John Phillips
San Diego Regional Water Quality Control Board
9174 Sky Park Court, Suite 100
San Diego, CA 92123-4340

**RE: Cabrillo Power I LLC - Encina Power Station;
Request for Schedule to Submit Information to Comply with the Phase II 316(b)
Rule (40 CFR Part 125 Subpart J)**

Ref: NPDES Permit Number CA0001350, Order No. 2000-03

Dear Mr. Phillips,

By this letter Cabrillo Power I LLC (Cabrillo) requests a schedule for submitting the information required by EPA's new Phase II 316(b) Rule for cooling water intake structures for the Encina Power Station (EPS). For the reasons to be presented in the following letter, Cabrillo requests your approval to allow the information required by 40 CFR 125.95 to be submitted to you no later than January 7, 2008. In our circumstances, this date is as "expeditious as practicable." The basis for our request is explained below.

As you know, on July 9, 2004, EPA published its final rule prescribing how "existing facilities" may comply with Section 316(b) of the Clean Water Act.¹ For most existing facilities, this rule will require a large amount of data to establish "best technology available" for the facility's intake structure and to demonstrate compliance with the rule.

EPS is a "Phase II existing facility" within the meaning of 40 CFR 125.91. As such, it is required to comply with the Phase II rule, and in particular to submit the studies and information required by 40 CFR 125.95.

Section 125.95 of the new rule requires detailed studies and other information to establish what intake structure technology or other measures will be used to comply with the rule. Ordinarily this material is to be submitted with the facility's next application for renewal of its NPDES permit.² For permits that expire less than four years after the rule was published on July 9, 2004 (that is, before July 9, 2008), the facility may have up to three and half years to submit the information, so long as it is submitted "as expeditiously as practicable."³ The facility may

¹ 69 Fed. Reg. 41575, 41683 (July 9, 2004).

² 40 CFR 125.95, 122.21(c)(1)(ii), 122.21(d)(2).

³ 40 CFR 125.95(a)(2)(ii).

Mr. John Phillips
Cabrillo Power 316(b) Request for Schedule
January 10, 2005
Page 2 of 7

have even longer, until the end of the permit term, under 40 CFR 122.21(d)(2)(i), if the permitting agency agrees.

The current NPDES permit for EPS expires on February 9, 2005, well before July 9, 2008. Therefore, Cabrillo hereby requests that you authorize the information called for in 125.95 to be submitted as expeditiously as practicable, which, as explained below, will require until January 7, 2008.

In order to satisfy the "expeditiously as practicable" requirement, it should be noted that Cabrillo began the process of collecting the necessary information even before the final rule was published. Cabrillo actually began as early as 2003 to begin collecting information and conducting internal evaluations on how the, at that time draft, requirements could be complied with at EPS. Such information collection included preliminary technology assessments and research into existing data and information. Cabrillo also initiated an impingement and entrainment sampling program in June 2004 that is scheduled to conclude toward the end of 2005.

Despite our early efforts, we will still need until January 7, 2008, to complete the studies and collect the information required by 40 CFR 125.95. Our detailed explanation is presented below by first summarizing the significant number of informational requirements that must be submitted and then concludes by presenting the schedule by which the information would be submitted.

Cooling Water System Data

First, all facilities covered by the Phase II Rule must submit "cooling water system data" as required by 40 CFR 122.21(r)(5). This includes a narrative description of the operation of the cooling water system, its relationship to cooling water intake structures, the proportion of the design intake flow that is used in the system, the number of days of the year the cooling water system is in operation, and the seasonal changes in the operation of the system, if applicable. It also includes design and engineering calculations prepared by a qualified professional and supporting data to support the description of the operation of the cooling water system.⁴ This information must be submitted at the same time as the Comprehensive Demonstration Study as discussed below.⁵

Proposal for Information Collection

Under 40 CFR 125.95(a)(1), Cabrillo must also submit a Proposal for Information Collection (PIC). Preparing the PIC is a large undertaking. The PIC must contain the items listed in 40 CFR 125.95(b)(1), including a description of proposed and/or implemented technologies, operational measures, and/or restoration measures to be evaluated, a list and description of historical studies characterizing impingement mortality and entrainment and/or the

⁴ 40 CFR 122.21(R)(5)(i) and (ii).

⁵ 40 CFR 125.95(a)(2).

Mr. John Phillips
Cabrillo Power 316(b) Request for Schedule
January 10, 2005
Page 3 of 7

physical and biological conditions in the vicinity of the cooling water intake structures and their relevance to the proposed study. For existing data, it must demonstrate the extent to which the data are representative of current conditions and that the data were collected using appropriate quality assurance/quality control procedures. The PIC must also include a summary of past or ongoing consultations with federal, state and tribal fish and wildlife agencies and a copy of their written comments, as well as a sampling plan for any new field studies describing all methods and quality assurance/quality control procedures for sampling and data analysis. As you know, Cabrillo already submitted the sampling plan portion of the PIC on September 2, 2004, which was later approved by the San Diego Regional Water Quality Control Board (Regional Board). The impingement and entrainment sampling actually commenced in June 2004 and is expected to conclude toward the end of 2005.

Because of the magnitude and specialized nature of the information to be submitted in the PIC, Cabrillo will have to contract with an outside consulting firm to obtain qualified personnel to perform the work and to handle the increased workload. Cabrillo's contractor procurement process has precise steps that must be undertaken to conform to internal policies and procedures and applicable law.

Including the time it takes to contract with a qualified consulting firm and to develop the PIC using the impingement and entrainment data collected during 2004 and 2005, Cabrillo believes a comprehensive PIC could not be submitted for the Regional Board's review and approval any earlier than April 1, 2006. Cabrillo asks that the Regional Board either approve it or advise us of any needed changes within 60 days as described in 40 CFR 125.95(a)(1), 125.95(b)(1).

Comprehensive Demonstration Study

The Comprehensive Demonstration Study (CDS), as described in 40 CFR 125.95(b), includes many mandatory sections that require substantial effort and time to develop and submit. Many sections of the CDS require that the information collection process described in the PIC be completed prior to being able to initiate those sections of the CDS. Because the PIC data collection will not be completed until early 2006, as described below in the Impingement Mortality and/or Entrainment Characterization Study section, much of the CDS will have to be completed during calendar years 2006 and 2007. This will most likely be a significant time constraint due to the level of work required by the Phase II 316(b) regulation. Below, ESP will describe each section of the CDS in detail, providing ample justification that Cabrillo's proposed complete CDS submission schedule is "as expeditiously as practicable."

Source Water Flow Information

Because EPS does not operate on a river or a lake, no specific source waterbody flow information is required to be submitted.⁴

Impingement Mortality and/or Entrapment Characterization Study

Cabrillo must provide, pursuant to 40 CFR 125.95(b)(3), an Impingement Mortality and/or Entrapment Characterization Study. This study must include (i) taxonomic identifications of all life stages of fish, shellfish, and any species protected under federal, state, or tribal law that are in the vicinity of the cooling water intake structures and are susceptible to impingement and entrainment; (ii) a characterization of all life stages of fish, shellfish, and any protected species, including a description of the abundance and temporal and spatial characteristics in the vicinity of the cooling water intake structures, based on sufficient data to characterize annual, seasonal, and other variations in impingement mortality and entrainment (e.g., related to climate and weather differences, spawning, feedings, and water column migration). These may include historical data that are representative of current operation of the facility and of biological conditions at the site.

Cabrillo must also document the current impingement mortality and entrainment of all life stages of fish, shellfish, and protected species and provide an estimate of impingement mortality and entrainment to be used as the "calculation baseline."⁵ This may include historical data representative of the current operation of the facility and of biological conditions at the site. Impingement mortality and entrainment samples to support the calculations must be collected during periods of representative operational flows for the cooling water intake structure, and the flows associated with the samples must be documented.

Cabrillo expects to submit, within the PIC document, justification for using the historical and representative impingement and entrainment data as well as the new data being collected during calendar years 2004 and 2005. As described above, impingement and entrainment sampling at EPS was initiated in June 2004 and is expected to continue through the end of 2005, which includes the necessary time to complete taxonomic identification, modeling, and development of draft and final reports.

Cabrillo plans on submitting its final PIC after submittal and review of the Impingement and Entrapment Characterization Study Final Report so that all of the collected information and its results can be incorporated into the development of the PIC. This appears to be the most efficient and complete way to produce the PIC, as the information from that study is necessary to complete the other components of the PIC, as described above. Since the Impingement and Entrapment Characterization Study Final Report is not expected to be complete until the end of 2005, the most expeditious submittal date for the final PIC is April 1, 2006.

⁴ 40 CFR 125.95(b)(2) only requires source water information for facilities that withdraw water from rivers or lakes other than the Great Lakes. Although not specifically required, a characterization of the source water will be provided in the report on the results of the Impingement and Entrapment Characterization Study.
⁵ 40 CFR 125.95(b)(3)(iii).

Design and Construction Technology Plan

Another analysis that must be provided is the Design and Construction Technology Plan.⁸ If Cabrillo decides to use design and construction technologies and/or operational measures to comply with the Phase II rule, a plan must be submitted that provides the capacity utilization rate for the intake structure at EPS and provide supporting data (including the average annual net generation of the facility in MWh) measured over a five-year period (if available) of representative operating conditions and the total net capacity of the facility in MW, along with the underlying calculations. The plan must explain the technologies and/or operational measures that Cabrillo has in place and/or have selected to meet the requirements of the rule.

This Design and Construction Technology Plan must contain a large amount of information, as described in 40 CFR 125.95(b)(4)(A)-(D). This information includes (A) a narrative description of the design and operation of all design and construction technologies and/or operational measures, including fish handling and return systems, and information that demonstrates the efficacy of the technologies and/or operational measures; (B) a narrative description of the design and operation of all design and construction technologies and/or operational measures and information that demonstrates the efficacy of the technologies and/or operational measures for entrainment; (C) calculations of the reduction in impingement mortality and entrainment of all life stages of fish and shellfish that would be achieved by the technologies and/or operational measures we have selected; and (D) design and engineering calculations, drawings, and estimates prepared by a qualified professional to support the descriptions described above.

Technology Installation and Operation Plan (TIOP)

Assuming Cabrillo decides that the best way to comply with the Phase II rule is to use design and construction technologies and/or operational measures, in whole or in part, we must submit to you the following information, in accordance with 40 CFR 125.95(b)(4)(ii): (A) A schedule for the installation and maintenance of any new design and construction technologies; (B) a list of operational and other parameters to be monitored and the location and frequency that we will monitor them; (C) a list of activities we will undertake to ensure to the degree practicable the efficacy of installed design and construction technologies and operational measures and our schedule for implementing them; (D) a schedule and methodology for assessing the efficacy of any installed design and construction technologies and operational measures in meeting applicable performance standards or site-specific requirements, including an "adaptive management plan" for revising design and construction technologies, operational measures, operation and maintenance requirements, and/or monitoring requirements in the event the assessment indicates that applicable performance or site-specific requirements are not being met; and (E) if Cabrillo chooses the compliance alternative in 125.94(a)(4) (wedge-wire screens or a technology approved by the state), documentation that the appropriate site conditions described in 125.99(a) or (b) exist at our facility.

⁸ 40 CFR 125.95(b)(4).

Restoration Plan

If Cabrillo determines that restoration measures are the best method to comply with the new rule, in whole or in part, then a Restoration Plan must be submitted in the CDS. This plan must include the information described in 40 CFR 125.95(b)(5). It must include a plan using an adaptive management method for implementing, maintaining, and demonstrating the efficacy of the restoration measures that are selected and for determining the extent to which the restoration measures, or the restoration measures in combination with design and construction technologies and operational measures, have met the applicable performance standards.

Site-Specific Requirements

If Cabrillo determines that site-specific requirements are appropriate because the cost of complying with the Phase II rule will be "significantly greater" than either the cost that EPA considered in its rulemaking or the benefits of complying with the rule, then Cabrillo will have to submit the information described in 40 CFR 125.95(b)(6). This includes a Comprehensive Cost Evaluation Study and, for the cost-benefit analysis, a Benefits Evaluation Study. Cabrillo must also include a Site-Specific Technology Plan describing and justifying the site-specific requirements.

Verification Monitoring Plan

Finally, Cabrillo must prepare a Verification Monitoring Plan as part of a complete CDS.⁹ This is a plan to conduct, at a minimum, two years of monitoring to verify the full-scale performance of the proposed or already implemented technologies and/or operational measures.

PIC and CDS Schedule

The first official submittal (besides this request for a schedule) that Cabrillo will make to the Regional Board in compliance with the Phase II 316(b) regulation will be the PIC. For the reasons explained above, Cabrillo proposes to submit a comprehensive PIC for the Regional Board's review and approval by April 1, 2006. Cabrillo asks that the Regional Board either approve the PIC or advise us of any needed changes within 60 days as described in 40 CFR 125.95(a)(1), 125.95(b)(1).

Because Cabrillo plans to collect substantial new information as part of the expected PIC, and since the report presenting the results of the new impingement and entrainment data collected in 2004 and 2005 will not be finalized until the end of 2005, and allowing for the period of time the Regional Board has to review and approve the PIC, it is unlikely that the information needed to commence the majority of the sections of the CDS (including the Design and Construction Technology Plan, the Technology Installation and Operation Plan, the

⁹ 40 CFR 125.95(b)(7).

Mr. John Phillips
Cabrillo Power 316(b) Request for Schedule
January 10, 2005
Page 7 of 7

Restoration Plan (if applicable), the Site Specific Requirements (if applicable), and the Verification Monitoring Plan) will be available until mid to late 2006.

Due to the step by step process by which the data must be collected, processed, evaluated, and then turned into a detailed plan of action to achieve the new Phase II 316(b) standards, Cabrillo does not believe a comprehensive CDS can be submitted earlier than January 7, 2008. It is for these important reasons that Cabrillo believes the most expeditious schedule possible for submittal of a comprehensive CDS is by January 7, 2008.


Conclusion

Collecting, generating, compiling, and analyzing the large amount of information required by the Phase II 316(b) rule will require a substantial effort. Cabrillo will have to collect and review the large volumes of already-existing data on the plant and the source waterbody, as well as integrate the substantial new biological information currently being collected.

Because the Phase II rule is new and untried, we foresee the need to coordinate closely with your department as we collect the necessary information, analyze it, and determine what combination of technology, operational measures, or restoration measures will best meet the Phase II rule for EPS. Cabrillo hopes your staff will be available to consult with us throughout this schedule as we complete these efforts.

For the above reasons, we request that we be allowed until January 7, 2008, to submit the information required for a permit application by the Phase II Rule, 40 CFR Part 125 Subpart J.

Sincerely,
Cabrillo Power LLC
By: Its Authorized Agent,


By: NRG Cabrillo Power Operations Inc.
Gregory J. Hughes
Regional Plant Manager

cc: ~~Sheila Hamik (Cabrillo)~~
Sheila Hamik (Cabrillo)
John Steinbeck (Ticarra)
Pedro Lopez (Cabrillo)
Hashim Navrozali (Regional Board)

Attachment C
Impingement Mortality & Entrainment
Characterization Study Sampling Plan

Encina Power Station
4600 Carlsbad Boulevard
Carlsbad, CA 92008-4301

Direct: (760) 268-4000
Fax: (760) 268-4026

NRG CABRILLO POWER OPERATIONS INC.

September 2, 2004

Mr. John R. Phillips, P.E.
Senior Water Resource Control Engineer
San Diego Regional Water Quality Control Board
9174 Sky Park Court, Suite 100
San Diego, CA 92123-4340

**Subject: Cabrillo Power I LLC - Encina Power Station;
Phase II 316(b) Entrainment and Impingement Sampling Plan**

Dear Mr. Phillips;

Cabrillo Power I LLC (Cabrillo) is pleased to submit a plan to conduct entrainment and impingement sampling for the Encina Power Station (EPS) to comply with the US EPA's recently published Phase II rule for compliance with Section 316(b) of the Clean Water Act. The approval of the EPS Entrainment & Impingement Sampling Plan (E&I Plan) is one of the early steps in the facility's compliance with the Phase II rule. Cabrillo requests expedited review and approval of this E&I Plan in order to optimize the sampling synergies available by virtue of the data collection efforts already underway on behalf of Poseidon Resources (Poseidon) for their proposed desalination project at EPS.

This sampling plan was prepared by Tenera Environmental (Tenera), which is the same firm that prepared the desalination sampling plan submitted to the San Diego Regional Water Quality Control Board (San Diego RWQCB) on behalf of Poseidon in July 2004. Consistent with that sampling plan, Poseidon has already collected several complete sets of entrainment and source water samples at EPS. The Poseidon study plan and collected data will produce information on the larval fish and target invertebrates contained in Poseidon's source of desalination feedwater (the power plant's cooling water discharge), as well as information on the larval fish and target invertebrates contained in the power plant's source waterbody and intake flows.

Data being collected for Poseidon on the power plant's source population of entrainable larval fish and target invertebrates is identical to the information Cabrillo will be required to collect and analyze for EPS Phase II 316(b) studies. Tenera has prepared this sampling plan to seamlessly and consistently continue the collection of the Poseidon entrainment data. In that way, Cabrillo can continue the sampling effort for compliance with the new Phase II performance standards in an efficient and cost-effective manner.

Mr. John Phillips

Encina Power Station 316(b) Entrainment and Impingement Sampling Plan

Page 2 of 2

In the past five years, Tenera has completed 316(b) resource assessments for the Diablo Canyon Nuclear Power Plant, Moss Landing Power Plant, Morro Bay Power Plant and Potrero Plant. Tenera study design and assessment methods are also being employed in the ongoing 316(b) studies for the Huntington Beach Generating Station. Throughout these projects, Tenera has worked closely with State and Federal agencies in the development of their field study, impact assessment, and benefits evaluation methods. Tenera has also just recently completed a 316(b) resource assessment for the South Bay Power Plant that has been presented in final form to the San Diego RWQCB. Cabrillo's proposed E&I Plan has been developed in consideration of, and in keeping with, the 316(b) study rationales, content, sampling methodology, analysis and reporting that were used in the South Bay Power Plant 316(b) Assessment (Duke Energy South Bay, May 2004), as well as all of the power plants listed above.

This submission of the EPS E&I Plan is intended to meet part of the requirements for the Proposal for Information Collection (PIC) section of the Phase II 316(b) regulation, but not to address all of the PIC requirements at this time. All of the sampling plan requirements specified in Section 125.95(b)(1)(iv) are incorporated into the EPS E&I Plan. At a later date, Cabrillo will submit the remainder of the PIC requirements pursuant to Section 125.95(b)(1). Cabrillo requests approval of this E&I Plan specifying how new E&I data will be collected, but acknowledges that the San Diego RWQCB will be able to review the other portions of the PIC once submitted by Cabrillo.


Therefore, in order to provide continuous, efficient and cost-effective sampling at EPS, Cabrillo requests that the San Diego RWQCB expedite review and approval of this E&I Plan. Cabrillo understands that San Diego RWQCB is considering retaining an outside consultant in order to provide timely response to this request. Cabrillo is available and prepared to work with your staff and the consultant to provide any additional clarification necessary to obtain timely approval.

Please contact Tim Hemig directly at 760.268.4037 if there are any questions.

Sincerely,

Cabrillo Power I LLC

By: Its Authorized Agent,



By: NRG Cabrillo Power Operations Inc.

Gregory J. Hughes

Regional Plant Manager

cc: Tim Hemig, Sheila Henika, John Steinbeck (Tenera)

Cabrillo Power I LLC, Encina Power Station
316(b) Cooling Water Intake Effects
Entrainment and Impingement Sampling Plan

*Submitted to the California Regional Water Quality Control
Board – San Diego Region for Compliance with Section 316(b)
of the Clean Water Act*

September 2, 2004

Prepared by:
Tenera Environmental
971 Dewing Ave. Suite 101
Lafayette, CA 94549

225 Prado Rd. Suite D
San Luis Obispo, CA 93401

TABLE OF CONTENTS

1.0 INTRODUCTION.....	1
1.1 Development of the 316(b) Sampling Plan	1
1.2 Overview of the 316(b) Program	1
1.2.1 Target Organisms Selected for Study	1
1.3 Sampling Plan Organization.....	2
2.0 DESCRIPTION OF THE ENCINA POWER STATION AND CHARACTERISTICS OF THE SOURCE WATER BODY.....	3
2.1 Background	3
2.1.1 Plant Cooling Water System Description and Operation.....	3
2.2 Aquatic Biological Resources in the Vicinity of EPS.....	7
2.2.1 Agua Hedionda Lagoon	7
2.2.2 Pacific Ocean	8
3.0 ENTRAINMENT STUDY AND ASSESSMENT METHODS.....	10
3.1 Entrainment Study.....	10
3.1.1 Entrainment Sampling Methods	11
3.2 Source Water Study.....	12
3.2.1 Source Water Sampling Methods	13
3.3 Laboratory Processing and Data Management.....	14
3.4 Assessment Methods	14
3.4.1 Demographic Approaches (FH and AEL)	15
3.4.2 Empirical Transport Model (ETM).....	17
4.0 IMPINGEMENT EFFECTS	18
4.1 Review of 1980 Impingement Study.....	18
4.2 Impingement Study Methods	19
4.2.1 Sampling Frequency	21
5.0 COOLING WATER SYSTEM IMPACT ASSESSMENT	23



5.1 Entrainment Effects Assessment	23
5.2 Summary of Entrainment Effects	24
5.3 Summary of Impingement Effects	24
6.0 LITERATURE CITED	25

LIST OF TABLES

Table 1. Encina Power Station generation capacity and cooling water flow volume	3
Table 2. Cooling water approach velocities at EPS intake screens	4

LIST OF FIGURES

Figure 1. Location of 2004 Encina Power Station	5
Figure 2. Schematic of Encina Power Station cooling water intake system	6
Figure 3. Location of 2004 Encina Power Station entrainment and source water stations	12



1.0 INTRODUCTION

1.1 Development of the 316(b) Sampling Plan

This document presents a sampling plan for conducting the entrainment and impingement sampling necessary for a cooling water intake assessment required under Section 316(b) of the Federal Clean Water Act (CWA). Our sampling plan is based on a survey and compilation of available background literature, results of completed Encina Power Station (EPS) intake studies, and cooling water system studies at other power plants. The data from this study will form the basis of demonstrating compliance with the new Phase II regulations recently developed by the U.S. Environmental Protection Agency (USEPA).

1.2 Overview of the 316(b) Program

Section 316(b) of the Clean Water Act requires that "the location, design, construction, and capacity of cooling water intake structures reflect the best technology available for minimizing adverse environmental impact" (USEPA 1977). Because no single intake design can be considered to be the best technology available at all sites, compliance with the Act requires a site-specific analysis of intake-related organism losses and a site-specific determination of the best technology available for minimizing those losses. Intake-related losses include losses resulting from entrainment (the drawing of organisms into the cooling water system) and impingement (the retention of organisms on the intake screens).

1.2.1 Target Organisms Selected for Study

The USEPA in its original 316(b) lists several criteria for selecting appropriate target organisms for assessment including the following:

1. representative, in terms of their biological requirements, of a balanced, indigenous community of fish, shellfish, and wildlife;
2. commercially or recreationally valuable (e.g., among the top ten species landed—by dollar value);
3. threatened or endangered;
4. critical to the structure and function of the ecological system (i.e., habitat formers);
5. potentially capable of becoming localized nuisance species;
6. necessary, in the food chain, for the well-being of species determined in 1–4; and
7. meeting criteria 1–6 with potential susceptibility to entrapment/impingement and/or entrainment.



In addition to these USEPA criteria there are certain practical considerations that limit the selection of target organisms such as the following:

- identifiable to the species level;
- collected in sufficient abundance to allow for impact assessment, i.e., allowing the model(s) constraints to be met and confidence intervals to be calculated; and
- having local adult and larval populations (i.e., source not sink species). For example, certain species that may be relatively abundant as entrained larvae may actually occur offshore or in deep water as adults.

These criteria, results from the previous 316(b) studies at EPS completed in 1980, results from a supplemental 316(b) study completed in 1997 (EA Engineering 1997), results from more recent studies on the ecological resources of Aqua Hedionda Lagoon (MEC Analytical Systems 1995), and data collected from studies described in this document will be used to determine the appropriate target organisms that will be evaluated in detail. The final target taxa will include the fishes that are found to be most abundant in the entrainment and impingement samples. In addition to large invertebrates that may be abundant in impingement, megalopal (final) larval stage of all species of cancer crabs (*Cancer* spp., which includes the edible species of rock crabs) and the larval stages of California spiny lobster will be identified and enumerated from all processed entrainment and source water plankton samples.

1.3 Sampling Plan Organization

This sampling plan first describes the EPS environment, design, and operating characteristics. The methods for obtaining updated information on the types and concentrations of planktonic marine organisms entrained by the power plant's CWIS are then discussed. A discussion of the theoretical considerations behind the assessment methods for the entrainment and impingement data is then presented. The final 316(b) report will also include an overview of alternative intake technologies and an analysis of feasible alternatives and their cost-effectiveness to minimize adverse entrainment and impingement effects of the EPS CWIS.



2.0 DESCRIPTION OF THE ENCINA POWER STATION AND CHARACTERISTICS OF THE SOURCE WATER BODY

2.1 Background

The Encina Power Station (EPS) is situated on the southern shore of the outer segment of the Agua Hedionda Lagoon in the city of Carlsbad, California, approximately 193 km (85 miles) south of Los Angeles and 16 km (35 miles) north of San Diego. EPS is a gas- and oil-fueled generating plant with five steam turbine generators (Units 1 through 5), which all use the marine waters of Agua Hedionda Lagoon for once-through cooling, and a small gas turbine generator. EPS began withdrawing cooling water from Agua Hedionda Lagoon in 1954 with the startup of commercial operation of Unit 1. Unit 2 began operation in 1956, Unit 3 in 1958, Unit 4 in 1973, and Unit 5 in 1978. The gas turbine was installed in 1968, which does not use cooling water in its operation. The combined net generation capacity of EPS is 966 megawatts electric (MWe) (Table 1).

2.1.1 Plant Cooling Water System Description and Operation

Cooling water for the five steam electric generating units are supplied by two circulating and one or two service water pumps for each unit. The quantity of cooling water circulated through the plant is dependent upon the number of units in operation. With all units in full operation, the cooling water flow through the plant is 2,253 m³/min (595,200 gallons per minutes [gpm]) or 3,244,430 m³/day (857 million gallons per day [mgd]) based on the manufacturer ratings for the cooling water pumps (Table 1).

Table 1. Encina Power Station generation capacity and cooling water flow volume.

Unit	Gross Generation (MWe)	Cooling Water Flow m ³ /min (gpm)	Daily Flow m ³ /day (mgd)
1	107	193 (51,000)	278,000 (73)
2	104	193 (51,000)	278,000 (73)
3	110	204 (54,000)	294,350 (78)
4	300	806 (213,000)	1,161,060 (307)
5	325	856 (226,200)	1,233,010 (326)
Gas Turbine	20		
Total	966	2,252 (595,200)	3,244,430 (857)

Cooling water for all five steam-generating units is supplied through a common intake structure located at the southern end of the outer segment of Agua Hedionda Lagoon, approximately 854



m (2,800 ft) from the opening of the lagoon to the ocean (Figure 1). Cooling water from the system is discharged into a small discharge pond that is located to the west of the intake structure. Water from the discharge pond flows through a culvert under Carlsbad Blvd and through a discharge canal across the beach and out to the ocean.

Seawater entering the cooling water system passes through metal trash racks on the intake structure that are spaced 8.9 cm (3½ in) apart and keep any large debris from entering the system. The trash racks are cleaned periodically. Behind the trash racks the intake tapers into two 3.7 m (12 ft) wide tunnels that further splits into four 1.8 m (6 ft) wide conveyance tunnels (Figure 2). Conveyance tunnels 1 and 2 provide cooling water for Units 1, 2 and 3, while conveyance tunnels 3 and 4 supply cooling water to Units 4 and 5, respectively. Vertical traveling screens prevent fish and debris from entering the cooling water system and potentially clogging the condensers. There are two traveling screens for Units 1, 2 and 3, two screens for Unit 4, and three screens for Unit 5. The mesh size on the screens for Units 1 through 4 is 0.95 cm (3/8 in), while the mesh size for Unit 5 is 1.6 cm (5/8 in).

The traveling screens can be operated either manually or automatically when a specified pressure differential is detected across the screens due to the accumulation of debris. When the specified pressure is detected the screens rotate and the material on the screen is lifted out of the cooling water intake. A screen wash system (70-100 psi), located at the head of the screen, washes the debris from each panel into a trough, which empties into collection baskets where it is accumulated until disposal.

The velocity of the water as it approaches the traveling screens has a large effect on impingement and entrainment and varies depending on the number of pumps operating, tidal level, and cleanliness of the screen faces. Approach velocities at high and low tide with all pumps operating were presented in the previous 316(b) study conducted in 1979 and 1980 (Table 2).

Table 2. Approach velocities at traveling screens for Encina Power Station with all circulating water and service water pumps in operation.

Unit	Estimated Mean Approach Velocity (fps)	
	High Tide	Low Tide
1	0.7	1.2
2	0.7	1.2
3	0.7	1.2
4	1.0	1.6
5	0.7	1.1






Figure 1. Location of Encina Power Station in Carlsbad, California



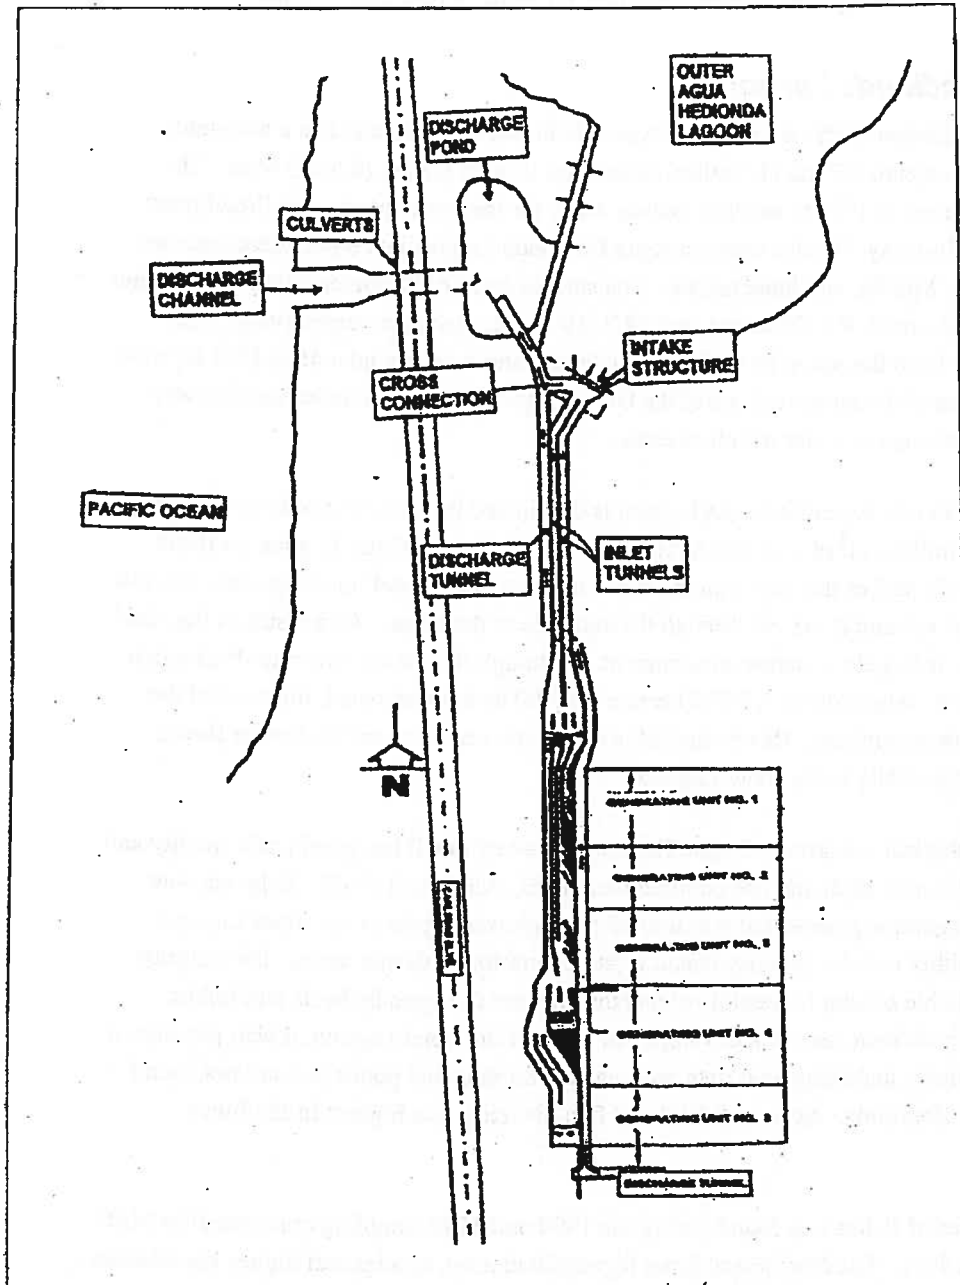


Figure 2. Schematic of Encina Power Station cooling water intake system.



2.2 Aquatic Biological Resources in the Vicinity of EPS

2.2.1 Agua Hedionda Lagoon

The Encina Power Station (EPS) is located on Agua Hedionda Lagoon, which is a man-made coastal lagoon that extends 2.7 km (1.7 miles) inland and is up to 0.8 km (0.5 mi) wide. The lagoon was constructed in 1954 to provide cooling water for the power plant. A railroad trestle and the Interstate Highway 5 bridge separate Agua Hedionda Lagoon into three interconnected segments: an Outer, Middle, and Inner lagoon. The surface areas of the Outer, Middle, and Inner lagoons are 26.7 (66 acres), 9.3 (23 acres), and 79.7 (197 acres) hectares, respectively. The lagoon is separated from the ocean by Carlsbad Boulevard and a narrow inlet 46 m [151 ft] wide and 2.7 m [9 ft] deep at the northwest end of the Outer Lagoon that passes under the highway and allows tidal exchange of water with the ocean.

Circulation and input into Agua Hedionda Lagoon is dominated by semi-diurnal tides that bring approximately 2.0 million m³ of seawater through the entrance to the Outer Lagoon on flood tides. Approximately half of this tidal volume flows into the Middle and Inner lagoons. On ebb tides this same tidal volume flows out through the entrance to the ocean. As a result of this tidal flushing the lagoon is largely a marine environment. Although freshwater can enter the lagoon through Buena Creek, which drains a 7,500 hectare (18,500 acres) watershed, for most of the year freshwater flow is minimal. Heavy rainfall in the winter can increase freshwater flows, reducing salinity, especially in the Inner Lagoon.

A study on the ecological resources of Agua Hedionda showed that it has good water quality and supports diverse infaunal, bird, and fish communities (MEC Analytical 1995). Eelgrass was found in all three lagoon segments, but was limited to shallower depths in the Inner Lagoon because water turbidity reduces photosynthetic light penetration in deeper areas. The eelgrass beds provide a valuable habitat for benthic organisms that are fed upon by birds and fishes. Although eelgrass beds were less well developed in areas of the Inner Lagoon, it also provides a wider range of habitats, including mud flats, salt marsh, and seasonal ponds that are not found elsewhere in Agua Hedionda. As a result bird and fish diversity was highest in the Inner Lagoon.

A total of 35 species of fishes was found during the 1994 and 1995 sampling conducted by MEC (MEC Analytical 1995). The Middle and Inner lagoons had more species and higher abundances than the Outer Lagoon. During the 1995 survey only four species were collected in the Outer Lagoon, compared to 14 to 18 species in the Middle and Inner lagoons. The sampling did not include any surveys of the rocky revetment lining the Outer Lagoon that would increase the abundance and number of species collected. Silversides (Atherinopsidae) and gobies (Gobiidae)



were the most abundant fishes collected. Silversides, including jacksmelt and topsmelt, that occur in large schools in shallow waters where water temperatures are warmest were most abundant in the shallower Middle and Inner lagoons. Gobies were most abundant in the Inner Lagoon which has large shallow mudflat areas that are their preferred habitat.

Special Status Species

The recent assessment of the ecological resources of Agua Hedionda did not collect any federally endangered tidewater goby (*Eucyclogobius newberryi*) that was once recorded from the lagoon (MEC Analytical 1995). The record of the occurrence may not be accurate or may predate the construction of the Outer Lagoon that provided a direct connection with the ocean. The current marine environment in the lagoon would not generally support tidewater gobies because they prefer brackish water habitats. No other listed fish species were collected in the study.

2.2.2 Pacific Ocean

Agua Hedionda Lagoon is tidally flushed through the small inlet in the Outer Lagoon by waters from the Pacific Ocean. The physical oceanographic processes of the southern California Bight that influence the lagoon include tides, currents, winds, swell, temperature, dissolved oxygen, salinity and nutrients through the daily tidal exchange of coastal seawater. Near the mouth of the lagoon the mean tide range is 3.7 ft (1.1 m) with a diurnal range of 5.3 ft (1.6 m). Waves breaking on the shore generally range in height from 2 to 4 ft (0.6 to 1.2 m), although larger waves (6 to 10 ft [1.8 to 3.0 m]) are not uncommon. Larger waves exceeding 15 ft (4.6 m) occur infrequently, usually associated with winter storms. Surface water in the local area ranges from a minimum of 57°F (13.9°C) to a maximum 72°F (22.2°C) with an average annual temperature between 63°F (17.2°C) and 66°F (18.9°C).

The outer coast has a diversity of marine habitats and includes zones of intertidal sandy beach, subtidal sandy bottom, rocky shore, subtidal cobblestone, subtidal mudstone and water column. Organisms typical of sandy beaches include polychaetes, sand crabs, isopods, amphipods, and clams. Grunion utilize the beaches around EPS during spawning season from March through August. Numerous infaunal species have been observed in subtidal sandy bottoms. Mollusks, polychaetes, arthropods, and echinoderms comprise the dominant invertebrate fauna. Sand dollars can reach densities of 1,200 per square meter. Typical fishes in the sandy subtidal include queenfish, white croaker, several surfperch species, speckled sanddab, and California halibut. Also, California spiny lobster and *Cancer* spp. crabs forage over the sand. Many of the typically outer coast species can occasionally occur within Agua Hedionda Lagoon, carried by incoming tidal currents.



The rocky habitat at the discharge canal and on offshore reefs supports various kelps and invertebrates including barnacles, snails, sea stars, limpets, sea urchins, sea anemones, and mussels. Giant kelp (*Macrocystis*) forests are an important habitat-forming community in the area offshore from Agua Hedionda. Kelp beds provide habitat for a wide variety of invertebrates and fishes. The water column and kelp beds are known to support many fish species, including northern anchovy, jack smelt, queenfish, white croaker, garibaldi, rockfishes, surfperches, and halibut.

Marine-associated wildlife that occur in the Pacific waters off Agua Hedionda Lagoon are numerous and include brown pelican, surf scoter, cormorants, western grebe, gulls, terns and loons. Marine mammals, including porpoise, sea lions, and migratory gray whales, also frequent the adjacent coastal area.



3.0 ENTRAINMENT STUDY AND ASSESSMENT METHODS

Entrainment studies were previously conducted in 1979 and 1980 at the EPS as part of the plant's initial Section 316(b) Demonstration requirement. The original study was conducted using pump sampling for plankton at the intake structure and net sampling of plankton at three source water stations in the Outer Lagoon (SDG&E 1980). For this study, plankton net sampling at the intake station and at an array of source water stations will be used to collect data for impact models that will be used to update the previous 316(b) Demonstration study. The following questions will be addressed by the entrainment and source water studies:

- What is the baseline entrainment mortality?
- What are the species composition and abundance of larval fishes, cancer crabs, and lobsters entrained by the EPS?
- What are the estimates of local species composition, abundance and distribution of source water stocks of entrainable larval fishes, cancer crabs, and spiny lobsters in Agua Hedionda Lagoon and the nearshore oceanic source waters?

The basis for estimation of entrainment effects is accurate knowledge of the composition and densities of planktonic organisms that are at risk of entrainment through the power plant cooling water system. Recent studies addressing 316(b) issues have focused on larval fishes and commercially important crustacean species (Tenera 2001, 2004). The basic study design involves the collection of plankton samples directly from the intake cooling water flow (entrainment sampling) and comparing the densities of various target species from plankton samples taken concurrently from the source water body (source water sampling). In the case of Encina Power Station (EPS), two areas contribute to the source water body; the lagoon sub-area and the nearshore sub-area, each having a unique contribution to the cooling water flows in terms of species composition and probability of entrainment.

3.1 Entrainment Study

Field data on the composition and abundance of potentially entrained larval fishes, *Cancer* spp. megalopae, and larval spiny lobster *Panulirus interruptus* will provide a basis to estimate the total number and types of these organisms passing through the power plant's cooling water intake system. For the purposes of modeling and calculations, through-plant mortality will be assumed to be 100 percent; unless otherwise determined through a San Diego RWQCB approved



entrainment mortality study. Monthly entrainment and source water surveys started in June 2004 will be continued on a monthly basis through May 2005.

3.1.1 Entrainment Sampling Methods

This study was designed to quantify the composition and abundance of entrained larval fishes, *Cancer* spp. megalopae, and spiny lobster larvae. A map of the station locations that were sampled starting in June 2004 is shown in Figure 3. These stations will continued to be sampled through May 2005 on a monthly basis.

Sample collection methods are similar to those developed and used by the California Cooperative Oceanic and Fisheries Investigation (CalCOFI) in their larval fish studies (Smith and Richardson 1977) but modified for sampling in the shallow areas of Agua Hedionda Lagoon. Two replicate entrainment samples are collected from a single station (E1) located in front of the EPP intakes by towing plankton nets from a small boat. A net frame is equipped with two 0.71 m (2.33 ft) diameter openings each with a 335 μ m (0.013 in) mesh plankton net and codend. The start of each tow begins close to the intake structure, proceeds in a northerly direction against the prevailing intake current, and ends approximately 100 m from the structure. It is assumed that all of the water sampled at the entrainment station would have been drawn through the EPS cooling water system.

The tows are done by first lowering the nets as close to the bottom as practical without contacting the substrate. Once the nets are near the bottom, the boat is moved forward and the nets retrieved at an oblique angle (winch cable at approximately 45° angle) to sample the widest strata of water depths possible. Total time of each tow is approximately two minutes at a speed of 1 kt during which a combined volume of at least 60m³ (2,119 ft³) of water is filtered through both nets. In similar studies conducted by Tenera, this volume has been shown to typically provide a reasonable number and diversity of larvae for data modeling. The water volume filtered is measured by calibrated flowmeters (General Oceanics Model 2030R) mounted in the openings of the nets. Accuracy of individual instruments differed by less than 5% between calibrations. The sample volume is checked when the nets reach the surface. If the target volume is not collected, the tow was repeated until the targeted volume is reached. The nets are then retrieved from the water, and all of the collected material rinsed into the codend. The contents of both nets are combined into one sample immediately after collection. The sample is placed into a labeled jar and preserved in 10 percent formalin. Each sample is given a serial number based on the location, date, time, and depth of collection. In addition, the information is logged onto a sequentially numbered data sheet. The sample's serial number is used to track it through laboratory processing, data analyses, and reporting.



Entrainment samples are collected over a 24-hour period, with each period divided into four 6-hour sampling cycles. Larval fishes show day-night differences in abundances related to their vertical migratory behavior and spawning periodicity, and the 24-hr sampling regime allows these differences to be averaged for assessing entrainment abundances. Concurrent surface water temperatures and salinities are measured with a digital probe (YSI Model 30).




Figure 3. Location of Encina Power Station entrainment (E1) and source water stations (L1 through L4, and N1 through N5).

3.2 Source Water Study

This study was designed to quantify the local source water composition and abundance of larval fishes, *Cancer* spp. megalopae, and larval *Panulirus interruptus* in Agua Hedionda Lagoon and the nearshore source waters. The source water is partitioned into lagoon and nearshore sub-areas for modeling cooling water withdrawal effects (Figure 3). Collection methods are identical to the entrainment sample collection, with the exception that a single paired-net sample is collected at each station and the nearshore samples are be collected from a larger vessel capable of

navigating open coastal waters in all weather conditions, day or night. The shallow waters in the Middle and Inner lagoons required a different sampling protocol than the oblique tows used at the Outer Lagoon and nearshore stations. The Inner Lagoon is sampled using a single frame plankton net mounted on the bow of a small boat which pushes the net through the water thereby eliminating any obstructions in front of the net during sampling. The net is raised and lowered during sampling to sample the range of depths available in the shallow Inner Lagoon.

The stations are stratified to include four lagoon stations within the inner (2), middle (1), and outer lagoons (1), and five nearshore stations that cover a depth range of 5–30 m (16–98 ft). The array of locations and depths was chosen to assure that all potential source water community types are represented. For example, stations in the inner lagoon will have a greater proportion of larvae from species with demersal eggs, such as gobies, that spawn in quiet water environments, while nearshore stations will have more larvae of species that spawn in open water such as California halibut and white seabass. The study will allow comparison to earlier larval fish studies done for the original EPS 316(b) in 1979–80 (SDG&E 1980).

A current meter is placed in the nearshore between Stations N4 and N5. The data from the meter will be used to characterize currents in the nearshore area that would directly affect the dispersal of planktonic organisms that could be entrained by the power plant. The data will be used to define the size of the nearshore component of the source water by using the current speed and the estimated larval durations of the entrained organisms.

The number of source water stations will be evaluated as data become available to determine if fewer stations can be sampled. For example, a reduction in the number of stations may be recommended if analysis indicates that only one station is necessary to characterize the Inner Lagoon, or the Middle Lagoon is sufficiently similar to the Inner Lagoon that it does not need to be sampled separately. Analysis of current meter data may also indicate that Station N5 does not need to be sampled because the current is predominantly alongshore and can be adequately characterized using the other stations closer to shore.

3.2.1 Source Water Sampling Methods

Sampling is conducted using the same methods and during the same time period described earlier for the entrainment collections (Section 3.1.1) with target volumes for the oblique tows of approximately 60 m³ (2–3 minute tow at approximately 1 knot).



3.3 Laboratory Processing and Data Management

Laboratory processing will remove all larval fishes, megalopal stages of *Cancer* spp., and larvae of spiny lobster from the samples. Fish eggs will not be sorted from the samples. Although many marine fish eggs are described in the scientific literature, most identifications are difficult and very time consuming, and impact models can be adequately parameterized without egg density data. Larval fishes and all species of cancer crab megalopae will be identified to the lowest taxonomic level possible by Tenera's taxonomists. In addition, the developmental stage of fish larvae (yolk-sac, preflexion, flexion, postflexion, transformation) will be recorded on the data sheet. A laboratory quality control (QC) program for all levels of laboratory sorting and taxonomic identification will be applied to all samples. The QC program will also incorporate the use of outside taxonomic experts to provide taxonomic QC and resolve identification uncertainties.

Many larval fish cannot be identified to the species level; these fish will be identified to the lowest taxonomic classification possible (e.g., genus and species are lower orders of classification than order or family). Myomere and pigmentation patterns are used to identify many species; however, this can be problematic for some species. For example, sympatric members of the family Gobiidae share similar characteristics during early life stages (Moser 1996), making identifications to the species level uncertain. Those gobiids that we are unable to identify to species will be grouped into an "unidentified goby" category.

Laboratory data sheets will be coded with species or taxon codes. These codes will be verified with species/taxon lists and signed off by the data manager. The data will be entered into a computer database for analysis.

Length measurements will be taken on a representative sample of the target larval fish taxa. Approximately 100 fish from each taxon will be measured using a video capture system and Optimus™ image analysis software. The 100 fish from each taxon will be selected from the entrainment station based on the percentage frequency of occurrence of a taxon in each survey. For example, if 20 percent of the California halibut larvae for the entire year-long study were collected from during the June survey then 20 fish will be measured from that survey.

3.4 Assessment Methods

Potential cooling water intake system (CWIS) entrainment effects will be evaluated using a suite of methods, with no single method being superior to any others. The potential entrainment effects of the EPS CWIS, assuming 100 percent through-plant mortality, will be estimated using the site-specific field data collected in this proposed study. The potential for any such CWIS



effects to cause long-term population level impacts will be evaluated through the use of three analytical techniques: proportional entrainment (*PE*), adult equivalent loss (*AEL*), and fecundity hindcasting (*FH*). The results of these analytical steps will support assessments with respect to species population demographics (e.g., standing stock, age structure stability, fishery trends, and sustainable harvest management plans).

3.4.1 Demographic Approaches (*FH* and *AEL*)

The fecundity hindcasting or *FH* analysis approach (Horst 1975) compares larval entrainment losses with adult fecundity to estimate the amount of adult female reproductive output eliminated by entrainment. It thereby hindcasts the numbers of adult females effectively removed from the reproductively active population. The accuracy of these estimates of effects is dependent upon such factors as accurate estimates of age-specific mortality from the egg and early larval stages to entrainment, and also on age-specific estimates of adult fecundity, spawning periodicity, and reproductive lifespan. If it is assumed that the adult population has been stable at some current level of exploitation and that the male:female ratio is known and constant, then fecundity and mortality are integrated into an estimate of loss by converting entrained larvae back into females (i.e., hindcasting). In making this conversion, the number of eggs, derived from the number of larvae adjusted for egg to larvae mortality, are divided by the average number of eggs produced by each age class (size) of reproductive females in the stable population's ideal age structure. However this degree of information is rarely available for a population. In most cases, a simple range of eggs per females is reported without age-specificity.

An advantage of *FH* is that survivorship need only be estimated for a relatively short period of the larval stage (i.e., egg to larva). This method does not require source water sampling in addition to estimates of larval entrainment concentrations. This method assumes that the loss of a single female's reproductive potential is equivalent to the loss of adults. For the purpose of the resource assessment, if EPS-induced entrainment losses are to be equated to population level units in terms of fractional losses, it is still necessary to estimate the size of the population of interest. To this end, our assessment will employ any available, scientifically acceptable sources of information on fisheries stock or population estimates of unexploited species entrained by the EPS.

The adult equivalent loss or *AEL* approach (Goodyear 1978) uses age-specific estimates of the abundance of entrained or impinged organisms to project the loss of equivalent numbers of adults based on mortality schedules and age at recruitment. The primary advantage of this approach is that it translates power plant-induced, early life-stage mortality into equivalent numbers of adult fishes, the units used by resource managers. Adult equivalent loss does not necessarily require source water estimates of larval abundance in addition to entrainment



estimates, as required in *PE*. This latter advantage may be offset by the need to gather age-specific mortality rates to predict adult losses and the need for information on the adult population of interest for estimating population-level effects (i.e., fractional losses). However, the need for age-specific mortality estimates can be reduced by various approximations as shown by Saila et al. (1987), who used six years of entrainment and two years of impingement data for winter flounder *Pleuronectes americanus*, red hake *Urophycis chuss*, and pollock *Pollachius virens* at the Seabrook Station in New Hampshire. Their model assumed an adult population at equilibrium, a stable age distribution, a constant male:female ratio, and an absence of density-dependent (i.e., compensatory) mortality between entrainment and recruitment to the adult or fished stocks. Input data to their model parameters were gathered in field surveys of spawning populations, egg and larval production, and local hydrology.

Declining populations can be accounted for in both the *AEL* and *FH* approaches by using age-specific adult mortality estimates from fishery catch data and by assuming no compensatory mortality. However, we know that this is not an assumption that fits the reality of population dynamics. The removal (mortality) of any life stage will have an effect if it exceeds the number of reproductive adults required to produce that number of larvae. That is, the adult population will decline one for one with every larva lost. This is clearly not the case, nor does every larva survive to become an adult. Although we have essentially no way of estimating the degree to which a population can sustain losses and remain stable, it is an important issue when estimating long-range effects. The effect, known as density-dependence (sometimes called compensation), can affect the vital rates of impacted organisms. Density-dependence is not confined to acting through mortality; growth and fecundity may also be density-dependent. In fisheries management models, which we will take as our working models in forecasting long-term population trends, the level of compensation possible in species can be examined empirically by the response of its population to harvest rates.

Some entrainment studies have assumed that compensation is not acting between entrainment and the time when adult recruitment would have taken place, and further, that this specific assumption resulted in conservative estimates of projected adult losses (Saila et al. 1987). Others, such as Parker and DeMartini (1989), did not include compensatory mortality in estimates of equivalent adult losses because of a lack of consensus on how to include it in the models and, more importantly, uncertainty about how compensation would operate on the populations under study. The uncertainty arises because the effect of compensation on the ultimate number of adults is directly related to which of the vital processes (fecundity, somatic growth, mortality) and which life stages are being affected. In particular, Nisbet et al. (1996) showed that neglecting compensation does not always lead to conservative long-term estimates of equivalent adult losses.



3.4.2 Empirical Transport Model (ETM)

The *PE* approach (Boreman et al. 1978, Boreman et al. 1981) will provide an estimate of incremental (conditional, Ricker 1975) mortality imposed by EPS on local source water larval populations by using empirical data (plankton samples) rather than relying solely on hydrodynamic and demographic calculations. Consequently, *PE* requires an additional level of field sampling to characterize abundance and composition of larvae using results from the larval fish surveys defined in this document (Section 3.2.1). These estimates of species-specific fractional losses (entrainment losses relative to source water abundance) can then be expanded to predict regional effects on appropriate adult populations using an empirical transport model (*ETM*), as described below. Required parameters for the *PE* approach include the rate of cooling water withdrawal, estimates of entrained larval fish concentrations, and estimates of the larval fish concentrations in the source waters.

The use of *PE* as an input to the empirical transport model (*ETM*) has been proposed by the U.S. Fish and Wildlife Service to estimate mortality rates resulting from cooling water withdrawals by power plants (Boreman et al. 1978, and subsequently in Boreman et al. 1981). Variations of this model have been discussed in MacCall et al. (1983) and have been used to assess impacts at a southern California power plant (Parker and DeMartini 1989). The *ETM* has also been used to assess impacts at the Salem Nuclear Generating Station in Delaware Bay, New Jersey (PSE&G 1993) as well as other power stations along the East Coast. Empirical transport modeling permits the estimation of annual conditional mortality due to entrainment while accounting for the spatial and temporal variability in distribution and vulnerability of each life stage to power plant withdrawals. The generalized form of the *ETM* incorporates many time-, space-, and age-specific estimates of mortality as well as information regarding spawning periodicity and duration, many of which are limited or unknown for the marine taxa being investigated at EPS. The applicability of the *ETM* to the present study at EPS will be limited by a lack of either empirically derived or reported demographic parameters needed as input to the model. However, the concept of summarizing *PE* over time that originated with the *ETM* can be used to estimate entrainment effects over appropriate temporal scales either through modeling or by making assumptions about species-specific life histories. We will employ a *PE* approach that is similar to the method described by MacCall et al. (1983) and used by Parker and DeMartini (1989) in their final report to the California Coastal Commission (Murdoch et al. 1989), as an example for the San Onofre Nuclear Generating Station (SONGS). This estimate can then be summarized over appropriate blocks of time in a manner similar to that of the *ETM*.



4.0 IMPINGEMENT EFFECTS

The two primary ways cooling water withdrawal can affect aquatic organisms are through impingement and entrainment. Larger organisms are subjected to impingement on the screening system on the power plant's cooling water intake system (CWIS) that excludes debris from the circulating water pumps. EPS presently has seven sets of vertical traveling screens in three separate areas. Approach velocities vary from approximately 0.7 fps at high tide to 1.6 fps at low tide. Impingement occurs when an organism larger than the traveling screen mesh size is trapped against the screens. These impinged organisms are assumed to undergo 100 percent mortality for the purposes of this study. The following questions will be addressed by the impingement study:

- What is the baseline impingement mortality?
- What are the species composition and abundance of fishes and macroinvertebrates impinged by EPS?

4.1 Review of 1980 Impingement Study

In earlier impingement studies at EPS, fish samples were collected from screen washes during high and low impingement periods for one year (SDG&E 1980). Samples were collected over two-12 hour periods during each day to represent daytime and nighttime impingement. Since samples were collected every day the study provides a direct measure of EPS impingement. During the one-year period during normal plant operations 76 species of fishes and 45 species of macro-invertebrates totaling 85,943 individuals and weighing 1,548 kg (3,414 lb) were impinged. During the seven heat treatments conducted during the sampling period 108,102 fishes weighing 2422 kg (5,341 lb) were collected. The most abundant fishes collected in impingement samples were actively swimming, open-water schooling species such as deepbody and northern anchovy, topsmelt, and California grunion. Other abundant species included queenfish and shiner surfperch. During heat treatments larger fishes were collected that were less common during normal impingement. These larger fishes probably live in the CWIS and are able to avoid impingement during normal plant operation, but succumb to the warmer temperatures during heat treatment. Marine plants, largely eelgrass and giant kelp, made up the largest component of material in impingement samples.

Impingement losses at EPS were much less when compared with impingement at other coastal plant in southern California. Impingement was much greater at the Redondo Beach Generating Station and San Onofre Nuclear Generating Station Unit 1, even though the cooling water flows



at those two facilities are less than the flow at EPS (673 and 500 MGD, respectively compared with 828 mgd at EPS). The intake approach velocities at the screenwells at EPS are lower than the velocities at these other facilities allowing most fishes to avoid impingement by continuous or burst swimming. The SDG&E report (SDG&E 1980) and a later evaluation (EA 1997) both concluded that the biological impact of EPS was insignificant in terms of impingement losses.

4.2 Impingement Study Methods

The purpose of the proposed 316(b) impingement study will be to characterize the juvenile and adult fishes and selected macroinvertebrates (e.g., shrimps, crabs, lobsters, squid, and octopus) impinged by the power plant's CWIS. The sampling program is designed to provide current estimates of the abundance, taxonomic composition, diel periodicity, and seasonality of organisms impinged at EPS. In particular, the study will focus on the rates (i.e., number or biomass of organisms per m³ water flowing per time into the plant) at which various species of fishes and macroinvertebrates are impinged. The impingement rate is subject to tidal and seasonal influences that vary on several temporal scales (e.g., hourly, daily, and monthly) while the rate of cooling water flow varies with power plant operations and can change at any time. A review of the previous impingement study at EPS will provide context for interpreting changes in the magnitude and characteristics of the present day impingement effects. Studies of the Agua Hedionda fish assemblages independent of EPS (e.g., MEC Analytical 1995) will also provide information regarding the marine environment in southern and central Agua Hedionda Lagoon.

In accordance with procedures employed in similar studies, impingement sampling will occur over a 24-hour period one day per week. Before each sampling effort, the trash racks will be cleaned and the traveling screens will be rotated and washed clean of all impinged debris and organisms. The sluiceways and collection baskets will also be cleaned before the start of each sampling effort. The operating status of the circulating water pumps on an hourly basis will be recorded during the collection period. Each 24-hour sampling period at the traveling screens will be divided into six 4-hour cycles. The traveling screens will remain stationary for a period of 3.5 hours then they will be rotated and washed for 30 minutes. The trash racks will be cleaned once every 24 hours. The impinged material from the traveling screens will be rinsed into the collection baskets associated with each set of screens and the impinged material from the trash racks will be collected in the bin on the rake apparatus. The debris and organisms rinsed from each set of traveling screens and the trash racks will be kept separate and processed according to the procedures presented in the following section.

If the traveling screens are operating in the continuous mode, then sampling will be coordinated with the intake crew so samples can be collected safely. A log containing hourly observations of the operating status (on or off) of the circulating water pumps for the entire study period will be



obtained from the power plant operation staff. This will provide a record of the amount of cooling water pumped by the plant, which will then be used to calculate impingement rates. The same procedure will be used to coordinate additional sampling efforts at the trash racks in case they need to be cleaned more frequently than once every 24 hours. The sampling at each of the three sets of traveling screens will be offset by one hour to allow screen wash and collection to occur at each set of screens separately.

Impingement sampling will also be conducted during heat treatment "tunnel shock" operations. Procedures for heat treatment will involve clearing and rinsing the traveling screens prior to the start of the heat treatment procedure. At the end of the heat treatment procedure normal pump operation is resumed and the traveling screens rinsed until no more fish are collected on the screens. Processing of the samples will occur using the same procedures used for normal impingement sampling. We anticipate that up to eight heat treatments will occur during the one-year study period.

A quality control (QC) program will be implemented to ensure the correct identification, enumeration, length and weight measurements of the organisms recorded on the data sheet. Random cycles will be chosen for QC re-sorting to verify that all the collected organisms were removed from the impinged material.

Depending on the number of individuals of a given target species present in the sample, one of two specific procedures is used, as described below. Each of these procedures involves the following measurements and observations:

1. The appropriate linear measurement for individual fishes and motile invertebrates is determined and recorded. These measurements are made in millimeters to the nearest 1 mm. The following standard linear measurements are used for the animal groups indicated:

Fishes	Total body length for sharks and rays and standard lengths (fork length) for bony fishes.
Crabs	Maximum carapace width.
Shrimps & Lobsters	Carapace length, measured from the anterior margin of carapace between the eyes to the posterior margin of the carapace.
Gastropod & Pelecypod Molluscs	Maximum shell length or maximum body length.
Octopus	Maximum "arm" spread, measured from the tip of one tentacle to the tip of the opposite tentacle.
Squid	Maximum body length, measured from the tip of one tentacle to the posterior end of the body.



2. The wet body weight of individual animals is determined after shaking loose water from the body. Total weight of all individuals combined is determined in the same manner. All weights are recorded to the nearest 1 g.
3. The qualitative body condition of individual fishes and macroinvertebrates is determined and recorded, using codes for decomposition and physical damage. These codes are shown on the attached form.
4. Other non-target, sessile macroinvertebrates are identified to species and their presence recorded, but they are not measured or weighed. Rare occurrences of other impinged animals, such as dead marine birds, are recorded and their individual weights determined and recorded.
5. The amount and type of debris (e.g., *Mytilus* shell fragments, wood fragments, etc.) and any unusual operating conditions in the screen well system are noted by writing specific comments in the "Notes" section of the data sheet.

The following specific procedures are used for processing fishes and motile invertebrates when the number of individuals per species in the sample or subsample is ≤ 29 :

1. For each individual of a given species the linear measurement, weight, and body condition codes are determined and recorded on separate lines.

The following specific subsampling procedures are used for fishes and motile invertebrates when the number of individuals per species is > 29 :

1. The linear measurement, individual weight, and body condition codes for a subsample of 30 individuals are recorded on individual lines of the data sheet. The individuals selected for measurement should be selected after spreading out all of the individuals in a sorting container, making sure that they are well mixed and not segregated into size groups. Individuals with missing heads or other major body parts are eliminated from consideration, since linear measurements of them are not representative.
2. The total number and total weight of all the remaining individuals combined are determined and recorded on a separate line.

4.2.1 Sampling Frequency

Results from the previous impingement study indicated that the impingement is much greater during the heat treatment "tunnel shock" events. Almost 60 percent of the total impinged fishes (over 60 percent by weight) were collected during the seven tunnel shock events. Impingement



rates during normal operations were much less. Although we have proposed to sample normal impingement weekly, we will evaluate the potential to reduce the sampling frequency to once every two weeks. The analysis will be done using the weekly data collected at EPS during this study and data from other southern California power plants with shoreline intake structures. The reduced sampling frequency may provide an adequate estimate of impingement especially since we will continue to sample impingement during each of the tunnel shock events when impingement is highest.



5.0 COOLING WATER SYSTEM IMPACT ASSESSMENT

The entrainment and impingement effects of the cooling water intake system for the EPS project will be assessed on the basis of historical studies and 12 months of recent plankton and 12 months of impingement survey information. The assessment will consider the effects of entraining larval fishes, crabs and lobsters, and impinging larger fishes and invertebrates in the CWIS. The three methods for assessing CWIS effects are fecundity hindcasting (*FH*), adult equivalent loss (*AEL*) and empirical transport modeling (*ETM*). These methods were explained in Section 3.5—Assessment Methods. The report will contain estimates of *AEL* and *FH* where data are available to parameterize these demographic approaches.

The impacts of impingement and entrainment on source water populations can be evaluated by estimating the fractional losses to the population attributable to the CWIS. Impingement rates and biomass estimates from the study will provide estimates of impingement losses that can then be translated directly to estimate potential impingement effects on local fisheries. Estimated entrainment losses are extrapolated to fishery losses using *FH* and *AEL* estimates. One constraint in the modeling approach is that life history data are available for only a portion of the entrained taxa and commercial fishery statistics will also only be available for a few of the entrained species (e.g., California halibut, northern anchovy, white croaker). Many of the fishes that have historically been entrained in highest numbers are small fishes that are not the focus of any recreational or commercial fishery.

Present-day findings on the EPS CWIS entrainment effects will be reviewed and assessed for the most abundant larval fish taxa, megalopal cancer crabs, and larval spiny lobster. By comparing the number of larvae and megalopae withdrawn by the power plant to the number available (i.e., at risk to entrainment), an estimate of the conditional mortality due to entrainment (*PE*) can be generated for each taxon or species. These estimates of conditional mortality will be combined in the *ETM* model to provide an estimate of the annual probability of mortality due to entrainment (P_m) that can be used for determining CWIS effects and the potential for long-term population declines. Fishery management practices and other forms of stock assessments will provide the context required to interpret P_m . In the case of a harvested species, P_m must be considered in addition to these harvest losses when assessing impacts and any potential for population decline.

5.1 Entrainment Effects Assessment

The assessment will focus on entrainment effects to the most abundant and to commercially or recreationally important fish taxa, cancer crab megalops and lobster larvae. Larval fishes



analyzed will tentatively be the Goby complex, three Engraulid species, three Atherinopsid species, California halibut, white croaker, black croaker, spotted sand bass, and barred sand bass. These taxa likely comprise over 90 percent of all the entrained larval fishes based on earlier studies. Other species, which may occur in lower abundances, may also be included in the assessment because they represent species of commercial or recreational importance

5.2 Summary of Entrainment Effects

The length of time that a larval fish is in the plankton and subject to entrainment is a key parameter in *ETM* calculations. Length measurements taken from representative samples of the larval fish taxa presented in Section 4.0 will be used to estimate the number of days that larvae (for a specific taxon) are at risk to entrainment. Reports on larval duration from the scientific literature are likely to overestimate the period of time that larvae are exposed to entrainment. This is because ontogenetic changes during larval development result in increased swimming ability or behavioral changes, such as association with the bottom or other pre-settlement microhabitats. Possible outliers are eliminated by basing the minimum and maximum lengths on the central 98 percent of the length distribution for a taxon and excluding the lengths of the top and bottom percentiles. Estimates of larval growth rates (mm/day) are then used on this range to estimate the number of days the larvae are exposed to entrainment. The estimates of growth rates and their source from the literature will be presented in the impact assessment section for the different taxa. The average duration of entrainment risk for a taxon is calculated from the bottom percentile value to the mean value, while the maximum duration is calculated from the bottom percentile value to the 99 percentile value. Our estimates of the period of entrainment risk for cancer crabs and spiny lobster will be derived from literature values on the average age of the stages for each crustacean species.

5.3 Summary of Impingement Effects

Impingement effects in relation to source water fishery resources and potential ecological effects will be summarized based on data summarized from the earlier impingement study (SDG&E 1980), data on fish populations in Agua Hedionda Lagoon (MEC 1995), and CDF&G catch records for sport and commercial fishery resources.



6.0 LITERATURE CITED

- Boreman, J., C. P. Goodyear, and S. W. Christensen. 1978. An empirical transport model for evaluating entrainment of aquatic organism by power plants. United States Fish and Wildlife Service. FWS/OBS-78/90, Ann Arbor, MI.
- Boreman, J., C. P. Goodyear, and S. W. Christensen. 1981. An empirical methodology for estimating entrainment losses at power plants sited on estuaries. *Transactions of the American Fishery Society* 110:253-260.
- EA Engineering, Science, and Technology. 1997. Encina Power Plant supplemental 316(b) assessment report. Prepared for San Diego Gas and Electric Company.
- Goodyear, C. P. 1978. Entrainment impact estimates using the equivalent adult approach. USFWS Biological Services Program. FWS/OBS - 78/65. 14 pp.
- Horst, T. J. 1975. The assessment of impact due to entrainment of ichthyoplankton. Pp. 107-118 *In* S. B. Saila (ed.) *Fisheries and Energy Production: A Symposium*. Lexington Books, D. C. Heath and Company, Lexington, MA.
- MacCall, A. D., K. R. Parker, R. Leithiser, and B. Jessee. 1983. Power plant impact assessment: A simple fishery production model approach. *Fishery Bulletin* 81(3):613-619.
- MEC Analytical Systems. 1995. 1994 and 1995 field survey report of the ecological resources of Agua Hedionda Lagoon. Submitted to San Diego Gas and Electric Company. 47 pp. + Appendices.
- Moser, H. G. 1996. *The Early Stages of Fishes in the California Current Region*. California Cooperative Oceanic Fisheries Investigations, Atlas No. 33. Allen Press Inc., Lawrence, Kansas.
- Murdoch, W. W., R. C. Fay, and B. J. Mechals. 1989. Final Report of the Marine Review Committee to the California Coastal Commission, Marine Review Committee Doc. No. 89-02, 346 pp.
- Nisbet, R. M., W. Murdoch and A. Stewart-Oaten. 1996. Consequences for adult fish stocks of human-induced mortality on immatures. Pages 257-277 *In*: Schmitt, R.J. and C.W. Osenberg (eds.). *Detecting ecological impacts: Concepts and applications in coastal habitats*. Academic Press.
- Parker, K. R. and E. E. DeMartini. 1989. Chapter D: Adult-equivalent loss. Technical Report to the California Coastal Commission. Prepared by Marine Review Committee, Inc. 56 pp.
- Public Service Electric and Gas Company (PSE&G). 1993. Appendix I—Modeling. Permit No. NJ0005622. Prepared by Lawler, Matusky, and Skelly Engineers, Pearl River, NY. Comments on NJPDES Draft. 82 pp.
- Ricker, W. E. 1975. Computation and interpretation of biological statistics of fish populations. *Fishery Research Board of Canada Bulletin* 91. 382 pp.
- Saila, S. B., X. Chen, K. Erzini, and B. Martin. 1987. Compensatory mechanisms in fish populations: Literature reviews. Volume 1: Critical evaluation of case histories of fish



- populations experiencing chronic exploitation or impact. EA-5200. Report prepared for the Electric Power Research Institute.
- San Diego Gas and Electric (SDG&E). 1980. Encina Power Plant cooling water intake system demonstration. Prepared for California Regional Water Quality Control Board, San Diego Region.
- Smith, P. E. and S. L. Richardson. 1977. Standard Techniques for Pelagic Fish Egg and Larva Surveys. FAO Fisheries Technical Paper 175:1-100.
- Tenera Environmental. 2001. Morro Bay Power Plant Modernization Project 316(b) Resource Assessment. Doc. E2000-107.8. Prepared for Duke Energy Morro Bay, LLC.
- Tenera Environmental. 2004. SBPP Cooling Water System Effects on San Diego Bay, Vol. II: Compliance with Section 316(b) of the Clean Water Act for the South Bay Power Plant. Doc. No. ESLO2003-037.6. Prepared for Duke Energy. August 2004.
- U. S. Environmental Protection Agency (USEPA). 1977. Guidance for evaluating the adverse impact of cooling water intake structures on the aquatic environment: Section 316(b) P.L. 92-500. 58 pp.



Encina Power Station
4600 Carlsbad Boulevard
Carlsbad, CA 92008-4301

Direct: (760) 268-4000
Fax: (760) 268-4026

NRG CABRILLO POWER OPERATIONS INC.

January 10, 2005

Mr. John Phillips
San Diego Regional Water Quality Control Board
9174 Sky Park Court, Suite 100
San Diego, CA 92123-4340

Subject: Cabrillo Power I LLC Response to Comments from Tetra Tech to San Diego Regional Water Quality Control Board on the Encina 316(b) Cooling Water Intake Effects Entrainment & Impingement Sampling Plan

Dear Mr. Phillips:

Cabrillo Power I LLC (Cabrillo) appreciates the opportunity to respond to the comments from Tetra Tech on the 316(b) *Cooling Water Intake Effects Entrainment and Impingement Sampling Plan* for the Encina Power Station (EPS) submitted to the San Diego Regional Water Quality Control Board (Regional Board) on September 2, 2004. Tenera Environmental prepared the plan for the EPS 316(b) studies, and Cabrillo had them respond to comments from Tetra Tech. The responses from Tenera are incorporated into this letter and identified accordingly.

The Tetra Tech comments generally call for further clarification of the study plan or additions to the plan that will not affect the sampling procedures currently being used. The Tetra Tech comments (numbered the same as on the Tetra Tech memo) with specific questions of Cabrillo have responses that are highlighted in boldface type. Tetra Tech also made several suggestions that we have responded to in the final section of this letter.

TETRA TECH COMMENTS AND CABRILLO RESPONSES:

- 1) *Page 2:* The authors state that they will use EPA's criteria for selecting appropriate target organisms for assessment, results from previous 316(b) studies, Aqua Hedionda Lagoon ecological surveys, and results from the upcoming study to "determine the appropriate target organisms that will be evaluated in detail." Final selection of target organisms should involve consultation with the appropriate resource agencies. Will the California Regional Water Quality Control Board (and others) be contacted to approve target organism selection before commencement of assessment analyses?

Response: The final selection of the specific target organisms will be made in collaboration with the Regional Board and other appropriate agencies. The

sampling and processing is currently focused on fishes and selected macroinvertebrates; the same groups of organisms that were studied in San Diego Bay in 2001–2003 at the Duke Energy South Bay Power Plant in San Diego. The final list of target organisms will be based largely on their abundances in the entrainment and impingement samples. The impact assessment will be restricted to the most abundant taxa to ensure that there is have reasonable confidence in the results.

- 3) *Page 7:* The MEC Analytical (1995) ecological surveys will be used to provide "data on fish populations in Aqua Hedionda Lagoon" (see page 24) for the evaluation of EPS impingement effects in relation to source water fishery resources. The authors mention that the MEC Analytical sampling "did not include any areas of the rocky revetment lining the Outer Lagoon that would increase the abundance and number of species collected." It appears that the surveys focused on the Middle and Inner Lagoons. Since the MEC Analytical data will be used for impingement effects analyses, the search for and/or collection of supplemental information for Outer Lagoon fishes may be warranted (however, it should be noted that we have not reviewed the contents of the MEC Analytical report).

Response: The MEC study utilized multiple gear types that effectively sampled most of the habitats in Aqua Hedionda Lagoon. Cabrillo is currently evaluating if supplemental studies of the habitats not sampled in the MEC study are necessary and will propose those to the Regional Board if warranted. These habitats include the shallow mudflats areas that are common in the middle and inner lagoon, the rocky habitat that lines the boundary of the outer lagoon, and the artificial substrates on the piers, docks and floats of the outer lagoon. Gobies that occur in burrows on the mudflats and combtooth blennies, garibaldi and rockfishes that occur on the rocky habitat and artificial substrates in the outer lagoon were not effectively sampled by any of the gear types used in the MEC study. The larvae from these fishes will likely be abundant in the entrainment samples and this study will provide an estimate of their adult source water populations that will be used in the assessment of cooling water intake system (CWIS) effects.

- 6) *Page 11:* The authors state that entrainment sampling began in June 2004 and will continue through May 2005. Has this proposed index period changed, or was approval received for sampling commencement prior to the preparation and review of this sampling plan (Plan is dated September 2004)? Did source water sampling also begin before this plan was written?

Response: Both entrainment and source water sampling began in June 2004. The sampling started before a sampling plan was submitted to the Regional Board to take advantage of studies of the cooling water system that were being conducted in association with the permitting for the desalination facility being proposed for construction at the plant site by Poseidon Resources. The original proposal for the Poseidon study did not include the more extensive source water sampling in the final study plan. The scope of the study was expanded to conform to other 316(b) demonstration studies Tenera has completed in California including the study recently completed at the Duke Energy South Bay Power Plant in San Diego Bay. This provided Cabrillo the opportunity to continue the sampling in response to EPA's recently published Phase II rule for compliance with Section 316(b) of the Clean Water Act.

- 7) **Page 11:** Entrainment samples will be collected from the lagoon, near the intake structure. Is entrainment sampling not possible from a location within the EPS CWIS?

Response: Entrainment sampling conducted at ocean and estuarine power plants over the last ten years in California has been done in the source waters as near as possible to the intakes. This sampling location has been used because studies at the Diablo Canyon Power Plant in central California showed that large losses of planktonic organisms such as larval fishes can occur as a result of filtering by biofouling organisms that grow on the surfaces inside the power plant cooling water intake system. Studies have shown reductions in densities of greater than 90 percent between intake and discharge samples that have been attributed to biofouling losses. Although the entrainment sampling proposed for the EPS with plankton nets in the source waters at the power plant intake structure requires the assumption that the densities of organisms in the source waters are representative of the densities of organisms that are entrained, sampling inside the power plant introduces additional assumptions, sampling problems, and the known problem of cropping by biofouling organisms. One of these problems involves obtaining representative, well-mixed samples and sampling in rapidly flowing water. In addition, sampling inside the plant cooling water system usually requires pump sampling methods that are different than the towed net sampling used in the source waters, therefore introducing additional assumptions affecting comparisons between density estimates. All of these issues have resulted in the recommendation that entrainment sampling be done in the lagoon using nets towed as close as practical to the intake structure.

- 8) *Page 11:* As part of the description of entrainment sampling methods, the authors mention that the "accuracy of individual instruments differed by less than 5% between calibrations." This is mentioned as a statement. Is it intended to be a quality standard?

Response: No, it is not intended as a quality standard, it is just a statement that the difference in rotor constants between calibrations was generally less than 5%. In addition to maintaining the flowmeters before and after each survey, they are calibrated every three months to recalculate a new rotor constant, which is used to calculate the flow of water through the net. If the value of a constant changes greater than 10% between calibrations, which is almost never the case, the readings from the field data sheets are reviewed to determine when the change occurred. If the change in the flowmeter can be detected from the data, the values will be adjusted using the average difference between the two flowmeters used on the bongo frame prior to that sample; otherwise the flowmeter reading for the instrument that is within the 10% calibration range will be used to estimate the volume of seawater filtered through both nets on the bongo frame.

- 9) *Page 11:* The authors state that if the target volume of water is not filtered during the entrainment tow, the tow will be repeated until the targeted volume is reached. Will the tow distance be extended to accomplish this, or will the tow truly be "repeated?"

Response: The tow will be continued at the lagoon and entrainment stations by extending the tow, covering the vertical depth of the water column until the target volume is collected. Some of the deeper nearshore samples cannot simply be extended because it would not be possible to collect an unbiased sample that extended across all depths without greatly increasing the sample volume. In these cases, or if flowmeters are fouled with kelp, the samples are discarded and the sampling is repeated at the station.

- 10) *Page 12:* The source water sampling methods are said to be "identical to the entrainment sample collection" (with a few noted exceptions). Does that mean that all source water stations will be sampled concurrently with entrainment sampling, and during the same (four) six-hour cycles? Is the source water sampling index period the same as the June 2004-May 2005 entrainment period?

Response: Yes, all of the stations, source water and entrainment, are sampled during the same four six-hour blocks on the day the survey is conducted. All of the stations are usually sampled within a 2-3 hour period. All of the

stations have been sampled since June 2004 with a total of eight surveys collected as of December 2004.

- 11) *Page 13:* The Inner Lagoon will be sampled with a single pushnet. Will the targeted volume of water be the same as the paired net (oblique) samples taken in the Outer Lagoon and nearshore ocean areas?

Response: Yes. The targeted volume for the lagoon source water and entrainment samples is approximately 50 m³. The volumes for samples from the nearshore stations may be greater, especially at the deepest stations, N4 and N5, where the minimum sample volume may exceed 50 m³ because the nets are lowered through the entire water column and then retrieved.

- 13) *Page 13:* The authors mention that "the number of source water stations will be evaluated as data become available to determine if fewer stations can be sampled." More information may be warranted to explain this process, and in particular, to explain whether reviewing agencies will be included in the decision process.

Response: A proposal for this or any other change in the sampling program would first be submitted to the Regional Board for review. Any changes would only be implemented after review and approval by Regional Board and other reviewing agencies.

- 14) *Page 14:* The authors state that, "A laboratory quality control (QC) program...will be applied to all samples." Is this a printed and approved QA/QC plan? If so, it should be cited. If not, what are the specific data quality objectives for laboratory processing (e.g., sorting efficiencies, taxonomic agreement, etc.)?

Response: The laboratory QC program is an internal Tenera document that was not cited in the study plan. The QC program includes a procedure for preserving, transferring, splitting, and sorting plankton samples. There is a separate procedure for identification of the organisms from the samples. The following data quality objectives are used for sorting:

1. The first ten samples that are sorted by an individual are completely resorted by a designated QC sorter. A sorter is allowed to miss one target organism when the original sorted count is 1-19. For original counts above 20 a sorter must maintain a sorting accuracy of 90%.
2. After the sorter has passed 10 consecutive sorts, the program is switched to a '1 sample in 10' QC program for that sorter. After the sorter has

completed another 10 samples, one sample is randomly selected by the designated QC sorter for a QC resort.

3. If the sorter maintains the 90% accuracy sorting rate for this sample, then the sorter continues in the '1 sample in 10' QC mode.
4. If a sample does not meet the 90% accuracy rate their subsequent samples will be resorted until 10 consecutive samples meet the criteria.

A similar QC procedure is used for taxonomic identification except that the taxonomist must maintain an accuracy level of 95% for the identifications.

- 16) *Page 15:* The FH model requires specific input parameter data (e.g., age-specific mortality) that may not be readily available. The authors state that, "...this degree of information is rarely available for a population." They also mention that "...our assessment will employ any available, scientifically acceptable sources of information on fisheries stock or population estimates of unexploited species entrained by the EPS." Will adequate input parameter data be available, or is it too early in the process to tell?

Response: The initial review of the data showed that many of the same fish taxa that were analyzed from other studies were also abundant in the EPS samples. Also, similar to other studies, the majority of the fishes were small, forage species that do not have direct commercial/recreational fishery values. Therefore, while it has been possible to parameterize the adult equivalent models (FH and AEL) for many of these species in past studies, estimates of their adult populations that were necessary to interpret the results of the modeling efforts were usually not available. The MEC study on the fishes of Aqua Hedionda Lagoon and results from supplemental studies on adult fishes will help provide some of this information.

- 19) *Page 19:* The impingement study methods do not mention an index period. Has impingement sampling begun, and will the sampling period coincide with entrainment sampling (June 2004-May 2005)?

Response: Yes, impingement sampling began in early July 2004 and will continue through June 2005. Although it does not exactly coincide with entrainment sampling, it is close enough to capture the same seasonal changes in fish and target invertebrate abundance that will be present in the entrainment sampling. The sampling was started in July to take advantage of studies at the plant being conducted in association with the permitting for the desalination facility being proposed for construction at the plant site by Poseidon Resources (See *Tenera Response to Comment 6*).

- 20) *Page 20:* The authors mention a quality control (QC) program for impingement sampling. Is this a printed and approved QA/QC plan? If so, it should be cited. If not, what are the "random cycles for re-sorting" and the specific quality objectives (e.g., for sorting efficiency)?

Response: Tenera has written procedures for conducting the impingement sampling at EPS that all participating samplers are required to follow. A quality control plan is part of this procedure. Each impingement sampling team is comprised of two qualified biologists familiar with the fish and invertebrate fauna likely to be impinged. The goal of the sampling is to correctly identify, and accurately count and weigh all impinged organisms according to the criteria in the sampling protocol. In addition to ongoing quality control checks by samplers (e.g., consultations among team members, supervisor involvement, preservation of specimens of uncertain identity), Tenera personnel will check the counts and identifications from two cycles of impinged material on a quarterly basis. Unlike the laboratory identification process where a 90% sorting accuracy objective is specified, a specific quantitative objective for the impingement QC program is not feasible because of the variability in the quantity and types of impinged material. The objective is 100% accuracy. Tenera will document the results of the QC checks and implement any corrective actions necessary to ensure compliance with the written procedures.

- 21) *Page 22:* The authors state that, "Although we have proposed to sample normal impingement weekly, we will evaluate the potential to reduce the sampling frequency to once every two weeks." More information may be warranted to explain this process, and in particular, to explain whether reviewing agencies will be included in the decision process.

Response: See response to Comment 13.

- 22) *Page 23:* The authors state that, "Fishery management practices and other forms of stock assessments will provide the context required to interpret [the estimate of the annual probability of mortality due to entrainment]." The data types mentioned may not be available for some of the most frequently entrained fishes (e.g., non-commercial /non-recreational species). Will adequate evaluation data be available, or is it too early in the process to tell?

Response: See response to Comment #16. The MEC study on the fishes of Agua Hedionda Lagoon will help provide this information for the small,

estuarine, forage species that are not targeted by commercial or recreational fisheries.

- 23) *Page 23 and 24:* Potential target organisms are mentioned. Comment 1 (above) applies here. Will the California Regional Water Quality Control Board (and others) be contacted to approve target organism selection before commencement of assessment analyses?

Response: See response to Comment 1.

SUGGESTIONS

- The governing regulatory/resource agencies should be given the opportunity to consider and approve/reject: the selection process for representative species (mentioned in comments 1 and 23, above); the possible reduction in the number of source water sampling stations (comment 13); and the possible reduced impingement sampling frequency.

Response: See responses to comments 1, 13, and 23. Proposals for these, or any other, change to the sampling program would first be submitted to the Regional Board for review. Any changes would only be implemented after review and approval by the Regional Board.

- The temporal aspects of the study questioned in comments 6, 10 and 19 (above) need to be explained in more detail.

Response: See responses to Comments 6 and 19.

- The quality control program needs to be described in more detail (see comments 14 and 20), or the QA/QC plan should be cited and/or attached as an appendix.

Response: Procedures for the sampling and laboratory processing will be submitted as attachments to the study plan.

- As mentioned previously, the study plan was obviously developed by qualified and experienced contractors, and we think that their study design is conceptually valid. Most comments listed above represent the need for relatively minor clarifications or additions.

Thank you again for the opportunity to respond to the comments from Tetra Tech. The study being conducted by Tenera Environmental is based on the design used for the entrainment and impingement studies at the Duke Energy South Bay Power Plant in San

Mr. John Phillips

Cabrillo Power Response to Regional Board Comments on Encina 316(b) Sampling Plan

January 10, 2005

Page 9 of 9


Diego Bay. These studies were required for the plant's NPDES permit that was recently approved by the Regional Board. Therefore, we are confident that the study will provide the information necessary for Cabrillo Power I LLC to comply with EPA's recently published Phase II rule for Section 316(b) of the Clean Water Act. We look forward to working with you and the other Regional Board staff on this project and would be available to discuss our responses to these comments at your convenience.

If you have any questions or comments, please contact Mr. Tim Hemig at (760) 268-4037.

Sincerely,

Cabrillo Power I LLC

By: Its Authorized Agent,



By: NRG Cabrillo Power Operations Inc.

Gregory J. Hughes

Regional Plant Manager

cc: Tim Hemig (Cabrillo)
Sheila Henika (Cabrillo)
John Steinbeck (Tenera)
Pedro Lopez (Cabrillo)
Hashim Navrozali (Regional Board)

CARLSBAD SEAWATER DESALINATION PROJECT

SAN DIEGO REGIONAL WATER QUALITY CONTROL BOARD

REGION 9, SAN DIEGO REGION

ORDER NO. R-9-2006-0065

NPDES NO. CA0109223

FLOW, ENTRAINMENT AND IMPINGEMENT MINIMIZATION PLAN

**ATTACHMENT 5 - UPDATED IMPINGEMENT AND ENTRAINMENT
ASSESSMENT, TENERA ENVIRONMENTAL, MAY 2007.**

March 2, 2009



CARLSBAD SEAWATER DESALINATION PROJECT

Technical Memorandum

**ASSESSMENT OF POTENTIAL
IMPINGEMENT AND ENTRAINMENT
ATTRIBUTED TO DESALINATION PLANT OPERATIONS
AND ASSOCIATED
AREA OF PRODUCTION FORGONE**

Prepared

By TENERA Environmental, Inc.

For

Poseidon Resources Channelside, LLC

May 2007

INTRODUCTION

The purpose of this technical memorandum (TM) is to present an estimate to of the maximum impingement and entrainment of marine organisms that could be attributed to the operations of the 50 MGD Carlsbad Seawater Desalination Facility (CDF) based on the most recent data collection study completed during the period of June 1, 2004 to May 31, 2005 at the Encina Power Generation Station (EPS). This memorandum also provides an estimate of the maximum area (acreage) of production forgone (APF) associated with the operation of the intake of the desalination plant under a stand-alone operational condition, when the plant collects 304 MGD of seawater through the existing system of the EPS to produce 50 MGD of drinking water and the power plant does not generate energy.

The data collected during the June'04/May'05 period and used for this study represent the most contemporary data on entrainment and impingement applicable to the CDF project. These impingement and entrainment data were collected in accordance with a published study plan (see Appendix 1), which plan was reviewed and approved by the San Diego Regional Water Quality Control Board, representatives of the California Department of Fish and Game, the National Marine Fisheries Service, and by an EPA-appointed independent consultant. The study plan, as appended to this technical memorandum, includes a review of the previous impingement and entrainment study results and methods completed in 1980 and a rationale, plan, and methods for completion of the 2004/2005 study results of which are used in this memorandum.

ASSESSMENT OF ENTRAINMENT EFFECT AND APF

The analysis presented in this TM employed entrainment impacts expressed as proportional losses as calculated using the empirical transport modeling (ETM) method (see Appendix 1- Study Plan, for description of model and formula). The ETM method is widely approved by numerous State and Federal agencies, and ETM results have been employed recently by these agencies in combination with an mitigation method referred to as area of production foregone (APF), as is also done in this TM.

All of the ETM values computed for this analysis were based on a total flow of 304 mgd collected through the existing EPS intake system. Of this total flow of 304 mgd, an average of 104 mgd would be used for production of drinking water and 200 mgd for dilution of concentrated seawater. The results of the ETM calculations are summarized in Table 1.

Table 1. ETM values for Encina Power Station larval fish entrainment for the period of 01 Jun 2004 to 31 May 2005, based on steady annual intake flow of 304 mgd.

	ETM Estimate	ETM Std.Err.	ETM + SE	ETM - SE
ETM Model Data for 3070 - Gobies	0.21599	0.30835	0.52434	-0.09236
ETM Model Data for 1495 - Blennies	0.08635	0.1347	0.22104	-0.04835
ETM Model Data for 1849 - Hypsopops	0.06484	0.13969	0.20452	-0.07485
AVERAGE	<u>0.122393</u>			
ETM Model Data for 3062 - White Croaker	0.00138	0.00281	0.00419	-0.00143
ETM Model Data for 1496 - Northern Anchovy	0.00165	0.00257	0.00422	-0.00092
ETM Model Data for 1219 - California Halibut	0.00151	0.00238	0.00389	-0.00087
ETM Model Data for 1471 - Queenfish	0.00365	0.00487	0.00852	-0.00123
ETM Model Data for 1494 - Spot Fin Croaker	0.00634	0.01531	0.02165	-0.00896
AVERAGE	<u>0.002906</u>			

The average ETM for the three most commonly entrained species living in Agua Hedionda Lagoon (gobies, blennies and hypsopops) of 0.122393 (i.e., 12.2 %) was used to assess the potential area of impact of the intake operations. This approach makes it possible to establish a definitive habitat value for the source water, and is consistent with the approach taken by the California Energy Commission and their independent consultants for the Morro Bay Power Plant (MBPP) in assessing and mitigating the entrainment effects of the proposed combined cycle project. In this case, as is the case at the CDF and EPS in Agua Hedionda, the MBPP is located inside the harbor near the bay's ocean entrance and the primarily entrained species are bay species of larvae. The average Pm value used was based on the three lagoon species was 12.2 % (0.122393 was rounded to 12.2 % to reflect the accuracy of data collection).

In order to calculate the Area of Production Foregone (in acres), the number of lagoon habitat acres used by the three most commonly entrained lagoon species was multiplied by the average Pm of the three species. The estimated acres of lagoon habitat for these species are based on a 2000 Coastal Conservancy inventory of Agua Hedionda Lagoon habitat (see Table 2).

Table 2. Wetland Profile: Agua Hedionda Lagoon¹

Approximate Wetland Habitat Acreage 330 (11)

Approximate Historic Acreage 695

Habitat Acres Vegetation Source

Brackish/ Freshwater	3	Cattail, bulrush and spiny rush were dominant	(11 ² , 1 ³)
Mudflat/Tidal Channel	49	Not specified	(1)
		<i>Estuarine flats</i>	
Open Water	253	Eelgrass occurred in all basins	(11,1)
Riparian	11	Not specified	(11)
Salt Marsh	14	(11,1)	
Upland	61	(11)	
		(brackish/freshwater, riparian, saltmarsh and upland	
	391	not included)	

The calculation of APF (acres of lagoon habitat, Table 2, multiplied by the average Pm, Table 1) excluded the lagoon's acres of upland habitat (61 acres), riparian habitat (11 acres), salt marsh habitat (14 acres) and brackish/freshwater habitat (3 acres), a total of 89 acres. These habitats were excluded from the estimate because they would not contribute to the species that were found to be entrained by the EPS intake. Using the average Pm value of 12.2 % for the three lagoon species of entrained larvae and the estimated 302 acres of Agua Hedionda habitat supporting these species' larval populations, the APF value is 36.8 acres (302 acres x 0.122 = 36.8 acres).

IMPINGEMENT ASSESSMENT

A number of juvenile and adult fishes and other marine life are impinged on the existing screens across the intake flow. The amount of impinged organisms generally varies with the amount of flow, but it not in a direct or linear manner. The daily biomass of

¹ Copyright © 2000 California State Coastal Conservancy. All rights reserved.

The Southern California Watershed Inventory is a project of the California State Coastal Conservancy. The Watershed Inventory compiles existing data that has not been independently verified. This information is not suitable for any regulatory purpose, and should not be the basis for any determination relating to impact assessment or mitigation.

This file last modified on June 12, 2000

² MEC Analytical Systems Inc.. 1993. San Dieguito Lagoon restoration project Lagoon restoration project regional coastal lagoon resources summary.56 pp and appendix. This report provides a summary of habitat types, fish, bird and benthic invertebrate populations at 16 coastal wetlands south of Anaheim Bay. It is primarily a synopsis of existing information; sources used in identifying and quantifying habitat types include aerial photographs taken in early 1993. It discusses restoration of habitats at San Dieguito Lagoon given present and historic conditions of other coastal wetlands in the region. This report was prepared as part of the San Dieguito Restoration Project undertaken by Southern California Edison to mitigate for damage to coastal marine resources from the operation of the San Onofre Nuclear Generating Station.

³ MEC Analytical Systems Inc.. 1995. 1994 and 1995 field survey report of the ecological resources of Agua Hedionda Lagoon.47 pp., plus appendices. This report summarizes the results of field surveys conducted between April 1994 and June 1995 at Agua Hedionda Lagoon. The surveys collected data on eelgrass, salt marsh vegetation, birds, fish, and benthic invertebrates. Data were also collected for water quality. The surveys were designed to provide adequate environmental information to support agency review of a dredging project. The survey design and methods were developed in consultation with state and federal regulatory agencies.

impinged fish during normal power plant operations declined from the previous February 1979 to January 1980 study that reported a rate of 2.46 kg/day, to impingement rates during June 2004 to June 2005 of 0.96 kg/day. The results of the June 2004 to June 2005 impingement study are summarized in Table 3 for the abundance and weight of sampled fish. Table 3 presents impingement losses during both normal operations and heat treatment operations. It should be noted that as described in the certified Environmental Impact Report for the Carlsbad seawater desalination project, the desalination plant will be shut down during periods of tunnel heat treatment. Therefore, the desalination plant operations do not contribute to the heat-treatment related impingement losses. The results of the 2004-2005 impingement survey indicate that by not heat treating CDF will reduce the number of impinged fish sampled by approximately 80 percent and the weight of impinged fish sampled by approximately 83 percent.

Analysis of the impingement data presented in Table 3 indicates that the impingement effect attributed to the desalination plant operation would be minimal. The total daily weight of the impinged marine organisms when the desalination plant is operating on a stand-alone basis at 304 MGD and the power plant is not operating is estimated at 1.92 lbs/day (0.96 kg/day). To put this figure in perspective, it is helpful to note that 1.92 lbs/day of impinged organisms represents 0.0000001 percent of the total volume of material flowing through the intake.

TABLE 3. Number and weight of fishes, sharks, and rays impinged during normal operation and heat treatment surveys at EPS from June 2004 to June 2005.

Taxon	Common Name	Normal Operations Sample Totals				Heat Treatment	
		Sample Count	Sample Weight (g)	Bar Rack Count	Bar Rack Weight (g)	Sample Count	Sample Weight (g)
1 <i>Atherinops affinis</i>	topsmelt	5,242	42,299	10	262	15,696	67,497
2 <i>Cymatogaster aggregata</i>	shiner surfperch	2,827	28,374	-	-	18,361	196,568
3 <i>Anchoa compressa</i>	deepbody anchovy	2,079	11,606	2	21	23,356	254,266
4 <i>Seriphus politus</i>	queenfish	1,304	7,499	2	17	929	21,390
5 <i>Xenistius californiensis</i>	salema	1,061	2,390	-	-	1,577	6,154
6 <i>Anchoa delicatissima</i>	slough anchovy	1,056	3,144	-	-	7	10
7 <i>Atherinopsidae</i>	silverside	999	4,454	-	-	2,105	8,661
8 <i>Hyperprosopon argenteum</i>	walleye surfperch	605	23,962	1	21	2,547	125,434
9 <i>Engraulis mordax</i>	northern anchovy	537	786	-	-	92	374
10 <i>Leuresthes tenuis</i>	California grunion	489	2,280	-	-	7,067	40,849
11 <i>Heterostichus rostratus</i>	giant kelpfish	344	2,612	-	-	908	9,088
<i>Paralabrax</i>							
12 <i>maculatofasciatus</i>	spotted sand bass	303	4,604	-	-	1,536	107,563
13 <i>Sardinops sagax</i>	Pacific sardine	268	1,480	-	-	6,578	26,266
14 <i>Roncador stearnsi</i>	spotfin croaker	182	8,354	2	3,000	106	17,160
15 <i>Paralabrax nebulifer</i>	barred sand bass	151	1,541	-	-	1,993	32,759

16	<i>Gymnura marmorata</i>	Calif. butterfly ray	146	60,629	1	390	70	36,821
17	<i>Phanerodon furcatus</i>	white surfperch	144	4,686	-	-	53	823
18	<i>Strongylura exilis</i>	California needlefish	135	6,025	-	-	158	11,899
19	<i>Paralabrax clathratus</i>	kelp bass	111	680	-	-	976	13,279
20	<i>Porichthys myriaster</i>	specklefin midshipman	103	28,189	-	-	218	66,860
21	unidentified chub	unidentified chub	96	877	-	-	7	44
22	<i>Paralichthys californicus</i>	California halibut	95	1,729	-	-	21	4,769
23	<i>Anisotremus davidsoni</i>	sargo	94	1,662	-	-	963	68,528
24	<i>Urolophus halleri</i>	round stingray	79	20,589	-	-	1,090	300,793
25	<i>Atractoscion nobilis</i>	white seabass	70	11,295	6	872	1,618	332,056
26	<i>Hypsopsetta guttulata</i>	diamond turbot	66	10,679	1	85	112	24,384
27	<i>Micrometrus minimus</i>	dwarf surfperch	57	562	-	-	-	-
28	<i>Syngnathus spp.</i>	pipefishes	55	161	-	-	56	90
29	<i>Atherinopsis californiensis</i>	jacksmelt	54	1,152	-	-	4,468	45,152
30	<i>Myliobatis californica</i>	bat ray	50	19,899	4	5,965	132	68,572
31	<i>Menticirrhus undulatus</i>	California corbina	43	1,906	-	-	16	4,925
32	<i>Amphistichus argenteus</i>	barred surfperch	43	1,306	-	-	34	2,528
33	<i>Fundulus parvipinnis</i>	California killifish	43	299	-	-	16	41
34	unidentified fish, damaged	unid. damaged fish	36	1,060	1	70	8	262
35	Ictaluridae	catfish unid.	35	4,279	-	-	-	-
36	<i>Leptocottus armatus</i>	Pacific staghorn sculpin	32	280	-	-	5	26
37	<i>Sphyræna argentea</i>	California barracuda	29	397	-	-	46	1,667
38	<i>Lepomis cyanellus</i>	green sunfish	29	1,170	-	-	-	-
39	<i>Umbrina roncadore</i>	yellowfin croaker	28	573	-	-	127	22,399
40	<i>Lepomis macrochirus</i>	bluegill	20	670	-	-	-	-
41	<i>Ophichthus zophochir</i>	yellow snake eel	18	5,349	-	-	51	17,303
42	<i>Citharichthys stigmaeus</i>	speckled sanddab	17	62	-	-	1	30
43	<i>Brachyistius frenatus</i>	kelp surfperch	16	182	-	-	17	598
44	<i>Cheilotrema saturnum</i>	black croaker	15	103	-	-	288	9,029
45	<i>Embiotoca jacksoni</i>	black surfperch	14	1,240	-	-	69	5,367
46	<i>Genyonemus lineatus</i>	white croaker	12	171	-	-	9	79
47	<i>Platyrrhinoidis triseriata</i>	thornback	11	4,731	1	1,500	-	-
48	<i>Chromis punctipinnis</i>	blacksmith	10	396	-	-	151	4,431
49	unidentified fish	unidentified fish	10	811	-	-	-	-
50	<i>Porichthys notatus</i>	plainfin midshipman	9	1,792	-	-	-	-
51	<i>Hermosilla azurea</i>	zebra perch	9	1,097	-	-	62	3,518
52	<i>Micropterus salmoides</i>	large mouth bass	9	27	-	-	-	-
53	<i>Trachurus symmetricus</i>	jack mackerel	7	7	-	-	15	702
54	<i>Hypsoblennius gentilis</i>	bay blenny	7	37	-	-	440	2,814
55	<i>Heterostichus spp.</i>	kelpfish	7	48	-	-	-	-
56	Engraulidae	anchovies	6	3	-	-	-	-
57	<i>Anchoa spp.</i>	anchovy	6	27	-	-	-	-
58	<i>Peprilus simillimus</i>	Pacific butterfish	5	91	-	-	1	33
59	<i>Rhacochilus vacca</i>	pile surfperch	4	915	-	-	-	-
60	<i>Sebastes atrovirens</i>	kelp rockfish	4	40	-	-	-	-
61	<i>Pleuronichthys verticalis</i>	hornyhead turbot	4	190	-	-	2	251
62	<i>Pylodictis olivaris</i>	flathead catfish	4	480	-	-	-	-
63	<i>Pleuronectiformes unid.</i>	flatfishes	4	62	-	-	-	-
64	<i>Syngnathus leptorhynchus</i>	bay pipefish	3	9	-	-	-	-

65	<i>Hypsoblennius gilberti</i>	rockpool blenny	3	16-	-	8	77
66	<i>Mustelus californicus</i>	gray smoothhound	3	1,850-	-	22	19,876
	<i>Cheilopogon</i>						
67	<i>pinnatibarbus</i>	smallhead flyingfish	3	604-	-	-	-
68	<i>Ameiurus natalis</i>	yellow bullhead	3	220-	-	-	-
69	<i>Lepomis</i> spp.	sunfishes	3	196-	-	-	-
70	<i>Girella nigricans</i>	opaleye	2	346-	-	355	30,824
71	<i>Rhinobatos productus</i>	shovelnose guitarfish	2	461	2	6,200-	-
72	<i>Acanthogobius flavimanus</i>	yellowfin goby	2	55-	-	-	-
73	<i>Scomber japonicus</i>	Pacific mackerel	2	10-	-	15	880
74	<i>Hypsoblennius</i> spp.	blennies	2	11-	-	113	489
75	<i>Hypsoblennius jenkinsi</i>	mussel blenny	2	17-	-	175	946
76	<i>Paralabrax</i> spp.	sand bass	2	2-	-	6	19
77	<i>Scorpaena guttata</i>	Calif. scorpionfish	2	76-	-	-	-
78	<i>Hyporhamphus rosae</i>	California halfbeak	2	23-	-	1-	-
79	<i>Symphurus atricauda</i>	California tonguefish	2	15-	-	-	-
80	<i>Tilapia</i> spp.	tilapias	2	7-	-	-	-
81	<i>Sarda chiliensis</i>	Pacific bonito	2	1,010-	-	2	540
82	<i>Albula vulpes</i>	bonefish	2	1,192-	-	1	900
83	Sciaenidae unid.	croaker	2	3-	-	17	1,212
84	<i>Oxylebius pictus</i>	painted greenling	1	5-	-	-	-
85	<i>Lyopsetta exilis</i>	slender sole	1	26-	-	-	-
86	<i>Citharichthys sordidus</i>	Pacific sanddab	1	1-	-	-	-
87	<i>Gibbonsia montereyensis</i>	crevice kelpfish	1	8-	-	-	-
88	<i>Pleuronichthys ritteri</i>	spotted turbot	1	7-	-	13	2,745
89	<i>Gillichthys mirabilis</i>	longjaw mudsucker	1	34-	-	-	-
90	<i>Dorosoma petenense</i>	threadfin shad	1	3-	-	-	-
91	<i>Porichthys</i> spp.	midshipman	1	200-	-	-	-
92	<i>Cynoscion parvipinnis</i>	shortfin corvina	1	900-	-	-	-
93	<i>Mugil cephalus</i>	striped mullet	1	3-	-	5	3,854
94	<i>Paraclinus integripinnis</i>	reef finspot	1	4-	-	4	12
95	<i>Hyperprosopon</i> spp.	surfperch	1	115-	-	7	552
96	<i>Ameiurus nebulosus</i>	brown bullhead	1	100-	-	-	-
97	<i>Micropterus dolomieu</i>	smallmouth bass	1	150-	-	-	-
98	<i>Citharichthys</i> spp.	sanddabs	-	-	-	1	3
99	<i>Triakis semifasciata</i>	leopard shark	-	-	-	2	688
100	<i>Medialuna californiensis</i>	halfmoon	-	-	-	53	1,864
101	<i>Torpedo californica</i>	Pacific electric ray	-	-	1	3,750-	-
102	Scorpaenidae	scorpionfishes	-	-	-	2	64
103	<i>Halichoeres semicinctus</i>	rock wrasse	-	-	-	1	33
104	<i>Hypsypops rubicundus</i>	garibaldi	-	-	-	5	1,897
105	<i>Seriola lalandi</i>	yellowtail jack	-	-	-	21	978
106	<i>Dasyatis dipterura</i>	diamond stingray	-	-	-	2	1,468
107	<i>Heterodontus francisci</i>	horn shark	-	-	-	1	850
108	Zoarcidae	eelpouts	-	-	-	1	17

19,408 351,672 34 22,152 94,991 2,034,900

CARLSBAD SEAWATER DESALINATION PROJECT

SAN DIEGO REGIONAL WATER QUALITY CONTROL BOARD

REGION 9, SAN DIEGO REGION

ORDER NO. R-9-2006-0065

NPDES NO. CA0109223

FLOW, ENTRAINMENT AND IMPINGEMENT MINIMIZATION PLAN

**ATTACHMENT 6 - CARLSBAD DESALINATION FACILITY – ENCINA
POWER STATION, SUMMARY OF FISH AND TARGET SHELLFISH LARVAE
COLLECTED FOR ENTRAINMENT AND SOURCE WATER STUDIES IN THE
VICINITY OF AGUA HEDIONDA LAGOON FROM JUNE 2005 THROUGH
MAY 2006.**

March 2, 2009

Carlsbad Desalination Facility – Encina Power Station

**Summary of Fish and Target Shellfish Larvae
Collected for Entrainment and Source Water Studies
in the Vicinity of Agua Hedionda Lagoon
from June 2005 through May 2006**

Prepared by:

Tenera Environmental
971 Dewing Ave. Suite 101
Lafayette, CA 94549

141 Suburban Rd. Suite A2
San Luis Obispo, CA 93401

List of Tables

Table 1. Average concentration and total number collected of larval fishes and target shellfishes in entrainment samples collected in Agua Hedionda Lagoon (Station E1), June 2004–May 2005.	2
Table 2. Average concentration of larval fishes and target shellfishes in source water samples collected at Agua Hedionda Lagoon and nearshore stations, June 2004–May 2005.	4
Table A1. Monthly abundance and mean concentration ($\#/1,000\text{ m}^3$) of larval fishes and target invertebrates at entrainment Station E1.	A1
Table A2. Monthly abundance and mean concentration ($\#/1,000\text{ m}^3$) of larval fishes and target invertebrates at source water Stations L1–L4 in Agua Hedionda Lagoon.	A5
Table A3. Monthly abundance and mean concentration ($\#/1,000\text{ m}^3$) of larval fishes and target invertebrates at source water Stations N1–N5 in nearshore area.	A9

List of Figures

Figure 1. Location of entrainment (E1) and source water (L1–L4; N1–N5) plankton sampling stations. ...	1
Figure 2. Mean concentration ($\#/1,000\text{ m}^3$ [264,172 gal]) and standard error of all larval fishes collected at entrainment Station E1 during monthly surveys, June 2004–May 2005.	3
Figure 3. Comparison among surveys of mean concentration ($\#/1,000\text{ m}^3$ [264,172 gal]) of CIQ goby complex larvae at entrainment Station E1.	6
Figure 4. Mean concentration ($\#/1,000\text{ m}^3$ [264,172 gal]) and standard error of CIQ goby complex larvae at Agua Hedionda Lagoon (inner, middle, and outer) and nearshore source water stations during the 2004 and 2005 sampling periods. Note logarithmic abundance scale.	7
Figure 5. Mean concentration ($\#/1.0\text{ m}^3$ [264 gal]) of CIQ goby complex larvae at entrainment Station E1 during night (Cycle 3) and day (Cycle 1) sampling.	8
Figure 6. Length frequency of CIQ goby complex larvae at entrainment Station E1. Data from sub-samples of all surveys in 2004–2005.	8
Figure 7. Comparison among surveys of mean concentration ($\#/1000\text{ m}^3$ [264,172 gal]) of combtooth blenny larvae at entrainment Station E1. Note: downward pointing triangle indicates survey with no larvae collected.	9
Figure 8. Mean concentration ($\#/1000\text{ m}^3$ [264,172 gal]) and standard error of combtooth blenny larvae at Agua Hedionda Lagoon (inner, middle, and outer) and nearshore source water stations during the 2004 and 2005 sampling periods. Note logarithmic scale for mean concentration.	10
Figure 9. Mean concentration ($\#/1.0\text{ m}^3$ [264 gal]) of combtooth blenny larvae at entrainment Station E1 during night (Cycle 3) and day (Cycle 1) sampling.	11
Figure 10. Length frequency of combtooth blenny larvae at entrainment and all source water stations combined. Data from sub-samples of all surveys in 2004–2005.	11

Table of Contents

Figure 11. Comparison among surveys of mean concentration (#/1000 m ³ [264,172 gal]) of anchovy larvae at entrainment Station E1. Note: downward pointing triangle indicates survey with no larvae collected.	12
Figure 12. Mean concentration (#/1000 m ³ [264,172 gal]) and standard error of anchovy larvae at Agua Hedionda Lagoon (inner, middle, and outer) and nearshore source water stations during the 2004 and 2005 sampling periods. Note logarithmic abundance scale.	13
Figure 13. Mean concentration (#/1.0 m ³ [264 gal]) of anchovy larvae at entrainment Station E1 during night (Cycle 3) and day (Cycle 1) sampling	14
Figure 14. Length frequency of anchovy larvae at entrainment Station E1. Data from sub-samples of all surveys in 2004–2005.	14




Figure 1. Location of entrainment (E1) and source water (L1–L4; N1–N5) plankton sampling stations.

Entrainment and Source Water Summary

Table 1. Average concentration and total number collected of larval fishes and target shellfishes in entrainment samples collected in Agua Hedionda Lagoon (Station E1), June 2004–May 2005.

Taxon	Common Name	Average Concentration (# / 1,000 m ³)	Total Count	Percentage of Total	Cumulative Percentage
Gobiidae (CIQ complex)	gobies	2,222.93	12,763	61.95	61.95
<i>Hypsoblennius</i> spp.	blennies	1,107.67	5,838	28.34	90.29
Engraulidae	anchovies	134.29	819	3.98	94.27
<i>Hypsypops rubicundus</i>	garibaldi	40.99	188	0.91	95.18
<i>Typhlogobius californiensis</i>	blind goby	24.65	148	0.72	95.90
<i>Gibbonsia</i> spp.	clinid kelpfishes	22.45	125	0.61	96.51
Labrisomidae.	labrisomid kelpfishes	17.65	81	0.39	96.90
Syngnathidae	pipefishes	16.06	83	0.40	97.30
<i>Acanthogobius flavimanus</i>	yellowfin goby	14.41	87	0.42	97.72
larvae, unid. fish fragment	unid. larval fishes	9.65	56	0.27	98.00
Atherinopsidae	silversides	9.18	54	0.26	98.26
larvae, unid. yolksac	unid. yolksac larvae	8.36	39	0.19	98.45
<i>Roncador stearnsii</i>	spotfin croaker	8.33	42	0.20	98.65
<i>Rimicola</i> spp.	kelp clingfishes	7.92	43	0.21	98.86
<i>Genyonemus lineatus</i>	white croaker	7.04	44	0.21	99.07
<i>Seriphus politus</i>	queenfish	5.50	29	0.14	99.21
<i>Paraclinus integripinnis</i>	reef finspot	4.95	31	0.15	99.36
<i>Paralichthys californicus</i>	California halibut	3.73	21	0.10	99.47
<i>Sardinops sagax</i>	Pacific sardine	2.66	16	0.08	99.54
<i>Citharichthys</i> spp.	sanddabs	2.24	14	0.07	99.61
<i>Gillichthys mirabilis</i>	longjaw mudsucker	2.14	13	0.06	99.67
Sciaenidae	croakers	1.86	11	0.05	99.73
<i>Paralabrax</i> spp.	sea basses	1.86	11	0.05	99.78
<i>Hypsopsetta guttulata</i>	diamond turbot	1.78	10	0.05	99.83
larvae, unid. post-yolksac	larval fishes	1.61	10	0.05	99.88
Pleuronectiformes	flatfishes	0.63	4	0.02	99.90
<i>Heterostichus rostratus</i>	giant kelpfish	0.54	3	0.01	99.91
<i>Clinocottus analis</i>	wooly sculpin	0.51	3	0.01	99.93
<i>Stenobranchius leucopsarus</i>	northern lampfish	0.37	2	0.01	99.94
<i>Cheilotrema saturnum</i>	black croaker	0.35	2	0.01	99.95
<i>Scomber japonicus</i>	Pacific mackerel	0.35	1	<0.01	99.95
Ophidiidae	cusk-eels	0.21	1	<0.01	99.96
Gobiesocidae	clingfishes	0.20	1	<0.01	99.96
<i>Diaphus theta</i>	Calif. headlight fish	0.19	1	<0.01	99.96
<i>Semicossyphus pulcher</i>	California sheephead	0.19	1	<0.01	99.97
<i>Menticirrhus undulatus</i>	California corbina	0.18	1	<0.01	99.97
Haemulidae	grunts	0.18	1	<0.01	99.98
Labridae	wrasses	0.17	1	<0.01	99.98
Myctophidae	lanternfishes	0.16	1	<0.01	99.99
<i>Symbolophorus californiensis</i>	California lanternfish	0.16	1	<0.01	99.99
<i>Oxyjulis californica</i>	señorita	0.14	1	<0.01	100.00
20,601					
<i>Cancer</i> spp. (megalops)	cancer crabs	0.17	1		0.07




Figure 2. Mean concentration (# / 1,000 m³ [264,172 gal]) and standard error of all larval fishes collected at entrainment Station E1 during monthly surveys, June 2004–May 2005.

Entrainment and Source Water Summary

Table 2. Average concentration of larval fishes and target shellfishes in source water samples collected at Agua Hedionda Lagoon and nearshore stations, June 2004–May 2005.

Taxon	Common Name	Nearshore		Lagoon	
		Average Concentration (# / 1,000 m ³)	Total Count	Average Concentration (# / 1,000 m ³)	Total Count
Fishes					
Engraulidae	anchovies	525.48	7,631	103.41	1,210
<i>Hypsoblennius</i> spp.	blennies	137.56	1,966	467.32	4,725
Gobiidae (CIQ complex)	gobies	69.12	921	2,718.58	30,270
<i>Genyonemus lineatus</i>	white croaker	64.66	921	4.25	54
larvae, unidentified yolksac	unid. yolksac larvae	45.82	678	3.12	32
<i>Paralichthys californicus</i>	California halibut	42.91	601	1.93	22
<i>Paralabrax</i> spp.	sand basses	24.88	372	0.68	8
<i>Seriphus politus</i>	queenfish	23.79	365	2.40	26
Sciaenidae	croaker	22.55	306	6.56	73
<i>Citharichthys</i> spp.	sanddabs	21.70	334	1.14	15
<i>Roncador stearnsii</i>	spotfin croaker	20.17	286	6.82	74
<i>Gibbonsia</i> spp.	clinid kelpfishes	19.29	277	16.74	182
Labrisomidae	labrisomid kelpfishes	16.36	219	35.30	366
<i>Sardinops sagax</i>	Pacific sardine	13.21	202	0.74	9
larval fish fragment	unid. larval fishes	10.50	145	15.02	174
Haemulidae	grunts	8.80	116	0.17	2
<i>Scomber japonicus</i>	Pacific mackerel	7.07	110	-	-
<i>Hypsypops rubicundus</i>	garibaldi	7.03	110	35.12	352
larval/post-larval fish unid.	larval fishes	6.81	93	1.36	16
<i>Oxyjulis californica</i>	senorita	5.55	79	0.75	8
<i>Paralabrax nebulifer</i>	barred sand bass	5.08	82	-	-
<i>Sphyrna argentea</i>	California barracuda	3.74	59	0.17	2
<i>Xenistius californiensis</i>	salema	3.61	55	0.30	3
<i>Lepidogobius lepidus</i>	bay goby	3.59	56	0.09	1
<i>Stenobranchius leucopsarus</i>	northern lampfish	3.26	51	-	-
Atherinopsidae	silversides	3.09	39	29.73	348
<i>Pleuronichthys verticalis</i>	hornyhead turbot	2.79	43	-	-
<i>Umbrina roncador</i>	yellowfin croaker	2.62	39	0.09	1
Ophidiidae	cusks-eels	2.61	37	0.09	1
<i>Pleuronichthys ritteri</i>	spotted turbot	2.51	34	0.17	2
Pleuronectidae unid.	flounders	2.28	35	0.08	1
<i>Xystreurys liolepis</i>	fantail sole	1.97	27	0.21	2
<i>Hypsopsetta guttulata</i>	diamond turbot	1.97	30	0.55	7
<i>Rimicola</i> spp.	kelp clingfishes	1.79	22	3.28	34
<i>Peprilus simillimus</i>	Pacific butterfish	1.78	28	-	-
<i>Cheilotrema saturnum</i>	black croaker	1.71	24	0.36	4
<i>Semicossyphus pulcher</i>	California sheephead	1.49	21	-	-
<i>Diaphus theta</i>	Calif. headlight fish	1.46	24	-	-
<i>Acanthogobius flavimanus</i>	yellowfin goby	1.46	22	38.98	499
Pleuronectiformes	flatfishes	1.25	21	0.07	1
<i>Menticirrhus undulatus</i>	California corbina	1.21	16	0.47	5
<i>Atractoscion nobilis</i>	white seabass	1.18	18	0.08	1
<i>Sebastes</i> spp.	rockfishes	1.09	18	-	-

(table continued)

Entrainment and Source Water Summary

Table 2 (continued). Average concentration of larval fishes and target shellfishes in source water samples collected at nearshore stations and Agua Hedionda Lagoon, June 2004-May 2005.

Taxon	Common Name	Nearshore		Lagoon	
		Average Concentration (# / 1,000 m ³)	Total Count	Average Concentration (# / 1,000 m ³)	Total Count
<i>Girella nigricans</i>	opaleye	1.06	16	-	-
Syngnathidae	pipefishes	1.02	13	5.31	53
<i>Typhlogobius californiensis</i>	blind goby	0.99	15	9.63	118
<i>Trachurus symmetricus</i>	jack mackerel	0.96	17	-	-
<i>Halichoeres semicinctus</i>	rock wrasse	0.95	15	-	-
Labridae	wrasses	0.83	11	-	-
<i>Paraclinus integripinnis</i>	reef finspot	0.81	14	2.88	31
<i>Symphurus atricaudus</i>	California tonguefish	0.77	11	-	-
<i>Triphoturus mexicanus</i>	Mexican lampfish	0.73	12	0.16	2
<i>Nannobranchium</i> spp.	lanternfishes	0.57	9	-	-
<i>Medialuna californiensis</i>	halfmoon	0.53	7	-	-
<i>Gillichthys mirabilis</i>	longjaw mudsucker	0.51	8	5.17	62
<i>Chilara taylori</i>	spotted cusk-eel	0.50	7	-	-
<i>Heterostichus rostratus</i>	giant kelpfish	0.50	7	-	-
Paralichthyidae	lefteye flounders	0.44	7	-	-
<i>Parophrys vetulus</i>	English sole	0.30	5	-	-
Myctophidae	lanternfishes	0.30	4	-	-
<i>Hippoglossina stomata</i>	bigmouth sole	0.29	5	-	-
<i>Zaniolepis frenata</i>	shortspine combfish	0.25	5	-	-
<i>Ruscarius creaseri</i>	roughcheek sculpin	0.22	3	-	-
Clupeiformes	herrings and anchovies	0.21	3	-	-
Gobiesocidae	clingfishes	0.18	3	0.64	7
Clupeidae	herrings	0.18	3	-	-
<i>Lyopsetta exilis</i>	slender sole	0.16	3	-	-
Pomacentridae	damselfishes	0.14	2	-	-
<i>Rhinogobiops nicholsii</i>	blackeye goby	0.14	2	-	-
<i>Nannobranchium ritteri</i>	broadfin lampfish	0.13	2	-	-
<i>Cyclothone</i> spp.	bristlemouths	0.13	2	-	-
<i>Chromis punctipinnis</i>	blacksmith	0.13	2	-	-
<i>Icelinus</i> spp.	sculpins	0.13	3	-	-
<i>Anisotremus davidsonii</i>	sargo	0.12	2	-	-
<i>Sebastes jordani</i>	shortbelly rockfish	0.10	2	-	-
Blennioidei	blennies	0.08	1	0.36	4
Clinidae	clinid kelpfishes	0.08	1	-	-
Chaenopsidae	tube blennies	0.07	1	-	-
<i>Leptocottus armatus</i>	Pacific staghorn sculpin	0.07	1	0.51	6
Cynoglossidae	tongue soles	0.07	1	-	-
Kyphosidae	sea chubs	0.07	1	-	-
<i>Cyclothone acclinidens</i>	benttooth bristlemouth	0.07	1	-	-
Hexagrammidae	greenlings	0.06	1	-	-
<i>Bathylagus ochotensis</i>	popeye blacksmelt	0.06	1	-	-
<i>Hypsoblennius gentilis</i>	bay blenny	0.05	1	-	-
<i>Rimicola eigenmanni</i>	slender clingfish	-	-	4.13	53
<i>Clinocottus analis</i>	wooly sculpin	-	-	0.31	4
<i>Clinocottus</i> spp.	sculpins	-	-	0.07	1
<i>Semicossyphus pulcher</i>	California sheephead	-	-	0.06	1
		16,763		38,872	
Shellfishes					
<i>Cancer</i> spp. (megalops)	cancer crabs	9.29	158	0.17	2
<i>Panulirus interruptus</i> (larval)	California spiny lobster	7.04	98	0.21	2
<i>Cancer gracilis</i> (megalops)	slender crab	2.93	48		




Figure 3. Comparison among surveys of mean concentration (#/1,000 m³ [264,172 gal]) of CIQ goby complex larvae at entrainment Station E1.




Figure 4. Mean concentration ($\#/1,000 \text{ m}^3$ [264,172 gal]) and standard error of CIQ goby complex larvae at Agua Hedionda Lagoon (inner, middle, and outer) and nearshore source water stations during the 2004 and 2005 sampling periods. Note logarithmic abundance scale.




Figure 5. Mean concentration (#/1.0 m³ [264 gal]) of CIQ goby complex larvae at entrapment Station E1 during night (Cycle 3) and day (Cycle 1) sampling.




Figure 6. Length frequency of CIQ goby complex larvae at entrapment Station E1. Data from sub-samples of all surveys in 2004–2005.

Entrainment and Source Water Summary




Figure 7. Comparison among surveys of mean concentration (#/1000 m³ [264,172 gal]) of combtooth blenny larvae at entrainment Station E1. Note: downward pointing triangle indicates survey with no larvae collected.




Figure 8. Mean concentration ($\#/1000 \text{ m}^3$ [264,172 gal]) and standard error of combtooth blenny larvae at Agua Hedionda Lagoon (inner, middle, and outer) and nearshore source water stations during the 2004 and 2005 sampling periods. Note logarithmic scale for mean concentration.




Figure 9. Mean concentration (#/1.0 m³ [264 gal]) of combtooth blenny larvae at entrapment Station E1 during night (Cycle 3) and day (Cycle 1) sampling.




Figure 10. Length frequency of combtooth blenny larvae at entrapment and all source water stations combined. Data from sub-samples of all surveys in 2004–2005.




Figure 11. Comparison among surveys of mean concentration (#/1000 m³ [264,172 gal]) of anchovy larvae at entrapment Station E1. Note: downward pointing triangle indicates survey with no larvae collected.




Figure 12. Mean concentration ($\#/1000 \text{ m}^3$ [264,172 gal]) and standard error of anchovy larvae at Agua Hedionda Lagoon (inner, middle, and outer) and nearshore source water stations during the 2004 and 2005 sampling periods. Note logarithmic abundance scale.




Figure 13. Mean concentration (#/1.0 m³ [264 gal]) of anchovy larvae at entrainment Station E1 during night (Cycle 3) and day (Cycle 1) sampling.




Figure 14. Length frequency of anchovy larvae at entrainment Station E1. Data from sub-samples of all surveys in 2004–2005.

Appendix A

Entrainment and Source Water Sampling Results by Survey

A1 – Entrainment

A2 – Source Water: Agua Hedionda Lagoon

A3 – Source Water: Nearshore

Appendix A: Results by Survey

Table A1. Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at entrainment Station E1.

			Survey Number:		1	2	
			Survey Date:		06/10/04	06/24/04	
			Sample Count:		8	8	
Taxon	Common Name	Total Count	Mean Conc.	Count	Conc.	Count	Conc.
Fishes							
1	Gobiidae unid.	12,762	2,222.69	609	2,059.68	576	1,622.60
2	<i>Hypsoblennius</i> spp.	5,838	1,107.67	784	2,712.14	438	1,197.26
3	<i>Engraulis mordax</i>	505	84.40	6	17.86	-	-
4	Engraulidae unid.	314	49.88	-	-	2	5.15
5	<i>Hypsypops rubicundus</i>	188	40.99	79	268.68	8	23.41
6	<i>Typhlogobius californiensis</i>	148	24.65	2	4.80	-	-
7	<i>Gibbonsia</i> spp.	125	22.45	3	11.11	2	5.24
8	Labrisomidae unid.	81	17.65	26	92.41	10	28.36
9	<i>Acanthogobius flavimanus</i>	87	14.41	-	-	-	-
10	larval fish fragment	56	9.65	8	25.54	-	-
11	larvae, unidentified yolk sac	39	8.36	5	16.62	6	18.21
12	<i>Roncador steamsi</i>	42	8.33	1	2.40	1	2.57
13	<i>Syngnathus leptorhynchus</i>	36	8.20	7	21.36	8	22.75
14	<i>Atherinopsis californiensis</i>	47	7.99	-	-	-	-
15	<i>Rimicola</i> spp.	43	7.92	3	9.95	1	2.49
16	<i>Syngnathus</i> spp.	47	7.85	2	6.39	-	-
17	<i>Genyonemus lineatus</i>	44	7.04	-	-	-	-
18	<i>Seriphus politus</i>	29	5.50	2	6.65	-	-
19	<i>Paraclinus integripinnis</i>	31	4.95	-	-	-	-
20	<i>Paralichthys californicus</i>	21	3.73	1	2.40	-	-
21	<i>Sardinops sagax</i>	16	2.66	-	-	-	-
22	<i>Gillichthys mirabilis</i>	13	2.14	-	-	-	-
23	Sciaenidae unid.	11	1.86	-	-	1	2.49
24	<i>Hypsopsetta guttulata</i>	10	1.78	-	-	-	-
25	larval/post-larval fish unid.	10	1.61	1	2.40	-	-
26	<i>Citharichthys stigmæus</i>	8	1.33	-	-	-	-
27	<i>Paralabrax</i> spp.	7	1.15	-	-	-	-
28	Atherinopsidae unid.	5	0.82	-	-	-	-
29	<i>Citharichthys sordidus</i>	5	0.79	-	-	-	-
30	<i>Paralabrax clathratus</i>	4	0.71	-	-	-	-
31	Pleuronectiformes unid.	4	0.63	-	-	-	-
32	<i>Heterostichus rostratus</i>	3	0.54	1	2.40	-	-
33	<i>Clinocottus analis</i>	3	0.51	-	-	-	-
34	<i>Stenobranchius leucopsarus</i>	2	0.37	-	-	-	-
35	<i>Atherinops affinis</i>	2	0.36	-	-	-	-
36	<i>Cheilotrema saturnum</i>	2	0.35	-	-	-	-
37	<i>Scomber japonicus</i>	1	0.35	1	4.51	-	-
38	<i>Quietula y-cauda</i>	1	0.25	-	-	-	-
39	Ophidiidae unid.	1	0.21	-	-	-	-
40	<i>Gobiesox</i> spp.	1	0.20	-	-	1	2.66
41	<i>Diaphus theta</i>	1	0.19	-	-	-	-
42	<i>Semicossyphus pulcher</i>	1	0.19	-	-	-	-
43	<i>Menticirrhus undulatus</i>	1	0.18	-	-	-	-
44	Haemulidae unid.	1	0.18	-	-	-	-
45	Labridae unid.	1	0.17	-	-	-	-
46	Myctophidae unid.	1	0.16	-	-	-	-
47	<i>Symbolophorus californiensis</i>	1	0.16	-	-	-	-
48	<i>Oxyjulis californica</i>	1	0.14	-	-	-	-
49	<i>Citharichthys</i> spp.	1	0.13	-	-	-	-
Invertebrates							
	<i>Cancer anthonyi</i> (megalops)	1	2.21	-	-	-	-
		20,602		1,541		1,054	

Appendix A: Results by Survey

Table A1 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at entrainment Station E1.

	Survey Number: 3		4		5		6	
	Survey Date: 07/06/04		08/13/04		09/23/04		10/21/04	
	Sample Count: 8		8		8		8	
Taxon	Count	Conc.	Count	Conc.	Count	Conc.	Count	Conc.
Fishes								
Gobiidae unid.	1,349	3,651.19	3,347	6,989.90	992	2,259.40	454	1,118.40
<i>Hypsoblennius</i> spp.	615	1,857.95	1,843	3,900.14	917	2,056.02	115	275.79
<i>Engraulis mordax</i>	7	19.60	-	-	2	4.55	2	4.43
Engraulidae unid.	17	41.45	6	11.44	-	-	-	-
<i>Hypsypops rubicundus</i>	24	76.54	8	16.58	-	-	-	-
<i>Typhlogobius californiensis</i>	1	3.57	-	-	-	-	-	-
<i>Gibbonsia</i> spp.	-	-	1	1.85	-	-	16	42.17
Labrisomidae unid.	20	52.50	2	4.38	20	45.30	1	2.62
<i>Acanthogobius flavimanus</i>	-	-	-	-	-	-	-	-
larval fish fragment	-	-	3	6.62	4	8.90	8	19.52
larvae, unidentified yolk sac	16	46.61	-	-	3	7.57	-	-
<i>Roncador steamsi</i>	11	34.26	1	2.09	28	67.03	-	-
<i>Syngnathus leptorhynchus</i>	19	57.50	-	-	-	-	1	2.83
<i>Atherinopsis californiensis</i>	-	-	-	-	-	-	-	-
<i>Rimicola</i> spp.	12	29.44	15	31.44	3	6.87	9	22.75
<i>Syngnathus</i> spp.	-	-	32	67.29	13	28.39	-	-
<i>Genyonemus lineatus</i>	-	-	1	1.93	7	16.59	-	-
<i>Seriplus politus</i>	-	-	3	6.38	22	53.74	2	4.77
<i>Paraclinus integrispinnis</i>	-	-	31	64.39	-	-	-	-
<i>Paralichthys californicus</i>	-	-	1	2.09	5	13.58	2	5.23
<i>Sardinops sagax</i>	-	-	-	-	-	-	-	-
<i>Gillichthys mirabilis</i>	-	-	-	-	-	-	-	-
Sciaenidae unid.	1	3.20	-	-	3	6.64	1	2.62
<i>Hypsopsetta guttulata</i>	-	-	-	-	3	7.81	-	-
larval/post-larval fish unid.	1	2.39	5	9.76	-	-	-	-
<i>Citharichthys stigmaeus</i>	-	-	-	-	-	-	2	5.54
<i>Paralabrax</i> spp.	-	-	3	5.69	4	9.26	-	-
Atherinopsidae unid.	-	-	-	-	-	-	-	-
<i>Citharichthys sordidus</i>	-	-	-	-	-	-	-	-
<i>Paralabrax clathratus</i>	-	-	-	-	4	9.21	-	-
Pleuronectiformes unid.	-	-	-	-	-	-	-	-
<i>Heterostichus rostratus</i>	-	-	-	-	-	-	-	-
<i>Clinocottus analis</i>	-	-	-	-	-	-	-	-
<i>Stenobranchius leucopsarus</i>	-	-	-	-	-	-	-	-
<i>Atherinops affinis</i>	1	2.50	-	-	-	-	-	-
<i>Cheilotrema saturnum</i>	1	2.50	1	2.02	-	-	-	-
<i>Scomber japonicus</i>	-	-	-	-	-	-	-	-
<i>Quietula y-cauda</i>	1	3.20	-	-	-	-	-	-
Ophidiidae unid.	-	-	-	-	-	-	1	2.71
Gobiesox spp.	-	-	-	-	-	-	-	-
<i>Diaphus theta</i>	-	-	-	-	-	-	-	-
<i>Semicossyphus pulcher</i>	-	-	-	-	-	-	-	-
<i>Menticirrhus undulatus</i>	1	2.39	-	-	-	-	-	-
Haemulidae unid.	-	-	-	-	1	2.29	-	-
Labridae unid.	-	-	-	-	1	2.19	-	-
Myctophidae unid.	-	-	-	-	-	-	-	-
<i>Symbolophorus californiensis</i>	-	-	-	-	-	-	-	-
<i>Oxyjulis californica</i>	-	-	-	-	-	-	-	-
<i>Citharichthys</i> spp.	-	-	-	-	-	-	-	-
Invertebrates								
<i>Cancer anthonyi</i> (megalops)	-	-	-	-	-	-	-	-
	2,097		5,303		2,032		614	

Appendix A: Results by Survey

Table A1 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at entrainment Station E1.

Survey Number: 7		8		9		10		
Survey Date: 11/18/04		12/16/04		01/13/05		02/24/05		
Sample Count: 8		8		8		8		
Taxon	Count	Conc.	Count	Conc.	Count	Conc.	Count	Conc.
Fishes								
Gobiidae unid.	203	411.13	102	233.48	118	263.27	555	1,179.31
Hypsoblennius spp.	151	320.89	5	11.75	4	8.53	-	-
Engraulis mordax	26	48.05	-	-	1	2.22	25	51.06
Engraulidae unid.	-	-	-	-	-	-	-	-
Hypsypops rubicundus	-	-	-	-	-	-	-	-
Typhlogobius californiensis	-	-	-	-	-	-	4	8.61
Gibbonsia spp.	7	13.96	6	13.51	61	141.98	11	22.93
Labrisomidae unid.	1	1.75	-	-	-	-	-	-
Acanthogobius flavimanus	-	-	-	-	19	44.01	63	133.24
larval fish fragment	2	3.95	-	-	1	2.28	4	8.48
larvae, unidentified yolk sac	-	-	-	-	-	-	-	-
Roncador stearnsi	-	-	-	-	-	-	-	-
Syngnathus leptorhynchus	-	-	-	-	-	-	-	-
Atherinopsis californiensis	-	-	2	4.93	13	29.82	22	47.31
Rimicola spp.	-	-	-	-	-	-	-	-
Syngnathus spp.	-	-	-	-	-	-	-	-
Genyonemus lineatus	4	7.92	1	2.47	3	6.50	13	26.67
Seriphus politus	-	-	-	-	-	-	-	-
Paraclinus integripinnis	-	-	-	-	-	-	-	-
Paralichthys californicus	1	1.75	1	2.22	2	4.40	3	5.75
Sardinops sagax	2	3.49	-	-	-	-	5	10.93
Gillichthys mirabilis	3	7.07	1	2.15	1	2.22	5	10.56
Sciaenidae unid.	1	1.85	-	-	-	-	-	-
Hypsopsetta guttulata	2	4.02	1	1.71	4	9.59	-	-
larval/post-larval fish unid.	-	-	-	-	3	6.33	-	-
Citharichthys stigmaeus	4	7.32	-	-	-	-	-	-
Paralabrax spp.	-	-	-	-	-	-	-	-
Atherinopsidae unid.	-	-	-	-	-	-	2	4.61
Citharichthys sordidus	3	5.24	-	-	-	-	-	-
Paralabrax clathratus	-	-	-	-	-	-	-	-
Pleuronectiformes unid.	3	5.70	-	-	-	-	-	-
Heterostichus rostratus	1	2.18	-	-	-	-	1	2.41
Clinocottus analis	-	-	1	2.20	1	2.28	1	2.15
Stenobranchius leucopsarus	-	-	-	-	2	4.82	-	-
Atherinops affinis	-	-	-	-	-	-	-	-
Cheilotrema saturnum	-	-	-	-	-	-	-	-
Scomber japonicus	-	-	-	-	-	-	-	-
Quietula y-cauda	-	-	-	-	-	-	-	-
Ophidiidae unid.	-	-	-	-	-	-	-	-
Gobiesox spp.	-	-	-	-	-	-	-	-
Diaphus theta	-	-	-	-	-	-	-	-
Semicossyphus pulcher	-	-	-	-	-	-	-	-
Menticirrhus undulatus	-	-	-	-	-	-	-	-
Haemulidae unid.	-	-	-	-	-	-	-	-
Labridae unid.	-	-	-	-	-	-	-	-
Myctophidae unid.	-	-	-	-	-	-	-	-
Symbolophorus californiensis	-	-	-	-	-	-	-	-
Oxyjulis californica	-	-	-	-	-	-	-	-
Citharichthys spp.	-	-	-	-	-	-	-	-
Invertebrates								
Cancer anthonyi (megalops)	-	-	1	2.21	-	-	-	-
	414		121		233		714	

Table A1 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at entrainment Station E1

	Survey Number: 11		12		13	
	Survey Date: 03/23/05		04/21/05		05/19/05	
	Sample Count: 8		8		8	
Taxon	Count	Conc.	Count	Conc.	Count	Conc.
Fishes						
Gobiidae unid.	1,357	2,700.63	1,314	2,649.98	1,786	3,755.99
Hypsoblennius spp.	49	99.47	86	174.14	831	1,785.69
Engraulis mordax	89	182.27	284	642.95	63	124.21
Engraulidae unid.	60	140.57	14	28.03	215	421.84
Hypsypops rubicundus	-	-	15	30.54	54	117.11
Typhlogobius californiensis	110	238.12	17	34.38	14	31.01
Gibbonsia spp.	12	26.60	2	3.96	4	8.59
Labrisomidae unid.	-	-	-	-	1	2.13
Acanthogobius flavimanus	5	10.08	-	-	-	-
larval fish fragment	12	24.32	4	8.17	10	17.70
larvae, unidentified yolk sac	1	2.43	3	7.12	5	10.12
Roncador steamsi	-	-	-	-	-	-
Syngnathus leptorhynchus	-	-	-	-	1	2.21
Atherinopsis californiensis	10	21.80	-	-	-	-
Rimicola spp.	-	-	-	-	-	-
Syngnathus spp.	-	-	-	-	-	-
Genyonemus lineatus	5	9.18	10	20.28	-	-
Serphus politus	-	-	-	-	-	-
Paraclinus integripinnis	-	-	-	-	-	-
Paralichthys californicus	1	1.82	3	7.12	1	2.13
Sardinops sagax	1	1.86	8	18.35	-	-
Gillichthys mirabilis	2	3.89	1	1.88	-	-
Sciaenidae unid.	2	3.67	-	-	2	3.75
Hypsopsetta guttulata	-	-	-	-	-	-
larval/post-larval fish unid.	-	-	-	-	-	-
Citharichthys stigmaeus	-	-	2	4.37	-	-
Paralabrax spp.	-	-	-	-	-	-
Atherinopsidae unid.	-	-	2	3.89	1	2.21
Citharichthys sordidus	-	-	2	4.98	-	-
Paralabrax clathratus	-	-	-	-	-	-
Pleuronectiformes unid.	-	-	1	2.49	-	-
Heterostichus rostratus	-	-	-	-	-	-
Clinocottus analis	-	-	-	-	-	-
Stenobranchius leucopsarus	-	-	-	-	-	-
Atherinops affinis	-	-	-	-	1	2.21
Cheliotrema satrumum	-	-	-	-	-	-
Scomber japonicus	-	-	-	-	-	-
Quietula y-cauda	-	-	-	-	-	-
Ophidiidae unid.	-	-	-	-	-	-
Gobiesox spp.	-	-	-	-	-	-
Diaphus theta	-	-	1	2.49	-	-
Semicossyphus pulcher	-	-	1	2.49	-	-
Menticirrhus undulatus	-	-	-	-	-	-
Haemulidae unid.	-	-	-	-	-	-
Labridae unid.	-	-	-	-	-	-
Myctophidae unid.	-	-	1	2.14	-	-
Symbolophorus californiensis	-	-	1	2.14	-	-
Oxyjulis californica	-	-	-	-	1	1.78
Citharichthys spp.	1	1.72	-	-	-	-
Invertebrates						
Cancer anthonyi (megalops)	-	-	-	-	-	-
	1,717		1,772		2,990	

Appendix A: Results by Survey

Table A2. Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations L1-L4 in Agua Hedionda Lagoon.

Survey Number:				1	2		
Survey Date:				06/10/04	06/24/04		
Sample Count:				16	16		
Taxon	Common Name	Total Count	Mean Conc.	Count	Conc.	Count	Conc.
Fishes							
1	Gobiidae unid.	30,229	2,714.74	7,936	9,400.29	4,466	5,925.43
2	Hypsoblennius spp.	4,725	467.32	614	901.83	398	547.24
3	Engraulidae unid.	652	57.90	54	72.86	141	182.94
4	Engraulis mordax	558	45.51	2	2.79	1	1.33
5	Acanthogobius flavimanus	499	38.98	-	-	-	-
6	Labrisomidae unid.	366	35.30	166	220.73	71	93.10
7	Hypsypops rubicundus	352	35.12	94	134.38	53	76.48
8	Atherinopsis californiensis	279	23.93	-	-	-	-
9	Gibbonsia spp.	182	16.74	8	11.54	4	5.44
10	larval fish fragment	174	15.02	17	19.27	21	30.99
11	Typhlogobius californiensis	118	9.63	2	2.79	-	-
12	Roncador steamsi	74	6.82	1	1.29	-	-
13	Sciaenidae unid.	73	6.56	23	29.17	-	-
14	Gillichthys mirabilis	62	5.17	-	-	-	-
15	Genyonemus lineatus	54	4.25	2	2.14	-	-
16	Rimicola eigenmanni	53	4.13	-	-	-	-
17	Atherinopsidae unid.	41	3.40	3	3.43	-	-
18	Rimicola spp.	34	3.28	-	-	2	2.98
19	Syngnathus leptorhynchus	33	3.19	12	15.60	9	11.57
20	larvae, unidentified yolk sac	32	3.12	5	8.47	-	-
21	Paraclinus integripinnis	31	2.88	-	-	-	-
22	Seriphus politus	26	2.40	1	1.64	5	5.51
23	Atherinops affinis	28	2.40	5	7.00	4	5.54
24	Quietula y-cauda	26	2.38	5	5.45	5	6.68
25	Syngnathus spp.	19	2.01	-	-	2	2.99
26	Paralichthys californicus	22	1.93	2	2.63	-	-
27	larval/post-larval fish unid.	16	1.36	-	-	-	-
28	Ilypnus gilberti	14	1.35	-	-	-	-
29	Oxyjulis californica	8	0.75	2	2.36	-	-
30	Sardinops sagax	9	0.74	-	-	-	-
31	Citharichthys stigmatosus	9	0.73	-	-	-	-
32	Paralabrax spp.	8	0.68	-	-	-	-
33	Hypsopsetta guttulata	7	0.55	-	-	-	-
34	Leptocottus armatus	6	0.51	-	-	-	-
35	Gobiesox spp.	5	0.49	-	-	2	3.29
36	Menticirrhus undulatus	5	0.47	-	-	-	-
37	Cheilodroma satumum	4	0.36	-	-	-	-
38	Blennioides unid.	4	0.36	1	1.11	1	1.40
39	Citharichthys sordidus	5	0.34	-	-	-	-
40	Clinocottus analis	4	0.31	-	-	-	-
41	Xenistius californiensis	3	0.30	-	-	-	-
42	Xystreus lilepis	2	0.21	-	-	-	-
43	Pleuronichthys ritteri	2	0.17	-	-	-	-
44	Haemulidae unid.	2	0.17	-	-	-	-
45	Sphyræna argentea	2	0.17	-	-	-	-
46	Triphoturus mexicanus	2	0.16	-	-	-	-
47	Gobiesocidae unid.	2	0.15	-	-	-	-
48	Clevelandia ios	1	0.11	-	-	-	-
49	Syngnathidae unid.	1	0.11	-	-	-	-
50	Ophidiidae unid.	1	0.09	-	-	-	-
51	Umbina roncador	1	0.09	-	-	-	-
52	Lepidogobius lepidus	1	0.09	-	-	-	-
53	Pleuronichthys spp.	1	0.08	-	-	-	-
54	Atractoscion nobilis	1	0.08	-	-	-	-
55	Pleuronectiformes unid.	1	0.07	-	-	-	-
56	Clinocottus spp.	1	0.07	-	-	-	-
57	Citharichthys spp.	1	0.06	-	-	-	-
58	Semicossyphus pulcher	1	0.06	1	0.78	-	-
Invertebrates							
	Panulirus interruptus (larvae)	2	0.21	-	-	-	-
	Cancer antennarius (megalops)	1	0.09	-	-	-	-
	Cancer anthonyi (megalops)	1	0.08	-	-	-	-
Totals:		38,876		8,958		5,186	

Appendix A: Results by Survey

Table A2 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations L1-L4 in Agua Hedionda Lagoon.

Survey Number:		3	4		5		6	
Survey Date:		07/06/04	08/13/04		09/23/04		10/21/04	
Sample Count:		16	16		20		16	
Taxon	Conc.	Count	Count	Conc.	Count	Conc.	Count	Conc.
Fishes								
Gobiidae unid.	3,034.53	30,229	1,498	1,925.13	1,115	1,272.53	550	690.51
Hypsoblennius spp.	1,053.95	4,725	1,004	1,421.30	360	398.18	245	290.58
Engraulidae unid.	57.39	652	-	-	-	-	-	-
Engraulis mordax	12.07	558	-	-	-	-	4	5.58
Acanthogobius flavimanus	-	499	-	-	-	-	-	-
Labrisomidae unid.	44.54	366	23	29.27	68	70.20	-	-
Hypsypops rubicundus	122.15	352	1	1.38	-	-	-	-
Atherinopsis californiensis	1.15	279	-	-	-	-	-	-
Gibbonsia spp.	4.46	182	1	1.38	3	3.04	12	19.17
larval fish fragment	4.41	174	9	10.98	3	3.48	8	9.95
Typhlogobius californiensis	11.38	118	-	-	-	-	-	-
Roncador steamsi	34.73	74	-	-	48	51.42	-	-
Sciaenidae unid.	10.27	73	4	4.85	17	17.20	-	-
Gillichthys mirabilis	-	62	-	-	-	-	-	-
Genyonemus lineatus	-	54	4	4.85	6	6.58	1	1.81
Rimicola eigenmanni	-	53	-	-	53	53.73	-	-
Atherinopsidae unid.	1.15	41	-	-	-	-	3	3.66
Rimicola spp.	6.03	34	-	-	9	9.96	10	13.61
Syngnathus leptorhynchus	7.04	33	-	-	5	4.97	1	1.33
larvae, unidentified yolk sac	12.08	32	6	7.87	2	2.11	-	-
Paraclinus integripinnis	-	31	31	37.45	-	-	-	-
Seniopus politus	6.58	26	1	1.26	8	8.51	6	7.72
Atherinops affinis	1.15	28	-	-	-	-	-	-
Quietula y-cauda	2.29	26	4	5.80	1	1.01	-	-
Syngnathus spp.	-	19	15	20.83	-	-	1	1.09
Paralichthys californicus	1.63	22	1	1.21	7	7.51	2	3.18
larval/post-larval fish unid.	-	16	2	2.42	3	3.03	-	-
Ilypnus gilberti	-	14	3	4.46	-	-	-	-
Oxyjulis californica	-	8	5	6.24	-	-	-	-
Sardinops sagax	-	9	-	-	-	-	-	-
Citharichthys stigmæus	1.36	9	1	1.20	2	2.12	-	-
Paralabrax spp.	-	8	3	3.63	5	5.24	-	-
Hypsopsetta guttulata	-	7	-	-	2	2.20	-	-
Leptocottus armatus	-	6	-	-	-	-	-	-
Gobiesox spp.	-	5	-	-	-	-	-	-
Menticirrhus undulatus	1.63	5	1	1.21	3	3.33	-	-
Chelotrema saturnum	1.32	4	1	1.21	2	2.19	-	-
Blennioides unid.	-	4	-	-	-	-	-	-
Citharichthys sordidus	-	5	-	-	-	-	-	-
Clinocottus analis	-	4	-	-	-	-	-	-
Xenistius californiensis	-	3	-	-	2	2.03	1	1.81
Xystreus liolepis	2.77	2	-	-	-	-	-	-
Pleuronichthys ritteri	-	2	-	-	2	2.20	-	-
Haemulidae unid.	-	2	1	1.21	1	0.96	-	-
Sphyræna argentea	-	2	1	1.17	1	0.99	-	-
Triphoturus mexicanus	-	2	-	-	1	1.10	-	-
Gobiesocidae unid.	-	2	-	-	-	-	2	2.01
Clevelandia ios	-	1	1	1.45	-	-	-	-
Syngnathidae unid.	-	1	-	-	-	-	1	1.38
Ophidiidae unid.	-	1	1	1.21	-	-	-	-
Umbrina roncador	-	1	-	-	1	1.21	-	-
Lepidogobius lepidus	-	1	-	-	-	-	-	-
Pleuronichthys spp.	-	1	-	-	1	1.10	-	-
Atractoscion nobilis	-	1	-	-	-	-	-	-
Pleuronectiformes unid.	-	1	-	-	-	-	-	-
Clinocottus spp.	-	1	-	-	-	-	-	-
Citharichthys spp.	-	1	-	-	-	-	-	-
Semicossyphus pulcher	-	1	-	-	-	-	-	-
Invertebrates								
Panulirus interruptus	2.73	2	-	-	-	-	-	-
Cancer antennarius (megalops)	-	1	-	-	-	-	-	-
Cancer anthonyi (megalops)	-	1	-	-	1	1.01	-	-
		38,876	2,622		1,732		847	

Appendix A: Results by Survey

Table A2 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations L1-L4 in Agua Hedionda Lagoon.

Taxon	Survey Number: 7		8		9		10	
	Survey Date: 11/18/04		12/16/04		01/13/05		02/24/05	
	Sample Count: 16		16		16		16	
	Count	Conc.	Count	Conc.	Count	Conc.	Count	Conc.
Fishes								
Gobiidae unid.	706	734.73	1,032	1,201.76	368	402.81	1,873	1,867.75
Hypsoblennius spp.	59	61.74	4	5.26	3	3.22	2	2.05
Engraulidae unid.	2	2.12	-	-	2	2.42	-	-
Engraulis mordax	30	28.07	2	2.43	-	-	21	21.19
Acanthogobius flavimanus	-	-	-	-	140	152.20	300	298.81
Labrisomidae unid.	-	-	-	-	-	-	-	-
Hypsypops rubicundus	-	-	-	-	-	-	-	-
Atherinopsis californiensis	5	5.80	16	18.84	52	61.60	167	185.66
Gibbonsia spp.	13	13.30	56	65.83	43	52.02	21	20.79
larval fish fragment	11	11.11	11	12.69	-	-	49	48.54
Typhlogobius californiensis	-	-	2	2.23	-	-	8	8.22
Roncador stearnsi	-	-	-	-	-	-	-	-
Sciaenidae unid.	-	-	-	-	3	3.65	-	-
Gillichthys mirabilis	4	4.25	21	24.94	14	14.54	15	15.16
Genyonemus lineatus	1	0.95	-	-	2	2.27	23	21.56
Rimicola eigenmanni	-	-	-	-	-	-	-	-
Atherinopsidae unid.	4	4.47	-	-	-	-	12	11.64
Rimicola spp.	1	1.14	5	5.82	-	-	-	-
Syngnathus leptorhynchus	-	-	-	-	-	-	1	0.94
larvae, unidentified yolk sac	-	-	1	1.31	-	-	-	-
Paraclinus integrifinnis	-	-	-	-	-	-	-	-
Serphus politus	-	-	-	-	-	-	-	-
Atherinops affinis	-	-	-	-	-	-	12	12.21
Quietula y-cauda	2	2.24	4	4.22	-	-	3	3.18
Syngnathus spp.	1	1.28	-	-	-	-	-	-
Paraichthys californicus	2	1.67	-	-	2	2.31	2	1.80
larval/post-larval fish unid.	-	-	-	-	10	11.33	1	0.89
Ilypnus gilberti	1	0.86	5	5.99	5	6.28	-	-
Oxyjulis californica	1	1.12	-	-	-	-	-	-
Sardinops sagax	-	-	-	-	1	1.23	4	4.40
Citharichthys stigmæus	1	0.81	-	-	-	-	-	-
Paralabrax spp.	-	-	-	-	-	-	-	-
Hypsopsetta guttulata	2	1.68	-	-	1	1.34	1	1.01
Leptocottus armatus	-	-	-	-	5	6.63	-	-
Gobiesox spp.	-	-	-	-	-	-	3	3.04
Menticirhus undulatus	-	-	-	-	-	-	-	-
Cheilotrema satunum	-	-	-	-	-	-	-	-
Blennioides unid.	-	-	1	1.24	-	-	1	0.94
Citharichthys sordidus	4	3.66	-	-	-	-	1	0.77
Clinocottus analis	-	-	2	2.27	-	-	2	1.74
Xenistius californiensis	-	-	-	-	-	-	-	-
Xystreurus liolepis	-	-	-	-	-	-	-	-
Pleuronichthys ritleri	-	-	-	-	-	-	-	-
Haemulidae unid.	-	-	-	-	-	-	-	-
Sphyræna argentea	-	-	-	-	-	-	-	-
Tripholurus mexicanus	1	0.95	-	-	-	-	-	-
Gobiesocidae unid.	-	-	-	-	-	-	-	-
Clevelandia ios	-	-	-	-	-	-	-	-
Syngnathidae unid.	-	-	-	-	-	-	-	-
Ophidiidae unid.	-	-	-	-	-	-	-	-
Umbrina roncadore	-	-	-	-	-	-	-	-
Lepidogobius lepidus	-	-	-	-	1	1.18	-	-
Pleuronichthys spp.	-	-	-	-	-	-	-	-
Atractoscion nobilis	-	-	-	-	-	-	-	-
Pleuronectiformes unid.	-	-	-	-	-	-	-	-
Clinocottus spp.	-	-	1	0.93	-	-	-	-
Citharichthys spp.	1	0.81	-	-	-	-	-	-
Semicossyphus pulcher	-	-	-	-	-	-	-	-
Invertebrates								
Panulirus interruptus	-	-	-	-	-	-	-	-
Cancer antennarius (megalops)	-	-	1	1.22	-	-	-	-
Cancer anthonyi (megalops)	-	-	-	-	-	-	-	-
	852		1,164		653		2,522	

Appendix A: Results by Survey

Table A2 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations L1-L4 in Agua Hedionda Lagoon.

Survey Number:		11	12	13		
Survey Date:		03/23/05	04/21/05	05/19/05		
Sample Count:		16	16	16		
Taxon	Count	Conc.	Count	Conc.	Count	Conc.
Fishes						
Gobiidae unid.	1,923	1,908.93	2,314	2,455.55	3,980	4,471.69
Hypsoblennius spp.	81	80.32	175	181.27	1,013	1,128.18
Engraulidae unid.	57	55.27	22	22.80	331	356.88
Engraulis mordax	104	98.45	151	155.03	235	264.72
Acanthogobius flavimanus	54	50.65	3	2.95	2	2.12
Labrisomidae unid.	-	-	-	-	1	1.06
Hypsypops rubicundus	-	-	62	63.71	48	58.49
Atherinopsis californiensis	38	37.99	-	-	-	-
Gibbonsia spp.	4	4.30	4	4.07	10	12.22
larval fish fragment	16	15.83	14	14.73	12	13.31
Typhlogobius californiensis	85	84.34	10	10.82	4	5.36
Roncador steamsi	-	-	1	1.18	-	-
Sciaenidae unid.	7	6.96	6	5.27	6	6.88
Gillichthys mirabilis	5	5.20	3	3.16	-	-
Genyonemus lineatus	2	1.95	12	12.02	1	1.12
Rimicola eigenmanni	-	-	-	-	-	-
Atherinopsidae unid.	6	7.09	7	7.50	5	5.29
Rimicola spp.	-	-	-	-	3	3.09
Syngnathus leptorhynchus	-	-	-	-	-	-
larvae, unidentified yolk sac	5	4.69	-	-	4	4.10
Paraclinus integripinnis	-	-	-	-	-	-
Seriophus politus	-	-	-	-	-	-
Atherinops affinis	1	0.81	2	2.23	2	2.27
Quietula y-cauda	-	-	-	-	-	-
Syngnathus spp.	-	-	-	-	-	-
Paralichthys californicus	2	1.92	1	1.18	-	-
larval/post-larval fish unid.	-	-	-	-	-	-
Ilypnus gilberti	-	-	-	-	-	-
Oxyjulis californica	-	-	-	-	-	-
Sardinops sagax	-	-	4	3.93	-	-
Citharichthys stigmaeus	1	1.05	3	2.97	-	-
Paralabrax spp.	-	-	-	-	-	-
Hypsopsetta guttulata	1	0.89	-	-	-	-
Leptocottus armatus	-	-	-	-	-	-
Gobiesox spp.	-	-	-	-	-	-
Menticirrhus undulatus	-	-	-	-	-	-
Cheilotrema saturnum	-	-	-	-	-	-
Blennioidei unid.	-	-	-	-	-	-
Citharichthys sordidus	-	-	-	-	-	-
Clinocottus analis	-	-	-	-	-	-
Xenistius californiensis	-	-	-	-	-	-
Xystreurys liolepis	-	-	-	-	-	-
Pleuronichthys ritteri	-	-	-	-	-	-
Haemulidae unid.	-	-	-	-	-	-
Sphyraena argentea	-	-	-	-	-	-
Triphoturus mexicanus	-	-	-	-	-	-
Gobiesocidae unid.	-	-	-	-	-	-
Clevelandia ios	-	-	-	-	-	-
Syngnathidae unid.	-	-	-	-	-	-
Ophidiidae unid.	-	-	-	-	-	-
Umbrina roncador	-	-	-	-	-	-
Lepidogobius lepidus	-	-	-	-	-	-
Pleuronichthys spp.	-	-	-	-	-	-
Atractoscion nobilis	-	-	1	0.99	-	-
Pleuronectiformes unid.	-	-	1	0.93	-	-
Clinocottus spp.	-	-	-	-	-	-
Citharichthys spp.	-	-	-	-	-	-
Semicossyphus pulcher	-	-	-	-	-	-
Invertebrates						
Parulirus interruptus	-	-	-	-	-	-
Cancer antennarius (megalops)	-	-	-	-	-	-
Cancer anthonyi (megalops)	-	-	-	-	-	-
	2,392		2,796		5,657	

Appendix A: Results by Survey

Table A3. Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations N1-N5 in nearshore area.

		Survey Number:		1		2	
		Survey Date:		06/10/04		06/24/04	
		Sample Count:		20		19	
Taxon	Common Name	Total Count	Mean Conc.	Count	Conc.	Count	Conc.
Fishes							
1	<i>Engraulis mordax</i>	6,318	423.31	285	211.27	27	24.69
2	<i>Hypsoblennius</i> spp.	1,959	137.11	936	747.96	325	335.32
3	Engraulidae unid.	1,313	102.17	80	54.22	2	1.74
4	Gobiidae unid.	920	69.06	150	118.83	22	22.51
5	<i>Genyonemus lineatus</i>	921	64.66	-	-	3	2.82
6	larvae, unidentified yolk sac	678	45.82	86	68.17	45	40.04
7	<i>Paralichthys californicus</i>	601	42.91	39	28.28	45	40.90
8	<i>Seriophus politus</i>	365	23.79	81	59.98	126	109.01
9	Sciaenidae unid.	306	22.55	52	36.56	17	15.94
10	<i>Roncador stearnsi</i>	286	20.17	105	84.11	66	63.55
11	<i>Citharichthys stigmæus</i>	309	20.01	7	5.17	11	10.03
12	<i>Gibbonsia</i> spp.	277	19.29	36	29.62	5	6.93
13	Labrisomidae unid.	219	16.36	87	73.38	47	48.08
14	<i>Paralabrax clathratus</i>	213	14.12	29	20.88	43	36.99
15	<i>Sardinops sagax</i>	202	13.21	3	1.99	-	-
16	<i>Paralabrax</i> spp.	159	10.76	12	9.46	8	7.03
17	larval fish fragment	145	10.50	13	9.98	11	9.51
18	Haemulidae unid.	116	8.80	10	6.71	4	3.34
19	<i>Scomber japonicus</i>	110	7.07	32	25.62	9	7.39
20	<i>Hypsypops rubicundus</i>	110	7.03	84	66.63	6	5.73
21	larval/post-larval fish unid.	93	6.81	8	5.67	5	4.57
22	<i>Oxyjulis californica</i>	79	5.55	12	8.05	2	1.98
23	<i>Paralabrax nebulifer</i>	82	5.08	-	-	2	1.67
24	<i>Sphyræna argentea</i>	59	3.74	8	6.51	8	6.60
25	<i>Xenistius californiensis</i>	55	3.61	-	-	31	25.82
26	<i>Lepidogobius lepidus</i>	56	3.59	-	-	-	-
27	<i>Stenobranchius leucopsarus</i>	51	3.26	-	-	-	-
28	<i>Pleuronichthys verticalis</i>	43	2.79	-	-	3	2.56
29	<i>Atherinopsis californiensis</i>	35	2.78	-	-	-	-
30	<i>Umbra roncador</i>	39	2.62	1	0.71	24	21.89
31	<i>Pleuronichthys ritteri</i>	34	2.51	-	-	-	-
32	<i>Xystreurys liolepis</i>	27	1.97	-	-	-	-
33	<i>Hypsopsetta guttulata</i>	30	1.97	-	-	-	-
34	<i>Rimicola</i> spp.	22	1.79	-	-	-	-
35	<i>Peprilus similimus</i>	28	1.78	-	-	15	12.77
36	<i>Chellotrema saturnum</i>	24	1.71	6	4.76	4	3.79
37	<i>Semicossyphus pulcher</i>	21	1.49	6	4.23	-	-
38	<i>Ophidion scrippsae</i>	22	1.48	-	-	-	-
39	<i>Diaphus theta</i>	24	1.46	1	0.76	1	0.83
40	<i>Acanthogobius flavimanus</i>	22	1.46	-	-	-	-
41	<i>Pleuronichthys</i> spp.	19	1.30	-	-	1	0.83
42	Pleuronectiformes unid.	21	1.25	-	-	-	-
43	<i>Menticirchus undulatus</i>	16	1.21	4	3.04	4	4.05
44	<i>Atractoscion nobilis</i>	18	1.18	2	1.48	9	8.43
45	Ophidiidae unid.	15	1.14	-	-	-	-
46	<i>Sebastes</i> spp.	18	1.09	-	-	-	-
47	<i>Girella nigricans</i>	16	1.06	2	1.36	1	0.80
48	<i>Typhlogobius californiensis</i>	15	0.99	4	3.24	1	0.81
49	<i>Citharichthys sordidus</i>	16	0.99	-	-	1	0.83
50	Pleuronectidae unid.	16	0.98	-	-	-	-
51	<i>Trachurus symmetricus</i>	17	0.96	13	9.40	-	-
52	<i>Halichoeres semicinctus</i>	15	0.95	-	-	-	-
53	<i>Syngnathus</i> spp.	10	0.84	-	-	1	0.81
54	Labridae	11	0.83	-	-	-	-

Appendix A: Results by Survey

Table A3 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations N1-N5 in nearshore area.

Survey Number:				1	2		
Survey Date:				06/10/04	06/24/04		
Sample Count:				20	19		
Taxon	Common Name	Total Count	Mean Conc.	Count	Conc.	Count	Conc.
<u>Fishes</u>							
55	<i>Paraclinus integripinnis</i>	reef finspot	14	0.81	7	4.25	-
56	<i>Symphurus atricauda</i>	California tonguefish	11	0.77	-	-	-
57	<i>Triphoturus mexicanus</i>	Mexican lampfish	12	0.73	-	-	1 0.83
58	<i>Citharichthys</i> spp.	sanddabs	9	0.70	-	-	1 0.83
59	<i>Nannobranchium</i> spp.	lanternfishes	9	0.57	-	-	-
60	<i>Medialuna californiensis</i>	halfmoon	7	0.53	2	1.69	-
61	<i>Gillichthys mirabilis</i>	longjaw mudsucker	8	0.51	-	-	-
62	<i>Chilara taylori</i>	spotted cusk-eel	7	0.50	-	-	-
63	<i>Heterostichus rostratus</i>	giant kelpfish	7	0.50	1	1.00	1 1.39
64	<i>Hypsoblennius jenkinsi</i>	mussel blenny	7	0.46	-	-	-
65	Paralichthyidae unid.	lefteye flounders & sandd	7	0.44	-	-	-
66	Atherinopsidae	silverside	4	0.31	-	-	-
67	<i>Parophrys vetulus</i>	English sole	5	0.30	-	-	-
68	Myctophidae unid.	lanternfishes	4	0.30	-	-	-
69	<i>Hippoglossina stomata</i>	bigmouth sole	5	0.29	-	-	-
70	<i>Zaniolepis frenata</i>	shortspine combfish	5	0.25	-	-	-
71	<i>Ruscarius creaseri</i>	roucheek sculpin	3	0.22	-	-	-
72	Clupeiformes	herrings and anchovies	3	0.21	2	1.92	-
73	<i>Syngnathus leptorhynchus</i>	bay pipefish	3	0.18	3	2.37	-
74	Clupeidae unid.	herrings	3	0.18	-	-	-
75	<i>Lyopsetta exilis</i>	slender sole	3	0.16	-	-	-
76	Pomacentridae	damselfishes	2	0.14	-	-	-
77	<i>Rhinogobiops nicholsi</i>	blackeye goby	2	0.14	-	-	-
78	<i>Nannobranchium ritteri</i>	broadfin lampfish	2	0.13	-	-	-
79	<i>Cyclothone</i> spp.	bristlemouths	2	0.13	-	-	-
80	<i>Chromis punctipinnis</i>	blacksmith	2	0.13	-	-	-
81	<i>Icelinus</i> spp.	sculpins	3	0.13	-	-	-
82	Gobiesocidae unid.	clingfishes	2	0.12	1	0.88	-
83	<i>Anisotremus davidsonii</i>	sargo	2	0.12	-	-	-
84	<i>Sebastes jordani</i>	shortbelly rockfish	2	0.10	-	-	-
85	Blennioidei	blennies	1	0.08	-	-	-
86	Clinidae unid.	clinid kelpfishes	1	0.08	1	1.00	-
87	Chaenopsidae unid.	tube blennies	1	0.07	-	-	-
88	<i>Leptocottus armatus</i>	Pacific staghorn sculpin	1	0.07	-	-	-
89	Cynoglossidae	tongue soles	1	0.07	-	-	-
90	Kyphosidae	sea chubs	1	0.07	-	-	-
91	<i>Cyclothone acclinidens</i>	bent tooth bristlemouth	1	0.07	-	-	-
92	<i>Ilypnus gilberti</i>	cheekspot goby	1	0.06	-	-	-
93	<i>Gobiesox</i> spp.	clingfishes	1	0.06	-	-	-
94	Hexagrammidae unid.	greenlings	1	0.06	-	-	-
95	<i>Bathylagus ochotensis</i>	popeye blacksmelt	1	0.06	-	-	-
96	<i>Hypsoblennius gentilis</i>	bay blenny	1	0.05	1	0.64	-
<u>Invertebrates</u>							
	<i>Panulirus interruptus</i> (larvae)	California spiny lobster	98	7.04	1	0.82	71 64.80
	<i>Cancer anthonyi</i> (megalops)	yellow crab	80	4.74	-	-	2 2.38
	<i>Cancer antennarius</i> (megalops)	brown rock crab	71	4.11	-	-	3 3.15
	<i>Cancer gracilis</i> (megalops)	slender crab	48	2.93	2	1.35	-
	<i>Cancer</i> spp. (megalops)	cancer crabs	4	0.23	-	-	-
	<i>Cancer productus</i> (megalops)	red rock crab	3	0.22	-	-	-
Totals:		17,067		40,384		39,197	

Table A3 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations NI-N5 in nearshore area.

Taxon	3		4		5		6	
	07/06/04		08/13/04		09/23/04		10/21/04	
	20		20		20		20	
Taxon	Count	Conc.	Count	Conc.	Count	Conc.	Count	Conc.
Fishes								
<i>Engraulis mordax</i>	214	168.35	73	62.19	204	167.31	94	81.59
<i>Hypsoblennius</i> spp.	183	181.20	234	255.74	64	66.94	1	0.90
<i>Engraulidae</i> unid.	24	19.48	-	-	3	2.95	8	9.23
<i>Gobiidae</i> unid.	86	82.38	154	190.83	48	52.35	44	48.00
<i>Genyonemus lineatus</i>	13	10.58	12	14.77	300	280.83	33	25.28
larvae, unidentified yolk sac	347	291.29	72	75.56	60	58.18	16	15.29
<i>Paralichthys californicus</i>	194	173.39	37	38.97	170	171.01	32	30.06
<i>Serphus politus</i>	50	42.17	8	6.62	97	88.33	2	1.94
<i>Sciaenidae</i> unid.	102	99.70	25	28.73	39	38.37	6	4.90
<i>Roncador steamsi</i>	52	47.53	10	10.18	53	56.79	-	-
<i>Citharichthys stigmaeus</i>	16	14.03	5	4.29	158	124.03	93	85.55
<i>Glbbonia</i> spp.	4	4.35	3	3.96	2	2.46	11	11.57
<i>Labrisomidae</i> unid.	46	46.77	22	27.32	15	15.46	1	0.90
<i>Paralabrax clathratus</i>	34	27.63	2	1.75	105	96.31	-	-
<i>Sardinops sagax</i>	9	8.07	5	4.93	25	22.04	3	2.47
<i>Paralabrax</i> spp.	50	40.52	31	29.86	55	50.38	2	1.92
larval fish fragment	41	35.90	16	19.10	29	30.59	6	5.77
<i>Haemulidae</i> unid.	5	4.12	4	2.79	91	95.77	2	1.68
<i>Scomber japonicus</i>	39	30.95	-	-	29	27.04	1	0.89
<i>Hypsopops rubicundus</i>	13	11.43	1	1.32	-	-	-	-
larval/post-larval fish unid.	39	34.86	14	17.27	16	16.26	6	5.81
<i>Oxyjulis californica</i>	17	15.21	16	16.22	17	17.58	9	7.70
<i>Paralabrax nebulifer</i>	-	-	-	-	80	64.38	-	-
<i>Sphyræna argentea</i>	27	20.12	9	8.12	7	7.31	-	-
<i>Xenistius californiensis</i>	-	-	2	1.90	22	19.24	-	-
<i>Lepidogobius lepidus</i>	-	-	1	1.18	3	2.32	-	-
<i>Stenobranchius leucopsarus</i>	-	-	-	-	-	-	-	-
<i>Pleuronichthys verticalis</i>	10	7.29	3	3.18	18	15.33	2	1.69
<i>Atherinopsis californiensis</i>	-	-	-	-	-	-	-	-
<i>Umbrina roncador</i>	14	11.41	-	-	-	-	-	-
<i>Pleuronichthys ritteri</i>	4	3.41	5	5.87	15	14.28	6	5.25
<i>Xystreus liolepis</i>	12	11.12	1	1.14	9	9.07	3	2.82
<i>Hypsopsetta guttulata</i>	-	-	2	1.93	8	7.31	6	4.26
<i>Rimicola</i> spp.	2	1.96	-	-	12	13.28	3	3.20
<i>Pepinus similimus</i>	6	4.66	-	-	4	3.42	-	-
<i>Cheilotrema saturem</i>	10	9.25	1	0.80	3	3.60	-	-
<i>Semicossyphus pulcher</i>	1	1.05	3	2.95	8	8.18	2	2.27
<i>Ophidion scrippsae</i>	-	-	6	6.04	11	8.98	4	3.21
<i>Diaphus theta</i>	1	0.81	-	-	3	2.41	1	0.89
<i>Acanthogobius flavimanus</i>	-	-	-	-	-	-	-	-
<i>Pleuronichthys</i> spp.	1	0.52	1	1.14	11	9.76	3	3.18
<i>Pleuronectiformes</i> unid.	-	-	-	-	1	0.78	5	3.67
<i>Menticirrhus undulatus</i>	-	-	2	2.14	6	6.54	-	-
<i>Atractoscion nobilis</i>	5	3.58	-	-	-	-	-	-
<i>Ophidiidae</i> unid.	-	-	1	0.93	5	5.38	8	7.74
<i>Sebastes</i> spp.	-	-	1	1.14	2	1.85	-	-
<i>Girella nigricans</i>	-	-	-	-	3	2.62	6	5.49
<i>Typhlogobius californiensis</i>	-	-	1	0.60	-	-	-	-
<i>Citharichthys sordidus</i>	-	-	-	-	2	1.53	2	1.89
<i>Pleuronectidae</i> unid.	-	-	-	-	1	0.76	-	-
<i>Trachurus symmetricus</i>	-	-	-	-	-	-	2	1.76
<i>Halichoeres semicinctus</i>	1	0.81	-	-	10	8.07	4	3.52
<i>Syngnathus</i> spp.	-	-	6	7.95	1	0.78	-	-
<i>Labridae</i>	7	6.83	1	1.34	-	-	1	0.68

Appendix A: Results by Survey

Table A3 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations N1-N5 in nearshore area.

	3		4		5		6	
	07/06/04		08/13/04		09/23/04		10/21/04	
	20		20		20		20	
Taxon	Count	Conc.	Count	Conc.	Count	Conc.	Count	Conc.
Fishes								
<i>Paraclinus integripinnis</i>	-	-	7	6.28	-	-	-	-
<i>Symphurus atricauda</i>	-	-	-	-	10	8.81	1	1.23
<i>Triphoturus mexicanus</i>	-	-	1	0.60	6	5.23	2	1.30
<i>Citharichthys</i> spp.	-	-	1	1.14	-	-	3	3.36
<i>Nannobranchium</i> spp.	-	-	-	-	-	-	-	-
<i>Medialuna californiensis</i>	-	-	4	4.48	-	-	1	0.68
<i>Gillichthys mirabilis</i>	-	-	-	-	-	-	-	-
<i>Chilara taylori</i>	-	-	-	-	-	-	6	5.72
<i>Heterostichus rostratus</i>	-	-	-	-	-	-	-	-
<i>Hypsoblennius jenkinsi</i>	-	-	1	0.70	5	4.55	1	0.68
Paralichthyidae unid.	2	1.04	-	-	1	1.11	-	-
Atherinopsidae	-	-	-	-	-	-	-	-
<i>Parophrys vetulus</i>	-	-	-	-	-	-	-	-
Myctophidae unid.	1	1.21	-	-	1	0.75	-	-
<i>Hippoglossina stomata</i>	-	-	1	0.78	2	1.52	-	-
<i>Zaniolepis frenata</i>	-	-	-	-	-	-	-	-
<i>Ruscarius creaseri</i>	-	-	-	-	-	-	-	-
Clupeiformes	-	-	-	-	-	-	-	-
<i>Syngnathus leptorhynchus</i>	-	-	-	-	-	-	-	-
Clupeidae unid.	1	0.71	-	-	-	-	1	0.89
<i>Lyopsetta exilis</i>	-	-	-	-	-	-	-	-
Pomacentridae	-	-	1	0.97	-	-	1	0.90
<i>Rhinogobiops nicholsi</i>	-	-	-	-	1	1.01	-	-
<i>Nannobranchium ritteri</i>	-	-	-	-	-	-	-	-
<i>Cyclothone</i> spp.	-	-	-	-	1	0.77	-	-
<i>Chromis punctipinnis</i>	-	-	-	-	-	-	1	0.83
<i>Icelinus</i> spp.	-	-	-	-	-	-	-	-
Gobiesocidae unid.	-	-	-	-	-	-	-	-
<i>Anisotremus davidsonii</i>	1	0.67	-	-	1	0.90	-	-
<i>Sebastes jordani</i>	-	-	-	-	-	-	-	-
Blennioidei	1	1.05	-	-	-	-	-	-
Clinidae unid.	-	-	-	-	-	-	-	-
Chaenopsidae unid.	-	-	-	-	-	-	-	-
<i>Leptocottus armatus</i>	-	-	-	-	-	-	-	-
Cynoglossidae	-	-	-	-	-	-	1	0.89
Kyphosidae	-	-	-	-	-	-	1	0.89
<i>Cyclothone acclinidens</i>	-	-	-	-	-	-	-	-
<i>Hypnus gilberti</i>	-	-	-	-	-	-	-	-
<i>Gobiesox</i> spp.	-	-	-	-	-	-	-	-
Hexagrammidae unid.	-	-	-	-	1	0.75	-	-
<i>Bathylagus ochotensis</i>	-	-	-	-	-	-	-	-
<i>Hypsoblennius gentilis</i>	-	-	-	-	-	-	-	-
Invertebrates								
<i>Panulirus interruptus</i>	19	18.79	5	5.56	2	1.49	-	-
<i>Cancer anthonyi</i> (megalops)	29	22.66	17	11.75	16	12.25	1	0.63
<i>Cancer antennarius</i> (megalops)	1	0.67	50	35.14	4	3.35	2	2.08
<i>Cancer gracilis</i> (megalops)	-	-	33	26.49	6	4.92	-	-
<i>Cancer</i> spp. (megalops)	-	-	4	2.93	-	-	-	-
<i>Cancer productus</i> (megalops)	-	-	1	1.32	-	-	-	-
	39,931		39,152		959	40,160	38,757	

Appendix A: Results by Survey

Table A3 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations N1-N5 in nearshore area.

Taxon	7		8		9		10	
	11/18/04		12/16/04		01/13/05		02/24/05	
	20	20	20	20	20	20	20	20
Taxon	Count	Conc.	Count	Conc.	Count	Conc.	Count	Conc.
Fishes								
<i>Engraulis mordax</i>	153	122.98	2	1.47	43	35.34	82	68.40
<i>Hypsoblennius</i> spp.	10	8.40	1	0.76	-	-	-	-
Engraulidae unid.	-	-	-	-	11	10.07	2	1.62
Gobiidae unid.	22	17.02	21	17.62	38	33.74	125	118.27
<i>Genyonemus lineatus</i>	78	63.14	8	6.99	46	38.44	143	124.31
larvae, unidentified yolksac	1	0.76	-	-	8	6.08	11	9.22
<i>Paralichthys californicus</i>	11	8.76	3	2.80	5	4.30	20	17.53
<i>Seriphys politus</i>	-	-	-	-	-	-	-	-
Sciaenidae unid.	1	0.67	-	-	6	5.75	3	3.04
<i>Roncador steamsi</i>	-	-	-	-	-	-	-	-
<i>Citharichthys stigmaeus</i>	12	10.73	2	1.75	-	-	1	0.67
<i>Gibbonsia</i> spp.	6	5.19	40	32.33	61	57.65	52	48.45
Labrisomidae unid.	-	-	-	-	-	-	-	-
<i>Paralabrax clathratus</i>	-	-	-	-	-	-	-	-
<i>Sardinops sagax</i>	5	4.12	-	-	-	-	34	26.67
<i>Paralabrax</i> spp.	-	-	-	-	-	-	-	-
larval fish fragment	7	6.37	1	0.89	2	1.69	4	3.60
Haemulidae unid.	-	-	-	-	-	-	-	-
<i>Scomber japonicus</i>	-	-	-	-	-	-	-	-
<i>Hypsypops rubicundus</i>	-	-	-	-	-	-	-	-
larval/post-larval fish unid.	-	-	-	-	2	1.90	-	-
<i>Oxyjulis californica</i>	-	-	-	-	1	0.81	-	-
<i>Paralabrax nebulifer</i>	-	-	-	-	-	-	-	-
<i>Sphyræna argentea</i>	-	-	-	-	-	-	-	-
<i>Xenistius californiensis</i>	-	-	-	-	-	-	-	-
<i>Lepidogobius lepidus</i>	13	9.84	4	4.20	20	16.88	4	3.75
<i>Stenobranchius leucopsarus</i>	-	-	-	-	41	34.59	-	-
<i>Pleuronichthys verticalis</i>	1	1.08	-	-	-	-	-	-
<i>Atherinopsis californiensis</i>	-	-	3	2.10	10	9.29	7	6.78
<i>Umbina roncador</i>	-	-	-	-	-	-	-	-
<i>Pleuronichthys ritteri</i>	-	-	-	-	2	1.77	-	-
<i>Xysteuryx liolepis</i>	1	0.77	-	-	-	-	-	-
<i>Hypsopsetta guttulata</i>	2	1.51	1	1.05	8	6.75	2	1.60
<i>Rimicola</i> spp.	-	-	1	1.05	3	2.59	1	1.15
<i>Peprius similimus</i>	-	-	-	-	-	-	-	-
<i>Cheilotrema satumum</i>	-	-	-	-	-	-	-	-
<i>Semicossyphus pulcher</i>	-	-	-	-	-	-	-	-
<i>Ophidion scrippsae</i>	1	0.95	-	-	-	-	-	-
<i>Diaphus theta</i>	-	-	-	-	-	-	-	-
<i>Acanthogobius flavimanus</i>	-	-	-	-	11	8.45	8	8.00
<i>Pleuronichthys</i> spp.	-	-	-	-	-	-	-	-
Pleuronectiformes unid.	10	7.45	-	-	-	-	-	-
<i>Menticirrhus undulatus</i>	-	-	-	-	-	-	-	-
<i>Atractoscion nobilis</i>	-	-	-	-	-	-	-	-
Ophidiidae unid.	1	0.76	-	-	-	-	-	-
<i>Sebastes</i> spp.	7	5.29	6	4.35	-	-	-	-
<i>Girella nigricans</i>	4	3.47	-	-	-	-	-	-
<i>Typhlogobius californiensis</i>	-	-	-	-	-	-	2	1.80
<i>Citharichthys sordidus</i>	9	7.31	-	-	-	-	-	-
Pleuronectidae unid.	1	0.88	-	-	-	-	-	-
<i>Trachurus symmetricus</i>	-	-	-	-	-	-	-	-
<i>Halichoeres semicinctus</i>	-	-	-	-	-	-	-	-
<i>Syngnathus</i> spp.	-	-	1	0.74	1	0.66	-	-
Labridae	-	-	-	-	-	-	-	-

Appendix A: Results by Survey

Table A3 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations N1-N5 in nearshore area.

	7		8		9		10	
	11/18/04		12/16/04		01/13/05		02/24/05	
	20		20		20		20	
Taxon	Count	Conc.	Count	Conc.	Count	Conc.	Count	Conc.
Fishes								
<i>Paracfinus integrispinnis</i>	-	-	-	-	-	-	-	-
<i>Symphurus atricauda</i>	-	-	-	-	-	-	-	-
<i>Triphoturus mexicanus</i>	2	1.54	-	-	-	-	-	-
<i>Citharichthys</i> spp.	-	-	1	0.89	2	1.60	-	-
<i>Nannobranchium</i> spp.	1	0.76	1	0.84	4	3.51	1	0.90
<i>Medialuna californiensis</i>	-	-	-	-	-	-	-	-
<i>Gillichthys mirabilis</i>	-	-	1	0.72	4	3.37	3	2.59
<i>Chilara taylori</i>	1	0.81	-	-	-	-	-	-
<i>Heterostichus rostratus</i>	2	1.83	1	0.88	2	1.35	-	-
<i>Hypsoblennius jenkinsi</i>	-	-	-	-	-	-	-	-
Paralichthyidae unid.	2	1.95	-	-	1	1.01	1	0.61
Atherinopsidae	1	0.84	-	-	-	-	-	-
<i>Parophrys vetulus</i>	-	-	-	-	-	-	-	-
Myctophidae unid.	-	-	-	-	1	0.96	-	-
<i>Hippoglossina stomata</i>	2	1.49	-	-	-	-	-	-
<i>Zaniolepis frenata</i>	-	-	1	0.64	2	1.33	1	0.70
<i>Ruscarius creaseri</i>	-	-	-	-	1	0.68	-	-
Clupeiformes	-	-	-	-	-	-	1	0.78
<i>Syngnathus leptorhynchus</i>	-	-	-	-	-	-	-	-
Clupeidae unid.	-	-	-	-	-	-	1	0.67
<i>Lyopsetta exilis</i>	-	-	-	-	-	-	-	-
Pomacentridae	-	-	-	-	-	-	-	-
<i>Rhinogobiops nicholsi</i>	1	0.85	-	-	-	-	-	-
<i>Nannobranchium ritteri</i>	2	1.75	-	-	-	-	-	-
<i>Cyclothone</i> spp.	-	-	-	-	-	-	1	0.90
<i>Chromis punctipinnis</i>	1	0.82	-	-	-	-	-	-
<i>Icelinus</i> spp.	-	-	-	-	-	-	-	-
Gobiesocidae unid.	-	-	1	0.72	-	-	-	-
<i>Anisotremus davidsonii</i>	-	-	-	-	-	-	-	-
<i>Sebastes jordani</i>	-	-	-	-	2	1.33	-	-
Blennioidei	-	-	-	-	-	-	-	-
Clinidae unid.	-	-	-	-	-	-	-	-
Chaenopsidae unid.	-	-	-	-	-	-	1	0.97
<i>Leptocottus armatus</i>	-	-	-	-	-	-	1	0.90
Cynoglossidae	-	-	-	-	-	-	-	-
Kyphosidae	-	-	-	-	-	-	-	-
<i>Cyclothone acclinidens</i>	1	0.85	-	-	-	-	-	-
<i>Ilypnus gilberti</i>	-	-	1	0.84	-	-	-	-
Gobiesox spp.	-	-	-	-	-	-	-	-
Hexagrammidae unid.	-	-	-	-	-	-	-	-
<i>Bathylagus ochotensis</i>	-	-	-	-	-	-	-	-
<i>Hypsoblennius gentilis</i>	-	-	-	-	-	-	-	-
Invertebrates								
<i>Panulirus interruptus</i>	-	-	-	-	-	-	-	-
<i>Cancer anthonyi</i> (megalops)	8	5.93	2	1.26	3	2.96	1	1.01
<i>Cancer antennarius</i> (megalops)	4	2.91	1	1.12	-	-	-	-
<i>Cancer gracilis</i> (megalops)	2	1.44	2	1.73	1	1.05	-	-
<i>Cancer</i> spp. (megalops)	-	-	-	-	-	-	-	-
<i>Cancer productus</i> (megalops)	-	-	-	-	-	-	-	-
	38,722		38,471		38,736		38,950	

Table A3 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations N1-N5 in nearshore area.

Taxon	11		12		13	
	03/23/05		04/21/05		05/19/05	
	15		20		20	
Taxon	Count	Conc.	Count	Conc.	Count	Conc.
Fishes						
<i>Engraulis mordax</i>	1,767	1,805.85	3,356	2,740.48	18	13.11
<i>Hypsoblennius</i> spp.	3	3.31	11	8.69	191	173.15
Engraulidae unid.	1,163	1,211.29	10	8.62	10	8.93
Gobiidae unid.	98	99.04	21	20.98	91	76.18
<i>Genyonemus lineatus</i>	234	235.43	45	33.43	6	4.54
larvae, unidentified yolk sac	19	20.47	2	1.58	11	9.07
<i>Paralichthys californicus</i>	28	27.91	11	9.12	6	4.78
<i>Seriophus politus</i>	-	-	1	1.22	-	-
Sciaenidae unid.	38	44.51	6	5.95	11	9.01
<i>Roncador steamsi</i>	-	-	-	-	-	-
<i>Citharichthys stigmaeus</i>	2	1.93	2	2.00	-	-
<i>Gibbonsia</i> spp.	15	15.39	2	2.29	40	30.54
Labrisomidae unid.	-	-	1	0.74	-	-
<i>Paralabrax clathratus</i>	-	-	-	-	-	-
<i>Sardinops sagax</i>	-	-	118	101.46	-	-
<i>Paralabrax</i> spp.	-	-	1	0.69	-	-
larval fish fragment	5	5.02	8	6.78	2	1.32
Haemulidae unid.	-	-	-	-	-	-
<i>Scomber japonicus</i>	-	-	-	-	-	-
<i>Hypsypops rubicundus</i>	-	-	1	0.94	5	5.36
larval/post-larval fish unid.	-	-	2	1.69	1	0.55
<i>Oxyjulis californica</i>	1	1.20	4	3.35	-	-
<i>Paralabrax nebulifer</i>	-	-	-	-	-	-
<i>Sphyræna argentea</i>	-	-	-	-	-	-
<i>Xenistius californiensis</i>	-	-	-	-	-	-
<i>Lepidogobius lepidus</i>	3	2.73	2	1.99	6	3.84
<i>Stenobrachius leucopsarus</i>	-	-	10	7.78	-	-
<i>Pleuronichthys verticalis</i>	4	3.45	2	1.74	-	-
<i>Atherinopsis californiensis</i>	15	17.97	-	-	-	-
<i>Umbrina roncador</i>	-	-	-	-	-	-
<i>Pleuronichthys ritteri</i>	1	1.34	1	0.74	-	-
<i>Xystreurus liolepis</i>	-	-	-	-	1	0.75
<i>Hypsopsetta guttulata</i>	1	1.20	-	-	-	-
<i>Rimicola</i> spp.	-	-	-	-	-	-
<i>Peprilus simillimus</i>	-	-	3	2.33	-	-
<i>Cheilotrema saturnum</i>	-	-	-	-	-	-
<i>Semicossyphus pulcher</i>	-	-	-	-	1	0.75
<i>Ophidion scrippsae</i>	-	-	-	-	-	-
<i>Diaphus theta</i>	-	-	13	10.38	4	2.94
<i>Acanthogobius flavimanus</i>	3	2.58	-	-	-	-
<i>Pleuronichthys</i> spp.	-	-	1	0.74	1	0.75
Pleuronectiformes unid.	-	-	3	1.94	2	2.42
<i>Menticirrhus undulatus</i>	-	-	-	-	-	-
<i>Atractoscion nobilis</i>	-	-	2	1.91	-	-
Ophidiidae unid.	-	-	-	-	-	-
<i>Sebastes</i> spp.	-	-	1	0.77	1	0.75
<i>Girella nigricans</i>	-	-	-	-	-	-
<i>Typhlogobius californiensis</i>	2	1.94	2	2.17	3	2.30
<i>Citharichthys sordidus</i>	-	-	2	1.29	-	-
Pleuronectidae unid.	1	0.93	13	10.21	-	-
<i>Trachurus symmetricus</i>	-	-	2	1.38	-	-
<i>Halichoeres semicinctus</i>	-	-	-	-	-	-
<i>Syngnathus</i> spp.	-	-	-	-	-	-
Labridae	-	-	2	1.88	-	-

Table A3 (continued). Monthly abundance and mean concentration (#/1,000 m³) of larval fishes and target invertebrates at source water Stations N1-N5 in nearshore area.

Taxon	11 03/23/05 15		12 04/21/05 20		13 05/19/05 20	
	Count	Conc.	Count	Conc.	Count	Conc.
Fishes						
<i>Paraclinus integripinnis</i>	-	-	-	-	-	-
<i>Symphurus atricauda</i>	-	-	-	-	-	-
<i>Triphoturus mexicanus</i>	-	-	-	-	-	-
<i>Citharichthys</i> spp.	-	-	-	-	1	1.24
<i>Nannobranchium</i> spp.	-	-	1	0.65	1	0.75
<i>Medialuna californiensis</i>	-	-	-	-	-	-
<i>Gillichthys mirabilis</i>	-	-	-	-	-	-
<i>Chilara taylori</i>	-	-	-	-	-	-
<i>Heterostichus rostratus</i>	-	-	-	-	-	-
<i>Hypsoblennius jenkinsi</i>	-	-	-	-	-	-
Paralichthyidae unid.	-	-	-	-	-	-
Atherinopsidae	3	3.21	-	-	-	-
<i>Parophrys vetulus</i>	-	-	5	3.93	-	-
Myctophidae unid.	-	-	1	0.94	-	-
<i>Hippoglossina stomata</i>	-	-	-	-	-	-
<i>Zaniolepis frenata</i>	-	-	-	-	1	0.55
<i>Ruscarius creaseri</i>	2	2.15	-	-	-	-
Clupeiformes	-	-	-	-	-	-
<i>Syngnathus leptorhynchus</i>	-	-	-	-	-	-
Clupeidae unid.	-	-	-	-	-	-
<i>Lyopsetta exilis</i>	-	-	3	2.04	-	-
Pomacentridae	-	-	-	-	-	-
<i>Rhinogobiops nicholsi</i>	-	-	-	-	-	-
<i>Nannobranchium nitteri</i>	-	-	-	-	-	-
<i>Cyclothone</i> spp.	-	-	-	-	-	-
<i>Chromis punctipinnis</i>	-	-	-	-	-	-
<i>Icelinus</i> spp.	-	-	-	-	3	1.65
Gobiesocidae unid.	-	-	-	-	-	-
<i>Anisotremus davidsonii</i>	-	-	-	-	-	-
<i>Sebastes jordani</i>	-	-	-	-	-	-
Blennioidel	-	-	-	-	-	-
Clinidae unid.	-	-	-	-	-	-
Chaenopsidae unid.	-	-	-	-	-	-
<i>Leptocottus armatus</i>	-	-	-	-	-	-
Cynoglossidae	-	-	-	-	-	-
Kyphosidae	-	-	-	-	-	-
<i>Cyclothone acclinidens</i>	-	-	-	-	-	-
<i>Ilypnus gilberti</i>	-	-	-	-	-	-
Gobiesox spp.	-	-	-	-	1	0.75
Hexagrammidae unid.	-	-	-	-	-	-
<i>Bathylagus ochotensis</i>	-	-	1	0.75	-	-
<i>Hypsoblennius gentilis</i>	-	-	-	-	-	-
Invertebrates						
<i>Panulirus interruptus</i>	-	-	-	-	-	-
<i>Cancer anthonyi</i> (megalops)	-	-	-	-	1	0.77
<i>Cancer antennarius</i> (megalops)	-	-	-	-	6	4.99
<i>Cancer gracilis</i> (megalops)	-	-	-	-	2	1.10
<i>Cancer</i> spp. (megalops)	-	-	-	-	-	-
<i>Cancer productus</i> (megalops)	-	-	-	-	2	1.54
	41,868		42,167		38,953	