



EDMUND G. BROWN JR.
GOVERNOR



MATTHEW RODRIGUEZ
SECRETARY FOR
ENVIRONMENTAL PROTECTION

San Diego Regional Water Quality Control Board

June 20, 2017

Mr. Jon Coombs
4747 Oak Crest Road
Fallbrook, CA 92028

In reply refer to / attn:
245555:BBushnell

Subject: Review of Monitoring Reports for Order No. 93-69, Oak Crest Treatment Plant

Mr. Coombs:

The California Regional Water Quality Control Board, San Diego Region (San Diego Water Board) has reviewed the January-June 2016 semiannual, 2015 and 2016 annual monitoring reports. Rainbow Municipal Water District submitted the monitoring report as required by the Monitoring and Reporting Program No. 93-69.


The San Diego Water Board found the following violations of Order No. 93-69 in the reports provided:

1. The Discharge Specifications (section B.1) establish the daily maximum concentration of total dissolved solids (TDS) in treated effluent at an increase of 300 milligrams per liter (mg/L) over the TDS concentration of the influent to the treatment system. The Discharge Specification for the concentration of TDS was exceeded on June 1, 2016 with an increase of 568 mg/L in effluent when compared to the influent concentration.


The next monitoring report required to be submitted is the January-December 2017 annual monitoring report, which is due by **January 30, 2018**.

In the subject line of any response, please include reference **245555:BBushnell**. Please contact Mr. Brandon Bushnell at 619-521-8044, or at brandon.bushnell@waterboards.ca.gov if you have any questions or comments.

Sincerely,



John R. Odermatt, M.Sc., P.G., Senior Engineering Geologist
Land Discharge Unit

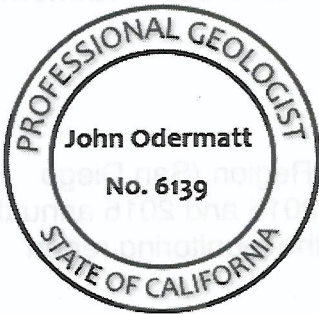

cc: Mr. Jon Coombs, Operations Manager, Water Quality Specialists, jon@wqsca.com

JRO: ac: bb

Tech Staff Info & Use	
Place ID	245555
Reg. Measure ID	143055
SEL Reg. Measure ID	413703
Violation ID	1025884