

California Regional Water Quality Control Board
Santa Ana Region

December 14, 2012

ITEM: 9

SUBJECT: Renewal of Waste Discharge Requirements for the City of Colton, Water Reclamation Facility, Order No. R8-2012-0050, NPDES No. CA0105236, Colton, San Bernardino County

DISCUSSION:

See attached Fact Sheet

RECOMMENDATION:

Adopt Order No. R8-2012-0050, NPDES No. CA0105236 as presented.

COMMENT SOLICITATION:

Comments were solicited from the discharger and the following agencies:

U.S. Environmental Protection Agency (WTR-5) – Peter Kozelka, Ph.D
U.S. Army District, Los Angeles, Corps of Engineers - Regulatory Branch
U.S. Fish and Wildlife Service, Carlsbad
State Water Resources Control Board, Office of the Chief Counsel – David Rice
State Department of Fish and Game, Ontario
California Department of Public Health, San Bernardino – Sean McCarthy
San Bernardino County Environmental Health Services – Terri Williams
San Bernardino County Department of Public Works, Flood Control – Naresh Varma
Santa Ana Watershed Project Authority – Celeste Cantu
Santa Ana River Dischargers Association
Inland Empire Waterkeeper - Autumn DeWoody
Orange County Water District - Nira Yamachika
Orange County Coastkeeper - Garry Brown
Lawyers for Clean Water c/o San Francisco Baykeeper

California Regional Water Quality Control Board

Santa Ana Region

3737 Main Street, Suite 500, Riverside, California 92501-3348
Phone (951) 782-4130 - FAX (951) 781-6288- TDD (951) 782-3221

<http://www.waterboards.ca.gov/santaana>

ORDER NO. R8-2012-0050
NPDES NO. CA0105236

WASTE DISCHARGE REQUIREMENTS FOR THE CITY OF COLTON WATER RECLAMATION FACILITY

The following Discharger is authorized to discharge in accordance with the waste discharge requirements set forth in this Order:

Table 1 Discharger/Facility

Discharger	City of Colton
Name of Facility	Colton Water Reclamation Facility
Facility Location	1201 S. Rancho
	Colton, CA. 92324
	San Bernardino County
The U.S. Environmental Protection Agency (USEPA) and the Regional Water Quality Control Board, Santa Ana Region, have classified this discharge as a major discharge.	

The discharge by the City of Colton from the discharge point identified below is subject to waste discharge requirements as set forth in this Order.

Table 2 Discharge Location


Discharge Point	Effluent Description	Discharge Point (Latitude)	Discharge Point (Longitude)	Receiving Water
001	Disinfected Secondary	34 ° 02' 45" N	117 ° 21' 100" W	Santa Ana River, Reach 4

Table 3 Administrative Information

This Order was adopted by the Regional Water Board on:	December 14, 2012
This Order shall become effective on:	January 1, 2013
This Order shall expire on:	December 31, 2017
The Discharger shall file a Report of Waste Discharge in accordance with Title 23, California Code of Regulations, not later than 180 days in advance of the Order expiration date as application for reissuance of new waste discharge requirements.	

IT IS HEREBY ORDERED, that this Order supersedes and rescinds Order No. R8-2005-0075 upon the effective date of this Order, except for enforcement purposes, and in order to meet the provisions contained in Division 7 of the California Water Code (CWC) and regulations adopted therein, and the provisions of the federal Clean Water Act, and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements in this Order.

I, Kurt V. Berchtold, Executive Officer, do hereby certify that this Order with all attachments is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Santa Ana Region, on December 14, 2012.



Kurt V. Berchtold, Executive Officer

TABLE OF CONTENTS

I.	Discharger/Facility Information	5
II.	Findings	5
III.	Discharge Prohibitions.....	11
IV.	Effluent Limitations and Discharge Specifications	11
	A. Effluent Limitations – Discharge Point 001	11
	B. Land Discharge Specifications – Not Applicable.....	12
	C. Reclamation Specifications – Not Applicable.....	12
V.	Receiving Water Limitations	12
	A. Surface Water Limitations.....	12
	B. Groundwater Limitations – Not Applicable.....	13
VI.	Provisions.....	13
	A. Standard Provisions.....	13
	B. Monitoring and Reporting Program Requirements.....	14
	C. Special Provisions.....	14
	1. Reopener Provisions.....	14
	2. Special Studies, Technical Reports and Additional Monitoring Requirements – Not Applicable	15
	3. Best Management Practices and Pollution Prevention – Not Applicable	15
	4. Compliance Schedules – Not Applicable	15
	5. Construction, Operation and Maintenance Specifications.....	15
	6. Special Provisions for Municipal Facilities	16
VII.	Compliance Determination	19
	A. Average Monthly Effluent Limitation (AMEL).....	19
	B. Average Weekly Effluent Limitation (AWEL).....	19
	C. Maximum Daily Effluent Limitation (MDEL).....	19
	D. Instantaneous Minimum Effluent Limitation.	19
	E. Instantaneous Maximum Effluent Limitation.	20
	F. Multiple Sample Data.....	21
	G. Compliance Determination.....	20

LIST OF TABLES

Table 1	Discharger/Facility	1
Table 2	Discharge Locations	1
Table 3	Administrative Information	2
Table 4	Discharger/Facility Information.....	5
Table 5	Basin Plan Beneficial Uses	8

LIST OF ATTACHMENTS

Attachment A – Definitions	A-1
Attachment B – Location Map.....	B-1
Attachment C – Flow Schematic.....	C-1
Attachment D – Standard Provisions.....	D-1
Attachment E – Monitoring and Reporting Program	E-1
Attachment F – Fact Sheet.....	F-1
Attachment G – USEPA Priority Pollutants List	G-1
Attachment H – Minimum Levels	H-1
Attachment I – Triggers for Monitoring Priority Pollutants.....	I-1

I. DISCHARGER/FACILITY INFORMATION

The following Discharger is authorized to discharge wastewater in accordance with the Waste Discharge Requirements set forth in this Order:

Table 4 Discharger/Facility Information

Discharger	City of Colton
Mailing Address	150 S. 10th, Colton, CA 92324
Facility	City of Colton Water Reclamation Facility
Facility Address	1201 S. Rancho
	Colton, CA 92324
	San Bernardino County
Facility Contact, Title, and Phone	Martin Guerrero, Chief Operator, (909) 825-4114
Type of Facility	Publicly Owned Treatment Works
Facility Design Flow	10.4 million gallons per day

II. FINDINGS

The California Regional Water Quality Control Board, Santa Ana Region (hereinafter Regional Water Board), finds:

- A. Background.** The City of Colton (hereinafter Discharger) is currently discharging wastewater under Order No. R8-2005-0075 and National Pollutant Discharge Elimination System (NPDES) Permit No. CA0105392. The Discharger submitted a Report of Waste Discharge, dated March 18, 2010, and applied for a NPDES permit renewal to discharge up to 5.84 million gallons per day (mgd) of secondary treated and disinfected wastewater to surface waters from the City of Colton Water Reclamation Facility (hereinafter Facility) when 20:1 dilution or more can be provided by the natural receiving waters.

B. Facility Description. The Discharger owns and operates a publicly owned treatment works with secondary treatment capability. The treatment systems consist of screening, grit removal, primary clarification, secondary activated sludge, oxidation ditch with nitrification and denitrification, secondary clarification, and chlorination. The plant schematic in Attachment C depicts how flows are split through two different treatment trains (activated sludge and oxidation ditch). Normally, effluent from the Facility is directed to the Colton/San Bernardino Regional Tertiary Treatment and Water Reclamation Agency's Rapid Infiltration and Extraction Facility for further treatment and disposal. Intermittently, the secondary treated and disinfected wastewater is discharged at Discharge Point 001 to Reach 4 of the Santa Ana River. These discharges occur only when there is sufficient flow in the River to provide 20:1 or more dilution. Although there was sufficient flow in the River to allow a discharge occasionally, no such discharges occurred throughout the duration of the previous Order.

All on-site storm water flows from the Facility, except a small area adjacent to the administrative building, are routed to the headworks for treatment.

C. Legal Authorities. This Order serves as Waste Discharge Requirements (WDRs) pursuant to article 4, chapter 4 of the California Water Code (CWC) commencing with section 13260. This Order shall also serve as an NPDES permit pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (USEPA) and Chapter 5.5, Division 7 of the CWC for point source discharges from this facility to surface waters.

D. Background and Rationale for Requirements. The Regional Water Board developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and through other available information. The Fact Sheet (Attachment F), which contains background information and rationale for Order requirements, is hereby incorporated into this Order, and thus constitutes part of the Findings for this Order. Attachments A through E, and G through K are also incorporated into this Order.

E. California Environmental Quality Act. Under CWC section 13389, the action to adopt these waste discharge requirements is exempt from the provisions of CEQA, Public Resources Code section 21000 et seq. (*County of Los Angeles v. California State Water Resources Control Board* (2006) 143 Cal.App.4th 985, mod. (Nov. 6, 2006, B184034) 50 Cal.Rptr.3d 619, 632-636). This action also involves the re-issuance of waste discharge requirements for an existing facility that discharges treated wastewater and as such, is exempt from the provisions of the California Environmental Quality Act (commencing with Section 21100) pursuant to Title 14 of the California Code of Regulations, Section 15301.

- F. Technology-based Effluent Limitations.** Section 301(b) of the CWA and implementing USEPA permit regulations at 40 CFR¹ 122.44 require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Secondary Treatment Standards at 40 CFR Part 133 and/or Best Professional Judgment (BPJ) in accordance with 40 CFR 125.3. A detailed discussion of the technology-based effluent limitations development is included in the Fact Sheet (Attachment F).
- G. Water Quality-based Effluent Limitations.** 40 CFR 122.44(d)(1)(i) mandates that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, water quality-based effluent limitations (WQBELs) must be established using: (1) USEPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state's narrative criterion, supplemented with other relevant information, as provided in 40 CFR 122.44(d)(1)(vi).
- H. Water Quality Control Plans.** The Regional Water Board adopted a Water Quality Control Plan for the Santa Ana River Basin (hereinafter Basin Plan) that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, the Basin Plan implements State Water Resources Control Board (State Water Board) Resolution No. 88-63, which established State policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply. Based on the criteria specified in the State Water Board Resolution, the Basin Plan specifies that the lower portions of Reach 5 of the Santa Ana River and downstream reaches, as well as most of its tributaries, are excepted from the municipal and domestic supply beneficial use.

¹ Title 40 of the Code of Federal Regulations

As discussed in detail in the Fact Sheet (Attachment F), beneficial uses applicable to the receiving waters are as follows:

Table 5 Basin Plan Beneficial Uses

Discharge Point	Receiving Water Name	Beneficial Uses
001 and S 001	Reach 4 of the Santa Ana River	Warm freshwater habitat (WARM), wildlife habitat (WILD), ground water recharge (GWR), hydropower generation, water contact recreation (REC-1), and non-contact water recreation (REC-2) Excepted from municipal and domestic supply (MUN)
	Downstream Reaches of the Santa Ana River	Agricultural supply (AGR); warm freshwater habitat (WARM); wildlife habitat (WILD); ground water recharge (GWR); hydropower generation, water contact recreation (REC-1); non-contact water recreation (REC-2); and rare, threatened, or endangered species (RARE). Excepted from municipal and domestic supply (MUN)

I. **Pretreatment:** The Discharger has established an approved regional pretreatment program. The approved pretreatment program and its components and control mechanisms, among others, are hereby made an enforceable condition of this Order.

J. **National Toxics Rule (NTR) and California Toxics Rule (CTR).** USEPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995 and November 9, 1999. About forty criteria in the NTR applied in California. On May 18, 2000, USEPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on February 13, 2001. These rules contain water quality criteria for priority pollutants.

K. **State Implementation Policy.** On March 2, 2000, the State Water Board adopted the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California* (State Implementation Policy or SIP). The SIP became effective on April 28, 2000 with respect to the priority pollutant criteria promulgated for California by the USEPA through the NTR and to the priority pollutant objectives established by the Regional Water Board in the Basin Plan. The SIP became effective on May 18, 2000 with respect to the priority pollutant criteria promulgated by the USEPA through the CTR. The State Water Board adopted amendments to the SIP on February 24, 2005 that became effective on July 13, 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.

- L. Antidegradation Policy.** 40 CFR 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing quality of waters be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the state and federal antidegradation policies. As discussed in detail in the Fact Sheet (Attachment F), the permitted discharge is consistent with the antidegradation provision of 40 CFR 131.12 and State Water Board Resolution No. 68-16.
- M. Anti-Backsliding Requirements.** Sections 402(o)(2) and 303(d)(4) of the CWA and federal regulations at 40 CFR 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require effluent limitations in a reissued permit to be as stringent as those in the previous permit, with some exceptions where limitations may be relaxed. All effluent limitations in this Order are at least as stringent as the effluent limitations in the previous Order. Therefore, this Order conforms to the anti-backsliding requirements of the CWA.
- N. Endangered Species Act.** This Order does not authorize any act that results in the taking of a threatened or endangered species or any act that is now prohibited, or becomes prohibited in the future, under either the California Endangered Species Act (Fish and Game Code sections 2050 to 2097) or the Federal Endangered Species Act (16 U.S.C.A. sections 1531 to 1544). This Order requires compliance with effluent limits, receiving water limits, and other requirements to protect the beneficial uses of waters of the state. The Discharger is responsible for meeting all requirements of the applicable Endangered Species Act.
- O. Monitoring and Reporting.** Water Code sections 13267 and 13383 authorizes the Regional Water Board to require technical and monitoring reports. 40 CFR 122.48 requires that all NPDES permits specify requirements for recording and reporting monitoring results. The Monitoring and Reporting Program establishes monitoring and reporting requirements to implement State and federal requirements. This Monitoring and Reporting Program is provided in Attachment E.
- P. Biosolids Requirements.** On February 19, 1993, the USEPA issued a final rule for the use and disposal of sewage sludge, 40 CFR, Part 503. This rule requires that producers of sewage sludge meet certain reporting, handling, and disposal requirements. The State of California has not been delegated the authority to implement this program, therefore, the USEPA is the implementing agency. However, this Order includes biosolids monitoring requirements.
- Q. State General Waste Discharge Requirements for Sanitary Sewer Systems.** The State Water Board issued General Waste Discharge Requirements for Sanitary Sewer Systems, Water Quality Order No. 2006-0003 on May 2, 2006, requiring public agencies that own sanitary sewer systems, comprised of more than one mile of pipes or sewer lines, to enroll for coverage under the General Order. The General Order requires

agencies to develop sanitary sewer management plans (SSMPs) and report all sanitary sewer overflows (SSOs). This Order requires the Discharger to continue its enrollment under the General Order.

- R. Standard and Special Provisions.** Standard Provisions, which apply to all NPDES permits in accordance with 40 CFR 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 CFR 122.42, are provided in Attachment D. The Discharger must comply with all standard provisions and with those additional conditions that are applicable under 40 CFR 122.42. The Regional Water Board has also included in this Order special provisions applicable to the Discharger. A rationale for the special provisions contained in this Order is provided in the attached Fact Sheet (Attachment F).
- S. Provisions and Requirements Implementing State Law.** The provisions/requirements in section IV.C. of this Order are included to implement state law only. These provisions/requirements are not required or authorized under the federal CWA; consequently, violations of these provisions/requirements are not subject to the enforcement remedies that are available for NPDES violations.
- T. Notification of Interested Parties.** The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe Waste Discharge Requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of notification are provided in the Fact Sheet (Attachment F) of this Order.
- U. Consideration of Public Comment.** The Regional Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet (Attachment F) of this Order.

III. DISCHARGE PROHIBITIONS

- A. The direct discharge of wastewater to the Santa Ana River other than when the flow³ in the River results in a dilution of 20:1 or more at the point of discharge is prohibited.
- B. The discharge of wastewater at a location or in a manner different from those described in this Order is prohibited, unless otherwise permitted through a separate action by the Regional Water Board.
- C. The discharge of any substances in concentrations toxic to animal or plant life is prohibited.
- D. The discharge of any radiological, chemical, or biological warfare agent or high level radiological waste is prohibited.

IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

A. Effluent Limitations – Discharge Point 001

Whenever the flow³ in the Santa Ana River, as measured at monitoring location R-001D results in a dilution of 20:1 (receiving water flow : wastewater flow) or more, the Discharger shall comply with the following effluent limitations:

1. Physical/Biological Limitations:

Table 1. Effluent Limitations at DP 001 Under 20:1 Dilution

Parameter	Units	Effluent Limitations	
		Average Monthly	Average Weekly
Biochemical Oxygen Demand 5-day @ 20°C	mg/L	30	45
Total Suspended Solids	mg/L	30	45

2. Percent Removal: The average monthly percent removal of BOD 5-day 20°C and total suspended solids shall not be less than 85 percent.
3. Coliform: The weekly average number of coliform bacteria does not exceed a median of 23 per 100 milliliters as determined from the daily coliform bacteria values for the last seven (7) days. To comply with the limit, the 7-day median MPN must not exceed 23 per 100 milliliters on any day during the week. However, only one violation is recorded for each calendar week, even if the 7-day median MPN value is greater than 23 for more than one day in the week.

³ Exclusive of discharges to surface waters from upstream public owned treatment works.

4. The pH of the discharge shall be within 6.5 to 8.5 pH units at all times. Compliance with pH limits shall be determined as follows:
 - a) The total time during which the pH is outside the range of 6.5 - 8.5 pH units shall not exceed 7 hours and 26 minutes in any calendar month; and
 - b) No individual excursion from the range of 6.5 – 8.5 pH units shall exceed 60 minutes.

B. Land Discharge Specifications – Not Applicable

C. Reclamation Specifications – Not Applicable

V. RECEIVING WATER LIMITATIONS

A. Surface Water Limitations

1. Receiving water limitations are based upon water quality objectives contained in the Basin Plan. As such, they are a required part of this Order. The discharge shall not cause the following in the Santa Ana River, Reach 4, or in downstream reaches of the Santa Ana River:
 - a. Coloration of the receiving waters, which causes a nuisance or adversely affects beneficial uses.
 - b. Deposition of oil, grease, wax or other materials in the receiving waters in concentrations which result in a visible film or in coating objects in the water, or which cause a nuisance or affect beneficial uses.
 - c. An increase in the amounts of suspended or settleable solids in the receiving waters, which will cause a nuisance or adversely affect beneficial uses as a result of controllable water quality factors.
 - d. Taste or odor-producing substances in the receiving waters at concentrations that cause a nuisance or adversely affect beneficial uses.
 - e. The presence of radioactive materials in the receiving waters in concentrations that are deleterious to human, plant or animal life.
 - f. The depletion of the dissolved oxygen concentration below 5.0 mg/l.
 - g. The temperature of the receiving waters to be raised above 90°F (32°C) during the period of June through October, or above 78°F (26°C) during the rest of the year.
 - h. The concentration of pollutants in the water column, sediments, or biota to adversely affect the beneficial uses of the receiving water. The discharge shall not result in the degradation of inland surface water communities and populations, including vertebrate, invertebrate, and plant species.

2. The discharge of wastes shall not cause a violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or State Water Board, as required by the Clean Water Act and regulations adopted thereunder.
3. Pollutants not specifically mentioned and limited in this Order shall not be discharged at levels that will bioaccumulate in aquatic resources to levels that are harmful to human health.

B. Groundwater Limitations – Not Applicable

VI. PROVISIONS

A. Standard Provisions

1. The Discharger shall comply with all Standard Provisions included in Attachment D of this Order.
2. The Discharger shall comply with the following provisions:
 - a. Neither the treatment nor the discharge of waste shall create, or threaten to create, a nuisance or pollution as defined by Section 13050 of the California Water Code.
 - b. The Discharger shall maintain a copy of this Order at the site so that it is available to site operating personnel at all times. Key operating personnel shall be familiar with its content.
 - c. The Discharger shall take all reasonable steps to minimize any adverse impact to receiving waters resulting from noncompliance with any requirements specified in this Order, including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.
 - d. The Discharger shall optimize chemical additions needed in the treatment process to meet waste discharge requirements so as to minimize total dissolved solid increases in the treated wastewater.
 - e. The provisions of this Order are severable, and if any provision of this Order, or the application of any provisions of this Order to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this Order shall not be affected thereby.
 - f. Collected screenings, sludge, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Regional Water Board's Executive Officer.

- g. If the Discharger demonstrates a correlation between the biological oxygen demand (BOD₅) and total organic carbon (TOC) concentrations in the effluent to the satisfaction of the Executive Officer, compliance with the BOD₅ limits contained in this Order may be determined based on analyses of the TOC of the effluent.
- h. In the event of any change in control or ownership of land or waste discharge facility presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be forwarded to the Regional Water Board.
- i. The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.

B. Monitoring and Reporting Program Requirements

1. The Discharger shall comply with the Monitoring and Reporting Program, and future revisions thereto, in Attachment E of this Order. This monitoring and reporting program may be modified by the Executive Officer at any time during the term of this Order, and may include an increase in the number of parameters to be monitored, the frequency of the monitoring or the number and size of samples to be collected. Any increase in the number of parameters to be monitored, the frequency of the monitoring or the number and size of samples to be collected may be reduced back to the levels specified in the original monitoring and reporting program at the discretion of the Executive Officer.

C. Special Provisions

1. Reopener Provisions

- a. This Order may be reopened to address any changes in State or federal plans, policies or regulations that would affect the requirements for the discharge.
- b. This Order may be reopened to include effluent limitations for pollutants determined to be present in the discharge in concentrations that pose a reasonable potential to cause or contribute to violations of water quality objectives.
- c. This Order may be reopened and modified in accordance with the requirements set forth at 40 CFR 122 and 124, to include the appropriate conditions or limits to address demonstrated effluent toxicity based on newly available information, or to implement any USEPA-approved new State water quality standards applicable to effluent toxicity.
- d. This Order may be reopened to incorporate appropriate biosolids requirements if the State Water Board and the Regional Water Board are given the authority to implement regulations contained in 40 CFR 503.

- 2. Special Studies, Technical Reports and Additional Monitoring Requirements – Not Applicable**
- 3. Best Management Practices and Pollution Prevention – Not Applicable**
- 4. Compliance Schedules – Not Applicable**
- 5. Construction, Operation and Maintenance Specifications**
 - a. The Discharger's wastewater treatment plant shall be supervised and operated by persons possessing certificates of appropriate grade pursuant to Title 23, Division 3, Chapter 14, California Code of Regulations.
 - b. The Discharger shall provide safeguards to assure that should there be reduction, loss, or failure of electric power, the Discharger will comply with the requirements of this Order.
 - c. The Discharger shall update as necessary, the "Operation and Maintenance Manual (O&M Manual)" that it has developed for the treatment facility to conform to latest plant changes and requirements. The O&M Manual shall be readily available to operating personnel onsite. The O&M Manual shall include the following:
 - 1) Description of the treatment plant table of organization showing the number of employees, duties and qualifications and plant attendance schedules (daily, weekends and holidays, part-time, etc.). The description should include documentation that the personnel are knowledgeable and qualified to operate the treatment facility so as to achieve the required level of treatment at all times.
 - 2) Detailed description of safe and effective operation and maintenance of treatment processes, process control instrumentation and equipment.
 - 3) Description of laboratory and quality assurance procedures.
 - 4) Process and equipment inspection and maintenance schedules.
 - 5) Description of safeguards to assure that, should there be reduction, loss, or failure of electric power, the Discharger will be able to comply with requirements of this Order.

- 6) Description of preventive (fail-safe) and contingency (response and cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events. These plans shall identify the possible sources (such as loading and storage areas, power outage, waste treatment unit failure, process equipment failure, tank and piping failure) of accidental discharges, untreated or partially treated waste bypass, and polluted drainage.

6. Special Provisions for Municipal Facilities

a. Sewer Collection System Requirements

The Discharger's collection system is part of the system that is subject to this Order. As such, the Discharger must properly operate and maintain its collection system (40 CFR 122.41(e)). The Discharger must report any non-compliance (40 CFR 122.41(l)(6) and (7)) and mitigate any discharge from the collection system in violation of this Order (40 CFR 122.41(d)). See Attachment D.

Furthermore, the General Waste Discharge Requirements for Collection System Agencies (Order No. 2006-0003 DWQ) contains requirements for operation and maintenance of collection systems and for reporting and mitigating sanitary sewer overflows. While the Discharger must comply with both Order No. 2006-0003 DWQ and this Order, the General Collection System WDR more clearly and specifically stipulates requirements for operation and maintenance and for reporting and mitigating sanitary sewer overflows. The Discharger and other governmental agencies that are discharging wastewater into the facility are required to obtain enrollment for regulation under Order No. 2006-0003-DWQ.

b. Biosolids Disposal Requirements

- 1) Collected screenings, sludge, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with regulations specified in Title 27 of the California Code of Regulations and approved by the Regional Water Board's Executive Officer.
- 2) The use and disposal of biosolids shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR 503.
- 3) Any proposed change in biosolids use or disposal practice from a previously approved practice should be reported to the Executive Officer and USEPA Regional Administrator at least 90 days in advance of the change.
- 4) The Discharger shall take all reasonable steps to minimize or prevent any discharge or biosolids use or disposal that has the potential of adversely affecting human health or the environment.

c. Pretreatment Program

- 1) The Discharger shall update as necessary and implement an acceptable pretreatment program.
- 2) The Discharger shall update as necessary the appropriate contractual agreements with all governmental agencies⁴. The contractual agreements shall give the Discharger the authority to implement and enforce the USEPA approved pretreatment program within the sewer service areas of the treatment facility. The Discharger shall assure that any other steps necessary to provide this implementation and enforcement authority (e.g. adoption of ordinances, etc.) are taken by all governmental agencies. If a governmental agency has an USEPA approved pretreatment program for any portion of the service area of the treatment facility, the Discharger's pretreatment program shall contain provisions ensuring that that governmental agency's program is implemented. In the event that any agency discharging to Discharger's facility fails to effectively implement its individual USEPA approved pretreatment program, the Discharger shall implement and enforce its approved program within that agency's service area.
- 3) The Discharger shall ensure that the pretreatment programs for all contributory agencies discharging to the Discharger's treatment facility are implemented and enforced. The Discharger shall be responsible and liable for the performance of all Control Authority pretreatment requirements contained in 40 CFR 403, including any subsequent regulatory revisions to Part 403. Where Part 403 or subsequent revisions place mandatory actions upon the Discharger as Control Authority but does not specify a timetable for completion of the actions, the Discharger shall submit for approval of the Regional Water Board's Executive Officer, a schedule for implementation of the required actions and shall implement the approved schedule. The schedule for implementation shall be submitted within six months from the date that such mandatory actions are established. For violations of pretreatment requirements, the Discharger shall be subject to enforcement actions, penalties, fines and other remedies by the USEPA, or other appropriate parties, as provided in the CWA, as amended (33 USC 1351 et seq.). The USEPA or the Regional Water Board may also initiate enforcement action against an industrial user (IU) for non-compliance with applicable standards and requirements as provided in the CWA.
- 4) The Discharger shall perform the pretreatment functions as required in 40 CFR Part 403 including, but not limited to:
 - a) Enforce the pretreatment requirements under 40 CFR 403.5 and 403.6;
 - b) Implement the necessary legal authorities as provided in 40 CFR 403.8(f)(1);

⁴

Member agencies and sewerage agencies discharging wastewater into the facility.

- c) Implement the programmatic functions as provided in 40 CFR 403.8(f)(2);
 - d) Publish a list of significant non-compliance as required by 40 CFR 403.8(f)(2)(vii); and
 - e) Provide the requisite funding and personnel to implement the pretreatment program as provided in 40 CFR 403.8(f)(3).
- 5) The following wastes shall not be introduced into the treatment works:
- a) Wastes that create a fire or explosion hazard in the treatment works;
 - b) Wastes that will cause corrosive structural damage to treatment works, but, in no case, wastes with a pH lower than 5.0 unless the works are designed to accommodate such wastes;
 - c) Wastes at a flow rate and/or pollutant discharge rate which is excessive over relatively short time periods so that there is a treatment process upset and subsequent loss of treatment efficiency;
 - d) Solid or viscous wastes in amounts that would cause obstruction to the flow in sewers or otherwise interfere with the proper operation of the treatment works.
- 6) The Discharger shall ensure compliance with any existing or future pretreatment standard promulgated by USEPA under Section 307 of the CWA or amendments thereto for any discharge to the municipal system.
- 7) The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement.
- 8) The Discharger shall require each user not in compliance with any pretreatment standard to submit periodic notice (over intervals not to exceed nine months) of progress toward compliance with applicable toxic and pretreatment standards developed pursuant to the CWA or amendments thereto. The Discharger shall forward a copy of such notice to the Regional Water Board and to the USEPA Regional Administrator.

VII. COMPLIANCE DETERMINATION

Compliance with the effluent limitations contained in Section IV of this Order will be determined as specified below:

A. Average Monthly Effluent Limitation (AMEL).

If the average, or when applicable, the median for multiple sample data (see subsection F, below), of daily discharges over a calendar month exceeds the AMEL for a given parameter, this will represent a single violation, though the Discharger may be considered out of compliance for each day of that month for that parameter (e.g., resulting in 31 days of non-compliance in a 31-day month). If only a single sample is taken during the calendar month and the analytical result for that sample exceeds the AMEL, the Discharger may be considered out of compliance for that calendar month. The Discharger will only be considered out of compliance for days when the discharge occurs. For any one calendar month during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar month.

B. Average Weekly Effluent Limitation (AWEL).

If the average, or when applicable, the median for multiple sample data (see subsection F, below), of daily discharges over a calendar week exceeds the AWEL for a given parameter, this will represent a single violation, though the Discharger may be considered out of compliance for each day of that week for that parameter, resulting in 7 days of non-compliance. If only a single sample is taken during the calendar week and the analytical result for that sample exceeds the AWEL, the Discharger may be considered out of compliance for that calendar week. The Discharger will only be considered out of compliance for days when the discharge occurs. For any one calendar week during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar week.

C. Maximum Daily Effluent Limitation (MDEL).

If a daily discharge exceeds the MDEL for a given parameter, an alleged violation will be flagged and the Discharger will be considered out of compliance for that parameter for that 1 day only within the reporting period. For any 1 day during which no sample is taken, no compliance determination can be made for that day.

D. Instantaneous Minimum Effluent Limitation.

If the analytical result of a single grab sample is lower than the instantaneous minimum effluent limitation for a parameter, a violation will be flagged and the Discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both are lower than the instantaneous minimum effluent limitation would result in two instances of non-compliance with the instantaneous minimum effluent limitation).

E. Instantaneous Maximum Effluent Limitation.

If the analytical result of a single grab sample is higher than the instantaneous maximum effluent limitation for a parameter, a violation will be flagged and the Discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both exceed the instantaneous maximum effluent limitation would result in two instances of non-compliance with the instantaneous maximum effluent limitation).

F. Multiple Sample Data.

When determining compliance with an AMEL or AWEL and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:

1. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
2. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.

G. Compliance Determination.

Compliance determinations shall be based on available analyses for the time interval associated with the effluent limitation. Where only one sample analysis is available in a specified time interval (e. g., monthly or weekly average), that sample shall serve to characterize the discharge for the entire interval. If quarterly sample results show noncompliance with the average monthly limit and that sample result is used for compliance determinations for each month of the quarter, then three separate violations of the average monthly limit shall be deemed to have occurred.

ATTACHMENT A – DEFINITIONS

Arithmetic Mean (μ), also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

$$\text{Arithmetic mean} = \mu = \Sigma x / n$$

where: Σx is the sum of the measured ambient water concentrations, and n is the number of samples.

Average Monthly Effluent Limitation (AMEL): the highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

Average Weekly Effluent Limitation (AWEL): the highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

Best Management Practices (BMPs) are methods, measures, or practices designed and selected to reduce or eliminate the discharge of pollutants to surface waters from point and nonpoint source discharges including storm water. BMPs include structural and non-structural controls, and operation and maintenance procedures, which can be applied before, during, and/or after pollution producing activities.

Bioaccumulative pollutants are those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

Carcinogenic pollutants are substances that are known to cause cancer in living organisms.

Coefficient of Variation (CV) is a measure of the data variability and is calculated as the estimated standard deviation divided by the arithmetic mean of the observed values.

Criteria Continuous Concentration (CCC) equals the highest concentration of a pollutant to which aquatic life can be exposed for an extended period of time (4 days) without deleterious effects.

Criteria Maximum Concentration (CMC) equals the highest concentration of a pollutant to which aquatic life can be exposed for a short period of time without deleterious effects.

Daily Discharge: Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of one day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

Detected, but Not Quantified (DNQ) are those sample results less than the RL, but greater than or equal to the laboratory's MDL.

Dilution Credit is the amount of dilution granted to a discharge in the calculation of a water quality-based effluent limitation, based on the allowance of a specified mixing zone. It is calculated from the dilution ratio or determined through conducting a mixing zone study or modeling of the discharge and receiving water.

Dilution Ratio is the critical low flow of the upstream receiving water divided by the flow of the effluent discharged.

Effluent Concentration Allowance (ECA) is a value derived from the water quality criterion/objective, dilution credit, and ambient background concentration that is used, in conjunction with the coefficient of variation for the effluent monitoring data, to calculate a long-term average (LTA) discharge concentration. The ECA has the same meaning as waste load allocation (WLA) as used in U.S. EPA guidance (Technical Support Document For Water Quality-based Toxics Control, March 1991, second printing, EPA/505/2-90-001).

Estimated Chemical Concentration is the estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

Existing Discharger means any Discharger that is not a new Discharger. An existing Discharger includes an "increasing Discharger" (i.e., an existing facility with treatment systems in place for its current discharge that is or will be expanding, upgrading, or modifying its existing permitted discharge after the effective date of this Policy).

Infeasible means not capable of being accomplished in a successful manner within a reasonable period of time, taking into account economic, environmental, legal, social, and technological factors.

Inland Surface Waters are all surface waters of the State that do not include the ocean, enclosed bays, or estuaries.

Instantaneous Maximum Effluent Limitation: the highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

Instantaneous Minimum Effluent Limitation: the lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

Load Allocation (LA) is the portion of receiving water's total maximum daily load that is allocated to one of its nonpoint sources of pollution or to natural background sources.

Maximum Daily Flow is the maximum flow sample of all samples collected in a calendar day.

Maximum Daily Effluent Limitation (MDEL) means the highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

Median is the middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of measurements (n) is odd, then the median = $X_{(n+1)/2}$. If n is even, then the median = $(X_{n/2} + X_{(n/2)+1})/2$ (i.e., the midpoint between the $n/2$ and $n/2+1$).

Method Detection Limit (MDL) is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero, as defined in 40 CFR 136, Appendix B, revised as of May 14, 1999.

Minimum Level (ML) is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

Mixing Zone is a limited volume of receiving water that is allocated for mixing with a wastewater discharge where water quality criteria can be exceeded without causing adverse effects to the overall water body.

New Discharger includes any building, structure, facility, or installation from which there is, or may be, a discharge of pollutants, the construction of which commenced after the effective date of this Policy.

Not Detected (ND) are those sample results less than the laboratory's MDL.

Objectionable Bottom Deposits are an accumulation of materials or substances on or near the bottom of a water body, which creates conditions that adversely impact aquatic life, human health, beneficial uses, or aesthetics. These conditions include, but are not limited to, the accumulation of pollutants in the sediments and other conditions that result in harm to benthic organisms, production of food chain organisms, or fish egg development. The presence of such deposits shall be determined by RWQCB(s) on a case-by-case basis.

Persistent pollutants are substances for which degradation or decomposition in the environment is nonexistent or very slow.

Pollutant Minimization Program (PMP) means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Regional Water Board may consider cost effectiveness when establishing the requirements of a PMP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to Water Code section 13263.3(d), shall be considered to fulfill the PMP requirements.

Pollution Prevention means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as defined in Water Code Section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the SWRCB or RWQCB.

Process Optimization means minor changes to the existing facility and treatment plant operations that optimize the effectiveness of the existing treatment processes.

Public Entity includes the federal government or a state, county, city and county, city, district, public authority, or public agency.

Reporting Level (RL) is the ML (and its associated analytical method) chosen by the Discharger for reporting and compliance determination from the MLs included in this Order. The MLs included in this Order correspond to approved analytical methods for reporting a sample result that are selected by the Regional Water Board either from Appendix 4 of the SIP in accordance with section 2.4.2 of the SIP or established in accordance with section 2.4.3 of the SIP. The ML is based on the proper application of method-based analytical procedures for sample preparation and the absence of any matrix interferences. Other factors may be applied to the ML depending on the specific sample preparation steps employed. For example, the treatment typically applied in cases where there are matrix-effects is to dilute the sample or sample aliquot by a factor of ten. In such cases, this additional factor must be applied to the ML in the computation of the RL.

Source of Drinking Water is any water designated as municipal or domestic supply (MUN) in a RWQCB basin plan.

Standard Deviation (σ) is a measure of variability that is calculated as follows:

$$\sigma = (\sum[(x - \mu)^2]/(n - 1))^{0.5}$$

where:

x is the observed value;

μ is the arithmetic mean of the observed values; and

n is the number of samples.


Toxicity Reduction Evaluation (TRE) is a study conducted in a step-wise process designed to identify the causative agents of effluent or ambient toxicity, isolate the sources of toxicity, evaluate the effectiveness of toxicity control options, and then confirm the reduction in toxicity. The first steps of the TRE consist of the collection of data relevant to the toxicity, including additional toxicity testing, and an evaluation of facility operations and maintenance practices, and best management practices. A Toxicity Identification Evaluation (TIE) may be required as part of the TRE, if appropriate. (A TIE is a set of procedures to identify the specific chemical(s) responsible for toxicity. These procedures are performed in three phases (characterization, identification, and confirmation) using aquatic organism toxicity tests.)

Use Attainability Analysis is a structured scientific assessment of the factors affecting the attainment of the use which may include physical, chemical, biological and economic factors as described in 40 CFR 131.10(g) (40 CFR 131.3, revised as of July 1, 1997).


Water Effect Ratio (WER) is an appropriate measure of the toxicity of a material obtained in a site water divided by the same measure of the toxicity of the same material obtained simultaneously in a laboratory dilution water.

12-Month Running Average Effluent Limitation (12-MRAEL): the highest allowable average of monthly discharges over last twelve months, calculated as the sum of all monthly discharges measured during last twelve months divided by the number of monthly discharges measured during that time period.

ATTACHMENT B – LOCATION MAP

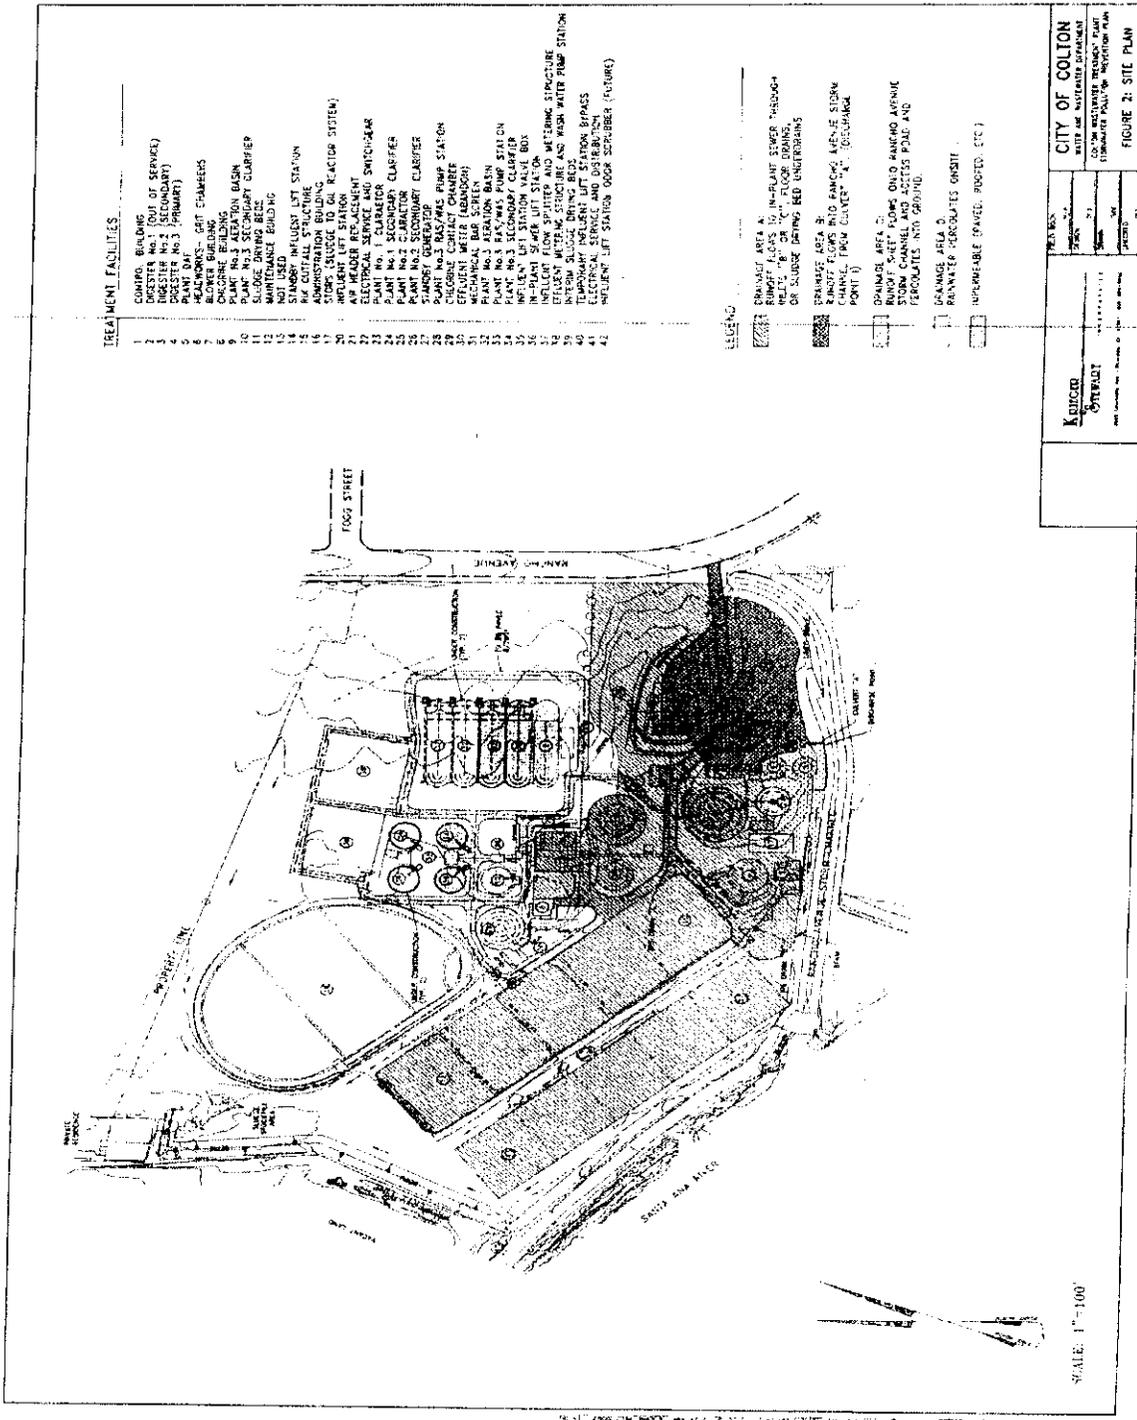

ATTACHMENT C – FLOW SCHEMATIC

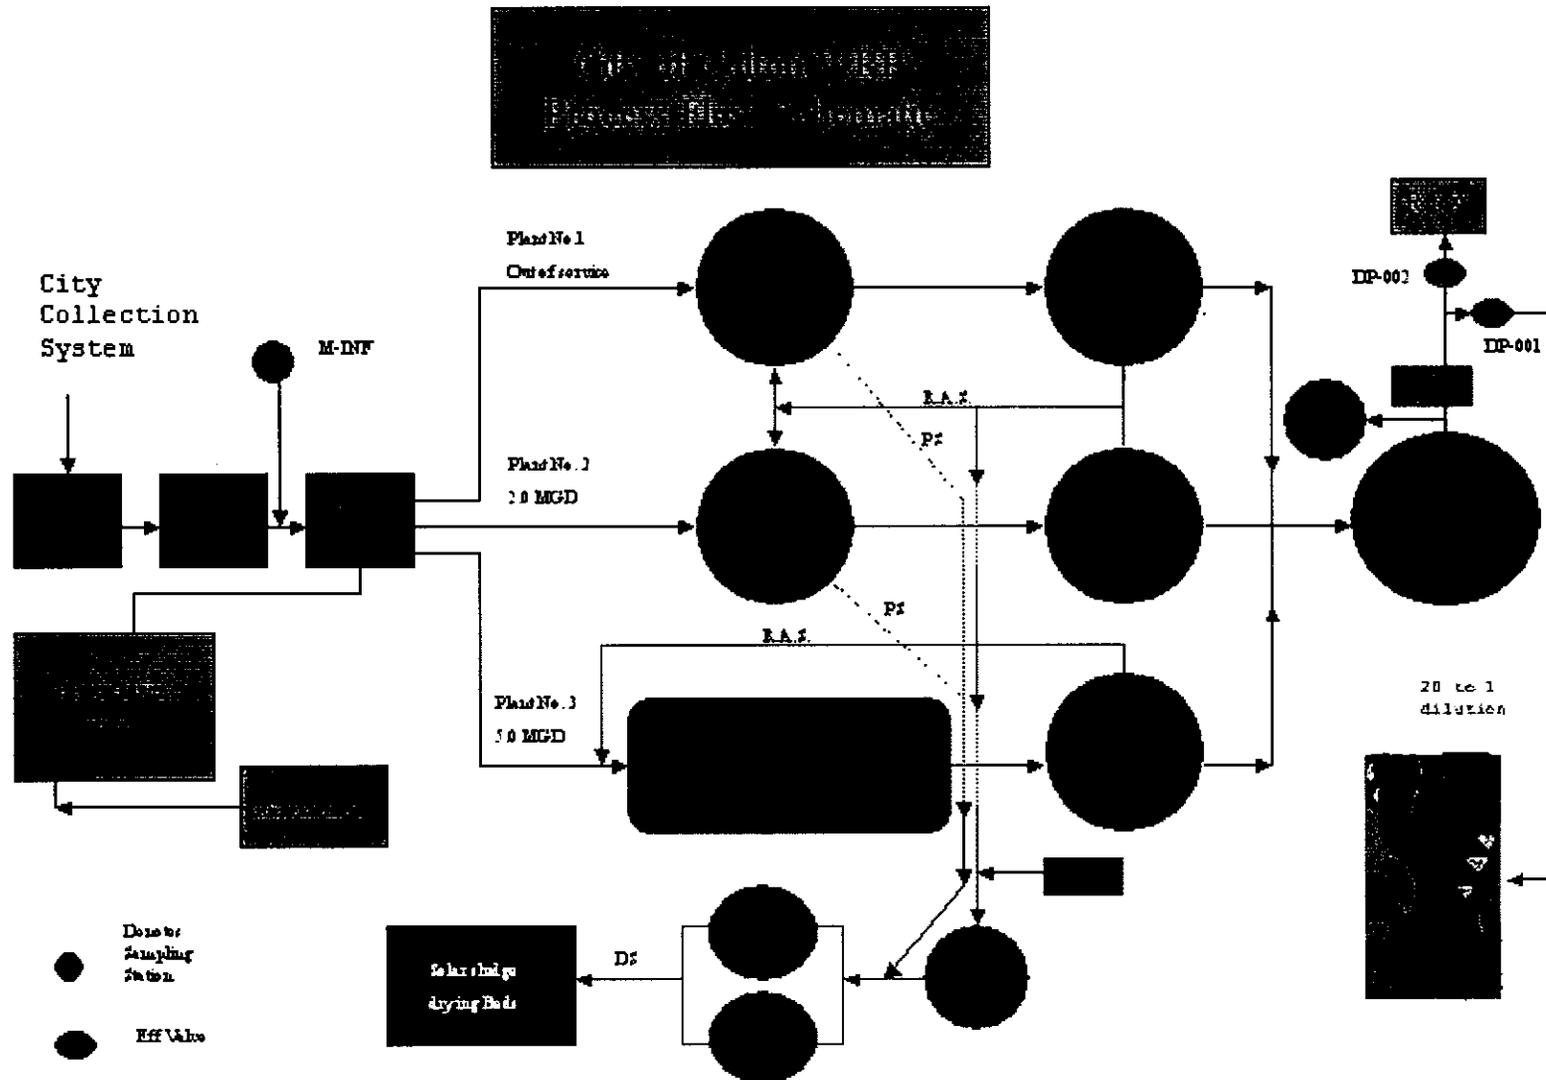

ATTACHMENT D – STANDARD PROVISIONS

I. STANDARD PROVISIONS – PERMIT COMPLIANCE

A. Duty to Comply

1. The Discharger must comply with all of the conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code (CWC) and is grounds for enforcement action, for permit termination, revocation and reissuance, or denial of a permit renewal application [40 CFR §122.41(a)].
2. The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under Section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not been modified to incorporate the requirement [40 CFR §122.41(a)(1)].

B. Need to Halt or Reduce Activity Not a Defense

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order [40 CFR §122.41(c)].

C. Duty to Mitigate

The Discharger shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment [40 CFR §122.41(d)].

D. Proper Operation and Maintenance

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order [40 CFR §122.41(e)].

E. Property Rights

1. This Order does not convey any property rights of any sort or any exclusive privileges [40 CFR §122.41(g)].
2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of State or local law or regulations [40 CFR §122.5(c)].

F. Inspection and Entry

The Discharger shall allow the Regional Water Quality Control Board (RWQCB), State Water Resources Control Board (SWRCB), United States Environmental Protection Agency (USEPA), and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to [40 CFR §122.41(i)] [CWC 13383(c)]:

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order [40 CFR §122.41(i)(1)];
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order [40 CFR §122.41(i)(2)];
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order [40 CFR §122.41(i)(3)];
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the CWC, any substances or parameters at any location [40 CFR §122.41(i)(4)].

G. Bypass

1. Definitions

- a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility [40 CFR §122.41(m)(1)(i)].
 - b. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production [40 CFR §122.41(m)(1)(ii)].
2. Bypass not exceeding limitations – The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3 and I.G.5 below [40 CFR §122.41(m)(2)].
 3. Prohibition of bypass – Bypass is prohibited, and the Regional Water Board may take enforcement action against a Discharger for bypass, unless [40 CFR §122.41(m)(4)(i)]:
 - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage [40 CFR §122.41(m)(4)(A)];

- b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance [40 CFR §122.41(m)(4)(B)]; and
 - c. The Discharger submitted notice to the Regional Water Board as required under Standard Provision – Permit Compliance I.G.5 below [40 CFR §122.41(m)(4)(C)].
4. The Regional Water Board may approve an anticipated bypass, after considering its adverse effects, if the Regional Water Board determines that it will meet the three conditions listed in Standard Provisions – Permit Compliance I.G.3 above [40 CFR §122.41(m)(4)(ii)].
5. Notice
- a. Anticipated bypass. If the Discharger knows in advance of the need for a bypass, it shall submit a notice, if possible at least 10 days before the date of the bypass [40 CFR §122.41(m)(3)(i)].
 - b. Unanticipated bypass. The Discharger shall submit notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below [40 CFR §122.41(m)(3)(ii)].

H. Upset

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation [40 CFR §122.41(n)(1)].

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of paragraph H.2 of this section are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review [40 CFR §122.41(n)(2)].
2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that [40 CFR §122.41(n)(3)]:
 - a. An upset occurred and that the Discharger can identify the cause(s) of the upset [40 CFR §122.41(n)(3)(i)];

- b. The permitted facility was, at the time, being properly operated [40 CFR §122.41(n)(3)(i)];
 - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b [40 CFR §122.41(n)(3)(iii)]; and
 - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above [40 CFR §122.41(n)(3)(iv)].
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof [40 CFR §122.41(n)(4)].

II. STANDARD PROVISIONS – PERMIT ACTION

A. General

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition [40 CFR §122.41(f)].

B. Duty to Reapply

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit [40 CFR §122.41(b)].

C. Transfers

This Order is not transferable to any person except after notice to the Regional Water Board. The Regional Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the CWC [40 CFR §122.41(l)(3)] [40 CFR §122.61].

III. STANDARD PROVISIONS – MONITORING

- A. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity [40 CFR §122.41(j)(1)].
- B. Monitoring results must be conducted according to test procedures under 40 CFR Part 136 or, in the case of sludge use or disposal, approved under 40 CFR Part 136 unless otherwise specified in 40 CFR Part 503 unless other test procedures have been specified in this Order [40 CFR §122.41(j)(4)] [40 CFR §122.44(i)(1)(iv)].

IV. STANDARD PROVISIONS – RECORDS

A. Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 CFR Part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Regional Water Board Executive Officer at any time [40 CFR §122.41(j)(2)].

B. Records of monitoring information shall include:

1. The date, exact place, and time of sampling or measurements [40 CFR §122.41(j)(3)(i)];
2. The individual(s) who performed the sampling or measurements [40 CFR §122.41(j)(3)(ii)];
3. The date(s) analyses were performed [40 CFR §122.41(j)(3)(iii)];
4. The individual(s) who performed the analyses [40 CFR §122.41(j)(3)(iv)];
5. The analytical techniques or methods used [40 CFR §122.41(j)(3)(v)]; and
6. The results of such analyses [40 CFR §122.41(j)(3)(vi)].

C. Claims of confidentiality for the following information will be denied [40 CFR §122.7(b)]:

1. The name and address of any permit applicant or Discharger [40 CFR §122.7(b)(1)]; and
2. Permit applications and attachments, permits and effluent data [40 CFR §122.7(b)(2)].

V. STANDARD PROVISIONS – REPORTING

A. Duty to Provide Information

The Discharger shall furnish to the Regional Water Board, SWRCB, or USEPA within a reasonable time, any information which the Regional Water Board, SWRCB, or USEPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Regional Water Board, SWRCB, or USEPA copies of records required to be kept by this Order [40 CFR §122.41(h)] [CWC 13267].

B. Signatory and Certification Requirements

1. All applications, reports, or information submitted to the Regional Water Board, SWRCB, and/or USEPA shall be signed and certified in accordance with paragraph (2.) and (3.) of this provision [40 CFR §122.41(k)].
2. All permit applications shall be signed as follows:
 - a. For a corporation: By a responsible corporate officer. For the purpose of this section, a responsible corporate officer means: (i) A president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy- or decision-making functions for the corporation, or (ii) the manager of one or more manufacturing, production, or operating facilities, provided, the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental laws and regulations; the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures [40 CFR §122.22(a)(1)];
 - b. For a partnership or sole proprietorship: by a general partner or the proprietor, respectively [40 CFR §122.22(a)(2)]; or
 - c. For a municipality, State, federal, or other public agency: by either a principal executive officer or ranking elected official. For purposes of this provision, a principal executive officer of a federal agency includes: (i) the chief executive officer of the agency, or (ii) a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., Regional Administrators of USEPA) [40 CFR §122.22(a)(3)].
3. All reports required by this Order and other information requested by the Regional Water Board, SWRCB, or USEPA shall be signed by a person described in paragraph (b) of this provision, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by a person described in paragraph (2.) of this provision [40 CFR §122.22(b)(1)];

- b. The authorization specified either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company (a duly authorized representative may thus be either a named individual or any individual occupying a named position) [40 CFR §122.22(b)(2)]; and
 - c. The written authorization is submitted to the Regional Water Board, SWRCB, or USEPA [40 CFR §122.22(b)(3)].
4. If an authorization under paragraph (3.) of this provision is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of paragraph (3.) of this provision must be submitted to the Regional Water Board, SWRCB or USEPA prior to or together with any reports, information, or applications, to be signed by an authorized representative [40 CFR §122.22(c)].
 5. Any person signing a document under paragraph (2.) or (3.) of this provision shall make the following certification:

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations" [40 CFR §122.22(d)].

C. Monitoring Reports

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program in this Order [40 CFR §122.41(l)(4)].
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Regional Water Board or SWRCB for reporting results of monitoring of sludge use or disposal practices [40 CFR §122.41(l)(4)(i)].
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under 40 CFR Part 136 or, in the case of sludge use or disposal, approved under 40 CFR Part 136 unless otherwise specified in 40 CFR Part 503, or as specified in this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Regional Water Board [40 CFR §122.41(l)(4)(ii)].

4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order [40 CFR §122.41(l)(4)(iii)].

D. Compliance Schedules

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date [40 CFR §122.41(l)(5)].

E. Twenty-Four Hour Reporting

1. The Discharger shall report any noncompliance that may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the Discharger becomes aware of the circumstances. A written submission shall also be provided within five (5) days of the time the Discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance [40 CFR §122.41(l)(6)(i)].
2. The following shall be included as information that must be reported within 24 hours under this paragraph [40 CFR §122.41(l)(6)(ii)]:
 - a. Any unanticipated bypass that exceeds any effluent limitation in this Order [40 CFR §122.41(l)(6)(ii)(A)].
 - b. Any upset that exceeds any effluent limitation in this Order [40 CFR §122.41(l)(6)(ii)(B)].
 - c. Violation of a maximum daily discharge limitation for any of the pollutants listed in this Order to be reported within 24 hours [40 CFR §122.41(l)(6)(ii)(C)].
3. The Regional Water Board may waive the above-required written report under this provision on a case-by-case basis if an oral report has been received within 24 hours [40 CFR §122.41(l)(6)(iii)].

F. Planned Changes

The Discharger shall give notice to the Regional Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when [40 CFR §122.41(l)(1)]:

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR §122.29(b) [40 CFR §122.41(l)(1)(i)]; or

2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in this Order nor to notification requirements under 40 CFR Part 122.42(a)(1) (see Additional Provisions—Notification Levels VII.A.1) [40 CFR §122.41(l)(1)(ii)].
3. The alteration or addition results in a significant change in the Discharger's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan [40 CFR §122.41(l)(1)(iii)].

G. Anticipated Noncompliance

The Discharger shall give advance notice to the Regional Water Board or SWRCB of any planned changes in the permitted facility or activity that may result in noncompliance with General Order requirements [40 CFR §122.41(l)(2)].

H. Other Noncompliance

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting E.3, E.4, and E.5 at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E [40 CFR §122.41(l)(7)].

I. Other Information

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Regional Water Board, SWRCB, or USEPA, the Discharger shall promptly submit such facts or information [40 CFR §122.41(l)(8)].

VI. STANDARD PROVISIONS – ENFORCEMENT

- A. The CWA provides that any person who violates section 301, 302, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any such sections in a permit issued under section 402, or any requirement imposed in a pretreatment program approved under sections 402(a)(3) or 402(b)(8) of the Act, is subject to a civil penalty not to exceed \$25,000 per day for each violation. The CWA provides that any person who negligently violates sections 301, 302, 306, 307, 308, 318, or 405 of the Act, or any condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, or any requirement imposed in a pretreatment program approved under section 402(a)(3) or 402(b)(8) of the Act, is subject to criminal penalties of \$2,500 to \$25,000 per day of violation, or imprisonment of not more than one (1) year, or both. In the case of a second or subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation, or by imprisonment of not more than two (2) years, or both. Any person who knowingly violates such sections, or such conditions or limitations is subject to criminal

penalties of \$5,000 to \$50,000 per day of violation, or imprisonment for not more than three (3) years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than six (6) years, or both. Any person who knowingly violates section 301, 302, 303, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine of not more than \$250,000 or imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the Clean Water Act, shall, upon conviction of violating the imminent danger provision, be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions [40 CFR §122.41(a)(2)] [CWC 13385 and 13387].

- B. Any person may be assessed an administrative penalty by the Regional Water Board for violating section 301, 302, 306, 307, 308, 318 or 405 of this Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of this Act. Administrative penalties for Class I violations are not to exceed \$10,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$25,000. Penalties for Class II violations are not to exceed \$10,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$125,000 [40 CFR §122.41(a)(3)].
- C. The CWA provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this permit shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than 2 years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than 4 years, or both [40 CFR §122.41(j)(5)].
- D. The CWA provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this Order, including monitoring reports or reports of compliance or noncompliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six months per violation, or by both [40 CFR §122.41(k)(2)].

VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS

A. Publicly-Owned Treatment Works (POTWs)

All POTWs shall provide adequate notice to the Regional Water Board of the following [40 CFR §122.42(b)]:

1. Any new introduction of pollutants into the POTW from an indirect Discharger that would be subject to Sections 301 or 306 of the CWA if it were directly discharging those pollutants [40 CFR §122.42(b)(1)]; and
2. Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of adoption of the Order [40 CFR §122.42(b)(2)].

Adequate notice shall include information on the quality and quantity of effluent introduced into the POTW as well as any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW [40 CFR §122.42(b)(3)].

Attachment E – Monitoring and Reporting Program

Table of Contents

I.	General Monitoring Provisions.....	E-2
II.	Monitoring Locations.....	E-6
III.	Influent Monitoring Requirements.....	E-6
	A. Monitoring Location M-INF.....	E-6
IV.	Effluent Monitoring Requirements	E-7
	A. Monitoring Location M-001	E-7
V.	Whole Effluent Toxicity Testing Requirements - Not Applicable	E-8
VI.	Land Discharge Monitoring Requirements – Not Applicable	E-8
VII.	Reclamation Monitoring Requirements – Not Applicable	E-8
VIII.	Receiving Water Monitoring Requirements – Surface Water and Groundwater	E-8
	A. Surface Water	E-8
	B. Groundwater – Not Applicable.....	E-8
IX.	Other Monitoring Requirements.....	E-8
	A. Biosolids Monitoring.....	E-8
	B. Stormwater Monitoring – Not Applicable.....	E-9
X.	Reporting Requirements.....	E-9
	A. General Monitoring and Reporting Requirements.....	E-9
	B. Self Monitoring Reports (SMRs)	E-10
	C. Discharge Monitoring Reports (DMRs)	E-12
	D. Other Reports	E-13
	E. Pretreatment Monitoring and Reporting.....	E-13

ATTACHMENT E – MONITORING AND REPORTING PROGRAM

California Water Code sections 13267 and 13383 authorize the Regional Water Board to require technical and monitoring reports. The Code of Federal Regulations (CFR) at 40 CFR 122.48 requires that all NPDES permits specify monitoring and reporting requirements. This Monitoring and Reporting Program establishes monitoring and reporting requirements that implement the state and federal regulations.

I. GENERAL MONITORING PROVISIONS

1. All sampling and sample preservation shall be in accordance with the current edition of "*Standard Methods for the Examination of Water and Wastewater*" (American Public Health Association).
2. All laboratory analyses shall be performed in accordance with test procedures under 40 CFR 136 "Guidelines Establishing Test Procedures for the Analysis of Pollutants," promulgated by the United States Environmental Protection Agency (USEPA), unless otherwise specified in this MRP. In addition, the Regional Water Board and/or USEPA, at their discretion, may specify test methods that are more sensitive than those specified in 40 CFR 136. (See also I.A.6., below)
3. Chemical, bacteriological, and bioassay analyses shall be conducted at a laboratory certified for such analyses by the California Department of Public Health in accordance with the provision of Water Code Section 13176, and must include quality assurance/quality control data with their reports, or USEPA or at laboratories approved by the Regional Water Board's Executive Officer.
4. Whenever the Discharger monitors any pollutant more frequently than is required by this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the discharge monitoring report specified by the Executive Officer.
5. In conformance with federal regulations 40 CFR 122.45(c), analyses to determine compliance with the effluent limitations for metals shall be conducted using the total recoverable method. For Chromium (VI), the dissolved method in conformance with 40 CFR 136 may be used to measure compliance with the Chromium (VI) limitation.

6. For effluent monitoring:

- a. The Discharger shall require its testing laboratory to calibrate the analytical system down to the minimum level (ML)¹ specified in Attachment "H" for priority pollutants, unless an alternative minimum level is approved by the Regional Water Board's Executive Officer. When there is more than one ML value for a given substance, the Discharger shall use the ML values, and their associated analytical methods listed in Attachment "H" that are below the effluent limitation. For analysis of priority pollutants without effluent limitations, the Discharger shall use an ML value that is below the trigger values listed in Attachment "I". If no ML value is below the effluent limitation, or the trigger value listed in Attachment "I", then the lowest ML and associated analytical method shall be used. Any internal quality control data associated with the sample must be reported when requested by the Executive Officer. The Regional Water Board will reject the quantified laboratory data if quality control data is unavailable or unacceptable.
- b. The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:
 - 1) Sample results greater than or equal to the reported ML shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
 - 2) Sample results less than the reported ML, but greater than or equal to the laboratory's current Method Detection Limit (MDL)², shall be reported as "Detected, but Not Quantified," or "DNQ." The estimated chemical concentration of the sample shall also be reported.
 - 3) Sample results not detected above the laboratory's MDL shall be reported as "not detected" or "ND."
- c. The Discharger shall submit to the Regional Water Board reports necessary to determine compliance with effluent limitations in this Order and shall follow the chemical nomenclature and sequential order of priority pollutant constituents shown in Attachment "G" – Priority Pollutant Lists. The Discharger shall report with each sample result:
 - 1) The reporting level achieved by the testing laboratory; and
 - 2) The laboratory's current MDL, as determined by the procedure found in 40 CFR 136.

¹ Minimum level is the concentration at which the entire analytical system must give a recognizable signal and acceptable point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

² MDL is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analytical concentration is greater than zero, as defined in 40 CFR 136, Appendix B, revised as of May 14, 1999.

- d. For receiving water monitoring and for those priority pollutants without effluent limitations, the Discharger shall require its testing laboratory to quantify constituent concentrations to the lowest achievable MDL as determined by the procedure found in 40 CFR 136. In situations where the most stringent applicable receiving water objective (freshwater or human health (consumption of organisms only), as specified for that pollutant in 40 CFR 131.38 is below the minimum level value specified in Attachment "H" and the Discharger cannot achieve an MDL value for that pollutant below the ML value, the Discharger shall submit justification why a lower MDL value cannot be achieved. Justification shall be submitted together with monthly monitoring reports.
7. For non-priority pollutants monitoring, all analytical data shall be reported with identification of practical quantitation levels and with method detection limits, as determined by the procedure found in 40 CFR 136.
8. The Discharger shall have, and implement, an acceptable written quality assurance (QA) plan for laboratory analyses. Duplicate chemical analyses must be conducted on a minimum of ten percent (10%) of the samples, or at least one sample per month, whichever is greater. A similar frequency shall be maintained for analyzing spiked samples. When requested by the Regional Water Board or USEPA, the Discharger will participate in the NPDES discharge monitoring report QA performance study.
9. For every item of monitoring data where the requirements are not met, the monitoring report shall include a statement discussing the reasons for noncompliance, the actions undertaken or proposed that will bring the discharge into full compliance with requirements at the earliest time, and an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Regional Water Board by letter when compliance with the time schedule has been achieved.
10. The Discharger shall assure that records of all monitoring information are maintained and accessible for a period of at least five years (this retention period supercedes the retention period specified in Section IV.A. of Attachment D) from the date of the sample, report, or application. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge or by the request of the Regional Water Board at any time. Records of monitoring information shall include:
 - a. The information listed in Attachment D- IV Standard Provisions – Records, subparagraph B. of this Order;
 - b. The laboratory which performed the analyses;
 - c. The date(s) analyses were performed;
 - d. The individual(s) who performed the analyses;
 - e. The modification(s) to analytical techniques or methods used;
 - f. All sampling and analytical results, including
 - 1) Units of measurement used;
 - 2) Minimum reporting level for the analysis (minimum level, practical quantitation level (PQL));
 - 3) Results less than the reporting level but above the method detection limit (MDL);
 - 4) Data qualifiers and a description of the qualifiers;

- 5) Quality control test results (and a written copy of the laboratory quality assurance plan);
 - 6) Dilution factors, if used; and
 - 7) Sample matrix type.
 - g. All monitoring equipment calibration and maintenance records;
 - h. All original strip charts from continuous monitoring devices;
 - i. All data used to complete the application for this Order; and,
 - j. Copies of all reports required by this Order.
 - k. Electronic data and information generated by the Supervisory Control And Data Acquisition (SCADA) System.
11. The flow measurement system shall be calibrated at least once per year or more frequently, to ensure continued accuracy.
12. All monitoring instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary to ensure their continued accuracy. In the event that continuous monitoring equipment is out of service for greater than a 24-hour period, the Discharger shall obtain a representative grab sample each day the equipment is out of service. The Discharger shall correct the cause(s) of failure of the continuous monitoring equipment as soon as practicable. In its monitoring report, the Discharger shall specify the period(s) during which the equipment was out of service and if the problem has not been corrected, shall identify the steps which the Discharger is taking or proposes to take to bring the equipment back into service and the schedule for these actions.
13. Monitoring and reporting shall be in accordance with the following:
- a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
 - b. The monitoring and reporting of influent, effluent, and sludge shall be done more frequently as necessary to maintain compliance with this Order and or as specified in this Order.
 - c. Whenever the Discharger monitors any pollutant more frequently than is required by this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the discharge monitoring report specified by the Regional Water Board's Executive Officer.
 - d. A "grab" sample is defined as any individual sample collected in less than 15 minutes.
 - e. A composite sample is defined as a combination of no fewer than eight individual grab samples obtained over the specified sampling period. The volume of each individual grab sample shall be proportional to the discharge flow rate at the time of sampling. The compositing period shall equal the specific sampling period, or 24 hours, if no period is specified.

- f. 24-hour composite samples shall be collected during a 24-hour operation of the facility.
- g. Daily samples shall be collected on each day of the week.
- h. Monthly samples shall be collected on any representative day of each month.
- i. Quarterly samples shall be collected by any representative day of January, April, July, and October.
- j. Annual samples shall be collected in accordance with the following schedule:

Year	Annual Samples
2013	October
2014	January
2015	April
2016	July
2017	October
2018	January

II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
--	M-INF	Influent line after the bar screen and before in-plant return
001	M-001	Effluent to the Santa Ana River
--	R-001D	Flow measurement location: US Army Corps of Engineers, Santa Ana River E. Street Station

III. INFLUENT MONITORING REQUIREMENTS

A. Monitoring Location M-INF

1. Sampling stations shall be established for the points of inflow to the treatment plant. The sampling station(s) shall be located upstream of any in-plant return flows and where representative sample(s) of the influent of the treatment plant can be obtained.
2. The Discharger shall monitor the influent to the facility at Monitoring Location M-INF as follows:

Parameter	Units	Sample Type	Minimum Sampling Frequency (See I.13., above)	Required Analytical Test Method
Flow	mgd	Recorder/Totalizer	Continuous	--
pH	pH Units	"	"	See Section I.2., above
Specific Conductance	µmhos/cm	"	"	"
BOD ₅	mg/l	24-Hour Composite	Daily	"
Total Suspended Solids	"	"	"	"
COD	mg/l	"	"	"
Total Inorganic Nitrogen	"	"	Monthly	"
Nitrate-Nitrogen	"	"	"	"
Total Dissolved Solids	"	"	"	"
Cyanide	"	Grab	Quarterly	"
Volatile organic portion of EPA Priority Pollutants (see Attachment G)	µg/l	"	Annually	See Sections I.2. and I.6., above
Remaining EPA Priority Pollutants (see Attachment G)	"	Composite	"	"

IV. EFFLUENT MONITORING REQUIREMENTS

A. Monitoring Location M-001

1. The Discharger shall monitor all discharges at Discharge Point 001 as follows:

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Test Method
Flow	mgd	Recorder/Totalizer	Continuous	--
pH	pH units	Grab	Daily	See Section I.2., above
Total Coliform	MPN	Grab	Daily	"
Suspended Solids	mg/l	"	"	"
BOD ₅	"	"	"	"
Total Residual Chlorine	"	"	"	"
EPA Priority Pollutants	"	"	Annually ³	See Sections I.2. and I.6., above

³ Sample shall be collected from the first discharge of each calendar year.

2. The monitoring frequency for those priority pollutants that are detected during the required annual monitoring at a concentration greater than the concentration specified for that pollutant in Attachment I after accounting for a dilution rate of 20:1 shall be accelerated to quarterly for one year. To return to the monitoring frequency specified, the Discharger shall request and receive approval from the Regional Water Board's Executive Officer or designee.

V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS - NOT APPLICABLE

VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE

VII. RECLAMATION MONITORING REQUIREMENTS – NOT APPLICABLE

VIII. RECEIVING WATER MONITORING REQUIREMENTS – SURFACE WATER AND GROUNDWATER

A. Surface Water

The Discharger shall make provisions for the measurement of the receiving water flow at a suitable location (R-001D) in the Santa Ana River and determine whether a 20:1 dilution exists at the point of discharge before discharging secondary treated effluent. A dilution of 20:1 or more is required at the point of discharge. Flow measurements shall be made prior to any direct discharge to the River and shall continue on a daily basis until the discharge is terminated.

B. Groundwater – Not Applicable

IX. OTHER MONITORING REQUIREMENTS

A. Biosolids Monitoring

1. Biosolids monitoring shall be conducted as follows:

Biosolids Monitoring	Units	Type of Sample	Minimum Frequency of Sampling & Testing
Priority Pollutants	mg/kg	Grab	Semi-annually
Moisture Content (% solid)	%	"	Quarterly

2. The Discharger shall maintain a permanent log of solids hauled away from the treatment facilities for use/disposal elsewhere, including the date hauled, the volume or weight (in dry tons), type (screening, grit, raw sludge, biosolids), application (agricultural, composting, etc), and destination. This information shall be reported annually.

B. Stormwater Monitoring – Not Applicable

X. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. Any internal quality control data associated with the sample must be reported when requested by the Executive Officer. The Regional Water Board will reject the quantified laboratory data if quality control data is unavailable or unacceptable.
3. Discharge monitoring data shall be submitted in a format acceptable by the Regional Water Board. Specific reporting format may include preprinted forms and/or electronic media. The results of all monitoring required by this Order shall be reported to the Regional Water Board, and shall be submitted in such a format as to allow direct comparison with the limitations and requirements of this order.
4. The Discharger shall tabulate the monitoring data to clearly illustrate compliance and/or noncompliance with the requirements of the Order.
5. The Discharger shall submit to the Regional Water Board reports necessary to determine compliance with effluent limitations in this Order and shall follow the chemical nomenclature and sequential order of priority pollutant constituents shown in Attachment G – Priority Pollutant Lists. The Discharger shall report with each sample result:
 - a. The minimum level achieved by the testing laboratory; and
 - b. The laboratory's current MDL, as determined by the procedure found in 40 CFR 136.
 - c. For those priority pollutants without effluent limitations, the Discharger shall require its testing laboratory to quantify constituent concentrations to the lowest achievable MDL as determined by the procedure found in 40 CFR 136. In situations where the trigger value listed in Attachment I is below the minimum level value specified in Attachment H and the Discharger cannot achieve an MDL value for that pollutant below or equal to the ML value, the Discharger shall submit justification why a lower MDL value cannot be achieved. Justification shall be submitted together with monthly monitoring reports.

6. For every item of monitoring data where the requirements are not met, the monitoring report shall include a statement discussing the reasons for noncompliance, the actions undertaken or proposed that will bring the discharge into full compliance with requirements at the earliest time, and an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Regional Water Board by letter when compliance with the time schedule has been achieved.
7. The reports for June and December shall include a roster of plant personnel, including job titles, duties, and level of State certification for each individual.
8. The Discharger shall report monitoring results for specific parameters in accordance with the following table:

Parameter	Measurement
Flow	Daily total flow
pH	Daily High and daily low
Total Residual Chlorine	Instantaneous Maximum

9. The Discharger shall file a written report with the Regional Water Board within ninety (90) days after the average dry-weather waste flow for any month equals or exceeds 75 percent of the design capacity of the waste treatment and/or disposal facilities. The Discharger's senior administrative officer shall sign a letter which transmits that report and certifies that the policy making body is adequately informed about it. The report shall include:
 - a. Average daily flow for the month, the date on which the instantaneous peak flow occurred, the rate of that peak flow, and the total flow for the day.
 - b. The Discharger's best estimate of when the average daily dry-weather flow rate will equal or exceed the design capacity of the treatment facilities.
 - c. The Discharger's intended schedule for studies, design, and other steps needed to provide additional capacity for the waste treatment and/or disposal facilities before the waste flow rate equals the capacity of present units.

B. Self Monitoring Reports (SMRs)

1. The Discharger shall submit Self-Monitoring Reports (SMRs) electronically using the State Water Board's California Integrated Water Quality System (CIWQS) Program Web site (<http://www.waterboards.ca.gov/ciwqs/index.html>). The CIWQS Web site will provide additional directions for SMR submittal in the event there will be service interruption for electronic submittal.

2. The Discharger shall report in the SMR the results for all monitoring specified in this Monitoring and Reporting Program. The Discharger shall submit monthly, quarterly, and annual SMRs including the results of all required monitoring using USEPA-approved test methods or other test methods specified in this Order. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.
3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

Sampling Frequency	Monitoring Period Begins On	Monitoring Period	SMR Due Date ⁴
Continuous	The effective date of this Order	All	Submit with monthly SMR
Daily	The effective date of this Order	(Midnight through 11:59 PM) or any 24-hour period that reasonably represents a calendar day for purposes of sampling.	Submit with monthly SMR
Weekly	The effective date of this Order	Sunday through Saturday	Submit with monthly SMR
Monthly	First day of calendar month following permit effective date or on permit date if that date is first day of the month	1 st day of calendar month through last day of calendar month	First day of the second month following the reporting period, submit as monthly SMR
Quarterly	Closest of January 1, April 1, July 1, or October 1 following permit effective date	January 1 through March 31, samples are collected in January; April 1 through June 30; samples are collected in April; July 1 through September 30; samples are collected in July; October 1 through December 31; samples are collected in October	First day of the second month following the reporting period, submit with monthly SMR
Semiannually	Closest of January 1 or July 1 following permit effective date	January 1 through June 30 July 1 through December 31	First day of the second month following the reporting period, submit with monthly SMR
Annually	The effective day of this Order	1 st day of calendar month through last day of calendar month (See Section I.A.13.j, above)	First day of the second month following the reporting period, submit with monthly SMR

4. Reporting Protocols. The Discharger shall report with each sample result the applicable Minimum Level (ML) and the current Method Detection Limit (MDL), as determined by the procedure in 40 CFR Part 136.
5. The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:
 - a. Sample results greater than or equal to the ML shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).

⁴ Should the due date fall on a weekend or holiday, the due date shall be extended to the next work day.

- b. Sample results less than the ML, but greater than or equal to the laboratory's MDL, shall be reported as "Detected, but Not Quantified," or DNQ.
 - c. Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.
 - d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.
6. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.

C. Discharge Monitoring Reports (DMRs)

- 1. At any time during the term of this permit, the State or Regional Water Board may notify the Discharger to electronically submit USEPA Discharge Monitoring Reports (DMRs). Until such notification is given, the Discharger shall submit DMRs in accordance with the requirements described below.
- 2. DMRs must be signed and certified as required by the standard provisions (Attachment D). The Discharge shall submit the original DMR and one copy of the DMR to the address listed below:

Standard Mail	FedEx/UPS/ Other Private Carriers
State Water Resources Control Board Division of Water Quality c/o DMR Processing Center PO Box 100 Sacramento, CA 95812-1000	State Water Resources Control Board Division of Water Quality c/o DMR Processing Center 1001 I Street, 15 th Floor Sacramento, CA 95814

- 3. All discharge monitoring results must be reported on the official USEPA pre-printed DMR forms (EPA Form 3320-1). Forms that are self-generated or modified cannot be accepted.

D. Other Reports – Not Applicable

E. Pretreatment Monitoring and Reporting

1. The Discharger shall submit to the Regional Water Board and the USEPA Region 9, a quarterly compliance status report. The quarterly compliance status reports shall cover the periods January 1 - March 31, April 1 - June 30, July 1 - September 30, and October 1 -December 31. Each report shall be submitted by the end of the month following the quarter, except that the report for April 1 - June 30 may be included in the annual report. This quarterly reporting requirement shall commence for the first full quarter following issuance of this Order. The reports shall identify:
 - a. All significant industrial users (SIUs) which violated any standards or reporting requirements during that quarter;
 - b. The violations committed (distinguish between categorical and local limits);
 - c. The enforcement actions undertaken; and
 - d. The status of active enforcement actions from previous periods, including closeouts (facilities under previous enforcement actions which attained compliance during the quarter).

2. Annually, the Discharger shall submit a report to the Regional Water Board, the State Water Board and the USEPA Region 9 describing the pretreatment activities within the service area during the previous year. In the event that any control authority within the service area is not in compliance with any conditions or requirements of this Order or their approved pretreatment program (such as due to industrial user discharges, interjurisdictional agency agreement implementation issues, or other causes,) then the Discharger shall also include the reasons for non-compliance and state how and when the Discharger and the control authority shall comply with such conditions and requirements. This annual report shall cover operations from July 1 through June 30 of each fiscal year and is due on September 1 of each year. The report shall contain, but not be limited to, the following information:

- a. A summary of analytical results from representative, flow-proportioned, 24-hour composite sampling of the POTW's influent and effluent wastewaters for those pollutants which are known or suspected to be discharged by industrial users (IUs) as identified by USEPA under Section 307(a) of the CWA. The summary will include the result of annual full priority pollutant scan, with quarterly samples analyzed only for those pollutants⁵ detected in the full scan. The Discharger shall also provide any influent or effluent monitoring data for non-priority pollutants which the Discharger believes may be causing or contributing to Interference, Pass Through or adversely impacting sludge quality. Sampling and analysis shall be performed in accordance with the techniques prescribed in 40 CFR 136 and amendments thereto.
- b. A discussion of any upset, interference, or pass-through incidents at the treatment plant (if any), which the Discharger knows or suspects were caused by IUs of the POTW system. The discussion shall include the following:
 - 1) The reasons why the incidents occurred, the corrective actions taken, and, if known, the name and address of the IU(s) responsible.
 - 2) A review of the applicable pollutant limitations to determine whether any additional limitations, or changes to existing requirements, may be necessary to prevent pass through, interference or noncompliance with sludge disposal requirements.
- c. A complete and updated list of the Discharger's significant industrial users (SIUs), including names, Standard Industrial Classification (SIC) code(s) and addresses, and a list of any SIU deletions and/or additions. The Discharger shall provide a brief explanation for each deletion. The SIU list shall identify the SIUs subject to Federal Categorical Standards by specifying which set(s) of standards are applicable to each SIU. The list shall also indicate which SIUs are subject to local limitations more stringent than Federal Categorical Standards and those which are not subject to local limits.
- d. A list or table characterizing the industrial compliance status of each SIU, including:
 - 1) SIU name;
 - 2) Industrial category;
 - 3) The type (processes) of wastewater treatment in place;
 - 4) Number of samples taken by the POTW during the year;
 - 5) Number of samples taken by the SIU during the year;
 - 6) Whether all needed certifications (if allowed) were provided by SIUs which have limits for total toxic organics;
 - 7) Federal and Regional Standards violated during the year, reported separately;

⁵ *The Discharger is not required to analyze for asbestos.*

- 8) Whether the SIU at any time in the year was in Significant Noncompliance (SNC)⁶, as defined by 40 CFR 403.12 (f)(2)(vii); and
 - 9) A summary of enforcement actions against the SIU taken during the year, including the type of action, final compliance date, and amount of fines assessed/collected (if any). Proposed actions, if known, should be included.
 - 10) Number of inspections conducted at each SIU during the year.
- e. A compliance summary table which includes:
- 1) SIU's which were in SNC at any time during the year;
 - 2) The total number of SIUs which are in SNC with pretreatment compliance schedules during the year;
 - 3) The total number of notices of violation and administrative orders issued against SIUs during the year;
 - 4) The total number of civil and criminal judicial actions filed against SIUs during the year;
 - 5) The number of SIUs which were published as being in SNC during the year; and
 - 6) The number of IUs from which penalties were collected during the year.
- f. A short description of any significant changes in operating the pretreatment program which differ from the previous year including, but not limited to changes concerning:
- 1) The program's administrative structure;
 - 2) Local industrial discharge limitations;
 - 3) Monitoring program or monitoring frequencies;
 - 4) Legal authority or enforcement policy;
 - 5) Funding mechanisms; and
 - 6) Resource requirements and/or staffing levels.
- g. A summary of the annual pretreatment budget, including the cost of pretreatment program functions and equipment purchases.
- h. A summary of public participation activities to involve and inform the public.
- i. A description of any changes in sludge disposal methods and a discussion of any concerns not described elsewhere in the report.
3. The cumulative number of industrial users that the Discharger has notified regarding Baseline Monitoring Reports and the cumulative number of industrial user responses.
 4. The Discharger shall submit the quarterly compliance status reports and the annual pretreatment report to USEPA Region 9, the State Water Board and the Regional Water Board.

⁶ SNC is determined at the beginning of each quarter based on data of the previous six months.

ATTACHMENT F – FACT SHEET

TABLE OF CONTENTS

I.	Permit Information	F-2
II.	Facility Description.....	F-3
	A. Description of Wastewater and Biosolids Treatment or Controls	F-3
	B. Discharge Points and Receiving Waters.....	F-3
	C. Compliance Summary.....	F-3
III.	Applicable Plans, Policies, and Regulations.....	F-4
	A. Legal Authorities	F-4
	B. California Environmental Quality Act (CEQA).....	F-4
	C. State and Federal Regulations, Policies, and Plans	F-4
	D. Impaired Water Bodies on CWA 303(d) List.....	F-6
IV.	Rationale For Effluent Limitations and Discharge Specifications.....	F-7
	A. Discharge Prohibitions	F-7
	B. Technology-Based Effluent Limitations.....	F-7
	1. Scope and Authority.....	F-7
	2. Applicable Technology-Based Effluent Limitations	F-8
	C. Water Quality-Based Effluent Limitations (WQBELs).....	F-8
	1. Scope and Authority.....	F-8
	2. Applicable Beneficial Uses and Water Quality Criteria and Objectives.....	F-8
	3. Determining the Need for WQBELs	F-9
V.	Rationale for Receiving Water Limitations.....	F-9
	A. Surface Water.....	F-9
	B. Groundwater – Not Applicable.....	F-9
VI.	Rationale for Monitoring and Reporting Requirements.....	F-9
	A. Influent Monitoring	F-10
	B. Effluent Monitoring.....	F-10
	C. Whole Effluent Toxicity Testing Requirements.....	F-10
	D. Receiving Water Monitoring.....	F-10
	1. Surface Water	F-10
	2. Groundwater – Not applicable.....	F-10
	E. Other Monitoring Requirements.....	F-10
VII.	Rationale for Provisions.....	F-11
	A. Standard Provisions.....	F-11
	B. Special Provisions.....	F-11
VIII.	Public Participation	F-12
	A. Notification of Interested Parties	F-12
	B. Written Comments	F-13
	C. Public Hearing.....	F-13
	D. Waste Discharge Requirements Petitions.....	F-13
	E. Information and Copying.....	F-14
	F. Register of Interested Persons.....	F-14
	G. Additional Information	F-14

Attachment F – Fact Sheet

As described in Section II of this Order, this Fact Sheet includes the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

I. PERMIT INFORMATION

The following table summarizes administrative information related to the Facility:

WDID	8 360105001
Discharger	City of Colton
Mailing Address	150 S. 10 th Street, Colton, CA 92324
Name of Facility	City of Colton Water Reclamation Facility
Facility Address	1201 S. Rancho , Colton, CA 92324
Facility Contact, Title and Phone	Martin Guerrero, Chief Operator, (909) 370-5599
Type of Facility	Publicly Owned Treatment Works
Major or Minor Facility	Major
Facility Design Flow	10.4 mgd
Watershed	Santa Ana River
Receiving Water	Santa Ana River, Reach 4
Receiving Water Type	Freshwater River

The City of Colton (hereinafter Discharger) is the owner and operator of the City of Colton Water Reclamation Facility (hereinafter Facility), a secondary treatment facility.

The Facility occasionally discharges secondary treated and disinfected wastewater to Reach 4 of the Santa Ana River when at least 20:1 dilution is provided by the River. The discharge is currently regulated by Order No. R8-2005-0075, NPDES No. CA0105236, which was adopted on September 30, 2005 and expired on September 1, 2010. The Discharger filed a report of waste discharge and submitted an application for renewal of its Waste Discharge Requirements (WDRs) and National Pollutant Discharge Elimination System (NPDES) permit on March 18, 2010. Since the Discharger filed a timely application for renewal of its permit, the terms and conditions of Order No. R8-2005-0075 have been automatically continued and remain in effect until new WDRs, which also serve as an NPDES permit, are adopted pursuant to this Order. This Order rescinds and supersedes Order No. R8-2005-0075.

II. FACILITY DESCRIPTION

A. Description of Wastewater and Biosolids Treatment or Controls

The Facility is a secondary treatment plant located at 1201 South Rancho Avenue, in the City of Colton. The Facility treats domestic, commercial, and industrial wastes generated within the Cities of Colton and Grand Terrace and unincorporated areas of San Bernardino County. The Facility services a population of about 65,000. Attachment B provides a map of the area around the Facility.

The Facility has a design capacity of 10.4 mgd¹ for secondary treatment and disinfection. The treatment systems consist of screening, grit removal, primary clarification, secondary activated sludge, oxidation ditch with nitrification and denitrification, secondary clarification, and chlorination. The plant schematic in Attachment C depicts how flows are split through two different treatment trains (activated sludge and oxidation ditch). Attachment C provides a flow schematic of the different treatment trains at the Facility.

Normally, effluent from the Facility is directed to the Colton/San Bernardino Regional Tertiary Treatment and Water Reclamation Agency's Rapid Infiltration and Extraction Facility for further treatment and disposal. Intermittently, the secondary treated and disinfected wastewater is discharged at Discharge Point 001 to Reach 4 of the Santa Ana River. These discharges occur only when there is sufficient flow in the River to provide 20:1 or more dilution. Although there was sufficient flow in the River to allow a discharge occasionally, no such discharges occurred throughout the duration of the previous Order.

Sludge treatment consists of dissolved air floatation, primary and secondary anaerobic digestion, and dewatering. The sludge is disposed of at a designated landfill site.

All on-site storm water flows from the Facility, except a small area adjacent to the administrative building, are routed to the headworks for treatment. Since there is no industrial activity-related stormwater runoff from the Facility, stormwater requirements and monitoring are not included in this Order.

B. Discharge Points and Receiving Waters

The Facility is located in the southeast portion of Section 30, T1S, R4W, SBB&M. The Discharger discharges secondary treated and disinfected wastewater under conditions of 20:1 or more dilution into Reach 4 of the Santa Ana River via Discharge Point 001, located at latitude 34° 02' 45" N and longitude 117° 21' 00" W.

C. Compliance Summary

The Discharger has been in compliance with effluent limitations and reporting requirements specified in Order No. R8-2004-0075.

¹ Estimated annualized average based on dry weather conditions.

III. APPLICABLE PLANS, POLICIES, AND REGULATIONS

The requirements contained in the proposed Order are based on the requirements and authorities described in this section.

A. Legal Authorities

This Order is issued pursuant to Chapter 5.5, Division 7 of the California Water Code (commencing with Section 13370) and section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (USEPA). This Order also serves as WDRs pursuant to Article 4, Chapter 4, Division 7 of the California Water Code (commencing with Section 13260). This Order shall also serve as a NPDES permit for point source discharges from this Facility to surface waters.

B. California Environmental Quality Act (CEQA)

Under Water Code Section 13389, this action to adopt waste discharge requirements that will serve as a NPDES permit is exempt from the provisions of CEQA, Public Resources Code Section 21100 through 21177.

This action also involves the re-issuance of waste discharge requirements for an existing facility that discharges treated wastewater to land and as such, is exempt from the provisions of the California Environmental Quality Act (commencing with Section 21100) pursuant to Title 14 of the California Code of Regulations, Section 15301.

C. State and Federal Regulations, Policies, and Plans

1. Water Quality Control Plans. The Regional Water Quality Control Board, Santa Ana Region (Regional Water Board) adopted a Water Quality Control Plan for the Santa Ana Basin (hereinafter Basin Plan) that became effective on January 24, 1995. The Basin Plan designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, State Water Resources Control Board (State Water Board) Resolution No. 88-63 (Sources of Drinking Water Policy) requires that, with certain exceptions, the Regional Water Board assign the municipal and domestic water supply use to water bodies. Based on the exception criteria specified in Resolution No. 88-63, the Regional Water Board excepted Reach 5 of the Santa Ana River downstream of Orange Avenue (Redlands), and further downstream reaches from the municipal and domestic supply beneficial use.

On January 22, 2004, the Regional Water Board adopted Resolution No. R8 2004 0001, amending the Basin Plan to incorporate revised boundaries for groundwater subbasins, now termed "management zones", new nitrate-nitrogen and TDS objectives for the new management zones, and new nitrogen and TDS management strategies applicable to both surface and ground waters. The State Water Board and Office of Administrative Law approved the N/TDS Amendment on September 30, 2004 and December 23, 2004, respectively. Effluent limitations for TDS and TIN in this Order are based on N and TDS wasteload allocations included in the N/TDS Amendment and are at least as stringent as the limits in the prior Order.

As previously discussed, the Facility discharges into Reach 4 of the Santa Ana River and affects downstream receiving waters. The beneficial uses of these affected waterbodies are as follows:

Discharge Point	Receiving Water Name	Beneficial Uses
001 and S 001	Reach 4 of the Santa Ana River	Warm freshwater habitat (WARM), wildlife habitat (WILD), ground water recharge (GWR), hydropower generation, water contact recreation (REC-1), and non-contact water recreation (REC-2) Excepted from municipal and domestic supply (MUN)
	Downstream Reaches of the Santa Ana River	Agricultural supply (AGR); warm freshwater habitat (WARM); wildlife habitat (WILD); ground water recharge (GWR); hydropower generation, water contact recreation (REC-1); non-contact water recreation (REC-2); and rare, threatened, or endangered species (RARE). Excepted from municipal and domestic supply (MUN)

- 2. National Toxics Rule (NTR) and California Toxics Rule (CTR).** USEPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995 and November 9, 1999. About forty criteria in the NTR applied in California. On May 18, 2000, USEPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on February 13, 2001. These rules contain water quality criteria for priority pollutants.
- 3. State Implementation Policy.** On March 2, 2000, the State Water Board adopted the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (State Implementation Policy or SIP). The SIP became effective on April 28, 2000 with respect to the priority pollutant criteria promulgated for California by the USEPA through the NTR and to the priority pollutant objectives established by the Regional Water Board in the Basin Plan. The SIP became effective on May 18, 2000 with respect to the priority pollutant criteria promulgated by the USEPA through the CTR. The State Water Board adopted amendments to the SIP on February 24, 2005 that became effective on July 13, 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.

4. **Antidegradation Policy.** 40 CFR 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies. The permitted discharge must be consistent with the antidegradation provision of 40 CFR 131.12 and State Water Board Resolution No. 68-16.
5. **Anti-Backsliding Requirements.** Sections 402(o)(2) and 303(d)(4) of the CWA and 40 CFR 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed. All effluent limitations in this Order are at least as stringent as the effluent limitations in the previous Order.
6. **Monitoring and Reporting Requirements.** Sections 13267 and 13383 of the CWC authorize the Regional Water Board to require technical and monitoring reports. 40 CFR 122.48 requires that all NPDES permits specify requirements for recording and reporting monitoring results. The Monitoring and Reporting Program (MRP) establishes monitoring and reporting requirements to implement State and federal requirements. This MRP is provided in Attachment E.
7. **Pretreatment:** This Order contains requirements for the implementation of an effective pretreatment program pursuant to Section 307 of the Federal Clean Water Act; 40 CFR, Parts 35 and 403; and/or Section 2233, Title 23, California Code of Regulations. The Discharger has established an approved regional pretreatment program. The approved pretreatment program and its components, and control mechanisms, among others, are an enforceable condition of this Order.
8. **Biosolids:** On February 19, 1993, the USEPA issued a final rule for the use and disposal of sewage sludge, 40 CFR, Part 503. This rule requires that producers of sewage sludge meet certain reporting, handling, and disposal requirements. The State of California has not been delegated the authority to implement this program, therefore, the USEPA is the implementing agency.

D. Impaired Water Bodies on CWA 303(d) List

Reach 4 of the Santa Ana River is included in the USEPA approved 2010 CWA 303(d) list due to pathogen indicators. However, "unknown nonpoint sources" are believed to be the cause; not discharges from wastewater treatment facilities. Nevertheless, this Order requires that the wastewater discharged from the Facility be essentially free of pathogens/pathogen indicators after 20:1 dilution occurs.

IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

The CWA requires point source discharges to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States. The control of pollutants discharged is established through effluent limitations; and other requirements in NPDES permits. There are two principal bases for effluent limitations: 40 CFR 122.44(a) requires that permits include applicable technology-based limitations and standards; and 40 CFR 122.44(d) requires that permits include water quality-based effluent limitations to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water. Where numeric water quality objectives have not been established, three options exist to protect water quality: 1) 40 CFR 122.44(d) specifies that water quality-based effluent limits (WQBELs) may be established using USEPA criteria guidance under CWA section 304(a); 2) proposed State criteria or a State policy interpreting narrative criteria supplemented with other relevant information may be used; or 3) an indicator parameter may be established.

A. Discharge Prohibitions

The discharge prohibitions are based on the Federal Clean Water Act, Basin Plan, State Water Control Board plans and policies, USEPA guidance and regulations, and the previous waste discharge requirements, Order No. R8-2005-0074, and are consistent with the requirements set for other discharges regulated by waste discharge requirements adopted by the Regional Water Board.

B. Technology-Based Effluent Limitations

1. Scope and Authority

Section 301(b) of the CWA and implementing USEPA permit regulations at 40 CFR 122.44 require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Secondary Treatment Standards at 40 CFR Part 133 and/or Best Professional Judgment (BPJ) in accordance with 40 CFR 125.3.

Regulations promulgated in 40 CFR 125.3(a)(1) require technology-based effluent limitations for municipal dischargers to be placed in waste discharge requirements based on Secondary Treatment Standards or Equivalent to Secondary Treatment Standards.

The Federal Water Pollution Control Act Amendments of 1972 (PL 92-500) established the minimum performance requirements for POTWs [defined in Section 304(d)(1)]. Section 301(b)(1)(B) of that Act requires that such treatment works must, as a minimum, meet effluent limitations based on secondary treatment as defined by the USEPA Administrator. Based on this statutory requirement, USEPA developed secondary treatment regulations, which are specified in 40 CFR Part 133. These technology-based regulations apply to all municipal wastewater treatment plants and identify the minimum

level of effluent quality attainable by secondary treatment in terms of biochemical oxygen demand (BOD5) and total suspended solids (TSS).

2. Applicable Technology-Based Effluent Limitations

The following summarizes the technology-based effluent limits specified in the Order:

Parameter	Effluent Limitations		
	Average Monthly (mg/L)	Average Weekly (mg/L)	Average Monthly Removal Rate %
Biochemical Oxygen Demand 5-day @ 20°C	30	45	85
Total Suspended Solids	30	45	85

C. Water Quality-Based Effluent Limitations (WQBELs)

1. Scope and Authority

As specified in 40 CFR 122.44(d)(1)(i), permits are required to include WQBELs for pollutants (including toxicity) that are or may be discharged at levels that cause, have reasonable potential to cause, or contribute to an excursion above any state water quality standard. The process for determining reasonable potential and calculating WQBELs when necessary is intended to protect the designated uses of the receiving water as specified in the Basin Plan, and achieve applicable water quality objectives and criteria that are contained in other state plans and policies, or water quality criteria contained in the CTR and NTR.

2. Applicable Beneficial Uses and Water Quality Criteria and Objectives

- a. **The Basin Plan.** The table in section III.C., above, lists the beneficial uses of the receiving waters affected by the discharge. The Basin Plan specifies narrative and numeric water quality objectives for all inland surface waters, including the Santa Ana River.
- b. **NTR, CTR and SIP.** The National Toxics Rule, California Toxics Rule (CTR), and State Implementation Policy specify numeric objectives for toxic substances and the procedures whereby these objectives are to be implemented. The procedures include those used to conduct reasonable potential analysis to determine the need for effluent limitations for priority and non-priority pollutants.

3. Determining the Need for WQBELs

As previously discussed, the Discharger is permitted to directly discharge secondary treated wastewater to Reach 4 of the Santa Ana River when 20:1 dilution is provided by the River. The Discharger implements an effective pretreatment program. Because of the effective pretreatment program conducted by the Discharger, the Facility discharges a quality of secondary treated and disinfected wastewater when diluted at 20:1 that does not have the reasonable potential to adversely impact receiving water quality for most constituents. Consequently, there are no WQBELs for priority pollutants in this Order. However, this Order requires the Discharger to conduct a priority pollutant scan once annually. This Order also requires the Discharger to conduct accelerated monitoring for those constituents that are detected in the annual priority pollutant scan at a concentration greater than the trigger levels specified in Attachment I of this Order, after accounting for a dilution rate of 20:1. The accelerated monitoring will be quarterly for one year.

The California Department of Public Health has determined that public health and water contact recreation (REC-1) beneficial uses will be protected provided that at least a 20:1 dilution of secondary treated and disinfected wastewater by natural receiving waters is achieved ("Wastewater Disinfection Guidelines Feb. 1987; these guidelines are based on sound science and are widely used as guidance to assure public health and beneficial use protection). Based on best professional judgment of the effluent limitations necessary to prevent nuisance and to assure public health and REC-1 use protection, it is necessary and appropriate to implement these guidelines in this Order. Consequently, this Order specifies that the weekly average total coliform concentration in the discharge does not exceed a median of 23 per 100 ml.

V. RATIONALE FOR RECEIVING WATER LIMITATIONS

A. Surface Water

Because the discharges from the Facility are intermittent and generally result during storm events, it is not practical or necessary to specify receiving water limitations in this Order.

B. Groundwater – Not Applicable.

VI. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS

Sections 13267 and 13383 of the CWC authorize the Regional Water Boards to require technical and monitoring reports. 40 CFR 122.48 also requires all NPDES permits to specify recording and reporting of monitoring results. The Monitoring and Reporting Program (MRP), Attachment E of this Order, establishes monitoring and reporting requirements to implement federal and State requirements. The following provides the rationale for the monitoring and reporting requirements contained in the MRP for this facility.

A. Influent Monitoring

This Order carries forward the treatment plant influent monitoring requirements specified in the previous Order without change. Influent monitoring is required to help determine the effectiveness of the pretreatment program and assess treatment plant performance.

B. Effluent Monitoring

The Discharger is required to conduct monitoring of the permitted discharges in order to evaluate compliance with permit conditions. Pollutants to be monitored include all pollutants for which effluent limitations are specified. Further, in accordance with Section 1.3 of the SIP, periodic monitoring is required at DP 001 for all priority pollutants defined by the CTR, for which criteria apply and for which no effluent limitations have been established, to evaluate reasonable potential to cause or contribute to an excursion above a water quality standard.

This Order continues the monitoring requirements specified in the previous Order, with some modifications. This Order requires the Discharger to conduct accelerated monitoring for those constituents that are detected in the annual priority pollutant scan.

C. Whole Effluent Toxicity Testing Requirements

Due to the intermittent frequency and 20:1 dilution conditions of the discharge, it is not practical or necessary to include toxicity effluent limits and requirements in the Order.

D. Receiving Water Monitoring

1. Surface Water

The Order requires the Discharger to establish a sampling station(s) at a suitable location(s) where the flow² in the River at the point of discharge can be determined. The Order also requires flow measurements to be made prior to any direct discharge to the River and daily measurements to be made until the discharge is terminated.

2. Groundwater – Not applicable.

E. Other Monitoring Requirements

- 1. Biosolids Monitoring** - This Order continues the monitoring requirements specified in Order No. R8-2005-0075.
- 2. Pretreatment Monitoring** - These monitoring and reporting requirements are established pursuant to 40 CFR 403 regulations.

² Exclusive of discharges to surface waters from upstream publicly owned treatment works.

VII. RATIONALE FOR PROVISIONS

A. Standard Provisions

Standard Provisions, which apply to all NPDES permits in accordance with 40 CFR 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 CFR 122.42, are provided in Attachment D.

40 CFR 122.41(a)(1) and (b) through (n) establish conditions that apply to all State-issued NPDES permits. These conditions must be incorporated into the permits either expressly or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. 40 CFR 123.25(a)(12) allows the state to omit or modify conditions to impose more stringent requirements. In accordance with 40 CFR 123.25, this Order omits federal conditions that address enforcement authority specified in 40 CFR 122.41(j)(5) and (k)(2) because the enforcement authority under the California Water Code is more stringent. In lieu of these conditions, this Order incorporates by reference Water Code section 13387(e).

B. Special Provisions

1. Reopener Provisions

The reopener provisions are based on 40 CFR 122.44(c) and Part 123. The Regional Water Board may reopen the permit to modify permit conditions and requirements. Causes for modifications include the promulgation of new regulations, modification in sludge use or disposal practices, or adoption of new regulations by the State or Regional Water Boards, including revisions to the Basin Plan.

2. Best Management Practices and Pollution Prevention

These requirements are based on the SIP Section 2.4.5.1.

3. Construction, Operation, and Maintenance Specifications

These requirements are based on requirements that were specified in the prior Order and industry standards.

4. Special Provisions for Municipal Facilities

The State Water Board issued General Waste Discharge Requirements for Sanitary Sewer Systems, Order No. 2006-0003-DWQ on May 2, 2006. The General Order requires public agencies that own or operate sanitary sewer systems with greater than one mile of pipes or sewer lines to enroll for coverage under the General Order. The General Order requires agencies to develop sanitary sewer management plans (SSMPs) and report all sanitary sewer overflows (SSOs), among other requirements and prohibitions.

Furthermore, the General Order contains requirements for operation and maintenance of collection systems and for reporting and mitigating sanitary sewer overflows. Inasmuch that the Discharger's collection system is part of the system that is subject to this Order, certain standard provisions are applicable as specified in Provisions, section VI.C.5. For instance, the 24-hour reporting requirements in this Order are not included in the General Order. The Discharger must comply with both the General Order and this Order. The Discharger and public agencies that are discharging wastewater into the facility were required to obtain enrollment for regulation under the General Order.

On February 19, 1993, the USEPA issued a final rule for the use and disposal of sewage sludge, 40 CFR, Part 503. This rule requires that producers of sewage sludge meet certain reporting, handling, and disposal requirements. The State has not been delegated the authority to implement this program, therefore, the USEPA is the implementing agency.

VIII. PUBLIC PARTICIPATION

The California Regional Water Quality Control Board, Santa Ana Region is considering the issuance of waste discharge requirements (WDRs) that will serve as a National Pollutant Discharge Elimination System (NPDES) permit for the City of Colton Water Reclamation Facility. As a step in the WDR adoption process, the Regional Water Board staff has developed tentative WDRs. The Regional Water Board encourages public participation in the WDR adoption process.

A. Notification of Interested Parties

The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Notification was provided through the posting of Notice of Public Hearing in the area of the discharge and publication in the local newspaper and at the Regional Water Board website.

B. Written Comments

The staff determinations are tentative. Interested persons are invited to submit written comments concerning these tentative WDRs. Comments should be submitted either in person or by mail to the Executive Officer at the Regional Water Board at the address above on the cover page of this Order.

To be fully responded to by staff and considered by the Regional Water Board, written comments should be received at the Regional Water Board offices by 5:00 p.m. on November 21, 2012.

C. Public Hearing

The Regional Water Board will hold a public hearing on the tentative WDRs during its regular Board meeting on the following date and time and at the following location:

Date: December 14, 2012
Time: 9:00 A.M.
Location: City of Council Chambers of Loma Linda
25541 Barton Road
Loma Linda, CA 92354

Interested persons are invited to attend. At the public hearing, the Regional Water Board will hear testimony, if any, pertinent to the discharge, WDRs, and permit. Oral testimony will be heard; however, for accuracy of the record, important testimony should be in writing.

Please be aware that dates and venues may change. The meeting agenda, that may contain changes to the dates and locations, can be accessed at the Regional Water Boards web address: <http://www.waterboards.ca.gov/santaana>.

D. Waste Discharge Requirements Petitions

Any aggrieved person may petition the State Water Board to review the decision of the Regional Water Board regarding the final WDRs. The petition must be submitted within 30 days of the Regional Water Board's action to the following address:

State Water Resources Control Board
Office of Chief Counsel
P.O. Box 100, 1001 I Street
Sacramento, CA 95812-0100

E. Information and Copying

The Report of Waste Discharge, related documents, tentative effluent limitations and special provisions, comments received, and other information are on file and may be inspected at the address above at any time between 9:00 a.m. and 3:00 p.m. Monday through Friday. Copying of documents may be arranged through the Regional Water Board by calling (951) 782-4130.

F. Register of Interested Persons

Any person interested in being placed on the mailing list for information regarding the WDRs and NPDES permit should contact the Regional Water Board, reference this facility, and provide a name, address, and phone number.

G. Additional Information

Requests for additional information or questions regarding this Order should be directed to Najah N. Amin at (951) 320-6362.

ATTACHMENT G - USEPA PRIORITY POLLUTANT LIST

EPA PRIORITY POLLUTANT LIST		
Metals	Acid Extractibles	Base/Neutral Extractibles (continuation)
1. Antimony	45. 2-Chlorophenol	91. Hexachloroethane
2. Arsenic	46. 2,4-Dichlorophenol	92. Indeno (1,2,3-cd) Pyrene
3. Beryllium	47. 2,4-Dimethylphenol	93. Isophorone
4. Cadmium	48. 2-Methyl-4,6-Dinitrophenol	94. Naphthalene
5a. Chromium (III)	49. 2,4-Dinitrophenol	95. Nitrobenzene
5b. Chromium (VI)	50. 2-Nitrophenol	96. N-Nitrosodimethylamine
6. Copper	51. 4-Nitrophenol	97. N-Nitrosodi-N-Propylamine
7. Lead	52. 3-Methyl-4-Chlorophenol	98. N-Nitrosodiphenylamine
8. Mercury	53. Pentachlorophenol	99. Phenanthrene
9. Nickel	54. Phenol	100. Pyrene
10. Selenium	55. 2, 4, 6 - Trichlorophenol	101. 1,2,4-Trichlorobenzene
11. Silver	Base/Neutral Extractibles	Pesticides
12. Thallium	56. Acenaphthene	102. Aldrin
13. Zinc	57. Acenaphthylene	103. Alpha BHC
Miscellaneous	58. Anthracene	104. Beta BHC
14. Cyanide	59. Benzidine	105. Delta BHC
15. Asbestos (not required unless requested)	60. Benzo (a) Anthracene	106. Gamma BHC
16. 2,3,7,8-Tetrachlorodibenzo-P-Dioxin (TCDD)	61. Benzo (a) Pyrene	107. Chlordane
Volatile Organics	62. Benzo (b) Fluoranthene	108. 4, 4' - DDT
17. Acrolein	63. Benzo (g,h,i) Perylene	109. 4, 4' - DDE
18. Acrylonitrile	64. Benzo (k) Fluoranthene	110. 4, 4' - DDD
19. Benzene	65. Bis (2-Chloroethoxy) Methane	111. Dieldrin
20. Bromoform	66. Bis (2-Chloroethyl) Ether	112. Alpha Endosulfan
21. Carbon Tetrachloride	67. Bis (2-Chloroisopropyl) Ether	113. Beta Endosulfan
22. Chlorobenzene	68. Bis (2-Ethylhexyl) Phthalate	114. Endosulfan Sulfate
23. Chlorodibromomethane	69. 4-Bromophenyl Phenyl Ether	115. Endrin
24. Chloroethane	70. Butylbenzyl Phthalate	116. Endrin Aldehyde
25. 2-Chloroethyl Vinyl Ether	71. 2-Chloronaphthalene	117. Heptachlor
26. Chloroform	72. 4-Chlorophenyl Phenyl Ether	118. Heptachlor Epoxide
27. Dichlorobromomethane	73. Chrysene	119. PCB 1016
28. 1,1-Dichloroethane	74. Dibenzo (a,h) Anthracene	120. PCB 1221
29. 1,2-Dichloroethane	75. 1,2-Dichlorobenzene	121. PCB 1232
30. 1,1-Dichloroethylene	76. 1,3-Dichlorobenzene	122. PCB 1242
31. 1,2-Dichloropropane	77. 1,4-Dichlorobenzene	123. PCB 1248
32. 1,3-Dichloropropylene	78. 3,3'-Dichlorobenzidine	124. PCB 1254
33. Ethylbenzene	79. Diethyl Phthalate	125. PCB 1260
34. Methyl Bromide	80. Dimethyl Phthalate	126. Toxaphene
35. Methyl Chloride	81. Di-n-Butyl Phthalate	
36. Methylene Chloride	82. 2,4-Dinitrotoluene	
37. 1,1,2,2-Tetrachloroethane	83. 2,6-Dinitrotoluene	
38. Tetrachloroethylene	84. Di-n-Octyl Phthalate	
39. Toluene	85. 1,2-Dipenylhydrazine	
40. 1,2-Trans-Dichloroethylene	86. Fluoranthene	
41. 1,1,1-Trichloroethane	87. Fluorene	
42. 1,1,2-Trichloroethane	88. Hexachlorobenzene	
43. Trichloroethylene	89. Hexachlorobutadiene	
44. Vinyl Chloride	90. Hexachlorocyclopentadiene	

ATTACHMENT H – MINIMUM LEVELS

MINIMUM LEVELS IN PPB (µg/l)

Table 1- VOLATILE SUBSTANCES ¹	GC	GCMS
Acrolein	2.0	5
Acrylonitrile	2.0	2
Benzene	0.5	2
Bromoform	0.5	2
Carbon Tetrachloride	0.5	2
Chlorobenzene	0.5	2
Chlorodibromomethane	0.5	2
Chloroethane	0.5	2
Chloroform	0.5	2
Dichlorobromomethane	0.5	2
1,1 Dichloroethane	0.5	1
1,2 Dichloroethane	0.5	2
1,1 Dichloroethylene	0.5	2
1,2 Dichloropropane	0.5	1
1,3 Dichloropropylene (volatile)	0.5	2
Ethylbenzene	0.5	2
Methyl Bromide (<i>Bromomethane</i>)	1.0	2
Methyl Chloride (<i>Chloromethane</i>)	0.5	2
Methylene Chloride (<i>Dichloromethane</i>)	0.5	2
1,1,2,2 Tetrachloroethane	0.5	1
Tetrachloroethylene	0.5	2
Toluene	0.5	2
trans-1,2 Dichloroethylene	0.5	1
1,1,1 Trichloroethane	0.5	2
1,1,2 Trichloroethane	0.5	2
Trichloroethylene	0.5	2
Vinyl Chloride	0.5	2
1,2 Dichlorobenzene (volatile)	0.5	2
1,3 Dichlorobenzene (volatile)	0.5	2
1,4 Dichlorobenzene (volatile)	0.5	2

Selection and Use of Appropriate ML Value:

ML Selection: When there is more than one ML value for a given substance, the discharger may select any one of those ML values, and their associated analytical methods, listed in this Attachment that are below the calculated effluent limitation for compliance determination. If no ML value is below the effluent limitation, then the discharger shall select the lowest ML value, and its associated analytical method, listed in the PQL Table.

ML Usage: The ML value in this Attachment represents the lowest quantifiable concentration in a sample based on the proper application of all method-based analytical procedures and the absence of any matrix interferences. Assuming that all method-specific analytical steps are followed, the ML value will also represent, after the appropriate application of method-specific factors, the lowest standard in the calibration curve for that specific analytical technique. Common analytical practices sometimes require different treatment of the sample relative to calibration standards.

Note: chemical names in parenthesis and italicized is another name for the constituent.

¹ The normal method-specific factor for these substances is 1, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

MINIMUM LEVELS IN PPB ($\mu\text{g/l}$)

Table 2 – Semi-Volatile Substances²	GC	GCMS	LC
2-Chloroethyl vinyl ether	1	1	
2 Chlorophenol	2	5	
2,4 Dichlorophenol	1	5	
2,4 Dimethylphenol	1	2	
4,6 Dinitro-2-methylphenol	10	5	
2,4 Dinitrophenol	5	5	
2- Nitrophenol		10	
4- Nitrophenol	5	10	
4 Chloro-3-methylphenol	5	1	
2,4,6 Trichlorophenol	10	10	
Acenaphthene	1	1	0.5
Acenaphthylene		10	0.2
Anthracene		10	2
Benzidine		5	
Benzo (a) Anthracene (1,2 Benzanthracene)	10	5	
Benzo(a) pyrene (3,4 Benzopyrene)		10	2
Benzo (b) Flouranthene (3,4 Benzofluoranthene)		10	10
Benzo(g,h,i)perylene		5	0.1
Benzo(k)fluoranthene		10	2
bis 2-(1-Chloroethoxyl) methane		5	
bis(2-chloroethyl) ether	10	1	
bis(2-Chloroisopropyl) ether	10	2	
bis(2-Ethylhexyl) phthalate	10	5	
4-Bromophenyl phenyl ether	10	5	
Butyl benzyl phthalate	10	10	
2-Chloronaphthalene		10	
4-Chlorophenyl phenyl ether		5	
Chrysene		10	5
Dibenzo(a,h)-anthracene		10	0.1
1,2 Dichlorobenzene (semivolatile)	2	2	
1,3 Dichlorobenzene (semivolatile)	2	1	
1,4 Dichlorobenzene (semivolatile)	2	1	
3,3' Dichlorobenzidine		5	
Diethyl phthalate	10	2	
Dimethyl phthalate	10	2	
di-n-Butyl phthalate		10	
2,4 Dinitrotoluene	10	5	
2,6 Dinitrotoluene		5	
di-n-Octyl phthalate		10	
1,2 Diphenylhydrazine		1	
Fluoranthene	10	1	0.05
Fluorene		10	0.1
Hexachloro-cyclopentadiene	5	5	
1,2,4 Trichlorobenzene	1	5	

MINIMUM LEVELS IN PPB (µg/l)

Table 2 - SEMI-VOLATILE SUBSTANCES ²	GC	GCMS	LC	COLOR
Pentachlorophenol	1	5		
Phenol ³	1	1		50
Hexachlorobenzene	5	1		
Hexachlorobutadiene	5	1		
Hexachloroethane	5	1		
Indeno(1,2,3,cd)-pyrene		10	0.05	
Isophorone	10	1		
Naphthalene	10	1	0.2	
Nitrobenzene	10	1		
N-Nitroso-dimethyl amine	10	5		
N-Nitroso-di n-propyl amine	10	5		
N-Nitroso diphenyl amine	10	1		
Phenanthrene		5	0.05	
Pyrene		10	0.05	

Table 3- INORGANICS ⁴	FAA	GFAA	ICP	ICPMS	SPGFAA	HYDRIDE	CVAA	COLOR	DCP
Antimony	10	5	50	0.5	5	0.5			1000
Arsenic		2	10	2	2	1		20	1000
Beryllium	20	0.5	2	0.5	1				1000
Cadmium	10	0.5	10	0.25	0.5				1000
Chromium (total)	50	2	10	0.5	1				1000
Chromium VI	5							10	
Copper	25	5	10	0.5	2				1000
Lead	20	5	5	0.5	2				10000
Mercury				0.5			0.2		
Nickel	50	5	20	1	5				1000
Selenium		5	10	2	5	1			1000
Silver	10	1	10	0.25	2				1000
Thallium	10	2	10	1	5				1000
Zinc	20		20	1	10				1000
Cyanide								5	

² With the exception of phenol by colorimetric technique, the normal method-specific factor for these substances is 1000, therefore, the lowest standards concentration in the calibration curve is equal to the above ML value for each substance multiplied by 1000.

³ Phenol by colorimetric technique has a factor of 1.

⁴ The normal method-specific factor for these substances is 1, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

MINIMUM LEVELS IN PPB (µg/l)

Table 4- PESTICIDES – PCBs⁵	GC
Aldrin	0.005
alpha-BHC (<i>a</i> -Hexachloro-cyclohexane)	0.01
beta-BHC (<i>b</i> -Hexachloro-cyclohexane)	0.005
Gamma-BHC (<i>Lindane</i> ; <i>g</i> -Hexachloro-cyclohexane)	0.02
Delta-BHC (<i>d</i> -Hexachloro-cyclohexane)	0.005
Chlordane	0.1
4,4'-DDT	0.01
4,4'-DDE	0.05
4,4'-DDD	0.05
Dieldrin	0.01
Alpha-Endosulfan	0.02
Beta-Endosulfan	0.01
Endosulfan Sulfate	0.05
Endrin	0.01
Endrin Aldehyde	0.01
Heptachlor	0.01
Heptachlor Epoxide	0.01
PCB 1016	0.5
PCB 1221	0.5
PCB 1232	0.5
PCB 1242	0.5
PCB 1248	0.5
PCB 1254	0.5
PCB 1260	0.5
Toxaphene	0.5

Techniques:

- GC - Gas Chromatography
- GCMS - Gas Chromatography/Mass Spectrometry
- HRGCMS - High Resolution Gas Chromatography/Mass Spectrometry (i.e., EPA 1613, 1624, or 1625)
- LC - High Pressure Liquid Chromatography
- FAA - Flame Atomic Absorption
- GFAA - Graphite Furnace Atomic Absorption
- HYDRIDE - Gaseous Hydride Atomic Absorption
- CVAA - Cold Vapor Atomic Absorption
- ICP - Inductively Coupled Plasma
- ICPMS - Inductively Coupled Plasma/Mass Spectrometry
- SPGFAA - Stabilized Platform Graphite Furnace Atomic Absorption (i.e., EPA 200.9)
- DCP - Direct Current Plasma
- COLOR - Colorimetric

⁵ The normal method-specific factor for these substances is 100, therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 100.

ATTACHMENT I – TRIGGERS FOR MONITORING PRIORITY POLLUTANTS

	CONSTITUENT	µg/L
1	Antimony	7
2	Arsenic	75
3	Beryllium	--
4	Cadmium	3.7
5a	Chromium III	120
5b	Chromium VI	5.5
6	Copper	14.2
7	Lead	12.2
8	Mercury	0.026
9	Nickel	30
10	Selenium	2.5
11	Silver	11.2
12	Thallium	2.8
13	Zinc	70
14	Cyanide	2.6
15	Asbestos	--
16	2,3,7,8-TCDD (Dioxin)	0.00000007
17	Acrolein	160
18	Acrylonitrile	0.03
19	Benzene	0.6
20	Bromoform	2.2
21	Carbon Tetrachloride	0.13
22	Chlorobenzene	340
23	Chlorodibromomethane	0.22
24	Chloroethane	--
25	2-Chloroethyl vinyl ether	--
26	Chloroform	--
27	Dichlorobromomethane	0.28
28	<i>1,1-Dichloroethane</i>	5
29	1,2-Dichloroethane	0.19
30	1,1-Dichloroethylene	0.029
31	1,2-Dichloropropane	0.26
32	1,3-Dichloropropylene	5
33	<i>Ethylbenzene</i>	0.3
34	Methyl Bromide	24
35	Methyl Chloride	--
36	Methylene Chloride	2.4
37	1,1,1,2-Tetrachloroethane	0.085

	CONSTITUENT	µg/L
38	Tetrachloroethylene	0.4
39	<i>Toluene</i>	0.15
40	<i>1,2-Trans-dichloroethylene</i>	10
41	<i>1,1,1-Trichloroethane</i>	200
42	1,1,2-Trichloroethane	0.3
43	Trichloroethylene	1.35
44	<i>Vinyl Chloride</i>	0.5
45	2-Chlorophenol	60
46	2,4-Dichlorophenol	46.5
47	2,4-Dimethylphenol	270
48	2-Methy-4,6-Dinitrophenol	6.7
49	2,4-Dinitrophenol	35
50	2-Nitrophenol	--
51	4-Nitrophenol	--
52	3-Methyl-4-Chlorophenol	--
53	Pentachlorophenol	0.14
54	Phenol	10500
55	2,4,6-Trichlorophenol	1.05
56	Acenaphthene	600
57	Acenaphthylene	--
58	Anthracene	4800
59	Benzidine	0.00006
60	Benzo (a) anthracene	0.0022
61	Benzo (a) pyrene	0.0022
62	Benzo (b) fluoranthene	0.0022
63	Benzo (g,h,i) pyrene	--
64	Benzo (k) fluorantene	0.0022
65	Bis (2-Chloroethoxy) methane	--
66	Bis (2-Chloroethyl) ether	0.016
67	Bis (2-Chloroisopropyl) ether	700
68	Bis (2-ethyhexyl) phthalate	0.9
69	4-Bromophenyl phenyl ether	--
70	Butyl benzyl phthalate	1500
71	2-Chloronaphthalene	850
72	4-Chlorophenyl phenyl ether	--
73	Chrysene	0.0022
74	Dibenzo (a,h) anthracene	0.0022
75	<i>1,2-Dichlorobenzene</i>	0.6

See notes below for italicized constituents.

ATTACHMENT I. -Continued

	CONSTITUENT	µg/L
76	1,3-Dichlorobenzene	200
77	<i>1,4-Dichlorobenzene</i>	<u>5</u>
78	3,3-Dichlorobenzidine	0.02
79	Diethyl phthalate	11,500
80	Dimethyl phthalate	156,500
81	Di-N-butyl phthalate	1,350
82	2,4-Dinitrotoluene	0.055
83	2,6-Dinitrotoluene	--
84	Di-N-octyl phthalate	--
85	1,2-Diphenylhydrazine	0.02
86	Fluoranthene	150
87	Fluorene	650
88	Hexachlorobenzene	0.00038
89	Hexachlorobutadiene	0.22
90	<i>Hexachlorocyclopentadiene</i>	<u>50</u>
91	Hexachloroethane	0.95
92	Indeno (1,2,3-cd) pyrene	0.0022
93	Isophorone	4.2
94	<i>Naphthalene</i>	<u>17</u>
95	Nitrobenzene	8.5
96	N-Nitrosodimethylamine	0.00035
97	N-Nitrosodi-N-propylamine	0.0025
98	N-Nitrosodiphenylamine	2.5
99	Phenanthrene	--

	CONSTITUENT	µg/L
100	Pyrene	480
101	<i>1,2,4-Trichlorobenzene</i>	<u>5</u>
102	Aldrin	0.00007
103	BHC Alpha	0.0020
104	BHC Beta	0.007
105	BHC Gamma	0.010
106	BHC Delta	--
107	Chlordane	0.00029
108	4,4-DDT	0.0003
109	4,4-DDE	0.0003
110	4,4-DDD	0.00042
111	Dieldrin	0.00007
112	Endosulfan Alpha	0.028
113	Endosulfan Beta	0.028
114	Endosulfan Sulfate	55
115	Endrin	0.018
116	Endrin Aldehyde	0.38
117	Heptachlor	0.00011
118	Heptachlor Epoxide	0.00005
119	PCB 1016	0.000085
120	PCB 1221	0.000085
125	PCB 1260	0.000085
126	Toxaphene	0.00037

Notes:

1. For constituents not shown italicized, the values shown in the Table are fifty percent of the most stringent applicable receiving water objectives (freshwater or human health (consumption of water and organisms) as specified for that pollutant in 40 CFR 131.38¹).
2. For constituents shown bold and italicized, the values shown in the Table are based on the California Department of Health Services maximum contaminant levels (MCLs) or Notification Level. Notification Level based trigger is underlined.
3. For hardness dependent metals, the hardness value used is 120 mg/L and for pentachlorophenol, the pH value used is 7.5 standard units

¹ See Federal Register/ Vol. 65, No. 97 / Thursday, May 18, 2000 / Rules and Regulations.