

CHAPTER 5
IMPLEMENTATION

SELECTED CHAPTER CONTENTS

Introduction.....	5-2
Implementation Through Waste Discharge Requirements.....	5-2
National Pollutant Discharge Elimination System (NPDES).....	5-3
Compliance Schedules / 2000 Amendment.....	5-4
Waste Discharge Requirements.....	5-6
Waivers.....	5-6
Water Reclamation Requirements.....	5-6
Waste Discharge Prohibitions.....	5-7
Quail Valley On-site Septic Tank-Subsurface Disposal System Prohibition / 2006 Amendment.....	5-10
Water Quality Certification.....	5-11
Monitoring and Enforcement.....	5-12
TDS and Nitrogen Management / 2004 Amendment.....	5-14
Salt Assimilative Capacity.....	5-18
Mineral Increments.....	5-25
Nitrogen Loss Coefficients.....	5-25
TDS & Nitrogen Wasteload Allocations for the Santa Ana River.....	5-27
Ammonia.....	5-33
Wastewater Reclamation.....	5-34
Special Considerations – Subsurface Disposal Systems.....	5-38
Other Projects and Programs.....	5-40
Salt Management Plan.....	5-43
Maximum Benefit Implementation for Salt Management.....	5-46
Salt Management – Chino Basin and Cucamonga Basin.....	5-47
Salt Management – San Timoteo.....	5-57
San Timoteo & Beaumont Management Zones.....	5-67
Eastern Municipal Water District Maximum Benefit Commitments.....	5-80
NonPoint Source Program.....	5-83
NPS Management Plan.....	5-84
Stormwater Program.....	5-86
Animal Confinement Facilities (Dairies).....	5-88
Impacts of Past Dairy Operations.....	5-91
Dairy Operations Outside the Chino Basin.....	5-92
Minimum Lot Size Requirements.....	5-93
Newport Bay Watershed.....	5-96
Siltation / 1998 Amendment.....	5-97
Phase 1 of the TMDL for Sediment.....	5-98
Phase 2: Monitoring and Reassessment.....	5-102
Eutrophication / TMDL for Nutrients / 1998 Amendment.....	5-103
Bacterial Contamination.....	5-112

Fecal Coliform TMDL / 1999 Amendment.....	5-113
Toxic Substance Contamination / 2002 Amendment.....	5-125
Diazinon and Chlorpyrifos TMDL.....	5-125
Organochlorine Compounds TMDL.....	5-130
Anaheim Bay / Huntington Harbour.....	5-161
Big Bear Lake.....	5-162
Big Bear Lake Nutrient Total Maximum Daily Loads (TMDLs) (Nutrient TMDL For Dry Hydrological Conditions for Big Bear Lake) / 2006 Amendment).....	5-166
Lake Elsinore / San Jacinto Watershed.....	5-181
Lake Elsinore and Canyon Lake Nutrient TMDL / 2004 Amendment	5-181
Middle Santa Ana River Watershed.....	5-205
Middle Santa Ana River Watershed Bacterial Indicator TMDL / 2006 Amendment	5-205
Bay Protection and Toxic Cleanup.....	5-221
Groundwater Contamination from Volatile Organic Compounds.....	5-223
Department of Defense Facilities.....	5-226
Leaking Underground Storage Tanks.....	5-228
Aboveground Storage Tanks.....	5-230
Disposal of Hazardous and Nonhazardous Waste to Land.....	5-230
References.....	5-235

INTRODUCTION

This chapter describes the implementation plan, the actions that are necessary to achieve the water quality objectives specified in Chapter 4 and thereby protect the beneficial uses of the region's surface and groundwaters (Chapter 3). These actions will require the coordinated efforts of the Regional Board and numerous water supply and wastewater management agencies, as well as city and county governments and other planning entities within the Region.

The Implementation chapter of the 1983 Basin Plan focused largely on the mineral imbalance problem in the region and the management of total dissolved solids (TDS) through waste discharges requirements, wastewater reclamation requirements, improvements in water supply quality, recharge projects, and other measures. Since the adoption of the 1983 Basin Plan, the Regional Board's knowledge of the water quality problems in the Santa Ana Region has increased considerably, and the number and variety of water quality programs undertaken to address those problems have increased accordingly. Several new programs are being implemented statewide by each regional board, including broad new responsibilities related to landfill operations and closure, oversight of leaking underground storage tank cleanup activities, and control of nonpoint sources such as urban runoff and stormwater from industrial facilities and construction sites. These new programs are part of the Board's implementation plan and are described in this chapter.

IMPLEMENTATION THROUGH WASTE DISCHARGE REQUIREMENTS

The Regional Board's principal means of achieving the water quality objectives and protecting the beneficial uses specified in this plan is the development, adoption, issuance and enforcement of waste discharge requirements. By regulating the quality of wastewaters discharged, and in other ways controlling the discharge of wastes which may impact surface and groundwater quality, the Regional Board works to protect the Region's water resources.

The Regional Board's regulatory tools include National Pollutant Discharge Elimination System permits, Waste Discharge Requirements, Water Reclamation Requirements, Water Quality Certification and Waste Discharge Prohibition.

National Pollutant Discharge Elimination System (NPDES)

National Pollutant Discharge Elimination System (NPDES) permits are required for discharges of pollutants to "navigable waters" of the United States, which includes any discharge to surface waters – lakes, rivers, streams, bays, the ocean, dry streambeds, wetlands and storm sewers that are tributary to any surface water body. NPDES permits are issued under the federal Clean Water Act, Title IV "Permits and Licenses," Section 402 (33 USC 466 *et seq.*). The Regional Board issues these permits in lieu of direct issuance by the US EPA, subject to review and approval by the US EPA Regional Administrator (EPA Region IX). The terms of these NPDES permits implement pertinent provisions of the federal Clean Water Act and the Act's implementing regulations including pretreatment, sludge management, effluent limitations for specific industries and antidegradation. In general, the discharge of pollutants is to be eliminated or reduced as much as practicable so as to achieve the Clean Water Act's goal of "fishable and swimmable" navigable (surface) waters. Technically, all NPDES permits issued by the Regional Board are also Waste Discharge Requirements issued under the authority of the California Water Code.

In addition to regulating discharges of wastewater to surface waters, NPDES permits also require municipal sewage treatment facilities to implement and monitor industrial pretreatment programs if their design capacity is greater than five million gallons per day (MGD). Smaller municipal treatment systems may also be required to conduct pretreatment programs if there are significant industrial contributions to their systems. The pretreatment programs must comply with the federal regulations specified in 40 CFR 403.

At this time, there are approximately 2,000 NPDES permits in effect in the Santa Ana Region. As shown in Table 5-1, these NPDES permits regulate discharge from publicly owned treatment works (POTWs, or sewage treatment plants), industrial discharges, stormwater runoff, dewatering operations, and groundwater cleanup discharges. NPDES permits are issued for five years or less and are therefore to be updated regularly. The rapid and dramatic population and urban growth in the Santa Ana Region has caused a significant increase in NPDES permit applications for new waste discharges. Because of staff resource limitations, the Board generally focuses its permitting efforts on the issuance of permits for these new discharges. NPDES permit updates are done to the extent

feasible, particularly for the more significant discharges. In some cases, if the discharge does not change substantially over the permitting period, administrative extensions of the existing permits are issued by the Regional Board's Executive Officer.

To expedite the permit issuance process, the Regional Board has adopted several general NPDES permits, each of which regulates numerous discharges of similar types of wastes. These general permits address discharges from groundwater cleanup projects (Order No. 91-63) and dewatering activities (Order No. 93-49). Proponents of groundwater cleanup or dewatering projects are required to file individual permit applications, which are reviewed by Regional Board staff to determine whether the requirements of the general permits apply and are sufficient to assure water quality protection. If so, the applicants are authorized by the Regional Board's Executive Officer to discharge in conformance with the general permit. A general permit for boatyard operations is being drafted. Additional general permits will be developed and adopted as appropriate to streamline the permitting process.

Similarly, the State Board has issued general permits for stormwater runoff from industrial facilities and construction sites statewide (see discussion on stormwater runoff). Stormwater discharges from industrial and construction activities in the Santa Ana Region can be covered under these general permits, which are administered jointly by the State Board and Regional Boards.

Compliance Schedules (The following text was added under Resolution No. 00-27)

Where the Regional Board determines that it is infeasible to achieve immediate compliance with an effluent limitation specified to implement a new, revised or newly interpreted water quality objective, whether numeric or narrative, adopted by the Regional Board or State Water Resources Control Board, or with a new, revised or newly interpreted water quality criterion promulgated by the U.S. Environmental Protection Agency, the Regional Board may establish a schedule of compliance in a discharger's waste discharge requirements (NPDES permit). The schedule of compliance shall include a time schedule for completing specific actions that demonstrate reasonable progress toward attainment of the effluent limitation and, thereby, the objective or criterion. The schedule shall contain a final compliance date, based on the shortest practicable time (determined by the Regional Board at a public hearing) required to achieve compliance. In no event shall an NPDES permit include a schedule of compliance that allows more than ten years from the date of adoption or interpretation of the applicable objective or criterion. Schedules of compliance are authorized by this provision only for those effluent limitations that implement objectives and criteria adopted, revised or newly interpreted after the effective date of this provision, July 15, 2002.

To document the need for and justify the duration of any such compliance schedule, a discharger must submit the following information, at a minimum: (1) the results of a diligent effort to quantify pollutant levels in the discharge and the sources of the

pollutant(s) in the waste stream; (2) documentation of source control efforts currently underway or completed, including compliance with any Pollution Prevention programs that have been established; (3) a proposed schedule for additional source control measures or waste treatment; (4) the discharge quality that can reasonably be achieved until final compliance is attained; and (5) a demonstration that the proposed schedule is as short as possible, taking into account economic, technical and other relevant factors. The need for additional information and analyses will be determined by the Regional Board on a case-by-case basis. **(End of text adopted under Resolution No. 00-27)**

**Table 5-1
Representative NPDES Permitted Facilities in the Santa Ana Region
(as of November 3, 1993)¹**

Facility Type	Number Requested
Boatyards	10
Dewatering Operations	31
Groundwater Cleanup Projects	150
Stormwater Discharges 39 individually regulated by RWQCB; 1800 regulated by SWRCB's general permits	1839
Publicly Owned Treatment Works	24
TOTAL	2054

¹ The list of facilities is regulated under NPDES permits is updated periodically and is available at the Regional Board office.

**Table 5-2
Representative WDR Permitted Facilities in the Santa Ana Region
(as of November 3, 1993)²**

Facility Type	Number Regulated
Brine Evaporation	24
Composting	19
Groundwater Cleanup	32
Dairies	468
Landfills	43
Mobile Home Parks (community septic systems)	22
Publicly Owned Treatment Works	37
TOTAL	645

Where the terms of these general permits are not sufficient to protect water quality, the Board issues individual permits for these discharges.

² The list of facilities regulated under WDR permits is updated periodically and is available at the Regional Board office.

Waste Discharge Requirements

Waste Discharge Requirements (WDRs) are issued by the Regional Board under the provisions of the California Water Code, Division 7 "Water Quality," Article 4 "Waste Discharge Requirements." These requirements regulate the discharge of wastes which are not made to surface waters but which may impact the region's water quality by affecting underlying groundwater basins. Such WDRs are issued for POTWs' wastewater reclamation operations, discharges of wastes from industries, subsurface waste discharges such as septic systems, sanitary landfills, dairies and a variety of other activities which can affect water quality. There are approximately 650 WDRs in place, as indicated in Table 5-2.

Table 5-2 shows that most WDRs have been issued to dairies. To streamline the permit process, the Regional Board has developed a general permit for dairies and other animal confinement facilities (Order No. 94-7). To implement the federal stormwater requirements, this permit will be issued as an NPDES permit.

Waivers

The California Water Code allows Regional Boards to waive waste discharge requirements (WDRs) for a specific discharge or types of discharges where it is not against the public interest (Section 13269). These waivers are conditional and may be terminated at any time.

On May 11, 1984, the Regional Board adopted Resolution No. 84-48, which waives WDRs for certain types of discharges. Resolution No. 84-48 was amended by Resolution No. 91-75 in 1991. Resolution No. 84-48 and Resolution No. 91-75 are incorporated into the Basin Plan by reference and are included in Appendix IV. Only discharges which comply with the conditions contained in Resolution No. 84-48 as amended by Resolution No. 91-75, qualify for this waiver. Even though a discharge may qualify for a waiver, dischargers are still required to file Reports of Waste Discharge (ROWD), together with the appropriate filing fees. Regional Board staff determines if the effort expended in reviewing the ROWD justifies retaining any portion of the fee. If not, the fee is fully refunded.

Water Reclamation Requirements

Reclaimed water is water that, as a result of treatment, is suitable for a direct beneficial use or a controlled use that would otherwise not occur and is therefore considered a valuable resource. The State Board adopted the Reclamation Policy to encourage development of water reclamation facilities to increase the availability of reclaimed water to help meet the growing water requirements of the State (Chapter 2). The State Board is authorized to provide loans for the development of water reclamation facilities, or for studies and investigations in connection with water reclamation.

Section 13521 of the California Water Code requires the State Department of Health Services to establish statewide reclamation criteria for each type of use of reclaimed water, where such use involves the protection of public health. These regulations, contained in Title 22 of the California Code of Regulations, are the basic regulations governing the use of reclaimed water in California. The existing Title 22 regulations were adopted in 1978; proposed new regulations are currently under review.

The Regional Board implements the provisions of Title 22 by issuing Water Reclamation Requirements (WRRs) to the producer, the user of reclaimed water, or both. WRRs are issued for a variety of uses, including, but not limited to, landscape irrigation, fodder crop irrigation, duck ponds, freeway landscape irrigation, groundwater recharge, injection for seawater intrusion barriers, use in toilet flushing, and other non-domestic uses in high rises or nonresidential buildings.

The Santa Ana Regional Board currently has 76 WRRs issued to producers and/or users of reclaimed water. Some of the producers have received or applied for Master Reclamation Requirements (MRR) which would allow the producer to distribute their reclaimed water to various users without additional user reclamation requirements from the Regional Board. With the water shortage in southern California, there is an increase in the demand for reclaimed water. With sophisticated treatment technologies, reclaimed water could be used for almost anything, except domestic supply.

The detailed requirements, conditions, prohibitions, and other specifications included within NPDES, WDR, and WRR permits are developed on the basis of existing state and federal law, State Board Water Quality Control Plans and Policies (e.g., the Ocean Plan), and the contents of this Basin Plan. The foremost consideration is the protection of water quality. The quality of the discharge specified through the limitations in the permit is calculated to allow the water quality objectives of the receiving water to be met or maintained, and in some cases, the water quality is improved.

When the limits included in the NPDES, WDR or WRR permits cannot be met because treatment facilities are inadequate or the water supply is inferior, these permits may include a time schedule for compliance and interim discharger a period of time to make the necessary changes and/or improvements.

Waste Discharge Prohibitions

The Regional Board also implements this Basin Plan through the adoption of waste discharge prohibitions as necessary. Section 13243 of the California Water Code states that a Regional Board may specify certain conditions or areas where the discharge of waste, or certain types of waste, will not be permitted. The Regional Board implements this section of the Water Code by adopting waste discharge requirements issued to individual discharges and in the Basin Plan itself.

A. General Prohibitions

1. Unless regulated by appropriate waste discharge requirements, the discharge to surface or groundwaters of waste which contains the following substances is prohibited.
 - Toxic substances or materials;
 - Pesticides;
 - PCB's (polychlorinated biphenyls);
 - Mercury or mercury compounds;
 - Radioactive substances or material in excess of levels allowed by the California Code of Regulations.

This list is not necessarily all-inclusive. The Regional Board may modify or update this list as appropriate.

B. Prohibitions Applying to Inland Surface Waters

1. The discharge of untreated sewage to any surface water stream, natural or man-made, or to any drainage system intended to convey stormwater runoff to surface water streams is prohibited.
2. The discharge of treated sewage to streams, lakes or reservoirs, or to tributaries thereto, which are designated **MUN** and which are used as a domestic water supply is prohibited unless approved by the California Department of Health Services. The discharge of treated sewage to waterbodies which are excepted from **MUN** (see Table 3-1) but which are tributary to waters designated **MUN** and are used as a domestic water supply is prohibited unless the discharge of treated sewage to the drinking water supply is precluded or approved by the California Department of Health Services.

C. Prohibitions Applying to Oceans, Bays, and Estuary Waters

The prohibitions included in the California Ocean Plan, Thermal Plan, and the Policy for Enclosed Bays and Estuaries are hereby incorporated into this plan by reference.

D. Prohibitions Applying to Groundwaters

1. The discharge of the following materials to the ground, other than into impervious facilities, is prohibited:
 - a. Acids or caustics, whether neutralized or not, and
 - b. Excessively saline wastes (electrical conductivity greater than 2000 $\mu\text{mhos/cm}$)

2. Prohibitions Applying to Subsurface Leaching Percolation Systems

In 1973, the Regional Board adopted prohibitions on the use of subsurface disposal systems in the following areas:

- a. Grand Terrace (CSA 70, Improvement Zone H);
- b. Yucaipa-Calimesa (Yucaipa Valley County Water District);
- c. Lytle Creek above 2600 foot elevation;
- d. Mill Creek above 2600 foot elevation; and
- e. Bear Valley (includes Baldwin Lake Drainage Area);

In 1982, the Regional Board adopted prohibitions on the use of subsurface disposal systems for the Homeland-Green Acres area and Romoland areas (exact boundaries for these prohibition areas are shown on maps on file at the Regional Board office).

The Board adopted specified dates for final compliance with these prohibitions. In some cases, these dates have been revised via Basin Plan amendments. The compliance dates are as follows:

- a. Grand Terrace: February 1, 1988
- b. Yucaipa-Calimesa – February 1, 1988
- c. Lytle Creek – July 1, 1978
- d. Mill Creek - July 1, 1978
- e. Bear Valley – July 1, 1980
- f. Homeland-Green Acres – July 1, 1990
- g. Romoland – July 1, 1990

Exemptions from these prohibitions may be granted if certain criteria are satisfied (exemption criteria are described in Appendix V).

Quail Valley On-site Septic Tank-Subsurface Disposal System Prohibition (The following was added under Resolution No. R8-2006-0024)

On October 3, 2006, the Board adopted a Basin Plan amendment prohibiting the use of septic tank-subsurface disposal systems in the Quail Valley area of Riverside County in accordance with the following:

Effective Date: August 20, 2007

(1) The discharge of waste from new on-site septic tank-subsurface disposal systems in the Quail Valley area of Riverside County is prohibited, if a sewer system is available to serve the lot. Except as provided in (2) below, the discharge of waste from existing on-site septic tank-subsurface disposal systems in the Quail Valley area of Riverside County is prohibited, if a sewer system is available to serve the lot.

(2) All existing septic tank-subsurface disposal systems shall connect to the sewer designed to serve the lot within one year of sewer installation. New septic tank-subsurface disposal systems shall not be permitted in Quail Valley if a sewer system is available to serve the lot.


(3) This prohibition applies to all areas within Quail Valley as depicted on a detailed map maintained in the Regional Board office (Quail Valley Septic Tank Prohibition Boundary Map). A copy of the boundary map is attached as Attachment "A".

(4) Upon the effective date of this prohibition, new septic systems in Quail Valley (see Attachment "A") shall not be permitted, except as follows:

(a) For areas in Quail Valley other than areas 4 and 9, new systems may be permitted, provided the Regional Board finds that the sewer agency proposes, and is on schedule, to provide sewer service for areas 4 and 9 within five years of the effective date of this amendment, and if the lot proposed for a septic system meets all Board and Riverside County requirements.

(b) If the Board finds that the sewer agency cannot meet the schedule identified in 1(4)(a), above, but that design of the project proceeds nonetheless, then, upon completion of the sewer system design, new systems may be permitted in areas other than 4 and 9, if all Board and Riverside County requirements are met.

**ATTACHMENT "A": MAP OF QUAIL VALLEY PROHIBITION AREA
FIGURE 5-1a**

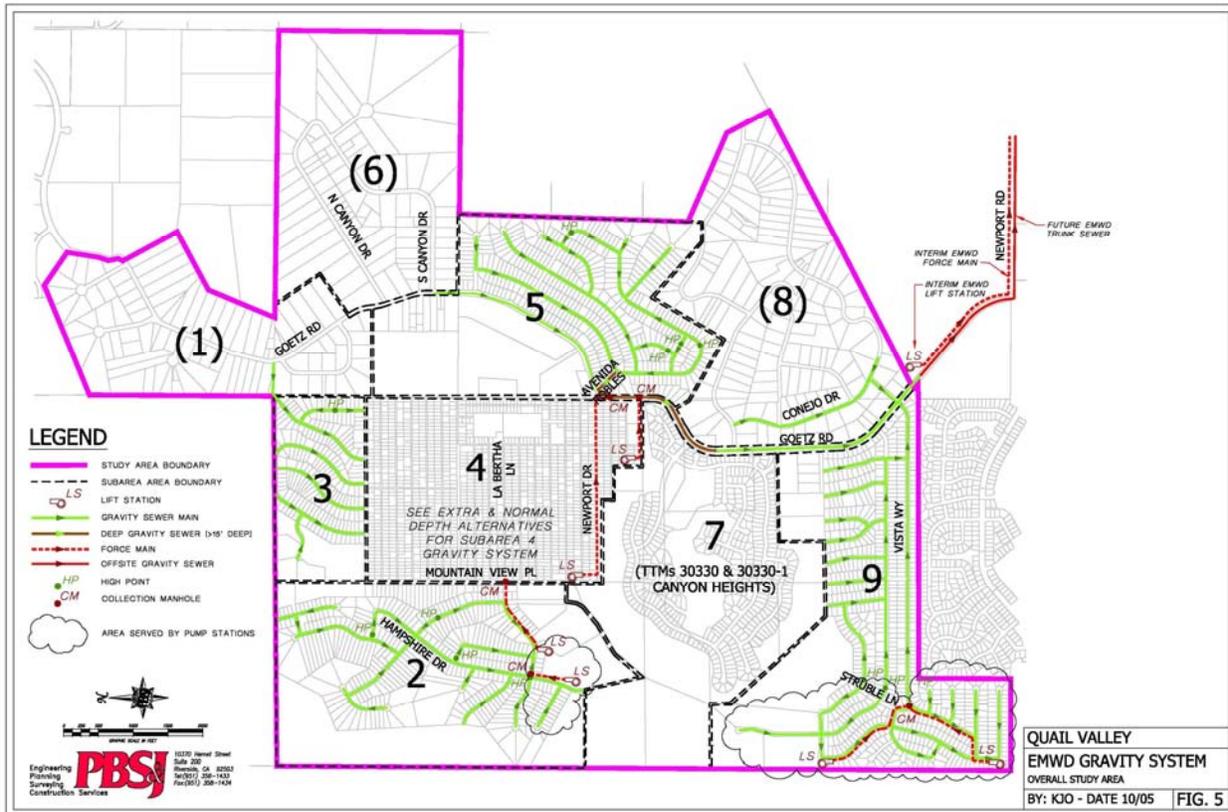

(End of amendment adopted under Resolution No. R8-2006-0024)

Water Quality Certification (Section 401)

In addition to the issuance of NPDES permits or waste discharge requirements, the Regional Board acts to protect the quality of surface waters through water quality certification as specified in Section 401 of the Clean Water Act (33 USC 466 *et seq.*). Section 401 requires that any person applying for a federal permit or license for an activity which may result in a discharge of pollutants into waters of the nation must obtain a state water quality certification verifying that the activity complies with the state’s water quality standards.

No license or permit can be granted until certification required by Section 401 has been obtained or waived. Further, no license or permit can be granted if certification has been denied by the state. Similarly, coastal states must concur that the activity meets the requirements of the Coastal Zone Management Program of the state or waive their right to concur by not taking action by a specified time.

The following permits or licenses require 401 Certification:

IMPLEMENTATION

5-11

January 24, 1995
Updated July 2014 to
include approved amendments

- NPDES permits issued by US EPA under Section 402 of the CWA (33 USC 466 *et seq.*);
- CWA Section 404 (33 USC 466 *et seq.*) permits issued by the U.S. Army Corps of Engineers;
- Permits issued under Sections 9 and 10 of the Rivers and Harbors Act (33 USC 466 *et seq.*) (for activities which may affect navigation);
- Licenses for hydroelectric power plants issued by the Federal Energy Regulatory Commission under the Federal Power Act; and
- Licenses issued by the Nuclear Regulatory Commission.

To date, the Regional Board's water quality certification activities have focused on applications for permits for the discharge of dredged or fill material to surface waters. These permits are issued by the U.S. Army Corps of Engineers (Section 404 permits) subject to any conditions imposed by the Regional Board.

The Section 404 program is administered at the federal level by the U.S. Army Corps of Engineers and the US EPA. The U.S. Fish and Wildlife Service and the National Marine Fisheries Service have important advisory roles. The U.S. Army Corps of Engineers has the primary responsibility for the permit program and is authorized, after notice and opportunity for a public hearing, to issue permits for the discharge of dredged or fill material. US EPA developed the regulations under which permits may be granted. States may assume the responsibility for implementation of the 404 permit program, however, California has not done so.

The Regional Board evaluates the projects for which 404 permits are requested and determines whether to deny water quality certification, issue a certification with conditions, or waive the certification. A certification is usually denied if the activity violates any water quality standard; if the activity may violate standards, a conditional certification is given; when the activity does not violate any standard, a 401 waiver may be given.

Presently, the executive Director of the State Board issues all water quality certifications in accordance with recommendations from the Regional Board.

MONITORING AND ENFORCEMENT

Waste discharge requirements issued by the Regional Board include requirements for monitoring of discharges. In some cases, the receiving waters must be monitored by the dischargers. The results of the "self monitoring" programs are reported to the Board and are used to determine compliance with the waste discharge requirements (see Chapter 6).

The California Water Code provides the Regional Board with a number of enforcement remedies for violations of requirements. Enforcement actions include Time Schedules, Cease and Desist Orders, Cleanup and Abatement Orders, and the issuance of Administrative Civil Liability Complaints.

Time Schedules

When a discharge is taking place or threatening to occur that will cause a violation of a Regional Board requirement, a discharger may be required to submit a detailed compliance plan and schedule (California Water Code Section 13300). These schedules may also be required when the waste collection treatment or disposal facility of a discharger are approaching capacity. Time Schedules are adopted by the Regional Board after a public hearing or by the Executive Officer pursuant to his or her authority.

Cease and Desist Order

If discharge prohibitions or requirements of the State Board or Regional Board are violated or threatened to be violated, the Regional Board may adopt a Cease and Desist order (California Water Code Section 13301) requiring the discharger to comply in accordance with a time schedule, or if the violation is threatened, to take appropriate remedial or preventive action. Cease and Desist orders may restrict or prohibit the volume, type or concentration of waste added to community sewer systems, if existing or threatened violations of waste discharge requirements occur. Cease and Desist Orders may specify interim time schedules as well as limitations that must be complied with until full compliance is achieved. Cease and Desist orders are adopted by the Regional Board after a public hearing.

Cleanup and Abatement Order

The Board may order *any* person who has discharged, is discharging or is threatening to discharge wastes that will result in a violation of waste discharge requirements or other order or prohibition of the State Board or Regional Board, to cleanup and abate the effects of the discharge or to take appropriate remedial action (California Water Code 13304). The Regional Board has delegated issuance of these orders to its Executive Officer; Cleanup and Abatement orders do not require Board action, but are often brought before the Regional Board for consideration.

Administrative Civil Liability

The Regional Board may also issue Administrative Civil Liability complaints (ACLs) to those who intentionally or negligently violate enforcement orders of the Board, or who intentionally or negligently discharge wastes in violation of any order, prohibition or requirement of the Board where the discharge causes conditions of pollution or nuisance (California Water Code Sections 13350). ACLs may also be issued in cases where a person fails to submit reports requested by the Board (California Water Code Sections 13261 and 13268) or when a person discharges waste without first having filed the appropriate Report of Waste Discharge (ROWD) (California Water Code Section 113265). ACLs may be issued pursuant to California Water Code Section 13385 for violations of any Regional Board prohibition or requirement implementing specified sections of the Clean Water Act, or any requirement in an approved pretreatment program, without showing

intent or negligence. Issuance of ACLs is delegated to the Board's Executive Officer, but, all administrative civil liability settlements must be affirmed by the Board. Amounts of administrative civil liability that the Board can impose range up to \$10,000 per day of violation. The Water Code also provides that a superior court may impose civil liability assessments in substantially higher amounts. The Regional Board may conduct a hearing if a discharger contests the imposition of the Administrative Civil Liability.

The Water Code provides that a Regional Board may request the State Attorney General to petition a superior court to enforce orders and complaints issued by the Board. The Regional Board may also request that the Attorney General seek injunctive relief in specific situations, such as violations of Cease and Desist orders or discharges which cause or threaten to cause a nuisance or pollution that could result in a public health emergency (California Water Code Sections 13331 and 13340).

TOTAL DISSOLVED SOLIDS AND NITROGEN MANAGEMENT

(The following has been modified under Resolution No. R8-2004-0001, No. R8-2010-0039, and No. R8-2012-0002)

I. Background

The 1975 and 1983 Basin Plans for the Santa Ana River Basin reported that the most serious problem in the basin was the build up of dissolve minerals, or salts, in the ground and surface waters. Sampling and computer modeling of groundwaters showed that the levels of dissolved minerals, generally expressed as total dissolved solids (TDS) or total filterable residue (TFR), were exceeding water quality objectives or would do so in the future unless appropriate controls were implemented. Nitrogen levels in the Santa Ana River, largely in the form of nitrate, were likewise projected to exceed objectives. As was discussed in Chapter 4, high levels of TDS and nitrate adversely affect the beneficial uses of ground and surface waters. The mineralization of the Region's waters, and its impact on beneficial uses, remains a significant problem.

Each use of water adds an increment of dissolved minerals. Significant increments of salts are added by municipal and industrial use, and the reuse and recycling of the wastewater generated as it moves from the hydrologically higher areas of the Region to the ocean. Wastewater and recycled water percolated into groundwater management zones is typically pumped and reused a number of times before reaching the ocean, resulting in increased salt concentrations. The concentration of dissolved minerals can also be increased by evaporation or evapotranspiration. One of the principal causes of the mineralization problem in the Region is historic irrigated agriculture, particularly citrus, which in the past required large applications of water to land, causing large losses by evaporation and evapotranspiration. TDS and nitrate concentrations are increased both by this reduction in the total volume of return water and by the direct application of these salts in fertilizers. Dairy operations, which began in the Region in the 1950's and continue today, also contribute large amounts of salts to the basin.

The implementation chapters of the 1975 and 1983 Basin Plans focused on recommended plans to address the mineralization problem. The 1975 Plan initiated a total watershed

approach to salt source control. Both Plans called for controls on salt loadings from all water uses including residential, commercial, industrial and agricultural (including dairies). The plans included: measures to improve water supply quality, including the import of high quality water from the State Water Project; waste discharge regulatory strategies (e.g., wasteload allocations, allowable mineral increments for uses of water); and recharge projects and other remedial programs to correct problems in specific areas. These Plans also carefully limited reclamation activities and the recycling of wastewaters into the local groundwater basins.

These salt management plans were developed using a complex set of groundwater computer models and programs, known collectively as the Basin Planning Procedure (BPP).

The modeling work focused on the upper Santa Ana Basin and, to a lesser extent, on the San Jacinto Basin, where the BPP was less developed and refined. The constituent modeled in those Plans was TDS.

For the salt management plan specified initially in the 1995 Basin Plan, when the Plan was adopted and approved in 1994 and 1995, modeling was conducted with the BPP for both the upper Santa Ana and San Jacinto Basins. However, most of the attention was again directed to the upper Santa Ana Basin, for which significant improvements to the BPP were made under a joint effort by the Santa Ana Watershed Project Authority, the Santa Ana River Dischargers Association, the Metropolitan Water District of Southern California, and the Regional Board. The most significant change to the BPP was the addition of a nitrogen modeling component so that projections of the nitrogen (nitrate) quality of groundwaters could be made, in addition to TDS. This enabled the development of a management plan for nitrogen, as well as TDS.

The BPP has not been used to model groundwater quality conditions in the lower Santa Ana Basin. For that Basin, the Regional Board's TDS and nitrogen management plans have relied, in large part, on the control of the quality of the Santa Ana River flows, which are a major source of recharge in the Basin. As discussed in Chapter 4, most of the baseflow (80-90%) is composed of treated sewage effluent; it also includes nonpoint source inputs and rising groundwater. Baseflow generally provides 70% or more of the water recharged in the Orange County Management Zone. In rare wet years, baseflow accounts for a smaller, but still significant, percentage (40%) of the recharge on an annual basis. Therefore, to protect Orange County groundwater, it is essential to control the quality of baseflow. To do so, baseflow TDS and nitrogen objectives are specified in this Plan for Reach 3 of the River. Wasteload allocations have been established and periodically revised to meet those and other Santa Ana River objectives.

For the 1983 Basin Plan, QUAL-II, a surface water model developed initially by the US EPA, was calibrated for the Santa Ana River and used to make detailed projections of River quality (TDS and nitrogen) and flow. The model was used to develop wasteload allocations for TDS and nitrogen discharges to the River that were approved as part of that Plan. (Wasteload allocations are discussed in detail in Section III of this Chapter). An updated version of the model, QUAL-2e, was used to revise these wasteload allocations,

which were included as part of the initial salt management plan in the 1995 Basin Plan. The models were used to integrate the quantity and quality of inputs to the River from various sources, including the headwaters, municipal wastewater treatment plant discharges, and rising groundwater, based on the water supply and wastewater management plans used in the BPP. Data on rising groundwater quality and quantity were provided to the QUAL-II/2e models by the BPP. As with the BPP, the QUAL-II/2e model projections were used to identify water quality problems and to assess the effectiveness of changes in TDS and nitrogen management strategies.

II. Update of the Total Dissolved Solids/Nitrogen Management Plan

The studies conducted to update the TDS/Nitrogen Management Plans in the 1983 and 1995 Basin Plans were not designed to validate or revise the TDS or nitrate-nitrogen objectives for groundwater. Rather, the focus of the studies was to determine how best to meet those established objectives. During public hearings to consider adoption of the 1995 Basin Plan, a number of water supply and wastewater agencies in the region commented that the TDS and nitrate-nitrogen objectives for groundwater should be reviewed, considering the estimated cost of complying with them (several billion dollars). In response, the Regional Board identified the review of these objectives as a high Basin Plan triennial review priority, and stakeholders throughout the Region agreed to provide sufficient resources to perform the necessary studies. In December 1995, these agencies, under the auspices of the Santa Ana Watershed Project Authority (SAWPA), formed the Nitrogen/Total Dissolved Solids (TDS) Task Force (Task Force) to undertake a watershed-wide study (Nitrogen/TDS Study) to review the groundwater objectives and the TDS/Nitrogen Management Plan in the Basin Plan as a whole. SAWPA managed the study, and Risk Sciences and Wildermuth Environmental, Inc., served as project consultants. Major tasks included review of the groundwater subbasin boundaries, development of recommendations for revised boundaries, development of appropriate TDS and nitrate-nitrogen objectives for the subbasins (management zones), and update of the TDS and TIN wasteload allocations to ensure compliance with both the established objectives for the Santa Ana River and tributaries and the recommended groundwater objectives. A complete list of all tasks completed in Phases 1A & 1B and 2A & 2B is included in the Appendix. The Task Force effort resulted in substantive proposed changes to the Basin Plan, including new groundwater management zones (Chapter 3) and new nitrate-nitrogen and TDS objectives for the management zones (Chapter 4). These changes necessitated the update and revision of the TDS/Nitrogen Management Plan, which is described below.

The Task Force studies, including the technical methods employed, are documented in a series of reports (Ref. 1-5). The Task Force studies differed from prior efforts to review the TDS and nitrogen management plans in that the BPP was not utilized. A revised model approach, not involving use of the QUAL-2e model, was used to update the wasteload allocations for the Santa Ana River. The Task Force concluded that the BPP no longer remained a viable tool for water quality planning purposes, and also concluded that the development of a new model was beyond the scope and financial capabilities of the Task Force. The efficacy of modeling to formulate and update salt

management plans in this Region has been well demonstrated; in the future, priority should be given to the development of a new model that would assist with future Basin Plan reviews.

III. TDS/Nitrogen Management Plan

TDS and nitrogen management in this Region involves both regulatory actions by the Regional Board and actions by other agencies to control and remediate salt problems. Regulatory actions include the adoption of appropriate TDS and nitrogen limitations in requirements issued for waste disposal and municipal wastewater recycling, and the adoption of waste discharge prohibitions. These regulatory steps are described earlier in this Chapter. Actions by other agencies include projects to improve water supply quality and the construction of groundwater desalters and brine lines to remove highly saline wastes from the watershed. The following sections discuss these programs in greater detail.

A. Water Supply Quality

Water supply quality has a direct affect on the quality of discharges from municipal wastewater treatment plants, discrete industrial discharges, returns to groundwater from homes using septic tank systems, returns from irrigation of landscaping in sewered and unsewered areas, and returns to groundwater from commercial irrigated agriculture. Water supply quality is an important determinant of the extent to which wastewater can be reused and recycled without resulting in adverse impacts on affected receiving waters. This is particularly true for TDS, since it is a conservative constituent, less likely than nitrogen to undergo transformation and loss as wastewater is discharged or recycled, and typically more difficult than nitrogen to treat and remove.

Water supplies cannot be directly regulated by the Regional Board; however, limitations in waste discharge requirements, including NPDES permits, may necessitate efforts to improve source water quality. These efforts may include drilling new wells, implementing alternative blending strategies, importing higher quality water when it is available, and constructing desalters to create or augment water supplies.

Imported water supplies are an important part of salt management strategies in the region from both a quantity and quality standpoint. Imported water is needed by many agencies to supplement local sources and satisfy ever-increasing demands. The import of high quality State Water Project water, with a long-term TDS average less than 300 mg/L, is particularly essential. The use of State Water Project water allows maximum reuse of water supplies without aggravating the mineralization problem. It is also used for recharge and replenishment to improve the quality of local water supply sources, which might otherwise be unusable. Thus, the use of high quality State Water Project water in the Region has water supply benefits that extend far beyond the actual quantity imported.

In some cases, the TDS quality of water supplies in a wastewater treatment service area may make it infeasible for the discharger to comply with TDS limits specified in

waste discharge requirements. In other cases, the discharger may add chemicals that enable compliance with certain discharge limitations, but also result in TDS concentrations in excess of waste discharge requirements. The Board recognizes these problems and incorporates provisions in waste discharge requirements to address them. These and other aspects of the Board's regulatory program are described next.

B. TDS and Nitrogen Regulation

As required by the Water Code (Section 13263), the Regional Board must assure that its regulatory actions implement the Basin Plan. Waste discharge requirements must specify limitations that, when met, will assure that water quality objectives will be achieved. Where the quality of the water receiving the discharge is better than the established objectives, the Board must assure that the discharge is consistent with the state's antidegradation policy (SWRCB Resolution No. 68-16). The Regional Board must also separately consider beneficial uses, and where necessary to protect those uses, specify limitations more stringent than those required to meet established water quality objectives. Of course, these obligations apply not only to TDS and nitrogen but also to other constituents that may adversely affect water quality and/or beneficial uses.

As indicated previously, the Regional Board's regulatory program includes the adoption of waste discharge prohibitions. The Board has established prohibitions on discharges of excessively saline wastes and, in certain areas, on discharges from subsurface disposal systems (see "Waste Discharge Prohibitions," above). The Board has also adopted other requirements pertaining to the use of subsurface disposal system use, both to assure public health protection and to address TDS and nitrogen-related concerns. These include the Regional Board's "Guidelines for Sewage Disposal from Land Developments" [Ref. 6], which are hereby incorporated by reference, and the minimum lot size requirements for septic system use (see Nonpoint Source section of this Chapter).

However, the principal TDS and nitrogen regulatory tool employed by the Regional Board is the issuance of appropriate discharge requirements, in conformance with the legal requirements identified above. Several important aspects of this permitting program warrant additional discussion:

1. Salt assimilative capacity
2. Mineral increments
3. Nitrogen loss coefficients
4. TDS and nitrogen wasteload allocations
5. Wastewater reclamation
6. Special considerations – subsurface disposal systems

1. Salt Assimilative Capacity

Some waters in the Region have assimilative capacity for additions of TDS and/or nitrogen; that is, wastewaters with higher TDS/nitrogen concentrations than the receiving waters are diluted sufficiently by natural processes, including rainfall or

recharge, such that the TDS and nitrogen objectives of the receiving waters are met. The amount of assimilative capacity, if any, varies depending on the individual characteristics of the waterbody in question.

The adoption of new groundwater management zone boundaries (Chapter 3) and new TDS and nitrate-nitrogen objectives for these management zones (Chapter 4), pursuant to the work of the Nitrogen/TDS Task Force, necessitated the re-evaluation of the assimilative capacity findings initially incorporated in the 1995 Basin Plan. To conduct this assessment, the Nitrogen-TDS study consultant calculated current ambient TDS and nitrate-nitrogen water quality using the same methods and protocols as were used in the calculation of historical ambient quality (see Chapter 4). The analysis focused on representing current water quality as a 20-year average for the period from 1978 through 1997. [Ref. 1]. For each management zone, current TDS and nitrate-nitrogen water quality were compared to water quality objectives (historical water quality)¹. Assimilative capacity was also assessed relative to the “maximum benefit” objectives established for certain management zones. If the current quality of a management zone is the same as or poorer than the specified water quality objectives, then that management zone does not have assimilative capacity. If the current quality is better than the specified water quality objectives, then that management zone has assimilative capacity. The difference between the objectives and current quality is the amount of assimilative capacity available.

Tables 5-3 and 5-4 show the water quality objectives and the current ambient quality for TDS and nitrate-nitrogen, respectively, for each management zone. These tables also list the TDS and nitrate-nitrogen assimilative capacity of the management zones, if any. Of the thirty-seven (37) management zones, twenty-seven (27) lack assimilative capacity for TDS, and thirty (30) lack assimilative capacity for nitrate-nitrogen (this assumes the “maximum benefit” objectives are in effect). There are five (5) management zones for which there were insufficient data to calculate TDS and/or nitrate-nitrogen water quality objectives and, therefore, assimilative capacity. For regulatory purposes, these 5 management zones are assumed to have no assimilative capacity. Dischargers to these management zones may demonstrate that assimilative capacity for TDS and/or nitrate-nitrogen is available. If the Regional Board approves this demonstration, then the discharger would be regulated accordingly.

As indicated in Table 5-3, it will be assumed for most regulatory purposes that there is no assimilative capacity for TDS in the Orange County groundwater management zone. The 20 mg/L of management zone-wide TDS assimilative capacity calculated for this zone will be allocated to discharges resulting from groundwater remediation and other legacy contaminant removal projects implemented within the Orange County Management Zone.

Tables 5-3 and 5-4 show the assimilative capacity available in management zones for which “maximum benefit” objectives have been specified. As described in Chapter 4

¹ As noted in Chapter 4, ammonia-nitrogen and nitrite-nitrogen data were also included in the analysis, where available. This occurred for a very limited number of cases and ammonia-nitrogen and nitrite-nitrogen concentrations were insignificant.

and later in this Chapter, the application of these objectives is contingent on the implementation of certain projects and programs by specific dischargers as part of their maximum benefit demonstrations. Assimilative capacity created by these projects/programs will be allocated to the party(-ies) responsible for implementing them.

Chapter 3 delineates the Prado Basin Management Zone, and Chapter 4 identifies the applicable TDS and nitrogen objectives for this Zone (the objectives for the surface waters that flow in this Zone). No assimilative capacity exists in this zone.

These assimilative capacity findings are significant from a regulatory perspective. If there is assimilative capacity in the receiving waters for TDS, nitrogen or other constituents, a waste discharge may be of poorer quality than the objectives for those constituents for the receiving waters, as long as the discharge does not cause violation of the objectives and provided that antidegradation requirements are met. However, if there is no assimilative capacity in the receiving waters, such as the management zones identified in Tables 5-3 and 5-4, the numerical limits in the discharge requirements cannot exceed the receiving water objectives or the degradation process would be accelerated.² This rule was expressed clearly by the State Water Resources Control Board in a decision regarding the appropriate TDS discharge limitations for the Rancho Caballero Mobilehome park located in the Santa Ana Region (Order No. 73-4, the so called “Rancho Caballero decision”) [Ref. 7]. However, this rule is not meant to restrict overlying agricultural irrigation, or similar activities, such as landscape irrigation. Even in management zones without assimilative capacity, groundwater may be pumped, used for agricultural purposes in the area and returned to the management zone from which it originated.

In regulating waste discharges to waters with assimilative capacity, the Regional Board will proceed as follows. (see also Section III.B.6., Special Considerations – Subsurface Disposal Systems).

If a discharger proposes to discharge wastes that are at or below (i.e., better than) the current ambient TDS and/or nitrogen water quality, then the discharge will not be expected to result in the lowering of water quality, and no antidegradation analysis will be required. TDS and nitrogen objectives are expected to be met. Such discharges clearly implement the Basin Plan and the Board can permit them to proceed. Of course, other pertinent requirements, such as those of the California Environmental Quality Act (CEQA) must also be satisfied. For groundwater management zones, current ambient quality is as defined in Table 5-3 and Table 5-4, or as these Tables may be revised (through the Basin Plan amendment process) pursuant to the detailed monitoring program to be conducted by dischargers in the watershed (see Section V., Salt Management Plan – Monitoring Program Requirements).

² A discharger may conduct analyses to demonstrate that discharges at levels higher than the objectives would not cause or contribute to the violation of the established objectives. See, for example, the discussion of wasteload allocations for discharges to the Santa Ana River and its tributaries (Section III. B. 4.) If the Regional Board approves this demonstration, then the discharger would be regulated accordingly.

If a discharger proposes to discharge wastes that exceed the current ambient TDS and/or nitrogen quality, then the Board will require the discharger to conduct an appropriate antidegradation analysis. The purpose of this analysis will be to demonstrate whether and to what extent the proposed discharge would result in a lowering of ambient water quality in affected receiving waters. That is, to what extent, if any, would the discharge use available assimilative capacity. If the discharger demonstrates that no lowering of water quality would occur, then antidegradation requirements are met, water quality objectives will be achieved, and the Regional Board can permit such discharges to proceed. If the analysis indicates that a lowering of current ambient water quality would occur, other than on a minor or temporally or spatially limited basis, then the discharger must demonstrate that: (1) beneficial uses would continue to be protected and the established water quality objectives would be met; and (2) that the resultant water quality would be consistent with maximum benefit to the people of California; and, (3) that best practicable treatment or control has been implemented. Best practical treatment or control means levels that can be achieved using best efforts and reasonable control methods. For affected receiving waters, the discharger must estimate the amount of assimilative capacity that would be used by the discharger. The Regional Board would employ its discretion in determining the amount of assimilative capacity that would be allocated to the discharger. Rather than allocating assimilative capacity, the Regional Board may require the discharger to mitigate or offset discharges that would result in the lowering of water quality.

Again, discharges to waters without assimilative capacity for TDS and/or nitrogen must be held to the objectives of the affected receiving waters (with the caveat identified in footnote 2 previous page). In some cases, compliance with management zone TDS objectives for discharges to waters without assimilative capacity may be difficult to achieve. Poor quality water supplies or the need to add certain salts during the treatment process to achieve compliance with other discharge limitations (e.g., addition of ferric chloride) could render compliance with strict TDS limits very difficult. The Regional Board addresses such situations by providing dischargers with the opportunity to participate in TDS offset programs, such as the use of desalters, in lieu of compliance with numerical TDS limits. These offset provisions are incorporated into waste discharge requirements. Provided that the discharger takes all reasonable steps to improve the quality of the waters influent to the treatment facility (such as through source control or improved water supplies), and provided that chemical additions are minimized, the discharger can proceed with an acceptable program to offset the effects of TDS discharges in excess of the permit limits.

Similarly, compliance with the nitrate-nitrogen objectives for groundwaters specified in this Plan would be difficult in many cases. Offset provision may apply to nitrogen discharges as well.

An alternative that dischargers might pursue in these circumstances is revision of the TDS or nitrogen objectives, through the Basin Plan amendment process. Consideration of less stringent objectives would necessitate comprehensive antidegradation review, including the demonstrations that beneficial uses would be protected and that water quality consistent with maximum benefit to the people of the State would be maintained.

As discussed in Chapter 4 and later in this Chapter, a number of dischargers have pursued this “maximum benefit objective” approach, leading to the inclusion of “maximum benefit” objectives and implementation strategies in this Basin Plan. Discharges to areas where the “maximum benefit” objectives apply will be regulated in conformance with these implementation strategies. Any assimilative capacity created by the maximum benefit programs will be allocated to the parties responsible for implementing them.

**Table 5-3
Total Dissolved Solids (TDS) Assimilative Capacity Findings**

Management Zone	Water Quality Objective (mg/L)	Current Ambient (mg/L)	Assimilative Capacity (mg/L)
UPPER SANTA ANA RIVER BASIN			
Beaumont – “max benefit” ³	330	290	40
Beaumont – “antideg”	230	290	None
Bunker Hill A	310	350	None
Bunker Hill B	330	260	70
Colton	410	430	None
Chino North – “max benefit”	420	300	120
Chino 1 – “antideg”	280	310	None
Chino 2 – “antideg”	250	300	None
Chino 3 – “antideg”	260	280	None
Chino South	680	720	None
Chino East	730	760	None
Cucamonga – “max benefit” ³	380	260	120
Cucamonga – “anti-deg”	210	260	None
Lytle	260	240	20
Rialto	230	230	None
San Timoteo – “max benefit” ³	400	300	100
San Timoteo – “anti-deg”	300	300	None
Yucaipa – “max benefit” ³	370	330	40
Yucaipa – “antideg”	320	330	None
MIDDLE SANTA ANA RIVER BASIN			
Arlington	980	-- ¹	None
Bedford	-- ¹	-- ¹	None
Coldwater	380	380	None
Elsinore	480	480	None
Lee Lake	-- ¹	-- ¹	None
Riverside A	560	440	120
Riverside B	290	320	None
Riverside C	680	760	None
Riverside D	810	-- ¹	None
Riverside E	720	720	None
Riverside F	660	580	80
Temescal	770	780	None
Warm Springs	-- ¹	-- ¹	None
SAN JACINTO RIVER BASINS			
Canyon	230	220	10
Hemet South	730	1030	None
Lakeview – Hemet North	520	830	None
Menifee	1020	3360	None
Perris North	570	750	None
Perris South	1260	3190	None
San Jacinto Lower	520	730	None
San Jacinto Upper	320	370	None
LOWER SANTA ANA RIVER BASINS			
Irvine	910	910	None
La Habra	-- ¹	-- ¹	None
Orange County ²	580	560	None ²
Santiago	-- ¹	-- ¹	None

¹ Not enough data to estimate TDS concentrations; management zone is presumed to have no assimilative capacity. If assimilative capacity is demonstrated by an existing or proposed discharger, that discharge would be regulated accordingly.

² For the purposes of regulating discharges other than those associated with projects implemented within the Orange County Management Zone to facilitate remediation projects and/or to address legacy contamination, no assimilative capacity is assumed to exist

³ Assimilative capacity created by “maximum benefit” objectives is allocated solely to agency(ies) responsible for “maximum benefit” implementation (see Section VI.).

**Table 5-4
Nitrate Nitrogen (NO₃-N) Assimilative Capacity Findings**

Management Zone	Water Quality Objective (mg/L)	Current Ambient (mg/L)	Assimilative Capacity (mg/L)
UPPER SANTA ANA RIVER BASINS			
Beaumont – “max benefit” ³	5.0	2.6	2.4
Beaumont – “antideg”	1.5	2.6	None
Bunker Hill A	2.7	4.5	None
Bunker Hill B	7.3	5.5	1.8
Colton	2.7	2.9	None
Chino North – “max benefit” ³	5.0	7.4	None
Chino 1 – “antideg”	5.0	8.4	None
Chino 2 – “antideg”	2.9	7.2	None
Chino 3 – “antideg”	3.5	6.3	None
Chino South	4.2	8.8	None
Chino East	10	29.1	None
Cucamonga – “max benefit” ³	5.0	4.4	0.6
Cucamonga – “anti-deg”	2.4	4.4	None
Lytle	1.5	2.8	None
Rialto	2.0	2.7	None
San Timoteo – “max benefit” ³	5.0	2.9	2.1
San Timoteo – “anti-deg”	2.7	2.9	None
Yucaipa – “max benefit” ³	5.0	5.2	None
Yucaipa – “antideg”	4.2	5.2	None
MIDDLE SANTA ANA RIVER BASINS			
Arlington	10.0	-- ¹	None
Bedford	-- ¹	-- ¹	None
Coldwater	1.5	2.6	None
Elsinore	1.0	2.6	None
Lee Lake	-- ¹	-- ¹	None
Riverside A	6.2	4.4	1.8
Riverside B	7.6	8.0	None
Riverside C	8.3	15.5	None
Riverside D	10.0	-- ¹	None
Riverside E	10.0	14.8	None
Riverside F	9.5	9.5	None
Temescal	10.0	13.2	None
Warm Springs	-- ¹	-- ¹	None
SAN JACINTO RIVER BASINS			
Canyon	2.5	1.6	0.9
Hemet South	4.1	5.2	None
Lakeview – Hemet North	1.8	2.7	None
Menifee	2.8	5.4	None
Perris North	5.2	4.7	0.5
Perris South	2.5	4.9	None
San Jacinto Lower	1.0	1.9	None
San Jacinto Upper	1.4	1.9	None
LOWER SANTA ANA RIVER BASINS			
Irvine	5.9	7.4	None
La Habra	-- ¹	-- ¹	None
Orange County	3.4	3.4	None
Santiago	-- ¹	-- ¹	None

¹ Not enough data to estimate nitrate nitrogen concentrations

² Assimilative capacity created by “maximum benefit” objectives is allocated solely to agency(ies) responsible for “maximum benefit” implementation (see Section VI.).

2. Mineral Increments

The fundamental philosophy of TDS management plans in Santa Ana Region Basin Plans to date has been to allow a reasonable use of the water, to treat the wastewater generated appropriately, and to allow it to flow downstream (or to lower groundwater basins) for reuse. "Reasonable use" is defined in terms of appropriate mineral increments that can be applied to water supply quality in setting discharge limitations.

The Department of Water Resources has recommended values for the maximum use incremental additions of specific ions that should be allowed through use, based on detailed study of water supplies and wastewater quality in the Region [Ref. 8]. Their recommendations are as follows:

Sodium	70 mg/L
Sulfate	40 mg/L
Chloride	65 mg/L
TDS	250 mg/L
Total Hardness	30 mg/L

These mineral increments were incorporated into the 1983 Basin Plan. They will be incorporated into waste discharge requirements when appropriate and necessary.

3. Nitrogen Loss Coefficients

The Regional Board's regulatory program has long recognized that some nitrogen transformation and loss can occur when wastewater is discharged to surface waters or reused for landscape irrigation. For example, the Total Inorganic Nitrogen (TIN) wasteload allocation adopted for the Santa Ana River in 1991 included unidentified nitrogen losses in the surface flows in Reach 3 of the River. Waste discharge requirements have allowed for nitrogen losses due to plant uptake when recycled water is used for irrigation.

In contrast, nitrogen has been considered a conservative constituent in the subsurface, not subject to significant transformation or loss, and no such losses have been identified or assumed for regulatory purposes.

One of the tasks included in the Nitrogen/TDS Task Force studies leading to the 2004 update of the N/TDS Management Plan was the consideration of subsurface transformation and loss. One objective of this task was to determine whether dischargers might be required to incur costs for additional treatment to meet the new groundwater management zone nitrate-nitrogen objectives (Chapter 4), or whether natural, subsurface nitrogen losses could achieve any requisite reductions. The second objective was to develop a nitrogen loss coefficient that could be used with certainty to develop appropriate limits for nitrogen discharges throughout the Region.

To meet these objectives, the Nitrogen/TDS study consultant, Wildermuth Environmental, Inc. (WEI), evaluated specific recharge operations (e.g., the Orange County Water District recharge ponds overlying the Orange County Forebay), wastewater treatment wetlands (e.g., the Hidden Valley Wildlife Area, operated by the City of Riverside) and Santa Ana River recharge losses (for the Santa Ana River, water quality in reaches where recharge is occurring (“losing” reaches) was compared with local well data). In each case, WEI evaluated long-term (1954 to 1997) nitrogen surface water quality data and compared those values to long-term nitrogen data for adjacent wells.

Based on this evaluation, a range of nitrogen loss coefficients was identified. [Ref. 1] In light of this variability, the N/TDS Task Force recommended that a conservative approach to be taken in establishing a loss coefficient. The Task Force recommended that a region-wide default nitrogen loss of 25% be applied to all discharges that affect groundwater in the Region. The Task Force also recommended that confirmatory, follow-up monitoring be required when a discharger requested and was granted the application of a nitrogen loss coefficient greater than 25%, based on site-specific data submitted by that discharger.

The City of Riverside also presented data to the Task Force regarding nitrogen transformation and losses associated with wetlands. These data support a nitrogen loss coefficient of 50%, rather than 25%, for the lower portions of Reach 3 of the Santa Ana River that overlie the Chino South groundwater management zone. [Ref. 9]. In fact, the data indicate that nitrogen losses from wetlands in this part of Reach 3 can be greater than 90%. However, given the limited database, the Task Force again recommended a conservative approach, i.e., 50% in this area, with confirmatory monitoring.

The 25% and, where appropriate, 50% nitrogen loss coefficients will be used in developing nitrogen discharge limits. These coefficients will be applied to discharges that affect groundwater management zones with and without assimilative capacity.

For discharges to groundwater management zones with assimilative capacity, the TIN discharge limitation would be calculated as follows:

$$\text{TIN Discharge Limit (mg/L)} = \frac{\text{management zone nitrate-nitrogen current ambient water quality}}{(1 - \text{nitrogen loss coefficient})}$$

The Regional Board will employ its discretion in specifying a higher TIN limit that would allocate some of the available assimilative capacity.

For discharges to groundwater management zones without assimilative capacity, the TIN discharge limitation would be calculated as follows:

$$\text{TIN Discharge Limit (mg/L)} = \frac{\text{management zone nitrate-nitrogen water water quality objective}}{(1 - \text{nitrogen loss coefficient})}$$

These coefficients do not apply to discharges specifically addressed by the TIN wasteload allocation, described in the next section, since surface and subsurface nitrogen losses were accounted for in developing this allocation.

4. TDS and Nitrogen Wasteload Allocations for the Santa Ana River

Wasteload allocations for regulating discharges of TDS and total inorganic nitrogen (TIN) to the Santa Ana River, and thence to groundwater management zones recharged by the River, are an important component of salt management for the Santa Ana Basin. As described earlier, the Santa Ana River is a significant source of recharge to groundwater management zones underlying the River and, downstream, to the Orange County groundwater basin. The quality of the River thus has a significant effect on the quality of the Region's groundwater, which is used by more than 5 million people. Control of River quality is appropriately one of the Regional Board's highest priorities.

Sampling and modeling analyses conducted in the 1980's and early 1990's indicated that the TDS and total nitrogen water quality objectives for the Santa Ana River were being violated or were in danger of being violated. Under the Clean Water Act (Section 303(d)(1)(c); 33 USC 466 *et seq.*), violations of water quality objectives for surface waters must be addressed by the calculation of the maximum wasteloads that can be discharged to achieve and maintain compliance. Accordingly, TDS and nitrogen wasteload allocations were developed and included in the 1983 Basin Plan. The nitrogen wasteload allocation was updated in 1991; an updated TDS wasteload allocated was included in the 1995 Basin Plan when it was adopted and approved in 1994/1995.

The wasteload allocations distribute a share of the total TDS and TIN wasteloads to each of the discharges to the River or its tributaries. The allocations are implemented principally through TDS and nitrogen limits in waste discharge requirements issued to municipal wastewater treatment facilities (Publicly Owned Treatment Works or POTWs) that discharge to the River, either directly or indirectly³. Nonpoint source inputs of TDS and nitrogen to the River are also considered in the development of these wasteload allocations. Controls on these inputs are more difficult to identify and achieve and may be addressed through the areawide stormwater permits issued to the counties by the Regional Board or through other programs. For example, the Orange County Water District has constructed and operates more than 400 acres of wetlands ponds in the

³ With some exceptions that may result from groundwater pumping practices, the ground and surface waters in the upper Santa Ana Basin (upstream of Prado Dam) eventually enter the Santa Ana River and flow through Prado Dam. Discharges to these waters will therefore eventually affect the quality of the River and must be regulated so as to protect both the immediate receiving waters and other affected waters, including the River.

Prado Basin Management Zone to remove nitrogen in flows diverted from, and then returned to, the Santa Ana River.

Because of the implementation of these wasteload allocations, the Orange County Water District wetlands and other measures, the TDS and TIN water quality objectives for the Santa Ana River at Prado Dam are no longer being violated, as shown by annual sampling of the River at the Dam by Regional Board staff [Ref. 10A]. However, as part of the Nitrogen/TDS Task Force studies to update the TDS/nitrogen management plan for the Santa Ana Basin, a review of the TDS and TIN wasteload allocations initially contained in this Basin Plan was conducted. In part, this review was necessary in light of the new groundwater management zones and TDS and nitrate-nitrogen objectives for those zones recommended by the N/TDS Task Force (and now incorporated in Chapters 3 and 4). The wasteload allocations were evaluated and revised to ensure that the POTW discharges would assure compliance with established surface water objectives and would not cause or contribute to violation of the groundwater management zone objectives. The Task Force members also recognized that this evaluation was necessary to determine the economic implications of assuring conformance with the new management zone objectives. Economics is one of the factors that must be considered when establishing new objectives (Water Code Section 13241).

WEI performed the wasteload allocation analysis for both TDS and TIN [Ref. 3, 5]. In contrast to previous wasteload allocation work, the QUAL-2e model was not used for this analysis. Further, the Basin Planning Procedure (BPP) was not used to provide relevant groundwater data. Instead, WEI developed a projection tool using a surface water flow/quality model and a continuous-flow stirred-tank reactor (CFSTR) model for TDS and TIN. The surface water Waste Load Allocation Model (WLAM) is organized into two major components – RUNOFF (RU) and ROUTER (RO). RU computes runoff from the land surface and RO routes the runoff estimated with RU through the drainage system in the upper Santa Ana watershed. Both the RU and RO models contain hydrologic, hydraulic and water quality components.

To ensure that all hydrologic regimes were taken into account, hydrologic and land use data from 1950 through 1999 were used in the analysis. The analysis took into account the TDS and nitrogen quality of wastewater discharges, precipitation and overland runoff, instream flows and groundwater. Off-stream and in-stream percolation rates, rising groundwater quantity and quality, and the 25% and 50% nitrogen loss coefficients described in the preceding section were also factored into the analysis. The purpose of the modeling exercise was to estimate discharge, TDS and TIN concentrations in the Santa Ana River and tributaries and in stream bed recharge. These data were then compared to relevant surface and groundwater quality objectives to determine whether changes in TDS and TIN regulation were necessary.

Discharges from POTWs to the Santa Ana River or its tributaries were the focus of the analysis. POTW discharges to percolation ponds were not considered. The wasteload

allocation analysis assumed, correctly, that these direct groundwater discharges will be regulated pursuant to the management zone objectives, findings of assimilative capacity and nitrogen loss coefficients identified in Chapter 4 and earlier in this chapter.

The surface waters evaluated included the Santa Ana River, Reaches 3 and 4, ChinoCreek, Cucamonga/Mill Creek and San Timoteo Creek. Management zones that are directly under the influence of these surface waters and that receive wastewater discharges were evaluated. These included the San Timoteo, Riverside A, Chino South, and Orange County Management Zones⁴. In addition, wastewater discharges to the Prado Basin Management Zone were also evaluated.

WEI performed three model evaluations in order to assess wasteload allocation scenarios through the year 2010. These included a “baseline plan” and two alternative plans (“2010-A” and “2010-B”). The baseline plan generally assumed the TDS and TIN limits and design flows for POTWs specified in waste discharge requirements as of 2001. These limits implemented the wasteload allocations specified in the 1995 Basin Plan when it was approved in 1995. A TDS limit of 550 mg/L was assumed for the Rapid Infiltration and Extraction Facility (RIX) and the analysis assumed a 540 mg/L TDS for the City of Beaumont. The baseline plan also assumed reclamation activities at the level specified in the 1995 Basin Plan, when it was approved. The purpose of the baseline plan assessment was to provide an accurate basis of comparison for the results of evaluation of the two alternative plans. For alternative 2010-A, it was generally assumed that year 2001 discharge effluent limits for TDS and TIN applied to POTW discharges, but projected year 2010 surface water discharge amounts were applied. TDS limits of 550 mg/L and 540 mg/L were again assumed for RIX and the City of Beaumont discharges. The same limited reclamation and reuse included in the baseline plan was assumed (see Table 5-7 in Section III.B.5.). For alternative 2010-B, POTW discharges were also generally limited to the 2001 TDS and TIN effluent limits (RIX was again held to 550 mg/L and Beaumont to 540 mg/L). However, in this case, large increases in wastewater recycling and reuse were assumed (Table 5-7), resulting in the reduced surface water discharges projected for 2010.

Analysis of the model results demonstrated that the TDS and nitrogen objectives of affected surface waters would be met and that water quality consistent with the groundwater management zone objectives would be achieved under both alternatives. It is likely that water supply and wastewater agencies will implement reclamation projects with volumes that are in the range of the two alternatives. The wasteload allocations would be protective throughout the range of surface water discharges identified. The year 2010 flow values are not intended as limits on POTW flows; rather, these flows were derived from population assumptions and agency estimates and are

⁴ The City of Beaumont discharges to Coopers Creek in a subunit of the Beaumont Management Zone. However, for analytical and regulatory purposes, it is considered a discharge to the San Timoteo Management Zone since it enters that Management Zone essentially immediately. Recharge of wastewater discharges by YVWD and Beaumont in downgradient management zones that may be affected by surface water discharges (e.g., Bunker Hill B, Colton) is not expected to be significant. Therefore, these management zones were not evaluated as part of the wasteload allocation analysis.

used in the models for quality projections. Surface water discharges significantly different than those projected will necessitate additional model analyses to confirm the propriety of the allocations.

The wasteload allocations for TDS and TIN are specified in Table 5-5. Allocations based on the 2010-A and 2010-B alternatives are shown for both TDS and TIN to reflect the expected differences in surface water discharge flows that would result from variations in the amount of wastewater recycling actually accomplished in the Region. As shown in this Table, irrespective of these differences, the TDS and TIN allocations remain the same.

It is essential to point out that the wasteload allocations in Table 5-5 will be not be used to specify TDS and TIN effluent limitations for wastewater recycling (reuse for irrigation) and recharge by the listed POTWs, but will be applied only to the surface water discharges by these POTWs to the Santa Ana River and its tributaries. TDS and TIN limitations for wastewater recycling and recharge by these POTWs will be based on the water quality objectives for affected groundwater management zones or, where appropriate, surface waters. These limitations are likely to be different than the wasteload allocations specified in Table 5-5.

For most dischargers, the allocations specified in Table 5-5 are the same as those specified in the prior 1995 Basin Plan TDS and TIN wasteload allocations. However, for certain dischargers, two sets of TDS and TIN wasteload allocations are shown in Table 5-5. One set is based on the assumption that the “maximum benefit” objectives defined in Chapter 4 for the applicable groundwater management zones are in effect. The other set of wasteload allocations applies if maximum benefit is not demonstrated and the antidegradation objectives for these management zones are therefore in effect. Maximum benefit implementation is described in Section VI. of this Chapter.

In addition, in contrast to the prior wasteload allocations, a single wasteload allocation for TDS and TIN that would be applied on a flow-weighted average basis to all of the treatment plants operated by the Inland Empire Utilities Agency as a whole is specified. These allocations are based on the water quality objectives for Chino Creek, Reach 1B (550 mg/L TDS and 8 mg/L TIN), to which the IEUA discharges occur, directly or indirectly. As described in Section VI, IEUA proposes to implement a “maximum benefit” program to support the implementation of the “maximum benefit” TDS and nitrate-nitrogen objectives for the Chino North and Cucamonga Management Zones. Separate “maximum benefit” and “antidegradation” wasteload allocations are not necessary for IEUA, as they are for YVWD and Beaumont. This is because the IEUA wasteload allocations are based solely on the Chino Creek objectives and are not contingent on “maximum benefit” objectives or implementation. The IEUA surface water discharges do not affect the groundwater management zones for which “maximum benefit” objectives are to be implemented.

Finally, the TDS wasteload allocation for the RIX facility is less stringent (550 mg/L) than the prior wasteload allocation. The new allocation will assure beneficial use protection and will not result in a significant lowering of water quality. As such, it is consistent with antidegradation requirements. Given this, the less stringent effluent limitation can be specified pursuant to the exception to the prohibition against backsliding established in the Clean Water Act, Section 303(d)(4)(a).

In most cases, the surface water discharges identified in Table 5-5 will affect or have the potential to affect groundwater management zones without assimilative capacity for TDS and/or nitrogen. As discussed earlier in this section, the lack of assimilative capacity normally dictates the application of the water quality objectives of the affected receiving waters as the appropriate waste discharge limitations. However, as shown in Table 5-5, the TIN and, in some cases, TDS wasteload allocations for these discharges exceed the objectives for these management zones. This is because the wasteload allocation analysis conducted by WEI demonstrated that POTW discharges at these higher-than-objective levels will not result in violations of the TDS and nitrate-nitrogen objectives of the affected management zones, or surface waters. Accordingly, these wasteload allocations will be used for surface water discharge regulatory purposes, rather than the underlying groundwater management zone objectives. If the extensive monitoring program to be conducted by the dischargers (see Salt Management Plan – Monitoring Program Requirements, below) indicates that this strategy is not effective, then this regulatory approach will be revisited and revised accordingly.

Table 5-5

Alternative Wasteload Allocations through 2010 based on “Maximum Benefit” or “Antidegradation” Water Quality¹

Publicly Owned Treatment Works (POTW)	Alternative 2010A – Reclamation in 1995 Basin Plan			Alternative 2010B – Reclamation Plans Advocated by POTWs/others		
	Surface Water Discharge (MGD)	TDS (mg/L)	TIN (mg/L)	Surface Water Discharge (MGD)	TDS (mg/L)	TIN (mg/L)
Beaumont – “max benefit” ²	2.3	490	6.0	1.0	490	6.0
Beaumont – “antideg” ^{2,3}	2.3	320 ³	4.1 ³	1.0	320 ³	4.1 ³
YVWD – Wochholz – “max benefit”	5.7	540	6.0	0.0	540	6.0
YVWD – Wochholz – “antideg” ³	5.7	320 ³	4.1 ³	0.0	320 ³	4.1 ³
Rialto	12.0	490	10.0	10.0	490	10.0
RIX	49.4	550	10.0	28.2	550	10.0
Riverside Regional WQCP	35.0	650	13.0	26.1	650	13.0
Western Riverside Co. WWTP	4.4	625	10.0	3.3	625	10.0
EMWD ⁴	43	650	10.0	6.0	650	10.0
EVMWD – Lake Elsinore Regional	7.2	700	13.0	2.0	700	13.0
Lee Lake WRF	1.6	650	13.0	1.6	650	13.0
Corona WWTP # 1	3.6	700	10.0	2.0	700	10.0
Corona WWTP # 2	0.2	700	10.0	0.5	700	10.0
Corona WWTP # 3	2.0	700	10.0	0.5	700	10.0
IEUA Facilities ⁵	80.0	550	8.0	37.4	550	8.0

1. “Antidegradation” wasteload allocation is the default allocation if the Regional Board determines that “maximum benefit” commitments are not being met.
2. Beaumont discharges to Coopers Creek, a tributary of San Timoteo Creek, Reach 4, it is a de facto discharge to San Timoteo Creek/San Timoteo Management Zone.
3. “Antidegradation” wasteload allocations for City of Beaumont and YVWD based on additional model analysis performed by WEI (WEI, October 2002).
4. EMWD discharges are expected to occur only during periods of wet weather.
5. IEUA facilities include the RP#1, Carbon Canyon WRP, RP#4 and RP#5; These facilities are to be regulated as a bubble (see text).

Ammonia

Total inorganic nitrogen is used for regulatory purposes in wasteload allocations and surface water discharge limits. It is the sum of nitrate, nitrite and ammonia. Ammonia dissociates under certain conditions to the toxic un-ionized form. Thus, nitrogen discharges to the Santa Ana River and other surface waters pose a threat to aquatic life and instream beneficial uses, as well as to the beneficial uses of affected groundwater.

Un-ionized ammonia objectives are specified in Chapter 4 of this Basin Plan for warmwater aquatic habitats, such as the Santa Ana River system. Table 5-6 specifies the ammonia limits necessary to achieve these objectives. These limits were derived using QUAL2E, the Colorado Ammonia Model, water quality data on the River and effluent quality.

The un-ionized ammonia objectives have not been approved by the United States Environmental Protection Agency (USEPA), which recommends that the objectives be reviewed and revised based on the Agency's revised national ammonia criteria. A review of the un-ionized ammonia objectives is included in the Regional Board's 2002 Triennial Review Priority List. Any revised objectives and revised ammonia effluent limits needed to achieve the revised objectives will be incorporated in future amendments to this Plan once the requisite review is completed.

Table 5-6
Effluent Limits for Total Ammonia Nitrogen¹

Discharge Location	Effluent Limit - Total Ammonia Nitrogen ² (mg/L)	
	Year 1995	Year 2000
San Timoteo Wash	5.0	4.5
Santa Ana River - Reach 4	5.0	4.5
Santa Ana River - Reach 3	5.0	5.0
Chino Creek	5.0	4.5
Mill Creek (Prado Area)	5.0	4.5
Temescal Creek	5.0	4.5
Other WARM designated waterbodies	Determined on a case-by-case basis	

¹ Total Ammonia Nitrogen Wasteload Allocation is specified in order to meet the site-specific Santa Ana River un-ionized ammonia objective (See Chapter 4).

² Total Ammonia Nitrogen = Un-ionized Ammonia Nitrogen (NH₃-N) + Ammonium Nitrogen (NH₄ + -N).

5. Wastewater Reclamation

Reclamation of wastewater for reuse (recycled water) is an important feature of wastewater and water management for the Santa Ana Region. The California Legislature has declared the primary interest of the people of California in the development of facilities to recycle wastewater to supplement existing water supplies and to meet future water demands (Water Code Section 13510-13512). State policy (State Board Resolution No. 77-1) affirms this commitment to encourage recycled water use. However, because reclamation projects tend to add to the salt balance problem in the Region, they must be carefully planned and implemented. The significant benefits that result from such projects include:

- The total water supply can be effectively increased, reducing the need for imports;
- Wastewater treatment costs can be reduced in some cases. Meeting the level of treatment required for discharge to surface waters may be more expensive than treating the effluent for use in irrigation;
- Stream flows can be established or enhanced, providing aquatic riparian habitat and allowing recreation and other beneficial uses of the stream;
- Downstream delivery commitments can often be met by discharges of appropriately treated wastewater.

Concerns related to wastewater reclamation projects include:

1. Mineral Quality Effects

The mineral quality of the receiving water (surface or groundwater) can be adversely affected. Each cycle of water use increases the salinity of the water. The amount of the increase depends on the type of use; normal domestic use generally adds 200-300 mg/L of TDS to the initial concentration. Agricultural use generally doubles the salinity, while industrial uses most often degrade water quality to a level where it may be unsuitable for discharge. Therefore, it is important that the type of reclaimed wastewater use and the likely effects on water quality be evaluated carefully prior to initiating such reuse. Certain waters in the upper Santa Ana Basin do not have assimilative capacity to accept the additional salinity that would be expected to result from reclamation.

2. Public Health Effects

Municipal wastewaters contain significant concentrations of bacteria, viruses, and organics. These wastewaters must be treated extensively to remove

pathogens before they can be reclaimed. Stable organics in reclaimed water are also cause for considerable concern. Chlorination of treated wastewater effluents can produce chlorinated hydrocarbons, some of which are carcinogenic. For this reason, the California State Department of Health Services is concerned with proposals that would return a high proportion of treated wastewater effluent into domestic water supply aquifers. Adequate treatment and dilution of the wastewater is essential. The Department is developing guidelines for the purposed use of reclaimed wastewater for groundwater recharge.

Because of the high percentage of wastewater in river baseflow, the Santa Ana River Water Quality and Health (SARWQH) Study was initiated by OCWD in 1994 to evaluate the use of the Santa Ana River to recharge the Orange County groundwater basin. The goal of the SARWQH Study was to characterize the quality of the Santa Ana River water and the quality of the groundwater basin it recharges. The study included an examination of hydrogeology, microbiology, water chemistry, toxicology and public health. The results of the study indicate that current recharge practices using Santa Ana River water are protective of public health.

3. Land Use Considerations

One of the major problems facing the future of wastewater reclamation is a decrease in the total amount of agricultural land in the basin. As the population of the basin increases, commercial and residential developments eliminate agricultural land and the need for irrigation waters. Some reclaimed wastewater may be used for irrigating landscaping in the new developments, but the volume utilized will almost certainly be reduced.

4. The Prado Settlement

On October 18, 1963, the Orange County Water District filed a class action lawsuit against the water users in the upper Santa Ana Basin, seeking an adjudication of water rights against substantially all the water users in the area tributary to Prado Dam in the Santa Ana River watershed. As a result of the 1969 settlement of this case, the wastewater dischargers in the upper basin are required to provide 42,000 acre-feet at Prado Dam. This can consist of treated wastewater effluent or imported water as well as certain natural flows (e.g., rising water); stormflows are not included. The amount of flow delivered is subject to adjustment based upon the TDS content of the water. Reclamation uses within the upper basin are thus limited to a degree by the need to ensure compliance with this settlement.

Wastewater is presently being reclaimed in the Santa Ana Watershed in a number of different ways:

1. Irrigation of Agricultural Land and Landscaping

Most of the direct reclamation of wastewater in the Region occurs as part of commercial agricultural and landscape irrigation, although this will change as recharge projects using recycled water are implemented (see below). This use is conducted under water reclamation requirements issued by the Regional Board, typically as part of Waste Discharge Requirements and NPDES permits. In the San Jacinto Watershed, most of the wastewater is reclaimed for agricultural uses.

2. Discharge to the Santa Ana River

Although it is not widely considered as such, discharges of treated wastewater to Reaches 3, 4 and 5 of the Santa Ana River constitute the largest single reclamation activity in the Region. These discharges make up as much as 95 percent of the river's dry weather flow and enhance the in-stream beneficial uses of the river throughout its 26-mile length (San Bernardino to Prado Dam). Essentially all of this water is recharged into the groundwater basin in Orange County

3. Groundwater Recharge by Percolation

This type of reclamation is common throughout the Region. Most wastewater treatment plants that do not discharge directly to the River discharge their effluent to percolation ponds. All of the treated wastewater in the upper Santa Ana Basin that is not directly reclaimed for commercial agricultural and landscape irrigation purposes, or discharged directly to the Santa Ana River, is returned to local or downstream groundwater management zones by percolation. In Orange County, reclaimed water is used for greenbelt and landscape irrigation, and injected into coastal aquifers to control sea water intrusion.

Significant additional reclamation activities are planned in the Region, as reflected in Table 5-7. The Chino Basin Watermaster, Inland Empire Utilities Agency, Yucaipa Valley Water District, the City of Beaumont and the San Timoteo Watershed Management Authority propose to implement extensive groundwater recharge projects using recycled water. To accommodate these projects and other water and wastewater management strategies, these agencies have made the requisite demonstrations necessary to support the "maximum benefit" TDS and nitrate-nitrogen water quality objectives specified in this Plan for certain groundwater management zones (see Chapter 4). The recharge projects will provide reliable sources of additional water supply needed to support expected development within the agencies' areas of jurisdiction. These agencies' "maximum benefit" programs are described in detail in Section VI. of this Chapter.

In Orange County, significant reclamation activities include the implementation of the Groundwater Replenishment System, a joint effort of the Orange County Water District and Orange County Sanitation District. Treated wastewater provided by the Sanitation District will receive extensive advanced treatment, including microfiltration, reverse osmosis, and disinfection using ultraviolet light and hydrogen peroxide. In the first phase of the project, approximately 70,000 acre-feet per year of highly treated recycled water will be produced and distributed to groundwater recharge facilities and to injection wells used to maintain a seawater intrusion barrier. The System will enhance both the quality and quantity of groundwater resources, the major source of water supply in the area. It will reduce the need for imported water and prevent, or at least delay, the need for an additional ocean outfall for disposal of the wastewater treated by the Sanitation District. Implementation of the GWR System will be phased. Operation of Phase 1 will begin in 2007. Future phases to expand the capacity of the GWR System are possible.

4. Dual Water Supply Systems

Given increasing demands for water supply but diminishing resources, there is great interest in using reclaimed water in office buildings and the like for flushing toilets and urinals. Clearly, the addition of this water supply source must be carefully planned and overseen to prevent public health problems. No dual systems have been implemented as yet in the upper basin; in Orange County, the Irvine Ranch Water District has implemented dual systems (a reclaimed water system in addition to a potable supply) in a number of office buildings in its service area, with the approval of the Department of Health Services and the Regional Board.

The Salt Management Plan draws a balance between the benefits and problems of reclamation by including carefully planned reclamation activities in the watershed. The Recommended Plan provides for reclamation within the upper basin, as shown in Table 5-7. All recycled water recharge projects will be regulated pursuant to the process identified in the discussion regarding assimilative capacity, and in accordance with the "maximum benefit" implementation strategies identified later in this Chapter (see section VI. Maximum Benefit Implementation Plans for Salt Management).

Recycled water used for landscape irrigation deserves special regulatory consideration. As discussed in the section on nitrogen loss coefficients, the Regional Board does not regulate nitrogen in recycled water used for landscape irrigation, recognizing the nitrogen losses that will occur as the result of plant uptake. The Nitrogen /TDS Task Force sponsored update of the TDS/Nitrogen Management Plan demonstrated that it is appropriate also to apply a 25 percent nitrogen loss coefficient to recycled water discharges applied to land to account for subsurface transformation and loss. Nitrogen losses due to plant uptake and subsurface transformation justify the Board's regulatory approach. With respect to

TDS, the water quality effects of recycled water used for landscape irrigation will be evaluated on a case-by-case basis and regulated accordingly.

6. Special Considerations – Subsurface Disposal Systems

In addition to establishing prohibitions and minimum lot size requirements for the use of subsurface disposal systems for sanitary wastes, the Regional Board issues waste discharge requirements where necessary to assure the protection of water quality and public health. In most cases, these requirements have been issued for commercial and industrial facilities, including mobile home parks, RV parks and truck washing operations, where the volume of waste is high and/or there is the potential for the discharge of wastes other than domestic sewage. Waste discharge requirements for individual residential systems and low volume (less than 500 gallons per day) domestic waste discharges from industrial and commercial facilities have been largely waived, pursuant to the waiver provisions of the Water Code (see discussion of waivers in the “Implementation through Waste Discharge Requirements” section, above). These waivers are conditional and may be revoked by the Regional Board at any time.

The Board has included TDS limitations in these waste discharge requirements in order to assure that the discharges are consistent with the TDS objectives of the affected receiving waters. These limits are expressed as both a maximum value that is based on the TDS objective of the receiving water, and a value that allows a reasonable use increment of 250 mg/L TDS above water supply quality. The more restrictive of the two TDS limits controls the allowed quality of the discharges.

TDS and nitrogen contributions from domestic waste discharges to existing commercial, industrial and residential subsurface disposal systems are reflected in the determinations of current ambient ground water quality and assimilative capacity (see preceding section – B.1.) on salt assimilative capacity). These determinations were made as part of the N/TDS Task Force sponsored update of the TDS/nitrogen management plan in this Basin Plan. These contributions are expected to decline over time as these discharges are eliminated through the expansion of regional sewer systems.

Compliance with TDS limits by these facilities is particularly problematic, since these facilities typically have little or no control over the TDS quality of water supplied to them, unlike POTWs. Further, sewerage of the discharges is often not an option, at least at the present time, although this is changing as rapid new development in many parts of the region continues to drive the expansion of sewer facilities. As systems expand, many of these discharges will be eliminated as they are connected to the sewers. Finally, the offset provisions that are applied to POTWs are unnecessary for existing residential commercial and industrial domestic waste discharges, given that they are addressed as part of the Regional Board’s minimum lot size program for subsurface disposal systems and through the updated TDS and

nitrogen management plan in this Basin Plan as part of the overlying land-use considerations and ambient water quality determinations.

Taking these factors into consideration, the waste discharge requirements that have been issued and will be updated periodically for domestic waste discharges from these existing residential, commercial and industrial facilities will include TDS requirements that specify a maximum mineral increment of 250 mg/L TDS to the water supply quality. This will assure reasonable use and prevent the disposal of highly saline wastes. Existing facilities are defined as those for which waste discharge requirements have been issued, or that have been built as of December 23, 2004.

**Table 5-7
Wastewater Reclamation**

Subbasin (Management Zone) Receiving Reclaimed Water	Source	Amount AF/Y 2010-A¹	Amount AF/Y 2010-B²
Beaumont MZ	Beaumont, City of	250	1,500
Yucaipa MZ	Yucaipa Valley Water District	--	6,400
Bunker Hill B MZ	San Bernardino, City of and Colton, City of	117	26,200
Colton MZ	Rialto, City of	200	
Chino North MZ	IEUA RP-1	1,200	48,000
Chino North MZ	IEUA RP-2A	2,470	
Chino North MZ	IEUA RP-4	3,300	
Chino North MZ	California Institute for Men	650	650
Chino North MZ	Upland Golf Course	31	31
Temescal MZ	Corona, City of	1,000	3,100
	TOTAL	9,218	86,000

¹ Wastewater reclamation assumed in 2010-A is the same as that assumed in the Basin Plan when approved in 1994/1995 (also known as Table 5-7)

² Wastewater reclamation assumed in 2010-B as identified by POTWs (see Ref. 3, 5).

IV. Other Projects and Programs

In addition to the regulatory efforts of the Regional Board described in the preceding section, water and wastewater purveyors and other parties in the watershed have implemented, and propose to implement, facilities and programs designed to address salt problems in the groundwater of the Region. These include the construction of brine lines and groundwater desalters, implementation of programs to enhance the recharge of high quality stormwater and imported water, where available, and re-injection of recycled water to maintain salt water intrusion barriers in coastal areas. These projects and programs are motivated by the need to protect and augment water supplies, as well as to facilitate compliance with waste discharge requirements.

A. Brine Lines

There are two brine line systems in the Region, the Santa Ana Regional Interceptor (SARI) and the older Chino Basin Non-Reclaimable Line (NRL). These lines are used to transport brine wastes out of the basin for treatment and disposal to the ocean. They are a significant part of industrial waste management and essential for operation of desalters in the upper watersheds. The SARI Line was constructed and is owned by SAWPA. It is approximately 93 miles of 16 inch to 84 inch pipeline connected to the Orange County Sanitation District treatment facilities. SAWPA owns capacity rights in SARI downstream of Prado Dam. The line extends from the Orange County Line near Prado Dam northeast to the San Bernardino area. Recently, the SARI Line has been extended to serve the San Jacinto Watershed. SARI Reach 5 extends up the Temescal Canyon from the City of Corona to the Eastern Municipal Water District (EMWD) brine line terminus in the Lake Elsinore area. EMWD's Menifee Desalter and other high salinity discharges from EMWD and Western Municipal Water District now have access to the brine line.

The Chino Basin Non-Reclaimable Line (NRL) is connected to the Los Angeles County Sanitation District sewer system in the Pomona area. The NRL, which is owned and operated by Inland Empire Utilities Agency, exports non-reclaimable industrial wastes and brine from the Chino Basin. It extends eastward from the Los Angeles County Line to the City of Fontana. It was originally built to serve industries including the Kaiser Steel Company and Southern California Edison Power Plants.

B. Groundwater Desalters

The studies leading to the development of the TDS/Nitrogen management plan included in this Basin Plan when it was approved in 1995 demonstrated that it was not realistic to achieve compliance with all the nitrogen and TDS objectives for the groundwater subbasins then identified within the Region. Long-term historic land use practices, particularly agriculture, have left an enormous legacy of salts that are now in the unsaturated soils overlying the groundwater subbasins (now, newly defined groundwater management zones). A significant amount of these salts will, over time, degrade groundwater quality. The programs of groundwater extraction, treatment, and

replenishment needed to completely address these historic salt loads were shown to far exceed the resources available to implement them.

While the boundaries of the groundwater management zones have been revised and new TDS and nitrate-nitrogen water quality objectives established, the salt legacy problem remains. The construction and operation of groundwater desalters to extract and treat poor quality groundwater continues to be an essential component of salt management in the Region. Such projects will be increasingly important to protect local water supplies and to provide supplemental, reliable sources of potable supplies.

A number of groundwater desalters have already been constructed, and more are planned. These facilities are described below.

1. Upper Santa Ana Basin

In the Upper Santa Ana Basin, the Santa Ana Watershed Project Authority constructed and operates the Arlington desalter. This desalter, with a capacity of about 7 MGD, treats water extracted from the Arlington Management Zone, which was heavily impacted by historic agricultural activities.

In the Chino Basin, the Chino Desalter Authority operates the Chino 1 desalter, which is planned for expansion from 8 MGD to 13 MGD capacity. Additional desalters and desalter capacity will be constructed as part of a “maximum benefit” proposal by the Chino Basin Watermaster and the Inland Empire Utilities Agency (see Section VI., Maximum Benefit Implementation Plans for Salt Management).

The City of Corona began operation of the Temescal desalter in late 2001. The desalter has a capacity of 10 MGD. The City is currently expanding the desalter by 5 MGD. It is expected to be operational in the early 2004. The product water is used to supplement current municipal supplies. The improved TDS quality of these supplies is an important part of the City’s efforts to assure compliance with waste discharge requirements.

In the San Timoteo Watershed areas, desalters will be implemented as necessary for the Yucaipa and Beaumont areas, as discussed in detail in Section VI., Maximum Benefit San Timoteo Watershed Salt Management Plan.

2. San Jacinto Watershed

EMWD operates the Menifee desalter, which has a capacity of about 3 MGD. Product water is added to the EMWD municipal supply system, and the waste brine is discharged to a non-reclaimable waste disposal system that is ultimately connected to the SAWPA SARI system. The desalter extracts groundwater from the Perris South and Menifee Management Zones, both of which are adversely affected by historic salt loads contributed largely by agricultural activities.

EMWD plans to construct a desalter with capacity of about 4.5 MGD to treat poor quality water extracted from the Perris South and Lakeview/Hemet North Management Zones. The purpose of this facility is to stop subsurface migration of poor quality groundwater from the Perris South Management Zone into the Lakeview/Hemet North Management Zone.

3. Orange County

The Tustin Nitrate Removal project, which began operation in 1996, added approximately 3,000 acre-feet of water annually to Tustin's domestic water supply. Treatment systems employing reverse osmosis and ion exchange are operating at two wells that had been shut down because of excessive nitrate concentrations. The Orange County Water District and Irvine Ranch Water District (IRWD) are moving forward with the Irvine Desalter, a dual-purpose regional groundwater remediation and water supply project located in the City of Irvine and its sphere of influence. The project consists of an extensive seven-well groundwater extraction and collection system, a treatment system, a five-mile brine disposal pipeline, a finished water delivery system, and ancillary facilities. While providing approximately 6,700 acre-feet per year to IRWD for potable supply, the desalter will extract and treat brackish groundwater and capture an overlapping regional plume of TCE-contaminated groundwater demonstrated to have originated from the U.S. Marine Corps Air Station-EI Toro.

C. Recharge of Stormwater and/or Imported Water

The Orange County Water District, San Bernardino Valley Water Conservation District and other agencies in the Region operate extensive facilities designed to enhance the capture and recharge of high quality stormwater. More such facilities are planned as part of "maximum benefit" proposals by the Chino Basin Watermaster/Inland Empire Utilities Agency, Yucaipa Valley Water District, San Timoteo Watershed Management Authority and the City of Beaumont (Section VI., Maximum Benefit Implementation Plans for Salt Management). These proposals also include efforts to import and recharge high quality State Water Project water, when it is available. These activities increase both the quantity and quality of available groundwater resources.

D. Sea Water Intrusion Barriers

The Orange County Water District operates advanced facilities designed to provide significantly enhanced tertiary treatment of secondary treated municipal wastewater from the Orange County Sanitation District's (Sanitation District) Fountain Valley Reclamation Plant No. 1. The recycled water is injected into a series of wells located along Ellis Avenue in the City of Fountain Valley to maintain the Talbert Gap Seawater Intrusion Barrier. The treatment facility, currently known as Water Factory 21, will be supplanted by the Groundwater Replenishment System (GWRS) being constructed jointly by Orange County Water District and the Sanitation District (see preceding section on wastewater reclamation).

V. Salt Management Plan -- Monitoring Program Requirements

California Water Code Section 13242 specifies that Basin Plan implementation plans must contain a description of the monitoring and surveillance programs to be undertaken to determine compliance with water quality objectives. The adoption of new groundwater TDS and nitrate-nitrogen water quality objectives (Chapter 4) in response to the studies sponsored by the N/TDS Task Force triggered the need to develop and implement a new, watershed-wide nitrogen/TDS monitoring program. The Task Force provided additional impetus for this comprehensive monitoring program. The Task Force recommended that future review and update of the salt management plan, including findings of assimilative capacity, appropriate changes to the wasteload allocations, etc., should be based on real-time data obtained through a rigorous monitoring program, rather than on model projections. As discussed earlier (see Section II., Update of the Total Dissolved Solids/Nitrogen Management Plan), the Task Force concluded that the development of new, workable modeling tools to assist in this review was beyond the scope and financial capability of the Task Force.

The monitoring program must consist of both surface water and groundwater components. Some of these are already being implemented, including the annual sampling of the Santa Ana River, Reach 3 at Prado Dam by Regional Board staff (see Chapter 4 and below). Certain agencies have committed to conduct monitoring of specific water bodies as part of their "maximum benefit" proposals (see Section VI., Maximum Benefit Implementation Plans for Salt Management, below). The N/TDS Task Force members, and other parties as appropriate, will be required to propose a comprehensive monitoring program that would integrate these existing commitments with other monitoring recommendations. These parties will be required to implement this program upon approval by the Regional Board.

A. Surface Water Monitoring Program Requirements for TDS and Nitrogen

Implementation of a surface water monitoring program is needed to determine compliance with the nitrogen and TDS objectives of the Santa Ana River, and thereby, the effectiveness of the wasteload allocations. It is also needed to provide

data required to evaluate the effects of surface water discharges on affected groundwater management zones. In particular, data are needed to confirm the validity of the 50% nitrogen loss coefficient that will be applied in regulating discharges to that part of Reach 3 of the River that overlies the Chino South groundwater management zone (see Section III.B.3., Nitrogen loss coefficients).

As discussed in Chapter 4, the Basin Plan specifies baseflow TDS and total nitrogen objectives for Reach 3 of the River. For Reach 2, a TDS objective based on a five-year moving average of the annual TDS concentration is specified. Use of this moving average allows the effects of wet and dry years to be integrated over the five-year period and reflects the actual long-term quality of water recharged by Orange County Water District downstream of Prado Dam.

The Basin Plan specifies a monitoring program to determine compliance with the Reach 3 baseflow objectives at Prado Dam (see Chapter 4). As noted above, Regional Board staff conducts this program on an annual basis. Measurement of baseflow quality, rather than the quality of flows in Reach 2, has long been used to indicate the effects of recharge of Santa Ana River flows on Orange County groundwater. The efficacy of this approach was evaluated as part of the 2004 update of the TDS/nitrogen management plan in the Basin Plan. Insufficient data were available to draw a direct correlation between the long-term TDS and nitrogen quality of River flows at Prado Dam and that of affected Orange County groundwater. However, the conclusion drawn was that reliance on the Reach 3 baseflow objectives to protect Orange County groundwater, and the existing monitoring program designed to measure compliance, is adequate.

In addition to this baseflow sampling program and the surface water monitoring commitments associated with certain agencies' "maximum benefit" programs, the comprehensive monitoring program to be proposed and implemented by the Task Force members, and other agencies as appropriate, must include an evaluation of compliance with the TDS and nitrogen objectives for Reaches 2, 4 and 5 of the Santa Ana River. Compliance with the Reach 2 TDS objective can be determined by evaluation of data collected by the Santa Ana River Watermaster, Orange County Water District, the United States Geological Survey, and others.

Surface water monitoring program requirements for TDS and nitrogen are as follows:

1. No later than March 23, 2005, Orange County Water District, Inland Empire Utilities Agency, Chino Basin Watermaster, City of Riverside, City of Corona, Elsinore Valley Municipal Water District, Eastern Municipal Water District, City of Colton, City of San Bernardino Municipal Water Department, Jurupa Community Services District, Western Riverside County Regional Wastewater Authority, Lee Lake Water District, Yucaipa Valley Water District, City of Beaumont, the San Timoteo Watershed Management Authority and the City of Rialto shall submit to the Regional Board for approval, a proposed surface water TDS and nitrogen

monitoring program that will provide an evaluation of compliance with the TDS and nitrogen objectives for Reaches 2, 4 and 5 of the Santa Ana River.

In lieu of this coordinated monitoring plan, one or more of the parties identified in the preceding paragraph may submit an individual or group monitoring plan. Any such individual or group monitoring plan shall also be submitted no later than March 23, 2005.

2. By August 1st of each year, the Orange County Water District, Inland Empire Utilities Agency, City of Riverside, City of Corona, Elsinore Valley Municipal Water District, Eastern Municipal Water District, Lee Lake Water District, City of Colton, City of San Bernardino Municipal Water Department, Jurupa Community Services District, Western Riverside County Regional Wastewater Authority, Yucaipa Valley Water District, City of Beaumont, and the City of Rialto, shall submit an annual report of Santa Ana River, Reach 2, 4 and 5 water quality. Data evaluated shall include that collected by the Santa Ana River Watermaster, Orange County Water District, and the US Geologic Survey, at a minimum.

In lieu of this coordinated annual report, one or more of the parties identified in the preceding paragraph may submit an individual or group annual report. Any such individual or group report shall also be submitted by August 15th of each year.

Additional surface water monitoring programs may be specified by the Regional Board depending upon watershed conditions, waste discharge specifications and/or any special studies related to TDS and nitrogen.

B. Groundwater Monitoring Program for TDS and Nitrogen

Implementation of a watershed-wide TDS/nitrogen groundwater monitoring program is necessary to assess current water quality, to determine whether TDS and nitrate-nitrogen water quality objectives for management zones are being met or exceeded, and to update assimilative capacity findings. Groundwater monitoring is also needed to fill data gaps for those management zones with insufficient data to calculate TDS and nitrate-nitrogen historical quality and current quality. Finally, groundwater monitoring is needed to assess the effects of POTW discharges to surface waters on affected groundwater management zones.

Groundwater monitoring requirements for TDS and nitrogen are as follows:

No later than June 23, 2005, Orange County Water District, Irvine Ranch Water District, Inland Empire Utilities Agency, Chino Basin Watermaster, City of Riverside, City of Corona, Elsinore Valley Municipal Water District, Eastern Municipal Water District, City of Colton, City of San Bernardino Municipal Water Department, City of Redlands, Jurupa Community Services District, Western Riverside County Regional

Wastewater Authority, Lee Lake Water District, Yucaipa Valley Water District, City of Beaumont, the San Timoteo Watershed Management Authority and the City of Rialto shall submit to the Regional Board for approval, a proposed watershed-wide TDS and nitrogen monitoring program that will provide data necessary to review and update the TDS/nitrogen management plan. Data to be collected and analyzed shall address, at a minimum: (1) determination of current ambient quality in groundwater management zones; (2) determination of compliance with TDS and nitrate-nitrogen objectives for the management zones; (3) evaluation of assimilative capacity findings for groundwater management zones; and (4) assessment of the effects of recharge of surface water POTW discharges on the quality of affected groundwater management zones. The determination of current ambient quality shall be accomplished using methodology consistent with that employed by the Nitrogen/TDS Task Force (20-year running averages) to develop the TDS and nitrogen water quality objectives included in this Basin Plan. [Ref. 1] The determination of current ambient groundwater quality throughout the watershed must be reported by July 1, 2005, and, at a minimum, every three years thereafter.

In lieu of this coordinated monitoring plan, one or more of the parties identified in the preceding paragraph may submit an individual or group monitoring plan. Any such individual or group monitoring plan shall also be due no later than June 23, 2005.

Details to be included in the proposed monitoring program shall include, but not be limited to, the following:

- monitoring program goals
- responsible agencies
- groundwater water sampling locations
- surface water sampling locations (if appropriate)
- water quality parameters
- sampling frequency
- quality assurance/quality control
- database management
- data analysis and reporting

Within 30 days of Regional Board approval of the proposed monitoring plan, the monitoring plan must be implemented.

Additional groundwater monitoring programs may be specified by the Regional Board depending upon watershed conditions, waste discharge specifications and/or any special studies related to TDS and nitrogen.

VI. Maximum Benefit Implementation Plans for Salt Management

As discussed in Chapter 4, with some limited exceptions, TDS and nitrate-nitrogen objectives for groundwater management zones in the Santa Ana Region were established to ensure that historical quality is maintained, pursuant to the State's

antidegradation policy (State Board Resolution No. 68-16). However, alternative, less stringent “maximum benefit” objectives are also specified in Chapter 4 for certain groundwater management zones. These “maximum benefit” objectives, which would allow the lowering of water quality, were established based on demonstrations by the agencies recommending them that antidegradation requirements were satisfied. First, these agencies demonstrated that beneficial uses would continue to be protected. Second, these agencies showed that water quality consistent with maximum benefit to the people of the state would be maintained. Other factors, such as economics, the need to use recycled water, and the need to develop housing in the area were also taken into account in establishing the objectives (see Chapter 4).

The demonstrations of “maximum benefit” by these agencies are contingent on the implementation of specific projects and programs by the agencies. As discussed in Chapter 4, if these projects and programs are not implemented to the Regional Board’s satisfaction, then the alternative “antidegradation” objectives apply to these waters for regulatory purposes.

This section identifies the specific commitments by the Chino Basin Watermaster and Inland Empire Utilities Agency, the Yucaipa Valley Water District, the City of Beaumont and the San Timoteo Water Management Authority to implement projects and programs to support the “maximum benefit” objectives established for groundwater management zones affected by their wastewater and water management practices.

A. Salt Management – Chino Basin and Cucamonga Basin

As shown in Chapter 4, both “antidegradation” and “maximum benefit” objectives for TDS and nitrate-nitrogen are specified in this Plan for certain parts of the Chino Basin and the Cucamonga groundwater Management Zone. The application of the “maximum benefit” objectives relies on the implementation by the Chino Basin Watermaster and the Inland Empire Utilities Agency of a specific program of projects and requirements [Ref. 10B], which are an integral part of the Chino Basin Optimum Basin Management Program (OBMP) [Ref. 10C]. The OBMP was developed by the Watermaster under the supervision of the San Bernardino County Superior Court. The OBMP is a comprehensive, long-range water management plan for the Chino Basin as a whole, including the Chino North (or Chino 1, 2, and 3) and Cucamonga Management Zones. The OBMP includes the use of recycled water for basin recharge, initially in the Chino North Management Zone. Recycled water recharge in the Cucamonga Management Zone may be pursued in the future. The OBMP also includes the capture of increased quantities of high quality storm water runoff, recharge of imported water when its TDS concentrations are low, improvement of water supply by desalting poor quality groundwater, and enhanced wastewater pollutant source control programs. The OBMP maps a strategy that will provide for enhanced yield for the Chino Basin and seeks to provide reliable water supplies for development expected to occur within the Basin. The OBMP also includes the implementation of management activities that would result in the hydraulic isolation of Chino Basin groundwater from the Orange County Management Zone, thus insuring the protection of downstream beneficial uses and water quality.

Table 5-8a identifies the projects and requirements that must be implemented to demonstrate that water quality consistent with maximum benefit to the people of the state will be maintained. An implementation schedule is also specified. The Regional Board will revise IEUA's waste discharge requirements, issue appropriate permits to the Chino Basin Watermaster, and utilize the authority provided by Section 13267 of the Water Code as necessary to require that these commitments be met. It is assumed that maximum benefit is demonstrated, and that the "maximum benefit" TDS and nitrate-nitrogen objectives apply to the Chino North and Cucamonga Management Zones as long as the schedule is being met. If the Regional Board determines that the maximum benefit program is not being implemented effectively in accordance with the schedule shown in Table 5-8a, then maximum benefit is not demonstrated, and the "antidegradation" TDS and nitrate-nitrogen objectives for the Chino 1, 2, and 3 and Cucamonga Management Zones apply. In this situation, the Regional Board will require mitigation for TDS and nitrate-nitrogen discharges to these management zones that took place in excess of limits based on the "antidegradation" objectives.

Table 5-8a
Chino Basin Maximum Benefit Commitments
(revised in 2012; see text)

Description of Commitment	Compliance Date – as soon as possible, but no later than
1. Surface Water Monitoring Program	
a. Submit Draft Monitoring Program to Regional Board	a. January 23, 2005
b. Implement Monitoring Program	b. Within 30 days from date of Regional Board approval of monitoring plan
c. Submit Draft Revised Monitoring Program to Regional Board	c. 15 days from BPA approval
d. Implement Revised Monitoring Program	d. Upon Regional Board approval
e. Submit Draft Revised Monitoring Program(s) (subsequent to that required in "c" above) to Regional Board	e. Upon notification of the need to do so from the Regional Board Executive Officer and in accordance with the schedule prescribed by the Executive Officer
f. Implement Revised Monitoring Program(s)	f. Upon Regional Board approval
g. Annual data report submittal	g. April 15 th

Table 5-8a cont.
Chino Basin Maximum Benefit Commitments
(revised in 2012; see text)

Description of Commitment	Compliance Date – as soon as possible, but no later than
<p>2. Groundwater Monitoring Program</p> <ul style="list-style-type: none"> a. Submit Draft Monitoring Program to Regional Board b. Implement Monitoring Program c. Plan and schedule for demonstrating hydraulic control d. Implement hydraulic control demonstration plan and schedule e. Submit Draft Revised Monitoring Program(s) (subsequent to that required in “a” above) to Regional Board f. Implement revised monitoring plan(s) g. Annual data report submittal 	<ul style="list-style-type: none"> a. January 23, 2005 b. Within 30 days from date of Regional Board approval of monitoring plan c. By December 31, 2013 d. Upon Regional Board approval e. Upon notification of the need to do so from the Regional Board Executive Officer and in accordance with the schedule prescribed by the Executive Officer f. Upon Regional Board approval g. April 15th
<p>3. Chino Desalters</p> <ul style="list-style-type: none"> a. Chino 1 desalter expansion to 10 MGD b. Chino 2 desalter at 10 MGD design 	<ul style="list-style-type: none"> a. Prior to recharge of recycled water b. Recharge of recycled water allowed once award of contract and notice to proceed issued for construction of desalter treatment plant
<p>4. Future desalters plan and schedule submittal</p>	<p>October 1, 2005 Implement plan and schedule upon Regional Board approval</p>
<p>5. Recharge facilities (17) built and in operation</p>	<p>June 30, 2005</p>
<p>6. IEUA wastewater quality improvement plan and schedule submittal</p>	<p>60 days after agency-wide 12 month running average effluent TDS quality equals or exceeds 545 mg/L for 3 consecutive months or agency-wide 12 month running average TIN equals or exceeds 8 mg/L in any month.</p> <p>Implement plan and schedule upon approval by Regional Board.</p>

Table 5-8a cont.
Chino Basin Maximum Benefit Commitments
(revised in 2012; see text)

Description of Commitment	Compliance Date – as soon as possible, but no later than
<p>7. Recycled water will be blended with other recharge sources so that the 5-year running average TDS and nitrate-nitrogen concentrations of water recharged are equal to or less than the “maximum benefit” water quality objectives for the affected Management Zone (Chino North or Cucamonga).</p> <p>a. Submit a report that documents the location, amount of recharge, and TDS and nitrogen quality of stormwater recharge before the OBMP recharge improvements were constructed and what is projected to occur after the recharge improvements are completed</p> <p>b. Submit documentation of amount, TDS and nitrogen quality of all sources of recharge and recharge locations. For stormwater recharge used for blending, submit documentation that the recharge is the result of CBW/IEUA enhanced recharge facilities.</p>	<p>Compliance must be achieved by end of 5th year after initiation of recycled water recharge operations.</p> <p>a. Prior to initiation of recycled water recharge</p> <p>b. Annually, by April 15th, after initiation of construction of basins/other facilities to support enhanced stormwater recharge.</p>
<p>8. Hydraulic Control Failure</p> <p>a. Plan and schedule to correct loss of hydraulic control</p> <p>b. Achievement and maintenance of hydraulic control</p> <p>c. Mitigation plan for temporary failure to achieve/maintain hydraulic control</p>	<p>a. 60 days from Regional Board finding that hydraulic control is not being maintained</p> <p>b. In accordance with plan and schedule approved by Regional Board. The schedule shall assure that hydraulic control is achieved as soon as possible.</p> <p>c. By January 23, 2005. Implement plan upon Regional Board determination that hydraulic control is not being maintained (see text).</p>
<p>9. Ambient groundwater quality determination</p>	<p>July 1, 2005 and every 3 years thereafter</p>

Description of Chino Basin Watermaster and Inland Empire Utilities Agency Commitments

1. Surface Water Monitoring Program (Table 5-8a #1)

In conjunction with the Groundwater Monitoring Program (see #2, below), the purpose of the surface water monitoring program is to collect the data necessary to demonstrate whether hydraulic control of the Chino Basin (see #8, below) is being achieved and maintained. A surface water monitoring program was developed, approved and implemented in response to the maximum benefit commitments initially incorporated in the Basin Plan in 2004 (Resolution No. R8-2004-0001). The Regional Board approved the Surface Water Monitoring Program in 2005 (R8-2005-0064). Subsequently, the need to revise the monitoring program, and other elements of the maximum benefit commitments (see below), was recognized and appropriate amendments were adopted in 2012 (Resolution No. R8-2012-0002). These include the requirement that by (**15 days from approval of the BPA**), the Watermaster shall submit a revised surface water monitoring program to the Regional Board for approval. The monitoring program must be implemented upon Regional Board approval.

It is expected that the monitoring program will be reviewed as it is implemented over time, and that further updates may be necessary. Accordingly, the Basin Plan requires that draft revised monitoring programs be submitted upon notification by the Regional Board's Executive Officer of the need to do so. The schedule for the submittal will be prescribed by the Executive Officer. Any such revision to the monitoring program is subject to Regional Board approval at a duly noticed public hearing and is to be implemented upon Regional Board approval.

An annual report summarizing all data collected for the year and evaluating compliance with relevant surface water objectives shall be submitted by April 15th of each year.

2. Groundwater Monitoring Program (Table 5-8a, #2)

The purpose of the Groundwater Monitoring Program is to (1) identify potential impacts from implementation of the Chino Basin "maximum benefit" water quality objectives on water levels and water quality within the Chino Basin and in downgradient basins and (2) in conjunction with the surface water monitoring program, determine whether hydraulic control (see # 8, below) is being achieved and maintained. In response to requirements established in 2004 (Resolution No. R80 2004-0001), a proposed groundwater monitoring program was submitted. In 2005, the Regional Board approved a groundwater monitoring program to determine hydraulic control and ambient water quality in the Chino North and Cucamonga Management Zones (Resolution No. R8-2005-0064). The groundwater monitoring program has been ongoing since 2005.

As noted above, the maximum benefit requirements were revised in 2012. Pursuant to these revisions, no later than December 31, 2013, the Watermaster and IEUA shall

prepare an updated proposed groundwater monitoring program that includes a proposed plan and schedule for demonstration of hydraulic control. This plan shall be implemented upon Regional Board approval.

It is expected that the monitoring program will be reviewed as it is implemented over time, and that further updates may be necessary. Accordingly, the Basin Plan requires that draft revised monitoring programs be submitted upon notification by the Regional Board's Executive Officer of the need to do so. The schedule for the submittal will be prescribed by the Executive Officer. Any such revision to the monitoring program is subject to Regional Board approval at a duly noticed public hearing and is to be implemented upon Regional Board approval.

An annual report, including all raw data and summarizing the results of the approved groundwater monitoring program, shall be submitted to the Regional Board by April 15th of each year.

3. Chino 1 and Chino 2 Desalters (Table 5-8a, # 3)

Prior to the recharge of recycled water in the Chino Basin, the Chino 1 desalter must be expanded and in operation at a capacity of 10 million gallons per day (MGD). Also, contracts for the construction of the Chino 2 desalter treatment plant must be awarded and a notice to proceed with the construction must be given prior to recharge of recycled water.

4. Future Desalter Development (Table 5-8a, # 4)

No later than October 1, 2005, the schedule for implementation of the next 20 MGD of desalter capacity, pursuant to the Peace Agreement that implements the Chino Basin OBMP, and as required by the San Bernardino Superior Court, must be submitted to the Regional Board by the Chino Basin Watermaster. IEUA and/or the Chino Basin Watermaster and/or other responsible parties deemed acceptable by the Executive Officer, will initiate building of the next desalter when the 12-month running average effluent concentration (measured as an average for all IEUA wastewater treatment facilities) reaches 545 mg/L TDS for three consecutive months.

5. Recharge Facilities (Table 5-8a, # 5)

By June 30, 2005, or no later than one year from the start of discharge of recycled water, the 17 recharge facilities identified in the August 2001 Watermaster Recharge Master Plan and as updated by the Watermaster and IEUA, must be completed and operated to maximize the capture of storm water in the Chino Basin. The Watermaster has also committed to optimize the recharge of imported water in the Chino Basin based on the goal of maximizing recharge of State Project water when the TDS of that water is lowest.

The Watermaster proposal recognizes the importance and necessity of recharge of both storm water and imported water to meet the water supply demands on the Chino Basin. Recharge of high quality supplies to the Chino Basin is necessary to offset the quality effects of recycled water and to achieve an ambient water quality equal to or better than the “maximum benefit” TDS and nitrate-nitrogen water quality objectives.

6. IEUA Wastewater Effluent Quality (Table 5-8a, # 6)

Within 60 days after the IEUA 12-month running average effluent concentration (measured as an average for all IEUA wastewater treatment facilities) for TDS exceeds 545 mg/L for 3 consecutive months, or the 12-month running average total inorganic nitrogen (TIN) concentration (measured as an average for all IEUA wastewater treatment facilities) exceeds 8 mg/L in any month, the IEUA shall submit to the Regional Board a plan and time schedule for implementation of measures to insure that the 12-month running average agency wastewater effluent quality does not exceed 550 mg/L and 8 mg/L for TDS and TIN, respectively. The Plan and schedule are to be implemented upon Regional Board approval.

7. Recycled Water Use (Table 5-8a, # 7)

The use and recharge of recycled water within the Chino Basin is a critical component of the Watermaster OBMP and is necessary to maximize the use of the water resources of the Chino Basin. The demonstration of maximum benefit, and the continued application of the “maximum benefit” TDS and nitrate-nitrogen water quality objectives, depends on the recharge to the Chino North Management Zone of 5-year annual average (running average) TDS and nitrogen concentrations of no more than 420 mg/L and 5 mg/L, respectively. If and when recycled water recharge in the Cucamonga Management Zone is pursued, the application of the “maximum benefit” objectives will depend on the recharge to that zone of 5-year running average TDS and nitrogen concentrations no greater than 380 mg/L and 5 mg/L, respectively. IEUA has committed to meeting these levels and recognizes that the maximum benefit objectives depend on achieving these 5-year running average concentrations.

Accordingly, the use of recycled water for groundwater recharge shall be limited to the amount that can be blended on a volume-weighted basis with other sources of recharge to the management zone to achieve a 5-year running average concentration equal to or less than the “maximum benefit” TDS and nitrogen water quality objectives of the affected Management Zone (Chino North or Cucamonga). The 25% nitrogen loss coefficient will be applied to calculate recycled water nitrogen quality when determining the amount of recharge of other water sources that must be achieved to meet the 5-year running averages.

8. Hydraulic Control (Table 5-8a, # 8)

“Hydraulic Control” is defined as eliminating groundwater discharge from the Chino Basin to the Santa Ana River, or controlling the discharge to *de minimis* levels. The surface water and groundwater monitoring programs described above are intended to demonstrate whether hydraulic control is achieved and maintained. In the event that the Regional Board finds that hydraulic control is not being accomplished, the Watermaster is required to submit to the Regional Board within 60 days of that finding a plan and time schedule to correct the failure to achieve and maintain hydraulic control. This plan must be implemented as soon as possible.

In response to a 2010 finding that hydraulic control was not being achieved, Watermaster and IEUA implemented an approved corrective action and mitigation plan and schedule. Additional plans and schedules to address hydraulic control deficiencies will be required if and as there are future Regional Board findings that hydraulic control is not being achieved or maintained.

By January 23, 2005, the Watermaster and IEUA shall prepare a proposed plan and schedule to mitigate temporary losses of hydraulic control. These agencies must implement this plan upon a determination by the Regional Board that hydraulic control is not being achieved or maintained.

9. Ambient Groundwater Quality Determination (Table 5-8a, # 9)

By July 1, 2005, and every three years thereafter, Watermaster shall submit a determination of ambient TDS and nitrate-nitrogen quality in the Chino North and Cucamonga Management Zones. This determination shall be accomplished using methodology consistent with the determinations (20-year running averages) used by the TDS/Nitrogen Task Force to develop the “antidegradation” TDS and nitrate-nitrogen water quality objectives for groundwaters subbasins within the Region. [Ref.1].

Implementation by Regional Board

1. Revision of the Inland Empire Utilities Agency NPDES Permits

To implement the “maximum benefit” objectives, the Regional Board will revise the NPDES permits for IEUA wastewater discharges to reflect the commitments described above, as appropriate. This includes the following. TDS and TIN (includes nitrate-nitrogen) limits of 550 mg/L and 8 mg/L, respectively, will be specified as an agency-wide, volume weighted-average. The limits will be expressed as 12-month running averages. These limits implement the wasteload allocations for IEUA surface water discharges (see Table 5-5), and are not contingent on the “maximum benefit” objectives or demonstration⁵. IEUA will be required to implement measures to improve effluent quality when the 12 month running average effluent concentration (measured

⁵ Surface water discharges by IEUA do not affect the groundwater management zones for which “maximum benefit” objectives are specified. Thus, the wasteload allocations do not vary depending on whether or not the “maximum benefit” objectives apply.

as an average for all IEUA treatment facilities) exceeds 545 mg/L for 3 consecutive months, or when the 12-month running average total inorganic nitrogen concentration (also measured as an average for all IEUA treatment facilities) exceeds 8 mg/L in any month. The permits will require that recycled water used for recharge shall be limited to the amount that can be blended in the management zone with other water sources, such as stormwater or imported water, to achieve 5-year running average concentrations equal to or less than the “maximum benefit” TDS and nitrate-nitrogen objectives for the affected management zone (Chino North or Cucamonga). Recycled water recharge is not currently contemplated in other parts of the Chino Basin. Alternative TDS and nitrate-nitrogen limitations based on the “antidegradation” objectives will also be specified for recycled water recharge in the Chino 1, 2 and 3 and Cucamonga Management Zones. These limits will apply should the Regional Board find that maximum benefit is not demonstrated. If recharge projects are implemented elsewhere in the Chino Basin, TDS and TIN limits will be based on the TDS and nitrate-nitrogen objectives of the affected management zones.

The effluent limits for IEUA, which establish an upper limit on TDS and TIN concentrations of recycled water discharged in the basin, are a cornerstone of the maximum benefit demonstration. The cap on effluent TDS and TIN concentrations provides a controlling point for management of TDS and nitrogen water quality in the Chino Basin. The TDS in IEUA’s effluent is expected to reach 550 mg/L before the groundwater in the Chino North Management Zone or the Cucamonga Management Zone reaches the “maximum benefit” objectives of 420 mg/L and 380 mg/L, respectively. The IEUA/Chino Basin Watermaster maximum benefit proposal commits to the initiation of construction of another Chino Basin desalter when the TDS in IEUA’s effluent reaches 545 mg/L for three consecutive months. This desalter may be constructed by IEUA and/or Chino Basin Watermaster and/or other responsible parties deemed acceptable by the Executive Officer. Further, IEUA will immediately implement a salt management program to reduce the salts, including nitrogen, entering IEUA’s wastewater treatment plants. This salt management program will include: 1) connection of new industries that have wastewater discharges with TDS greater than 550 mg/L to the brine line; 2) regulation of the use of new and existing water softeners to the extent allowed by law, with incentives provided for the removal of on-site regenerative water softeners and the use of exchange canisters or other off-site regenerative systems; 3) connection of existing domestic system industries with high TDS waste discharges to the brine lines; 4) percolation of State Water Project water into the Chino Basin when that water is low in TDS; and 5) development of a plan for sewerage areas presently served by septic tanks to reduce the nitrogen loading into the Chino and Cucamonga Management Zones. IEUA’s permits will reflect these commitments.

Implementing these measures will assure that the groundwater quality remains at or below the Chino North Management Zone objective of 420 mg/L and the Cucamonga Management Zone objective of 380 mg/L. Maintenance of this ambient groundwater quality is necessary, in turn; to assure that IEUA’s wastewater treatment facilities are able to meet the effluent TDS limits. Chino Basin groundwater is a significant

component of the water supplied in IEUA's service area and its quality thus has an important effect on effluent quality. Poor ambient water quality will preclude IEUA from meeting effluent limits, without desalting. IEUA can revise treatment plant operations to assure that the TIN limit is achieved. These TDS and TIN limitations assure beneficial use protection for Chino Basin and downstream Orange County groundwater, as well as surface waters (including Chino Creek and the Santa Ana River) affected by IEUA discharges.

IEUA's revised permits will also reflect the surface and groundwater monitoring program requirements described above.

2. Issuance of permits to Chino Basin Watermaster

The Regional Board will issue appropriate permits to the Watermaster, individually or jointly with IEUA, for the recharge of recycled water in the Basin. These permits will implement the commitments described above for recharge of other water sources to offset the quality of the recycled water. The parties will be required to document the amount, quality and location of recharge of these other sources, and to demonstrate that stormwater recharge used for blending purposes occurred as the result of the parties' efforts to enhance such recharge. Other "maximum benefit" commitments will be reflected in these permits, or in other orders of the Regional Board, as appropriate.

3. Review of Project Status

No later than 2005, and every three years thereafter (to coincide with the Regional Board's triennial review process), the Regional Board intends to review the status of the activities planned and executed by the Watermaster and IEUA to demonstrate maximum benefit and to justify continued implementation of the "maximum benefit" water quality objectives. This review is intended to determine whether the commitments specified above and summarized in Table 5-8a are met. If, as a result of this review and after consideration at a duly noticed Public Hearing, the Regional Board finds that the Watermaster and IEUA commitments are not met, the Regional Board will make a finding that the lowering of water quality associated with TDS and nitrate-nitrogen water quality objectives that are higher than historical water quality (the "antidegradation" objectives") is not of maximum benefit to the people of the state. By default, the scientifically derived, "antidegradation objectives" for the Chino 1, 2 and 3 and Cucamonga Management Zones would become effective (280 mg/L, 250 mg/L, 260 mg/L and 210 mg/L TDS respectively; 5.0 mg/L, 2.9 mg/L, 3.5 mg/L and 2.4 mg/L for nitrate-nitrogen – see Chapter 4).

The Watermaster and IEUA have made clear commitments to the implementation of projects and management strategies to achieve the "maximum benefit" objectives. A finding of "maximum benefit to the people of the state" is also a very strong commitment of support by the Regional Board for the goals, vision and future plans of the Watermaster and IEUA. Watermaster and IEUA have indicated that the supervision of the Watermaster program by the San Bernardino County Superior

Court will ensure that the Watermaster and IEUA commitments are met. However, people change, commitments may be changed, and public agency decisions may certainly change. If the commitments are not met and “maximum benefit” is not demonstrated, then the Regional Board will require that Watermaster and IEUA mitigate the effects of discharges of recycled and imported water that took place under the maximum benefit objectives. Under this circumstance, mitigation will be required such that, after mitigation, the salt and nitrogen loads to the basin from imported water, newly captured stormwater inputs under the Watermaster enhanced stormwater interception program, and recycled water are made to be equivalent to the salt loads that would have been allowed to the Chino Basin under the antidegradation objectives. Discharges in excess of the antidegradation objectives that must be considered for mitigation include both recycled water and imported water at TDS concentrations in excess of the antidegradation objectives. Mitigation by groundwater extraction and desalting must be adjusted to address concentrations of salt and nitrogen in the basin, not simply salt load. (Desalting will be an effective mitigation strategy, but desalting removes water, as well as salt, and the resulting salt concentrations in the groundwater will not completely mitigate the effects of the maximum benefit discharges, if mitigation is considered simply on a salt load, rather than concentration, basis.) This remediation will be required of the agencies that were responsible for the discharge of recycled and imported water (waste discharge permit holders) under the maximum benefit objectives. The remediation must be completed within a 10-year period following the finding by the Regional Board that the antidegradation objectives apply. The Regional Board will also require mitigation of any adverse effects on water quality downstream of the Chino Basin that result from failure to implement the “maximum benefit” commitments.

B. Salt Management - San Timoteo Watershed

1. San Timoteo and Yucaipa Management Zone - Yucaipa Valley Water District

Two sets of objectives have been adopted for the San Timoteo and Yucaipa Management Zones; the “maximum benefit” objectives and objectives based on historic ambient quality (“antidegradation” objectives) (see Chapter 4). The application of the “maximum benefit” objectives relies on the implementation by the Yucaipa Valley Water District (YVWD) (and in the case of the San Timoteo Management Zone, by the City of Beaumont/STWMA (see discussion below)) of a specific program of projects and requirements [Ref. 10D]. This program is a part of a watershed-scale water resources management plan designed by YVWD and other members of the San Timoteo Watershed Management Authority (STWMA) (the City of Beaumont, the Beaumont-Cherry Valley Water District and the South Mesa Water Company) to assure reliable supplies to meet present and anticipated demands. The projected water demands for the Yucaipa area for the year 2030 require approximately an additional 10,000 AF/Y of supplemental water, including State Water

Project water, water imported from local sources, recharged storm water and recycled water. YVWD is in the process of implementing the water resources management

plan which includes enhanced recharge of stormwater and recycled water, optimizing direct use of recycled and imported water, and conjunctive use.

In addition to its water supply responsibilities, YVWD provides sewage collection and treatment services within its service area. YVWD operates a wastewater treatment facility that currently discharges tertiary treated wastewater to San Timoteo Creek, Reach 3. This unlined reach of the Creek overlies and recharges the San Timoteo groundwater management zone.

Table 5-9a identifies the projects and requirements that must be implemented by YVWD to demonstrate that water quality consistent with maximum benefit to the people of the state will be maintained. An implementation schedule is also specified. The Regional Board will revise YVWD's waste discharge requirements to require that these commitments be met. It is assumed that maximum benefit is demonstrated, and that the "maximum benefit" water quality TDS and nitrate-nitrogen objectives apply to the Yucaipa and San Timoteo Management Zones, as long as the schedule is being met⁶. If the Regional Board determines that the maximum benefit program is not being implemented effectively in accordance with the schedule shown in Table 5-9a (and in the case of the San Timoteo Management Zone, the commitments and schedule shown in Table 5-10a (see next section)), then maximum benefit is not demonstrated and the "antidegradation" TDS and nitrate-nitrogen objectives apply. In this situation, the Regional Board will require mitigation for TDS and nitrate-nitrogen discharges affecting these management zones that took place in excess of limits based on the "antidegradation" objectives. As for Chino Basin Watermaster and Inland Empire Utilities Agency, discharges in excess of the antidegradation objectives that must be considered for mitigation include both recycled water and imported water, at TDS concentrations in excess of the antidegradation objectives. Mitigation by groundwater extraction and desalting must be adjusted to address concentrations of salt and nitrogen in the basin, not simply salt load.

⁶ Application of "maximum benefit" objectives for the San Timoteo Management Zone is also contingent on the timely implementation of the commitments by the City of Beaumont and the San Timoteo Watershed Management Authority which are discussed in the next section.

**Table 5-9a
Yucaipa Valley Water District Maximum Benefit Commitments**

Description of Commitment	Compliance Date – as soon as possible, but no later than
<p>1. Surface Water Monitoring Program</p> <p>a. Submit Draft Monitoring Program to Regional Board</p> <p>b. Implement Monitoring Program</p> <p>c. Quarterly data report submittal</p> <p>d. Annual data report submittal</p>	<p>a. January 23, 2005</p> <p>b. Within 30 days from Regional Board approval of monitoring plan</p> <p>c. April 15, July 15, October 15, January 15</p> <p>d. February 15th</p>
<p>2. Groundwater Monitoring Program</p> <p>a. Submit Draft Monitoring Program to Regional Board</p> <p>b. Implement Monitoring Program</p> <p>c. Annual data report submittal</p>	<p>a. January 23, 2005</p> <p>b. Within 30 days from Regional Board approval of monitoring plan</p> <p>c. February 15th</p>
<p>3. Desalter(s) and Brine Disposal Facilities</p> <p>a. Submit plan and schedule for construction of desalter(s) and brine disposal facilities. Facilities are to operational as soon as possible but no later than 7 years from date of Regional Board approval of plan/schedule.</p> <p>b. Implement the plan and schedule</p>	<p>a. Within 6 months of either of the following:</p> <p>i. When YVWD’s effluent 5-year running average TDS exceeds 530 mg/L; and/or</p> <p>ii.. When volume weighted average concentration in the Yucaipa MZ of TDS exceeds 360 mg/L</p> <p>b. Within 30 days from Regional Board approval of monitoring plan</p>
<p>4. Non-potable water supply</p> <p>Implement non-potable water supply system to serve water for irrigation purposes. The non-potable supply shall comply with a 10-year running average TDS concentration of 370 mg/L or less</p>	<p>December 23, 2014</p>

Description of Commitment	Compliance Date – as soon as possible, but no later than
<p>5. Recycled water recharge</p> <p>The recharge of recycled water in the Yucaipa or San Timoteo Management Zones shall be limited to the amount that can be blended with other recharge sources to achieve a 5-year running average equal to or less than the “maximum benefit” objectives for TDS and nitrate-nitrogen for the relevant Management Zone(s).</p> <ul style="list-style-type: none"> a. Submit baseline report of amount, locations, and TDS and nitrogen quality of stormwater/imported water recharge. b. Submit documentation of amount, TDS and nitrogen quality of all sources of recharge and recharge locations. For stormwater recharge used for blending, submit documentation that the recharge is the result of YVWD enhanced recharge facilities/programs 	<p>Compliance must be achieved by end of 5th year after initiation of recycled water use/recharge operations.</p> <ul style="list-style-type: none"> a. Prior to initiation of construction of basins/other facilities to support enhanced stormwater/imported water recharge. b. Annually, by January 15th, after initiation construction of facilities/implementation of programs to support enhanced recharge.
<p>6. Ambient groundwater quality determination</p>	<p>July 1, 2005 and every 3 years thereafter</p>
<p>7. Replace denitrification facilities (necessary to comply with TIN wasteload allocation specified in Table 5-5)</p>	<p>New facilities shall be operational no later than December 23, 2007</p>
<p>8. YVWD recycled water quality improvement plan and schedule</p> <ul style="list-style-type: none"> a. Submit plan and schedule b. Implement plan and schedule 	<ul style="list-style-type: none"> a. 60 days after the TDS 12-month running average effluent quality equals or exceeds 530 mg/L for 3 consecutive months and/or the 12-month running average TIN concentration equals or exceeds 6 mg/L in any month (once replacement denitrification facilities are in place) b. Upon approval by Regional Board

Description of Commitment	Compliance Date – as soon as possible, but no later than
9. Remove/reduce the discharge of YVWD effluent from the unlined portion of San Timoteo Creek a. Submit proposed plan/schedule b. Implement plan/schedule	a. June 23, 2005 b. Upon Regional Board approval
10. Construct the Western Regional Interceptor for Dunlap Acres a. Submit proposed construction plan and schedule. The schedule shall assure the completion of construction as soon as possible but no later than January 1, 2010. b. Implement plan and schedule	a. June 23, 2005 b. Upon Regional Board approval

A. Description of Yucaipa Valley Water District Commitments

1. Surface Water Monitoring Program (Table 5-9a, # 1)

The YVWD shall develop and submit for Regional Board approval a surface water monitoring program for San Timoteo Creek and the Santa Ana River Reaches 4 and 5. The monitoring program must be implemented within 30 days of Regional Board approval of the monitoring plan, and six months of data must be generated prior to the implementation of any changes made to the effluent discharge points and before any recycled water is used in the Yucaipa or San Timoteo Management Zones.

At a minimum, the surface water monitoring program shall include the collection of monthly measurements of TDS and nitrogen components in San Timoteo Creek and Santa Ana River, Reaches 4 and 5 (see Table 5-9b). Data reports shall be submitted to the Regional Board's Executive Officer by April 15, July 15, October 15 and January 15 each year. An annual report summarizing all data collected for the year and evaluating compliance with relevant surface water objectives shall be submitted by February 15th of each year.

2. Groundwater Monitoring Program (Table 5-9a, #2)

The purpose of the Groundwater Monitoring Program is to identify the effects of the implementation of the San Timoteo and Yucaipa Management Zones maximum benefit water quality objectives on water levels and water quality within the San Timoteo and Yucaipa Management Zones. Prior to discharge of recycled water to

the San Timoteo and/or Yucaipa Management Zones, YVWD shall submit to the Regional Board for approval a groundwater monitoring program to determine ambient water quality in the San Timoteo and Yucaipa Management Zones . The groundwater monitoring program must be implemented within 30 days of approval by the Regional Board.

An annual report, including all raw data and summarizing the results of the approved groundwater monitoring program, shall be submitted to the Regional Board by February 15th of each year.

3. Desalters and Brine Disposal (Table 5-9a, #3)

YVWD anticipates that demineralization of groundwater or recycled water will be necessary in the future. YVWD is committed to construct and operate desalting and brine disposal facilities when:

- 1) The 5-year running average TDS concentration in recycled water produced at the YVWD wastewater treatment plant exceeds 530 mg/L; or
- 2) The volume-weighted TDS concentration in the Yucaipa Management Zone reaches or exceeds 360 mg/L

The construction of these facilities will be in accordance with a plan and schedule submitted by YVWD and approved by the Regional Board. The schedule shall assure that these facilities are in place within 7 years of Regional Board approval. These facilities shall be designed to stabilize or reverse the degradation trend evidenced by effluent and/or management zone quality.

4. Non-potable water supply distribution system (Table 5-9a, # 4)

A key element of the YVWD's water resources management plan is the construction of a non-potable supply system to serve a mix of recycled water and un-treated imported water for irrigation uses. The intent of blending these sources is to minimize the impact of recycled water use on the Yucaipa and San Timoteo Management Zones.

Parts of this system are under design and construction. A higher proportion of State Project water will be used in wet, surplus years, while larger amounts of recycled water will be used in dry, deficit years. YVWD will produce a non-potable supply with a running ten-year average TDS concentration less than the "maximum benefit" objective for the Yucaipa Management Zone (370 mg/L).

Table 5 – 9b

**Surface Water Monitoring Sites for Monitoring Water Quality and Quantity
Yucaipa Valley Water District**

Site Name	Discharge	Owner	Type	Discharge Frequency	Monitoring Period	Water Quality Frequency	Monitoring Period	Monitoring Analyses
11057500, Gage	San Timoteo Creek	USGS	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
At Barton Rd.	San Timoteo Creek	YVWD	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
At San Timoteo Canyon Rd.	San Timoteo Creek	YVWD	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
Above confluence Yucaipa Creek	San Timoteo Creek	YVWD	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
Above YVWD Discharge	San Timoteo Creek	YVWD	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
11059300 Gage	Santa Ana River	USGS	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
At Waterman Ave	Santa Ana River	YVWD	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
Recharged to Yucaipa MZ	State Water Project	YVWD	Total Discharge	Monthly	Jan-Dec	Monthly	Jan-Dec	TDS, Nitrate-N
Recharged to Yucaipa MZ	Storm water	YVWD	Total Discharge	Monthly	Jan-Dec	Monthly	Jan-Dec	TDS, Nitrate-N

5. Recycled Water Use (Table 5-9a, # 5)

The use and recharge of recycled water within the Yucaipa Management Zone is a critical component of the YVWD water management plan and is necessary to maximize the use of the water resources of the Yucaipa area. The demonstration of “maximum benefit” and the continued application of the “maximum benefit” objectives depends on the combined recharge (recycled water, imported water, storm water) to the Yucaipa Management Zone of a 5-year annual average (running average) TDS concentration of 370 mg/L and nitrate-nitrogen concentration of 5 mg/L. If recycled water recharge in the proposed San Timoteo Management Zone is pursued, then the application of the “maximum benefit” objectives will depend on the combined recharge to that Zone of 5-year annual average (running average) concentrations of 400 mg/L or less TDS, and 5 mg/L or less nitrate-nitrogen.

To meet this requirement, YVWD will establish a fund to purchase imported water from local sources and/or the State Water Project and will recharge water with a TDS concentration less than 300 mg/L (recent long term historical average of water delivered from the State Project). YVWD will also pursue implementation, with the City of Yucaipa and the San Bernardino County Flood Control District, of the *Yucaipa Water Capture and Resource Management Complex* by December 31, 2010.

Accordingly, the use of recycled water for groundwater recharge in the Yucaipa or San Timoteo Management Zone shall be limited to the amount that can be blended in the

management zone on a volume-weighted basis with other sources of recharge to achieve 5-year running average concentrations less than or equal to the “maximum benefit” objectives for the affected groundwater management zone. The 25% nitrogen loss coefficient will be applied in determining the amount of recharge of other water sources that must be achieved to meet the 5-year running average nitrogen concentrations.

6. Ambient Groundwater Quality Determination (Table 5-9a, # 6)

By July 1, 2005, and every three years thereafter, YVWD shall submit a determination of ambient TDS and nitrate-nitrogen quality in the San Timoteo and Yucaipa Management Zones. This determination shall be accomplished using methodology consistent with the calculation (20-year running averages) used by the Nitrogen/TDS Task Force to develop the TDS and nitrate-nitrogen “antidegradation” water quality objectives for groundwater management zones within the region. [Ref. 1].

7. Replacement of Denitrification Facilities (Table 5-9a, #7)

YVWD shall replace existing denitrification facilities to provide effluent total inorganic nitrogen quality (6 mg/L) needed to assure compliance with the “maximum benefit” nitrate-nitrogen objective of the San Timoteo and Yucaipa Management Zones (see Wasteload Allocation section of this Chapter). A maximum three year schedule for completion of these facilities will be required. This schedule will be specified in a revised NPDES permit for YVWD’s discharges to San Timoteo Creek.

8. YVWD Recycled Water Management (Table 5-9a, #8)

YVWD expects to limit the TDS concentration in its effluent to less than or equal to 540 mg/L by using a low TDS source water supply for potable uses, selective desalting of either source water and/or recycled waters, and minimizing the TDS waste increment. YVWD is currently constructing a 12-MGD treatment plant to treat and serve State Project Water. The plant will also be able to treat low TDS Mill Creek and Santa Ana River water. When necessary, YVWD will construct desalters to reduce either the TDS concentration in water supplied to customers or the TDS concentration in the effluent. YVWD will also use best efforts to enact ordinances and other requirements to minimize the TDS use increment.

Within 60 days after the YVWD 12-month running average concentration for TDS equals or exceeds 530 mg/L for 3 consecutive months, or the 12-month running average TIN concentration equals or exceeds 6 mg/L in any month (once replacement denitrification facilities are in place), YVWD shall submit to the Regional Board a plan and time schedule for implementation of measures to insure that the average agency wastewater effluent quality does not exceed 540 mg/L and 6 mg/L for TDS and TIN, respectively. The plan and schedule are to be implemented upon approval by the Regional Board.

9. Relocation of San Timoteo Creek Discharge (Table 5-9a, #9)

YVWD has established the goal of eliminating its discharge to the unlined reach of San Timoteo Creek by 2008. First priority will be given to the direct reuse and limited recharge of this recycled water in the YVWD service area (principally the area overlying the Yucaipa Management Zone). The District may construct a pipeline to convey the recycled water to the San Jacinto watershed for reuse. The District is also planning the construction of a pipeline to convey recycled water downstream to the lined reach of the Creek (Reach 1A) to minimize recycled water effects on the San Timoteo Management Zone. In the long-term, discharges to this area of the Creek are likely to be infrequent and limited to the wintertime, when the recycled water cannot be used in the YVWD (or potentially, the San Jacinto) service areas. However, YVWD is obligated to maintain flows in the Creek to support existing riparian habitat (State Board Order No. WW-26) and may need to continue recycled water discharges at some level. Groundwater and imported State Project water may also be used as alternative water sources.

Whole or partial removal of the discharge from the unlined reach of San Timoteo Creek would improve the quality of groundwater in the San Timoteo Management Zone and supplement recycled water supplies available for reuse elsewhere in the service area.

By June 23, 2005, YVWD shall submit a proposed plan and schedule to remove/reduce the discharge of recycled water to the unlined reach of San Timoteo Creek. The plan and schedule shall be implemented upon Regional Board approval.

10. Construction of Western Regional Interceptor (Table 5-9a, # 10)

YVWD will construct the Western Regional Interceptor to provide wastewater collection and treatment services to Dunlap Acres in order to mitigate what has been identified as a poor quality groundwater area due to prior agricultural use and existing septic systems. The Dunlap Acres area was inadvertently omitted from the Yucaipa-Calimesa septic tank subsurface disposal system prohibition established by the Regional Board in 1973. The interceptor includes the construction of a major wastewater interceptor pipeline, a force main and pump station. YVWD committed to complete construction of these facilities prior to 2010. Regional Board action may be necessary to require connection of properties to the wastewater collection system, when it is completed.

By June 23, 2005, YVWD shall submit a plan and schedule for construction of the Interceptor. The Interceptor is to be complete no later than January 1, 2010. YVWD shall implement the plan and schedule upon Regional Board approval.

B. Implementation by Regional Board

1. Revision to Yucaipa Valley Water District NPDES Permit

To implement the “maximum benefit” objectives, the Regional Board will revise the NPDES permit for YVWD wastewater discharges to reflect the commitments described above, as appropriate. This includes the following.

The discharge limits for TDS and TIN will be specified as an annual volume-weighted average not to exceed 540 mg/L TDS and 6 mg/L TIN. These limits are based on the “maximum benefit” wasteload allocations shown in Table 5-5. A schedule not to exceed December 23, 2007 for compliance with this TIN limit shall be included in the permit. This schedule will enable YVWD to replace its existing denitrification facilities. Alternative TDS and nitrate-nitrogen limitations based on the “antidegradation” objectives will also be specified and will apply should the Regional Board find that maximum benefit is not demonstrated. These alternative limits are also specified in Table 5-5. Compliance schedules for these alternative limits will be specified in YVWD’s waste discharge requirements, as necessary.

YVWD will be required to implement measures to improve effluent quality when the 12-month running average effluent TDS quality equals or exceeds 530 mg/L for 3 consecutive months, and/or when the 12-month running average TIN concentration equals or exceeds 6 mg/L in any month (once replacement denitrification facilities are in place).

YVWD’s waste discharge requirements will require that recycled water used for recharge shall be limited to the amount that can be blended with other water sources, such as stormwater or imported water, to achieve 5-year running average concentrations equal to or less than the “maximum benefit” TDS and nitrate-nitrogen objectives for the affected management zone (Yucaipa or San Timoteo). Alternative TDS and nitrate-nitrogen limitations based on the “antidegradation” objectives will also be specified for recycled water recharge in these management zones.

The effluent limits for YVWD, which establish an upper limit on TDS and TIN concentrations of recycled water discharged in the Yucaipa and/or San Timoteo Management Zones, are a cornerstone of the maximum benefit demonstration. The cap on effluent TDS and TIN concentrations provides a controlling point for management of TDS and nitrogen water quality. YVWD will be required to initiate the building of a desalter and brine disposal line when the 5-year running average TDS in YVWD’s effluent reaches 530 mg/L, or when the volume weighted-average TDS concentration in the Yucaipa Management Zone reaches 360 mg/L. YVWD will immediately implement a salt management program to reduce the salts entering the

District’s wastewater treatment plant. This salt management program will include: 1) provision of incentives for the removal of on-site regenerative water softeners and the use of off-site regenerative systems; and 2) percolation of State Water Project water into the Yucaipa Management Zone when State Water Project water has low TDS. Implementing these measures will assure that the groundwater quality remains at or

below the Yucaipa Management Zone objective of 360 mg/L TDS. Maintenance of this ambient groundwater quality is necessary, in turn, to assure that YVWD's wastewater treatment facility is able to meet the effluent TDS limits. Yucaipa Management Zone groundwater is a significant component of the water supplied in YVWD's service area, and its quality thus has an important effect on effluent quality. Poor ambient quality will preclude YVWD from meeting effluent limits without desalting.

YVWD will be required to submit proposed plans and schedules for the removal/reduction of its wastewater discharges from the unlined reach of San Timoteo Creek and for the construction of the Western Regional Interceptor. YVWD's revised permit will also reflect the surface and groundwater monitoring program requirements described above. This includes the determination of ambient quality in the San Timoteo and Yucaipa Management Zones.

2. Review of Project Status

No later than 2005, and every three years thereafter (to coincide with the Regional Board's triennial review process), the Regional Board intends to review the status of the activities planned and executed by the YVWD to demonstrate maximum benefit and justify continued implementation of the "maximum benefit" water quality objectives. This review is intended to determine whether the commitments specified above and summarized in Table 5-9a are met. As indicated above, if, as a result of this review, the Regional Board finds that the YVWD commitments are not met and after consideration at a duly noticed Public Hearing, the Regional Board will make a finding that the lowering of water quality associated with TDS and nitrate-nitrogen water quality objectives that are higher than historical water quality (the "antidegradation" objectives) is not of maximum benefit to the people of the state. By default, the scientifically derived "antidegradation" objectives for the San Timoteo (300 mg/L for TDS, 2.7 mg/L for nitrate-nitrogen) and Yucaipa (320 mg/L for TDS and 4.2 mg/L for nitrate-nitrogen Management Zones would become effective (see Chapter 4).

Furthermore, in the event that the projects and actions specified in Table 5-9a are not implemented, the Regional Board will require that the YVWD mitigate the adverse water quality effects, both on the immediate and downstream waters, that resulted from the recycled water discharges based on the "maximum benefit" objectives.

2. San Timoteo and Beaumont Management Zones – City of Beaumont and San Timoteo Watershed Management Authority (STWMA)

As shown in Chapter 4, two sets of TDS and nitrate-nitrogen objectives have been adopted for both the San Timoteo and Beaumont Management Zones: the "maximum benefit" objectives and objectives based on historic ambient quality (the "antidegradation" objectives). The application of the "maximum benefit" objectives for

these Management Zones is contingent on the implementation of commitments by the City of Beaumont/STWMA (and, in the case of the San Timoteo Management Zone, by

the Yucaipa Valley Water District (YVWD; see preceding discussion)) to implement a specific water and wastewater resources management program [Ref. 10E]. This program is part of a coordinated effort by the member agencies of STWMA to develop and implement projects that will assure reliable water supplies to meet rapidly increasing demands in this area. The San Timoteo Watershed Management Program (STWMP) developed by STWMA entails enhanced recharge of native and recycled water, maximizing the direct use of recycled water, optimizing the direct use of imported water, recharge and conjunctive use.

Wastewater collection and treatment services in the STWMA service area are provided by the City of Beaumont, as well as YVWD. Beaumont discharges tertiary treated wastewater to Coopers Creek, a tributary of San Timoteo Creek, Reach 3. This unlined reach of the Creek overlies and recharges the San Timoteo groundwater management zone.

Table 5-10a identifies the projects and requirements that must be implemented by Beaumont/STWMA to demonstrate that water quality consistent with maximum benefit to the people of the state will be maintained. STWMA, acting for all its member agencies, has committed to conduct the regional planning and monitoring activities necessary to implement these “maximum benefit” commitments, and the San Timoteo Watershed Management Program as a whole. Table 5-10a also specifies an implementation schedule. The Regional Board will revise the City of Beaumont’s waste discharge requirements and take other actions as necessary to require that these commitments be met. It is assumed that maximum benefit is demonstrated, and that the “maximum benefit” water quality TDS and nitrate-nitrogen objectives apply to the Beaumont and San Timoteo Management Zones, as long as the schedule is being met⁷. If the Regional Board determines that the maximum benefit program is not being implemented effectively in accordance with the schedule shown in Table 5-10a (and in the case of the San Timoteo Management Zone, the commitments and schedule shown in Table 5-9a (see preceding section)), then maximum benefit is not demonstrated, and the “antidegradation” TDS and nitrate-nitrogen objectives apply. In this situation, the Regional Board will require mitigation for TDS and nitrate-nitrogen discharges affecting these management zones that took place in excess of limits based on the “antidegradation” objectives.

⁷ Application of “maximum benefit” objectives for the San Timoteo Management Zone is also contingent on the timely implementation of the commitments by the Yucaipa Valley Water District which are discussed in the preceding section.

**Table 5-10a
City of Beaumont and San Timoteo Watershed Management Authority
Maximum Benefit Commitments**

Description of Commitment	Compliance Date – as soon as possible, but no later than
<p>1. Surface Water Monitoring Program</p> <ul style="list-style-type: none"> a. Submit Draft Monitoring Program to Regional Board b. Implement Monitoring Program c. Quarterly data report submittal d. Annual data report submittal 	<ul style="list-style-type: none"> a. January 23, 2005 b. Within 30 days from Regional Board approval of monitoring plan c. April 15, July 15, October 15, January 15 d. February 15th
<p>2. Groundwater Monitoring Program</p> <ul style="list-style-type: none"> a. Submit Draft Monitoring Program to Regional Board b. Implement Monitoring Program c. Annual data report submittal 	<ul style="list-style-type: none"> a. January 23, 2005 b. Within 30 days from Regional Board approval of monitoring plan c. February 15th
<p>3. Desalter(s) and Brine Disposal Facilities</p> <ul style="list-style-type: none"> a. Submit plan and schedule for construction of desalter(s) and brine disposal facilities. Facilities are to be operational as soon as possible but no later than 7 years from date of Regional Board approval of plan/schedule. b. Implement the plan and schedule 	<ul style="list-style-type: none"> a. Within 6 months of either of the following: <ul style="list-style-type: none"> i. When Beaumont’s effluent 5-year running average TDS exceeds 480 mg/L; and/or ii. When volume weighted average concentration in the Yucaipa MZ of TDS exceeds 320 mg/L b. Within 30 days from Regional Board approval of monitoring plan
<p>4. Non-potable water supply</p> <p>Implement non-potable water supply system to serve water for irrigation purposes. The non-potable supply shall comply with a 10-year running average TDS concentration of 330 mg/L or less</p>	<p>December 23, 2014</p>
<p>5. Recycled water recharge</p> <p>The recharge of recycled water in the Beaumont or San Timoteo Management Zones shall be limited to the amount that can be blended with other recharge sources to achieve a 5-year running average equal to or less than the “maximum benefit” objectives for TDS and nitrate-nitrogen for the relevant Management Zone(s).</p>	<p>Compliance must be achieved by end of 5th year after initiation of recycled water use/recharge operations.</p>

Description of Commitment	Compliance Date – as soon as possible, but no later than
<ul style="list-style-type: none"> a. Submit baseline report of amount, locations, and TDS and nitrogen quality of stormwater/imported water recharge. b. Submit documentation of amount, TDS and nitrogen quality of all sources of recharge and recharge locations. For stormwater recharge used for blending, submit documentation that the recharge is the result of City of Beaumont/STWMA enhanced recharge facilities/programs 	<ul style="list-style-type: none"> a. Prior to initiation of construction of basins/other facilities to support enhanced storm/water imported water recharge . b. Annually, by January 15th, after initiation construction of facilities/implementation of programs to support enhanced recharge.
6. Ambient groundwater quality determination	July 1, 2005 and every 3 years thereafter
7. Replace denitrification facilities (if necessary to comply with TIN wasteload allocation specified in Table 5-5)	Compliance with 6 mg/L TIN limitation to be achieved by December 23, 2007
8. City of Beaumont recycled water quality Improvement plan and schedule <ul style="list-style-type: none"> a. Submit plan and schedule b. Implement plan and schedule 	<ul style="list-style-type: none"> a. 60 days after the TDS 12-month running average effluent quality equals or exceeds 480 mg/L for 3 consecutive months and/or the 12-month running average TIN concentration equals or exceeds 6 mg/L in any month (once facility/operational changes needed to achieve 6 mg/L TIN are in place) b. Upon approval by Regional Board
9. Remove/reduce the discharge of Beaumont Effluent From the unlined portion of San Timoteo Creek <ul style="list-style-type: none"> a. Submit proposed plan/schedule b. Implement plan/schedule 	<ul style="list-style-type: none"> a. June 23, 2005 b. Upon Regional Board approval

A. Description of City of Beaumont, San Timoteo Watershed Authority Commitments

1. Surface Water Monitoring Program (Table 5-10a, #1)

The City of Beaumont and the STWMA shall develop and submit for Regional Board approval a surface water monitoring program for San Timoteo, Little San Gorgonio and Noble Creeks at the locations listed in Table 5-10b. The monitoring program must be implemented within 30 days of Regional Board approval of the monitoring plan, and six months of data must be generated prior to the implementation of any changes to the effluent discharge points and before any recycled water is used in the Beaumont or San Timoteo Management Zones.

At a minimum, the surface water monitoring program shall include the collection of monthly measurements of TDS and nitrogen components at locations in San Timoteo,

Little San Gorgonio and Noble Creeks (see Table 5-10b). Data reports shall be submitted to the Regional Board's Executive Officer by April 15, July 15, October 15 and January 15 each year. An annual report summarizing all data collected for the year and evaluating compliance with relevant surface water objectives shall be submitted February 15th of each year.

2. Groundwater Monitoring Program (Table 5-10a. #2)

The purpose of the groundwater monitoring program is to identify the effects of the implementation of the Beaumont and San Timoteo Management Zone maximum benefit TDS and nitrate-nitrogen water quality objectives on water levels and water quality within the Beaumont and San Timoteo Management Zones. Prior to discharge of recycled water to the Beaumont and/or San Timoteo Management Zone, the City of Beaumont and the STWMA shall submit to Regional Board for approval a groundwater monitoring program to determine ambient water quality in the Beaumont and San Timoteo Management Zones. The groundwater monitoring program must be implemented within 30 days of approval by the Regional Board.

An annual report, including all raw data and summarizing the results of the approved groundwater monitoring program, shall be submitted to the Regional Board by February 15th of each year.

3. Desalters and Brine Disposal (Table 5-10a. #3)

The City of Beaumont and the STWMA shall construct and operate desalting facilities and brine disposal facilities when:

- a. The 5-year running average TDS concentration in recycled water produced at the City of Beaumont wastewater treatment plant exceeds 480 mg/L, or
- b. The volume-weighted TDS concentration in the Beaumont Management Zone equals or exceeds 320 mg/L.

The construction of these facilities will be in accordance with a plan and schedule submitted by Beaumont/STWMA and approved by the Regional Board. The schedule shall assure that these facilities are in place within 7 years of Regional Board approval. These facilities shall be designed to stabilize or reverse the degradation trend evidenced by effluent and/or management zone quality.

Table 5 – 10b

**Surface Water Monitoring Sites for Monitoring Water Quality and Quantity
City of Beaumont & San Timoteo Watershed Management Authority**

Site Name	Discharge	Owner	Type	Discharge Frequency	Monitoring Period	Water Quality Monitoring		
						Frequency	Period	Analyses
Above confluence With Coopers Ck.	San Timoteo Creek	Beaumont & STWMA	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
Near Hinda Sec.35 T2S,R2W	San Timoteo Creek	Beaumont & STWMA	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
Above confluence With San Timoteo Creek	Coopers Creek	Beaumont & STWMA	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
At Freeway 10	Little San Gorgonio Ck.	Beaumont & STWMA	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
At Freeway 10	Noble Creek	Beaumont & STWMA	Total Discharge	Bi-weekly	Jan-Dec	Bi-weekly	Jan-Dec	TDS, TIN, Physical
Recharged to Beaumont MZ	State Water Project	Beaumont & STWMA	Total Discharge	Bi-weekly	Jan-Dec	Monthly	Jan-Dec	TDS, Nitrate-N
Recharged to Beaumont MZ	Storm water	Beaumont & STWMA	Total Discharge	Bi-weekly	Jan-Dec	Monthly	Jan-Dec	TDS, Nitrate-N

4. Non-potable water supply distribution system (Table 5-10a, #4)

Like YVWD, the City of Beaumont is constructing a non-potable water system that will convey untreated State Project water and recycled water for irrigation within its service area. The intent of blending these sources is to minimize the impact of recycled water use on groundwater quality in the proposed Beaumont and San Timoteo Management Zones. A higher proportion of State Project water will be used in wet, surplus years, while larger amounts of recycled water will be used in dry, deficit years.

5. Recycled Water Use (Table 5-10a, #5)

The use of recycled water within the Beaumont Management Zone is a critical component of the City of Beaumont and STWMA water management plan and is necessary to maximize the use of the water resources of the Beaumont area.

The demonstration of “maximum benefit” and the continued application of the “maximum benefit” objectives depends on the combined recharge (recycled water, imported water, storm water) to the Beaumont Management Zone of a 5-year annual average (running average) TDS concentration of 330 mg/L and a nitrate-nitrogen concentration of 5 mg/L. If recycled water recharge in the San Timoteo Management

Zone is pursued, then the application of the “maximum benefit” objectives will depend on the combined recharge to that Zone of 5-year annual average (running average) concentrations of 400 mg/L or less TDS, and 5 mg/L or less nitrate-nitrogen.

To comply with this requirement, the STWMA member agencies are developing plans to recharge and store State Project water in the proposed Beaumont Management Zone. The Beaumont-Cherry Valley Water District (BCVWD) is developing a new 80-acre groundwater recharge project that will increase storm water recharge in the Beaumont Basin by 4,100 acre-ft/yr. This facility will also be used to recharge State Water project water. The City of Beaumont is also developing storm water recharge in facilities in newly developing areas, which is expected to result in the recharge of an additional 2,400 acre-ft/yr of stormwater runoff.

Accordingly, the use of recycled water for use or recharge in the Beaumont or San Timoteo Management Zone shall be limited to the amount that can be blended on a volume-weighted basis with other sources of recharge to achieve 5-year running average concentrations less than or equal to the “maximum benefit” objectives for the affected groundwater management zone. The 25% nitrogen loss coefficient will be applied in determining the amount of recharge of other water sources that must be achieved to meet the 5-year running average nitrogen concentrations.

6. Ambient Groundwater Quality Determination (Table 5-10a, # 6)

By July 1, 2005, and every three years thereafter, the City of Beaumont and STWMA shall submit a determination of ambient TDS and nitrate-nitrogen quality in the Beaumont and San Timoteo Management Zones. This determination shall be accomplished using methodology consistent with the calculation (20-year running averages) used by the Nitrogen /TDS Task Force to develop the TDS and nitrate-nitrogen “antidegradation” water quality objectives for groundwater management zones within the region [Ref. 1].

7. Replacement/modification of denitrification facilities (Table 5-10a, #7)

The City of Beaumont has committed to produce recycled water with a 12-month average TIN concentration of 6 mg/L or less by 2008. This may be accomplished via operational changes, or may require the installation/modification of facilities. This TIN effluent quality is specified in the TIN wasteload allocation (see Table 5-5) and is necessary to assure compliance with the proposed “maximum benefit” nitrate-nitrogen objective for the Beaumont and San Timoteo Management Zones (5 mg/L). An appropriate schedule, not to exceed December 23, 2007 for compliance with this effluent limit will be specified in a revised NPDES permit for the City.

8. City of Beaumont Wastewater Management (Table 5-10a, #8)

Beaumont expects to limit the TDS concentration in its effluent to less than or equal to 490 mg/L by using a low TDS source water supply for potable uses, selective desalting

of either source water and/or recycled waters, and minimizing the TDS waste increment.

Within 60 days after the Beaumont 12-month running average concentration for TDS equals or exceeds 480 mg/L for 3 consecutive months, or the 12-month running average TIN concentration equals or exceeds 6 mg/L in any month (once facility/operational changes needed to achieve 6 mg/L TIN are in place), the City of Beaumont shall submit to the Regional Board a plan and time schedule for implementation of measures to insure that the average agency wastewater effluent quality does not exceed 490 mg/L and 6 mg/L for TDS and TIN, respectively. The plan and schedule are to be implemented upon approval by the Regional Board.

9. Relocation of San Timoteo Creek Discharge (Table 5-10a, #9)

Like YVWD, Beaumont has established the goal of eliminating its discharge to the unlined reach of San Timoteo Creek by 2008 to minimize the impacts of these discharges on the San Timoteo Management Zone. The STWMP anticipates that Beaumont's recycled water will be almost completely reused within the Beaumont area for landscape irrigation, habitat enhancement, and potentially for groundwater recharge. Like YVWD, Beaumont and STWMA are also considering the export of a portion of Beaumont's surplus recycled water to the San Jacinto basin, where the TDS objectives are higher than those for the Beaumont Management Zone and recycled water demands are greater than supplies. Some limited recycled water discharge to Coopers Creek and thence /San Timoteo Creek may need to be continued to support existing riparian habitat.

Whole or partial removal of the discharge from the unlined reach of San Timoteo Creek would improve the quality of groundwater in the San Timoteo Management Zone and supplement recycled water supplies available for reuse elsewhere in the service area.

By June 23, 2005, Beaumont/STWMA shall submit a proposed plan and schedule to remove/reduce the discharge of recycled water to the unlined reach of San Timoteo Creek. The plan and schedule shall be implemented upon Regional Board approval.

B. Implementation by Regional Board

1. Revision of City of Beaumont NPDES Permit

To implement the "maximum benefit" objectives, the Regional Board will revise the NPDES permit for the City of Beaumont wastewater discharge to reflect the commitments described above, as appropriate. This includes the following.

The discharge limits for TDS and TIN will be specified as an annual volume-weighted average not to exceed 490 mg/L TDS and 6 mg/L TIN. These limits are based on the wasteload allocation shown in Table 5-5. A schedule not to exceed December 23, 2007 for compliance with this TIN limit shall be included in the permit. This schedule will

enable Beaumont to make the necessary facility/operational changes. Alternative TDS and nitrate-nitrogen limitations based on the “antidegradation” objectives will also be specified and will apply should the Regional Board find that maximum benefit is not demonstrated. These alternative limits are also specified in Table 5-5. Compliance schedules for these alternative limits will be specified in Beaumont’s waste discharge requirements, as necessary.

Beaumont will be required to implement measures to improve effluent quality when the 12-month running average effluent TDS quality equals or exceeds 480 mg/L for 3 consecutive months, and/or when the 12-month running average TIN concentration equals or exceeds 6 mg/L in any month (once the facility/operational changes necessary to assure compliance with the 6 mg/L limit are in place).

Beaumont’s waste discharge requirements will require that recycled water used for recharge shall be limited to the amount that can be blended with other water sources, such as stormwater or imported water, to achieve 5-year running average concentrations equal to or less than the “maximum benefit” TDS and nitrate-nitrogen objectives for the affected management zone (Beaumont or San Timoteo).

The effluent limits for the City of Beaumont, which establish an upper limit on TDS and TIN concentrations of recycled water discharged in the management zones, are a key part of the maximum benefit demonstration. The cap on effluent TDS and TIN concentrations provides a controlling point for management of TDS and nitrogen water quality. The City of Beaumont has committed to initiate the building of a groundwater desalter and brine disposal line when the TDS in the City’s effluent reaches 480 mg/L. Further, the City will immediately implement a salt management program to reduce the salts entering the City’s wastewater treatment plant. This salt management program will include: 1) provision of incentives for the removal of on-site regenerative water softeners and the use of off-site regenerative systems; and 2) percolation of State Water Project water into the Beaumont Management Zone when State Water Project water has low TDS. Implementing these measures will assure that the groundwater quality remains at or below the Beaumont management zone objective of 330 mg/L TDS. Maintenance of this ambient groundwater quality is necessary, in turn, to assure that the City’s wastewater treatment facility is able to meet the effluent TDS limits. Beaumont Management Zone groundwater is a component of the water supplied to the City and its quality thus has an important effect on the effluent quality. Poor ambient quality will preclude the City from meeting effluent limits without desalting.

Beaumont will be required to submit a proposed plan and schedule for the removal/reduction of its wastewater discharges from the unlined reach of San Timoteo Creek. Beaumont’s revised permit will also reflect the surface and groundwater monitoring program requirements described above. This includes the determination of ambient quality in the San Timoteo and Beaumont Management Zones.

2. Review of Project Status

No later than 2005, and every three years thereafter (to coincide with the Regional Board's triennial review process), the Regional Board intends to review the status of the activities planned and executed by the City of Beaumont and STWMA to demonstrate maximum benefit and justify continued implementation of the "maximum benefit" water quality objectives. This review is intended to determine whether the commitments specified above and summarized in Table 5-10a are met. As indicated above, if, as a result of this review, the Regional Board finds that the City of Beaumont and STWMA commitments are not met and after consideration at a duly noticed Public Hearing, the Regional Board will make a finding that the lowering of water quality associated with TDS and nitrate-nitrogen water quality objectives that are higher than historical water quality (the "antidegradation" objectives) is not of maximum benefit to the people of the state. By default, the scientifically derived "antidegradation" objectives for the Beaumont and San Timoteo Management Zones would become effective (230 mg/L TDS and 1.5 mg/L nitrate-nitrogen for the Beaumont Management Zone; 300 mg/L TDS and 2.7 mg/L nitrate-nitrogen for the San Timoteo Management Zone (see Chapter 4).

Furthermore, in the event that the projects and actions specified in Table 5-10a are not implemented, the Regional Board will require that the City of Beaumont and STWMA mitigate the adverse water quality effects, both on the immediate and downstream waters, that resulted from the recycled water discharges based on the "maximum benefit" objectives. As for CBW/IEUA and YVWD, discharges in excess of the antidegradation objectives that must be considered for mitigation include both recycled water and imported water, at TDS concentrations in excess of the antidegradation objectives. Mitigation by groundwater extraction and desalting must be adjusted to address concentrations of salt and nitrogen in the basin, not simply salt load.

C. Salt Management - San Jacinto Upper Pressure Management Zone

As shown in Chapter 4, both "antidegradation" and "maximum benefit" objectives for TDS and nitrate-nitrogen are specified for the San Jacinto Upper Pressure Management Zone. The application of the "maximum benefit" objectives for these Management Zones is contingent on the implementation of a specific water and wastewater resources management program by Eastern Municipal Water District (EMWD) [Ref. 33]. This program is an integral part of the Hemet/San Jacinto Water Management Plan (Management Plan). The "maximum benefit" objectives would allow the Management Plan to be implemented. The Management Plan guides and supports responsible water management into the future. It includes recharge of high quality imported water, use of recycled water for agricultural purposes, and import of high quality water into EMWD's water filtration plant to provide water for potable use in the San Jacinto Upper Pressure Management Zone. Recycled water from the San Jacinto Valley Regional Water Reclamation Facility will be provided for agricultural irrigation in lieu of pumping native groundwater for agricultural operations that overlie the San Jacinto Upper Pressure Management Zone. The Management Plan was developed through a coordinated effort

among EMWD, Lake Hemet Municipal Water District, the cities of Hemet and San Jacinto, and two of the areas largest farming operations. The primary benefits of the Management Plan are to reduce local overdraft and increase the sustainability and reliability of the local groundwater resources, to maximize use of recycled water produced from local water reclamation plants, and to maximize the reasonable and beneficial use of all waters available in the area. All of these activities will be managed by a local Watermaster.

In addition to its water supply responsibilities, EMWD also provides sewage collection and treatment services within its service area. EMWD operates four (4) wastewater treatment facilities. For the most part, EMWD provides the recycled water to local agencies and farmers for irrigation purposes. During winter months, when the demand for recycled water is reduced, EMWD discharges excess recycled water to the Santa Ana River via Temescal Creek.

Table 5-11 identifies the actions and requirements that must be implemented to demonstrate that water quality consistent with maximum benefit to the people of the state will be maintained. An implementation schedule is also specified. It is assumed that the maximum benefit demonstration is made, and that the “maximum benefit” TDS and nitrate-nitrogen objectives apply to the San Jacinto Upper Pressure Management Zone, as long as the schedule and commitments are being met. If the Regional Board determines that the maximum benefit program is not being implemented effectively in accordance with the schedule shown in Table 5-11, then the maximum benefit demonstration is not made, and the “antidegradation” TDS and nitrate-nitrogen objectives would apply for the San Jacinto Upper Pressure Management Zone. In this situation, the Regional Board will require mitigation for TDS and nitrate-nitrogen discharges to these management zones that took place in excess of limits based on the “antidegradation” objectives.

Table 5-11

Eastern Municipal Water District Maximum Benefit Commitments and Schedule for the San Jacinto Upper Pressure Management Zone

Description of Commitment	Compliance Date – as soon as possible, but no later than
<p>1. Groundwater Monitoring Program</p> <p>a. Submit Draft Monitoring Program to Regional Board</p> <p>b. Implement Monitoring Program</p> <p>c. Annual data report submittal</p>	<p>a. May 23, 2012</p> <p>b. Within 30 days from Regional Board approval of monitoring plan</p> <p>c. August 15th</p>
<p>2. Ambient Groundwater Quality Determination For all the groundwater management zones within EMWD's service area in the San Jacinto watershed, EMWD shall develop:</p> <p>a. Estimates of ambient TDS and nitrate</p> <p>b. Ambient TDS projection</p>	<p>a. July 1, 2012 and every 3 years thereafter</p> <p>b. July 18, 2014 and every 6 years thereafter</p>
<p>3. TDS and Nitrogen Wasteload Allocation (WLA) Submit necessary studies and/or modeling to support update of the TDS and Nitrogen WLA for the Upper Santa Ana River watershed.</p>	<p>Within 1 year after notification from Regional Board that WLA needs to be reviewed/revised</p>
<p>4. Salinity Management Plan</p> <p>a. Submit Draft Salinity Management Plan for control of TDS in source water and in recycled water.</p> <p>b. Implement the Plan and schedule</p> <p>c. Triennial Report submittal</p>	<p>a. April 23, 2013</p> <p>b. Within 30 days of Regional Board approval</p> <p>c. August 15, 2012 and every 3 years thereafter</p>

Table 5-11 cont.

Eastern Municipal Water District Maximum Benefit Commitments and Schedule for the San Jacinto Upper Pressure Management Zone

Description of Commitment	Compliance Date – as soon as possible, but no later than
<p>5. Desalter(s) and Brine Disposal Facilities (or Equivalent Technologies)</p> <p>a. Submit plan and schedule for construction of desalter(s) and brine disposal facilities.</p> <p>b. Implement the plan and schedule</p> <p>c. Desalter(s)/Brine Disposal Facilities operational</p>	<p>a. Within 6 months of either of the following:</p> <p>i. When the 5-year running average TDS of the San Jacinto Valley Regional Water Reclamation Facility effluent exceeds 640 mg/L; and/or</p> <p>ii. When the volume weighted, ambient, average concentration in the San Jacinto Upper Pressure MZ of TDS exceeds 490 mg/L</p> <p>b. Within 30 days from Regional Board approval of plan/schedule</p> <p>c. Within 7 years from date of Regional Board approval of plan/schedule.</p>
<p>6. Recycled water reuse</p> <p>The use of recycled water in the San Jacinto Upper Pressure Management Zone shall be limited to agricultural and landscape irrigation uses only. Recycled water shall not be used for direct, intentional recharge of the San Jacinto Upper Pressure Management Zone, unless authorization has been provided by the Regional Board and Department of Public Health.</p> <p>Submit documentation of amount, TDS and nitrogen quality of recycled water provided to agricultural operations and/or landscape irrigation, the amount of groundwater pumped for agricultural and all other uses and amount of State Project Water recharged in the San Jacinto Upper Pressure Management Zone.</p>	<p>Annually, by April 15th, after initiation of construction of facilities/implementation of programs to support recycled water reuse program.</p>
<p>7. EMWD recycled water quality improvement plan and schedule</p> <p>a. Submit plan and schedule</p> <p>b. Implement plan and schedule</p>	<p>a. 60 days after the TDS 5-year running average effluent quality at the San Jacinto Valley Regional Water Reclamation Facility equals or exceeds 640 mg/L</p> <p>b. Upon approval by Regional Board</p>

Description of Eastern Municipal Water District's (EMWD's) Commitments

Groundwater Monitoring Program (Table 5-11, No. 1)

For the Canyon Management Zone, the Hemet South Management Zone, the San Jacinto Upper Pressure Management Zone and Lakeview-Hemet North Management Zone, EMWD shall conduct and/or fund monitoring activities to determine ambient TDS and nitrate concentrations. EMWD already implements comprehensive monitoring and reporting programs associated with the use of the groundwater for potable water supply and the use of recycled water for agricultural and landscape irrigation purposes. EMWD periodically reports the data to several regulatory agencies for the State and US EPA and will provide these data as needed to the Regional Board. These monitoring and reporting programs will continue and the data will be analyzed and used to evaluate water quality in the area. For purposes of this maximum benefit program, the groundwater monitoring program data will be used to assess the water quality of the San Jacinto Upper Pressure Management Zone and the management zones addressed in the Management Plan.

By May 23, 2012 and prior to the discharge of recycled water to the San Jacinto Upper Pressure Management Zone, EMWD shall submit to the Regional Board for approval a proposed groundwater monitoring program to determine ambient water quality and to evaluate the water quality effects of implementation of the maximum benefit program, including the "maximum benefit" nitrate-nitrogen and TDS objectives. The proposed monitoring program shall include an appropriate quality control/quality assurance component. Within 30 days of Regional Board approval of the monitoring plan, the groundwater monitoring program must be implemented.

An annual report, including all raw data, quality assurance/quality control data and a summary of the results of the approved groundwater monitoring program, shall be submitted to the Regional Board by August 15th of each year.

2. Ambient Groundwater Quality Determinations (Table 5-11, No. 2)

a. Develop estimates of ambient TDS and nitrate

By July 1, 2012 and every three years thereafter, EMWD shall submit a determination of ambient TDS and nitrate-nitrogen quality in all of the San Jacinto Basin management zones within the EMWD service area. This determination shall be accomplished using methodology consistent with the calculation of ambient quality as conducted by the Basin Monitoring Program Task Force.⁸ To conduct the ambient quality determinations, EMWD can either contribute financially to efforts by the Basin Monitoring Program Task Force to

⁸ The Basin Monitoring Program Task Force, was formed after the N/TDS Task Force completed its work and the 2004 N/TDS Basin Plan amendments were adopted. The Basin Monitoring Program Task Force has assumed the responsibility to conduct analyses needed to implement certain Basin Plan requirements, including the triennial determination of ambient groundwater quality and revisions to the TDS and TIN waseload allocations.

estimate the ambient TDS and nitrate concentrations for the management zones in EMWD's service area or assume sole responsibility for the preparation of these estimates.

b. Develop ambient TDS projection

By July 18, 2014 and every six years thereafter, EMWD shall submit a projection of TDS quality in all of the San Jacinto Basin management zones. This projection shall be developed using methodology developed by the Imported Water Recharge Workgroup⁹ and approved by the Regional Board. The projections will be compared to prior projections and to estimates of the historical ambient TDS concentrations. This analysis must be submitted in a report to the Regional Board. The methodology employed to date provides a 20-year TDS projection. Changes to this time period may be made if justified to the satisfaction of the Executive Officer.

3. TDS and Nitrogen Wasteload Allocations (WLAs) (Table 5-11, No. 3)

Within 1 year after notification from the Regional Board of the need to review/revise the TDS and nitrogen WLAs, EMWD shall submit documents including, but not limited to, modeling analysis, data compilation or data analysis in support of a revised TDS and nitrogen WLA for the Santa Ana River and its tributaries. EMWD may contribute financially in regional efforts, such as those of the Basin Monitoring Program Task Force, to review and recommend updates to the wasteload allocations, or EMWD may conduct the analyses individually.

4. Salinity Management Plan (Table 5-11, No. 4)

By April 23, 2013, EMWD shall submit a proposed Salinity Management Plan to minimize the TDS concentration in water supplied in the EMWD service area and in recycled water. The Plan shall include efforts to supply water with the lowest reasonable TDS concentration for municipal uses. The Plan shall also include efforts to reduce the TDS waste increment through use (defined herein as the average TDS increase that occurs through indoor uses, which is numerically equal to the average TDS concentration in recycled water minus the average TDS concentration in the source water supply) and salt added through treatment at recycled water facilities. The waste increment includes salt added by water conditioning and self regenerative water softeners, industrial sources, and other sources. EMWD will use its best efforts to enact ordinances, incentive programs, and development requirements that minimize the TDS waste increment.

Within 30 days of Regional Board approval, the Salinity Management Plan must be implemented.

⁹ The Imported Water Recharge Workgroup was established by agencies that recharge water to assure that water quality (TDS and Nitrogen) in groundwater as a result of recharge operations is protected. The Workgroup developed a cooperative agreement to prepare a report at six-year intervals that provides a 20-year projection of ambient water quality in each groundwater management zone.

Beginning August 15, 2012 and every three years thereafter, EMWD shall submit a Salinity Management Report that describes past, current and planned salinity management actions and evaluates the efficacy of these actions.

5. Desalters and Brine Disposal (Table 5-11, No. 5)

EMWD shall submit a plan and schedule for the construction and operation of desalting facilities and brine disposal facilities (or equivalent technologies) when:

- a. The 5-year running average TDS concentration in recycled water produced at the San Jacinto Valley Regional Reclamation Facility exceeds 640 mg/L, or
- b. The volume-weighted ambient average TDS concentration in the San Jacinto Upper Pressure Management Zone equals or exceeds 490 mg/L.

Within 30 days of Regional Board approval, the Plan/schedule must be implemented.

The construction of these facilities will be in accordance with a plan and schedule submitted by EMWD and approved by the Regional Board. The schedule shall assure that these facilities are in place within 7 years of Regional Board approval. These facilities shall be designed to stabilize or reverse the degradation trend evidenced by effluent and/or management zone quality.

6. Recycled Water Use (Table 5-11, No. 6)

The use of recycled water for agricultural and landscape irrigation in-lieu of potable water within the San Jacinto Upper Pressure Management Zone is a critical component of the implementation of the Hemet/San Jacinto Water Management Plan and is necessary to maximize the use of the water resources of the area. Recycled water use in the San Jacinto Upper Pressure Management Zone is contingent upon EMWD providing recycled water quality of 5-year annual average (running average) concentrations of 640 mg/L or less TDS, and 13 mg/L or less nitrate-nitrogen. The use of recycled water in the San Jacinto Upper Pressure Management Zone shall be limited to agricultural and landscape uses. Recycled water shall not be directly recharged in the San Jacinto Upper Pressure Management Zone, unless prior authorization has been provided by the Regional Board and California Department of Public Health.

An annual report shall be submitted to the Regional Board by April 15th of each year that documents (1) the TDS and nitrogen quality and amount of recycled water provided to agricultural operations, including the in-lieu program, and/or used for landscape irrigation and (2) the amount of groundwater pumped for agricultural and all other uses.

7. Recycled Water Quality Improvement (Table 5-11, No. 7)

Within 60 days after the TDS 5 year running average effluent quality at the San Jacinto Valley Regional Water Reclamation Facility equals or exceeds 640 mg/L, EMWD shall

submit a plan and schedule for the improvement of recycled water quality

Upon Regional Board approval, the recycled water quality plan and schedule must be implemented.

Implementation by Regional Board

No later than January 2014, and every three years thereafter, the Regional Board intends to review the status of the activities planned and executed by the EMWD to demonstrate maximum benefit and justify continued implementation of the “maximum benefit” water quality objectives. This review is intended to determine whether the commitments described above and summarized in Table 5-11 are being or have been met. As indicated above, if, as a result of this review, the Regional Board finds that the EMWD commitments are not being met, then the lowering of water quality that would be allowed by the “maximum benefit” objectives is not of maximum benefit to the people of the state. Under these circumstances, the “antidegradation” objectives for the San Jacinto Upper Pressure Management Zone (320 mg/L TDS and 1.4 mg/L nitrate-nitrogen; see Chapter 4) would apply for regulatory purposes. Further, the Regional Board will require that the EMWD mitigate TDS and nitrogen discharges that occurred in excess of those allowed pursuant to the “antidegradation” objectives. Consistent with the requirements for the other agencies implementing maximum benefit programs, discharges in excess of the “antidegradation” objectives that must be considered for mitigation include both recycled water and imported water at TDS and/or nitrogen concentrations in excess of the antidegradation objectives. Mitigation by groundwater extraction and desalting must be adjusted to address concentrations of salt and nitrogen in the basin, not simply salt load.

(End of revisions adopted under Resolution No. R8-2004-0001, No. R8-2010-0039 and No. R8-2012-0002)

NONPOINT SOURCE (NPS) PROGRAM

Considerable improvements in water quality have been achieved in the nation through the control of point source discharges such as those from sewage treatment plants or industrial facilities. It is now recognized that in many areas, nonpoint source inputs, such as urban nuisance flows and stormwater runoff, are the principal sources of contaminant inputs to surface and groundwaters.

In contrast to point sources, which discharge wastewater of predictable quantity and quality at a discrete point (usually at the end of a pipe), nonpoint source inputs are diffuse in origin and variable in quality. Management of nonpoint source inputs is in many ways more difficult to achieve, since it requires an array of control techniques customized to local watershed conditions.

Nonpoint Source (NPS) Management Plan

Section 319 of the 1987 amendments to the Clean Water Act (33 USC 466 *et seq.*), established the framework for nonpoint source activities. Section 319 requires each state to prepare a Nonpoint Source Management Plan and to conduct an assessment of the impact nonpoint sources have on the state's waterbodies. In response to these requirements, the State Board adopted the Nonpoint Source Management Plan (NPSMP) in 1988 and the Water Quality Assessment in 1990 (see Chapter 6 for a discussion of the Water Quality Assessment). The NPSMP establishes a statewide policy for managing nonpoint source inputs to California's waters and is part of this Basin Plan.

The State Board defined six objectives of the Nonpoint Source Management Plan, four of which apply to activities in the Santa Ana Region:

1. Initiate and institutionalize activities for control of nonpoint source pollution (drainage from urban activities, agriculture, silviculture, abandoned mines construction, grazing, hydrologic modification, and individual disposal systems). These activities include outreach, education, public participation, technical assistance, financial assistance, interagency coordination, and demonstration projects.

A major part of the Regional Board staff's nonpoint source activities is participation in outreach activities. Board staffs attend committee meetings to exchange information and to coordinate planning efforts among the various agencies in the region. Staff also coordinates with other public agencies and citizens' groups engaged in protecting water quality from nonpoint source impacts, generally by participating in technical advisory committees. Regional outreach activities are also beginning to include identification of best management practices such as education, information dissemination, and structural and nonstructural water quality controls.

2. Fund contracts for nonpoint source projects selected for nonpoint source grant funding in State Fiscal Year 1992-93. Regional water Board staff will also participate in these projects and provide technical assistance.

Regional Board staff has managed or acted in an advisory capacity for a number of nonpoint source grant funded contracts. These projects have included Newport Bay studies to develop a hydrodynamic model of the Bay as well as a study to monitor sources of toxics into the Bay.

3. Initiate nonpoint source watershed pilot programs on nine watersheds in the state.

San Diego Creek was designated as the region's pilot watershed project. The Creek's water quality has been impaired by excessive sedimentation, nitrates, pesticides, and metals originating from point and nonpoint sources (see the following discussion on the Newport Bay Watershed). In addition, the Upper Newport Bay Dredging Project was identified as the Region's focused nonpoint source watershed project. The U.S. Army

Corps of Engineers, under Congressional authorization, is investigating dredging Upper Newport Bay to deepen the channel. The Army Corps of Engineers' activities could modify the Upper Bay's water quality and currents. Regional Board staff are aiding the Army Corps of Engineers in their development of preliminary ideas so as to prevent potential water quality degradation.

4. Implement the requirements of the 1990 Reauthorization of the Coastal Zone Management Act (CZMA) which requires the State Water Board and the California Coastal Commission to develop and implement an enforceable nonpoint source program in the coastal zone.

The reauthorization of the CZMA, together with specific guidance from the US EPA and the National Oceanic & Atmospheric Administration (NOAA), requires coastal states to develop coastal nonpoint pollution control programs. These programs are to implement management measures for the control of land uses which contribute nonpoint source pollution to coastal waters. Management measures, which include specific measures for mitigating water quality impacts, are specified for the following land uses: agriculture; grazing; confined animal facilities; forestry; urban development; roads; marinas and recreational boating; hydromodification; and mines. The state's coastal program is to be considered for approval by the US EPA and NOAA in July 1995.

Revision of the NPSMP has been initiated. The revised NPSMP will go beyond the requirements of the Coastal Zone Management Act by specifying management measures that are applicable throughout the state. There will also be more of an emphasis placed on watershed based nonpoint source controls in the revised NPSMP. To develop these management measures, the State Board is forming Task Force Committees composed of experts in the various nonpoint source categories. The management measures developed by the Task Force Committee will be reviewed by an oversight committee made up of State and Regional Board staff prior to inclusion in the revised NPSMP. The anticipated date of completion of the revised NPSMP is in 1995.

Some major nonpoint source problems which have been addressed in the Santa Ana Region include:

- Urban runoff: addressed through the stormwater permitting program;
- Animal confinement facilities: addressed through the Dairy Regulatory Strategy;
- On-site disposal systems: addressed through prohibitions and the Minimum Lot-Size Criteria; and
- Erosion/sedimentation in the Newport Bay watershed: addressed through the implementation of the Areawide 208 Plan.

Stormwater Program

The 1987 Clean Water Act amendments required the U.S. Environmental Protection Agency (US EPA) to establish regulations to control stormwater discharges associated with industrial activity, and discharges from large and medium municipal separate storm sewer systems. Large municipal separate storm sewer systems serve a population of 250,000 or more and medium municipal separate storm sewer systems serve a population of more than 100,000 but less than 250,000. On November 16, 1990, EPA published the final regulations that established the National Pollutant Discharge Elimination System (NPDES) permit requirements for discharges of stormwater from large and medium municipal separate storm sewer systems and stormwater discharges associated with industrial activities, including construction activities.

The stormwater NPDES permitting program is administered by the State Board and the Regional Boards.

A. Municipal Stormwater Discharge Permits

Prior to the promulgation of EPA's final regulations, the Santa Ana Regional Water Quality Control Board adopted areawide urban NPDES stormwater permits for each of the three counties in the Region. As shown in Table 5-9, as part of the areawide urban permits, the counties are named as the principal permittee and the incorporated cities are named as co-permittees. These permits require the development and implementation of programs to identify and eliminate illegal/illicit discharges to municipal stormwater conveyance systems, the development and implementation of best management practices (BMPs) to reduce pollutants in stormwater and urban runoff, and the development and implementation of monitoring programs.

**Table 5-9
Municipal Stormwater Permits
Santa Ana Region**

Municipality	Order Number	Date Issued
Orange County Environmental Management Agency, the County of Orange, and 23 incorporated cities	90-071 NPDES - CA8000180	7/12/90
Riverside County Flood Control and Water Conservation District, the County of Riverside, and 13 incorporated cities	90-104 NPDES - CA8000192	7/13/90
San Bernardino County Transportation and Flood Control Department, the County of San Bernardino, and 16 incorporated cities	90-136 NPDES - CA8000200	10/19/90

B. Industrial and Construction Stormwater Discharge Permits

The federal regulations identify eleven industrial categories which are subject to stormwater discharge permitting:

1. Facilities subject to stormwater effluent guidelines (40 CFR Subchapter N);
2. Manufacturing facilities;
3. Mining and Oil and Gas facilities;
4. Hazardous waste treatment, storage or disposal facilities;
5. Landfills, land application sites, and open dumps that receive industrial waste;
6. Recycling facilities such as metal scrap yards, battery reclaimers, salvage yards, and automobile yards;
7. Steam electric generating facilities;
8. Transportation facilities;
9. Sewage treatment plants;
10. Construction activities; and
11. Certain facilities if materials are exposed to stormwater.

As shown these categories include construction activities (#10), which are covered by a separate permit in the State of California (see below).

To satisfy the federal requirements, the State Board issued two general permits: the General Industrial Activities Stormwater Permit (State Board Order No. 91-13-DWQ as amended by State Board Order No. 92-12-DWQ); and the General Construction Activity Stormwater Permit (State Board Order No. 92-08-DWQ). Industrial facilities and proponents of construction projects must file a Notice of Intent (NOI) with the State Board to be covered under the applicable general permit.

The General Industrial Activities Stormwater Permit requires dischargers to comply with federal regulations to reduce or eliminate industrial stormwater pollution, to develop and implement a stormwater pollution prevention plan, and to perform monitoring of stormwater discharges. This permit covers stormwater discharges from all the listed categories of industrial activity, except construction activities.

The General Construction Activity Stormwater Permit addresses stormwater discharges associated with a construction activity where grading, clearing, and excavation results in a land disturbance of five acres or more. A stormwater discharge from a construction resulting in a land disturbance of less than five acres also requires a permit if the construction is a part of a larger common plan of development or sale.

The use of general permits to regulate these various types of stormwater discharges streamlines the permitting process, which greatly benefits the Regional Board. It is also the least costly way for a discharger to obtain a permit and comply with federal and state regulations.

For industrial and construction activities in the Region, it is the Regional Board's responsibility to enforce the General Industrial Activities and General Construction Activity stormwater permits. In addition to these general permits, the Regional Board has issued and will continue to issue individual permits for stormwater dischargers if warranted by the character of the discharges and/or sensitivity of the receiving waters.

Animal Confinement Facilities (Dairies)

As described earlier in this chapter, one of the most significant water quality problems confronting the region is increasing concentrations of TDS and nitrates in the groundwater. This problem is particularly acute in those groundwater subbasins without assimilative capacity, including the Chino II and III Groundwater Subbasins (Subbasins changed by December 22, 2004 amendment).

In 1989-90, the Regional Board conducted a special investigation of the salt balance problem in the Chino Basin, described in "Dairies and Their Relationship to Water Quality Problems in the Chino Basin" or Dairy Report [Ref. 11]. The findings of this study showed that while irrigated agriculture and municipal wastewater disposal are contributors to the degradation, wastes from dairies and other animal confinement facilities play an overwhelmingly significant role.

Dairy operations began in the Chino Basin about 40 years ago and continue intensively today. In fact, the Chino Basin contains the highest concentration of dairy animals found anywhere in the world. Within an area of about 15,000 acres, there are approximately 300 dairies, housing about 300,000 animals. These animals produce approximately 0.5 million tons (dry weight) per year of manure. Significant quantities of water are used to wash the cows prior to milking. Both this wastewater and the manure contain significant quantities of salts (TDS and nitrogen). The Regional Board's studies showed that close to 30,000 tons of salts reach Chino Basin groundwater every year as a result of the disposal of these dairy wastes.

Dairy operations and waste disposal practices can also affect the quality of surface waters. Discharges of washwater and/or runoff of stormwater which has come into contact with manure contribute salts and other pollutants to receiving streams, which ultimately flow into the Santa Ana River. While the Regional Board prohibits these discharges (with the exception of stormwater under certain conditions), these discharges do occur as a result of inadequate construction and maintenance of containment facilities. Drainage from upstream urban areas exacerbates this problem.

The quality of the Santa Ana River is affected indirectly as well: significant quantities of the poor quality groundwater in the Chino Basin rise to the surface and enter the River just upstream of Prado Dam. The TDS and nitrogen problems in the Santa Ana River, which are addressed by the implementation of wasteload allocations, have been described previously. The failure to address and correct the water quality problems in the Chino Basin could compromise the effectiveness of the water quality improvements implemented by the sewage treatment plants in response to those allocations.

The Regional Board initiated a regulatory program to address the water quality impacts of the salt loads from dairy operations in 1972. Waste discharge requirements are issued to all dairies and other significant animal confinement facilities. (See the Dairy Report for a detailed description of the Regional Board's waste discharge requirements). However, the Regional Board's studies demonstrated that changes in this regulatory program were necessary.

The Regional Board developed a revised regulatory strategy, working closely with dairy industry representatives. As described in the Dairy Report, it consists of a comprehensive, three part program. Part I is designed to address the present and future impacts from ongoing dairy activities. Part II addresses the impacts from past dairy activities, and Part III addresses the need for improved drainage facilities upstream of and within the dairy area. Although termed a "dairy" regulatory strategy, the strategy is intended to apply to all animal confinement facilities within the Chino Basin. The term "dairy" is used here for simplicity.

Part I. Dairy Waste Discharge Requirements: Impacts of Ongoing Operations

The first part of the strategy addresses dairy waste discharge requirements and the impacts of ongoing operations. Four specific changes to the dairy regulatory program are included: an improved manure tracking system; inclusion of groundwater monitoring requirements for dairy operators; submittal of engineered waste management plans; and revision of waste discharge requirements to prohibit dairy waste disposal unless suitable offset programs are implemented.

1. Implementation of Manure Tracking and Reporting System

The Regional Board determined that the manure tracking system in use was not adequate to determine the full effects of dairy waste management practices on groundwater quality nor was it adequate to determine compliance with waste discharge requirements related to manure disposal.

In response, a new manure tracking manifest form was developed and is now being used. Dairy operators are required to complete the form and submit it annually in a report to the Regional Board.

2. Implementations of Groundwater Monitoring Requirements

Comprehensive groundwater quality data is necessary for planning mitigation activities in the Chino Basin. Groundwater monitoring requirements will be included in the waste discharge requirements for all dairy operators in the Chino Basin. The WDRs will provide the operators with the option of participating in an established, comprehensive groundwater monitoring program in lieu of their individual monitoring efforts. Such a monitoring program is now being conducted by the Chino Basin Watermaster.

3. Preparation of an Engineered Waste Management Plan as part of the Report of Waste Discharge

Historically, the Regional Board has required that dairy operators provide a general description of their proposed containment controls as part of the Report of Waste Discharge (ROWD). Experience has shown, however, that this is not adequate and that illegal discharges of manured water occur due to improper design, construction, and maintenance of containment controls.

To address this problem, the Regional Board now requires that a waste management plan be prepared by a registered engineer, member of the Soil Conservation Service or others who are suitably qualified. This plan must address containment of all washwater and stormwater runoff, as well as protection of the facility from inundation, as required by the waste discharge requirements. For any given property, the engineering plan must address necessary containment controls for the property as a whole, even in situations where some portion of that property is leased, subleased or operated by another party (for example, cultivation of agricultural crops by a farmer on a portion of dairy property).

Engineered waste management plans are required to be submitted as part of the ROWD for new or substantially modified dairy operations. These plans are also required when the containment controls at facilities are known or suspected to be inadequate.

4. Revision of the Manure and Washwater Disposal Requirements

As noted earlier, the Chino II and III Groundwater Subbasins lack assimilative capacity for additional salt inputs. In basins without assimilative capacity, mineral increments are not permitted when regulating waste discharges (see preceding section on salt balance and assimilative capacity, State Board Order No. 73-4, the Rancho Caballero decision [Ref. 7]). To meet the Chino Basin groundwater objectives, the discharge of manure and dairy washwater and their application as fertilizer and irrigation water cannot be legally permitted.

The implications of prohibiting manure and washwater disposal are significant. Recognizing this, the strategy allows for the implementation of programs to offset the salt loads contributed by ongoing manure/washwater disposal. An offset program would work as follows: for every ton of salt that will reach groundwater as a result of continued disposal/application of manure or washwater within the Chino Basin, the dairy operator must remove an equivalent amount of salt from the Basin through participation in a desalter or other appropriate means. The offsets required of the dairy industry would depend on the industry's success in identifying acceptable methods of manure and wastewater disposal; the more manure and washwater that is removed from the basin, the less need there is for offset.

The strategy calls for the waste discharge requirements for dairy operators in the Chino Basin to “prohibit the disposal of manure and washwater, and their application as fertilizer or irrigation water in the Chino Basin unless the dairy operator participates in an offset program. The offset program must ensure that water quality impacts of continued manure and/or washwater disposal/application practices are mitigated.”

Implementation of this element of the dairy regulatory strategy has been withheld since acceptable mitigation projects are now being developed. As described in the preceding section the selected TDS and nitrogen management plan (Alternative 5C) includes two desalters in the Chino Basin, which are being built by the Santa Ana Watershed Project Authority and other participating agencies. These desalters, though not designed or implemented specifically to address ongoing dairy salt loading, will provide sufficient groundwater treatment and salt loads identified in Alternative 5C. This includes the salt loads from present and future dairy operations and other agriculture, unsewered areas, and other sources.

Part II. Impacts of Past Dairy Operations

This part of the dairy regulatory strategy addresses the mitigation of water quality impacts caused by past discharges of dairy waste in the Chino Basin.

While the two desalters mentioned above should be adequate to offset present and future salt wasteloads, they will not provide sufficient groundwater treatment to address the historic contributions of salts from long-term dairy or other agricultural activities, municipal wastewater disposal, etc. These historic salt inputs must be addressed to protect the beneficial uses of the Basin’s groundwaters and to prevent long-term adverse impacts to the Santa Ana River.

Additional desalters or other treatment facilities and strategies will be necessary. The implementation of these measures may have significant costs. To be equitable, each of the sources of TDS and nitrogen input to the Basin, including dairies, other types of agriculture, and municipalities, should assume its fair share of the Chino Basin cleanup costs. The dairy regulatory strategy incorporates the concept of shared responsibility and directs the use of this concept to develop an equitable approach to water quality correction in the Chino Basin.

A comprehensive study of water resources management in the Chino Basin is now being conducted. The study, the Chino Basin Water Resources Management Study, is funded by a task force which includes representatives of the Chino Basin Watermaster (composed of water users in the Chino Basin including the agricultural industry), Chino Basin Municipal Water District, Western Municipal Water District, the Santa Ana Watershed Project Authority, Metropolitan Water District, and the Regional Board. The goal of this study is to identify a water resources management plan which will provide for water quality protection, water demands are met, and the quality of the Santa Ana River is not adversely affected by outflow from the Basin.

Part III. Surface Water Quality Impacts: Control of Drainage in the Chino Agricultural Preserve

The third part of the dairy strategy addresses surface water drainage problems in the Chino Agricultural Preserve, where most of the dairies are located. These problems are caused both by inadequate and poorly maintained drainage facilities within the Preserve, and by inadequate controls on drainage from upstream urban areas.

Runoff from the rapidly developing areas upstream of the dairy area creates additional difficulties for many dairy operators in complying with the manured water containment requirements specified in their waste discharge requirements. A number of studies have been conducted to determine the best method of preventing urban stormwater runoff impacts in the dairy area. The most recent study, "Chino Agricultural Preserve Drainage and Land Use Study"[Ref. 12], was conducted with federal 205(j) planning funds and was completed in 1987. The recommended solution to these urban drainage problems was the construction of a trapezoidal earth swale at the northern boundary of the dairy area (roughly, at Riverside Avenue, between Campus Avenue and the Cucamonga Creek flood control channel, just west of Archibald Avenue). This swale would intercept flows from upstream urban areas (cities of Ontario and Chino) and convey these flows to the Lower Cucamonga Spreading Grounds, adjacent to the Cucamonga Creek Channel.

To alleviate drainage problems in the dairy area and reduce surface water quality problems which result from dairy waste inputs, the following measures need to be implemented:

1. Riverside Avenue interceptor swale – San Bernardino County and/or the cities of Ontario and Chino should pursue the funding and implementation of the interceptor swale project at Riverside Avenue.
2. Other drainage controls – Both San Bernardino and Riverside counties and the cities tributary to the dairy area should identify and implement a coordinated program of drainage controls necessary to supplement the interceptor swale and prevent drainage problems within the dairy area.

These recommendations are directed to the counties and cities, rather than to the dairy industry. The counties are required to implement such best management practices (BMPs) as part of their NPDES stormwater permits.

Dairy Operations Outside the Chino Basin

Since the greatest concentration of dairies occurs in the Chino Basin, the dairy strategy has appropriately focused on mitigating the problems in this area. However, in recent years, many new dairies have been established elsewhere in the Region, specifically in the San Jacinto Basin, and this trend appears to be continuing. To prevent the recurrence of the groundwater quality problem now confronting the Region in the Chino Basin, an appropriate dairy waste management strategy for the San Jacinto Basin must be developed and implemented. The pattern of dairy land use, the quality of underlying

groundwater, and the availability of assimilative capacity in the San Jacinto Groundwater Subbasins should be considered in more detail before recommending a complete dairy strategy. However, it is anticipated that the wastewater management plan, the manure tracking system, and the groundwater monitoring elements of the strategy recommended for the Chino Basin will also apply in the San Jacinto Basin.

Minimum Lot Size Requirements and Exemption Criteria for New Developments Using On-Site Septic Tank-Subsurface Leaching/Percolation Systems

The Santa Ana Region is characterized by dramatic population growth. Most of this population is concentrated in urban areas, where high density development on small lots is typical. Sanitary sewers are not available in many areas where rapid growth is occurring, so many of these high density developments use on-site septic tank-subsurface disposal systems for sewage disposal. In 1989, the Regional Board investigated the relationship between these high density developments and the nitrate problems found in the groundwater of the Region [Ref. 13]. The findings showed that the use of high density subsurface disposal systems would cause or add to nitrate quality problems. To control these impacts, the Board found that it was necessary to limit the density of new subsurface systems.

On October 13, 1989, the Regional Board adopted Resolution No. 89-157, amending the Water Quality Control Plan to add a one-half acre minimum lot size requirement for new developments using on-site septic tank-subsurface leaching/percolation systems region-wide. Certain exemptions from the minimum lot size requirement were specified in Resolution No. 89-157. On December 7, 1990, the Regional Board adopted Resolution No. 90-158, which revised the exemption criteria. However, on June 7, 1991, the Regional Board adopted Resolution No. 91-51, rescinding Resolution No. 90-158 and revising the exemption criteria in Resolution No. 89-157. On July 16, 1993, the Regional Board adopted Resolution No. 93-40, revising the requirements and exemption criteria in Resolution No. 89-157, as amended by Resolution No. 91-51. Resolution No. 89-157, as amended by Resolution No. 93-40, stipulates the following:

1. A minimum lot size of one-half acre (average gross) per dwelling unit is required for new developments in the Region using on-site septic tank-subsurface leaching/percolation systems.
 - A. The term “one-half acre” specified as the minimum lot size requirement means an average gross area of land of one-half acre per dwelling unit. Easements (including streets, curbs, commons, and greenbelts), or those portions thereof which are part of the property proposed for development shall be included in the calculation of the average gross area of land.
 - B. A “new” development is defined as a proposed tract, parcel, industrial or commercial development for which:

1. One or more of the following has not been granted on or prior to September 7, 1989:
 - a. Conditional approval or approval of a tentative parcel or tract map by the local agency such as the county/city Planning Commission, City Council or the Board of Supervisors.
 - b. A conditional use permit.
 - c. Conditional approval or approval by the San Bernardino County Department of Environmental Health Services, Riverside County Department of Health Care Agency or other local agency; or
2. One or more of the conditional approvals or approvals listed under B.1., above, were granted on or prior to September 7, 1989 but had expired prior to September 7, 1989.
 - C. The minimum lot size requirement does not apply to existing developments where septic tank-subsurface disposal systems have been installed on or prior to September 7, 1989. Replacement of the existing septic tank-subsurface disposal systems shall be exempt from the minimum lot size requirements under the following conditions:
 1. For Residential, Commercial and Industrial Developments

Replacement of the existing septic tank-subsurface disposal systems is necessary to bring the system up to code as required by the local health care agencies and/or the building and safety departments.
 2. For Single-Family Residential Only

Replacement of the existing septic tank-subsurface disposal systems is proposed to allow additional flows resulting from additions to the existing dwelling unit. (This does not include any free-standing additional structures.)

(Note: Board staff does not consider the number of bedrooms and/or bathrooms for existing or proposed single-family dwelling units in determining compliance with the exemption criteria.)

 - a. An existing development on land zoned single-family residential will be considered as a new development if the addition of any free-standing structures which result in additional wastewater flows to the septic system is proposed. Commercial and/or industrial developments will be considered as new development if any additions to the existing structures are proposed which will result in additional wastewater flows to the septic system.

- b. For single-family residential developments, if the existing septic system could accommodate additional wastewater flows, then additional installations (rooms/bathroom) to these developments shall be exempt from the minimum lot size requirements.
- D. Those tracts, parcels, industrial or commercial developments which have received one or more of the approvals listed in B.1., above, on or prior to September 7, 1989 are exempt from minimum lot size requirements for use of septic tank-subsurface disposal systems. However, those tracts, parcels, industrial or commercial developments which had received one or more of the approvals listed in B.1., above, but for which the approval had expired prior to September 7, 1989 are considered as new development and are subject to the minimum lot size requirements.
- E. Industrial/commercial developments are developments other than single-family residential developments. For new industrial commercial developments utilizing septic tank-subsurface disposal systems, the wastewater flow for each one-half acre gross area of land may not exceed that from a three-bedroom, two bathroom single-family dwelling unit. For determining compliance with this criterion, a flow rate of 300 gallons per day shall be considered as the flow equivalent to that from a 3-bedroom, 2-bathroom single-family dwelling. For industrial/commercial developments with lots smaller than one-half acre, this flow rate requirement shall be prorated. (For example, an industrial/commercial development on a one-quarter (1/4) acre parcel will be in compliance with this requirement if the wastewater flow does not exceed 150 gallons per day.)
- F. This minimum lot size requirement does not affect the lot size criterion for continuing exemptions in prohibition areas (1 acre minimum).
- G. This minimum lot size requirement does not preclude the prescription of more stringent lot size requirements in specific areas if it is determined necessary to protect water quality.
- H. No exemptions shall be granted for new developments on lots less than one-half acre which are 200 feet or less from a sewer which could serve that tract/parcel, barring legal impediments to such use. All other developments shall be considered on sliding scale, *e.g.*, for each additional unit (any development which is more than a single-family dwelling), this requirement should be increased by 100 feet per dwelling unit. For example, a 10-lot subdivision shall be required to connect to a sewer if the sewer is within 1,100 feet ($200 + 9 \times 100$ feet = 1,100 feet) of the proposed development barring legal impediments to connection to the sewer. For this subsection, a commercial/industrial development which produces a wastewater flow of up to 300 gallons per day would be considered equivalent to a single-family dwelling unit.

- I. New lots of less than one-half acre may be formed by combining two or more lots which have received one of the approvals specified in Section B.1., above on or prior to September 7, 1989. Individually, these existing lots would be eligible for an exemption from the minimum lot size requirement. Developments on the combined lots may also be granted an exemption provided that the total number of units proposed for the new parcel is equal to or less than the total number of units proposed for the existing parcel. For the purposes of this subsection, a combined lot of less than one-half acre formed from two or more existing lots shall not be considered a new development.
- J. Exemptions from the minimum lot size requirements for the use of septic tank-subsurface disposal systems on lots smaller than one-half acre may be granted if the following conditions are met:
 - 1. The project proponent implements an acceptable offset program. Under an offset program, the project proponent can proceed with development using septic systems on lots smaller than one-half acre if the proponent connects an equivalent number of septic systems to the sewer. The unsewered developments must be those which would not otherwise be required to connect to the sewer.
 - 2. If the septic systems (developments) proposed are not identical to the ones connected to the sewer (the offset), an engineering report shall be submitted certifying that the nitrogen loading rate from the proposed development(s) is(are) equivalent to or less than the nitrogen loading rate from the septic systems in the offset program.
 - 3. The proposed use of septic tank-subsurface disposal systems complies with the Regional Board's "Guidelines for Sewage Disposal from Land Developments,"
- K. The project proponent may propose an alternative treatment system for sewage disposal as the basis for an exemption from the minimum lot size requirement. Each request for use of an alternative treatment system shall be reviewed on a case-by-case basis and submitted to the Regional Board for consideration.

Newport Bay Watershed

Water quality problems in Newport Bay were described in detail in reports prepared in response to Senate Concurrent Resolutions 38 and 88 [Ref. 16, 17]. These problems are essentially nonpoint source problems and fall into four major categories: 1) siltation; 2) bacterial contamination; 3) eutrophication and 4) toxic substances contamination. Because of these problems, the Bay and, in some cases, certain tributaries have been identified as being water quality limited, pursuant to the requirements of Section 303 (d) of the Clean Water Act. (See Water Quality Assessment, Page 6-17.) Section 303(d) requires that Total Maximum Daily Loads (TMDLs) be established for each pollutant

causing water quality impairment. The TMDL must: 1) identify the maximum load of pollutant which can be discharged while ensuring compliance with water quality standards; 2) allocate necessary reductions in the pollutant load among contributing sources; and, 3) establish a plan and schedule to meet the target pollutant load. The following sections describe the major nonpoint source problems and will include the TMDLs and Load Allocations for each category and an Implementation Plan and Schedule for the TMDLs and Load Allocations, after each TMDL is adopted. Each TMDL includes a proposed target for the reduction of pollutant discharge, together with an implementation plan and schedule for requiring compliance with the water quality objectives in the Basin Plan for each pollutant.

1. Siltation (The following was added or modified under Resolution No. 98-101)

Erosion in the watershed and the resultant siltation in the Bay are a continual threat to the Bay's designated uses. Sediment loads result from erosion of open space lands in foothill areas and from man's activities in the watershed, including: 1) extensive grading for development; 2) increased runoff and channel erosion due to urbanization; and 3) erosion of agricultural lands. San Diego Creek, the largest drainage system in the watershed, accounts for approximately 94 percent of the sediment delivered to the Bay. Most deposition occurs during major storm events, although low-level transport occurs year-round.

In 1982, the Southern California Association of Governments (SCAG) completed the "San Diego Creek Comprehensive Stormwater Sedimentation Control Plan" (Plan) as part of an areawide planning process conducted pursuant to Section 208 of the Clean Water Act. The Plan recommended a two-part approach to management of the erosion-siltation problem. The first part is the reduction of erosion at the source through the implementation of agricultural and construction best management practices (BMPs) and resource conservation plans (RCPs). The second part of the Plan is to intercept as much of the remaining sediment as possible in sediment traps in San Diego Creek and in excavated basins in the upper Bay.

Intensive and well-coordinated efforts to implement the recommendations of the 208 Plan have been and are being made by the state, local agencies and The Irvine Company, the largest private landowner in the watershed. In the past, construction and maintenance of the in-channel and in-bay basins was achieved through cooperative agreements among the California Department of Fish and Game, the County of Orange, the Cities of Newport Beach, Irvine and Tustin, and The Irvine Company (collectively known as the Sediment Executive Committee). Between 1982 and 1988, about 2.4 million cubic years of sediments were removed from the Bay, at a cost of about \$13 million. The location and design of the in-bay basins are carefully coordinated with the Department of Fish and Game's management plan for the Upper Newport Bay Ecological Reserve, so that the basins serve not only to trap sediment but also to preserve habitat for many rare and endangered species.

Congress and the U.S. Army Corps of Engineers (Corps) have determined there is a federal interest in sediment removal in the Upper Bay. The Corps also has the primary responsibility for the dredging necessary to maintain navigable channels in the Lower Bay which are impacted by the accumulation of sediment in the Upper Bay. The Corps is currently involved in conducting a Feasibility Study of potential environmental restoration projects in the Upper Bay and has received congressional authorization of initiate a “Fast Track Recon” Study of the San Diego Creek watershed to determine if there are federal interests sufficient to warrant conduct of a Watershed Management Study. The Feasibility Study and Fast Track Recon Study are in the planning stages.

To minimize sediment transport to the Bay, programs have been implemented to control erosion resulting from grading operations at construction sites, and to prevent erosion of agricultural lands. The cities of Irvine, Costa Mesa, Santa Ana, and Newport Beach have grading ordinances which require erosion/siltation control plans for construction projects within their boundaries. The focus of these plans is on the implementation of BMPs. Compliance with the area wide stormwater permit for Orange County and the State Water Resources Control Board’s general construction activity stormwater permit, will necessitate additional coordinated efforts to control sediment inputs from construction activities. With technical assistance from the Regional Board, Orange County oversees a program to ensure development and implementation of resource conservation plans (RCPs) by agricultural landowners, principally the Irvine Company.

1.a. Phase 1 of the TMDL for Sediment

The Total Maximum Daily Load for sediment in the Newport Bay/San Diego Creek Watershed includes the following quantifiable targets and Load Allocations that shall be implemented by the Cities (Irvine, Tustin, Lake Forest, Costa Mesa, Santa Ana and Newport Beach) and County responsible for the sediment discharged into stormwater and flood control conveyances under their control which discharge into San Diego Creek and/or Newport Bay.

1. Sediment control measures shall be implemented and maintained to ensure that sediment discharges into Newport Bay will not significantly change the existing acreages of aquatic, wildlife, and rare and endangered species habitat, and to maintain the navigational and non-contact recreational beneficial uses of the bay. The existing aquatic and wildlife habitat of the Upper Bay, which is comprised of approximately 210 acres of marine aquatic habitat, 214 acres of mudflat habitat, 277 acres of salt marsh, and 31 acres of riparian habitat within, and adjacent to, the 700 acre Upper Newport Bay Ecological Reserve and the existing navigational and recreational uses of Newport Bay, will be used by the Regional Board as a performance standard of the effectiveness of the sediment TMDL. If these acreages are changed by more than 1% as the result of sediment deposition, if the in-bay sediment basins or the in-channel sediment basins are not maintained, or if there are impacts to navigational and recreational uses, this will indicate that the local sediment control measures are not adequate to protect the beneficial uses provided by these areas, and the Board will reevaluate the sediment TMDL for Newport Bay and San

Diego Creek. Since the intent of the sediment TMDL is to protect these beneficial uses, this quantifiable target will be used as the primary measurement of the success of the TMDL. In order to maintain the marine aquatic habitat of the Unit 1 and 2 Sediment Basins in Upper Newport Bay, a minimum depth of 7 feet below mean sea level shall be maintained. The Cities and County, acting through cooperative agreements under the Newport Bay Watershed Executive Committee, shall conduct bathymetric and vegetation surveys of Newport Bay no less than once every three years or as agreed upon by the Executive Officer. This information will be used to evaluate compliance with the acreage and depth targets. If these acreages are changed by more than 1% as the result of sediment deposition, if the minimum depth is not maintained, and if the 50% target sediment reduction described below is not achieved, the Regional Board may consider appropriate enforcement action.

2. It is recognized that the Department of Fish and Game, which is responsible for the management of the Reserve, may wish to modify the habitat composition and acreages of the Reserve to address wildlife needs. The habitat acreages identified above will be revised accordingly through the Basin Plan Amendment process.
3. The second quantifiable target is to reduce the annual average sediment load in the watershed from a total of approximately 250,000 tons per year to 125,000 tons per year, thereby reducing the sediment load to Newport Bay to approximately 62,500 tons per year and limiting sediment deposition in the drainages to approximately 62,500 tons per year. Sediment control measures shall be implemented and maintained to result in a 50% reduction in the current load of sediment in the Newport Bay/San Diego Creek Watershed within 10 years. The Regional Board will determine compliance with this target by calculating the annual average amount of suspended solids measured in San Diego Creek at Jamboree Boulevard and Campus Drive over a ten year period, and by evaluating the scour studies of the creek channels and topographic surveys of all the sediment control basins in the watershed to estimate the amount of deposition. Given that annual sediment deposition can vary widely based on weather and other conditions, it is appropriate to evaluate compliance with the sediment reduction target as a 10 year running annual average of the suspended solids load measured in San Diego Creek at Jamboree Boulevard and Campus Drive. The Regional Board will compare this information to the bathymetric and scour studies information to determine if the monitoring data accurately reflects sediment deposition in the bay and creek channels and to determine compliance with this target.
4. Sediment control measures shall be implemented and maintained to comply with the following Load Allocations (implemented as 10-year running annual averages) for discharges of sediment to Newport Bay: 1) no more than 28,000 tons per year of sediment shall be discharged to Newport Bay from open space areas within the watershed, 2) no more than 19,000 tons per year shall be from agricultural land, 3) no more than 13,000 tons per year from construction sites, 4) no more than 2,500 tons per year discharged from urban areas. The Cities and County, acting through cooperative agreements under the Newport Bay Watershed Executive Committee, shall be required to provide a proposal for evaluating compliance with these individual

land use type load allocations that is subject to the approval of the Executive Officer. This proposal shall be implemented upon approval of the Executive Officer.

5. Sediment control measures shall be implemented and maintained to comply with the following Load Allocations (implemented as 10-year running annual averages) in addition to the load allocations specified above for Newport Bay for discharges of sediment to tributaries of Newport Bay: 1) no more than 28,000 tons per year of sediment shall be discharged to San Diego Creek and its tributaries from open space areas within the watershed, 2) no more than 19,000 tons per year shall be discharged to San Diego Creek and its tributaries from agricultural land, 3) no more than 13,000 tons per year discharged to San Diego Creek and its tributaries from construction sites, 4) no more than 2,500 tons per year discharged to San Diego Creek and its tributaries from urban areas. The Cities and County, acting through cooperative agreements under the Newport Bay Watershed Executive Committee, shall be required to provide a proposal for evaluating compliance with these individual land use type load allocations that is subject to the approval of the Executive Officer. This proposal shall be implemented upon approval of the Executive Officer.
6. Sediment control measures shall be implemented such that Upper Newport Bay, including In-Bay Sediment Basins 1 and 2, need not be dredged more frequently than about once every 10 years, and the long term goal of Phase 1 of the TMDL for sediment is to reduce the frequency of dredging to once every 20 to 30 years. It is recognized that extreme rainfall conditions may necessitate more frequent dredging of the in-bay basins. The Regional Board will adopt waste discharge requirements for such dredging projects as the means of recommending Clean Water Act Section 401 Water Quality Certification for the dredging, and to ensure proper disposal of the dredged sediment.
7. Waste Discharge Requirements will be waived for maintenance dredging of flood control channels and drainages throughout the watershed in order to maintain flood control capacity, under the following conditions; 1) any vegetation removal or earthwork conducted between March 1 and September 1 shall be supervised by a qualified biologist, approved by the Department of Fish and Game, to ensure compliance with the Endangered Species Act and Migratory Bird Treaty Act (this monitor shall have the authority to stop or divert work to avoid impacts as necessary); and 2) the information in a complete application (report of waste discharge) demonstrates that the waiver criteria specified herein and in Regional Board Resolution No. 96-9, Waiver of Waste Discharge Requirements for Certain Types of Discharges, are met.
8. All in-channel and foothill sediment control basins throughout the drainages in the watershed shall be maintained to have at least 50% of design capacity available prior to November 15 of each year. Waste Discharge Requirements will be waived for sediment control basin maintenance activities under the following conditions: 1) any vegetation removal or earthwork conducted between March 1 and September 1 shall be supervised by a qualified biologist, approved by the Department of Fish and Game,

to ensure compliance with the Endangered Species Act and Migratory Bird Treaty Act (this monitor shall have the authority to stop or divert work to avoid impacts as necessary); 2) the use of herbicides for the control of vegetation within channels shall be avoided to the greatest extent practicable; and 3) the information in a complete application (report of waste discharge) demonstrates that the waiver criteria specified herein and in Regional Board Resolution No. 96-9, Waiver of Waste Discharge Requirements for Certain Types of Discharges, are met.

9. Waste Discharge Requirements will be waived for drainage channelization and stabilization projects on drainages within the watershed between the foothill sediment basins and Upper Newport Bay, under the following conditions: 1) while modifying the channels, no native riparian wetland vegetation shall be removed from within the basins or adjacent to the basins during the period between April 1 and September 1 of each year, in order to protect the federally listed least Bell's vireo, unless one to one mitigation is provided for the loss of the riparian and aquatic habitat; 2) any vegetation removal or earthwork conducted between March 1 and September 1 shall be supervised by a qualified biologist, approved by the Department of Fish and Game, to ensure compliance with the Endangered Species Act and Migratory Bird Treaty Acts (this monitor shall have the authority to stop or divert work to avoid impacts as necessary); and 3) the information in a complete application (report of waste discharge) demonstrates that the waiver criteria specified herein and in Regional Board Resolution No. 96-9, Waiver of Waste Discharge Requirements for Certain Types of Discharges, are met. The Regional Board will continue to work with the U.S. Army Corps of Engineers and other appropriate agencies towards the adoption of a Special Area Management Plan (or comparable plan) and General Permit for channel stabilization and flood control projects in accordance with Section 404 and 401 of the Clean Water Act. If a plan for completing the Special Area Management Plan by June 1, 1999 is not submitted to the Executive Officer by January 1, 1999, then the Executive Officer is directed to require, as an additional condition for obtaining a waiver, the completion of a comprehensive delineation of all the wetlands in the watershed and an evaluation of the cumulative impacts of projects to control sediment and the build-out of the watershed on the beneficial uses of these waters of the State. This evaluation of the cumulative impacts must be completed, according to a plan acceptable to the Executive Officer, by June 1, 1999. Staff intends to use the delineation to propose a general permit to the Regional Board that will cover the kind of activities described in the amendment. Until the SAMP, or, alternatively, the comprehensive delineation described above, is completed, staff will continue to process individual permit applications for each project.
10. The Cities and County, acting through cooperative agreements under the Newport Bay Watershed Executive Committee, shall evaluate: 1) the amount of sediment being discharged from areas that contribute sediment to the total load discharged to Newport Bay; and 2) the effectiveness of the local sediment control plan (the 208 Plan). Where areas that contribute sediment are not under the jurisdiction of entities that are currently part of the Newport Bay Watershed Executive Committee, the Cities and County shall recommend to the Regional Board, if necessary, a new formula for

allocating sediment loads and sharing of the costs of implementing the sediment control measures that will provide a 50% reduction in the current load of sediment. This evaluation shall, at a minimum, address the sediment loads from the Santa Ana-Delhi Channel, Bonita Creek, the federal lands within the watershed, and the City of Lake Forest.

These conditions shall not supersede more restrictive conditions of other agencies, such as the U.S. Army Corps of Engineers, U.S. Fish and Wildlife Service, the State Department of Fish and Game, or other local agencies.

1.b. Phase 2 of the TMDL for Sediment: Monitoring and Reassessment

The Newport Bay Watershed Executive Committee has developed an agreement whereby the County of Orange conducts the monitoring of sediment discharge within the watershed, with the costs shared by all parties, except the Department of Fish and Game. There has been no site specific monitoring of the various sources of sediment, so it is impossible to determine the effectiveness of specific BMPs. It is also too soon to reach any conclusions about the overall effectiveness of the local sediment control measures.

Since 1983, the County has monitored flow and total suspended solids at three locations and conducts periodic scour studies to evaluate sediment transport and deposition in the drainages within the watershed. In addition, the County has conducted two topographic surveys of the Upper Bay to determine sediment accumulation in the Upper Bay. The County intends to continue this monitoring program on behalf of the Newport Bay Watershed Executive Committee.

In addition, the Newport Bay Watershed Executive Committee shall:

1. Propose monitoring stations and schedules to be established to monitor the discharge of sediment from the Santa Ana-Delhi Channel and Bonita Canyon Creek into the Upper Bay and to evaluate the effectiveness of the BMPs being implemented in the watershed. This monitoring plan shall also propose monitoring to evaluate compliance with the Load Allocations for various land use types. This monitoring plan will not become effective until approved by the Regional Board at a duly noticed public hearing as specified in Chapter 1.5, Division 3, Title 23 of the California Code of Regulations (Section 647 et seq.).
2. Propose monitoring stations and schedules to conduct the scour studies for the drainages in the watershed to be conducted annually. These surveys shall determine the amount of sediment accumulated in San Diego Creek and its tributaries, the in-channel sediment basins, the foothill sediment basins, and any other sediment basins in the watershed. The survey report shall be used to demonstrate whether the sediment basins have at least 50% capacity prior to November 15 of each year. This monitoring plan will not become effective until approved by the Regional Board at a duly noticed public hearing as specified in Chapter 1.5, Division 3, Title 23 of the California Code of Regulations (Section 647 et seq.).

3. Conduct topographic and vegetation surveys of Upper Newport Bay at least every three years, or as agreed upon by the Executive Officer, and after any year in which the monitoring for total suspended solids at Campus Drive shows that more than 250,000 tons of sediment were discharged to the Bay. In any year in which these surveys are required, the surveys shall be conducted by July 1. The results of these surveys shall be submitted as part of an annual report by December 31 of each year. The topographic and vegetation surveys shall be conducted to determine the amount of sediment deposition in the two In-Bay basins and the other marine aquatic habitat areas and to determine changes in the areal extent of the existing aquatic, wildlife and endangered species habitat areas.
4. Submit an annual report by December 31 of each year providing the monitoring data and information collected by the Newport Bay Watershed Executive Committee, including the flow and suspended solids monitoring data, the scour studies, the bathymetric and vegetation surveys, (and any additional information collected by the Committee). The monitoring shall be completed prior to July 1 of each year and this information shall be used to determine the maintenance requirements of all sediment basins in the watershed. Additionally, the Newport Bay Watershed Executive Committee shall submit a report by November 15 of each year certifying whether the sediment basins in the watershed have at least 50% capacity. The Regional Board will use the information collected by this monitoring program to evaluate the effectiveness of the sediment TMDL and will reevaluate the sediment TMDL as part of the Regional Board's Basin Planning process.
5. The monitoring data and information collected by the Newport Bay Watershed Executive Committee, including the flow and suspended solids monitoring data, the scour studies, the bathymetric surveys and the vegetation surveys, (and any additional information collected by the Newport Bay Watershed Executive Committee) shall be submitted in an annual report by December 31 of each year. The monitoring shall be completed prior to July 1 of each year and this information shall be used to determine the maintenance requirements of all sediment basins in the watershed. Additionally, the Newport Bay Watershed Executive Committee shall submit a report by November 15 of each year certifying whether the sediment basins in the watershed have at least 50% capacity. The Regional Board will use the information collected by this monitoring program to evaluate the effectiveness of the sediment TMDL and will reevaluate the sediment TMDL as part of the Board's Basin Planning process.
(End of amendment adopted under Resolution 99-101)

2. Eutrophication (The following was added under Resolution No. 98-100)

Nutrient loading to the Bay, particularly from the San Diego Creek watershed, contributes to seasonal algal blooms which can create a recreational and aesthetic nuisance. These algal blooms may also adversely affect wildlife.

The nutrient TMDL for the Newport Bay/San Diego Creek Watershed distributes the portions of the waterbody's assimilative capacity to various pollution sources so that the waterbody achieves its water quality standards. The Regional Board supports the trading of pollutant allocations among sources where appropriate. Trading can take place between point/point, point/nonpoint, and nonpoint/nonpoint pollutant sources. Optimizing alternative point and nonpoint control strategies through allocation tradeoffs may be a cost effective way to achieve pollution reduction benefits.

While there are a number of sources of nutrient input, tailwaters from the irrigation of agricultural crops and from several commercial nurseries in the watershed has been the predominant source. The Regional Board issued Waste Discharge Requirements to the three nurseries, requiring substantial reductions in their nutrient loads. Significant improvements have been achieved by these nurseries, largely due to the implementation of drip irrigation systems (which greatly reduce the amount of tailwater) and/or recycle systems. Installation of drip irrigation systems for other agricultural crops has also significantly reduced the volume of nutrient-laden tailwaters. These improvements, coupled with the increased tidal flushing caused by the in-bay basins, appears to have resulted in a substantial downward trend in nitrate concentrations in the Bay. However, algal blooms are still occurring in Newport Bay and San Diego Creek. As a result, Newport Bay and San Diego Creek are listed as water quality impaired due to nutrients pursuant to Section 303(d) of the Clean Water Act. A nutrient TMDL to address this problem for Newport Bay and San Diego Creek is described in the following sections.

The hydrodynamic, sediment transport, and water quality models of Newport Bay being jointly developed by the U.S. Army Corps of Engineers and the Regional Board will be used in the future to further refine the algae and nutrient relationships in the Bay. These refinements will be considered in future reviews and revisions of the nutrient TMDL.

2.a. Quantifiable Nutrient Targets

The annual loading of total nitrogen and phosphorus to Newport Bay shall be reduced by 50% by 2012. The seasonal and annual loading targets are listed in Table 5-9a.

Table 5-9a Summary of Loading Targets and Compliance Time Schedules.

TMDL	December 31, 2002 ⁵	December 31, 2007 ⁵	December 31, 2012 ⁵
Newport Bay Watershed Total Nitrogen - Summer Load ¹	200,097 lbs.	153,861 lbs.	
Newport Bay Watershed Total Nitrogen - Winter Load ²			144,364 lbs.
Newport Bay Watershed Total Phosphorus - Annual Load ³	86,912 lbs.	62,080 lbs.	
San Diego Creek, Reach 2 Total Nitrogen - Daily Load ⁴			14 lbs.

¹ Total nitrogen summer loading limit applies between April 1 and September 30.

² Total nitrogen winter loading limit applies between October 1 and March 31 when the mean daily flow rate at San Diego Creek at Campus Drive is below 50 cubic feet per second (cfs), and when the mean daily flow rate in San Diego Creek at Campus Drive is above 50 cubic feet per second (cfs), but not as the result of precipitation.

³ Total phosphorus annual loading is the sum of summer and winter loading during all daily flow rates.

⁴ Total nitrogen daily loading limit applies when the mean daily flow rate at San Diego Creek at Culver Drive is below 25 cubic feet per second (cfs), and when the mean daily flow rate in San Diego Creek at Culver Drive is above 25 cubic feet per second (cfs), but not as the result of precipitation.

⁵ Compliance to be achieved no later than this date. The Regional Board may require earlier compliance with these targets when it is feasible and reasonable.

The margin of safety of the nutrient TMDL is implicit through the use of conservative assumptions. These conservative assumptions include controlling all forms of nitrogen and phosphorus and controlling seasonal and annual loading.

Load Allocations

The 5, 10, and 15 year seasonal load allocations of total nitrogen for the Newport Bay Watershed are presented in Table 5-9b. The 5 and 10-year annual total phosphorus load allocations for the Newport Bay Watershed are presented in Table 5-9c. The 15 year daily total nitrogen load allocations for San Diego Creek, Reach 2 are presented in Table 5-9d. The nutrient load reduction targets will be incorporated into waste discharge requirements as effluent limits, load allocations, and waste load allocations as necessary to ensure that:

- a. the total inorganic nitrogen and narrative water quality objectives for Newport Bay and San Diego Creek are achieved
- b. Clean Water Act requirements for the implementation of a TMDL are satisfied

Table 5-9b Seasonal Load Allocations of Total Nitrogen for the Newport Bay Watershed.

Nutrient TMDL	1990-1997 Loading	2002 Allocation ⁸	2002 Summer Allocation (April-Sept) ⁸	2007 Allocation ⁸	2007 Summer Allocation (April-Sept) ⁸	2012 Allocation ⁸	2012 Winter Allocation (Oct-Mar) ^{7, 8, 11}
Newport Bay Watershed	lbs/year TN ²	lbs/day TN ¹⁰	lbs/season TN	lbs/day TN ¹⁰	lbs/season TN	lbs/day TN ¹⁰	lbs/season TN
Wasteload Allocation							
Hines Nurseries	96,360 TIN ¹	224	40,992	211	38,613	211	14,227
Bordiers Nursery	30,660 TIN	71	12,993	67	12,261	67	4,518
EI Modeno Gardens	18,250 TIN	43	7,869	40	7,320	40	2,697
Unpermitted nurseries	----- ³	30	5,490	24	4,392	24	1,618
Nursery subtotal			67,344		62,586		23,060
IRWD WWSP (permanent discharge) ⁹	0	62		62		62	4,181
Silverado Constructors ETC ⁴	0	141	25,671	141	25,671	141	9,459
Urban runoff	277,131 ⁶		20,785		16,628		55,442
Wasteload Allocation			113,800		104,885		92,142
Load Allocation							
Agricultural discharges	328,040 ⁶		22,963		11,481		38,283
Undefined sources (Open space, atmospheric deposition, rising groundwater, groundwater cleanup/dewatering, in-bay nitrogen)	----- ³		63,334		37,495		13,939
Load Allocation			86,297		48,976		52,222
Total	1,087,000 ⁵		200,097		153,861		144,364
			5 year target		10 year target		15 year target

¹ TIN = (NO3+NH3).

² TN = (TIN + Organic N).

³ Unknown.

⁴ Wasteload allocation of a 50% reduction in nitrogen concentration upon commencement of discharge

⁵ 1990-1997 annual average (summer loading and winter loading).

⁶ Estimated annual average (summer and winter loading).

⁷ Total nitrogen winter loading limit applies between October 1 and March 31 when the mean daily flow rate at San Diego Creek at Campus Drive is below 50 cubic feet per second (cfs), and when the mean daily flow rate in San Diego Creek at Campus Drive is above 50 cubic feet per second (cfs), but not as the result of precipitation.

⁸ Compliance to be achieved no later than this date. The Regional Board may require earlier compliance with these targets when it is feasible and reasonable.

⁹ Daily load limit applies upon commencement of discharge.

¹⁰ Lbs/day TN (monthly average).

¹¹ Assumes 67 non-storm days.

Table 5-9c Annual Total Phosphorous Load Allocations For The Newport Bay Watershed.

	2002 Allocation lbs/year TP¹	2007 Allocation lbs/year TP¹
TMDL	86,912	62,080
Urban areas	4,102	2,960
Construction sites	17,974	12,810
Waste Load Allocation	22,076	15,770
Agricultural areas	26,196	18,720
Open space	38,640	27,590
Load Allocation	64,836	46,310

¹ Compliance to be achieved no later than this date. The Regional Board may require earlier compliance with these targets when it is feasible and reasonable.

Table 5-9d Annual Total Nitrogen Load Allocations For San Diego Creek, Reach 2 During Non-Storm Conditions.¹

	2012 Allocation lbs/day TN²
TMDL	14 lbs/day (TN)
Waste Load Allocation (Urban runoff)	5.5 lbs/day (TN)
Load Allocation (Nurseries, agriculture, undefined sources)	8.5 lbs/day (TN)

¹ Total nitrogen loading limit applies when the mean daily flow rate at San Diego Creek at Culver Drive is below 25 cubic feet per second (cfs), and when the mean daily flow rate in San Diego Creek at Culver Drive is above 25 cubic feet per second (cfs), but not as the result of precipitation.

² Compliance to be achieved no later than this date. The Regional Board may require earlier compliance with these targets when it is feasible and reasonable.

2.b. Phase I of the Nutrient TMDL

1. Review and Revision of Water Quality Objectives

By December 31, 2000, the Regional Board shall review, and revise as necessary, the numeric water quality objectives for total inorganic nitrogen for San Diego Creek, Reaches 1 and 2. The Regional Board shall also examine the appropriateness of establishing numeric water quality objectives for phosphorus for San Diego Creek, Reaches 1 and 2.

2. Establish New Waste Discharge Requirements

By December 31, 1999, the Regional Board shall issue new Waste Discharge Requirements (WDRs) to nursery operations of 5 acres or greater which currently are not regulated by WDRs (as of the effective date of this amendment) but discharge nutrients in excess of 1 mg/L TIN to storm channels which are tributary to Newport Bay. The new WDRs shall incorporate the appropriate wasteload, load, and margin of safety allocations identified in the nutrient load targets for the Newport Bay Watershed. Appropriate monitoring programs to evaluate compliance with load targets and allocations shall be required and incorporated into the WDRs

3. Revision of Existing Waste Discharge Requirements

a. By December 31, 1998, the Regional Board shall revise existing WDRs for nursery operations which currently (as of the effective date of this amendment) discharge nutrients in excess of 1 mg/L TIN to drainages which are tributary to Newport Bay. The revised WDRs shall incorporate the appropriate wasteload, load, and margin of safety allocations identified in the nutrient load reduction targets for the Newport Bay Watershed. Appropriate monitoring programs to evaluate compliance with load targets and allocations shall be required and incorporated into the WDRs.

b. By December 31, 1998, the Regional Board shall revise existing NPDES permits for discharges which currently (as of the effective date of this amendment) discharge nutrients in excess of 1 mg/L TIN to drainages which are tributary to Newport Bay. The revised NPDES permits shall incorporate the appropriate wasteload, load, and margin of safety allocations identified in the nutrient load reduction targets for the Newport Bay Watershed. Appropriate monitoring programs to evaluate compliance with load targets and allocations shall be required and incorporated into the NPDES permits.

c. By March 31, 1999, the Regional Board shall revise the Monitoring and Reporting Programs of existing NPDES permits and WDRs for groundwater dewatering and cleanup operations which discharge to drainages which are tributary to Newport Bay to include requirements for phosphorus and total nitrogen sampling and analysis. This monitoring will generate the data necessary to develop appropriate wasteload allocations for these discharges.

4. Agricultural Activities

A watershed-wide nutrient management program for agricultural activities shall be developed by the Orange County Farm Bureau, University of California Cooperative Extension, and the affected growers, in conjunction with Regional Board staff. The proposed management program shall be submitted by July 1, 1999. The nutrient management program will not become effective until approved by the Regional Water Quality Control Board at a duly noticed public meeting as specified in Chapter 1.5, Division 3, Title 23 of the California Code of Regulations (Section 647 et seq.).

5. Urban Stormwater

Co-permittees of the Orange County Areawide Urban Stormwater Permit (Order No. 96-31) shall be required to submit for approval by the Regional Board's Executive Officer an analysis of appropriate Best Management Practices which will be additionally implemented through the Drainage Area Management Plan (DAMP) to achieve the short term (5-year) interim targets and final nutrient load reduction targets for the Newport Bay Watershed. The co-permittees shall also be required to provide a proposal for 1) evaluating the effectiveness of control actions implemented and 2) evaluating compliance with the nutrient load allocation. The proposal and analysis shall be submitted by July 1, 1999, and shall be implemented upon approval of the Executive Officer as specified by Section IV.1.a.ii.A of Order No. 96-31.

6. Phosphorus

The primary reduction of phosphorus loading is expected to be achieved by the implementation of the total maximum daily load for sediment in the Newport Bay/San Diego Creek watershed. The sediment TMDL is incorporated into the nutrient TMDL for the Newport Bay/San Diego Creek watershed by reference (Note - the sediment TMDL will be appropriately referenced once it is approved by OAL). Limits on phosphorus discharges shall be incorporated into the new and revised Waste Discharge Requirements previously listed, as necessary.

2.c. Phase II of the Nutrient TMDL

1. Monitoring

The Regional Board will establish and oversee a regional monitoring program (RMP) for the Newport Bay watershed. The new and revised WDRs, NPDES permits, DAMP, and agricultural nutrient management plans shall have include requirements to conduct self-monitoring, or in lieu of self-monitoring, to participate in the RMP. Participation in the RMP could result in the reduction of self-monitoring requirements. The RMP will not become effective until approved by the Regional Water Quality Control Board at a duly noticed public meeting as specified in Chapter 1.5, Division 3, Title 23 of the California Code of Regulations (Section 647 et seq.).

The RMP shall be designed by the Regional Board to assess the attainment of the goals of the nutrient TMDL. The objectives of the monitoring program shall be the quantification of the three endpoints of the nutrient TMDL: (1) the seasonal nutrient loading from the watershed; (2) the nutrient concentration in San Diego Creek, Reaches 1 and 2; and (3) the extent, magnitude, and duration of algal blooms in San Diego Creek and Newport Bay. The monitoring plan shall be implemented by March 1999.

The Regional Board will initiate investigations into the currently unknown sources of nutrients in the Newport Bay Watershed. The Regional Board, in cooperation with other agencies and entities, will investigate the occurrence of rising shallow groundwater in the Newport Bay Watershed. The study will focus on the contributions of rising groundwater to the loading of nutrients to drainage channels which are tributary to Newport Bay. Additionally, the study of the nutrient and algae processes of Newport Bay and San Diego Creek will be encouraged and supported by the Regional Board. Regional Board support could include financial resources, personnel, agency coordination, and scientific review.

2. Actions and Schedule to Achieve Water Quality Objectives

The actions and schedule to achieve water quality objectives is outlined in Table 5-9e. Meeting load reduction targets is highly dependent upon the effectiveness of individual actions; therefore, the Regional Board will review the TMDL, WDRs and compliance schedule at least once every 3 years. Any or all of these may be revised in order to meet water quality standards.

2.d. Estimated Costs of Agricultural Water Quality Control Programs and Potential Sources of Financing

The estimates of capital and operational costs to achieve the nutrient targets of the nutrient TMDL for the San Diego Creek/Newport Bay watershed range from \$0.69 million/year to \$4.73 million/year.

Potential funding sources include:

1. Private financing by individual sources.
2. Bonded indebtedness or loans from governmental institutions.
3. Surcharge on water deliveries to lands contributing to the drainage problem.
4. Ad Valorem tax on lands contributing to the drainage problem.
5. State or federal grants or low-interest loan programs.
6. Single-purpose appropriations from federal or State legislative bodies (including land retirement programs).

Table 5-9e Schedule of Actions to Achieve Water Quality Objectives.

Program Actions	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013
Review and revision of water quality objectives			X													
New nursery permits		X														
Revise existing permits	X															
Nurseries	X															
NPDES permit	X															
Groundwater cleanup/dewatering		X														
Agricultural nutrient management plans		X														
Urban runoff BMP plan		X														
Sediment TMDL implementation	X															
Monitoring		X														
Newport Bay Watershed total nitrogen - summer TMDL targets					X					X						
Newport Bay Watershed total nitrogen - winter TMDL target															X	
Newport Bay Watershed total phosphorus - annual TMDL targets					X					X						
San Diego Creek, Reach 2 total nitrogen - daily target															X	
Evaluation of TMDL			X			X			X		X			X		X

(End of amendment adopted under Resolution No. 98-100)

3. Bacterial Contamination (The following was added under Resolution No. 99-10)

Bacterial contamination of the waters of Newport Bay can directly affect two designated beneficial uses: water-contact recreation (**REC-1**) and shellfish harvesting (**SHEL**). The Orange County Health Care Agency (OCHCA) conducts routine bacteriological monitoring and more detailed sanitary surveys as necessary, and is responsible for closure of areas to recreational and shellfish harvesting uses if warranted by the results.

Because of consistently high levels of total coliform bacteria, the upper portion of Upper Newport Bay (Upper Bay) has been closed to these uses since 1974. In 1978, the shellfish harvesting prohibition area was expanded to include all of the Upper Bay, and the OCHCA generally advises against the consumption of shellfish harvested anywhere in the Bay. Bacterial objectives established to protect shellfish harvesting activities are rarely met in the Bay. (Fecal coliform objectives for the protection of shellfish harvesting and water-contact recreation are shown in Chapter 4, "Enclosed Bays and Estuaries". The OCHCA has relied on total coliform standards specified in the California Health and Safety Code. Fecal coliform are a subset of total coliform.). Certain areas in the lower parts of the Upper Bay and in Lower Newport Bay (Lower Bay) are also closed to water-contact recreation on a temporary basis, generally in response to storms. In these areas, there is generally good compliance with water-contact recreation bacterial objectives in the summer.

Data collected by the OCHCA demonstrate that tributary inflows, composed of urban and agricultural runoff, including stormwater, are the principal sources of coliform input

to the Bay. As expected, there are more violations of bacterial standards in the Bay during wet weather, when tributary flows are higher, than in dry weather. There are few data on the exact sources of the coliform in this runoff. Coliform has diverse origins, including: manure fertilizers which may be applied to agricultural crops and to commercial and residential landscaping; the fecal wastes of humans, household pets and wildlife; and other sources. Special investigations by OCHCA have demonstrated that food wastes are a significant source of coliform. Many restaurants wash down equipment and floor mats into storm drains tributary to the Bay and may improperly dispose of food waste such that it eventually washes into the Bay. Such discharges likely contribute to the chronic bacterial quality problems in certain parts of the Bay.

Another source of bacterial input to the Bay is the discharge of vessel sanitary wastes. Newport Bay has been designated a no-discharge harbor for vessel sanitary wastes since 1976. Despite this prohibition, discharges of these wastes have continued to occur. Since these wastes are of human origin, they pose a potentially significant public health threat.

The Regional Board, the City of Newport Beach (City), the County of Orange, the City of Newport Beach Harbor Quality Committee, and other parties have taken or stimulated actions to enforce the vessel waste discharge prohibition. The principal focus of these efforts has been to make compliance with the prohibition convenient and therefore more

likely. Vessel waste pumpouts have been installed at key locations around the Bay and are inspected routinely by the OCHCA. A City ordinance addresses people-intensive boating activities to ensure proper disposal of sanitary wastes. The ordinance requires that sailing clubs, harbor tour, and boat charter operations install pumpouts for their vessels. Another City ordinance addresses vessel waste disposal by persons living on their boats. Efforts have also been made to ensure that there are adequate public rest rooms onshore. The City also sponsors an extensive public education campaign designed to advise both residents and visitors of the discharge prohibition, the significance of violations, and of the location of pumpouts and rest room facilities. The effectiveness of these extensive vessel waste control efforts is not known.

As noted, the fecal waste of wildlife, including waterfowl that inhabit the Bay and its environs, is a source of coliform input. The fecal coliform from these natural sources may contribute to the violations of water quality objectives and the loss of beneficial uses, but it is currently unknown to what extent these natural sources contribute to, or cause, the violations of bacterial quality objectives in Newport Bay.

Reports prepared by Regional Board staff describe the bacterial quality problems in the Bay in greater detail and discuss the technical basis for the fecal coliform TMDL that follows (Ref. 21, 22). Implementation of this TMDL is expected to address these bacterial quality problems and to assure attainment of water quality standards, that is, compliance with water quality objectives and protection of beneficial uses.

3.a. Fecal Coliform TMDL

A prioritized, phased approach to the control of bacterial quality in the Bay is specified in this TMDL. This approach is appropriate, given the complexity of the problem, the paucity of relevant data on bacterial sources and fate, the expected difficulties in identifying and implementing appropriate control measures, and uncertainty regarding the nature and attainability of the SHEL use in the Bay. The phased approach is intended to allow for additional monitoring and assessment to address areas of uncertainty and for future revision and refinement of the TMDL as warranted by these studies.

Table 5-9f summarizes the TMDL, Waste Load Allocations (WLAs) for point sources of fecal coliform inputs and Load Allocations (LAs) for nonpoint source inputs. As shown, the TMDL, WLAs and LAs are established to assure compliance with water contact recreation standards no later than December 30, 2014 and with shellfish standards no later than December 30, 2019. WLAs are specified for vessel waste and urban runoff, including stormwater, the quality of which is regulated under a County-wide NPDES permit issued by the Regional Board. This runoff is thus regulated as a point source, even though it is diffuse in origin. LAs are specified for fecal coliform inputs from agricultural runoff, including stormwater, and natural sources. The TMDL is to be adjusted, as appropriate, based upon completion of the studies contained in Table 5-9g. Upon completion of these studies, an updated TMDL report will be prepared summarizing the results of the studies and making recommendations regarding

implementation of the TMDL. The results of the studies may lead to recommendations for changes to the TMDL specified in Table 5-9f to assure compliance with existing Basin Plan standards (objectives and beneficial uses). The study results may also lead to recommendations for changes to the Basin Plan objectives and/or beneficial uses. If such standards changes are approved through the Basin Plan amendment process, then appropriate changes to the TMDL would be required to assure attainment of the revised standards. Revision of the TMDL, if appropriate, would also be considered through the Basin Plan amendment process.

Upon completion and consideration of the studies and any appropriate Basin Plan amendments, a plan for compliance with the TMDL specified in Table 5-9f, or with an approved amended TMDL, will be established. It is expected that this plan will specify a phased compliance approach, based on consideration of such factors as geographic location, the priority assigned by the Regional Board to specific locations for control actions (see Section 3.a.ii, "Beneficial Use Assessment"), season, etc. Interim WLAs, LAs and compliance dates that lead to ultimate compliance with the TMDL will be established.

The TMDL and its allocations contain a significant margin of safety. The margin of safety can be either incorporated implicitly through analytical approaches and assumptions used to develop the TMDL or added explicitly as a separate component of the TMDL. A substantial margin of safety is implicitly incorporated in the TMDL in the fact that the TMDL does not apply criteria for dilution, natural die-off, and tidal flushing. The TMDL, WLAs, and LAs are established at concentrations equivalent to the water quality objectives.

Table 5-9f: Total Maximum Daily Load, Waste Load Allocations, and Load Allocations for Fecal Coliform in Newport Bay

Total Maximum Daily Load for Fecal Coliform In Newport Bay	Waste Load Allocations for Fecal Coliform in Urban Runoff, including stormwater, Discharges to Newport Bay	Load Allocations for Fecal Coliform in Agricultural Runoff, including stormwater, Discharges to Newport Bay	Load Allocations for Fecal Coliform from Natural Sources in all Discharges to Newport Bay	Waste Load Allocations for Vessel Waste
As soon as possible but no later than (14 years after State TMDL Approval)*			In Effect	In Effect
5-Sample/30-days Geometric Mean less than 200 organisms/100 mL, and not more than 10% of the samples exceed 400 organisms/ 100 mL for any 30-day period.	5-Sample/30-days Geometric Mean less than 200 organisms/100 mL, and not more than 10% of the samples exceed 400 organisms/ 100 mL for any 30-day period.	5-Sample/30-days Geometric Mean less than 200 organisms/ 100 mL, and not more than 10% of the samples exceed 400 organisms/ 100 mL for any 30-day period.	5-Sample/30-days Geometric Mean less than 200 organisms/100 mL, and not more than 10% of the samples exceed 400 organisms/ 100 mL for any 30-day period.	0 MPN/100 mL No discharge.
As soon as possible but no later than (20 years after State TMDL Approval)*				In Effect
Monthly Median less than 14 MPN/100 mL, and not more than 10% of the samples exceed 43 MPN/100 mL.	Monthly Median less than 14 MPN/100 mL, and not more than 10% of the samples exceed 43 MPN/100 mL.	Monthly Median less than 14 MPN/100 mL, and not more than 10% of the samples exceed 43 MPN/100 mL.	Monthly Median less than 14 MPN/100 mL, and not more than 10% of the samples exceed 43 MPN/100 mL.	0 MPN/100 mL No discharge.

Table 5-9g: Fecal Coliform Implementation Plan/Schedule Report Due Dates

Task	Description	Compliance Date-As soon As Possible but No Later Than
Task 1	Routine Monitoring Program (Section 3.a.ii.a) a) Submit Proposed Routine Monitoring Plan(s) ¹ b) Implement Routine Monitoring Plan(s) c) Submit Monthly and Annual Reports (Reporting Period: April 1-March 31)	a) (Within 30 days) ² b) Upon Regional Board Approval of Plan(s) c) Monthly within 30 days, Annual Report by September 1
Task 2	Water Quality Model for Bacterial Indicators (Section 3.a.ii.b) a) Submit Proposed Model Development Plan b) Submit Calibrated Model and Model Documentation	a) (Within 30 days) ² b) 13 months after Regional Board approval of plan(s)
Task 3	Beneficial Use Assessment Plan (Section 3.a.ii.c) Submit Proposed Assessment Plan for: a) REC-1 b) SHEL	a) (Within 30 days) ² b) (Within 13 months) ²
Task 4	Beneficial Use Assessment Report (3.a.ii.c) Submit Beneficial Use Assessment Report for: a) REC-1 b) SHEL	a) 13 months after Regional Board approval of plan(s) b) 13 months after Regional Board approval of plan(s)
Task 5	Source Identification and Characterization Plan(s) (Section 3.a.ii.d) Submit Proposed Source Identification Plans for: a) The Dunes Resort b) Urban Runoff (including stormwater) c) Agriculture (including stormwater) d) Natural Sources	a) (Within 60 days) ² b) (Within 60 days) ² c) (Within 3 months) ² d) (Within 3 months) ²

Table 5-9g: Fecal Coliform Implementation Plan/Schedule Report Due Dates

Task	Description	Compliance Date-As Soon As Possible but No Later Than
Task 6	Source Identification and Characterization Reports (Section 3.a.ii.d) Submit Source Identification and Characterization Reports for: a) The Dunes Resort b) Urban Runoff (including stormwater) c) Agriculture (including stormwater) d) Natural Sources	a) 7 months after Regional Board approval of plan(s) b) 13 months after Regional Board approval of plan(s) c) 16 months after Regional Board approval of plan(s) d) 16 months after Regional Board approval of plan(s)
Task 7	Evaluation of Vessel Waste Program (Section 3.a.ii.e) a) Submit Proposed Plan for Evaluating the Current Vessel Waste Program b) Submit Report on the Evaluation of the Vessel Waste Program	a) (Within 3 months) ² b) 12 months after Regional Board approval of plan
Task 8	TMDL, WLA, and LA Evaluation and Source Monitoring Program (Section 3.a.ii.f) a) Submit Proposed Evaluation and Source Monitoring Program Plan(s) b) Implement Evaluation and Source Monitoring Plan(s) c) Submit Monthly and Annual Reports (Reporting Period: April 1-March 31)	a) 3 months after completion of Tasks 2, 4a, and 6 b) Upon Regional Board approval of plan(s) c) Monthly within 30 days, Annual Report by September 1
Task 9	Updated TMDL Report Submit updated TMDL report for: a) REC-1 b) SHEL	a) 6 months after completion of Tasks 2, 4a, 6, and 7 b) 6 months after completion of Tasks 2, 4b, 6, and 7

Table 5-9g: Fecal Coliform Implementation Plan/Schedule Report Due Dates

Task	Description	Compliance Date-As Soon As Possible but No Later Than
Task 10	Adjust TMDL, if necessary; adopt interim WLAs, LAs, and Compliance Dates (Section 3.a.ii.h) a) REC-1 b) SHEL	a) 12 months after completion of Updated TMDL Report for REC-1 (Task 9.a) b) 12 months after completion of Updated TMDL Report for SHEL (Task 9.b)
¹ Note: Provided that the monitoring program plan(s) fulfills the minimum requirements specified in this TMDL, approval of the TMDL shall constitute Regional Board approval of the monitoring program plan(s).		
² Note: Within specified time periods of State TMDL approval (i.e., approval by the Regional Board, the State Water Resources Control Board, and the Office of Administrative Law). Upon State TMDL approval, this parenthetical “formula” will be replaced by the date certain, based upon the date of approval.		

3.a.i. TMDL Implementation

As soon as possible but no later than the dates specified in Table 5-9g, the County of Orange, the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Orange, Lake Forest and Newport Beach and agricultural operators in the Newport Bay watershed shall submit the plans and schedules shown in Table 5-9g and described in Section 3.a.ii.

Subsequent phases of TMDL implementation shall take into account the results of the monitoring and assessment efforts required by the initial study phase of the TMDL implementation plan and other relevant studies.

The following sections describe the requirements for the submittal of plans by dischargers in the Newport Bay watershed to complete specific monitoring, investigations and analyses. In each and every case, the plans submitted by the named dischargers will be considered for approval by the Regional Board at a duly noticed public hearing as specified in Chapter 1.5, Division 3, Title 23 of the California Code of Regulations (Section 647 et seq.). The plans are to be implemented upon Regional Board approval and completed as specified in Table 5-9g.

3.a.ii. Monitoring and Assessment

Routine monitoring and special investigations and analyses are an important part of this phased TMDL. Routine monitoring is necessary to assess compliance with the bacterial quality objectives in the Bay and with the WLAs and LAs specified in the TMDL. Special investigations and analyses are needed to identify and characterize sources of fecal coliform input and to determine their fate in the Bay so that appropriate control measures can be developed and implemented. The effectiveness of current and future bacterial control measures needs to be evaluated. The results of these studies may warrant future changes to this TMDL.

3.a.ii.a. Routine Monitoring

By January 30, 2000, the County of Orange, the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Orange, Lake Forest and Newport Beach, and the agricultural operators in the Newport Bay watershed shall propose a plan for routine monitoring to determine compliance with the bacterial quality objectives in the Bay.

At a minimum, the proposed plan shall include the collection of five (5) samples/30-days at the stations specified in Table 5-9h and shown in Figure 5-1 and analysis of the samples for total and fecal coliform and enterococci. Reports of the collected data shall be submitted monthly. An annual report summarizing the data collected for the year and evaluating compliance with the water quality objectives shall be submitted by September 1 of each year.

In lieu of this coordinated, regional monitoring plan, one or more of the parties identified in the preceding paragraph may submit an individual or group plan to conduct routine monitoring in areas solely within their jurisdiction to determine compliance with the bacterial objectives in the Bay (if appropriate). Any such individual or group plans shall also be submitted by January 30, 2000. Reports of the data collected pursuant to approved individual/group plan(s) shall be submitted monthly and an annual report summarizing the data and evaluating compliance with water quality objectives shall be submitted by September 1 of each year.

The monitoring plan(s) shall be implemented upon Regional Board approval.

Table 5-9h

Newport Bay Sampling Stations for Routine Compliance Monitoring with Bacterial Quality Objectives (see Figure 1 for Station Locations)

Ski Zone	33rd Street	Park Avenue
Vaughns Launch	Rhine Channel	Via Genoa
Northstar Beach	De Anza	Alvarado/Bay Is.
Abalone Avenue	Promontory Pt.	10th Street
Dunes East	Bayshore Beach	15th Street
Dunes Middle	Onyx Avenue	19th Street
Dunes West	Garnet Avenue	Lido Island Yacht Club
Dunes North	Ruby Avenue	Harbor Patrol
43rd Street	Sapphire Avenue	N Street Beach
38th Street	Newport Blvd. Bridge	Rocky Point
San Diego Creek @ Campus Dr.	Santa Ana Delhi Channel	Big Canyon Wash
Backbay Dr. Drain		

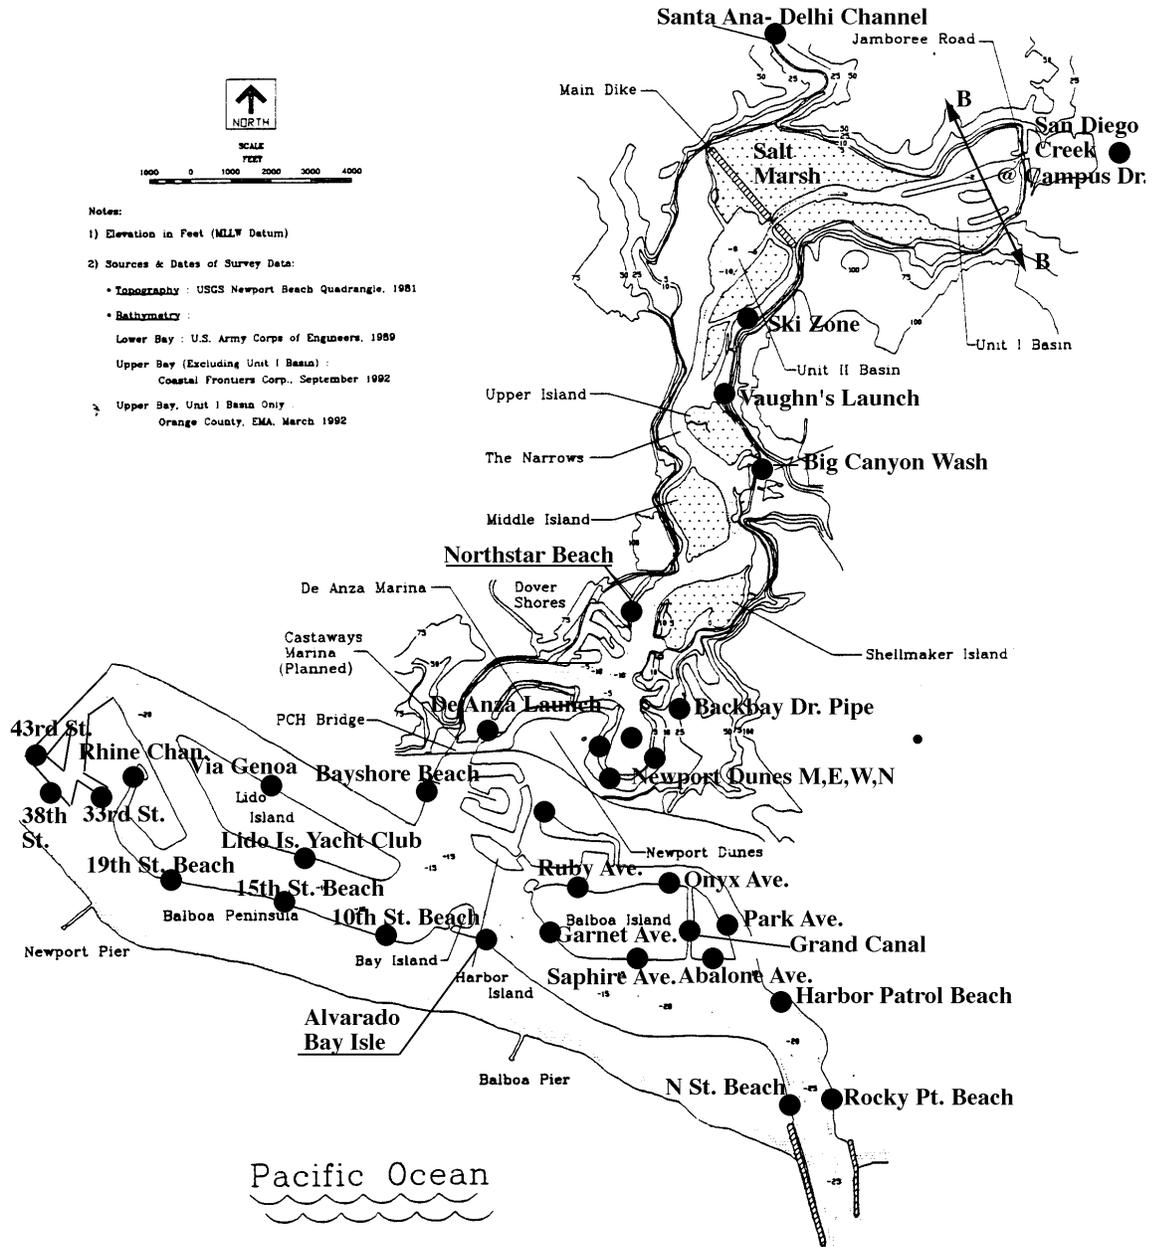


Figure 5-1: Newport Bay Bacterial Quality Monitoring Stations

3.a.ii.b. Fate of Bacterial Inputs

By January 30, 2000, the County of Orange, the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Orange, Lake Forest, and Newport Beach and the agricultural operators in the Newport Bay watershed shall submit a plan for the development and submittal of a water quality model to be completed by 13 months after Regional Board approval of the plan. The model shall be capable of analysis of fecal coliform inputs to Newport Bay, the fate of those inputs, and the effect of those inputs on compliance with bacterial quality objectives in the Bay.

3.a.ii.c. Beneficial Use Assessment

By January 30, 2000, the County of Orange, the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Orange, Lake Forest and Newport Beach shall submit a plan to complete, by 13 months after Regional Board approval of the plan, a beneficial use assessment to identify and quantify water contact recreation activities in Newport Bay. By 13 months after Regional Board approval of the beneficial use assessment plan, these parties shall submit a report of the results of the water contact recreation beneficial use assessment.

By March 1, 2001, the County of Orange, the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Orange, Lake Forest and Newport Beach shall submit a plan to complete, by 13 months after Regional Board approval of the plan, a beneficial use assessment to identify and quantify shellfish harvesting activities in Newport Bay. By 13 months after Regional Board approval of the beneficial use assessment plan, these parties shall submit a report of the results of the shellfish harvesting beneficial use assessment.

The beneficial use assessment reports shall contain recommendations for prioritizing areas within Newport Bay for purposes of evaluation and implementation of cost-effective and reasonable control actions as part of the TMDL process. The Regional Board will consider these recommendations and make its determinations regarding high priority water contact recreation and shellfish harvesting areas at a duly noticed public hearing. These determinations will be considered in establishing interim WLAs and LAs and compliance dates (Task 10, Table 5-9g).

3.a.ii.d. Source Identification and Characterization

By March 1, 2000 the County of Orange and the City of Newport Beach shall submit a proposed plan for a program, to be completed within 7 months after Regional Board approval of the plan to identify and characterize fecal coliform inputs to The Dunes Resort. In lieu of this coordinated plan, each of these parties may submit an individual plan to identify and characterize fecal coliform inputs to The Dunes Resort. Any such individual plan shall also be submitted by March 1, 2000 and completed within 7 months after Regional Board approval of the plan(s).

By March 1, 2000 the County of Orange and the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Orange, Lake Forest, and Newport Beach shall submit a proposed plan for a program, to be completed within 13 months after Regional Board approval of the plan to identify and characterize fecal coliform inputs to Newport Bay from urban runoff, including stormwater. In lieu of this coordinated, regional plan, one or more of these parties may submit an individual or group plan to identify and characterize fecal coliform inputs to the Bay from urban runoff from areas within its jurisdiction. Any such individual or group plan shall also be submitted by (60 days after State TMDL approval)* and completed within 13 months after Regional Board approval of the plan(s).

By April 1, 2000, the agricultural operators in the Newport Bay watershed shall submit a proposed plan for a program, to be completed within 16 months after Regional Board approval of the plan, to identify and characterize fecal coliform inputs to Newport Bay from agricultural runoff, including stormwater. In lieu of this coordinated plan, one or more of the agricultural operators may submit an individual or group plan to identify and characterize fecal coliform inputs to the Bay from agricultural runoff from areas within their jurisdiction. Any such individual or group plan shall also be submitted by April 1, 2000, and completed within 16 months after Regional Board approval of the plan(s).

By April 1, 2000, the County of Orange and the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Orange, Lake Forest, and Newport Beach shall submit a proposed plan for a program, to be completed within 16 months after Regional Board approval of the plan, to identify and characterize fecal coliform inputs to Newport Bay from natural sources. In lieu of this coordinated, regional plan, one or more of these parties may submit an individual or group plan to identify and characterize fecal coliform inputs to the Bay from natural sources from areas within its jurisdiction. Any such individual or group plan shall also be submitted by April 1, 2000 and completed within 16 months after Regional Board approval of the plan(s).

3.a.ii.e. Evaluation of Vessel Waste Control Program

By April 1, 2000 the County of Orange and the City of Newport Beach shall submit a plan to complete, by one year after Regional Board approval of the plan, an assessment of the effectiveness of the vessel waste control program implemented by those agencies in Newport Bay. The plan shall be implemented upon approval by the Regional Board. A report of the study results shall be submitted, together with recommendations for changes to the vessel waste program necessary to ensure compliance with this TMDL.

The Regional Board will consider appropriate changes to the vessel waste control program. These changes shall be implemented in accordance with a schedule to be established by the Regional Board.

3.a.ii.f. TMDL, WLA and LA Evaluation and Source Monitoring Program

By (3 months after completion of Tasks 2, 4a, and 6 as shown in Table 5-9g)* the County of Orange, the Cities of Tustin, Irvine, Costa Mesa Santa Ana, Orange, Lake Forest and Newport Beach, and the agricultural operators in the Newport Bay watershed shall propose a plan for evaluation and source monitoring to determine compliance with the WLAs and LAs specified in Table 5-9f. In lieu of this coordinated, regional plan, one or more of these parties may submit an individual or group plan to conduct TMDL, WLA, LA and Source Evaluation monitoring from areas solely within their jurisdiction. Any such individual or group plan shall also be submitted by (3 months after completion of Tasks 2, 4a, and 6 as shown in Table 5-9g).* Reports of the data collected pursuant to approved individual/group plan(s) shall be submitted monthly and an annual report summarizing the data and evaluating compliance with WLAs and LAs shall be submitted by September 1 of each year. The annual report shall also include an evaluation of the effectiveness of control measures implemented to control sources of fecal coliform, and recommendations for any changes to the control measures needed to ensure compliance with the TMDL, WLAs, and LAs. The evaluation and source monitoring plan(s) shall be implemented upon Regional Board approval.

3.a.ii.g. Updated TMDL Report

The County of Orange, the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Orange, Lake Forest and Newport Beach, and the agricultural operators in the Newport Bay watershed shall submit Updated TMDL Reports as specified in Table 5-9g. These updated TMDL reports shall, at a minimum, integrate and evaluate the results of the studies required in Table 5-9g (Task 1 – 7). The reports shall include recommendations for revisions to the TMDL, if appropriate and for interim WLAs, LAs and compliance schedules.

3.a.ii.h. Adjust TMDL; Adopt Interim WLA, LAs and Compliance Dates

Based on the results of the studies required by Table 5-9g and recommendations made in the Updated TMDL Reports, changes to the TMDL for fecal coliform may be warranted. Such changes would be considered through the Basin Plan Amendment process. Upon completion and consideration of the studies and any appropriate Basin Plan amendments, interim WLAs and LAs that lead to ultimate compliance with the TMDL specified in Table 5-9f, or with an approved amended TMDL, will be established with interim compliance dates. Schedules will also be established for submittal of implementation plans for control measures to achieve compliance with these WLAs, LAs, and compliance dates. These implementation plans will be considered by the Regional Board at a duly noticed public hearing.

The Regional Board is committed to the review of this TMDL every three years or more frequently if warranted by these or other studies. The County of Orange, the Cities of Tustin, Irvine, Costa Mesa, Santa Ana, Lake Forest, and Newport Beach, The Irvine Company and the Irvine Ranch Water District have undertaken to prepare a health risk assessment for Newport Bay for water contact recreation and shellfish harvesting beneficial uses. This study will evaluate whether exceedances of fecal coliform objectives correlates with actual impairment of beneficial uses and may recommend revisions to the Basin Plan objectives and/or beneficial use designations. Because this study is in progress, it is not required by this TMDL implementation plan, but will be considered in conjunction with the studies required by the implementation plan.

(End of amendment adopted under Resolution No. 99-10.

4. Toxic Substance Contamination (The following was added under Resolution No. R8-2003-0039)

San Diego Creek and Newport Bay are not attaining water quality standards with respect to certain classes of toxic pollutants. On June 14, 2002, USEPA established Total Maximum Daily Loads (TMDLs) for selenium, heavy metals (cadmium, copper, lead, and zinc), organochlorine pesticides (chlordane, dieldrin, DDT, and toxaphene), PCBs, and organophosphate pesticides (diazinon and chlorpyrifos). In addition, USEPA established a separate TMDL for the Rhine Channel in Lower Newport Bay. Table 5-9i shows these TMDLs, the constituents addressed, and the waterbodies affected.

USEPA’s TMDLs do not specify implementation plans, which are the responsibility of the Regional Board. The Regional Board has adopted or will adopt Basin Plan amendments to incorporate the USEPA TMDLs, revised if and as appropriate, into the Basin Plan. These amendments will include implementation plans. The anticipated schedule for these Basin Plan amendments is also shown in Table 5-9i.

Table 5-9i. USEPA TMDLs Established June 14, 2002

TMDL	Basin Plan Schedule	Location	Constituents
Organophosphate Pesticides	2003	SDC	Diazinon, chlorpyrifos
		UNB	Chlorpyrifos
Selenium	2007	SDC, UNB LNB	Selenium
Metals	2007	SDC	Cd, Cu, Pb, Zn
		UNB	Cd, Cu, Pb, Zn
		LNB	Cu, Pb, Zn
Organochlorine Compounds	2007	SDC	Chlordane, dieldrin, DDT, PCBs, toxaphene
		UNB	Chlordane, DDT, PCBs
		LNB	Chlordane, dieldrin, DDT, PCBs
Rhine Channel	2007	Rhine Channel	Se, Cr, Hg, Cu, Pb, Zn Chlordane, dieldrin, DDT, PCBs

SDC= San Diego Creek; UNB=Upper Newport Bay; LNB=Lower Newport Bay

4.a Diazinon and Chlorpyrifos TMDL

Aquatic toxicity in San Diego Creek and Upper Newport Bay causes adverse impacts to the established beneficial uses of those waterbodies.

A report prepared by Regional Board staff describes the aquatic life toxicity problems in San Diego Creek and Upper Newport Bay in greater detail and discusses the technical basis for the TMDL that follows¹. This TMDL is the same as that promulgated by the USEPA on June 14, 2002, but an implementation plan is also specified (see Section 4.a.i.). The USEPA TMDL was, in fact, based on a draft TMDL prepared by Regional Board staff. The TMDL addresses toxicity due to diazinon and chlorpyrifos in San Diego Creek and chlorpyrifos in Upper Newport Bay. Implementation of this TMDL is expected to address, to a significant extent, the occurrence of aquatic life toxicity in these waterbodies. Reduction in aquatic life toxicity will help assure attainment of water quality standards; that is, compliance with water quality objectives and protection of beneficial uses.

Table 5-9j shows the TMDL and the allocations for diazinon and chlorpyrifos in San Diego Creek.

Table 5-9j. Diazinon and Chlorpyrifos Allocations for San Diego Creek

Category	Diazinon (ng/L)		Chlorpyrifos (ng/L)	
	Acute	Chronic	Acute	Chronic
Wasteload Allocation	72	45	18	12.6
Load allocation	72	45	18	12.6
MOS	8	5	2	1.4
TMDL	80	50	20	14

MOS = Margin of Safety; Chronic means 4-consecutive day average

Table 5-9k shows the TMDL and the allocations for chlorpyrifos in Upper Newport Bay.

Table 5-9k. Chlorpyrifos Allocations for Upper Newport Bay

Category	Acute (ng/L)	Chronic (ng/L)
Wasteload allocation	18	8.1
Load allocation	18	8.1
MOS	2	0.9
TMDL	20	9

MOS = Margin of Safety; Chronic means 4-consecutive day average

The TMDL and its allocations contain an explicit 10% margin of safety. In addition, a substantial margin of safety is implicitly incorporated in the TMDL through use of conservative assumptions.

¹ Diazinon and Chlorpyrifos TMDL, Upper Newport Bay and San Diego Creek, April 4, 2003

4.a.i TMDL Implementation

Table 5-9I outlines the tasks and schedules to implement the TMDL.

Table 5-9I. TMDL Task Schedule

Task No.	Task	Schedule	Description
1	USEPA Re-Registration Agreements	12/2001 to 12/2006	Phase-out of uses specified in the re-registration agreements. Should end over 90% of usage. ²
2	Revise Discharge Permits	2005	WDR and NPDES permits will be revised to include the TMDL allocations, as appropriate.
3	Pesticide Runoff Management Plan	2004	A pesticide runoff management plan will be developed
4	Monitoring	2003	Modify existing regional monitoring program to include analysis for organophosphate pesticides and toxicity
	Special Studies		
5a	Atmospheric deposition	2003	Quantify atmospheric deposition of chlorpyrifos loading to Upper Newport Bay
5b	Mixing volumes in Upper Newport Bay	2003	Model mixing and stratification of chlorpyrifos in Upper Newport Bay during storm events

Task 1: USEPA Re-Registration Agreements

The re-registration agreements negotiated by USEPA with the manufacturers of diazinon and chlorpyrifos are the most significant factor affecting the implementation plan. Usage of both diazinon and chlorpyrifos in the Newport Bay Watershed is expected to be reduced by over 90 percent.

Task 2: Revise Discharge Permits

The TMDL allocates wasteloads to all dischargers in the watershed. Since the TMDL is concentration-based, these wasteloads are concentration limits. The concentration limits will be incorporated into existing and future discharge permits in the watershed. Compliance schedules would be included in permits only if they are demonstrated to be

necessary. Compliance would be required as soon as possible, but no later than December 1, 2007.

Task 3: Pesticide Runoff Management Plan

A pesticide runoff management plan will be developed for the watershed as a cooperative project between the Regional Board and stakeholders.

Task 4: Monitoring


Routine monitoring is necessary to assess compliance with the allocations specified in the TMDL. The County of Orange, the Cities of Tustin, Irvine, Costa

Mesa, Santa Ana, Orange, Lake Forest and Newport Beach, and the agricultural operators in the Newport Bay watershed will be required to propose a plan by January 30, 2004 for routine monitoring to determine compliance with the TMDL allocations for diazinon and chlorpyrifos. At a minimum, the proposed plan must include the collection of monthly samples at the stations specified in Table 5-9m and shown in Figure 5-2 and analysis of the samples for diazinon and chlorpyrifos. Monthly toxicity tests should also be conducted at several locations in the watershed. Data summaries will be required monthly. An annual report summarizing the data collected for the year and evaluating compliance with the TMDL will be required to be submitted by November 30 of each year.

² This task is not within the purview of the Regional Board, but is nevertheless of critical significance for implementation of the TMDL.

Table 5-9m. Minimum Required Monthly Sampling Stations

Station Code	Location
BARSED	Peters Canyon Wash
WYLSSED	San Diego Creek at Harvard Dr.
SDMF05	San Diego Creek at Campus Dr.
SADF01, or CMCG02	Santa Ana Delhi Channel, or Costa Mesa Channel

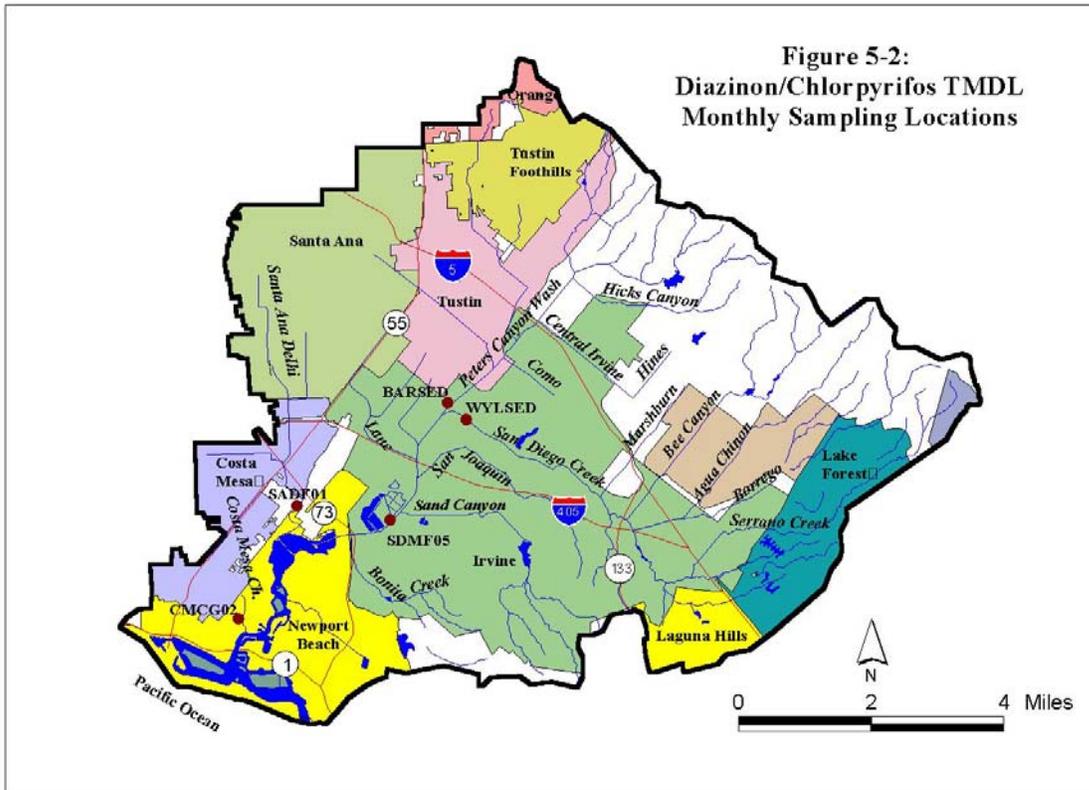

In lieu of this coordinated, regional monitoring plan, one or more of the parties identified in the preceding paragraph may submit an individual or group plan to conduct routine monitoring in areas solely within their jurisdiction to determine compliance with the TMDL. Any such individual or group plans must also be submitted by January 30, 2004. Reports of the data collected pursuant to approved individual/group plan(s) will be required to be submitted monthly, and an annual report summarizing the data and evaluating compliance with the TMDL will be required to be submitted by November 30 of each year.

It is likely that implementation of these requirements will be through the issuance of Water Code Section 13267 letters to the affected parties. The monitoring plan(s) will be considered by the Regional Board and implemented upon the Regional Board's approval.

Task 5: Special Studies

With the anticipated assistance of stakeholders in the watershed, the Regional Board will conduct investigations to (1) quantify the significance of atmospheric deposition of

chlorpyrifos to Upper Newport Bay, and (2) determine the adequacy of the freshwater allocations for chlorpyrifos in the tributaries to Upper Newport Bay in achieving the lower saltwater allocations. The existing hydrodynamic model for Newport Bay is being used to perform simulations that predict contaminant concentrations in the Bay based on various flow and management scenarios. The model results will be used to verify whether the TMDL allocations for chlorpyrifos in the watershed will be sufficient to achieve the TMDL allocations in Upper Newport Bay. One of the questions to be addressed is the magnitude of toxic exposure that could result from development of a freshwater lens associated with the discharge of stormwater to Upper Newport Bay.

4.a.ii Adjust TMDL

Based on the results of the special studies and recommendations made in the Pesticide Runoff Monitoring reports, changes to the TMDL may be warranted. Such changes would be considered through the Basin Plan Amendment process.

The Regional Board is committed to the review of this TMDL every three years, or more frequently if warranted by these or other studies.

(End of amendment adopted under Resolution No. R8-2003-0039)

4.b Organochlorine Compounds TMDLs (The following was added under Resolution No. R8-2011-0037)

Organochlorine compounds, including DDT, PCBs, toxaphene and chlordane, possess unique physical and chemical properties that influence their persistence, fate and transport in the environment. While these characteristics vary among the organochlorine compounds, they all exhibit an ability to resist degradation, partition into sediment, and to accumulate in the tissue of organisms, including invertebrates, fish, birds and mammals. The bioaccumulation of these compounds can adversely affect the health and reproductive success of aquatic organisms and their predators, and can pose a health threat to human consumers.

A TMDL technical report prepared by Regional Board staff [Ref. # 1] describes organochlorine-related problems in Newport Bay and its watershed and delineates the technical basis for the TMDLs that follow.

The waterbody-pollutant combinations for which organochlorine compounds TMDLs were established by the Regional Board are listed in Table NB-OCs-1. These TMDLs differ from those established by USEPA in 2002 in several respects:

First, based on an updated impairment assessment that utilized new data and applied the State Water Board's "Water Quality Control Policy for Developing California's Clean Water Act Section 303(d) List" (2004) [Ref. # 2], the Regional Board established TMDLs for a list of organochlorine compound-waterbody combinations different from that of USEPA. As shown in Table NB-OCs-2, USEPA also established TMDLs for dieldrin, chlordane, and PCBs in San Diego Creek and for dieldrin in Lower Newport Bay. In

contrast, the Regional Board found no impairment as the result of dieldrin in any of these waters, nor was impairment due to chlordane or PCBs found in San Diego Creek and its tributaries.

As described in the TMDL technical report, Regional Board staff also found no impairment due to DDT in San Diego Creek or its tributaries. However, in adopting the 2006 Section 303(d) list (October 25, 2006, Resolution No. 2006-0079), the State Water Board found impairment due to DDT in Peter’s Canyon Channel. In response, the Regional Board established a TMDL for DDT in San Diego Creek and its tributaries, including Peters Canyon Channel.

Second, corrections and modifications were made to loading capacities and existing loads identified in USEPA’s TMDLs. Finally, an implementation plan is specified (see Section 4.b.3).

While the Regional Board did not establish TMDLs for chlordane and PCBs for San Diego Creek and tributaries, the Board did develop informational TMDLs for these substances in these waters, pursuant to Clean Water Act Section 303(d)(3). These informational TMDLs are shown in Table NB-OCs-3. This action was taken in light of several factors. First, the largest source of organochlorine compounds to Newport Bay is San Diego Creek. Second, the data suggest that the existing loading of chlordane to the Creek is greater than the loading capacity. This suggests that the lack of finding of impairment due to chlordane may be simply a reflection of a lack of data with which to assess impairment. Finally, these informational TMDLs may forward action to address organochlorine compound problems in the watershed. These informational TMDLs have no regulatory effect but may be used as the basis for further investigation of the relative contributions of the various sources of organochlorine compound inputs to San Diego Creek and thence the Bay. In the long-term, this would be expected to help assure proper apportionment of responsibility for implementation of the TMDLs identified in Table NB-OCs-1.

Table NB-OCs-1. Waterbody-pollutant combinations for which Organochlorine Compound TMDLs are established

<i>Waterbody</i>	<i>Pollutant</i>
San Diego Creek and tributaries	DDT, Toxaphene
Upper Newport Bay	Chlordane, DDT, PCBs
Lower Newport Bay	Chlordane, DDT, PCBs

Table NB-OCs-2. Waterbody-pollutant combinations for which Organochlorine Compounds TMDLs were established by USEPA (2002) and Regional Board (2007)

<i>Waterbody</i>	<i>TMDLs</i>	
	USEPA	Regional Board
San Diego Creek and tributaries*	Chlordane, dieldrin, DDT, PCBs, Toxaphene	DDT, Toxaphene
Upper Newport Bay	Chlordane, DDT, PCBs	Chlordane, DDT, PCBs
Lower Newport Bay	Chlordane, dieldrin, DDT, PCBs	Chlordane, DDT, PCBs

*TMDLs are established for San Diego Creek and tributaries, even if impairment was only found in particular reaches (e.g., SWRCB found DDT impairment in Peter’s Canyon Channel, a primary tributary to San Diego Creek Reach 1, but the TMDL includes all of San Diego Creek and tributaries).

Table NB-OCs-3. Informational TMDLs

<i>Waterbody</i>	<i>Informational TMDLs</i>
San Diego Creek and tributaries	Chlordane, PCBs

4.b.1 Numeric Targets used in Organochlorine Compounds TMDLs

Numeric targets identify specific endpoints in sediment, water column or tissue that equate to attainment of water quality standards, which is the purpose of TMDLs. Multiple targets may be appropriate where a single indicator is insufficient to protect all beneficial uses and/or attain all applicable water quality objectives. The range of beneficial uses identified in this Basin Plan (see Chapter 3) for the waters addressed by the organochlorine compounds TMDLs makes clear that the targets must address the protection of aquatic organisms, wildlife (including federally listed threatened and endangered species) and human consumers of recreationally and commercially caught fish.

Sediment, water column and fish tissue targets are identified for these TMDLs, as shown in Table NB-OCs-4. The sediment and water column targets are identical to those selected by USEPA in the development of their organochlorine compounds TMDLs (2002). Fish tissue targets are added for the protection of aquatic life and wildlife.

The targets employed in the development of informational TMDLs for chlordane and PCBs in San Diego Creek and its tributaries are shown in Table NB-OCs-5.

Table NB-OCs-4. Numeric Sediment, Fish Tissue, and Water Column TMDL Targets

	Total DDT	Chlordane	Total PCBs	Toxaphene
Sediment Targets¹; units are µg/kg dry weight				
San Diego Creek and tributaries	6.98			0.1
Upper & Lower Newport Bay	3.89	2.26	21.5	
Fish Tissue Targets for Protection of Human Health²; units are µg/kg wet weight				
San Diego Creek and tributaries	100			30
Upper & Lower Newport Bay	100	30	20	
Fish Tissue Targets for Protection of Aquatic Life and Wildlife³; units are µg/kg wet weight				
San Diego Creek and tributaries	1000			100
Upper & Lower Newport Bay	50	50	500	
Water Column Targets for Protection of Aquatic Life, Wildlife & Human Health⁴ (µg/L)				
San Diego Creek and tributaries				
<i>Acute Criterion (CMC^a)</i>	1.1			0.73
<i>Chronic Criterion (CCC^b)</i>	0.001			0.0002
<i>Human Health Criterion</i>	0.00059			0.00075
Upper & Lower Newport Bay				
<i>Acute Criterion (CMC^a)</i>	0.13	0.09		
<i>Chronic Criterion (CCC^b)</i>	0.001	0.004	0.03	
<i>Human Health Criterion</i>	0.00059	0.00059	0.00017	

¹Freshwater and marine sediment targets, except toxaphene, are Threshold Effect Levels (TELs) from Buchman, M.F. 1999. NOAA Screening Quick Reference Tables, NOAA HAZMAT Report 99-1, Seattle WA, Coastal Protection and Restoration Division, National Oceanic and Atmospheric Administration, 12 pp. Toxaphene target is from N.Y. Dept. of Environmental Conservation.

²Freshwater and marine fish tissue targets for protection of human health are Office of Environmental Health Hazard Assessment (OEHHA, 1999) Screening Values (SVs).

³Freshwater and marine fish tissue targets for protection of aquatic life and wildlife are from Water Quality Criteria 1972. A report of the Committee on Water Quality Criteria, Environmental Studies Board, National Academy of Sciences, National Academy of Engineering. Washington, D.C., 1972.

⁴Freshwater and marine targets are from California Toxics Rule (2000).

^a CMC: Criteria Maximum Concentration

^b CCC: Continuous Criteria Concentration

Table NB-OCs-5. Numeric Sediment, Fish Tissue, and Water Column Targets used in Informational TMDLs

	Chlordane	Total PCBs
Sediment Targets¹; units are µg/kg dry weight		
San Diego Creek and tributaries	4.5	34.1
Fish Tissue Targets for Protection of Human Health²; units are µg/kg wet weight		
San Diego Creek and tributaries	30	20
Fish Tissue Targets for Protection of Aquatic Life and Wildlife³; units are µg/kg wet weight		
San Diego Creek and tributaries	100	500
Water Column Targets for Protection of Aquatic Life, Wildlife & Human Health⁴ (µg/L)		
San Diego Creek and tributaries		
<i>Acute Criterion (CMC^a)</i>	2.4	
<i>Chronic Criterion (CCC^b)</i>	0.0043	0.014
<i>Human Health Criterion</i>	0.00059	0.00017

¹Freshwater sediment targets are Threshold Effect Levels (TELs) from Buchman, M.F. 1999. NOAA Screening Quick Reference Tables, NOAA HAZMAT Report 99-1, Seattle WA, Coastal Protection and Restoration Division, National Oceanic and Atmospheric Administration, 12 pp.

²Freshwater fish tissue targets for protection of human health are Office of Environmental Health Hazard Assessment (OEHHA, 1999) Screening Values (SVs).

³Freshwater fish tissue targets for protection of aquatic life and wildlife are from Water Quality Criteria 1972. A report of the Committee on Water Quality Criteria, Environmental Studies Board, National Academy of Sciences, National Academy of Engineering. Washington, D.C., 1972.

⁴Freshwater targets are from California Toxics Rule (2000).

^a CMC: Criteria Maximum Concentration

^b CCC: Continuous Criteria Concentration

The linkage between adverse effects in sensitive wildlife species and concentrations of the organochlorine pollutants in sediments, prey organisms and water is not well understood at the present time, although work is underway to better understand ecological risk in Newport Bay. In addition, the State is in the process of developing sediment quality objectives that should provide guidance for assessing adverse effects due to pollutant bioaccumulation. Reducing contaminant loads in the sediment will result in progress toward reducing risk to aquatic life and wildlife. During implementation of these TMDLs, additional and/or modified wildlife or other targets will be identified as risk assessment information becomes available. These TMDLs will be revisited (see 4.b.3) and revised as appropriate.

4.b.2. Organochlorine Compounds TMDLs, Wasteload Allocations, Load Allocations and Compliance Dates

The organochlorine compounds TMDLs for San Diego Creek and its tributaries, Upper Newport Bay and Lower Newport Bay are shown in Tables NB-OCs-6 and NB-OCs-7. The TMDLs are expressed on a daily basis (average grams per day) in Table NB-OCs-6, and on an annual basis (grams per year) in Table NB-OCs-7. Expression of the TMDLs on a daily basis is intended to comply with a relevant court decision. However, because of the strong seasonality associated with the loading of organochlorine compounds during storm events, it is appropriate for implementation to occur based on average annual loadings. The TMDLs are to be achieved as soon as possible but no later than December 31, 2020.

Table NB-OCs-6. TMDLs for San Diego Creek, Upper and Lower Newport Bay (expressed on a “daily” basis to be consistent with the D.C. Circuit Court of Appeals decision in Friends of the Earth, Inc. v. EPA, et al., No. 05-5015 [D.C. Cir.2006])

Water Body	Pollutant	TMDL (average grams per day) ^a
San Diego Creek and Tributaries	Total DDT	1.08
	Toxaphene	0.02
Upper Newport Bay	Total DDT	0.44
	Chlordane	0.25
	Total PCBs	0.25
Lower Newport Bay	Total DDT	0.16
	Chlordane	0.09
	Total PCBs	0.66

^a Compliance to be achieved as soon as possible but no later than December 31, 2020.

Table NB-OCs-7. TMDLs for San Diego Creek, Upper and Lower Newport Bay (expressed on annual basis for implementation purposes)

Water Body	Pollutant	TMDL (grams per year)^a
San Diego Creek and Tributaries	Total DDT	396
	Toxaphene	6
Upper Newport Bay	Total DDT	160
	Chlordane	93
	Total PCBs	92
Lower Newport Bay	Total DDT	59
	Chlordane	34
	Total PCBs	241

^a Compliance to be achieved as soon as possible but no later than December 31, 2020.

Informational TMDLs for San Diego Creek and its tributaries for chlordane and total PCBs are shown in Table NB-OCs-8. Again, these informational TMDLs are expressed on average daily and annual bases.

Table NB-OCs-8. Informational TMDLs for San Diego Creek and Tributaries (expressed on average daily and annual bases)

Water Body	Pollutant	TMDL (average grams per day)
San Diego Creek and Tributaries	Chlordane	0.70
	Total PCBs	0.34
		TMDL (grams per year)
San Diego Creek and Tributaries	Chlordane	255
	Total PCBs	125

Wasteload and load allocations to achieve the TMDLs specified in Tables NB-OCs-6 and NB-OCs-7 are shown in Tables NB-OCs-9 and NB-OCs-10, respectively. Like the TMDLs, the allocations are expressed in terms of both average daily and annual loads. An explicit margin of safety (MOS) of ten percent was applied in calculating the allocations. Consistent with the TMDL compliance schedule, these allocations are to be achieved as soon as possible but no later than December 31, 2020.

Wasteload and load allocations necessary to meet the informational TMDLs shown in Table NB-OCs-8 are identified in Tables NB-OCs-11 (expressed as average daily loads) and NB-OCs-12 (expressed as annual loads). These allocations are identified only for informational purposes.

4.b.3. Implementation of Organochlorine Compounds TMDLs

These TMDLs are to be implemented within an adaptive management framework, with compliance monitoring, special studies, and stakeholder interaction guiding the process over time. Information obtained from compliance monitoring will measure progress towards achievement of WLAs and LAs, potentially leading to changes to TMDL allocations; ongoing investigations and recommended special studies, if implemented, may provide information that leads to revisions of the TMDLs, adjustments to the implementation schedule, and/or improved implementation strategies. Thus, implementation of the TMDLs is expected to be an ongoing and dynamic process.

The implementation plan identified in this section reflects the adaptive management, phased approach to the organochlorine compound TMDLs adopted by the Regional Board. The Board found a phased approach, with compliance schedules, appropriate in light of the following considerations. First, it was recognized that additional monitoring and special studies were either already underway or would be needed to address data limitations and significant uncertainty associated with the TMDL calculations, and that changes to the TMDLs might be appropriate based on the results of those investigations. Second, it was also understood that these data limitations and uncertainties pertained to the impairment assessment itself and the determination of the specific organochlorine compounds for which TMDLs are required. Third, the natural attenuation of these compounds over time is expected to affect significantly the selection, development and implementation of BMPs. As described in the TMDL technical report [Ref.1], use of the organochlorine compounds addressed by these TMDLs has been banned for many years and trend analyses indicate declining concentrations of these substances in fish tissue over time. Natural attenuation should eventually reduce organochlorine pollutant levels to concentrations that pose no threat to beneficial uses in San Diego Creek or Newport Bay. While natural degradation of these compounds is likely the principal cause of the observed decline in fish tissue concentrations, the implementation of erosion and sediment controls and other Best Management Practices to address compliance with the sediment and nutrient TMDLs for Newport Bay and its watershed (see discussions of these TMDLs elsewhere in

Table NB-OCs-9. TMDLs and Allocations for San Diego Creek, Upper and Lower Newport Bay (expressed on a “daily” basis to be consistent with the recent D.C. Circuit Court of Appeals decision in Friends of the Earth, Inc. v. EPA, et al., No. 05-5015 [D.C. Cir.2006]).^{a,b}

	Type	Total DDT	Chlordane	Total PCBs	Toxaphene
		(average grams/day)			
San Diego Creek					
WLA	Urban Runoff – County MS4 (36%)	0.35			0.005
	Construction (28%)	0.27			0.004
	Commercial Nurseries (4%)	0.04			0.001
	Caltrans MS4 (11%)	0.11			0.002
	Subtotal – WLA (79%)	0.77			0.01
LA	Agriculture (5%) (excludes nurseries under WDRs)	0.05			0.001
	Open Space (9%)	0.09			0.001
	Streams & Channels (2%)	0.02			0.0003
	Undefined (5%)	0.05			0.001
	Subtotal – LA (21%)	0.21			0.003
MOS (10% of total TMDL)		0.11			0.002
Total TMDL		1.08			0.02
Upper Newport Bay					
WLA	Urban Runoff - County MS4 (36%)	0.14	0.08	0.08	
	Construction (28%)	0.11	0.06	0.06	
	Commercial Nurseries (4%)	0.02	0.01	0.01	
	Caltrans MS4 (11%)	0.04	0.03	0.02	
	Subtotal – WLA (79%)	0.31	0.18	0.18	
LA	Agriculture (5%) (excludes nurseries under WDRs)	0.02	0.01	0.01	
	Open Space (9%)	0.04	0.02	0.02	
	Streams & Channels (2%)	0.01	0.005	0.005	
	Undefined (5%)	0.02	0.01	0.01	
	Subtotal – LA (21%)	0.08	0.05	0.05	
MOS (10% of Total TMDL)		0.04	0.03	0.03	
Total TMDL		0.44	0.25	0.25	
Lower Newport Bay					
WLA	Urban Runoff – County MS4 (36%)	0.05	0.03	0.21	
	Construction (28%)	0.04	0.02	0.17	
	Commercial Nurseries (4%)	0.01	0.003	0.02	
	Caltrans MS4 (11%)	0.02	0.01	0.07	
	Subtotal – WLA (79%)	0.11	0.07	0.47	
LA	Agriculture (5%) (excludes nurseries under WDRs)	0.01	0.004	0.03	
	Open Space (9%)	0.01	0.01	0.05	
	Streams & Channels (2%)	0.003	0.002	0.01	
	Undefined (5%)	0.01	0.004	0.03	
	Subtotal – LA (21%)	0.03	0.02	0.12	
MOS (10% of Total TMDL)		0.02	0.01	0.07	
Total TMDL		0.16	0.09	0.66	

^a Percentages for WLA (79%) and LA (21%) are applied to the TMDL, after subtracting the 10% MOS from the Total TMDL. Percent WLA and Percent LA add to 100%.

^b Compliance to be achieved as soon as possible but no later than December 31, 2020.

Table NB-OCs-10. TMDLs and Allocations for San Diego Creek, Upper and Lower Newport Bay (expressed on an “annual” basis for implementation purposes).^{a, b}

		Total DDT	Chlordane	Total PCBs	Toxaphene
Type		(grams per year)			
San Diego Creek					
WLA	Urban Runoff – County MS4 (36%)	128.3			1.9
	Construction (28%)	99.8			1.5
	Commercial Nurseries (4%)	14.3			0.2
	Caltrans MS4 (11%)	39.2			0.6
	Subtotal – WLA (79%)	281.6			4.3
LA	Agriculture (5%) (excludes nurseries under WDRs)	17.8			0.3
	Open Space (9%)	32.1			0.5
	Streams & Channels (2%)	7.1			0.1
	Undefined (5%)	17.8			0.3
	Subtotal – LA (21%)	74.8			1.1
MOS (10% of Total TMDL)		40			0.6
Total TMDL		396			6
Upper Newport Bay					
WLA	Urban Runoff – County MS4 (36%)	51.8	30.1	29.8	
	Construction (28%)	40.3	23.4	23.2	
	Commercial Nurseries (4%)	5.8	3.3	3.3	
	Caltrans MS4 (11%)	15.8	9.2	9.1	
	Subtotal – WLA (79%)	113.8	66.1	65.4	
LA	Agriculture (5%) (excludes nurseries under WDRs)	7.2	8	7	
	Open Space (9%)	13.0	7.6	7.5	
	Streams & Channels (2%)	2.9	1.7	1.7	
	Undefined (5%)	7.2	4.2	4.2	
	Subtotal – LA (21%)	30.2	21.4	20.3	
MOS (10% of Total TMDL)		16	9	9	
Total TMDL		160	93	92	
Lower Newport Bay					
WLA	Urban Runoff – County MS4 (36%)	19.1	11.0	78.1	
	Construction (28%)	14.9	8.6	60.7	
	Commercial Nurseries (4%)	2.1	1.2	8.7	
	Caltrans MS4 (11%)	5.8	3.4	23.9	
	Subtotal – WLA (79%)	41.9	24.2	171.4	
LA	Agriculture (5%) (excludes nurseries under WDRs)	2.7	1.5	10.8	
	Open Space (9%)	4.8	2.8	19.5	
	Streams & Channels (2%)	1.1	0.6	4.3	
	Undefined (5%)	2.7	1.5	10.8	
	Subtotal – LA (21%)	11.2	6.4	45.5	
MOS (10% of Total TMDL)		5.9	3.4	24	
Total TMDL		59	34	241	

^a Percentages for WLA (79%) and LA (21%) are applied to the TMDL, after subtracting the 10% MOS from the total TMDL. Percent WLA and Percent LA add to 100%.

^b Compliance to be achieved as soon as possible but no later than December 31, 2020.

Table NB-OCs-11. Informational TMDLs and Allocations for San Diego Creek (expressed on a “daily” basis) ^a

Category	Type	Chlordane	Total PCBs
		(average grams per day)	
San Diego Creek			
WLA	Urban Runoff – County MS4 (36%)	0.23	0.11
	Construction (28%)	0.18	0.09
	Commercial Nurseries (4%)	0.03	0.01
	Caltrans MS4 (11%)	0.07	0.03
	Subtotal – WLA (79%)	0.50	0.24
LA	Agriculture (5%) (excludes nurseries under WDRs)	0.03	0.02
	Open Space (9%)	0.06	0.03
	Streams & Channels (2%)	0.01	0.01
	Undefined (5%)	0.03	0.02
	Subtotal – LA (21%)	0.13	0.08
MOS (10% of total TMDL)		0.07	0.03
Total TMDL		0.70	0.34

^a Percentages for WLA (79%) and LA (21%) are applied to the TMDL, after subtracting the 10% MOS from the Total TMDL. Percent WLA and Percent LA add to 100%.

Table NB-OCs-12. Informational TMDLs and Allocations for San Diego Creek (expressed on an “annual” basis) ^a

Category	Type	Chlordane	Total PCBs
		(grams per year)	
San Diego Creek			
WLA	Urban Runoff – County MS4 (36%)	82.6	40.5
	Construction (28%)	64.3	31.5
	Commercial Nurseries (4%)	9.2	4.5
	Caltrans MS4 (11%)	25.2	12.4
	Subtotal – WLA (79%)	181.3	88.9
LA	Agriculture (5%) (excludes nurseries under WDRs)	11.5	5.6
	Open Space (9%)	20.7	10.1
	Streams & Channels (2%)	4.6	2.3
	Undefined (5%)	11.5	5.6
	Subtotal – LA (21%)	48.2	23.6
MOS (10% of total TMDL)		26	13
Total TMDL		255	125

^a. Percentages for WLA (79%) and LA (21%) are applied to the TMDL, after subtracting the 10% MOS from the total TMDL. Percent WLA and Percent LA add to 100%.

this Basin Plan) is a probable factor. In any case, the observed trends suggest that as monitoring continues in the watershed and pollutant levels decline, some or all of the organochlorine compounds may warrant delisting from the Clean Water Act Section 303(d) list of impaired waters. Again, these TMDLs would need to be revisited accordingly.

This implementation plan also reflects recommendations by regulated stakeholders in the Newport Bay watershed to convene a Working Group to develop and implement a comprehensive Work Plan to: address, as an early action item, the technical uncertainties in these TMDLs and make recommendations for revisions, as appropriate; identify and prioritize tasks necessary to implement the TMDLs; integrate TMDL implementation tasks with those already being conducted in response to other programs (e.g., permits, other TMDLs); and, investigate other pollutants of concern in the watershed.

Table NB-OCs-13 lists the tasks and schedules needed to implement the organochlorine TMDLs. This implementation plan is aimed at identifying actions to accelerate the decline in organochlorine compound concentrations in the watershed, and to augment their natural attenuation. The implementation plan is focused to a large extent on the monitoring and, where necessary, enhanced implementation of Best Management Practices (BMPs) to reduce the erosion and transport to surface waters of fine sediment to which the organochlorine compounds tend to adhere. Many of these BMPs are already in place as the result of existing permits issued by the Regional

Board or State Water Resources Control Board for stormwater and construction activities, and/or in response to established TMDLs. The intent is to assure that source control activities are implemented to reduce any active sources of the organochlorine compounds, and in other areas where such actions will be most effective in meeting the TMDL goals. Monitoring and special study requirements are included to provide for TMDL compliance assessment and refinement.

In response to the recommendation by watershed stakeholders, this implementation plan provides an opportunity for dischargers to participate in the development and implementation of a comprehensive Work Plan. The implementation tasks identified in Table NB-OCs-13 (except Tasks 1 and 4; see discussion of Task 7, below) will be considered in the development of the Work Plan and incorporated, as appropriate. Implementation of the Work Plan, which will be approved by the Regional Board at a public hearing, will obviate the need for individual actions on the tasks in Table NB-OCs-13 by members of the Working Group. Completion of the Work Plan will result, in part, in recommendations for revisions to these TMDLs based on review by an Independent Advisory Panel and the results of ongoing or requisite monitoring and investigations, and in the development of a comprehensive plan for BMPs and other actions needed to assure compliance with the TMDLs, wasteload allocations and load allocations as soon as possible after completion of execution of the Work Plan but no later than December 31, 2020². Dischargers who elect not to participate in the Work Plan approach will be required to implement the tasks shown in Table NB-OCs-13, as appropriate.

Each of the tasks identified in Table NB-OCs-13 is described below.

² This compliance schedule and/or the organochlorine compounds TMDLs may be modified, through the Basin Planning process, in response to information provided by implementation of the Work Plan tasks and/or other investigations.

Table NB-OCs-13. Organochlorine Compounds TMDLs Implementation Tasks and Schedule

Task	Description	Compliance Date – As Soon As Possible But No Later Than ^{b,c}
PHASE I IMPLEMENTATION		
1	Revise existing WDRs and NPDES permits: <i>Commercial Nursery WDRs, MS4 Permit, Other NPDES Permits</i>	Upon OAL approval of BPA and permit renewal
2 ^a	a. Develop proposed agricultural BMP and monitoring program to assess and control OCs discharges. b. Implement program	a. October 26, 2013 b. Upon Regional Board approval
3 ^a	a. Identify responsible parties for open space areas b. Develop proposed monitoring program to assess OCs inputs from open space areas c. Implement proposed monitoring program d. Develop plan to implement effective erosion and sediment control BMPs for management of fine particulates (if found necessary based on monitoring results) e. Implement BMP plan	a. August 26, 2013 b. 2 months after notification of responsible parties c. Upon Regional Board approval d. Within 6 months of notification of need to develop plan e. Upon Regional Board approval
4 ^a	Implement effective sediment and erosion control BMPs for management of fine particulates on construction sites: Regional Board: a. Develop SWPPP Improvement Program MS4 permittees: b. Revise planning processes as necessary to assure proper communication of SWPPP requirements c. Evaluate/implement BMPs effective in reducing/eliminating organochlorine discharges: i. Submit proposed plan and schedule for BMP studies and implement plan ii. Submit studies report; including plan and schedule to implement BMPs/include in Guidance Manual iii. Implement BMPs/include in Guidance Manual	a. July 26, 2013 b. Within 3 months of appropriate revision of the MS4 permit c. i. Submit plan within 3 months of 13267 letter issuance/MS4 permit revision and implement upon Executive Officer approval; ii. Within 6 months of completion of studies plan; iii. Upon Executive Officer approval
5 ^a	Evaluate sources of OCs; develop and implement BMPs accordingly: a. Submit proposed plan and schedule for source	a. Submit plan within 3 months of 13267 letter issuance/appropriate revision of the MS4 permit

	area investigations b. Implement investigation plan c. Submit report of investigation findings and plan/schedule for implementation of BMPs d. Implement BMP plan	b. Upon Executive Officer approval c. Within 6 months of completion of investigation plan d. Upon Executive Officer approval
6 ^a	Evaluate feasibility and mechanisms to fund future dredging operations within San Diego Creek, Upper and Lower Newport Bay	Submit feasibility/funding report by July 26, 2016
7	Develop comprehensive Work Plan to meet TMDL implementation requirements, consistent with an adaptive management approach a. Convene Working Group b. Submit proposed Work Plan c. Implement Work Plan d. Complete execution of Work Plan	a. 08/26/2013 b. 10/26/2013 c. Upon Regional Board approval d. Within 5 years of Work Plan approval
8 ^a	Revise regional monitoring program	October 26, 2013; Annual Reports due November 15
9	Conduct special studies	As funding allows, and in order of priority identified in comprehensive Work Plan (Task 7), if applicable
PHASE II IMPLEMENTATION		
10	Review TMDLs, including numeric targets, WLAs and LAs; delist or revise TMDLs pursuant to established Sediment Quality Objectives, new data, and results of special studies	No later than July 26, 2018

- a. The tasks and schedules identified in the Regional Board approved Work Plan developed by the Working Group shall govern implementation activities by members of the Working Group.
- b. Final compliance with the TMDLs to be achieved no later than December 31, 2020.
- c. The Regional Board may, after a public hearing, and without need for a Basin Plan amendment, revise the schedules in this table, except for the final compliance date of December 31, 2020, if it determines good cause exists for such revisions.

Table NB-OCs-14. Existing NPDES Permits and WDRs Regulating Discharges in the Newport Bay Watershed

No.	Permit Title	Order No.	NPDES No.
1	Waste Discharge Requirements for the United States Department of the Navy, Former Marine Corps Air Station Tustin, Discharge to Peters Canyon Wash in the San Diego Creek/Newport Bay Watershed	R8-2006-0017	CA8000404
2	Waste Discharge Requirements for the County of Orange, Orange County Flood Control District and the Incorporated Cities of Orange County within the Santa Ana Region - Areawide Urban Storm Water Runoff - Orange County (MS4 permit)	R8-2002-0010	CAS618030
3	National Pollutant Discharge Elimination System (NPDES) Permit Statewide Storm Water Permit and Waste Discharge Requirements (WDRs) for the State of California, Department of Transportation (Caltrans)	99-06-DWQ	CAS000003
4	General Waste Discharge Requirements for Discharges to Surface Waters that Pose an Insignificant (de minimus) Threat to Water Quality	R8-2003-0061 as amended by R8-2005-0041 and R8-2006-0004	CAG998001
5	General Waste Discharge Requirements for Short-term Groundwater-Related Dischargers and De Minimus Wastewater Discharges to Surface Waters Within the San Diego Creek/Newport Bay Watershed	R8-2004-0021	CAG998002
6	General Groundwater Cleanup Permit for Discharges to Surface Waters of Extracted and Treated Groundwater Resulting from the Cleanup of Groundwater Polluted by Petroleum Hydrocarbons, Solvents and/or Petroleum Hydrocarbons mixed with Lead and/or Solvents	R8-2002-0007, as amended by R8-2003-0085 and R8-2005-0110	CAG918001
7	Waste Discharge Requirements for City of Tustin's 17th Street Desalter	R8-2002-0005	CA8000305
8	Waste Discharge Requirements for City of Irvine, Groundwater Dewatering Facilities, Irvine, Orange County,	R8-2005-0079	CA8000406
9	Waste Discharge Requirements for Bordiers Nursery, Inc.	R8-2003-0028	
10	Waste Discharge Requirements Hines Nurseries, Inc.	R8-2004-0060	
11	Waste Discharge Requirements for El Modeno Gardens, Inc., Orange County	R8-2005-0009	
12	Waste Discharge Requirements for Nakase Bros. Wholesale Nursery, Orange County	R8-2005-0006	

Phase I Implementation

Task 1: WDRs and NPDES Permits

The Regional Board shall review and revise, as necessary, existing NPDES permits and/or WDRs to incorporate the appropriate TMDL WLAs, compliance schedules, and monitoring program requirements. These permits are identified in Table NB-OCs-14. The appropriate TMDL WLAs, compliance schedules and monitoring program requirements shall be included in new NPDES permits/WDRs. The NPDES permits/WDRs shall specify TMDL-related provisions that apply provided that: (1) the dischargers are and remain members of the Working Group (see Task 7); and (2) the approved Work Plan developed by the Working Group is implemented in a timely and effective manner. The NPDES permit/WDRs shall also include TMDL-related provisions that apply if the discharger(s) do not participate or discontinue participation in the Working Group and/or if the approved Work Plan is not implemented effectively or in a timely manner.

Compliance with the TMDLs and wasteload allocations is to be achieved as soon as possible, but no later than December 31, 2020. The way that this deadline applies to a particular discharger differs depending on whether the discharger is participating in the Working Group:

1. Working Group Participants. Provisions in NPDES permits/WDRs issued during implementation of the Work Plan will specify the following for Working Group members:

(a) Interim effluent limitations. Participation in the Working Group and timely and effective implementation of the Regional Board-approved Work Plan will constitute interim, performance-based effluent limitations to implement the wasteload allocations. Adhering to these interim effluent limitations satisfies the requirement, during the Work Plan implementation period, to achieve compliance with the TMDLs and wasteload allocations “as soon as possible.”

(b) Final effluent limitations. Final effluent limitations based on the wasteload allocations will also be specified, with a schedule requiring compliance as soon as possible but no later than December 31, 2020.³ Compliance with the interim, performance-based limitations will fulfill the “as soon as possible” requirement. The NPDES permits/WDRs will specify further that the status of compliance with the final effluent limitations based on the wasteload allocations will be reviewed on an annual basis. Compliance with these limitations will be required prior to the completion of the Work Plan tasks, in accordance with a schedule approved by the Regional Board’s Executive Officer, if it is demonstrated to the satisfaction of the Executive Officer that such earlier compliance is reasonably feasible.

² It is recognized that this schedule may exceed the five year terms of NPDES permits. This schedule will be reflected in subsequent renewals of these NPDES permits.

Following the completion of the Work Plan tasks, NPDES permits/WDRs will require dischargers to comply with wasteload allocations in the shortest practicable time, but in no event later than December 31, 2020.

2. Non-Working Group Dischargers. For dischargers not participating in the Working Group, NPDES permit/WDR provisions will require compliance with the wasteload allocations as soon as possible after adoption of NPDES permits/WDRs that implement the TMDLs, but no later than December 31, 2020. In this case, the determination of what constitutes "as soon as possible" will be at the discretion of the Regional Board's Executive Officer.

Completion of the Work Plan and/or other investigations conducted by the Regional Board or others may result in modification of the TMDLs, wasteload allocations and the compliance schedule through the Basin Planning process. Subsequent issuance/revision of NPDES permit/WDRs will implement any such changes.

Ultimate compliance with permit limitations based on wasteload allocations is expected to be based upon iterative implementation of effective BMPs to manage the discharge of fine sediments containing organochlorine compounds, along with monitoring to measure BMP effectiveness.

Permit revisions shall be accomplished as soon as possible upon approval of these TMDLs. Given Regional Board resource constraints and the need to consider other program priorities, permit revisions are likely to be tied to renewal schedules.

For commercial nurseries covered under existing WDRs, revisions of these WDRs shall address the following identified needs:

- (1) Evaluation of sites to determine/verify potential storm water and nonstorm water discharge locations;
- (2) Evaluation of current monitoring programs and methods of sampling and analysis for consistency with other monitoring efforts in the watershed;
- (3) In cooperation with U.C. Cooperative Extension, evaluation of BMPs for adequacy and implementation of the most effective BMPs to reduce/eliminate the discharge of potentially-contaminated fine sediments in both storm water and non-storm water discharges;
- (4) Monitoring to better quantify nursery runoff as a potential source of organochlorine compounds and to assure that load reductions are achieved; and
- (5) Based on the results of the preceding tasks, development of a workplan to be submitted within one month of the effective date of these TMDLs that identifies: (a) the BMPs implemented to date and their effectiveness in reducing fine sediment and organochlorine compound discharges; (b) the adequacy and consistency of monitoring efforts, and proposed improvements; (c) a plan and schedule for implementation of revised BMPs and monitoring protocols, where appropriate. It is recognized that most nursery operations

are likely to be of very limited duration due to the expiration of land leases. The workplan shall identify recommendations for BMP and monitoring improvements that are effective, reasonable and practicable, taking this consideration into account. This workplan shall be implemented upon approval by the Regional Board Executive Officer.

Revisions to the Municipal Separate Storm Sewer System (MS4) permit (R8-2002-0010, NPDES No. CAS618030), including the monitoring program shall address the monitoring and BMP-related tasks identified below, as appropriate. The Regional Board will coordinate also with the State Water Resources Control Board regarding revision of the Caltrans permit to address these monitoring and BMP-related tasks. These include: oversight and implementation of construction BMPs (Task 4); organochlorine compound source evaluations (Task 5); assessment of dredging feasibility and identification of a funding mechanism (Task 6); and, revision of the regional monitoring program (Task 8).

NPDES permits that regulate discharges of ground water to San Diego Creek or its tributaries shall be reviewed and revised as necessary to require annual (at a minimum) monitoring, using the most sensitive analytical techniques practicable, to analyze for organochlorine compounds in the discharges. If organochlorine compounds are found to be present, the dischargers shall be required to evaluate whether and to what extent the discharges would cause or contribute to an exceedance of wasteload allocations and to implement appropriate measures to reduce or eliminate organochlorine compounds in the discharges. New NPDES permits issued for these types of discharges shall incorporate the same requirements.

These dischargers (nurseries, MS4 permittees, Caltrans, ground water dischargers) may address the specific requirements identified above through their participation in the development and implementation of an appropriate Regional Board approved Work Plan (see Task 7).

Task 2: Develop and Implement an Agricultural BMP and Monitoring Program

Apart from certain nurseries, agricultural operations in the watershed are not currently regulated pursuant to waste discharge requirements. The SWRCB's "Policy for Implementation and Enforcement of the Nonpoint Source Pollution Control Program" (Nonpoint Source Policy) (2004) requires that all nonpoint source dischargers be regulated under WDRs, waivers of WDRs, Basin Plan prohibitions, or some combination of these three administrative tools. Board staff is developing recommendations for an appropriate regulatory approach to address agricultural discharges. It is expected that the Regional Board will be asked to consider these recommendations and to approve a regulatory approach in late 2007. Appropriate load allocations to implement these TMDLs will be included in WDRs or a waiver of WDRs, if and when issued by the Regional Board to address discharges from agricultural operations.

In the interim, agricultural operators shall identify and implement a monitoring program to assess OCs discharges from their facilities, and identify and implement a BMP program designed to reduce or eliminate those discharges. The proposed monitoring and BMP program shall be submitted as soon as possible but no later than October 26, 2013. These monitoring and BMP programs will be components of the waste discharge requirements or conditional waiver of waste discharge requirements that Board staff will recommend to implement the Nonpoint Source Policy. Load allocations identified in these TMDLs will also be specified in the WDRs/waiver, with a schedule of compliance.

It is recognized that most agricultural operations are expected to be of very limited duration due to the expiration of land leases. The monitoring and BMP programs proposed by the agricultural operators should include recommendations that are effective, reasonable and practicable, taking this consideration into account. The BMP and monitoring programs shall be implemented upon approval by the Regional Board. The BMP and monitoring programs may be implemented individually or by a group or groups of agricultural operators.

In addition, responsible parties may address these BMP/monitoring program requirements through their participation in the development and implementation of an appropriate, Regional Board approved Work Plan (see Task 7). WDRs or conditional waivers of WDRs issued to agricultural operators pursuant to the Nonpoint Source Policy shall specify that for those operators who participate in the development and implementation of a Regional Board approved Work Plan, compliance with the TMDLs and load allocations is to be achieved as soon as possible, but no later than December 31, 2020. The way that this deadline applies to a particular agricultural operator differs depending on whether the operator is participating in the Working Group:

1. Working Group Participants. Provisions in WDRs or conditional waivers of WDRs issued during implementation of the Work Plan will specify the following for Working Group members:

(a) Interim limitations: Participation in the Working Group and timely and effective implementation of the Regional Board-approved Work Plan will constitute interim, performance-based limitations to implement the load allocations. Adherence to these interim limitations satisfies the requirement, during the Work Plan implementation period, to achieve compliance with the TMDLs and load allocations “as soon as possible.”

(b) Final limitations: Final limitations based on the load allocations will also be specified in the WDRs/waivers, with a schedule requiring compliance as soon as possible but no later than December 31, 2020. Compliance with the interim, performance-based limitations will fulfill the “as soon as possible” requirement. The WDRs/waivers will specify further that the status of compliance with the final limitations based on the load allocations will be reviewed on an annual basis. Compliance with these limitations will be required prior to the completion of the Work Plan tasks, in accordance with a schedule approved by the Regional Board’s Executive Officer, if it is

demonstrated to the satisfaction of the Executive Officer that such earlier compliance is reasonably feasible.

Following the completion of the Work Plan tasks, WDRs/waivers will require agricultural operators to comply with load allocations in the shortest practicable time, but in no event later than December 31, 2020.

2. Non-Working Group Dischargers. For agricultural operators not participating in the Working Group, provisions in WDR/waivers of WDRs will require compliance with the load allocations as soon as possible after adoption of WDRs/waivers of WDRs that implement the TMDLs, but no later than December 31, 2020. In this case, the determination of what constitutes “as soon as possible” will be at the discretion of the Regional Board’s Executive Officer.

Completion of the Work Plan and/or other investigations conducted by the Regional Board or others may result in modification of the TMDLs, load allocations and the compliance schedule through the Basin Planning process. Subsequent issuance/revision of WDRs/conditional waivers of WDRs will implement any such changes.

Task 3: Identify Parties Responsible for Open Space Areas; Develop and Implement an OCs Monitoring Program to Assess Open Space Discharges; Develop and Implement an OCs BMP Program, if Necessary

Nonpoint source discharges from open space are also subject to State regulation. During Phase I of these TMDLs, sufficient data shall be collected by the responsible parties to determine whether discharges of OCs from designated open space, as well as discharges resulting from erosion in and adjacent to unmodified streams, are causing or contributing to exceedances of water quality objectives and/or impairment of beneficial uses of San Diego Creek and Newport Bay. With the assistance of the stakeholders, Regional Board staff will identify the responsible parties as soon as possible but no later than August 26, 2013. Board staff will notify the identified responsible parties of their obligation to propose an organochlorine compound monitoring program within two months of notification. The monitoring program shall be implemented upon Regional Board approval.

Based on the results of this monitoring program, the responsible parties shall develop a BMP implementation plan within 6 months of notification by the Regional Board’s Executive Officer of the need to do so. The responsible parties shall implement that plan upon Regional Board approval.

The responsible parties may address these monitoring and BMP implementation program requirements through their participation in the development and implementation of an appropriate Regional Board approved Work Plan (see Task 7).

The Regional Board will consider whether WDRs or a WDR waiver is necessary and appropriate for responsible parties not currently regulated, based on the monitoring results. WDRs or a WDR waiver, if issued, will include appropriate load allocations to implement these TMDLs. For responsible parties compliance with the TMDLs and load allocations is to be achieved as soon as possible, but no later than December 31, 2020. The way that this deadline applies to a particular responsible party differs depending on whether that responsible party is participating in the Working Group:

1. Working Group Participants. Provisions in WDRs or conditional waivers of WDRs issued during implementation of the Work Plan will specify the following for Working Group members:

(a) Interim limitations: Participation in the Working Group and timely and effective implementation of the Regional Board-approved Work Plan will constitute interim, performance-based limitations to implement the load allocations. Adherence to the interim, performance-based limitations satisfies the requirement, during the Work Plan implementation period, to achieve compliance with the TMDLs and load allocations “as soon as possible.”

(b) Final limitations: Final limitations based on the load allocations will also be specified in the WDRs/waivers, with a schedule requiring compliance as soon as possible but no later than December 31, 2020. Compliance with the interim, performance-based limitations will fulfill the “as soon as possible” requirement. The WDRs/waivers will specify further that the status of compliance with the final limitations based on the load allocations will be reviewed on an annual basis. Compliance with the final limitations will be required prior to the completion of the Work Plan tasks, in accordance with a schedule approved by the Regional Board’s Executive Officer, if it is demonstrated to the satisfaction of the Executive Officer that such earlier compliance is reasonably feasible.

Following the completion of the Work Plan tasks, WDRs/waivers will require responsible parties to comply with load allocations in the shortest practicable time, but in no event later than December 31, 2020.

2. Non-Working Group Dischargers. For responsible parties not participating in the Working Group, compliance with the load allocations will be as soon as possible after TMDLs adoption and approval, but no later than December 31, 2020. In this case, the determination of what constitutes “as soon as possible” will be at the discretion of the Regional Board’s Executive Officer.

Completion of the Work Plan and/or other investigations conducted by the Regional Board or others may result in modification of the TMDLs, load allocations and the compliance schedule through the Basin Planning process. Subsequent issuance/revision of WDRs/conditional waivers of WDRs will implement any such changes.

Task 4: Develop and Implement Appropriate BMPs for Construction Activities

Currently, all construction activities in the watershed are regulated under the State Water Resource Control Board's (SWRCB) General Permit for Discharge of Storm Water Runoff Associated with Construction Activity (Order No. 99-08-DWQ, NPDES No. CAS000002; the "General Construction Permit"), SWRCB National Pollutant Discharge Elimination System (NPDES) Permit Statewide Storm Water Permit and Waste Discharge Requirements (WDRs) for the State of California, Department of Transportation (Caltrans) (Order No. 99-06-DWQ, NPDES No. CAS000003; the Caltrans MS4 permit), and/or the Orange County MS4 NPDES permit. The requirements of these permits and an iterative, adaptive-management BMP approach, coupled with monitoring, are the foundation for meeting the TMDL WLAs for construction. The General Construction Permit, and the Orange County and Caltrans MS4 permits are expected to be revised over time. The specific tasks identified below may be addressed by revisions to one or more of these permits. In that case, the Regional Board will integrate requirements for implementation of this Task with the requirements of the Orange County and Caltrans MS4/General Construction permits so as to prevent conflict and/or duplication of effort.

To assure that effective construction BMPs are identified and implemented, program improvements are needed in the following areas: (a) Storm Water Pollution Prevention Plans (SWPPPs) prepared in response to the General Construction Permit must include supporting documentation and assumptions for selection of sediment and erosion control BMPs, and must state why the selected BMPs will meet the Construction WLAs for the organochlorine compounds; (b) SWPPP provisions must be rigorously implemented on construction sites; (c) sampling and analysis for the organochlorine pesticides and PCBs in storm and nonstorm discharges containing sediment from construction sites is necessary to determine the efficacy of BMPs, as well as compliance with the construction WLAs; sampling and analysis plans must be included in SWPPPs; (d) additional BMPs, including enhanced BMPs, must be evaluated to determine those that may be appropriate for reducing or eliminating organochlorine compound discharges from construction sites (e.g., BMPs effective in control of fine particulates) without significant adverse environmental effects (e.g., toxicity that might result from improper storage and/or application of polymers); (e) outreach is necessary to assure the effective implementation of these SWPPP requirements; and (e) enforcement of the SWPPP requirements is necessary.

To address these program improvements, Regional Board staff shall develop a SWPPP Improvement Program that identifies the Regional Board's expectations with respect to the content of SWPPPs, including documentation regarding the selection and implementation of BMPs, and a sampling and analysis plan. The Improvement Program shall include specific guidance regarding the development and implementation of monitoring plans, including the constituents to be monitored, sampling frequency and analytical protocols. The SWPPP Improvement Program shall be completed by July 26,

2013. No later than two months from completion of the Improvement Program, Board staff shall assure that the requirements of the Program are communicated to interested parties, including dischargers with existing authorizations under the General Construction Permit. Existing, authorized dischargers shall revise their project SWPPPs as needed to address the Program requirements as soon as possible but no later than October 26, 2013. Applicable SWPPPs that do not adequately address the Program requirements shall be considered inadequate and enforcement by the Regional Board shall proceed accordingly. The Caltrans and Orange County MS4 permits shall be revised as needed to assure that the permittees communicate the Regional Board's SWPPP expectations, based on the SWPPP Improvement Program, with the Standard Conditions of Approval.

The MS4 permittees shall conduct studies to evaluate BMPs that are most appropriate for reducing or eliminating organochlorine compound discharges from construction sites (e.g., fine particulates), including advanced treatment BMPs. The evaluation shall consider the potential for adverse environmental effects associated with implementation of each of the BMPs identified. MS4 Permittees shall include these BMPs in the Orange County Stormwater Program Construction Runoff Guidance Manual and the Caltrans Storm Water Management Plan (SWMP). Implementation of these MS4 permittee requirements shall commence upon issuance of appropriate Water Code Section 13267 letters or renewal of the MS4 permits, whichever occurs first. The Section 13267 letters/revised permits shall require the permittees to: (a) submit a proposed plan and schedule for studies to evaluate appropriate BMPs, as described above, within three months of issuance of the 13267 letter or permit revision; (b) implement the plan and schedule upon approval by the Regional Board's Executive Officer; (c) submit a report of the BMP investigations within 6 months of approval of the study plan, provided that sufficient storms, as defined in the study plan, have occurred within that period. If the number of storms does not conform to the study plan, then the report shall be submitted in accordance with a schedule approved by the Executive Officer once the requisite number of storms has occurred. The report shall include a proposed plan and schedule for implementation of the BMPs, as appropriate, and inclusion of the BMPs in the Orange County Guidance Manual and in the Caltrans SWMP and related guidance documents; (d) implement the BMP plan upon approval by the Executive Officer.

The MS4 permittees may address these SWPPP and construction site BMP-related requirements through their participation in the development and implementation of an appropriate, Regional Board approved Work Plan (see Task 7).

Task 5: Evaluate Sources of OCs to San Diego Creek and Newport Bay; Identify and Implement Effective BMPs to Reduce/Eliminate Sources

Based on the regional monitoring program being implemented by the Orange County MS4 permittees and/or on the results of other monitoring and investigations, all MS4 permittees shall conduct source analyses in areas tributary to the MS4 system demonstrating elevated concentrations of OCs. Based on mass emissions monitoring (described below) and source analysis, the permittees shall implement

additional/enhanced BMPs as necessary to ensure that organochlorine discharges from significant land use sources to surface waters are reduced or eliminated. As part of the investigation task, if the results indicate that additional OCs soil remediation is necessary on MCAS Tustin and MCAS El Toro, the responsible parties for such remediation will be identified. The responsible party will be tasked to implement those portions of the BMP plan identified for the responsible party for MCAS Tustin and MCAS El Toro.

The permittees shall develop and implement a collection program for all banned OC pesticides and PCBs. This type of program has had demonstrated success in other geographic areas in collecting and disposing of banned pesticides. Residents and businesses in the watershed may have stored legacy pesticides that could be collected through such a program; if this is the case, this task would prevent future use and improper disposal of these banned pesticides.

Implementation of these requirements shall commence upon issuance of appropriate Water Code Section 13267 letters or approval of an appropriately revised MS4 permits, whichever occurs first. Revisions to the Orange County MS4 permit and Caltrans SWMP shall implement requirements specified in applicable Section 13267 letters, if used to implement TMDL-related requirements. The 13267 letters/revised permit shall specify require the permittees to: (a) submit a proposed plan and schedule for source analyses of MS4 tributary areas with elevated OCs concentrations within 3 months of issuance of the 13267 letters or permit revision; (b) implement the proposed plan upon approval by the Regional Board's Executive Officer; (c) submit a report within 6 months of completion of the approved study plan. The report shall provide the study results and include a proposed plan and schedule for prioritized implementation of BMPs in OCs source areas; (d) implement the BMP plan upon Executive Officer approval.

The permittees may address these requirements through their participation in the development and implementation of an appropriate, Regional Board approved Work Plan (Task 7).

Task 6: Evaluate Feasibility and Mechanisms to Fund Future Dredging Operations

Because large-scale erosion and sedimentation primarily occurs during large storm events, traditional BMPs may have limited success in reducing/eliminating the discharge of potentially-contaminated sediments to receiving waters during wet weather. In such cases, dredging within Newport Bay and/or San Diego Creek may be the most feasible and appropriate method of reducing OCs loads in these waters. However, the feasibility and effectiveness of dredging projects in removing OCs would require careful consideration, since dredging may or may not expose sediments with higher concentrations of OCs. Financing of such projects is also a significant consideration.

Entities discharging potentially contaminated sediment in the watershed shall analyze the feasibility of dredging to achieve water quality standards, and shall identify funding

mechanisms for ensuring that future dredging operations can be performed, as necessary, within San Diego Creek, Upper and Lower Newport Bay. A report that presents the results of this effort shall be submitted no later than July 26, 2016. It is recognized that dredging activities are likely to be an integral part of efforts to comply with other established TMDLs, particularly the sediment TMDL. Ideally, dredging feasibility and funding investigations would be integrated with implementation and review of the sediment TMDL through the comprehensive Work Plan (Task 7). The responsible parties may address this Task requirement through their participation in the development and implementation of an appropriate, Regional Board approved Work Plan.

Task 7: Develop a Comprehensive Work Plan to Meet TMDL Implementation Requirements, Consistent with the Adaptive Management Approach

During the development of these organochlorine compounds TMDLs, regulated stakeholders in the Newport Bay watershed expressed concerns that the numeric targets used to develop the TMDLs, wasteload allocations and load allocations were flawed and that scientific review by an independent panel of experts was necessary. Further, these stakeholders suggested that pollutants other than the organochlorine compounds, such as metals, pyrethrins or other, emerging pollutants may pose the more real or significant threat to beneficial uses in the watershed. Finally, it was recommended that an integrated approach to TMDL implementation, and to the development of pending TMDLs and refinement of established TMDLs, would be a more effective and efficient approach.

Substantial efforts are already being made by many stakeholders in the watershed to address established permit and/or TMDL requirements for BMP implementation and monitoring and to conduct special investigations to understand and improve water quality conditions in the watershed. Thus, the framework exists to develop a comprehensive watershed plan for addressing water quality, not only as it relates to the organochlorine compounds, but on a larger scale that encompasses all sources of water quality impairment.

This implementation plan provides the opportunity for regulated stakeholders to form a Working Group and to participate in the development and implementation of a comprehensive Work Plan to evaluate the scientific basis of these organochlorine TMDLs, to prioritize TMDL implementation tasks, to integrate implementation with other TMDL and/or permit requirements, and to investigate unknown sources of toxicity in the watershed. As noted in the previous Task descriptions, participation by responsible parties in the Working Group and the development and implementation of a Regional Board Work Plan would address the responsible parties' obligations pursuant to the Tasks in Table NB-OCs-13. Dischargers who elect not to participate in the Working Group/Work Plan will be required to implement these Tasks, as described above.

Dischargers interested in participating in a Working Group to develop and implement a comprehensive Work Plan must commit to do so by August 26, 2013. Submittal of a

draft Work Plan is required no later than October 26, 2013. The schedules for implementation of the tasks identified in the Work Plan must reflect the shortest practicable time necessary to complete the tasks. Implementation of the Work Plan will commence upon approval of the Work Plan by the Regional Board at a properly noticed public hearing. Execution of the Work Plan must be complete within five years of Regional Board approval. Substantive changes to the tasks and schedules included in the approved Work Plan are contingent on Regional Board approval at a subsequent, properly noticed public hearing(s). However, the Regional Board's Executive Officer is authorized to revise the approved tasks and schedules if no significant comments are received during the public notice period.

At a minimum, the expected result of the execution of the Work Plan is a comprehensive, watershed plan for BMP implementation, monitoring, special investigations and other actions that will assure compliance with the OCs TMDLs, as they may be amended, as soon as possible after completion of execution of the Work Plan but no later than December 31, 2020⁴.

The specific detailed Work Plan tasks and schedules will be determined as the Work Plan is developed. Regional Board staff will work with the Working Group to identify a suitable Work Plan. Key initial tasks are expected to include the following:

1. Convene an Independent Advisory Panel (IAP) of experts with relevant expertise. To avoid questions of objectivity, the panel shall be convened by a neutral third party organization such as the National Water Research Institute. The Working Group and Regional Board staff will work together to define the desired qualifications needed for IAP participants, define the scope and authority of the IAP, and identify and describe the primary issues that will require guidance, recommendations, or specific actions from the IAP.

2. Re-evaluate OCs TMDLs Numeric Targets and Loads

With input and recommendations from the IAP, and using data being generated through ongoing scientific investigations in the watershed, the Work Plan should assess the current OCs TMDLs numeric targets, evaluate potential alternative numeric targets, and determine if the current targets should be revised, or whether targets based on site-specific data can be developed. If site-specific targets can be developed, the process or methods that will be used to develop targets should be determined, such as risk assessments or re-calculation of targets using accepted, peer-reviewed scientific methodologies.

It is recognized that there is a need for flexibility to respond to unanticipated findings and events, and to changes that may be recommended by the Independent Advisory Panel (see below). However, at a minimum, each of the Tasks identified in Table NB-

⁴ This compliance date is subject to change through the Basin Planning process.

OCs-13 (except Task 1, which requires action by the Regional Board, and Task 4, which requires action by the Regional Board and the MS4 permittees based on established MS4 permit requirements) must be considered in Work Plan development and implementation. If one or more of these tasks is not proposed for inclusion in the Work Plan, or where modifications of these tasks/schedules are recommended, a written description and justification must be provided with the draft Work Plan submittal. In addition, consideration shall be given to the following:

Develop conceptual models

Data interpretation and monitoring must be organized around a systematic conceptual view of the sources of the different organochlorine compounds and their distribution and behavior in the watershed. Development of conceptual models for these compounds would significantly enhance our understanding of their sources and impacts and would help to structure hypothesis development, monitoring design, and data interpretation. Development of the conceptual models should be based on a review of available data and information about the OCs in the watershed, and the models should be updated as new information accumulates. Characterization of sources and of habitats at risk should be based on a review of available data, framed in terms of the conceptual models and supported with the collection of new data as needed. It is expected that the IAP would provide critical review and recommendations in this process.

Develop Information Management System

Different types of data – water column, sediment, fish or bird egg tissue, infaunal surveys, hydrology, etc. – are being or will be collected throughout the Newport Bay watershed through a variety of studies, monitoring programs, or other projects. Since these data are often collected for different purposes (e.g., in response to various TMDLs and/or permits), at different times and in different areas, much of the data may be in non-comparable formats, redundant, or not spatially or temporally compatible. In order to determine what data are useful or significant, where data gaps may still occur, or where current data needs are sufficient, a comprehensive information management system should be developed that (1) establishes clear procedures for assessing data quality for data acquisition and transfer and for control of evolving versions of datasets; (2) is a relational database that can manage the variety of data types and has appropriate mechanisms for ensuring and maintaining data quality; (3) can conduct quality control checks and needed reformatting to ensure needed consistency across all data types and sources as data from other sources are obtained; (4) provides for straightforward query and data sub-setting routines to streamline access to the data; and (5) ensures that GIS capability is available for analysis, modeling, and presentation purposes. Development of a comprehensive information management system will allow for the identification of significant data gaps that need to be addressed and will provide a vehicle for

establishing monitoring guidelines and preventing redundant or superfluous data collection.

To the extent that there are any conflicts between the individual tasks and schedules identified in Table NB-OCs-13, and the prioritized plan and schedule identified in the Work Plan, the Work Plan would govern implementation activities with respect to the stakeholders responsible for Work Plan development and implementation as part of the Working Group.

Task 8: Revise Regional Monitoring Program

The County of Orange, as Principal Permittee under the County's MS4 permit, oversees the countywide monitoring program. Implementation of the monitoring program is supported by funds shared proportionally by each of the Permittees named in the Orange County MS4 permit. Some monitoring requirements identified in this implementation plan are already reflected in the current program.

By October 26, 2013, the Orange County MS4 permittees shall: (1) document each of the current monitoring program elements that address the monitoring requirements identified in the preceding tasks; and, (2) revise the monitoring program as necessary to assure compliance with these monitoring requirements.

Review of/revisions to the monitoring program shall address:

- (1) Estimation of mass emissions of chlordane, DDT, PCBs and toxaphene.
- (2) Determination of compliance with MS4 wasteload allocations for Upper and Lower Newport Bay, and of status of achievement with the informational wasteload allocations for San Diego Creek for chlordane and PCBs.
- (3) Assessment of temporal and spatial trends in organochlorine compound concentrations in water, sediment and tissue samples.
- (4) Semi-annual sediment monitoring in San Diego Creek and Newport Bay. Measurements of sediment chemistry in these waters should be evaluated with respect to evidence of biological effects, such as toxicity and benthic community degradation.
- (5) Evaluation of organochlorine bioaccumulation and food web biomagnification
- (6) Assessment of the degree to which natural attenuation is occurring in the watershed.

Accurately quantifying the very small mass loads that are allowable under these TMDLs will be very challenging; analytical strategies for quantifying loads of the organochlorine compounds must be carefully explored.

Revisions to the monitoring program shall take into consideration the following recommendations provided by members of the Organochlorine Compounds TMDL Technical Advisory Committee (TAC):

- (1) The analytical parameters measured need to be established for each matrix of interest (e.g., sediment, tissue, ambient water). The representative list of compounds to be measured needs to be identified (e.g., what chlordane compounds will be measured and summed to represent “total chlordane;” will PCB congeners be measured and summed or will Aroclors?).
- (2) Data quality will need to be consistent with the State’s Surface Water Ambient Monitoring Program (SWAMP). Detection limits, accuracy and precision of analytical methods should be adequate to assure the goals of the monitoring efforts can be achieved.
- (3) Bioaccumulation/biomagnification in high trophic level predators may not immediately respond to load reductions; appropriate time scales and schedules for monitoring that are supported by empirical data and/or modeling should be established.
- (4) Sentinel fish and wildlife species should be selected for monitoring based on home range, life history, size and age.

MS4 permittees may address the requirements specified herein by participation in the Working Group and development and implementation of an appropriate, Regional Board approved Work Plan (see Task 7).

Task 9: Conduct Special Studies

The following special studies should be conducted, in addition to the studies already underway in the watershed. This list is based, in part, on recommendations of the technical advisory committee for the organochlorine compounds TMDLs. These studies will be implemented as resources become available, and the results will be used to review and revise these TMDLs. Stakeholder contributions to these investigations are encouraged and would facilitate review of the TMDLs.

- (1) Evaluation of sediment toxicity in San Diego Creek and tributaries, and Upper and Lower Newport Bay.

Previous studies have included Toxicity Identification Evaluations (TIEs) that have yielded inconclusive results as to the cause of toxicity in Newport Bay. Sediment toxicity within San Diego Creek is not well-documented or well-understood. There is evidence that pyrethroid compounds may be a significant contributor. In determining the extent to which nonpolar organic compounds are causing or contributing to sediment toxicity, the differential contribution of both the organochlorine compounds and pyrethroids should be determined to assure that control actions are properly identified and implemented. Monitoring should be performed year-round at multiple locations within San Diego Creek and Newport Bay (to encompass spatial and temporal variability), and should include various land use types in order to quantify the relative contributions from various sources.

- (2) Refinement of sediment and tissue targets.

A study is being conducted by the San Francisco Estuary Institute to develop indicators and a framework for assessing the indirect effects of sediment contaminants. The objective is to provide methodology that will assist in evaluating indirect adverse biological effects for bioaccumulative pollutants (e.g. due to food web biomagnification), as part of the overall goal of developing statewide sediment quality objectives. Newport Bay is being used as a case study to show how the proposed methodology could be implemented on a screening level. Multiple lines of evidence will be evaluated to determine impacts of organochlorine pesticides and PCBs to humans and wildlife. A conceptual foodweb model will be developed, and sensitive wildlife receptors will be identified. Empirical field data and a steady-state food web model will be used to calculate bioaccumulation factors for the organochlorine compounds. The bioaccumulation factors will be combined with effects thresholds to identify sediment concentrations that are protective of target wildlife and humans.

Once completed by SFEI, a thorough evaluation of the Newport Bay case study needs to be initiated, and any additional analyses required for a more in-depth risk analysis should be identified and completed. Protective sediment and tissue targets for indirect effects to humans and wildlife should be developed by the time the TMDLs are re-opened. Furthermore, once TIEs have identified the likely toxicant(s) responsible for sediment toxicity in San Diego Creek and Newport Bay (direct effects), field and laboratory studies should be conducted in order to determine bioavailability and the dose-response relationship between sediment concentrations and biologic effects.

- (3) Evaluation of regional BMPs (e.g., constructed wetlands and sediment detention basins) for mitigating potential adverse water quality impacts of sediment-associated pollutants (e.g., OCs, pyrethroids).

Large-scale, centralized BMPs such as constructed wetlands and storm water retention basins may be more effective than project-level BMPs in reducing adverse environmental impacts of sediment-borne pollutants. Regional BMPs are either being planned or are in place within the watershed (e.g., IRWD NTS). Their potential effectiveness for capturing the organochlorine compounds and mitigating impacts needs to be evaluated.

- (4) Improvement in linkage between toxaphene measured in fish tissue and toxaphene in bed sediments.

The toxaphene impairment listing for San Diego Creek is based on fish tissue exceedances that have no measured linkage with toxaphene in sediments. While sediment is the primary TMDL target for these TMDLs, toxaphene is usually not detected in sediment. Because of its chemical complexity, there is a large degree of analytical uncertainty with measurements of toxaphene in environmental samples that use standard methods (e.g., EPA Method 8081a), especially at low levels. Confirmations of toxaphene in fish and sediment samples in San Diego Creek (and possibly Newport Bay) using other techniques (e.g., GC-ECNI-MS or MS/MS) is recommended.

- (5) Evaluation of relative importance of continuing OCs discharges to receiving waters through erosion and sedimentation processes, versus recirculation of existing contaminated bed sediments, in causing beneficial use impairment in San Diego Creek and Newport Bay.

This study should allow for determination of the most effective implementation strategies to reduce organochlorine compounds in the MS4 and other receiving waters.

Phase II Implementation

Task 10: TMDL Reopener

These TMDLs will be reopened no later than July 26, 2018 in order to evaluate the effectiveness of Phase I implementation. At that time, all new data will be evaluated and used to reassess impairment, BMP effectiveness, and whether modifications to the TMDLs are warranted. If BMPs implemented during Phase I have been shown to be ineffective in reducing levels of organochlorine compounds, then more stringent BMPs may be necessary during Phase II implementation.

Implementation of these TMDLs and the schedule for implementation are very closely tied with other TMDLs that are currently being implemented in the watershed. The sediment TMDL allowable load for San Diego Creek was the basis for calculating organochlorine compound loading capacities. The sediment TMDL is scheduled for revision in 2007; changes to the sediment TMDLs will likely necessitate changes to these organochlorine compounds TMDLs as well.

(End of amendment adopted under Resolution No. R8-2011-0037)

Anaheim Bay/Huntington Harbour

As in Newport Bay, bacteria and toxics threaten the water quality and beneficial uses of Anaheim Bay/Huntington Harbour. As shown in Table 5-10, the presence of toxic metals and pesticides/herbicides has resulted in the designation of Anaheim Bay and Huntington Harbour as a Toxic Hot Spot for some constituents and a Potential Toxic Hot Spot for other constituents. Two major storm drains, the Bolsa Chica Channel and the East Garden Grove Wintersburg Channel, as well as their tributaries, drain in to the Anaheim Bay/Huntington Harbour complex. Inputs of stormwater and urban nuisance flows via these channels appear to be significant sources of pollutants. The County of Orange's general stormwater permit requires the implementation of best management practices (BMPs) and other measures in the watershed to control these inputs to the maximum extent practicable.

During 1992-93, the Regional Board contracted with UC Irvine and UC Davis to evaluate the occurrence and impacts of these toxics in Huntington Harbour [Ref. 23, 24]. Results of

the study indicated that concentrations of trace metals have decreased over a 13 year period and 1992/93 measurements met established water quality criteria. However, an unidentified nonpolar organic compound was found to be acutely toxic to test species.

Anaheim Bay (inland of Pacific Coast Highway Bridge) and Huntington Harbour are designated as no discharge areas for vessel sanitary wastes. Pumpout facilities are in place throughout the Harbour to facilitate compliance. Additional discussion of the activities of the Huntington Harbour Waterways Committee is provided in Chapter 7.

Big Bear Lake (The following added under Resolution No. R8-2004-0023)

Big Bear Lake, located in the San Bernardino Mountains, was created by the construction of the Bear Valley Dam in 1884. The Lake has a surface area of approximately 3,000 acres, a storage capacity of 73,320 acre-ft and an average depth of 24 feet. The lake reaches its deepest point of 72 feet at the dam. The Big Bear Lake drainage basin encompasses 37 square miles and includes more than 10 streams. Local stream runoff and precipitation on the Lake are the sole source of water supply to the Lake. The spillway altitude is 6,743.2 feet. The major inflows to the lake are creeks, including Rathbone (Rathbun) Creek, Summit Creek, and Grout Creek. Outflow from the Lake is to Bear Creek, which is tributary to the Santa Ana River at about the 4,000-foot elevation level. Twelve percent of Big Bear Lake's drainage basin consists of the Lake itself. The US Forest Service is the largest landowner in the Big Bear area. Two ski resorts, Bear Mountain and Snow Summit, lease land from the Forest Service.

The beneficial uses of Big Bear Lake include cold freshwater habitat (COLD), warm freshwater habitat (WARM), water contact recreation (REC1), non-contact water recreation (REC2), municipal and domestic supply (MUN), agriculture supply (AGR), groundwater recharge (GWR), wildlife habitat (WILD) and rare, threatened or endangered species (RARE).

Big Bear Lake is moderately eutrophic. During the summer months, deeper water may exhibit severe oxygen deficits. Nutrient enrichment has resulted in the growth of aquatic plants, which has impaired the fishing, boating, and swimming uses of the lake. To control this vegetation, mechanical harvesters are used to remove aquatic plants, including the roots.

Toxics may be entering the Big Bear Lake watershed and accumulating in aquatic organisms and bottom sediments at concentrations that are of concern, not only for the protection of aquatic organisms, but for the protection of human health as well. Past Toxic Substances Monitoring Program data have indicated the presence of copper, lindane, mercury, zinc, and PCBs in fish tissue.

During 1992-93, the Regional Board conducted a Phase I Clean Lakes study (Section 314 of the Clean Water Act) to evaluate the current water quality condition of the lake and its major tributaries [Ref. 25]. The focus of the study was to identify the tributaries responsible for inputs of toxics and nutrients. As a result of data collected in the Clean Lakes Study,

Big Bear Lake and specific tributaries were placed on the 1994 Clean Water Act Section 303(d) List of Water Quality Limited Segments for the reasons indicated in Table 5-9a-b.

Table 5-9a-b

Big Bear Lake Watershed Waterbodies on the 1994 303(d) List of Impaired Waters

WATERBODY	STRESSOR
Big Bear Lake	nutrients
	noxious aquatic plants
	sedimentation/siltation
	metals
	copper
	mercury
Rathbone (Rathbun) Creek	nutrients
	sedimentation/siltation
Grout Creek	metals
	nutrients
Summit Creek	nutrients
Knickerbocker Creek	metals
	pathogens

In 2000, the Regional Board convened a TMDL workgroup to assist in the development of Total Maximum Daily Loads for the Big Bear Lake watershed. The Big Bear Municipal Water District, a key contributor to the workgroup, created the Big Bear Lake TMDL Task Force, including representatives of the District, Regional Board staff, the San Bernardino County Flood Control District, the City of Big Bear Lake, the Big Bear Area Regional Wastewater Authority, the State of California Department of Transportation (Caltrans), the US Forest Service and the Big Bear Mountain Resorts. Initial TMDL development efforts were focused on nutrients, leading to Regional Board adoption of a nutrient TMDL for dry hydrological conditions for Big Bear Lake in 2006. Nutrient TMDLs for wet and/or average hydrological conditions will be incorporated in the Basin Plan when these TMDLs are developed in the future. As shown in Table 5-9a-f, the development of these TMDLs is a requirement of the adopted TMDL implementation plan for the nutrient TMDL for dry hydrological conditions.

1. Big Bear Lake Nutrient Total Maximum Daily Loads (TMDLs)

Past studies, starting in 1968/1969, have shown that Big Bear Lake is moderately eutrophic and that the limiting nutrient is generally phosphorus. In Big Bear Lake, nutrients (nitrogen and phosphorus) are available in the water column and sediment and

are taken up by aquatic macrophytes and algae. Nutrients are also bound in living and dead organic material, primarily macrophytes and algae. Decomposition of this organic material, as well as macrophyte and algal respiration, consumes dissolved oxygen,

resulting in the depletion of dissolved oxygen from the water column. Oxygen depletion in the hypolimnion results in anoxic conditions, leading to periodic fish kills in Big Bear Lake. Oxygen depletion also results in the release of nutrients from the sediment into the water column, promoting more algae and aquatic macrophyte production. Nutrients released by plant decomposition are cycled back into a bioavailable form.

Although aquatic macrophytes provide protection from shoreline erosion, habitat for fish and other aquatic biota and waterfowl habitat, excessive growth of noxious and nuisance species, particularly Eurasian watermilfoil (*Myriophyllum spicatum*) impairs recreational uses of the Lake and reduces plant and animal species and habitat diversity.

As stated above, development of nutrient TMDLs to address these problems was initiated in 2000. In this process, it was recognized that insufficient data for wet or average hydrological conditions were available to allow calibration of the lake water quality model used to calculate the TMDL. Accordingly, a TMDL was developed to address dry hydrologic conditions only (see Section 1.B., below). This TMDL was adopted by the Regional Board in 2006 and became effective on August 21, 2007. The implementation plan included with this TMDL specifies a requirement for the development of nutrient TMDLs for wet and/or average hydrological conditions.

A key step in the development of the nutrient TMDL was the identification of the numeric targets to be achieved. The numeric targets, identified in Section 1.A., below, do not vary based upon hydrological condition. Like the approved TMDL for dry hydrological conditions, the TMDLs for wet and/or average hydrological conditions that will be developed are expected to assure also that these numeric targets are achieved. Indeed, since the TMDL for dry hydrological conditions was developed to meet the targets under the critical, worst-case conditions, consistent compliance with these targets is expected to be achieved even in the absence of TMDLs for wet/average hydrological conditions, given the greater lake volume and dilution anticipated under wetter conditions. It is recognized that future modifications to the targets may be found necessary.

1. A. Numeric Targets

As shown in Table 5-9a-c, both “causal and response” numeric targets are specified for Big Bear Lake. The causal target is for phosphorus. Phosphorus is the primary

limiting nutrient in Big Bear Lake⁵ Response targets include macrophyte coverage, percentage of nuisance aquatic vascular plant species and chlorophyll a concentration. These response targets are more direct indicators of impairment and are specified to assess and track water quality improvements in Big Bear Lake

A weight of evidence approach will be used to assess compliance with the TMDL, which means that data pertaining to all the numeric targets will be evaluated and non-compliance with one target will not automatically imply non-compliance with the TMDL.

**Table 5-9a-c
Big Bear Lake Nutrient TMDL Numeric Targets^a**

Indicator	Target Value
Total P concentration	Annual average ^b no greater than 35 µg/L; to be attained no later than 2015 (dry hydrological conditions), 2020 (all other times) ^c
Macrophyte Coverage	30-40% on a total lake area basis; to be attained by 2015 (dry hydrological conditions), 2020 (all other times) ^{c, d}
Percentage of Nuisance Aquatic Vascular Plant Species	95% eradication on a total area basis of Eurasian Watermilfoil and any other invasive aquatic plant species; to be attained no later than 2015 (dry hydrological conditions), 2020 (all other times) ^{c, d}
Chlorophyll a concentration	Growing season ^e average no greater than 14 µg/L; to be attained no later than 2015 (dry hydrological conditions), 2020 (all other times) ^c

^a Compliance with the targets to be achieved as soon as possible, but no later than the date specified

^b Annual average determined by the following methodology: the nutrient data from both the photic composite and discrete bottom samples are averaged by station number and month; a calendar year average is obtained for each sampling location by averaging the average of each month; and finally, the separate annual averages for each location are averaged to determine the lake-wide average. The open-water sampling locations used to determine the annual average are MWDL1, MWDL2, MWDL6, and MWDL9 (see 1.B.4. Implementation, Task 4.2, Table 5-9a-i).

^c Compliance date for wet and/or average hydrological conditions may change in response to approved TMDLs for wet/average hydrological conditions.

^d Calculated as a 5-yr running average based on measurements taken at peak macrophyte growth as determined in the Aquatic Plant Management Plan (see 1.B.4. Implementation, Task 6C)

¹There is evidence that nitrogen is a limiting nutrient under certain conditions. However, given data and analytical limitations, no nitrogen targets are specified. Nitrogen monitoring is required as part of this TMDL. The data will be used to specify nitrogen targets in the future, as warranted.

^e Growing season is the period from May 1 through October 31 of each year. The open-water sampling locations used to determine the growing season average are MWDL1, MWDL2, MWDL6 and MWDL9 (see 1.B.4. Implementation, Task 4.2, Table 5-9a-i). The chlorophyll *a* data from the photic samples are averaged by station number and month; a growing season average is obtained for each sampling location by averaging the average of each month; and finally, the separate growing season averages for each location are averaged to determine the lake-wide average.

1.B. Big Bear Lake Nutrient Total Maximum Daily Load (TMDL) for Dry Hydrological Conditions

The TMDL technical report [Ref. #26] describes in detail the technical basis for the TMDL for Dry Hydrological Conditions that follow.

1. B. 1. Nutrient TMDL, WLAs and LAs and Compliance Dates – Dry Hydrological Conditions

A TMDL, and the WLAs and LAs necessary to achieve it, are established for total phosphorus for dry hydrological conditions only. As stated above, phosphorus and nitrogen are the nutrients that cause beneficial use impairment in Big Bear Lake. Dry hydrological conditions are defined by the conditions observed from 1999-2003; that is, average tributary inflow to Big Bear Lake ranging from 0 to 3,049 AF, average lake levels ranging from 6671 to 6735 feet and annual precipitation ranging from 0 to 23 inches. TMDLs, WLAs and LAs for wet and/or average hydrological conditions will be established as part of the TMDL Phase 2 activities once additional data have been collected (see 1.B.4. TMDL Implementation, Task 9).

The phosphorus TMDL for Big Bear Lake for dry hydrological conditions is shown in Table 5-9a-d. Wasteload allocations for point source discharges and load allocations for nonpoint source discharges are shown in Table 5-9a-e.

Table 5-9a-d

Big Bear Lake Nutrient TMDL for Dry Hydrological Conditions

	Total Phosphorus (lbs/yr)^b
TMDL ^a	26,012

^a Compliance to be achieved as soon as possible, but no later than December 31, 2015.

^b Specified as an annual average for dry hydrological conditions only.

Table 5-9a-e

**Big Bear Lake
Phosphorus Wasteload and Load Allocations for Dry Hydrological Conditions**

Big Bear Lake Nutrient TMDL for Dry Hydrological Conditions	Total Phosphorus Load Allocation (lbs/yr)^{a, b}
TMDL	26,012
WLA	475
Urban	475
LA	25,537
Internal Sediment	8,555
Internal macrophyte	15,700
Atmospheric Deposition	1,074
Forest	175
Resort	33

^a Allocation compliance to be achieved as soon as possible, but no later than December 31, 2015.

^b Specified as an annual average for dry hydrological conditions only.

1.B.2. Margin of Safety

The Big Bear Lake Nutrient TMDL for Dry Hydrological Conditions includes an implicit margin of safety (MOS) as follows:

1. The derivation of numeric targets based on the 25th percentile of nutrient data;
2. The use of conservative assumptions in modeling the response of Big Bear Lake to nutrient loads.

1. B.3. Seasonal Variations/Critical Conditions

The critical condition for attainment of aquatic life and recreational uses in Big Bear Lake occurs during the summer and during dry years, when nutrient releases from the sediment are greatest and water column concentrations increase. Macrophyte biomass peaks in the summer/early fall. Recreational uses of the lake are also highest during the summer. This nutrient TMDL for Big Bear Lake is focused on the critical dry hydrological conditions and, in particular, on the control of the internal sediment loads that dominate during these periods. This is the first phase of TMDLs needed to address eutrophication in Big Bear Lake. The next phase will include collection of data needed to refine the in-lake and watershed models (see

1.B.4. TMDL Implementation, Task 6A) and to develop TMDLs that address other hydrological conditions (see 1.B.4. TMDL Implementation, Task 9). TMDLs for wet and average hydrological conditions will be developed to address external loading that contributes to the nutrient reservoir in the lake and thus eutrophic conditions, particularly during the critical dry periods. However, it is important to note again that since the TMDL for dry hydrological conditions was developed to meet the numeric targets under the critical, worst-case conditions, consistent compliance with these targets is expected to be achieved even in the absence of TMDLs for wet/average hydrological conditions, given the greater lake volume and dilution anticipated under wetter conditions.

The TMDL recognizes that different nutrient inflow and cycling processes dominate the lake during different seasons. These processes were simulated in the in-lake model using data collected during all seasons over a multi-year period. Thus, the model results reflect all seasonal variations. The phosphorus numeric target is expressed as an annual average, while the chlorophyll *a* numeric target is expressed as a growing season average. The intent is to set targets that will, when achieved, result in improvement of the trophic status of Big Bear Lake year-round.

Compliance with numeric targets will ensure water quality improvements that prevent excessive algae blooms and fish kills, particularly during the critical summer period when these problems are most likely to occur.

1.B.4. TMDL Implementation

Table 5-9a-f outlines the tasks and schedules to implement the TMDL for Dry Hydrological Conditions. Each of these tasks is described below.

Table 5-9a-f

**Big Bear Lake Nutrient TMDL Implementation
Plan/Schedule Report Due Dates**

Task	Description	Compliance Date-As soon As Possible but No Later Than
TMDL Phase 1		
Task 1	Establish New Waste Discharge Requirements for Nutrient Sources	February 29, 2008
Task 2	Establish New Waste Discharge Requirements for Lake Restoration Activities	February 28, 2009
Task 3	Revise Existing Waste Discharge Requirements	February 29, 2008
Task 4	Nutrient Water Quality Monitoring Program 4.1 Watershed-wide Nutrient Monitoring Plan(s) 4.2 Big Bear Lake Nutrient Monitoring Plan(s)	Plan/schedule due November 30, 2007. Annual reports due February 15
Task 5	Atmospheric Deposition Determination	Plan/schedule due August 31, 2008
Task 6	Big Bear Lake – Lake Management Plan, including: 6A. Big Bear Lake and Watershed Model Updates 6B. Big Bear Lake In-Lake Sediment Nutrient Reduction Plan 6C. Big Bear Lake Aquatic Plant Management Plan	Plan/schedule due August 31, 2008. Annual reports due February 15
TMDL Phase 2		
Task 7	Review/Revision of Big Bear Lake Water Quality Standards 7.1 Review/Revise Nutrient Water Quality Objectives 7.2 Development of biocriteria 7.3 Development of natural background definition	December 31, 2015
Task 8	Review Big Bear Lake Tributary Data	December 31, 2008
Task 9	Develop TMDLs, WLAs and LAs for wet and/or average hydrological conditions	December 31, 2012
Task 10	Review of TMDL/WLAs/LAs	Once every 3 years

Task 1: Establish New Waste Discharge Requirements for Nutrient Sources

On or before February 29, 2008, the Regional Board shall issue the following new waste discharge requirements

1.1 Waste Discharge Requirements (WDRs) or Conditional Waiver of WDRs to the US Forest Service to incorporate the nutrient load allocations, compliance schedule and monitoring and reporting requirements for Forested Areas.

Other nutrient discharges will be addressed and permitted as appropriate.

Task 2: Establish New Waste Discharge Requirements for Lake Restoration Activities

On or before February 28, 2009, the Regional Board shall issue the following new waste discharge requirements:

NPDES Permit to the US Forest Service, the State of California, Department of Transportation (Caltrans), the County of San Bernardino, San Bernardino County Flood Control District, the City of Big Bear Lake, and Big Bear Mountain Resorts for Lake restoration activities, including, but not limited to alum treatment and/or herbicide treatment. Requirements specified in these Waste Discharge Requirements, shall be developed using the Aquatic Plant Management Plan and Schedule submitted pursuant to Task 6C.

Task 3: Review and/or Revise Existing Waste Discharge Requirements

Waste Discharge Requirements (WDRs) have been issued by the Regional Board regulating discharge of various types of wastes in the Big Bear Lake watershed. On or before February 29, 2008, these WDRs shall be reviewed and revised as necessary to incorporate the nutrient wasteload allocations, compliance schedule and TMDL monitoring and reporting requirements.

3.1 Waste Discharge Requirements for the San Bernardino County Flood Control and Transportation District, the County of San Bernardino and the Incorporated Cities of San Bernardino County within the Santa Ana Region, Areawide Urban Runoff, NPDES No. CAS 618036 (Regional Board Order No. R8-2002-0012). The current Order has provisions to address TMDL issues. In light of these provisions, revision of the Order may not be necessary to address TMDL requirements.

3.2 State of California, Department of Transportation (Caltrans) Stormwater Permit

Provision E.1 of Order No. 99-06-DWQ requires Caltrans to maintain and implement a Storm Water Management Plan (SWMP). Annual updates of the SWMP needed to

maintain an effective program are required to be submitted to the State Water Resources Control Board.

Provision E.2 of Order No. 99-06-DWQ requires Caltrans to submit a Regional Workplan by April 1 of each year for the Executive Officer's approval. As part of the annual update of the SWMP and Regional Workplan, Caltrans shall submit plans and schedules for conducting the monitoring and reporting requirements specified in Task 4 and the special studies required in Task 6.

Task 4: Monitoring

4.1 Watershed-wide Nutrient Water Quality Monitoring Program

No later than November 30, 2007, the US Forest Service, the State of California, Department of Transportation (Caltrans), the County of San Bernardino, San Bernardino County Flood Control District, the City of Big Bear Lake and Big Bear Mountain Resorts shall, as a group, submit to the Regional Board for approval a proposed watershed-wide nutrient monitoring program that will provide data necessary to review and update the Big Bear Lake Nutrient TMDL, to determine specific sources of nutrients and to develop TMDLs for other hydrological conditions. Data to be collected and analyzed shall address, at a minimum, determination of compliance with the phosphorus dry condition TMDL, including the WLAs and LAs, and with the existing total inorganic nitrogen (TIN) objective.

At a minimum, the proposed plan shall include the collection of samples at the stations specified in Table 5-9a-g and shown in Figure 5-7, at the frequency specified in Table 5-9a-h. Modifications to the required sampling stations, sampling frequencies and constituents to be monitored (see below) will be considered upon request by the stakeholders, accompanied by a report that describes the rationale for the proposed changes and identifies recommended alternatives. In addition to water quality samples, every two weeks on a year-round basis, visual monitoring (including documenting flow type and stage) determinations shall be made at all stations shown in Table 5-9a-g. Flow measurements will be required each time water quality samples are obtained.

At a minimum, samples shall be analyzed for the following constituents:

- Total nitrogen
- Nitrate + nitrite nitrogen
- Total phosphorus
- Total dissolved phosphorus
- Suspended sediment concentration
- Chlorophyll *a*
- Dissolved oxygen
- Alkalinity
- Bedload concentration
- Total nitrogen in sediment
- Ammonia nitrogen
- Total dissolved nitrogen
- Ortho-phosphate (SRP)
- Temperature
- Turbidity
- pH
- Conductivity
- Hardness
- Grain size
- Total phosphorus in sediment

Note: Chlorophyll *a* to be collected and analyzed only from May 1- October 31 of each year at the frequencies described in Table 5-9a-h; chlorophyll *a* sampling not required at Bear Creek outlet.

In addition, the proposed plan shall include a proposed plan and schedule for development of a Big Bear Lake Sedimentation Processes Plan for the determination of nutrient loads associated with sediment. At a minimum, the proposed plan shall include the placement of sediment traps at the mouths of Rathbun, Knickerbocker, Grout and Boulder Creeks to determine the rate of influx of sediment and particulate nutrients to Big Bear Lake, as specified in Table 5-9a-g and shown in Figure 5-7, at the specified frequency indicated in Table 5-9a-h. Modifications to the required sampling stations, sampling frequencies and constituents to be monitored will be considered upon request by the stakeholders, accompanied by a report that describes the rationale for the proposed changes and identifies recommended alternatives. The proposed monitoring plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report summarizing the data collected for the year and evaluating compliance with the TMDL/WLAs/LAs shall be submitted by February 15 of each year.

In lieu of this coordinated monitoring plan, one or more of the parties identified above may submit a proposed individual or group monitoring plan for Regional Board approval. Any such individual or group monitoring plan is due no later than November 30, 2007 and shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report of data collected pursuant to approved individual/group plan(s) shall be submitted by February 15 of each year. The report shall summarize the data and evaluate compliance with the TMDL/WLAs/LAs.

**Table 5-9a-g
Big Bear Lake Watershed
Minimum Required Sampling Station Locations**

Station Number	Station Description
MWDC2	Bear Creek Outlet
MWDC3	Grout Creek at Hwy 38
MWDC4	Rathbun Creek at Sandalwood Ave.
MWDC5	Summit Creek at Swan Dr.
MWDC6	Rathbun Creek below the Zoo
MWDC8	Knickerbocker Creek at Hwy 18
MWDC13	Boulder Creek at Hwy 18

Note: Bear Creek outlet to be sampled monthly from March – November. At a minimum, samples shall be analyzed at the frequencies specified in Table 5-9a-h:


**Table 5-9a-h
Big Bear Lake Watershed
Sampling Frequency**

Flow type	Months monitoring is required	Frequency
Baseflow	January 1 – December 31	Once/month when baseflow is present;
Snowmelt	January 1 – May 31 ¹	Varied -See note 2 below
Storm events	January 1 – December 31	3 storms per year ³

¹ Sampling to begin after the first substantial snowfall resulting in an accumulation of 1.0 inch or more of snow

² Samples to be collected daily for the first three days of the snowmelt period. If ambient air temperatures remain above freezing after three days have passed, snowmelt sampling will then be performed once a week for the following three weeks or until the snowmelt period ceases. Snowmelt cessation will be determined by one of the following: a) ambient air temperatures drop below freezing during most of the day; or b) a storm/rain precipitation event occurs after the snowmelt event was initiated. Beginning March 15th of each year, snowmelt flows will most likely be continuous since ambient air temperatures will usually remain above freezing. From March 15th through May 31 of each year, snowmelt sampling events will be conducted daily for the first two days of a snowmelt event and then once a week thereafter until the spring runoff period has ended or the tributary station location shows no signs of daily flows for one week. Flow status will be evaluated in the afternoon, when ambient air temperatures are highest and flow potential is greatest.

³ Two storm events to be sampled during October – March; 1 storm event to be sampled during April – September. For each storm event, eight samples across the hydrograph are to be

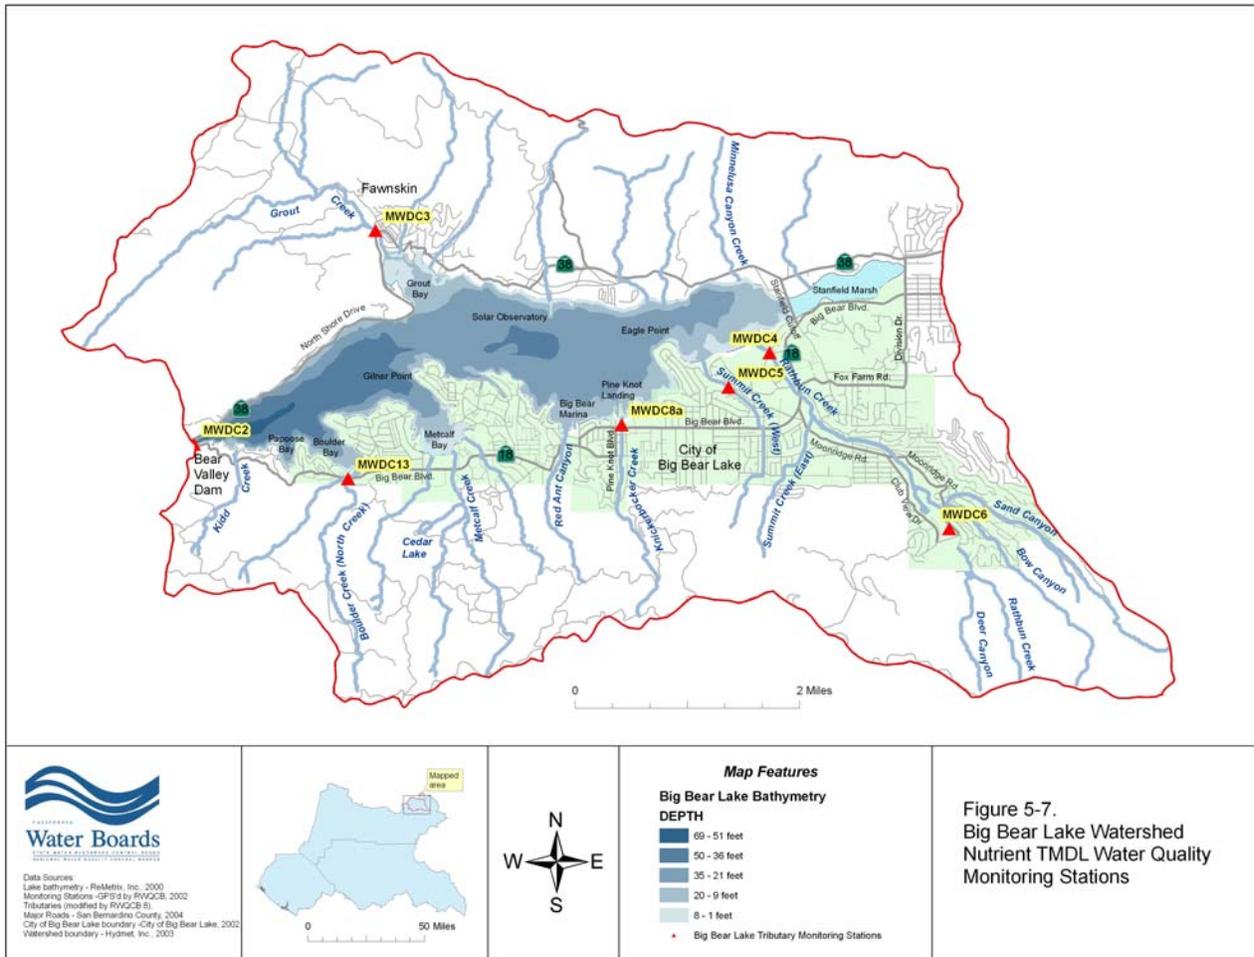

collected.

Figure 5-7 – Big Bear Lake Watershed Nutrient TMDL Water Quality Stations

4.2 Big Bear Lake: In-Lake Nutrient Monitoring Program

No later than November 30, 2007, the US Forest Service, the State of California, Department of Transportation (Caltrans), the County of San Bernardino, San Bernardino County Flood Control District, the City of Big Bear Lake, and Big Bear Mountain Resorts shall, as a group, submit to the Regional Board for approval a proposed Big Bear Lake nutrient monitoring program that will provide data necessary to review and update the Big Bear Lake Nutrient TMDL, and to develop TMDLs for other hydrological conditions. Data to be collected and analyzed shall address, at a minimum: (1) determination of compliance with phosphorus and chlorophyll a numeric targets; (2) determination of

compliance with the existing total inorganic nitrogen (TIN) objective; and (3) refinement of the in-lake model for the purposes of TMDL review and development.

At a minimum, the proposed plan shall include the collection of samples at the stations specified in Table 5-9a-i and shown in Figure 5-8, at the specified frequency indicated in Table 5-9a-i. Modifications to the required sampling stations, sampling frequencies and constituents to be monitored (see below) will be considered upon request by the stakeholders, accompanied by a report that describes the rationale for the proposed changes and identifies recommended alternatives. With the exception of hardness, alkalinity, total organic carbon (TOC), dissolved organic carbon (DOC), and chlorophyll *a*, each sample to be analyzed shall be collected as a photic zone composite (from the surface to 2 times the secchi depth) and as a bottom discrete (0.5 meters off the surface bottom) sample. Hardness, alkalinity, TOC, DOC, and chlorophyll *a* shall be collected as photic zone composites. Dissolved oxygen, water temperature, turbidity, specific conductance, and pH shall be measured at 1-meter intervals from the surface to 0.5 meters from the bottom using a multi-parameter water quality meter. Water clarity shall be measured with a secchi disk.

At a minimum, in-lake samples must be analyzed for the following constituents:

- Specific conductance
- Water temperature
- Chlorophyll *a*
- Total nitrogen
- Nitrate +nitrite nitrogen
- Total phosphorus
- Total hardness
- Total dissolved phosphorus
- Dissolved organic carbon(DOC)
- Total dissolved nitrogen
- Dissolved oxygen
- Water clarity (secchi depth)
- Ammonia nitrogen
- Alkalinity
- Turbidity
- Ortho-phosphate (SRP)
- Total suspended solids (TSS)
- pH
- Total dissolved solids (TDS)
- Total organic carbon (TOC)

The monitoring plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report summarizing the data collected for the year and evaluating compliance with the TMDL/WLAs/LAs and numeric targets shall be submitted by February 15 of each year.

**Table 5-9a-i
Big Bear Lake Required Sampling Station Locations**

Station Number	Station Description
MWDL1	Big Bear Lake – Dam
MWDL2	Big Bear Lake – Gilner Point
MWDL6	Big Bear Lake – Mid Lake Middle
MWDL9	Big Bear Lake – Stanfield Middle

Frequency of sampling at all stations: for all constituents except TOC and DOC, monthly from March – November; bi-weekly (i.e., every other week) from June 1 through October 31. TOC and DOC to be monitored four times per year (quarterly) from January through December.

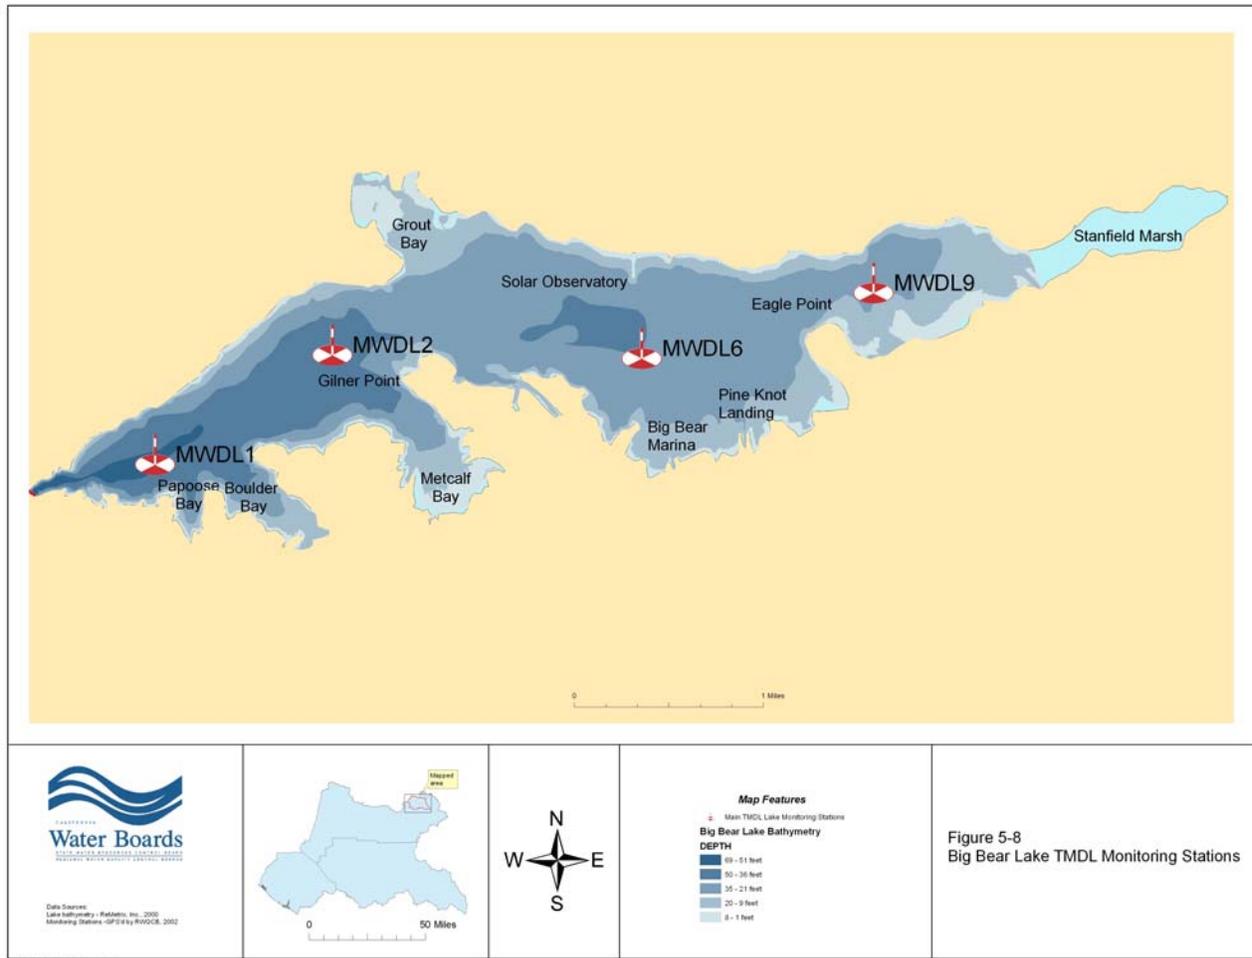


Figure 5-8 Big Bear Lake TMDL Monitoring Stations

In lieu of this coordinated monitoring plan, one or more of the parties identified above may submit a proposed individual or group monitoring plan for Regional Board approval. Any such individual or group monitoring plan is due no later than November 30, 2007 and shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report of data collected pursuant to approved individual/group plan(s), shall be submitted by February 15 of each year. The report shall summarize the data and evaluate compliance with the TMDL/WLAs/LAs and numeric targets.

Task 5: Atmospheric Deposition Determination

No later than August 31, 2008, the Regional Board, in coordination with local stakeholders, the South Coast Air Quality Management District and the California Air Resources Board, shall develop a plan and schedule for quantifying atmospheric deposition of nutrients in the Big Bear Lake watershed.

Task 6: Big Bear Lake-Lake Management Plan

No later than August 31, 2008, the US Forest Service, the State of California, Department of Transportation (Caltrans), the County of San Bernardino, San Bernardino County Flood Control District, the City of Big Bear Lake, and Big Bear Mountain Resorts, shall, as a group, submit to the Regional Board for approval a proposed Lake Management Plan for Big Bear Lake. The purpose of the plan is to identify a coordinated and comprehensive strategy for management of the lake and surrounding watershed to address restoration and protection of the lake's beneficial uses. The plan shall include the following:

- A) A proposed plan and schedule for updating the existing Big Bear Lake watershed nutrient model and the Big Bear Lake in-lake nutrient model. The plan and schedule must take into consideration additional data and information that are or will be generated from the required TMDL monitoring programs (Tasks 4.1 and 4.2, above).
- B) A proposed plan and schedule for in-lake sediment nutrient reduction for Big Bear Lake. The proposed plan shall include an evaluation of the applicability of various in-lake treatment technologies to support development of a long-term strategy for control of nutrients from the sediment. The submittal shall also contain a proposed sediment nutrient monitoring program to evaluate the effectiveness of any strategies implemented.
- C) The proposed plan shall include an evaluation of the applicability of various in-lake treatment technologies to control noxious and nuisance aquatic plants. The plan shall also include a description of the monitoring conducted and proposed to track aquatic plant diversity, coverage, and biomass. Data to be collected and analyzed shall address, at a minimum, determination of compliance with the numeric targets for macrophyte coverage and percentage of nuisance aquatic vascular plant species (see 1.A., above).

In addition, at a minimum, the proposed plan shall also address the following:

- The plan shall be based on identified and acceptable goals for lake capacity, biological resources and recreational opportunities. Acceptable goals shall be identified in coordination with the Regional Board and other responsible agencies, including the California Department of Fish and Game and the U.S. Fish and Wildlife Service.
- The plan shall include a proposed plan and schedule for the development of biocriteria for Big Bear Lake. (This is intended to complement Regional Board efforts to develop biocriteria and to signal the parties' commitment to participate substantively.)
- The plan must identify a scientifically defensible methodology for measuring changes in the capacity of the lake.

- The proposed plan shall identify recommended short and long-term strategies for control and management of sediment and dissolved and particulate nutrient inputs to the lake.
- The plan shall also integrate the beneficial use survey information required to be developed pursuant to the Regional Board's March 3, 2005, Clean Water Act Section 401 Water Quality Standards Certification for Big Bear Lake Nutrient/Sediment Remediation Project, City of Big Bear Lake, County of San Bernardino, California. The purpose of the beneficial use survey is to correlate beneficial uses of the lake with lake bottom contours. The survey is required to be conducted throughout the lake. The survey will determine the location and the quality of beneficial uses of the lake and the contours of the lake bottom where these uses occur. The survey is expected to be used in regulating future lake dredge projects to maximize the restoration and protection of the lake's beneficial uses.

The Big Bear Lake – Lake Management Plan shall be implemented upon Regional Board approval at a duly noticed public meeting. Once approved, the plan shall be reviewed and revised as necessary at least once every three years. The review and revision shall take into account assessments of the efficacy of control/management strategies implemented and relevant requirements of new or revised TMDLs for Big Bear Lake and its watershed. An annual report summarizing the data collected for the year and evaluating compliance with the TMDL/WLAs/LAs and numeric targets shall be submitted by February 15 of each year.

In lieu of this coordinated plan, one or more of the parties identified above may submit a proposed individual or group Big Bear Lake – Lake Management Plan and schedule for approval by the Regional Board. Any such individual or group plan must conform to the requirements specified above and is due no later than August 31, 2008. An individual or group plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report summarizing the data collected for the year and evaluating compliance with the TMDL/WLAs/LAs and numeric targets shall be submitted by February 15 of each year.

Task 7: Review and Revision of Big Bear Lake Water Quality Standards

By December 31, 2015, the Regional Board shall:

- 7.1 Review/revise as necessary the total inorganic nitrogen and total phosphorus numeric water quality objectives for Big Bear Lake. The Regional Board shall also consider the development of narrative or numeric objectives for other indicators of impairment (e.g., chlorophyll *a*, macrophyte coverage and species composition), in lieu of or in addition to review/revision of the numeric objectives for phosphorus and nitrogen.
- 7.2 Develop biocriteria for Big Bear Lake.

- 7.3 Develop a definition for natural background sources of nutrients (and other constituents) to Big Bear Lake and its tributaries.

Given budgetary constraints, completion of these tasks are likely to require substantive contributions from interested parties.

Task 8: Review of Big Bear Lake Tributary Data

No later than December 2008, the Regional Board shall review data collected on Rathbun Creek, Summit Creek and Grout Creek to determine whether beneficial uses of these tributaries are impaired by nutrients. If the Creeks are found to be impaired by nutrients, the Regional Board shall develop a TMDL development project plan and schedule. If these tributaries are found not to be impaired by nutrients, Regional Board shall schedule the delisting of the tributaries from the 303(d) list of impaired waters at the earliest opportunity.

Task 9: Development of TMDLs for Wet and/or Average Hydrological Conditions

No later than December 31, 2012, the Regional Board shall utilize additional water quality data and information collected pursuant to monitoring program requirements (Tasks 4 and 5) and model updates (Task 6A) to develop proposed nutrient TMDLs for Big Bear Lake for wet and/or average hydrological conditions. Completion of this task is contingent on the collection of requisite data for wet and/or average hydrological conditions.

Task 10: Review/Revision of the Big Bear Lake Nutrient TMDL for Dry Hydrological Conditions (TMDL “Re-opener”)

The basis for the TMDL for Dry Hydrological Conditions, the implementation plan and schedule will be re-evaluated at least once every three years² to determine the need for modifying the allocations, numeric targets and TMDL. Regional Board staff will continue to review all data and information generated pursuant to the TMDL requirements on an ongoing basis. Based on results generated through the monitoring programs, special studies and/or modeling analyses, changes to the TMDL may be warranted. Such changes will be considered through the Basin Plan Amendment process.

The Regional Board is committed to the review of this TMDL every three years, or more frequently if warranted by these or other studies.

(End of Amendment adopted under Resolution No. R8-2004-0023)

² The three-year schedule is tied to the 3 year triennial review schedule.

Lake Elsinore/San Jacinto River Watershed (The following was added under Resolution No. R8-2004-0037)

The Lake Elsinore/San Jacinto River Watershed is located in Riverside County and includes the following major waterbodies: Lake Hemet, San Jacinto River, Salt Creek, Canyon Lake and Lake Elsinore. The total drainage area of the San Jacinto River watershed is approximately 782 square miles. Over 90 percent of the watershed (735 square miles) drains into Canyon Lake. Lake Elsinore is the terminus of the San Jacinto River watershed. The local tributary area to Lake Elsinore, consisting of drainage from the Santa Ana Mountains and the City of Lake Elsinore, is 47 square miles.

Land use in the watershed includes open/forested, agricultural (including concentrated animal feeding operations such as dairies and chicken ranches, and irrigated cropland), and urban uses, including residential, industrial and commercial. Vacant/open space is being converted to residential uses as the population in the area expands. The municipalities in the watershed include the cities of San Jacinto, Hemet, Perris, Canyon Lake, Lake Elsinore and portions of Moreno Valley and Beaumont.

1. Lake Elsinore and Canyon Lake Nutrient Total Maximum Daily Load (TMDL)

Lake Elsinore and Canyon Lake are not attaining water quality standards due to excessive nutrients (nitrogen and phosphorus). Reports prepared by Regional Board staff describe the impact nutrient discharges have on the beneficial uses of Lake Elsinore and Canyon Lake [Ref. #27,28] Lake Elsinore was formed in a geologically active graben area and has been in existence for thousands of years. Due to the mediterranean climate and watershed hydrology, fluctuations in the level of Lake Elsinore have been extreme, with alternate periods of a dry lake bed and extreme flooding. These drought/flood cycles have a great impact on lake water quality. Fish kills and excessive algae blooms have been reported in Lake Elsinore since the early 20th century. As a result, in 1994, the Regional Board placed Lake Elsinore on the 303(d) list of impaired waters due to excessive levels of nutrients and organic enrichment/low dissolved oxygen.

Canyon Lake, located approximately 5 miles upstream of Lake Elsinore, was formed by the construction of Railroad Canyon Dam in 1928. Approximately 735 square miles of the 782 square mile San Jacinto River watershed drain to Canyon Lake. During most years, runoff from the watershed terminates at Canyon Lake without reaching Lake Elsinore, resulting in the buildup of nutrients in Canyon Lake. While Canyon Lake does not have as severe an eutrophication problem as Lake Elsinore, there have been periods of algal blooms and anecdotal reports of occasional fish kills. Accordingly, in 1998, the Regional Board added Canyon Lake to the 303(d) list of impaired waters due to excessive levels of nutrients.

A TMDL technical report prepared by Regional Board staff describes the nutrient related problems in Canyon Lake and Lake Elsinore in greater detail and discusses the technical basis for the TMDLs that follow [Ref. # 29].

A. Lake Elsinore and Canyon Lake Nutrient TMDL Numeric Targets

Numeric targets for Lake Elsinore and Canyon Lake are based on reference conditions when beneficial uses in the lakes were not significantly impacted by nutrients. Table 5-9n shows both “causal” and “response” interim and final numeric targets for both lakes. Causal targets are those for phosphorus and nitrogen. Phosphorus and nitrogen are the primary limiting nutrients in Lake Elsinore and Canyon Lake, respectively. However, under certain conditions, nitrogen may be limiting in Lake Elsinore and phosphorus may be limiting in Canyon Lake. Targets for both nutrients are therefore necessary. Reduction in nitrogen inputs will be necessary over the long-term and only final targets are specified. Response targets include chlorophyll *a* and dissolved oxygen. These targets are specified to assess water quality improvements in the lakes. Finally, ammonia targets are specified to prevent un-ionized ammonia toxicity to aquatic life.

Table 5-9n

Lake Elsinore and Canyon Lake Nutrient TMDL Numeric Targets*

Indicator	Lake Elsinore	Canyon Lake
Total P concentration (Final)	Annual average no greater than 0.1 mg/L; to be attained no later than 2020	Annual average no greater than 0.1 mg/L; to be attained no later than 2020
Total N concentration (Final)	Annual average no greater than 0.75 mg/L; to be attained no later than 2020	Annual average no greater than 0.75 mg/L; to be attained no later than 2020
Ammonia nitrogen concentration (Final) [Ref. #4]	<p>Calculated concentrations to be attained no later than 2020</p> <p>Acute: 1-hour average concentration of total ammonia nitrogen (mg/L) not to exceed, more than once every three years on the average, the CMC (acute criteria), where $CMC = 0.411/(1+10^{7.204-pH}) + 58.4/(1+10^{pH-7.204})$</p> <p>Chronic: thirty-day average concentration of total ammonia nitrogen (mg/L) not to exceed, more than once every three years on the average, the CCC (chronic criteria) $CCC = (0.0577/(1+10^{7.688-pH}) + 2.487/(1+10^{pH-7.688})) * \min(2.85, 1.45*10^{0.028(25-T)})$</p>	<p>Calculated concentrations to be attained no later than 2020</p> <p>Acute: 1-hour average concentration of total ammonia nitrogen (mg/L) not to exceed, more than once every three years on the average, the CMC (acute criteria), where $CMC = 0.411/(1+10^{7.204-pH}) + 58.4/(1+10^{pH-7.204})$</p> <p>Chronic: thirty-day average concentration of total ammonia nitrogen (mg/L) not to exceed, more than once every three years on the average, the CCC (chronic criteria) $CCC = (0.0577/(1+10^{7.688-pH}) + 2.487/(1+10^{pH-7.688})) * \min(2.85, 1.45*10^{0.028(25-T)})$</p>
Chlorophyll a concentration (Interim)	Summer average no greater than 40 ug/L; to be attained no later than 2015	Annual average no greater than 40 ug/L; to be attained no later than 2015
Chlorophyll a concentration (Final)	Summer average no greater than 25 ug/L; to be attained no later than 2020	Annual average no greater than 25 ug/L; to be attained no later than 2020
Dissolved oxygen concentration (Interim)	Depth average no less than 5 mg/L; to be attained no later than 2015	Minimum of 5 mg/L above thermocline; to be attained no later than 2015
Dissolved oxygen concentration (Final)	No less than 5 mg/L 1 meter above lake bottom; to be attained no later than 2020	Daily average in hypolimnion no less than 5 mg/L; to be attained no later than 2020.

* compliance with targets to be achieved as soon as possible, but no later than the date specified

B. Lake Elsinore and Canyon Lake Nutrient TMDLs, Wasteload Allocations, Load Allocations and Compliance Dates

As discussed in the technical TMDL report, nutrient loading to Canyon Lake and Lake Elsinore varies depending on the hydrologic conditions that occur in the San Jacinto watershed. As part of the TMDL analysis and development, three hydrologic scenarios and the relative frequency of each of these conditions (based upon an 87 year record of flow data at the USGS Gauging station downstream of Canyon Lake), were identified as shown in Table 5-9o. The resulting TMDLs, wasteload allocations and load allocations are based on 10-year running flow weighted average nutrient loads, taking into account the frequency of the three hydrologic conditions and the nutrient loads associated with each of them. Phosphorus and nitrogen TMDLs for Canyon Lake and Lake Elsinore are shown in Table 5-9p. The TMDLs, expressed as 10-year running averages, will implement the numeric targets and thereby attain water quality standards. Phosphorus and nitrogen wasteload allocations for point source discharges and load allocations for nonpoint source discharges, also expressed as 10-year running averages, are shown in Tables 5-9q and 5-9r. No TMDLs, wasteload allocations or load allocations are specified for chlorophyll a, dissolved oxygen or ammonia. Chlorophyll a and dissolved oxygen targets are intended to serve as measures of the effectiveness of phosphorus and nitrogen reductions implemented to meet TMDL requirements. Until ammonia transformations, and nitrogen dynamics in general, are better understood, no ammonia TMDLs, wasteload allocations or load allocations are specified.

**Table 5-9o
San Jacinto River Hydrologic Conditions with Relative Flow Frequency at the USGS Gauging Station Downstream of Canyon Lake (Station No. 1170500)**

Hydrologic Condition	Representative Water Year	Years of Hydrologic Condition	Relative Frequency (%)	Description
Wet	1998	14	16	Both Canyon Lake and Mystic Lake overflow; flow at the USGS gauging station 11070500 17,000 AF or greater
Moderate	1994	36	41	No Mystic Lake overflow; Canyon Lake overflowed; flow at the USGS gauging station 11070500 less than 17,000 AF and greater than 2,485 AF
Dry	2000	37	43	No overflows from Mystic Lake or Canyon Lake; flow at the USGS gauging station 11070500 371 AF or less

Table 5-9p

Nutrient TMDLs and Compliance Dates for Lake Elsinore and Canyon Lake

TMDL	Final Total Phosphorus TMDL (kg/yr)^{a, b}	Final Total Nitrogen TMDL (kg/yr)^{a, b}
Canyon Lake	8,691	37,735
Lake Elsinore	28,584	239,025

^a Final compliance to be achieved as soon as possible, but no later than December 31, 2020.

^b TMDL specified as 10-year running average.

Table 5-9q

**Canyon Lake
Nitrogen and Phosphorus Wasteload and Load Allocations^a**

Canyon Lake Nutrient TMDL	Final Total Phosphorus Load Allocation (kg/yr)^{b, c}	Final Total Nitrogen Load Allocation (kg/yr)^{b, c}
TMDL	8,691	37,735
WLA	486	6,248
Supplemental water	48	366
Urban	306	3,974
CAFO	132	1,908
LA	8,205	31,487
Internal Sediment	4,625	13,549
Atmospheric Deposition	221	1,918
Agriculture	1,183	7,583
Open/Forest	2,037	3,587
Septic systems	139	4,850

^a The TMDL allocations for Canyon Lake apply to those land uses located upstream of Canyon Lake.

^b Final allocation compliance to be achieved as soon as possible, but no later than December 31, 2020.

^c TMDL and allocations specified as 10-year running average.

Table 5-9r

**Lake Elsinore
Nitrogen and Phosphorus Wasteload and Load Allocations^a**

Lake Elsinore Nutrient TMDL	Final Total Phosphorus Load Allocation (kg/yr)^{b, c}	Final Total Nitrogen Load Allocation (kg/yr)^{c, d}
TMDL	28,584	239,025
WLA	3,845	7,791
Supplemental water ^d	3,721	7,442
Urban	124	349
CAFO	0	0
LA	21,969	210,461
Internal Sediment	21,554	197,370
Atmospheric Deposition	108	11,702
Agriculture	60	213
Open/Forest	178	567
Septic systems	69	608
CL Watershed ^e	2,770	20,774

^a The Lake Elsinore TMDL allocations for urban, agriculture open/forest, septic systems and CAFOs only apply to those land uses located downstream of Canyon Lake.

^b Final allocation compliance to be achieved as soon as possible, but no later than December 31, 2020.

^c TMDL and allocations specified as 10-year running average.

^d WLA for supplemental water should met as soon as possible as a 5 year running average.

^e Allocation for Canyon Lake overflows

The TMDL distributes the portions of the waterbody's assimilative capacity to various pollution sources so that the waterbody achieves its water quality standards. The Regional Board supports the trading of pollutant allocations among sources, where appropriate. Trading can take place between point/point, point/nonpoint, and nonpoint/nonpoint pollutant sources. Optimizing alternative point and nonpoint control strategies through allocation tradeoffs may be a cost-effective way to achieve pollution reduction benefits. (See Section E. TMDL Implementation, Task 11, below).

C. Margin of Safety

The Canyon Lake and Lake Elsinore Nutrient TMDLs include an implicit margin of safety (MOS) as follows:

- the derivation of numeric targets based on the 25th percentile of data for Lake Elsinore; Canyon Lake numeric targets to be consistent with the Lake Elsinore targets;
- the use of multiple numeric targets to measure attainment of beneficial uses and thereby assure TMDL efficacy;
- the use of conservative literature values in the absence of site-specific data for source loading rates in the watershed nutrient model;
- the use of conservative assumptions in modeling the response of Lake Elsinore and Canyon Lake to nutrient loads; and
- requiring load reductions to be accomplished during hydrological conditions when model results indicate, in some instances, that theoretical loads could be higher.

D. Seasonal Variations/Critical Conditions

The Canyon Lake and Lake Elsinore Nutrient TMDLs account for seasonal and annual variations in external and internal nutrient loading and associated impacts on beneficial uses by the use of a 10-year running average allocation approach. This 10-year running average approach addresses variation in hydrologic conditions (wet, moderate and dry) that can dramatically affect both nutrient loading and lake response.

Compliance with numeric targets will ensure water quality improvements that prevent excessive algae blooms and fish kills, particularly during the critical summer period when these problems are most likely to occur.

E. TMDL Implementation

Typically, under dry and moderate conditions, the internal nutrient loading drives the nutrient dynamics in both Canyon Lake and Lake Elsinore. However, it is the extreme (albeit infrequent) loading that occurs during wet conditions that provides the nutrients to the lakes that remain in the lakes as internal nutrient sources in subsequent years. Given the complexity of the San Jacinto River watershed hydrology, control of nutrients input to the lakes is needed for all hydrologic conditions. Collection of additional monitoring data is critical to developing long-term solutions for nutrient control. With that in mind, the submittal of plans and schedules to implement the TMDLs should take into consideration the need to develop and implement effective short-term solutions, as well as allow for the development of long-term solutions once additional data have been generated.

Implementation of tasks and schedules as specified in Table 5-9s is expected to achieve compliance with water quality standards. Each of these tasks is described below.

Table 5-9s

**Lake Elsinore and Canyon Lake Nutrient TMDL Implementation
Plan/Schedule Report Due Dates**

Task	Description	Compliance Date-As soon As Possible but No Later Than
TMDL Phase 1		
Task 1	Establish New Waste Discharge Requirements	March 31, 2006
Task 2	Revise Existing Waste Discharge Permits	March 31, 2006
Task 3	Identify Agricultural Operators	October 31, 2005
Task 4	Nutrient Water Quality Monitoring Program 4.1 Watershed-wide Nutrient Monitoring Plan(s) 4.2 Lake Elsinore Nutrient Monitoring Plan(s) 4.3 Canyon Lake Nutrient Monitoring Plan(s)	<ul style="list-style-type: none"> • Initial plan/schedule due December 31, 2005 • Annual reports due August 15 • Revised plan/schedule due December 31, 2006
Task 5	Agricultural Discharges – Nutrient Management Plan	Plan/schedule due September 30, 2007
Task 6	On-site Disposal Systems (Septic Systems) Management Plan	Dependent on State Board approval of relevant regulations (see text).
Task 7	Urban Discharges 7.1 Revision of Drainage Area Management Plan (DAMP) 7.2 Revision of the Water Quality Management Plan (WQMP) 7.3 Update of the Caltrans Stormwater Management Plan and Regional Plan 7.4 Update of US Air Force, March Air Reserve Base SWPPP	Plan/schedule due: 7.1 August 1, 2006 7.2 August 1, 2006 7.3 April 1, 2006 7.4 Dependent on Task 3 results. See text.
Task 8	Forest Area – Review/Revision of Forest Service Management Plans	Plan/schedule due September 30, 2007
Task 9	Lake Elsinore In-Lake Sediment Nutrient Reduction Plan	Plan/schedule due March 31, 2007
Task 10	Canyon Lake In-Lake Sediment Treatment Evaluation	Plan/schedule due March 31, 2007
Task 11	Watershed and Canyon Lake and Lake Elsinore In-Lake Model Updates	Plan/schedule due March 31, 2007
Task 12	Pollutant Trading Plan	Plan/schedule due September 30, 2007
Task 13	Review and Revise Nutrient Water Quality Objectives	December 31, 2009
Task 14	Review of TMDL/WLA/LA	Once every 3 years to coincide with the Regional Board's triennial review

Task 1: Establish New Waste Discharge Requirements

On or before March 31, 2006, the Regional Board shall issue new waste discharge requirements (NPDES permit) to Elsinore Valley Municipal Water District for supplemental water discharges to Canyon Lake that incorporate the appropriate interim and final wasteload allocations, compliance schedule and monitoring program requirements.

Other proposed nutrient discharges will be addressed and permitted as appropriate.

Task 2: Review and/or Revise Existing Waste Discharge Requirements

There are five Waste Discharge Requirements (WDRs) issued by the Regional Board regulating discharge of various types of wastes in the San Jacinto watershed. On or before March 31, 2006, each of these WDRs shall be reviewed and revised as necessary to implement the Lake Elsinore and Canyon Lake Nutrient TMDLs, including the appropriate nitrogen and phosphorus interim and final wasteload allocations, compliance schedules and/or monitoring program requirements.

- 2.1 Waste Discharge Requirements for the Riverside County Flood Control and Water Conservation District, the County of Riverside and the Incorporated Cities of Riverside County within the Santa Ana Region, Areawide Urban Runoff, NPDES No. CAS 618033 (Regional Board Order No. R8-2002-0011). The current Order has provisions to address TMDL issues (see Task 7.1, below). In light of these provisions, revision of the Order may not be necessary to address TMDL requirements.
- 2.2 Watershed-Wide Waste Discharge Requirements for Discharges of Storm Water Runoff Associated with New Developments in the San Jacinto Watershed, Order No. 01-34, NPDES No. CAG 618005. It is expected that this Order will be rescinded once the Regional Board/Executive Officer approves a Water Quality Management WQMP) under Order No. R8-2002-0011 (see 2.1, above and Task 7.2, below)
- 2.3 General Waste Discharge Requirements for Concentrated Animal Feeding Operations (Dairies and Related Facilities) within the Santa Ana Region, NPDES No. CAG018001 (Regional Board Order No. 99-11).
- 2.4 Waste Discharge and Producer/User Reclamation Requirements for the Elsinore Valley Municipal Water District, Regional Water Reclamation Facility Riverside County, Order No. 00-1, NPDES No. CA8000027. Revised permit specifications will take into consideration the Lake Elsinore Recycled Water Pilot Project findings.

- 2.5 Waste Discharge Requirements for Eastern Municipal Water District, Regional Water Reclamation System, Riverside County, Order No. 99-5, NPDES No. CA8000188¹. Revised permit specifications will take into consideration the Lake Elsinore Recycled Water Pilot Project findings.
- 2.6 Waste Discharge Requirements for US Air Force, March Air Reserve Base, Storm Water Runoff, Riverside County, Order No. R8-2004-0033, NPDES CA 00111007

Task 3: Identify Agricultural Operators

On or before October 31, 2005, the Regional Board shall develop a list of all known agricultural operators in the San Jacinto watershed that will be responsible for implementing requirements of this TMDL. The Regional Board will send a notice to these operators informing them of their TMDL responsibility and alerting them to potential regulatory consequences of failure to comply.

Task 4: Monitoring

No later than December 31, 2005, the US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, California Department of Transportation (Caltrans), California Department of Fish and Game, the County of Riverside, the cities of Lake Elsinore, Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Murrieta, Riverside and Beaumont, Eastern Municipal Water District¹, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators within the San Jacinto watershed shall, as a group, submit to the Regional Board for approval monitoring program as required by Tasks 4.1, 4.2 and 4.3.

If modifications to the monitoring program are warranted, no later than December 31, 2006, the US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, California Department of Transportation (Caltrans), California Department of Fish and Game, the County of Riverside, the cities of Lake Elsinore, Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Murrieta, Riverside and Beaumont, Eastern Municipal Water District¹, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators within the San Jacinto watershed shall, as a group, submit to the Regional Board for approval a revised proposed Watershed nutrient monitoring program (Task 4.1), Lake Elsinore monitoring program (Task 4.2) and Canyon Lake nutrient monitoring program (Task 4.3).

In lieu of this coordinated monitoring plan, one or more of the parties identified above may submit a proposed individual or group monitoring plan for Regional Board approval for the monitoring program specified in tasks 4.1, 4.2 and 4.3. Any such individual or

¹ Contingent on Eastern Municipal Water District discharge of recycled water to Lake Elsinore.

group monitoring plan is due no later than December 31, 2005. If needed, any individual or group revised monitoring plan is due no later than December 31, 2006.

4.1 Watershed-wide Nutrient Water Quality Monitoring Program

The US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, California Department of Transportation (Caltrans), California Department of Fish and Game, the County of Riverside, the cities of Lake Elsinore, Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Murrieta, Riverside and Beaumont, Eastern Municipal Water District¹, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators within the San Jacinto watershed shall, as a group, submit to the Regional Board for approval a proposed watershed-wide nutrient monitoring program that will provide data necessary to review and update the Lake Elsinore and Canyon Lake Nutrient TMDL. Data to be collected and analyzed shall address, at a minimum: (1) determination of compliance with interim and/or final nitrogen and phosphorus allocations; and (2) determination of compliance with the nitrogen and phosphorus TMDL, including the WLAs and LAs.

At a minimum, the stations specified in Table 5-9t and shown in Figure 5-3, at the frequency specified in Table 5-9t, shall be considered for inclusion in the proposed monitoring plan. If one or more of these monitoring stations are not included, rationale shall be provided and proposed alternative monitoring locations shall be identified in the proposed monitoring plan. In addition to water quality samples, at a minimum, daily discharge (stream flow) determinations shall be made at all stations shown in Table 5-9t.

At a minimum, samples shall be analyzed for the following constituents:

- organic nitrogen
- nitrite nitrogen
- total phosphorus
- total hardness
- total suspended solids (TSS)
- biological oxygen demand (BOD)
- ammonia nitrogen
- nitrate nitrogen
- ortho-phosphate (SRP)
- total dissolved solids (TDS)
- turbidity
- chemical oxygen demand (COD)
- pH
- water temperature

The proposed monitoring plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report summarizing the data collected for the year and evaluating compliance with the WLAs/LAs shall be submitted by August 15 of each year.

In lieu of this coordinated monitoring plan, one or more of the parties identified above may submit a proposed individual or group monitoring plan for Regional Board approval. This individual monitoring plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report of data collected pursuant to approved

individual/group plan(s) shall be submitted by August 15 of each year. The report shall summarize the data and evaluate compliance with the WLAs/LAs.

It may be that implementation of these monitoring requirements will be required through the issuance of Water Code Section 13267 letters to the affected parties. The monitoring plan(s) will be considered by the Regional Board and implemented upon the Regional Board's approval.

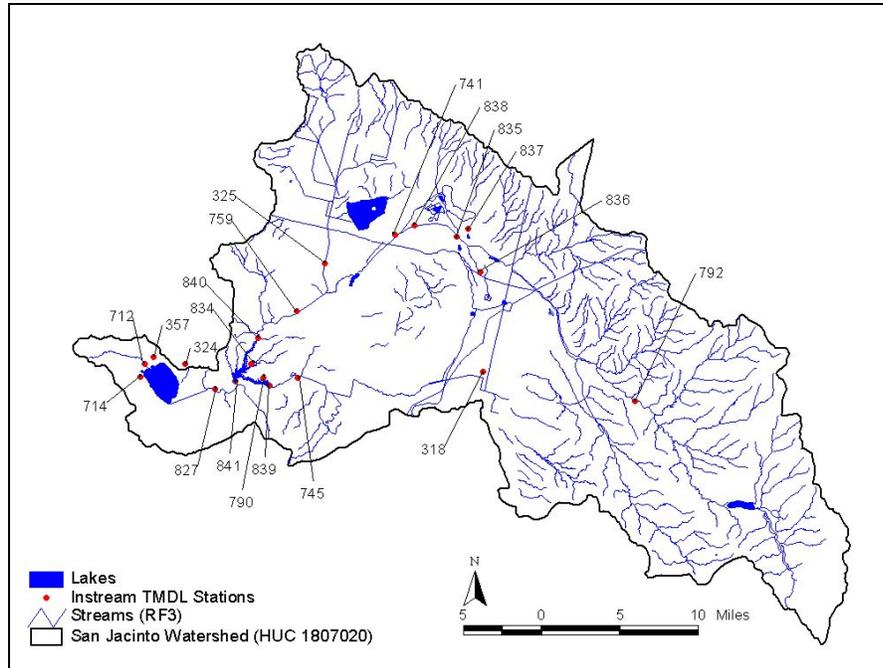


Figure 5-3 – San Jacinto River Watershed Nutrient TMDL Water Quality Stations Locations

Table 5-9t
Lake Elsinore and Canyon Lake Watershed
Minimum Required Sampling Station Locations

Station Number	Station Description
792	San Jacinto River @ Cranston Guard Station
318	Hemet Channel at Sanderson Ave.
745	Salt Creek @ Murrieta Road
759	San Jacinto River @ Goetz Rd
325	Perris Valley Storm Drain @ Nuevo Rd.
741	San Jacinto River @ Ramona Expressway
827	San Jacinto River upstream of Lake Elsinore
790	Fair Weather Dr. Storm Drain in Canyon Lake
357	4 Corners Storm Drain in Elsinore
714	Ortega Flood Channel in Elsinore
324	Lake Elsinore Outlet Channel
712	Leach Canyon Channel in Elsinore
834	Sierra Park Drain in Canyon Lake
835	Bridge Street and San Jacinto River
836	North Side of Ramona Expressway near Warren Road
837	Mystic Lake inflows
838	Mystic Lake outflows
841	Canyon Lake spillway

Frequency of sampling at all stations: dry season – none; wet season; minimum of 3 storms/year whenever possible and 8 samples across each storm hydrograph

4.2 Lake Elsinore: In-Lake Nutrient Monitoring Program

The US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, California Department of Transportation (Caltrans), California Department of Fish and Game, the County of Riverside, the cities of Lake Elsinore, Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Murrieta, Riverside and Beaumont, Eastern Municipal Water District¹, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators within the San Jacinto watershed shall, as a group, submit to the Regional Board for approval a proposed Lake Elsinore nutrient monitoring program that will provide data necessary to review and update the Lake Elsinore Nutrient TMDL. Data to be collected and analyzed shall address, at a minimum: determination of compliance with interim and final nitrogen, phosphorus, chlorophyll *a*, and dissolved oxygen numeric targets. In addition, the monitoring program shall evaluate and determine the relationship between ammonia toxicity and the total nitrogen allocation to ensure that the total nitrogen allocation will prevent ammonia toxicity in Lake Elsinore.

At a minimum, the proposed plan shall include the collection of samples at the stations specified in Table 5-9u and shown in Figure 5-4, at the specified frequency indicated in Table 5-9u. With the exception of dissolved oxygen and water temperature, all samples to be analyzed shall be depth integrated.

The monitoring plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report summarizing the data collected for the year and evaluating compliance with the TMDL shall be submitted by August 15 of each year.

Table 5-9u
Lake Elsinore Minimum Required Sampling Station Locations

Station Number	Station Description
LE 14	Lake Elsinore – inlet
LE 15	Lake Elsinore – four corners
LE 16	Lake Elsinore – mid-lake

Frequency of sampling at all stations: monthly October through May; bi-weekly June through September.

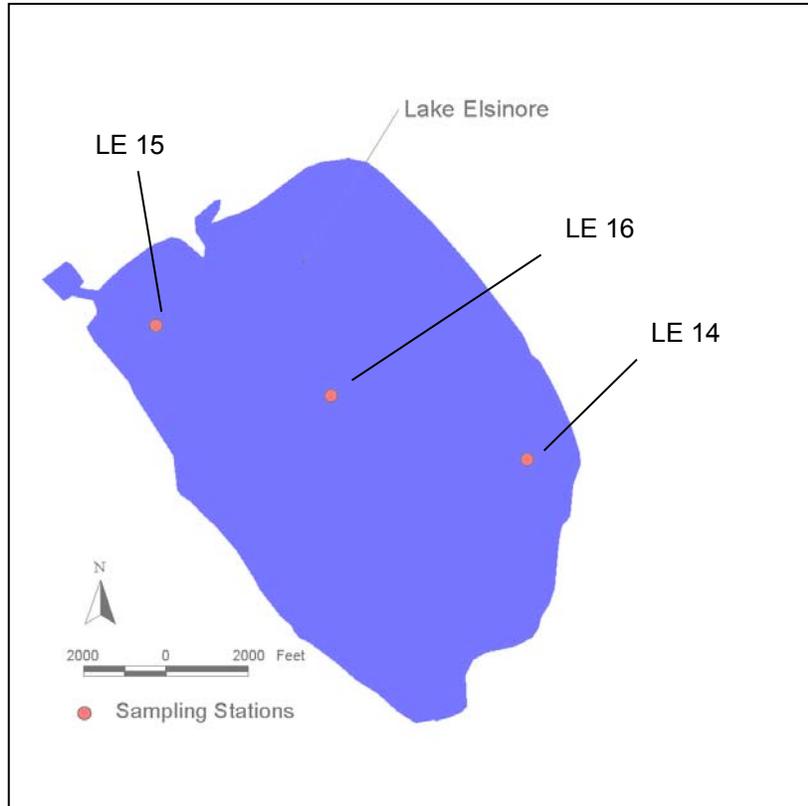


Figure 5-4 Lake Elsinore TMDL monitoring Stations

At a minimum, in-lake samples must be analyzed for the following constituents:

- specific conductance
- water temperature
- pH
- chlorophyll *a*
- organic nitrogen
- nitrite nitrogen
- organic phosphorus
- total hardness
- total dissolved solids (TDS)
- chemical oxygen demand (COD)
- dissolved oxygen
- water clarity (secchi depth)
- ammonia nitrogen
- nitrate nitrogen
- turbidity
- ortho-phosphate (SRP)
- total suspended solids (TSS)
- biological oxygen demand (BOD)

In lieu of this coordinated monitoring plan, one or more of the parties identified above may submit a proposed individual or group monitoring plan for Regional Board approval. This individual monitoring plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report of data collected pursuant to approved individual/group plan(s), shall be submitted by August 15 of each year. The report shall summarize the data and evaluate compliance with the numeric targets.

It may be that implementation of these requirements will be required through the issuance of Water Code Section 13267 letters to the affected parties. The monitoring

plan(s) will be considered by the Regional Board and implemented upon the Regional Board's approval.

4.3 Canyon Lake Nutrient Monitoring Program

The US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, California Department of Transportation (Caltrans), California Department of Fish and Game, the County of Riverside, the cities of Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Murrieta, Riverside and Beaumont, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators within the San Jacinto watershed shall, as a group, submit to the Regional Board for approval a proposed Canyon Lake nutrient monitoring program that will provide data necessary to review and update the Canyon Lake Nutrient TMDL. Data to be collected and analyzed shall address, at a minimum: determination of compliance with interim and final nitrogen, phosphorus, chlorophyll *a*, and dissolved oxygen numeric targets. In addition, the monitoring program shall evaluate and determine the relationship between ammonia toxicity and the total nitrogen allocation to ensure that the total nitrogen allocation will prevent ammonia toxicity in Canyon Lake.

At a minimum, the proposed plan shall include the collection of samples at the stations specified in Table 5-9v and shown in Figure 5-5, at the specified frequency indicated in Table 5-9v. Discrete samples in Canyon Lake are to be collected in the epilimnion, hypolimnion and thermocline when and where appropriate.

The monitoring plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report summarizing the data collected for the year and evaluating compliance with the TMDL shall be submitted by August 15 of each year.

**Table 5-9v
Canyon Lake Minimum Required Sampling Station Locations**

Station Number	Station Description
CL 07	Canyon Lake – At the Dam
CL 08	Canyon Lake – North Channel
CL 09	Canyon Lake – Canyon Bay
CL 10	Canyon Lake – East Bay

Frequency of sampling at all stations: monthly October through May; bi-weekly June through September.

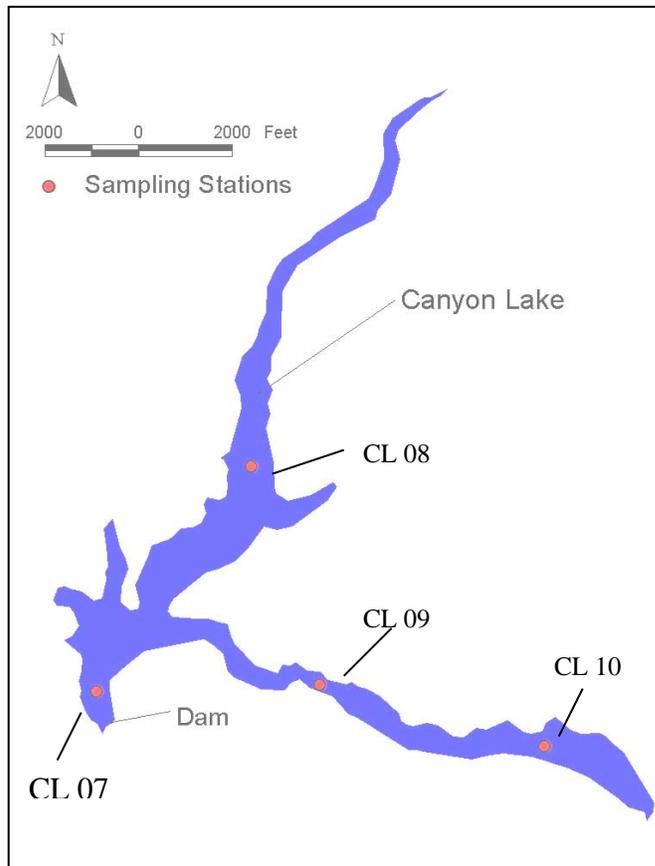


Figure 5-5 – Canyon Lake Nutrient TMDL Monitoring Station Locations

At a minimum, in-lake samples must be analyzed for the following constituents:

- specific conductance
- water temperature
- pH
- chlorophyll *a*
- organic nitrogen
- nitrite nitrogen
- organic phosphorus
- total hardness
- total dissolved solids (TDS)
- chemical oxygen demand (COD)
- dissolved oxygen
- water clarity (secchi depth)
- ammonia nitrogen
- nitrate nitrogen
- turbidity
- ortho-phosphate (SRP)
- total suspended solids (TSS)
- biological oxygen demand (BOD)

In lieu of this coordinated monitoring plan, one or more of the parties identified above may submit a proposed individual or group monitoring plan for Regional Board approval. This individual plan shall be implemented upon Regional Board approval at a duly noticed public meeting. An annual report of data collected pursuant to approved individual/group plan(s) shall be submitted by August 15 of each year. The report shall summarize the data and evaluate compliance with the numeric targets.

It may be that implementation of these requirements will be required through the issuance of Water Code Section 13267 letters to the affected parties. The monitoring plan(s) will be considered by the Regional Board and implemented upon the Regional Board's approval.

Task 5: Agricultural Activities

No later than September 30, 2007, the agricultural operators within the Lake Elsinore and Canyon Lake watershed (see Task 2), in cooperation with the Riverside County Farm Bureau, the UC Cooperative Extension, Western Riverside County Ag Coalition shall, as a group, submit a proposed Nutrient Management Plan (NMP). The Nutrient Management Plan shall be implemented upon Regional Board approval at a duly noticed public meeting.

In lieu of a coordinated plan, one or more of the parties identified above may submit a proposed individual or group Nutrient Management Plan to conduct the above studies for areas within their jurisdiction. Any such individual or group plan shall also be submitted for Regional Board approval no later than September 30, 2007. This Nutrient Management Plan shall be implemented upon Regional Board approval at a duly noticed public meeting.

At a minimum, the NMP shall include, plans and schedules for the following. In order to facilitate any needed update of the numeric targets and/or the TMDLs and/or agricultural LA, the proposed schedule shall take into consideration the Regional Board's triennial review schedule.

- implementation of nutrient controls, BMPs and reduction strategies designed to meet load allocations;
- evaluation of effectiveness of BMPs;
- development and implementation of compliance monitoring; and
- development and implementation of focused studies that will provide the following data and information
 - inventory of crops grown in the watershed;
 - amount of manure and/or fertilizer applied to each crop with corresponding nitrogen and phosphorus amounts; and
 - amount of nutrients discharged from croplands.

The Regional Board expects that the NMP will be submitted and implemented pursuant to these TMDL requirements. Where and when necessary to implement these requirements, the Regional Board will issue appropriate waste discharge requirements.

Compliance with the agricultural load allocation may be achieved through a Regional Board approved pollutant trading program.

Task 6: On-site Disposal Systems (Septic System) Management Plan

No later than 6 months after the effective date of an agreement between the County of Riverside and the Regional Board to implement regulations adopted pursuant to Water Code Sections 13290-13291.7, or if no such agreement is required or completed, within 12 months of the effective date of these regulations, the County of Riverside and the Cities of Perris, Moreno Valley and Murrieta shall, as a group, submit a Septic System Management Plan to identify and address nutrient discharges from septic systems within the San Jacinto watershed. The Septic System Management Plan shall implement regulations adopted by the State Water Resources Control Board pursuant to California Water Code Section 13290 – 13291.7.

At a minimum, the Septic System Management Plan shall include plans and schedules for the development and implementation of the following. In order to facilitate any needed update of the numeric targets and/or the TMDLs and septic system LA, the proposed schedule shall take into consideration the Regional Board's triennial review schedule.

- public education program;
- tracking system, including maintenance thereof;
- maintenance standards;
- enforcement provisions;
- monitoring program; and
- sanitary survey.

In lieu of a coordinated plan, one or more of the agencies with septic system oversight responsibilities may submit an individual or group Management Plan to develop the above Plan for areas within their jurisdiction. Any such individual or group plan shall also be submitted no later than March 31, 2006. This Septic System Management Plan shall be implemented upon Regional Board approval at a duly noticed public meeting.

Compliance with the septic systems load allocation may be achieved through a Regional Board approved pollutant trading program.

Task 7: Urban Discharges

Urban discharges, including stormwater runoff, are those discharges from the cities and unincorporated communities in the San Jacinto River watershed. These discharges are regulated under the Riverside County MS4 NPDES permit, the San Jacinto Watershed Construction Activities Storm Water permit, the State Board's General Permit for Storm Water Runoff from Construction Activities, and the State Board's General Permit for Storm Water Runoff from Industrial Activities. Nuisance and stormwater runoff from state highways and right of ways is regulated under the State of California, Department of Transportation (Caltrans) statewide general NPDES permit. Finally, nuisance and stormwater runoff from the March Air Reserve Base is also regulated through an NPDES permit.

7.1 Revision to the Drainage Area Management Plan (DAMP)

Provision XIII.B. of Order No. R8-2002-0011 (see 2.1, above) requires the permittees to revise their Drainage Area Management Plan (DAMP) to include TMDL requirements. By August 1, 2006, the permittees shall review and revise the DAMP and or WQMP (see 7.2 below) as necessary to address the requirements of these nutrient TMDLs. Further review and revision of the DAMP needed to address these TMDLs shall be completed in accordance with the requirements of Order No. R8-2002-0011 or amendments/updates thereto that are adopted by the Regional Board at a public hearing. The DAMP revisions shall include schedules for meeting the interim and final nutrient wasteload allocations. In order to facilitate any needed update of the numeric targets and/or the TMDLs and urban discharge WLA, the proposed schedule shall take into consideration the Regional Board's triennial review schedule. The revised DAMP/WQMP shall also include a proposal for 1) evaluating the effectiveness of BMPs and other control actions implemented and 2) evaluating compliance with the nutrient waste load allocation for urban runoff. The proposal must be implemented upon approval by the Regional Board after public notice and public hearing, or upon approval by the Executive Officer if no significant comments are received during the public notice period.

7.2 Revision of the Water Quality Management Plan (WQMP)

Provision VIII.B. of Order No. R8-2002-0011 (see 2.1, above) requires the permittees to develop and submit a WQMP by June 2004 for approval. On September 17, 2004, the Board approved a WQMP developed by the permittees. The approved WQMP includes source control BMPs, design BMPs and treatment control BMPs. Further revisions to the WQMP and/or the DAMP may be necessary to meet the WLA for urban runoff. By August 1, 2006, the permittees shall submit a revised WQMP and/or revised DAMP (see 7.1 above) that addresses the nutrient input from new developments and significant redevelopments to assure compliance with the nutrient wasteload allocations for urban runoff. The WQMP shall also address requirements currently in Order No. 01-34 (see 2.2, above). Once the WQMP is approved, Order No. 01-34 may be rescinded. Further review and revision of the WQMP necessary to assure that TMDL requirements are addressed shall be completed in accordance with the requirements of Order No. R8-2002-0011 or amendments/updates thereto that are adopted by the Regional Board at a public hearing.

7.3 Revision of the State of California, Department of Transportation (Caltrans) Stormwater Permit

Provision E.1 of Order No. 99-06-DWQ requires Caltrans to maintain and implement a Storm Water Management Plan (SWMP). Annual updates of the SWMP needed to maintain an effective program are required to be submitted to the

State Water Resources Control Board.

Provision E.2 of Order No. 99-06-DWQ requires Caltrans to submit a Regional Workplan by April 1 of each year for the Executive Officer's approval. By April 1, 2006, Caltrans shall submit a Regional Workplan that includes plans and schedules for meeting the interim and final nutrient wasteload allocations, and provides a proposal for 1) evaluating the effectiveness of BMPs and other control actions implemented and 2) evaluating compliance with the nutrient waste load allocations for urban runoff, which includes runoff from Caltrans facilities. In order to facilitate any needed update of the numeric targets and/or the TMDLs and urban discharge WLA, the proposed schedule shall take into consideration the Regional Board's triennial review schedule. The proposal shall be implemented upon the Executive Officer's approval. Annual updates to the Regional Workplan shall include, as necessary, revised plans and schedules for meeting the interim and final nutrient wasteload allocations and revised proposals for evaluating the efficacy of control actions and compliance with the nutrient wasteload allocations.

7.4 Revision to the United States Air Force, March Air Reserve Base, Stormwater Permit

Order No. R8-2004-0033 specifies monitoring and reporting requirements for stormwater runoff from the US Air Force, March Air Reserve facility. Provision C.17 indicates that the order could be reopened to incorporate TMDL requirements. Provisions C.18.a and C.18.b require that March Air Reserve Base submit a report and revise the Stormwater Pollution Prevention Plan (SWPPP) to address any pollutants that may be causing or contributing to exceedances of water quality standards. Results from the TMDL nutrient monitoring program conducted pursuant to Task 3, shall serve as the basis for revision of the SWPPP and/or reopening the order.

Development of the Municipal permittee's WQMP and revisions to their DAMP, development of the Caltrans SWMP and Regional Workplan, and Revision to the March Air Reserve Base SWPPP, shall address the urban component of the nutrient TMDL.

Compliance with the urban wasteload allocation may be achieved through a Regional Board approved pollutant trading program.

Task 8: Forest Area –Identification of Forest Lands Management Practices

No later than September 30, 2007, the US Forest Service shall submit for approval a plan with a schedule for identification, development and implementation of Management Practices to reduce nutrient discharges emanating from the Cleveland National Forest and the San Bernardino National Forest. The Plan shall identify watershed-specific appropriate Best Management Practices (BMPs) that will be implemented to achieve the interim and final load allocations for forest. The proposal shall include specific

recommendations and a schedule for 1) evaluating the effectiveness of control actions implemented to reduce nutrient discharges from forest and 2) evaluating compliance with the nutrient load allocation from forest/open space. The revised watershed-specific Management Practices shall be implemented upon Regional Board approval at a duly noticed public meeting.

Compliance with the open space/forest load allocation may be achieved through a Regional Board approved pollutant trading program.

Task 9: Lake Elsinore Sediment Nutrient Reduction Plan

No later than March 31, 2007, the US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, the State of California, Department of Transportation (Caltrans), the State of California, Department of Fish and Game, the County of Riverside, the cities of Lake Elsinore, Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Murrieta, Riverside and Beaumont, Eastern Municipal Water District¹, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators within the San Jacinto watershed shall, as a group, submit to the Regional Board for approval a proposed plan and schedule for in-lake sediment nutrient reduction for Lake Elsinore. The proposed plan shall include an evaluation of the applicability of various in-lake treatment technologies to prevent the release of nutrients from lake sediments to support development of a long-term strategy for control of nutrients from the sediment. The submittal shall also contain a proposed sediment nutrient monitoring program to evaluate the effectiveness of any strategies that are implemented. The Lake Elsinore In-lake Sediment Nutrient Reduction Plan shall be implemented upon Regional Board approval at a duly noticed public meeting.

In lieu of this coordinated plan, one or more of the parties identified above may submit a proposed individual or group In-lake Sediment Nutrient Reduction Plan for approval by the Regional Board. Any such individual or group Plan is due no later than March 31, 2007 and shall be implemented upon Regional Board approval at a duly noticed public meeting.

Compliance with the Lake Elsinore Sediment Nutrient Reduction Plan requirement may be achieved through a Regional Board approved pollutant trading program.

Task 10: Canyon Lake Sediment Nutrient Treatment Evaluation Plan

No later than March 31, 2007, the US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, California Department of Transportation (Caltrans), California Department of Fish and Game, the County of Riverside, the cities of Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Murrieta, Riverside and Beaumont, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators within the San Jacinto watershed shall, as a group, submit to the Regional Board for approval a proposed plan and schedule for

evaluating in-lake sediment nutrient treatment strategies for Canyon Lake. The proposed plan shall include an evaluation of the applicability of various in-lake treatment technologies to prevent the release of nutrients from lake sediments in order to develop a long-term strategy for control of nutrients from the sediment. The submittal shall also contain a proposed sediment nutrient monitoring program to evaluate the effectiveness of any strategies that are implemented. The Canyon Lake In-lake Sediment Nutrient Treatment Plan shall be implemented upon Regional Board approval at a duly noticed public meeting.

In lieu of this coordinated plan, one or more of the parties identified above may submit a proposed individual or group In-lake Sediment Nutrient Treatment Evaluation Plan for approval by the Regional Board. Any such individual or group Plan is due no later than March 31, 2007 and shall be implemented upon Regional Board approval at a duly noticed public meeting.

Task 11: Update of Watershed and In-Lake Nutrient Models

No later than March 31, 2007, the US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, California Department of Transportation (Caltrans), California Department of Fish and Game, the County of Riverside, the cities of Lake Elsinore, Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Riverside and Beaumont, Eastern Municipal Water District, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators shall, as a group, submit to the Regional Board for approval a proposed plan and schedule for updating the existing Lake Elsinore/San Jacinto River Nutrient Watershed Model and the Canyon Lake and Lake Elsinore in-lake models. The plan and schedule must take into consideration additional data and information that are generated from the respective TMDL monitoring programs. In order to facilitate any needed update of the numeric targets and/or the TMDLs/WLAs/LAs, the proposed schedule shall take into consideration the Regional Board's triennial review schedule. The plan for updating the Watershed and In-lake Models shall be implemented upon Regional Board approval at a duly noticed public meeting.

In lieu of this coordinated plan, one or more of the parties identified above may submit a proposed individual or group plan for update of the Lake Elsinore/San Jacinto River Nutrient Watershed Model and the Canyon Lake and Lake Elsinore in-lake models. The plan and schedule must take into consideration additional data and information that are generated from the respective TMDL monitoring programs. In order to facilitate any needed update of the numeric targets and/or the TMDLs/WLAs/LAs, the proposed schedule shall take into consideration the Regional Board's triennial review schedule. Any such individual or group Plan is due no later than March 31, 2007 and shall be implemented upon Regional Board approval at a duly noticed public meeting.

Task 12: Pollutant Trading Plan

No later than September 30, 2007, the US Forest Service, the US Air Force (March Air Reserve Base), March Joint Powers Authority, California Department of Transportation (Caltrans), California Department of Fish and Game, the County of Riverside, the cities of Lake Elsinore, Canyon Lake, Hemet, San Jacinto, Perris, Moreno Valley, Riverside and Beaumont, Eastern Municipal Water District¹, Elsinore Valley Municipal Water District, concentrated animal feeding operators and other agricultural operators shall, as a group, submit to the Regional Board for approval a proposed Pollutant Trading Plan. At a minimum, this plan shall contain a plan, schedule and funding strategy for project implementation, an approach for tracking pollutant credits and a schedule for reporting status of implementation of the Pollutant Trading Plan to the Regional Board, The Pollutant Trading Plan shall be implemented upon Regional Board approval at a duly noticed public meeting.

In lieu of this coordinated plan, one or more of the parties identified above may submit a proposed individual or group Pollutant Trading Plan. Any such individual or group Plan is due no later than September 30, 2007 and shall be implemented upon Regional Board approval at a duly noticed public meeting.

Task 13: Review and Revision of Water Quality Objectives

By December 31, 2009, the Regional Board shall review and revise as necessary the total inorganic nitrogen numeric water quality objectives for Lake Elsinore and Canyon Lake. In addition, the Regional Board shall evaluate the appropriateness of establishing total phosphorus and un-ionized ammonia numeric water quality objectives for both Lake Elsinore and Canyon Lake. Given budgetary constraints, completion of this task is likely to require substantive contributions from interested parties.

Task 14: Review/Revision of the Lake Elsinore/Canyon Lake Nutrient TMDL

The basis for the TMDLs and implementation schedule will be re-evaluated at least once every three years² to determine the need for modifying the load allocations, numeric targets and TMDLs. Regional Board staff will continue to review all data and information generated pursuant to the TMDL requirements on an ongoing basis. Based on results generated through the monitoring programs, special studies, modeling analysis, and/or special studies by one or more responsible parties, changes to the TMDL, including revisions to the numeric targets, may be warranted. Such changes would be considered through the Basin Plan Amendment process.

The Regional Board is committed to the review of this TMDL every three years, or more frequently if warranted by these or other studies.

(End of amendment adopted under Resolution No. R8-2004-0037)

² The three-year schedule will coincide with the Regional Board's triennial review schedule.

Middle Santa Ana River Watershed (The following was added under Resolution No. R8-2005-0001)

The Middle Santa Ana River Watershed covers approximately 488 square miles and lies largely in the southwestern corner of San Bernardino County, and the northwestern corner of Riverside County. A small part of Los Angeles County (Pomona/Claremont area) is also included. This watershed is comprised of three sub-watersheds. The first sub-watershed is the Chino Basin Watershed, which includes portions of San Bernardino County, Los Angeles County, and Riverside County. Surface drainage in this area is directed to Chino Creek and Cucamonga/Mill Creek and is generally southward, from the San Gabriel Mountains toward the Santa Ana River and the Prado Flood Control Basin. The second sub-watershed, the Riverside Watershed, is located in Riverside County. Surface drainage in this area is generally westward from the City of Riverside to the Santa Ana River, Reach 3. The third sub-watershed, the Temescal Canyon Watershed, is also located in Riverside County. Surface drainage in this area is generally northward to Temescal Creek.

Land uses in the Middle Santa Ana River watershed include urban, agriculture, and open space. Although originally developed as an agricultural area, the watershed is being steadily urbanized. Incorporated cities in the Middle Santa Ana River watershed include Pomona, Chino Hills, Upland, Montclair, Claremont, Ontario, Rancho Cucamonga, Rialto, Chino, Fontana, Norco, Corona, and Riverside. In addition, there are several pockets of urbanized unincorporated areas. The current population of the watershed, based upon 2000 census data, is approximately 1.4 million people. The principal remaining agricultural area in the watershed is the area formerly known as the Chino Dairy Preserve. This area is located in the south-central part of the Chino Basin watershed and contains approximately 300,000 cows, which generate the waste equivalent of more than two million people. Recently, the cities of Ontario and Chino annexed the San Bernardino County portions of this area. The remaining portion of the former preserve, which is in Riverside County, remains unincorporated. Open space areas include National Forest lands and State Parks lands.

Middle Santa Ana River Watershed Bacterial Indicator Total Maximum Daily Loads (TMDLs)

Middle Santa Ana River Watershed waterbodies listed on the Clean Water Act Section 303(d) list of impaired waters due to violations of REC1 fecal coliform bacteria objectives are shown in Table 5-9w.

Table 5-9w – Middle Santa Ana River Watershed Waterbodies on the 303(d) List Due to Bacterial Contamination

Waterbody, Reach
Santa Ana River, Reach 3
Chino Creek, Reach 1
Chino Creek, Reach 2
Mill Creek (Prado Area)
Cucamonga Creek, Reach 1
Prado Park Lake

During storm events, these waterbodies receive and transport runoff from urban, agricultural, and open space areas. During dry weather, these waterbodies receive and transport nuisance runoff, primarily from urban areas. Based on monitoring results, and observed waterbody conditions (fish kills and waste-laden stormflows), the Regional Board placed these waterbodies on the 303(d) list of impaired waters due to levels of bacterial indicators that exceeded established objectives for REC1 uses. The listings took place from 1988 to 1998.

A TMDL technical report prepared by Regional Board staff describes the bacterial indicator related problems in the Middle Santa Ana River Watershed waterbodies in greater detail and discusses the technical basis for the TMDLs that follow [Ref. # 31].

A. Middle Santa Ana River Watershed Bacterial Indicator TMDL Numeric Targets

Bacterial indicator numeric targets for the Middle Santa Ana River Watershed waterbodies shown in Table 5-9x are based, in part, on the fecal coliform water quality objective specified in Chapter 4 for the protection of body-contact recreation (REC1) in inland surface waters.

Recognizing that, in the future, *Escherichia coli* (*E. coli*) may be incorporated into the Basin Plan as new bacterial water quality objectives for REC1, alternative numeric targets for *E. coli* are also specified¹. These targets are based on *E. coli* criteria recommended by the U.S. Environmental Protection Agency [Ref #32]. The *E. coli* levels were chosen to roughly correspond to the health risk level associated with the fecal coliform objectives.

¹ USEPA is requiring the states to evaluate and incorporate more appropriate bacterial indicators, including *E. coli*, as water quality standards based on its Ambient Water Quality Criteria for Bacteria – 1986. The Regional Board is participating in the efforts of the Storm Water Quality Standards Task Force (SWQSTF), which is evaluating USEPA's bacterial indicator recommendations and REC1 beneficial use designations for waterbodies within the Santa Ana Region, including the Middle Santa Ana River watershed waterbodies. This numeric target and resulting TMDLs, WLAs and LAs will be adjusted accordingly when and if recommendations from the SWQSTF are incorporated into the Basin Plan.

The numeric targets for both bacterial indicators incorporate an explicit 10% margin of safety to address uncertainties recognized in the development of the TMDLs.

These numeric targets are specified as follows:

Fecal coliform: log mean less than 200 organisms/100 mL based on five or more samples per 30 day period, and not more than 10% of the samples exceed 400 organisms/100 mL for any 30–day period.

***E. coli*: log mean less than 126 organisms/100 mL based on five or more samples per 30–day period, and not more than 10% of the samples exceed 235 organisms/100mL for any 30 day period.**

The fecal coliform numeric targets (and other fecal coliform related provisions of these TMDLs) will become ineffective upon the replacement of the fecal coliform REC1 objectives in the Basin Plan with REC1 objectives based on *E. coli*. Incorporation of new *E. coli* objectives will be considered through the Basin Planning process.

B. Middle Santa Ana River Watershed Bacterial Indicator TMDLs, Wasteload Allocations, Load Allocations and Compliance Dates

As discussed in the technical TMDL Report, the bacterial indicator TMDLs are expressed in terms of density since it is the number of organisms in a given volume of water (i.e., their density), and not their mass that is significant with respect to public health and the protection of beneficial uses. Similarly, the wasteload allocations for point source discharges (WLAs) and load allocations for nonpoint source discharges (LAs) are also based on density. The density–based WLAs and LAs do not add up to equal the TMDLs, since this is not scientifically valid. To achieve the density–based TMDLs, each WLA and LA must meet the density–based TMDL. As indicated in Table 5-9x, the TMDLs, WLAs and LAs also include a 10% margin of safety (see C., below) applied to the existing Basin Plan fecal coliform objective for REC1 for inland surface waters and to the alternative indicator *E. coli* criteria recommended by the U.S. Environmental Protection Agency. Again, the *E. coli* was chosen to correspond with the health risk level associated with the fecal coliform objectives.

WLAs are specified for urban discharges and discharges from Confined Animal Feeding Operations, including stormwater. LAs are specified for runoff from other types of agriculture and from natural sources (open space/undeveloped forest land). TMDLs, WLAs and LAs are specified for both dry weather discharges and wet weather discharges, with separate compliance schedules. An extended schedule for compliance with the wet weather TMDLs is specified in light of the expected increased difficulty in achieving compliance under these conditions.

Table 5-9x – Total Maximum Daily Loads, Waste Load Allocations, and Load Allocations for Bacterial Indicators in Middle Santa Ana River Waterbodies^{a,b,c}

Indicator	Total Maximum Daily Loads for Bacterial Indicators	Waste Load Allocation for Bacterial Indicators in Urban Runoff including stormwater discharges	Waste Load Allocation for Bacterial Indicators in Confined Animal Feeding Operations discharges	Load Allocation for Bacterial Indicators in Agricultural runoff discharges	Load Allocation for Bacterial Indicators from Natural Sources
Dry Summer Conditions: April 1 through October 31, as soon as possible, but no later than December 31, 2015					
Fecal coliform	5–sample/30–day Logarithmic Mean less than 180 organisms/100mL, and not more than 10% of the samples exceed 360 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 180 organisms/100mL, and not more than 10% of the samples exceed 360 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 180 organisms/100mL, and not more than 10% of the samples exceed 360 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 180 organisms/100mL, and not more than 10% of the samples exceed 360 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 180 organisms/100mL, and not more than 10% of the samples exceed 360 organisms/100mL for any 30–day period.
E. coli	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.
Wet Winter Conditions: November 1 through March 31, as soon as possible, but no later than December 31, 2025					
Fecal coliform	5–sample/30–day Logarithmic Mean less than 180 organisms/100ml, and not more than 10% of the samples exceed 360 organisms/100ml for any 30–day period.	5–sample/30–day Logarithmic Mean less than 180 organisms/100ml, and not more than 10% of the samples exceed 360 organisms/100ml for any 30–day period.	5–sample/30–day Logarithmic Mean less than 180 organisms/100ml, and not more than 10% of the samples exceed 360 organisms/100ml for any 30–day period.	5–sample/30–day Logarithmic Mean less than 180 organisms/100ml, and not more than 10% of the samples exceed 360 organisms/100ml for any 30–day period.	5–sample/30–day Logarithmic Mean less than 180 organisms/100ml, and not more than 10% of the samples exceed 360 organisms/100ml for any 30–day period.
E. coli	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.	5–sample/30–day Logarithmic Mean less than 113 organisms/ 100mL, and not more than 10% of the samples exceed 212 organisms/100mL for any 30–day period.

^a To be achieved as soon as possible, but no later than dates specified.

^b TMDLs, WLAs and LAs, include a 10% Margin of Safety

^c The fecal coliform TMDLs, WLAs, and LAs become ineffective upon the replacement of the REC1 fecal coliform objectives in the Basin Plan by approved REC1 objectives based on E. coli.

C. Margin of Safety

A 10% margin of safety is explicitly incorporated into the Bacterial Indicator TMDLs for the Middle Santa Ana River Watershed to account for unknowns, such as bacterial regrowth, bacteria dilution and organism die-off. As additional data on bacterial dynamics in the Middle Santa Ana River watershed are developed, the margin of safety can be adjusted accordingly.

D. Seasonal Variations/Critical Conditions

The Basin Plan REC1 fecal coliform objectives apply year-round; no distinctions based on climate or other conditions that may affect actual REC1 use are specified². As shown in Table 5-9x, different compliance dates are specified for dry season discharges and wet season discharges. This ensures that dry season recreational beneficial uses are addressed on a priority basis. Additional time is allowed to address complexities associated with the control of wet weather discharges.

E. TMDL Implementation

Implementation is expected to result in compliance with the water quality objectives/numeric targets for fecal coliform and with the numeric targets for *E. coli*. The intent is to ensure protection of the REC1 beneficial uses of Middle Santa Ana River Watershed waterbodies. Collection of additional monitoring data is critical to developing long-term solutions for bacterial indicator control, as well as to consider whether changes to the TMDL are appropriate. With that in mind, the requirements for submittal of plans and schedules to implement the TMDLs take into consideration the need to develop and implement effective short-term solutions, as well as allow for the development of long-term solutions once additional data have been generated.

Implementation of tasks and schedules as specified in Table 5-9y is expected to achieve compliance with the TMDLs and, thereby, water quality standards. Each of these tasks is described below.

-
2. The SWQSTF may recommend changes to the REC1 objectives to reflect conditions, such as high flows, that affect REC1 use. Any such changes will be considered through the Basin Planning process

Table 5-9y – Middle Santa Ana River Watershed Bacterial Indicator TMDL Implementation Plan/Schedule Due Dates

Task	Description	Compliance Date-As soon As Possible but No Later Than
<i>TMDL Phase 1</i>		
Task 1	Revise Existing Waste Discharge Requirements	February 28, 2008
Task 2	Identify Agricultural Operators	June 30, 2007
Task 3	Develop Watershed-Wide Bacterial Indicator Water Quality Monitoring Program Implement Watershed-Wide Bacterial Indicator Water Quality Monitoring Program	November 30, 2007 Upon Regional Board approval Seasonal reports due May 31 and December 31 of each year Triennial reports due every 3 years beginning with first report due February 15, 2010.
Task 4	Urban Discharges 4.1 Develop and Implement Bacterial Indicator Urban Source Evaluation Plan 4.2 San Bernardino County MS4: Revise Municipal Storm Water Management Program (MSWMP) 4.3 Riverside County MS4: Revise Drainage Area Management Plan (DAMP) 4.4 San Bernardino County MS4: Revise Water Quality Management Plan (WQMP) 4.5 Riverside County MS4: Revise Water Quality Management Plan (WQMP)	Plan/schedule due 4.1 November 30, 2007 4.2 Dependent on Task 4.1 results (see text) 4.3 Dependent on Task 4.1 results (see text) 4.4 Dependent on Task 4.1 results (see text) 4.5 Dependent on Task 4.1 results (see text)
Task 5	Agricultural Discharges 5.1 Develop and Implement Bacterial Indicator Agricultural Source Evaluation Plan 5.2 Develop and Implement Bacterial Indicator Agricultural Source Management Plan	Plan/schedule due 5.1 November 30, 2007 5.2 Dependent on Task 5.1 results (see text)
Task 6	Review of TMDLs/WLAs/LAs	Once every 3 years to coincide with the Regional Board's triennial review, or more frequently as warranted

Task 1: Review and/or Revise Existing Waste Discharge Requirements

There are three Waste Discharge Requirements (WDRs) issued by the Regional Board regulating discharge of various types of wastes in the watershed. On or before **February 28, 2008**, each of these WDRs shall be reviewed and revised as necessary to implement the TMDLs, including the appropriate wasteload allocations, compliance schedules and/or monitoring program requirements.

- 1.1 Waste Discharge Requirements for the San Bernardino County Flood Control and Transportation District, the County of San Bernardino and the Incorporated Cities of San Bernardino County within the Santa Ana Region, Areawide Urban Runoff, NPDES No. CAS 618036 (Regional Board Order No. R8-2002-0012). The current Order has provisions to address TMDL issues (see Task 4, below). In light of these provisions, revision of the Order may not be necessary to address TMDL requirements.
- 1.2 Waste Discharge Requirements for the Riverside County Flood Control and Water Conservation District, the County of Riverside and the Incorporated Cities of Riverside County within the Santa Ana Region, Areawide Urban Runoff, NPDES No. CAS 618033 (Regional Board Order No. R8-2002-0011). The current Order has provisions to address TMDL issues (see Task 4, below). In light of these provisions, revision of the Order may not be necessary to address TMDL requirements.
- 1.3 General Waste Discharge Requirements for Concentrated Animal Feeding Operations (Dairies and Related Facilities) within the Santa Ana Region, NPDES No. CAG018001 (Regional Board Order No. 99-11). Updated waste discharge requirements for Concentrated Animal Feeding Operations are expected to be considered by the Regional Board in 2005. These requirements will include appropriate TMDL requirements.

Other waste discharge requirements may be reviewed and/or revised to address bacterial indicator discharges as appropriate.

Task 2: Identify Agricultural Operators

On or before **June 30, 2007**, the Regional Board shall develop a list of all known agricultural owners/operators in the Middle Santa Ana River watershed that will be responsible for implementing requirements of these TMDLs. The Regional Board will send a notice to these operators informing them of their TMDL responsibility and alerting them to the potential regulatory consequences of failure to comply.

To implement the agricultural load allocations for non-Concentrated Animal Feeding Operations, monitoring program requirements specified in Task 3 and the agricultural

source evaluation studies (Task 5), the Regional Board may issue waste discharge requirements or a waiver of such waste discharge requirements that is conditioned on satisfactory compliance with these TMDL elements.

Task 3: Watershed-Wide Bacterial Indicator Water Quality Monitoring Program

No later than **November 30, 2007**, the US Forest Service, the County of San Bernardino, the County of Riverside, the cities of Ontario, Chino, Chino Hills, Montclair, Rancho Cucamonga, Upland, Rialto, Fontana, Norco, Riverside, and Corona, Pomona and Claremont and agricultural operators in the watershed, shall as a group, submit to the Regional Board for approval a proposed watershed-wide monitoring program that will provide data necessary to review and update the TMDLs. Data to be collected and analyzed shall address, at a minimum, determination of compliance with the TMDLs, WLAs and LAs.

At a minimum, the stations specified in Tables 5-9z and 5-9aa and shown in Figure 5-6, at the frequency specified in Tables 5-9z and 5-9aa shall be considered for inclusion in the proposed monitoring plan. If one or more of these monitoring stations are not included, the rationale shall be provided and proposed alternative monitoring locations shall be identified in the proposed monitoring plan. The proposed monitoring plan shall also include a plan to compile streamflow measurements at existing USGS stream gauging stations.

At a minimum, samples shall be analyzed for the following constituents:

- Fecal Coliform
- Escherichia Coli (E. coli)
- Total Suspended Solids
- pH
- Temperature
- Electrical Conductivity
- Dissolved Oxygen
- Turbidity

The proposed monitoring plan shall be implemented upon Regional Board approval at a duly noticed public meeting. Seasonal reports summarizing and including copies of the data collected during the dry season and wet season monitoring periods shall be submitted by May 31 and December 31 of each year. In order to facilitate review and update of the numeric targets and/or the TMDLs, WLAs, LAs, a triennial report summarizing the data collected for the preceding 3 year period and evaluating compliance with the WLAs/LAs shall be submitted every three years, beginning with the first report due February 15, 2010.

In lieu of this coordinated monitoring plan, one or more of the parties identified above may submit a proposed individual or group monitoring plan for Regional Board approval. Any such individual or group monitoring plan is due no later than November 30, 2007 and shall be implemented upon Regional Board approval at a duly noticed public meeting. Seasonal reports summarizing and including copies of the data collected during the dry season and wet season monitoring periods shall be submitted by May 31 and December 31 of each year. In order to facilitate review and update of the numeric

targets and/or the TMDLs, WLAs, LAs, a triennial report summarizing the data collected for the preceding 3 year period and evaluating compliance with the WLAs/LAs shall be submitted every three years, beginning with the first report due February 15, 2010.

Table 5-9z – Watershed Minimum Required Weekly Sampling Station Locations

Station Number	Station Description
C1	Icehouse Canyon Creek
C2	Chino Creek at Schaeffer Avenue
C3	Prado Park Lake at lake outlet
C7	Chino Creek at Central Avenue
C8	Chino Creek at Prado Golf Course
M2	Cucamonga Creek at Regional Plant No. 1
M5	Mill Creek at Chino–Corona Road
S1	Santa Ana River at MWD Crossing
S3	Santa Ana River at Hamner Avenue
T1	Temescal Wash at Lincoln Avenue
TQ1	Tequesquite Arroyo at Palm Avenue

Frequency of sampling:

Dry season: weekly

Wet season: two 30-day sampling periods during which a minimum of 5 samples are to be collected (at least one sample weekly) and if possible, a minimum of 5 of those samples must be from storm events.

Table 5-9a-a --Additional Watershed Storm Event Sampling Locations

Station Number	Station Description
M3	Bon View Avenue @ Merrill Avenue
M4	Archibald Avenue @ Cloverdale Avenue
G1	Grove Channel @ Pine Avenue
E1	Euclid Avenue Channel @ Pine Avenue

Frequency of sampling: wet weather – one sample/storm event for 5 storm events/year; dry weather – none.


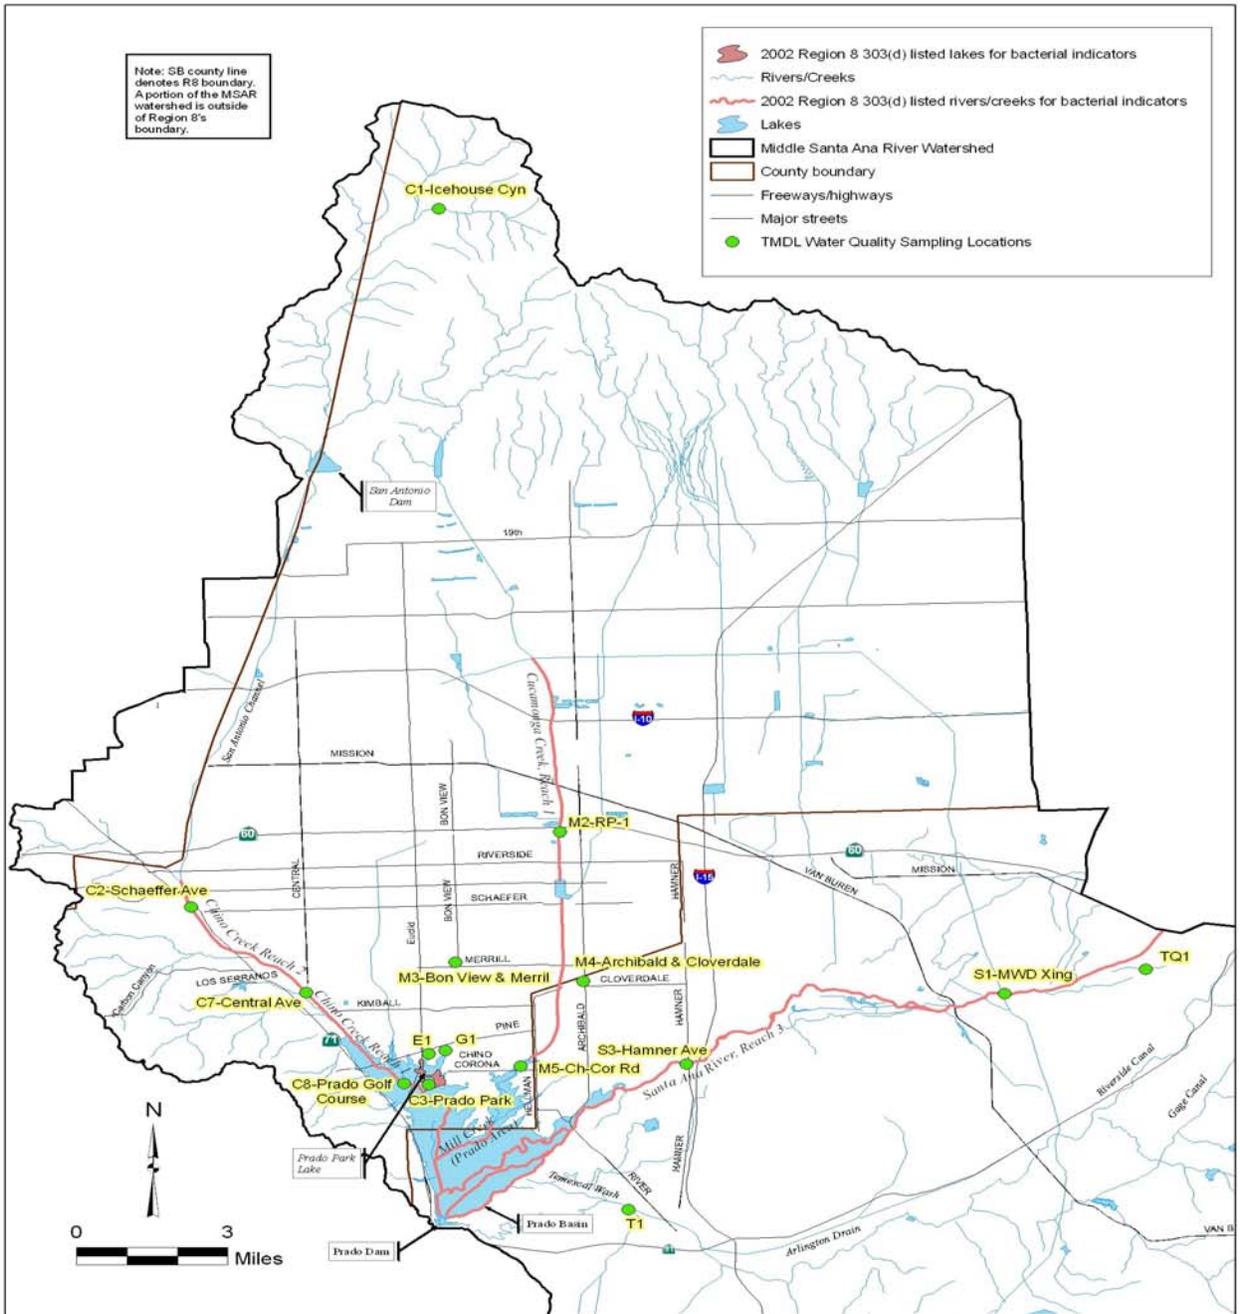


FIGURE 5-6: TMDL WATER QUALITY SAMPLING LOCATIONS

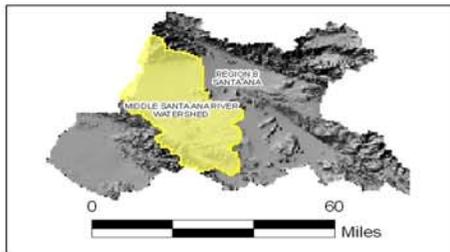

Map created January 2005
Map created by: HB

Data Sources:
Middle Santa Ana River Watershed:
based on Calwater v. 2.2.1 boundaries -
CA Spatial Information Library (2004),
Santa Ana River reach designations,
and GDT streets (SWRCB, 2002)
County: CA Spatial Information Library (2004)
Rivers/creeks, and lakes:
CA Spatial Information Library (1998)
2002 303(d) listed water bodies:
SWRCB (2003)

Task 4: Urban Discharges

Phase I urban discharges, including stormwater runoff, include those from the cities and unincorporated communities in the Middle Santa Ana River Watershed. These discharges are regulated under the MS4 NPDES permits identified in Tasks 1.1 and 1.2 (Review and Revise Existing Waste Discharge Requirements), above. The requirements of these NPDES permits differ somewhat and therefore the TMDL implementation requirements that pertain to the permittees under each permit also vary slightly, as shown below³.

4.1 Develop and Implement Bacterial Indicator Urban Source Evaluation Plans

On or before **November 30, 2007**, the County of San Bernardino, the County of Riverside, the cities of Ontario, Chino, Chino Hills, Montclair, Rancho Cucamonga, Upland, Rialto, Fontana, Norco, Riverside, and Corona, Pomona and Claremont shall develop a Bacterial Indicator Urban Source Evaluation Plan(s) (USEP). This plan shall include steps needed to identify specific activities, operations, and processes in urban areas that contribute bacterial indicators to Middle Santa Ana River Watershed waterbodies. The plan shall also include a proposed schedule for completion of each of the steps identified. The proposed schedules can include contingency provisions that reflect uncertainty concerning the schedule for completion of the SWQSTF work and/or other investigations that may affect the steps that are proposed. The USEP shall be implemented upon Regional Board approval at a duly noticed public meeting.

4.2 Revise the San Bernardino County Municipal Storm Water Management Program (MSWMP)

Provision XVI.3. of Order No. R8-2002-0012 (see 1.1, above) requires the permittees to revise their Municipal Storm Water Management Program (MSWMP) to include TMDL requirements. Revisions to the MSWMP may be necessary based on the results of Task 4.1, Basin Plan amendments to address recommendations of the SWQSTF, or other investigations. Because of uncertainties regarding the timing of completion of these studies, it is not feasible to identify an explicit date whereby the revision of the MSWMP is to be accomplished. Instead, the Executive Officer shall notify the permittees of the need to revise the MSWMP. Within 90 days of notification by the Executive Officer, the permittees shall submit for Regional Board approval, a plan and schedule to review and revise the MSWMP as necessary to incorporate measures to address the results of

3. The San Bernardino MS4 permit requires the development and implementation of a Municipal Stormwater Management Program (MSWMP) to address stormwater discharges from existing urban activities. For the Riverside County MS4 permit, the Drainage Area Management Plan (DAMP) addresses stormwater discharges from existing urban activities.

the USEP and/or other studies. Further review and revision of the MSWMP needed to address these TMDLs shall be completed in accordance with the requirements of Order No. R8-2002-0012 or amendments thereto that are adopted by the Regional Board at a public hearing. The MSWMP revisions shall include schedules for meeting the bacterial indicator wasteload allocations based on the schedule established in these TMDLs. In order to facilitate any needed update of the numeric targets and/or the TMDLs and urban discharge WLAs, the proposed schedule shall take into consideration the Regional Board's triennial review schedule. The permittees shall also provide a proposal and schedule for 1) evaluating the effectiveness of BMPs and other control actions implemented and 2) evaluating compliance with the bacterial indicator waste load allocations for urban runoff. The plan and schedule to review the MSWMP must be implemented upon approval by the Regional Board after public notice and public hearing, or upon approval by the Executive Officer if no significant comments are received during the public notice period.

4.3 Revise the Riverside County Drainage Area Management Plan (DAMP)

Provision XIII.B. of Order No. R8-2002-0011 (see 1.2, above) requires the permittees to revise their Drainage Area Management Plan (DAMP) to include TMDL requirements. Revisions to the DAMP may be necessary based on the results of Task 4.1, Basin Plan amendments to address recommendations of the SWQSTF, or other investigations. Because of uncertainties regarding the timing of completion of these studies, it is not feasible to identify an explicit date whereby the revision of the DAMP is to be accomplished. Instead, the Executive Officer shall notify the permittees of the need to revise the DAMP. Within 90 days of notification by the Executive Officer, the permittees shall submit for Regional Board approval, a plan and schedule to review and revise the DAMP as necessary to incorporate measures to address the results of the USEP and/or other studies. Further review and revision of the DAMP needed to address these TMDLs shall be completed in accordance with the requirements of Order No. R8-2002-0011 or amendments/updates thereto that are adopted by the Regional Board at a public hearing. The DAMP revisions shall include schedules for meeting the bacterial indicator wasteload allocations based on the schedule established in these TMDLs. In order to facilitate review and update of the numeric targets and/or the TMDLs and urban discharge WLAs, the proposed schedule shall take into consideration the Regional Board's triennial review schedule. The revised DAMP shall also include a proposal and schedule for 1) evaluating the effectiveness of BMPs and other control actions implemented and 2) evaluating compliance with the bacterial indicator waste load allocations for urban runoff. The plan and schedule to review and revise the DAMP must be implemented upon approval by the Regional Board after public notice and public hearing, or upon approval by the Executive Officer if no significant comments are received during the public notice period.

4.4 Revise the San Bernardino County Water Quality Management Plan (WQMP)

Provision XII.B. 1. of Order No. R8-2002-0012 requires the permittees to develop and submit a WQMP for new developments and significant redevelopments by January 2004 for the Executive Officer's approval. Revisions to the WQMP may be necessary based on the results of Task 4.1, Basin Plan amendments to address recommendations of the SWQSTF, or other investigations. Because of uncertainties regarding the timing of completion of these studies, it is not feasible to identify an explicit date whereby the revision of the WQMP is to be accomplished. Instead, the Executive Officer shall notify the permittees of the need to revise the WQMP. Within 90 days of notification by the Executive Officer, the permittees shall submit for Regional Board approval a plan and schedule to review and revise the WQMP that addresses the bacterial indicator input from new developments and significant redevelopments to assure compliance with the bacterial indicator wasteload allocations for urban runoff. Further review and revision of the WQMP necessary to address TMDL requirements, shall be completed in accordance with the requirements of Order No. R8-2002-0012 or amendments/updates thereto that are adopted by the Regional Board at a public hearing.

4.5 Revise the Riverside County Water Quality Management Plan (WQMP)

Provision VIII.B. of Order No. R8-2002-0011 (see 1.2, above) requires the permittees to develop and submit a WQMP for new developments and significant redevelopments by June 2004 for approval. On September 17, 2004, the Board approved a WQMP developed by the permittees. The approved WQMP includes source control BMPs, design BMPs and treatment control BMPs. Further revisions to the WQMP may be necessary to meet the WLA for urban runoff. Such revisions may be necessary based on the results of Task 4.1, Basin Plan amendments to address recommendations of the SWQSTF, or other investigations. Because of uncertainties regarding the timing of completion of these studies, it is not feasible to identify an explicit date whereby the revision of the WQMP is to be accomplished. Instead, the Executive Officer shall notify the permittees of the need to revise the WQMP. Within 90 days of notification by the Executive Officer, the permittees shall submit for Regional Board approval a plan and schedule for review and revision of the WQMP that addresses the bacterial indicator input from new developments and significant redevelopments to assure compliance with the bacterial indicator wasteload allocations for urban runoff. Further review and revision of the WQMP necessary to address TMDL requirements, shall be completed in accordance with the requirements of Order No. R8-2002-0011 or amendments/updates thereto that are adopted by the Regional Board at a public hearing.

If the results of studies conducted pursuant to Tasks 3 and 4.1 above demonstrate that either the Phase II non-traditional small MS4 discharges covered under the statewide Waste Discharge Requirements for Stormwater Discharges from Small Municipal

Separate Storm Systems (Order No. 2003-0005-DWQ) or industrial discharges from facilities covered by the statewide Industrial Stormwater General Permit (Order 97-03-DWQ) or any Regional Board individual industrial permit, are responsible, to a significant degree, for exceedances of the urban WLAs, the Regional Board will take the appropriate regulatory steps to address these discharges.

Task 5: Agricultural Discharges

Agricultural discharges include stormwater runoff, wastewater release and tailwater runoff from agricultural land uses. Tailwater runoff is irrigation water that runs off of agricultural land. Agricultural land uses include concentrated animal feeding operations and irrigated and dry-land farming in the Middle Santa Ana River Watershed. Concentrated animal feeding operations are regulated under WDRs (see Task 1.3, above); irrigated agriculture and dry-land farming are not currently regulated.

5.1 Develop and Implement Bacterial Indicator Agricultural Source Evaluation Plans

On or before **November 30, 2007**, concentrated animal feeding facility operators and agricultural operators in the Middle Santa Ana River Watershed shall develop and implement Bacterial Source Agricultural Source Evaluation Plans (AGSEP). These plans shall include steps needed to identify specific activities, operations, and processes in agricultural areas that contribute bacterial indicators to Middle Santa Ana River Watershed waterbodies. The plan shall also include a proposed schedule for completion of each of the steps identified. The proposed schedules can include contingency provisions that reflect uncertainty concerning the schedule for completion of the SWQSTF work and/or other investigations that may affect the steps that are proposed. The AGSEP shall be implemented upon Regional Board approval at a duly noticed public meeting.

The Regional Board expects that the AGSEP will be submitted and implemented pursuant to these TMDL requirements. Where and when necessary to implement these requirements, the Regional Board will utilize appropriate waste discharge requirements including those for concentrated animal feeding operations (see 1.3, above), or other Water Code authorities.

In lieu of a coordinated source evaluation plan, one or more of the parties identified above may submit a proposed individual or group AGSEP to conduct the above studies for areas within their jurisdiction. Any such individual or group plan shall also be submitted for Regional Board approval no later than November 30, 2007. This AGSEP shall be implemented upon Regional Board approval at a duly noticed public meeting.

5.2 Develop and Implement a Bacterial Indicator Agricultural Source Management Plan

Based on the results of Task 5.1 or other studies conducted in the watershed, concentrated animal feeding operators and agricultural operators within the

Middle Santa Ana River Watershed shall, as a group, submit a proposed Bacterial Indicator Agricultural Source Management Plan (BASMP). Because of uncertainties regarding the timing of completion of these studies and in recognition that readily identifiable steps may be taken to reduce bacterial discharges from agricultural lands, it is not feasible to identify an explicit date whereby the development and implementation of the BASMP is to be accomplished. Instead, the Executive Officer shall notify agricultural operators of the need to submit the proposed BASMP in whole or to submit plans and schedule to address a subset of tasks identified in the AGSEP. Within 90 days of notification by the Executive Officer, the proposed BASMP, or a subset thereof, shall be submitted. The BASMP, or subset thereof, shall be implemented upon Regional Board approval at a duly noticed public meeting. At a minimum, the BASMP shall include plans and schedules for the following:

- A. implementation of bacterial indicator controls, BMPs and reduction strategies designed to meet load allocations;
- B. evaluation of effectiveness of BMPs; and
- C. development and implementation of compliance monitoring program(s).

The Regional Board expects that the BASMP will be submitted and implemented pursuant to these TMDL requirements. Where and when necessary to implement these requirements, the Regional Board will utilize appropriate waste discharge requirements or other Water Code authorities.

In lieu of a coordinated plan, one or more of the parties identified above may submit a proposed individual or group BASMP to develop and implement the above plan for areas within their jurisdiction. Any such individual or group plan shall also be submitted for Regional Board approval. Because of uncertainties regarding the timing of completion of these studies and in recognition that readily identifiable steps may be taken to reduce bacterial discharges from agricultural lands, it is not feasible to identify an explicit date whereby the development and implementation of the BASMP is to be accomplished. Instead, the Executive Officer shall notify agricultural operators of the need to submit the proposed BASMP in whole or to submit plans and schedule to address a subset of tasks identified in the AGSEP. Within 90 days of notification by the Executive Officer, the proposed BASMP, or a subset thereof, shall be submitted. This BASMP, or a subset thereof, shall be implemented upon Regional Board approval at a duly noticed public meeting.

Task 6: Review/Revision of the Bacterial Indicator TMDL (TMDL “Re-opener”)

The basis for the TMDLs and implementation schedule will be re-evaluated at least once every three years⁴ to determine the need for modifying the load and wasteload allocations, numeric targets and TMDLs. Regional Board staff will continue to review all

data and information generated pursuant to the TMDL requirements on an ongoing basis. Based on results generated through the monitoring programs, special studies, modeling analysis, efforts of the Storm Water Quality Standards Task Force⁵ and/or special studies by one or more responsible parties, changes to the TMDLs, including revisions to the numeric targets, WLAs and LAs, may be warranted. Such changes would be considered through the Basin Plan Amendment process.

The Regional Board is committed to the review of this TMDL every three years, or more frequently if warranted by the results of monitoring and/or other relevant studies.

(End of amendment adopted under Resolution No. R8-2005-0001)

BAY PROTECTION AND TOXIC CLEANUP PROGRAM

Legislation enacted in 1989 added Chapter 5.6, Bay Protection and Toxic Cleanup, to Division 7 of the California Water Code (Sections 13390-13396). These new sections require the State Board and Regional Boards to establish programs for the maximum protection of beneficial uses of bays and estuaries, focusing on water quality problems due to toxic substances. In part, the State Board was directed to formulate and adopt a water quality control plan for Enclosed Bays and Estuaries and a workplan for the development of sediment quality objectives. When setting waste discharge requirements, the Regional Boards must implement the water quality control plan and any sediment quality objectives which may be adopted by the State Board.

The Bay Protection and Toxic Cleanup Program (BPTCP) must also include plans to identify and remediate “toxic hot spots.” These are areas in the enclosed bays, estuaries or adjacent waters where the contamination affects the interests of the state and “...where hazardous substances have accumulated in the water or sediment to levels which (1) may pose a substantial present or potential hazard to aquatic life, wildlife, fisheries or human health, or (2) may adversely affect the beneficial uses of bay, estuary or ocean waters as defined in water quality control plans, or (3) exceeds adopted water quality or sediment quality objectives.” Criteria for the assessment and priority ranking of toxic hot spots are to be developed by the State Board in coordination with the California Department of Fish and Game and the California Office of Environmental Health Hazard Assessment (OEHHA). The ranking criteria will be used by the Regional Board to prioritize toxic hot spots based on the severity of the problem.

⁴ The three-year schedule will coincide with the Regional Board’s triennial review schedule.

⁵ Stakeholders formed the Storm Water Quality Standards Task Force (Task Force) in 2002 to support review and update of the bacterial quality objectives for REC1 waters and to review the REC1 designations themselves to assure their accuracy. Participants include representatives from the Santa Ana Watershed Project Authority, (SAWPA) flood control agencies from the 3 counties within the Santa Ana Region, POTW dischargers and stormwater staff from various municipalities in the watershed. Environmental groups, Regional Board staff and USEPA staff are also participants. SAWPA staff serve as facilitators for the Task Force.

The BPTCP consists of both short- and long-term activities. The short-term activities include:

- Develop and maintain a program to identify toxic hot spots, plan for their cleanup or mitigation, and amend Water Quality Control Plans and policies to abate toxic hot spots;
- Develop and implement regional monitoring and assessment programs;
- Develop numeric sediment quality objectives;
- Develop and implement Toxic Hot Spot Cleanup Plans;
- Revise waste discharge requirements, if necessary, to conform to the Basin Plan; and
- Develop a comprehensive database containing information pertinent to describing and managing toxic hot spots.

Long-term activities of the BPTCP include:

- (Continue to) develop numeric sediment quality objectives;
- Develop and implement strategies to prevent the formation of new Toxic Hot Spots and to reduce the severity of effects from existing Toxic Hot Spots;
- Periodic review and update of a Water Quality Control Plan for enclosed bays and estuaries; and
- Maintain the comprehensive database.

The BPTCP is a comprehensive effort to regulate toxic pollutants in enclosed bays and estuaries and is not intended to be a monitoring program resembling the State Mussel Watch Program or the Toxic Substances Monitoring Program (see Chapter 6 for descriptions of these programs). The BPTCP program does, however, use the data from the State Mussel Watch Program and the Toxic Substances Monitoring Program to identify Toxic Hot Spots.

The Santa Ana Region, State Mussel Watch data and data provided by the Orange County Environmental Management Agency have been used to identify toxic hot spots in Newport Bay and Anaheim Bay/Huntington Harbour. Tables 5-10 and 5-11 lists the known toxic hot spots and potential toxic hot spots, respectively. The Regional Board, in coordination with

the State Board and the California Department of Fish and Game are currently in the process of confirming these toxic hot spots and potential toxic hot spots using a battery of

toxicity tests on both the water column and sediment. Once confirmed, the list of toxic hot spots and potential toxic hot spots will be ranked according to the ranking criteria. The priority ranking will be included in the regional Toxic Hot Spot Cleanup Plan(s) which will include identification of likely contaminant sources and appropriate remedial actions.

GROUNDWATER CONTAMINATION FROM VOLATILE ORGANIC COMPOUNDS

In 1984, the legislation passed Assembly Bill 1803 which instructed the California Department of Health Services, Office of Drinking Water, to develop and implement a program to require the sampling of public drinking water supply wells for volatile organic compounds. The Department was instructed to provide the results to the appropriate Regional Board. The initial data indicated extensive organic contamination of groundwater supplies throughout the state. As a result, in 1985, the State Board and the Regional Water Quality Control Boards initiated the Well Investigation Program. The intent of the Well Investigation Program was to identify the parties responsible for the organic contamination of municipal drinking water supply wells so that those parties could be made accountable for cleanup.

In order to identify the responsible parties, the Regional Board followed an intensive investigation program for each contaminated public drinking water supply well on a priority basis. This program included:

- Field reconnaissance for potential sources
- Record searches
- Hydrogeological assessments
- Questionnaires, meetings, and inspections
- Requests for preliminary soil investigations and follow-up soil and groundwater investigations of potential sources
- Requests for cleanup
- Enforcement actions, where appropriate

In the late 1980's the Well Investigation Program was expanded to include private drinking water supply wells and agricultural and industrial supply wells that were located in areas where organic contamination posed a threat to public drinking water supply wells. In the late 1980's the Well Investigation Program represented the largest single funded program in the Region. However, due to severe budget cuts statewide, the Well Investigation Program was scaled down and eventually discontinued in 1992. Investigation and cleanup of sites identified by the Well Investigation Program are currently being overseen by the Regional Board's Spills, Leaks, Investigations, and Cleanup (SLIC) program.

Currently (1993), there are more than 300 water supply wells identified in the Region which contain organic compound contaminants. The loss of many drinking water supply wells

and the threat of loss of additional existing drinking water supply wells due to organic compound contamination is a serious problem in several areas of the Region, most notably the Bunker Hill, Chino, and Santa Ana Forebay Groundwater Basins.

Perchloroethylene (PCE) and trichloroethylene (TCE) are the major contaminants in the Bunker Hill I Subbasin, which underlies northern San Bernardino. The City of San Bernardino lost 25% of its water supply in the early 1980s when 14 wells operated by the City were found to contain concentrations of perchloroethylene above the state and federal drinking water Maximum Contaminant Level (MCL). The Newmark Wellfield was placed on the federal Superfund list in 1988, and EPA assumed lead responsibility for investigating the extent of the contamination and identifying long-term cleanup measures. The Regional Board has identified no specific source of the contamination; potential sources include dry cleaners, airports, and a World War II munitions facility. Interim groundwater extraction and treatment at existing municipal supply wells using air stripping and granulated activated carbon (GAC) facilities funded by the California Department of Toxic Substances Control. These facilities have the capacity to treat 37.6 million gallons per day (MGD). The treated water is used as a potable water supply to replace the water lost as a result of the solvent contamination.

Table 5-10

**Known Toxic Hot Spots
Santa Ana Region**

Waterbody Name	Pollutants Involved
Lower Newport Bay	Cd, Pb, As, Se, Zn, Cu
Upper Newport Bay Ecological Reserve	Pb, Cu, Cd
Anaheim Bay	Cd, Cu, Pb, Cr
Huntington Harbour	Cd, Pb, Se, Cr, Cu
Bolsa Bay	Cr, Cu, Pb

Table 5-11

**Potential Toxic Hot Spots
Santa Ana Region**

Waterbody Name	Pollutants Involved
Lower Newport Bay	Chlorpyrifos, Dacthal, PCB, Chlorbenseide, DDT, Lindane, Ronnel, Hexachlorbenzene, Chlordane, Endosulfan, Toxaphene, Aldrin, Heptachlorepoide, Heptachlor
Upper Newport Bay Ecological Reserve	Dacthal, DDT, PCB, Endosulfan, Chlordane, Chlorpyrifos, Diazinon, Lindane, Heptachlorepoide, Hexchlorbenzene
Anaheim Bay	Aldrin, Chlordane, Lindane, Chlorbenseide, PCB, DDT, Chlorpyrifos, Endosulfan, Heptachlorepoide, Hexachlorbenzene
Huntington Harbour	Aldrin, Chlorbenseide, DDT, Lindane, Endosulfan, Chlordane, Chlorpyrifos, Dieldrin, Endrin, Toxaphene, Heptachlorepoide

The Bunker Hill II Subbasin underlying Redlands has been contaminated with TCE and dibromochloropropane (DBCP). It is estimated that the TCE plume covers an area of approximately twenty square miles. Twenty-six water supply wells are impacted by TCE or DBCP, including five municipal water supply wells where the concentration of TCE or DBCP exceeds the MCL. No responsible parties have been identified yet, however, potential sources for the TCE plume include an airport, commercial and industrial facilities, and a former rocket motor testing facility. DBCP, a soil fumigant, was used extensively by the citrus industry prior to the 1960's and the DBCP contamination in the Bunker Hill II Subbasin is believed to be the result of this past legal agricultural use. A 3.0 MGD GAC facility at the Rees Well, which began operation in 1989, treats the contaminated water and provides potable water for the City of Redlands. In addition, an 8.6 MGD wellhead treatment facility at the Texas Street Well Field began operation in 1993. The facility, which was funded by the State Board and the State Department of Toxics, removes TCE and DBCP and also provides potable water back to the City of Redlands.

Forty-four water supply wells in the Chino Basin, primarily the Chino II Subbasin, contain TCE and PCE. To date, only one facility, the former GE Flatiron Plant in Ontario, has been confirmed as a source of organic compound contamination that has impacted a water supply well. In 1993, prior to exploring final cleanup options, GE will be implementing plume containment and interim cleanup activities on the almost two mile long, one-half

mile wide TCE plume. Other potential sources in the Chino Basin include the California Institute for Men, the Chino Airport, and the Ontario Airport. Potential responsible parties are in the process of conducting investigative studies.

Organic contamination from TCE, PCE, dichloroethylene (DCE), and dichloroethane (DCA) has been found in water supply wells in Orange County in the Santa Ana Forebay and Irvine Forebay Groundwater Basins. A wellhead treatment unit (air stripping) was installed at the City of Orange Well No. 13 and began operation in 1993. The Regional Board staff oversees investigations at numerous sites in the Forebay area where past discharges of industrial solvents have occurred. Twenty-one of these sites have been identified to date as sources of volatile organic compounds in groundwater. Site investigations are being conducted to identify the extent of contamination and to clean up the effects of the discharges.

The Regional Board has been successful in identifying many sites throughout the region where volatile organic compounds have impacted groundwater. However, with the exception of the former GE Flatiron facility in the Chino Basin, there has been no other direct cause-and-effect relationship drawn between a contaminated drinking water supply well and a specific source. In most cases, records of compounds used at facilities have not been maintained and information regarding past disposal practices is not available, making it difficult to pinpoint specific sources. In addition, considering that most sources of the volatile organic compounds found in water supply wells are probably industrial discharges that may have occurred as long as 30 years ago, and considering the complex factors affecting the fate of volatile organic compounds in soil and groundwater and the changes in groundwater flow patterns from pumping, etc., it is difficult to backtrack contamination from water supply wells to specific sites which may be sources of local groundwater contamination.

DEPARTMENT OF DEFENSE FACILITIES

There are six major Departments of Defense (DoD) facilities in the Santa Ana Region, two of which are currently scheduled for closure. Table 5-12 identifies these facilities and the water quality problems of each.

Significant groundwater contamination has been detected at a number of these facilities. Contamination is severe enough at three of these facilities to have them placed on EPA's National Priorities List (NPL) for remediation under the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA, commonly referred to as Superfund).

For these three National Priorities List facilities (Norton and March Air Force Bases and Marine Corps Air Station – El Toro), the EPA is the lead environmental regulatory agency for oversight of investigation and cleanup. CERCLA requires EPA to consider applicable or relevant and appropriate state laws and regulations when establishing cleanup. CERCLA requires EPA to consider applicable or relevant and appropriate state laws and regulations when establishing cleanup standards for remedial activities. To ensure that the state's concerns are properly addressed, two Cal/EPA agencies, the Regional Board and the

Department of Toxic Substances Control (DTSC) also perform a significant oversight role in the investigations and cleanup of these facilities.

The US EPA, DoD, and the state agencies have signed Federal Facility Agreements (FFA) for each of the National Priorities List facilities. The intent of the FFA is to ensure that: (1) environmental impacts are investigated; (2) remedial actions are defined; (3) procedural framework or schedules are established; (4) cooperation among agencies is facilitated; (5) adequate assessment it performed; and (6) compromise is reached.

The US EPA is not involved in the investigation and cleanup of DoD facilities that are not on the National Priorities List (Marine Corps Air Station-Tustin, Naval Weapons Station-Seal Beach, and Armed Forces Reserve Center-Los Alamitos). However, many of these facilities have significant contamination. In these cases, the two state agencies enter into Federal Facility Site Remediation Agreements (FFSRAs) with DoD.

Table 5-12
Summary of Water Quality Problems from Department of Defense (DoD) Facilities
Santa Ana Region

DoD Facility	Receiving Water Affected	Water Quality Problem Identified to Date
Norton Air Force Base ¹	Bunker Hill I Subbasin	trichloroethylene (TCE) plume; landfills; Superfund listing
March Air Force Base	Perris North Subbasin	trichloroethylene (TCE) plume; fuel plume; landfills; Superfund listing
Marine Corps Air Station - El Toro	Irvine Forebay Subbasin	trichloroethylene (TCE) plume; fuel plume; benzene plume; landfills; proposed Superfund Listing
Marine Corps Air Station - Tustin ¹	Irvine Pressure Subbasin	volatile organic compound (VOC) plume; fuel plume
Naval Weapons Station - Seal Beach	Santa Ana Pressure Subbasin	fuel plume; landfills
Armed Forces Reserve Center - Los Alamitos	Santa Ana Pressure Subbasin	fuel plume; landfills

¹ Facilities which are scheduled to be closed. These bases are given high cleanup priority.

FFSRAs are very similar to the above-mentioned Federal Facility Agreements, with the exception that US EPA is not a party. The Regional Board and Department of Toxic Substances Control have already entered into an agreement with DoD for the Naval

Weapons Station – Seal Beach and are near the end of negotiations on Federal Facility Site Remediation Agreements for Marine Corps Air Station – Tustin.

The Department of Toxic Substances Control has been identified as the “lead” state agency and the Regional Board as “support” agency for all of the above facilities. A Memorandum of Understanding has been signed by the State Board and Department of Toxic Substances Control which describes the roles of each agency. The Regional Board’s oversight role is with regard to the investigation and cleanup of water resources that have been impacted or are threatened by waste discharges from the facilities. The Regional Board’s responsibility also extends to source areas (landfills, contaminated soil, etc.) that currently, or may in the future, pose a threat to water quality. DTSC’s role is to address all other environmental aspects including health risk assessment, air emissions, community relations, etc.

The State Board and DTSC have entered into a two-year cooperative agreement with the Department of Defense for cleanup and oversight reimbursement. All work performed by the State agencies with regard to the investigation and cleanup of environmental problems at these facilities is fully reimbursed by DoD.

LEAKING UNDERGROUND STORAGE TANKS

The Underground Storage Tank Program was enacted in 1983 and took effect January 1, 1984. The authority for the program is found in the Health and Safety Code, Division 20, Chapter 6.7, and the regulations for the program are found in the California Code of Regulations, Title 23, Division 3, Chapter 16. In 1988, the State Board and the Department of Health Services (now Department of Toxic Substances Control) issued the Leaking Underground Fuel Tank (LUFT) field manual which prescribes specific methods for evaluating the effects of underground storage tank leaks.

There are approximately 2,000 known cases of leaking underground storage tanks (USTs) in the Region. Approximately 35% of the cases involve instances where only soil contamination is present, 35% are cases which have been closed. The majority of the releases from these underground storage tanks are gasoline and the constituent of most concern is benzene, a known carcinogen. A smaller percentage of the underground storage tank releases involve chlorinated industrial solvents, which are suspected carcinogens. As anticipated, the majority of the sites where these releases have occurred are automotive service stations, with tanks from industrial facilities contributing a smaller, but significant, minority. To date, these groundwater impacts have not grown to the point where drinking water supply wells have been affected. The Regional Board maintains and regularly updates the Leaking Underground Storage Tank Information Systems (LUSTIS) database, which identifies all known underground storage tank release sites in the Region.

Implementation of the underground storage tank program includes direct Regional Board oversight of leaking underground storage tank cleanups. It also involves coordination of oversight activities with local agencies under contract with the State Board through the Local Oversight Program. Local agencies have the authority, pursuant to Section 25297.1

of the Health and Safety Code, to act on behalf of the Regional Board in requiring investigations and cleanup of underground storage tanks cases. The local agencies also implement the permitting, construction, inspections, and monitoring portion of the Underground Tank Regulations. The Orange County Health Care Agency, the County of Riverside Department of Environmental Health, and the County of San Bernardino Department of Environmental Health Services handle approximately 80% of the active cases in the Region, with several cities managing their own programs. The local agencies' caseload consists of soil cases, while the Regional Board maintains responsibility for the highly complex cases where groundwater has been affected.

As specified in State Board Resolution No. 92-49, "Policies and Procedures for Investigation and Cleanup and Abatement of Discharges," the investigation and cleanup of releases from underground storage tanks involves several steps including: (1) preliminary site assessment and workplan submittal; (2) pollution characterization; (3) remediation; and (4) post-remedial action monitoring. Soil contamination cleanup levels are determined on a case-by-case basis and are established to prevent continued leaching from the affected soils at levels which may cause the underlying groundwater to exceed applicable water quality objectives. Cleanup goals for groundwater contamination cases are generally established at drinking water standards (Maximum Contaminant Levels or Action Levels).

In most areas of the Santa Ana Region, the uppermost portions of the aquifers are considered to be in hydrologic contact with deeper portions which are currently utilized for drinking water supplies. In the pressure zone of Orange County, the uppermost sediments are fine-grained materials which are unable to sustain sufficient pumping rates. However, due to the large volume of water held within these sediments, the close vertical proximity of these areas to underlying pumping locations, and the existence of pathways for movement into the deeper aquifers, the shallow waters in this area are considered as contributing to the sources of drinking water in Orange County. Leaking underground storage tank cleanups must be conducted accordingly.

Underground Storage Tank Cleanup Fund

The State Board, Division of Clean Water Programs, administers the Underground Storage Tank Cleanup Fund. The Cleanup Fund can be used as a mechanism to satisfy federal financial responsibility requirements and pay for corrective action and third party liability costs resulting from a leaking petroleum UST. The Fund can also pay for direct cleanup (by local agency or Regional Board) of UST sites requiring emergency and prompt action on abandoned or recalcitrant sites. This fund, collected by the Board of Equalization, is supported by a 0.6 cents per gallon fee for gasoline. The Fund has been established to provide reimbursement to tank owners or operators for the costs of cleanup of the effects of unauthorized releases of petroleum. Up to one million dollars (\$1,000,000) can be provided per site, with the first ten thousand dollars (\$10,000) being provided by the claimant. With certain qualifications, expenditures made to remediate an unauthorized petroleum release since January 1, 1988 can be reimbursed and letters of credit can be issued for the funding of ongoing remediation activities.

The Regional Boards provide technical support to both the applicants who file claims against the UST Cleanup Fund and the State Board staff who verify the corrective action work covered by the claim. For claims that involve future work, the Regional Boards will oversee site investigation and cleanup on cases for which they are the lead agency.

ABOVEGROUND STORAGE TANKS

The state's Aboveground Petroleum Storage Act was enacted in 1989 and amended in 1991. The Act became effective on January 1, 1990 (Health and Safety Code, Chapter 6.67).

The purpose of the regulation is to protect the public and the environment from the serious threat of millions of gallons of petroleum-derived chemicals stored in thousands of aboveground storage tanks. The Regional Board inspects aboveground petroleum storage tanks, which were used to store crude oil and its fractions after January 1991, to assure compliance with a federally required site-specific Spill Prevention, Control, and Countermeasure Plan. In the event that a release occurs which threatens surface or groundwater, the Act allows the state to recover reasonable costs incurred in the oversight and regulation of cleanup.

Storage statements are required from facilities with aboveground storage tanks, describing the nature and size of their tanks. Filing fees are required which are intended to fund inspections, training, and research. Approximately 280 aboveground storage tanks are under regulation in the Santa Ana Region as of May 1, 1993. Their number is continually expanding as aboveground storage tanks are increasingly used to replace underground storage tanks. A list of aboveground storage tanks is available from the Regional Board.

DISPOSAL OF HAZARDOUS AND NONHAZARDOUS WASTE TO LAND

Hazardous and nonhazardous waste disposal can, if not properly managed and regulated, diminish the beneficial uses of the waters of the Region. These are typically losses to groundwater beneficial uses, but in some cases, surface waters can also be affected by disposal operations or contaminated soil in the vadose zone.

The Regional Board regulates landfills receiving municipal solid wastes and surface impoundments receiving hazardous or designated liquid wastes. Although these sites are closely regulated and monitored, some water quality problems have been detected and are being addressed. There are no hazardous solid waste disposal facilities currently operating in the Region.

The laws and regulations governing the disposal of both hazardous and nonhazardous solid wastes have been revised and strengthened in the last few years. The US EPA, DTSC, the State Board, and Regional Water Quality Control Boards are implementing the federal RCRA regulations. Described below is Regional Board implementation of RCRA and the following state programs: Title 23, Division 3, Chapter 15; Toxic Pits Cleanup Act; and Solid Waste Assessment Tests.

Resource Conservation and Recovery Act

The state implements the Resource Conservation and Recovery Act (RCRA) in California through the Department of Toxic Substances Control (DTSC) and the Regional Boards. Chapter 15 monitoring requirements have been implemented through the adoption of waste discharge requirements for both hazardous and nonhazardous waste disposal sites covered by RCRA. The discharge requirements for both hazardous waste sites are part of a state RCRA permit issued by the DTSC. The Regional Board and the Integrated Waste Management Board issues state permits for nonhazardous waste disposal sites.

The Resource Conservation and Recovery Act of 1976 provided for the development of federal and state programs for the regulation of land disposal of waste materials and the recovery of materials and energy resources from the waste stream. The Act regulates not only the generation, transportation, treatment, storage, and disposal of hazardous wastes, but also nonhazardous solid waste disposal facilities. In addition, the 1976 Act called for phasing out the use of open dumps for disposal of solid wastes in favor of sanitary landfills.

The most recent and significant amendments to RCRA (1984) impose a variety of new, more stringent requirements both on hazardous and nonhazardous waste generators, transporters, and the owners/operators of treatment, storage, and disposal facilities within the existing regulated community. Significant provisions include bans on land disposal of certain wastes, restrictions and placement of liquids in landfills, and establishment of minimum technological requirements for landfills and surface impoundments.

Subtitle C of RCRA contains requirements related to the identification and listing of hazardous wastes and standards applicable to generators, transporters, owners, and owner/operators of treatment, storage, and disposal facilities. Primary responsibility for the implementation of Subtitle C rests with the DTSC, with Regional Board participation as necessary.

Subtitle D of RCRA establishes a framework for federal, state, and local government cooperation in controlling the management of nonhazardous solid waste. The federal role in this arrangement is to establish the overall regulatory direction by providing minimum nationwide standards for protecting human health and the environment and to provide technical assistance to states for planning and developing their own environmentally sound waste management practices. The actual planning and direct implementation of solid waste programs under subtitle D, however, remain largely state and local functions, and the act authorizes states to devise programs to deal with state-specific conditions and needs. US EPA approved the state's proposed solid waste management program, and delegated authority to the state to implement the program in October 1993. In September 1993, the Santa Ana Region adopted a blanket Waste Discharge Requirement (WDR) amendment for all affected landfills in the Region which implements both Subtitle D and Chapter 15.

Subtitle D includes the Criteria for Classification of Solid Waste Disposal Facilities and Practices (40 CFR Part 257). The criteria establish minimum national performance standards necessary to ensure that “no reasonable probability of adverse effects on health or the environment” will result from solid waste disposal facilities or practices.

Part 258 of subtitle D establishes minimum national criteria for municipal solid waste landfills including those used for sludge disposal and disposal of nonhazardous waste combustion and ash. Part 258 also sets forth minimum federal criteria for municipal solid waste landfills, including location restrictions, facility design and operating criteria, groundwater monitoring requirements, financial assurance requirements, and closure and post-closure care requirements. The rule establishes differing requirements for existing and new units, (e.g., existing units are not required to remove wastes in order to install liners).

Subtitle D provides that states with approved water management programs that wish to run the program will have flexibility in implementing these criteria. A municipal solid waste landfill unit that does not meet the Part 258 Criteria will be considered to be engaged in the practice of “open dumping” in violation of Section 4005 of RCRA. Municipal solid waste landfill units that receive sewage sludge and fail to satisfy those criteria will be deemed to be in violation of Sections 309 and 405(e) of the Clean Water Act.

Title 23, Division 3, Chapter 15

The most important regulation used by the Regional Board in regulating hazardous and nonhazardous waste disposal is California Code of Regulations (CCR) Title 23, Division 3, Chapter 15 (formerly Subchapter 15). These regulations include very specific siting, construction, monitoring, and closure requirements for all existing and new waste disposal facilities. Chapter 15 also contains a provision requiring landfill operators to provide assurances of financial responsibility for initiating and completing closure, and for corrective action to address all known or reasonably foreseeable releases from their waste management units. Detailed technical criteria are provided for establishing water quality protection standards, monitoring programs, and corrective action programs for releases from waste management units. Chapter 15 defines waste types to include hazardous wastes (Class I), designated wastes (Class II), and nonhazardous solid wastes (Class III). Hazardous wastes are defined by DTSC in Title 22 of the California Code of Regulations.

Designated wastes are defined as:

1. Those non hazardous wastes consisting of or containing contaminants which under ambient landfill conditions could be released at concentrations that could cause water quality degradation, or
2. Those wastes which are hazardous according to Title 22, but are not considered hazardous by the federal RCRA definition and have been granted a variance from hazardous waste management requirements by DTSC.

Nonhazardous solid wastes are those normally associated with domestic and commercial activities. The California Integrated Waste Management Board (CIWMB) is the lead agency responsible for non-water quality-related issues relating to nonhazardous waste management in California (Division 7 of Title 14 of the CCR). CIWMB has the overall responsibility for landfill operations and ensuring that nonhazardous wastes are collected and disposed of in a manner which protects public health and safety as well as the environment. Inert wastes can be regulated by the Regional Board if necessary to protect water quality.

The Regional Board has regulated nonhazardous municipal solid waste facilities (Class III) since the mid-1970s. Many of the smaller, older facilities have closed, and waste is now typically disposed of at larger regional nonhazardous solid waste facilities. The Regional Board is responsible for the review and revision of waste discharge requirements for both active and inactive permitted sites to assure consistency with the current regulations. These responsibilities include the upgrading of groundwater monitoring systems to identify violations of water quality protection standards, and the establishment of corrective action programs where standards are violated.

A significant task faced by the Regional Board in implementing Chapter 15 at nonhazardous solid waste facilities is defining what constitutes designated wastes. Many wastes which are not hazardous still contain constituents of water quality concern that can become mobile in a nonhazardous solid waste facility, and can produce leachates that could pose a threat to beneficial uses of the water of the state. The criteria for determining whether a nonhazardous waste is a designated waste are based on water quality objectives for waters located in the vicinity of the sites, the containment features of the solid waste facility, and the solubility/mobility of the waste constituents. To assist in the identification of designated waste criteria, the Regional Board will rely on a methodology acceptable to the Executive Officer and other relevant technical data.

Landfill Expansion

A steady increase in the rate of solid waste generation in the region is causing landfills to reach capacity sooner than expected. This situation has made it necessary not only to plan for the closure of some existing landfills, but also to anticipate the need for expansions of existing facilities and the construction of new ones. To minimize the problems associated with the rapid filling and subsequent closure of solid waste disposal facilities, the Regional Board supports efforts to reduce the volume of wastes disposed of at landfills. To reduce the potential for household hazardous wastes entering municipal landfills, the Regional Board also supports public education and household hazardous waste disposal and recycling programs.

The Regional Board conducts many other activities related to the disposal of wastes. Examples of these activities are review and approval of site design plans and construction oversight for new or expanding facilities, implementation of strict drainage and erosion control measures at landfills, soil and groundwater cleanup activities at contaminated

disposal sites, and closure/post-closure plan review, approval, and closure construction oversight.

Toxics Pits Cleanup Act

The Toxics Pits Cleanup Act of 1984 (TPCA) required that all impoundments containing liquid hazardous wastes or free liquids containing hazardous waste must be either reconstructed with a liner/leachate collection system or be dried out by July 1, 1988. These facilities must also be closed by removing all contaminants or by capping to contain any residual soil contamination. In 1985, there were 11 sites in the Santa Ana Region with ponds subject to TPCA. As of 1993, 2 facilities are continuing to operate following upgrades to meet TPCA requirements, eight facilities have closed, and discharges at the remaining facility have ceased. Lead responsibility for closure of the remaining site has been assumed by the DTSC, with participation continued by the Regional Board.

Solid Waste Assessment Tests

Section 13273 was added to the Water Code in 1985, requiring all operations of both active and inactive nonhazardous landfills to complete a Solid Waste Assessment Test (SWAT). The purpose of the SWAT is to determine whether hazardous or toxic substances above regulatory thresholds, or any other constituents which may threaten water quality, are migrating from the facility. Funding for the SWAT program is provided by the California Integrated Waste Management Board.

There were 159 sites identified in the region subject to this program. Pursuant to a list adopted by the State Board, 150 sites statewide were to be evaluated each year through the year 2001 (approximately 10 sites per year in the Santa Ana Region). These sites were according to their perceived threat to water quality. Active sites, those overlying high quality aquifers, and those already known to have adversely impacted groundwater were replaced in the highest ranks (Rank 1 through 4).

Program funding was eliminated in 1991, but was restored in 1992 for a period of three years to allow for review of reports for sites in Ranks 1 through 5 only. These reviews must be completed by 1995. Although landfill site evaluations, which seek to identify adverse impacts to both surface and groundwater quality, can be required pursuant to Chapter 15 whenever necessary, it appears that the SWAT program will be fully funded after 1995. A revised SWAT ranking list will be created prior to implementation of the program for Rank 6 and beyond.

REFERENCES:

1. Wildermuth Environmental, Inc., TIN/TDS – Phase 2A of the Santa Ana Watershed, Development of Groundwater Management Zones, Estimation of Historic and Current TDS and Nitrogen Concentrations in Groundwater, Final Technical Memorandum,” July 2000.
2. Wildermuth Environmental, Inc., “Santa Ana Watershed Data Collection and Management Program, Final Technical Memorandum,” October 2001.
3. Wildermuth Environmental, Inc., “TIN/TDS Study - Phase 2B of the Santa Ana Watershed, Wasteload Allocation Investigation Memorandum,” October 2002.
4. Wildermuth Environmental, Inc., Memo to TIN/TDS Task Force, “Transmittal of Final Tables, Figures and CD in Support of Basin Plan Amendments – TIN/TDS Study,” October 2002.
5. Wildermuth Environmental, Inc., “June 2003 Addendum TIN/TDS Study – Phase 2B of the Santa Ana Watershed Wasteload Allocation Investigation,” July 2003
6. California Regional Water Quality Control Board – Santa Ana Region, “Guidelines for Sewage Disposal from Land Developments,” January 1979.
7. State Water Resources Control Board, “Order No. 73-4, Rancho Caballero Decision,” April 1972.
8. Department of Water Resources, “Mineral Increases from Municipal Use of Water in the Santa Ana River Basin,” Memorandum Report, June 1982.
9. City of Riverside, Memo from Rod Cruze to TIN/TDS Task Force,” Nitrogen Loss Assumptions for Reach 3 of the Santa Ana River,” April 2002.
- 10A. California Regional Water Quality Control Board – Santa Ana Region, Staff Report, “Santa Ana River at Prado Dam, Results of Annual Water Quality Sampling for 2002”, April 2003.
- 10B. Chino Basin Watermaster, Letter to Gerard Thibeault, “Chino Basin Watermaster Proposal for New Total Dissolved Solids (TDS) and Nitrogen Water Quality Objectives for the Chino and Cucamonga Basins Based on Maximum Beneficial Use,” December 2002.
- 10C. Chino Basin Watermaster, “Chino Basin Optimum Basin Management Plan,” 1999.
- 10D. Yucaipa Valley Water District, Letter to Gerard Thibeault, “Yucaipa Valley Water District Proposal for New Total Dissolved Solids (TDS) and Total Inorganic Nitrogen Water Quality Objectives for the San Timoteo and Yucaipa Management Zones Based on Maximum Beneficial Use,” January 2002.
- 10E. San Timoteo Watershed Management Agency, Letter to Gerard Thibeault, “Revised San Timoteo Watershed Management Agency Proposal for New Total Dissolved Solids (TDS) and Total Inorganic Nitrogen Water Quality Objectives for the Beaumont, San Timoteo and Yucaipa Management Zones Based on Maximum Beneficial Use,” December 2002 (Revised November 11, 2003).

11. California Regional Water Quality Control Board – Santa Ana Region, “Dairies and Their Relationship to Water Quality Problems in the Chino Basin,” July 1990.
12. USDA Soil Conservation Service, U.S. Forest Service, and the West End Conservation District, “Chino Agriculture Land Use Study,” September 1988.
13. California Regional Water Quality Control Board – Santa Ana Region, “A Review of Nitrate Problems in the Ground Waters of the Santa Ana Region and Their Relationship to High Density Developments on Septic Tank-Subsurface Disposal Systems,” September 1989.
14. California Regional Water Quality Control Board – Santa Ana Region, “Guidelines for Sewage Disposal from Land Developments,” January 1979.
15. Department of Water Resources, “Mineral Increases from Municipal Use of Water in the Santa Ana River Basin,” Memorandum Report, June 1982.
16. California Regional Water Quality Control Board – Santa Ana Region, “A Report to the California Legislature, Newport Bay: Water Quality Issues and Recommendations,” November 1985.
17. California Regional Water Quality Control Board – Santa Ana Region, “Newport Bay Clean Water Strategy--A Report and Recommendations for Future Actions,” September 1989.
18. California Regional Water Quality Control Board – Santa Ana Region, “Evaluation of Boatyard Waste Treatment Technologies within the Santa Ana Region,” October 1990.
19. University of California, Irvine, “Newport Bay Basin Plan Update/Nonpoint Source Study,” July 1993.
20. University of California, Davis, “Newport Bay Watershed Toxicity Study,” June 1993.
21. California Regional Water Quality Control Board – Santa Ana Region, “Total Maximum Daily Load for Fecal Coliform Bacteria in Newport Bay, California,” November 1998.
22. California Regional Water Quality Control Board – Santa Ana Region, “Total Maximum Daily Load for Fecal Coliform in Newport Bay, California: Continuation of Public Hearing,” April 9, 1999.
23. University of California, Irvine, “Anaheim Bay Basin Plan Update Study,” August 1993.
24. University of California, Davis, “Anaheim Bay Watershed Toxicity Study,” June 1993.
25. California Regional Water Quality Control Board – Santa Ana Region, “An Assessment of the Water Quality Conditions in Big Bear Lake,” pending.
26. California Regional Water Quality Control Board, Santa Ana Region. “Staff Report on the Nutrient Total Maximum Daily Loads for Big Bear Lake,” June 2005.
27. California Regional Water Quality Control Board, “Lake Elsinore Nutrient TMDL Problem Statement,” October, 2000.

28. California Regional Water Quality Control Board, "Canyon Lake Nutrient TMDL Problem Statement," October 2001.
29. California Regional Water Quality Control Board, "Total Maximum Daily Load for Nutrients in Lake Elsinore and Canyon Lake," May 2004.
30. Environmental Protection Agency, "Update of Ambient Water Quality Criteria for Ammonia." EPA-822-R-99-014.
31. California Regional Water Quality Control Board, "Total Maximum Daily Load for Bacterial Indicators in the Middle Santa Ana River Watershed," February 3, 2005.
32. US Environmental Protection Agency (USEPA), "Ambient Water Quality Criteria for Bacteria," 1986.
33. Eastern Municipal Water District, Letter to Gerard Thibeault, "Eastern Municipal Water District Proposal for New Total Dissolved Solids (TDS) and Total Inorganic Nitrogen (TIN) Water Quality Objectives for the San Jacinto Upper Pressure Management Zone Based on Maximum Beneficial Use," July 3, 2007.