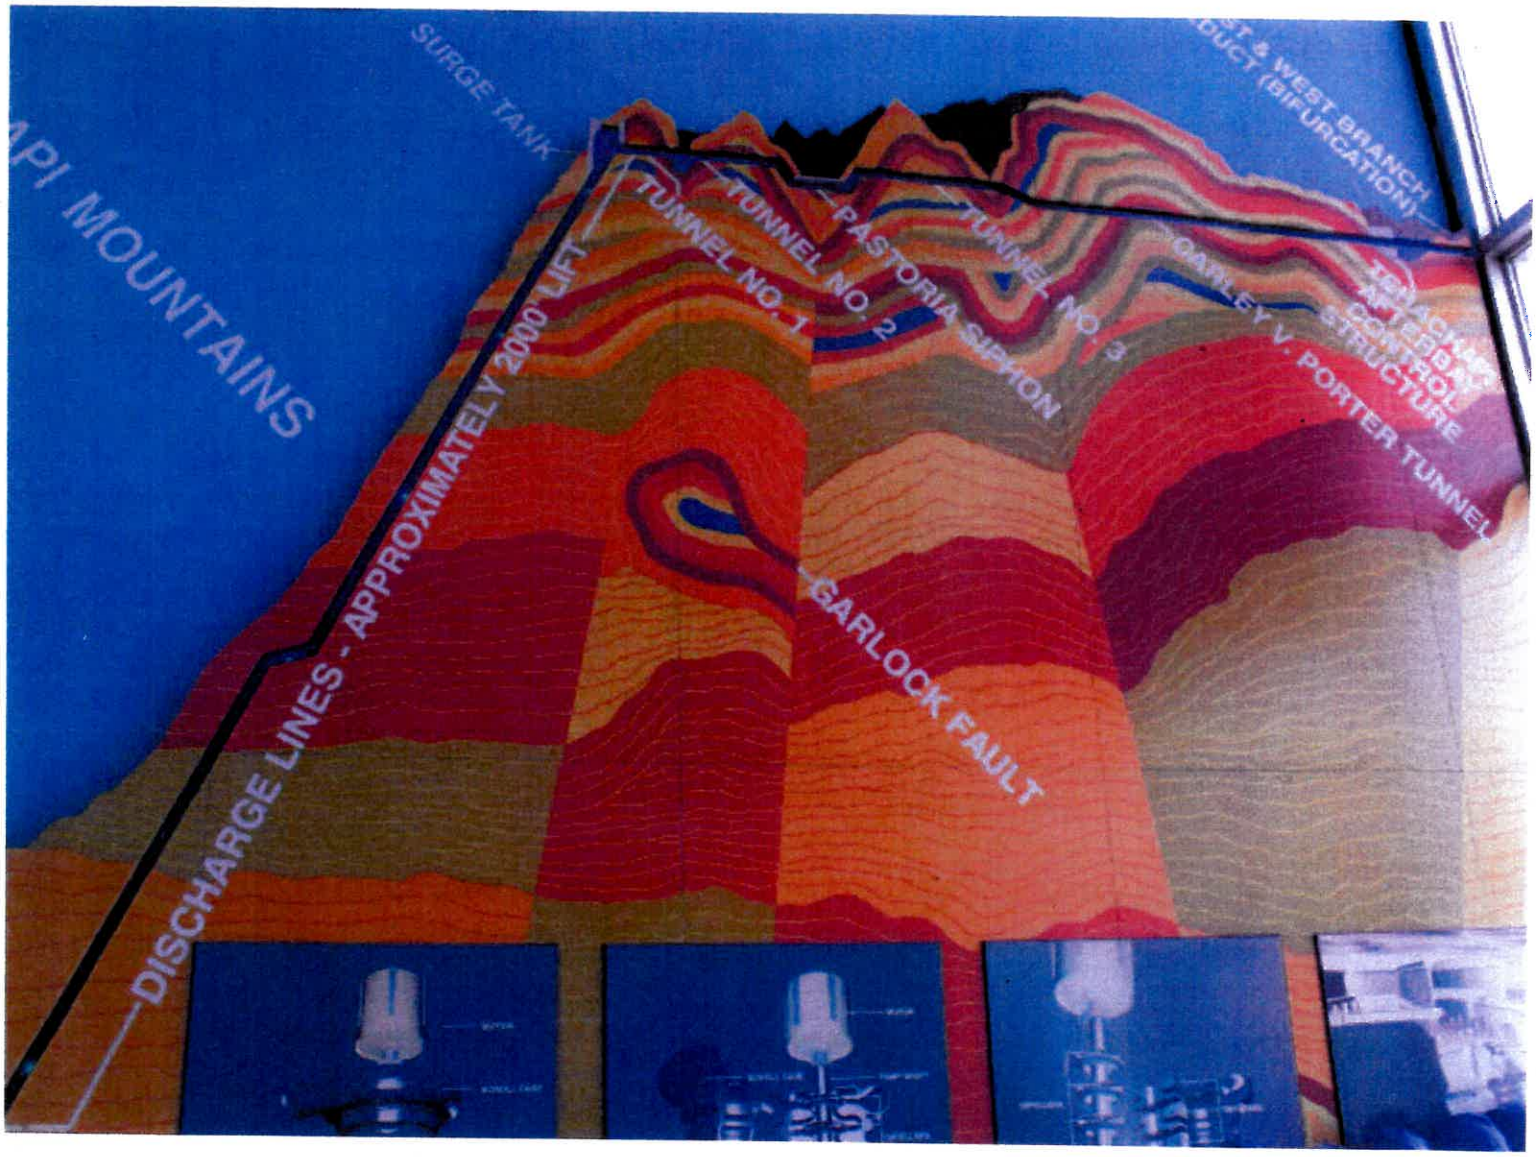
SURGE TANK
API MOUNTAINS
DISCHARGE LINES - APPROXIMATELY 2000' LIFT
TUNNEL NO. 1
TUNNEL NO. 2
PASTORIA SIPHON
TUNNEL NO. 3
GARLEY V. PORTER TUNNEL
GARLOCK FAULT