


TRACY PUMPING PLANT (TRP)

Date from 08/03/2013 11:58 through 04/30/2014 11:58 Duration : 270 days

Max of period : (04/03/2014 00:00, 4240.99) Min of period: (01/16/2014 00:00, 0.0)

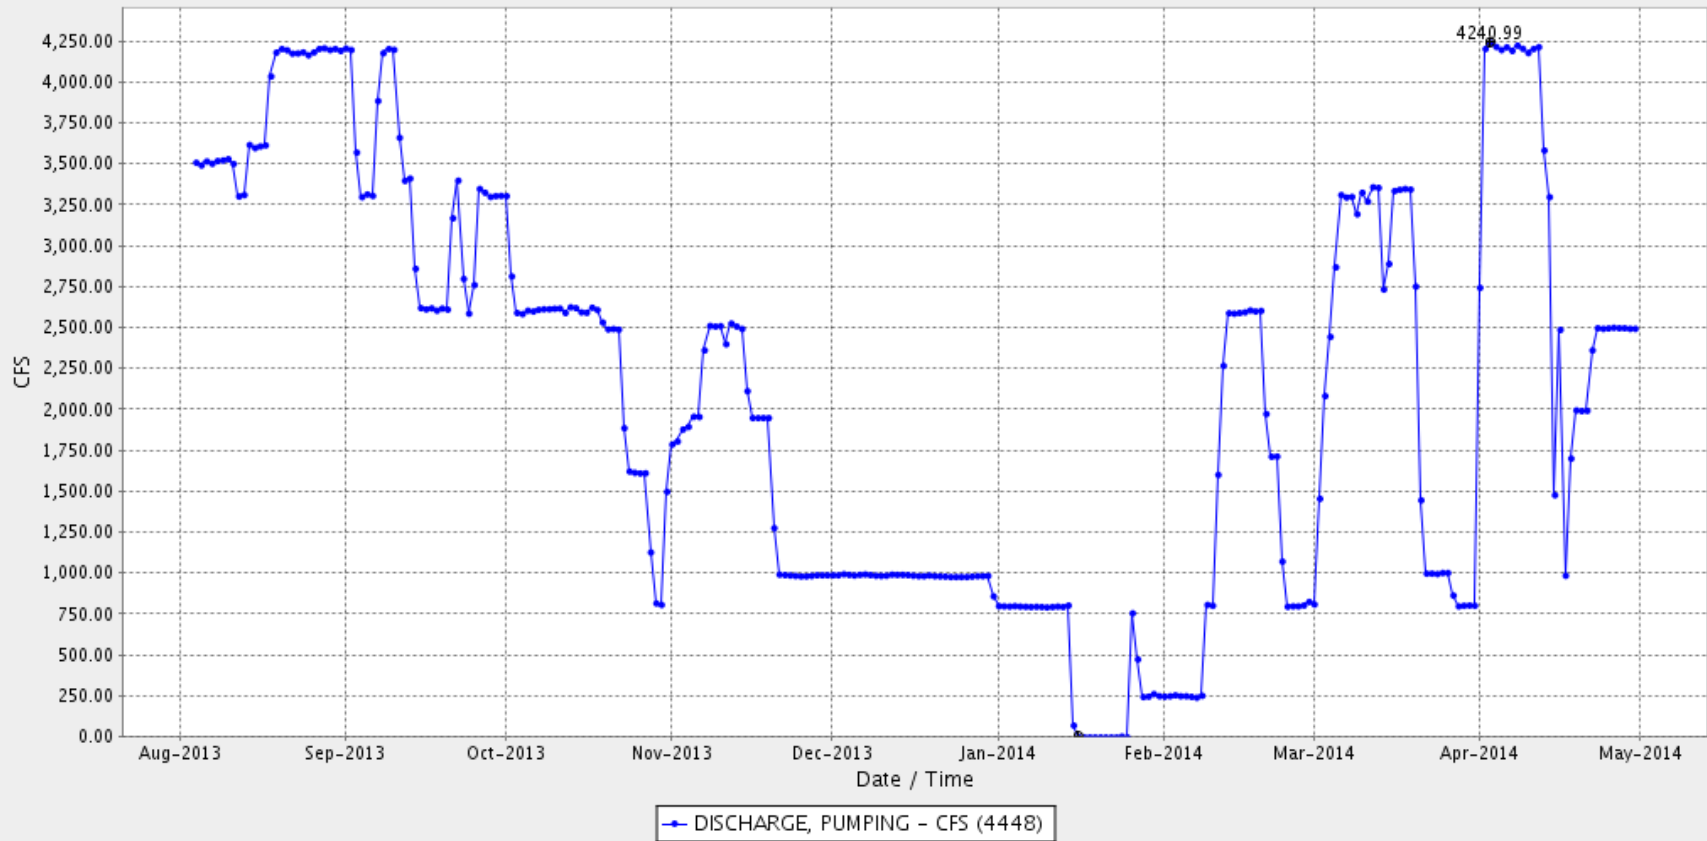


Source: cdec.water.ca.gov TRP

TRACY PUMPING PLANT (TRP)

Date from 04/04/2014 11:58 through 12/30/2014 11:58 Duration : 270 days

Max of period : (04/08/2014 00:00, 4225.37) Min of period: (06/08/2014 00:00, 0.0)

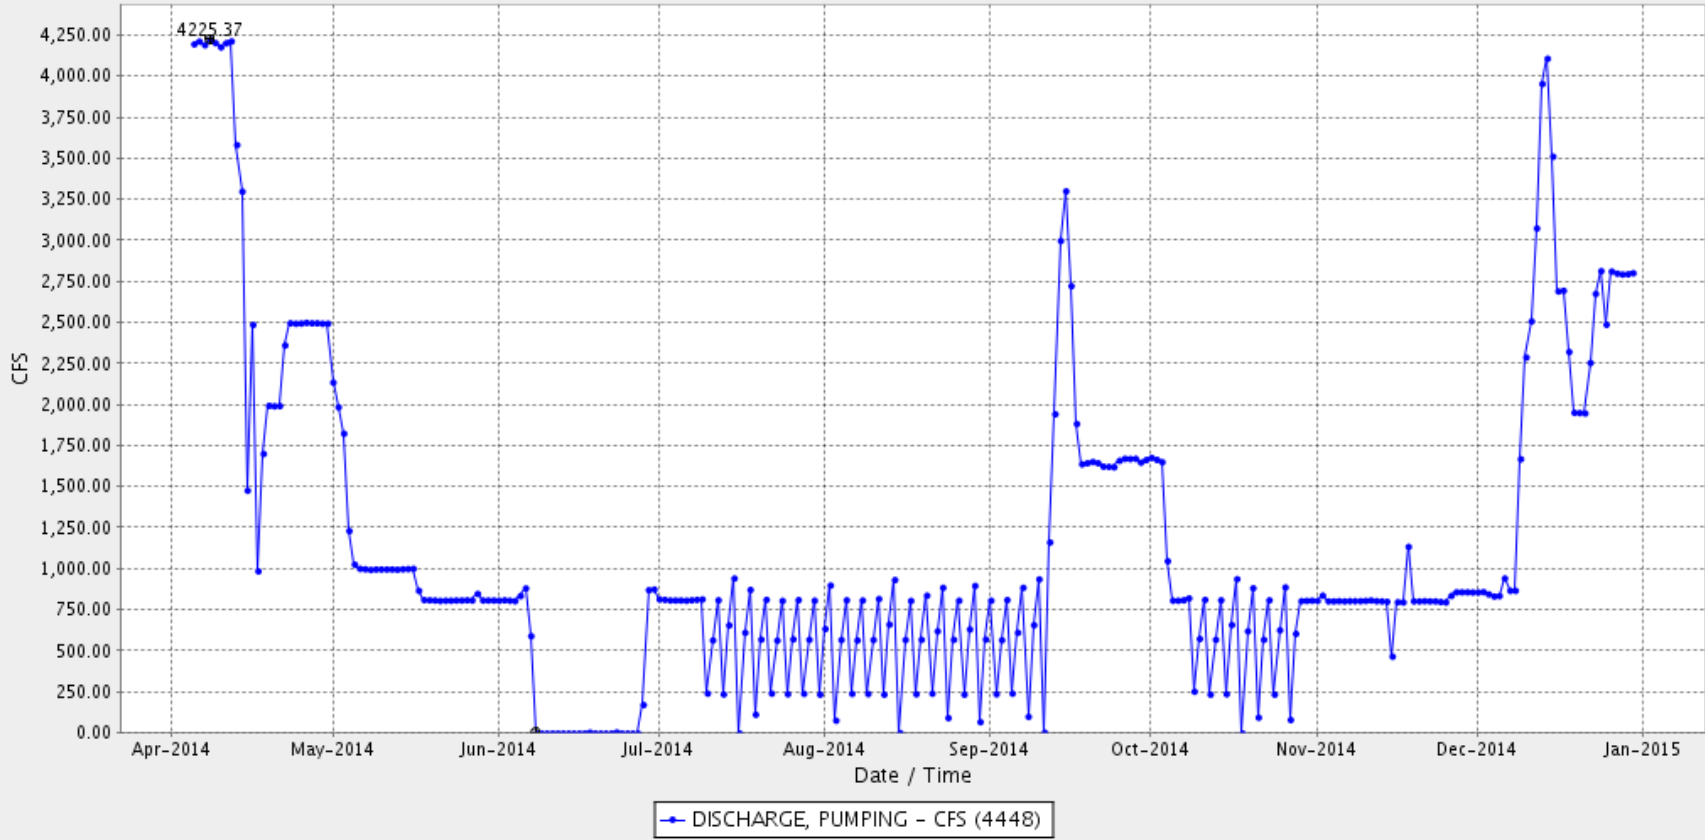

Source: cdec.water.ca.gov TRP