








EXHIBIT D

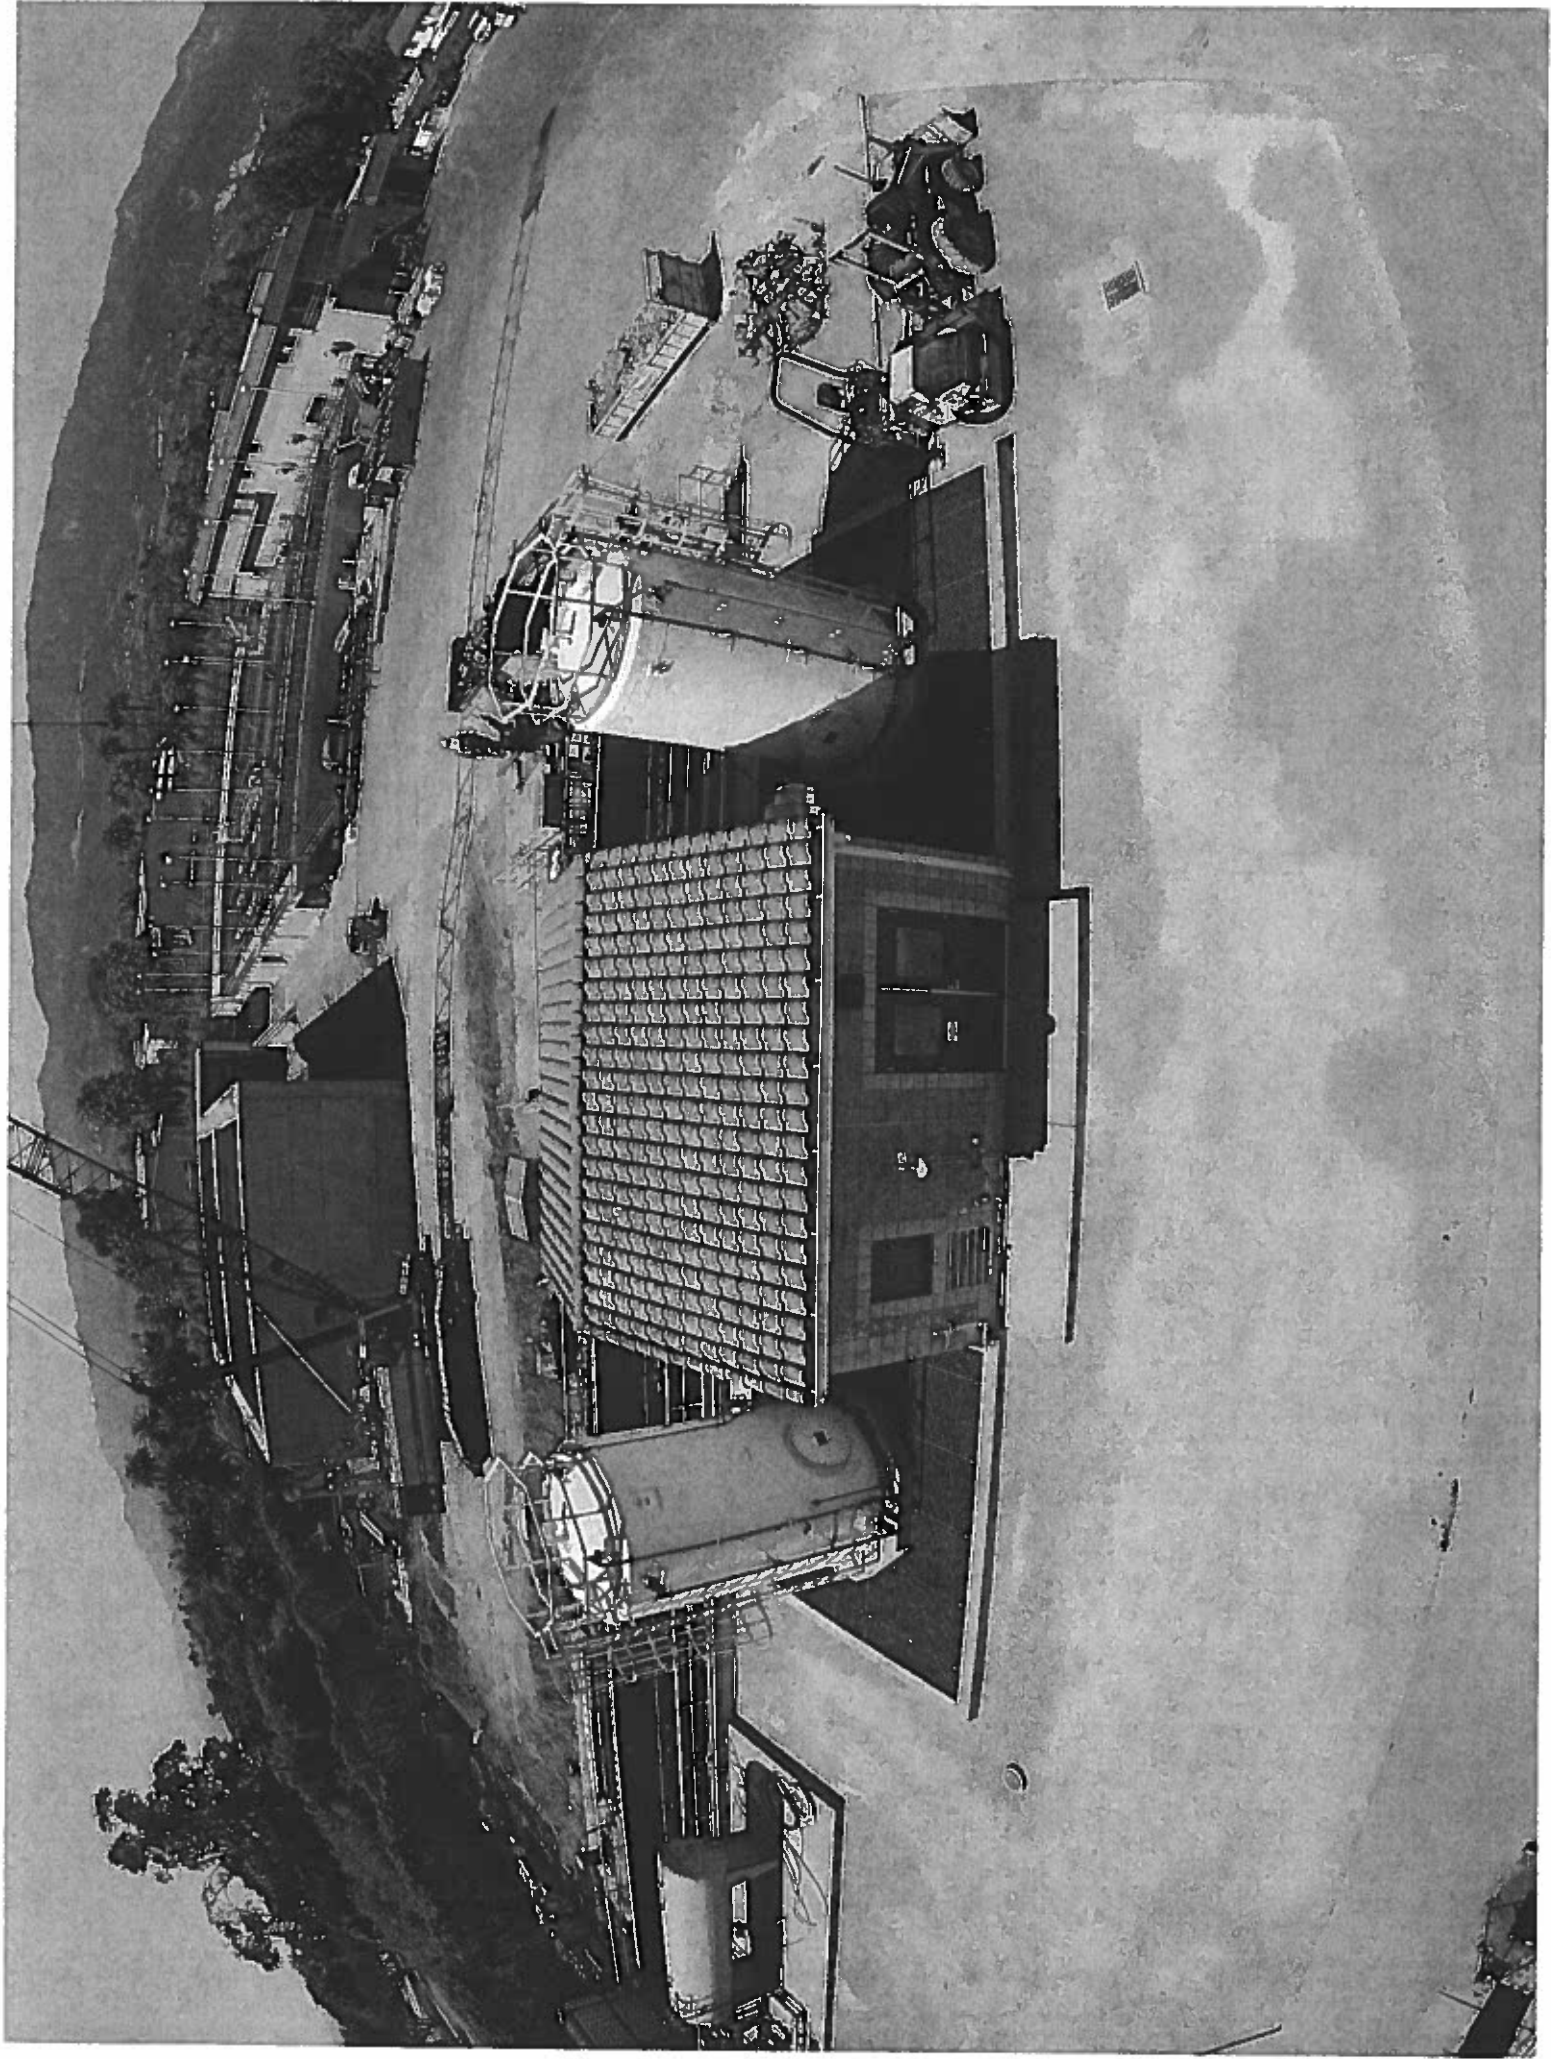


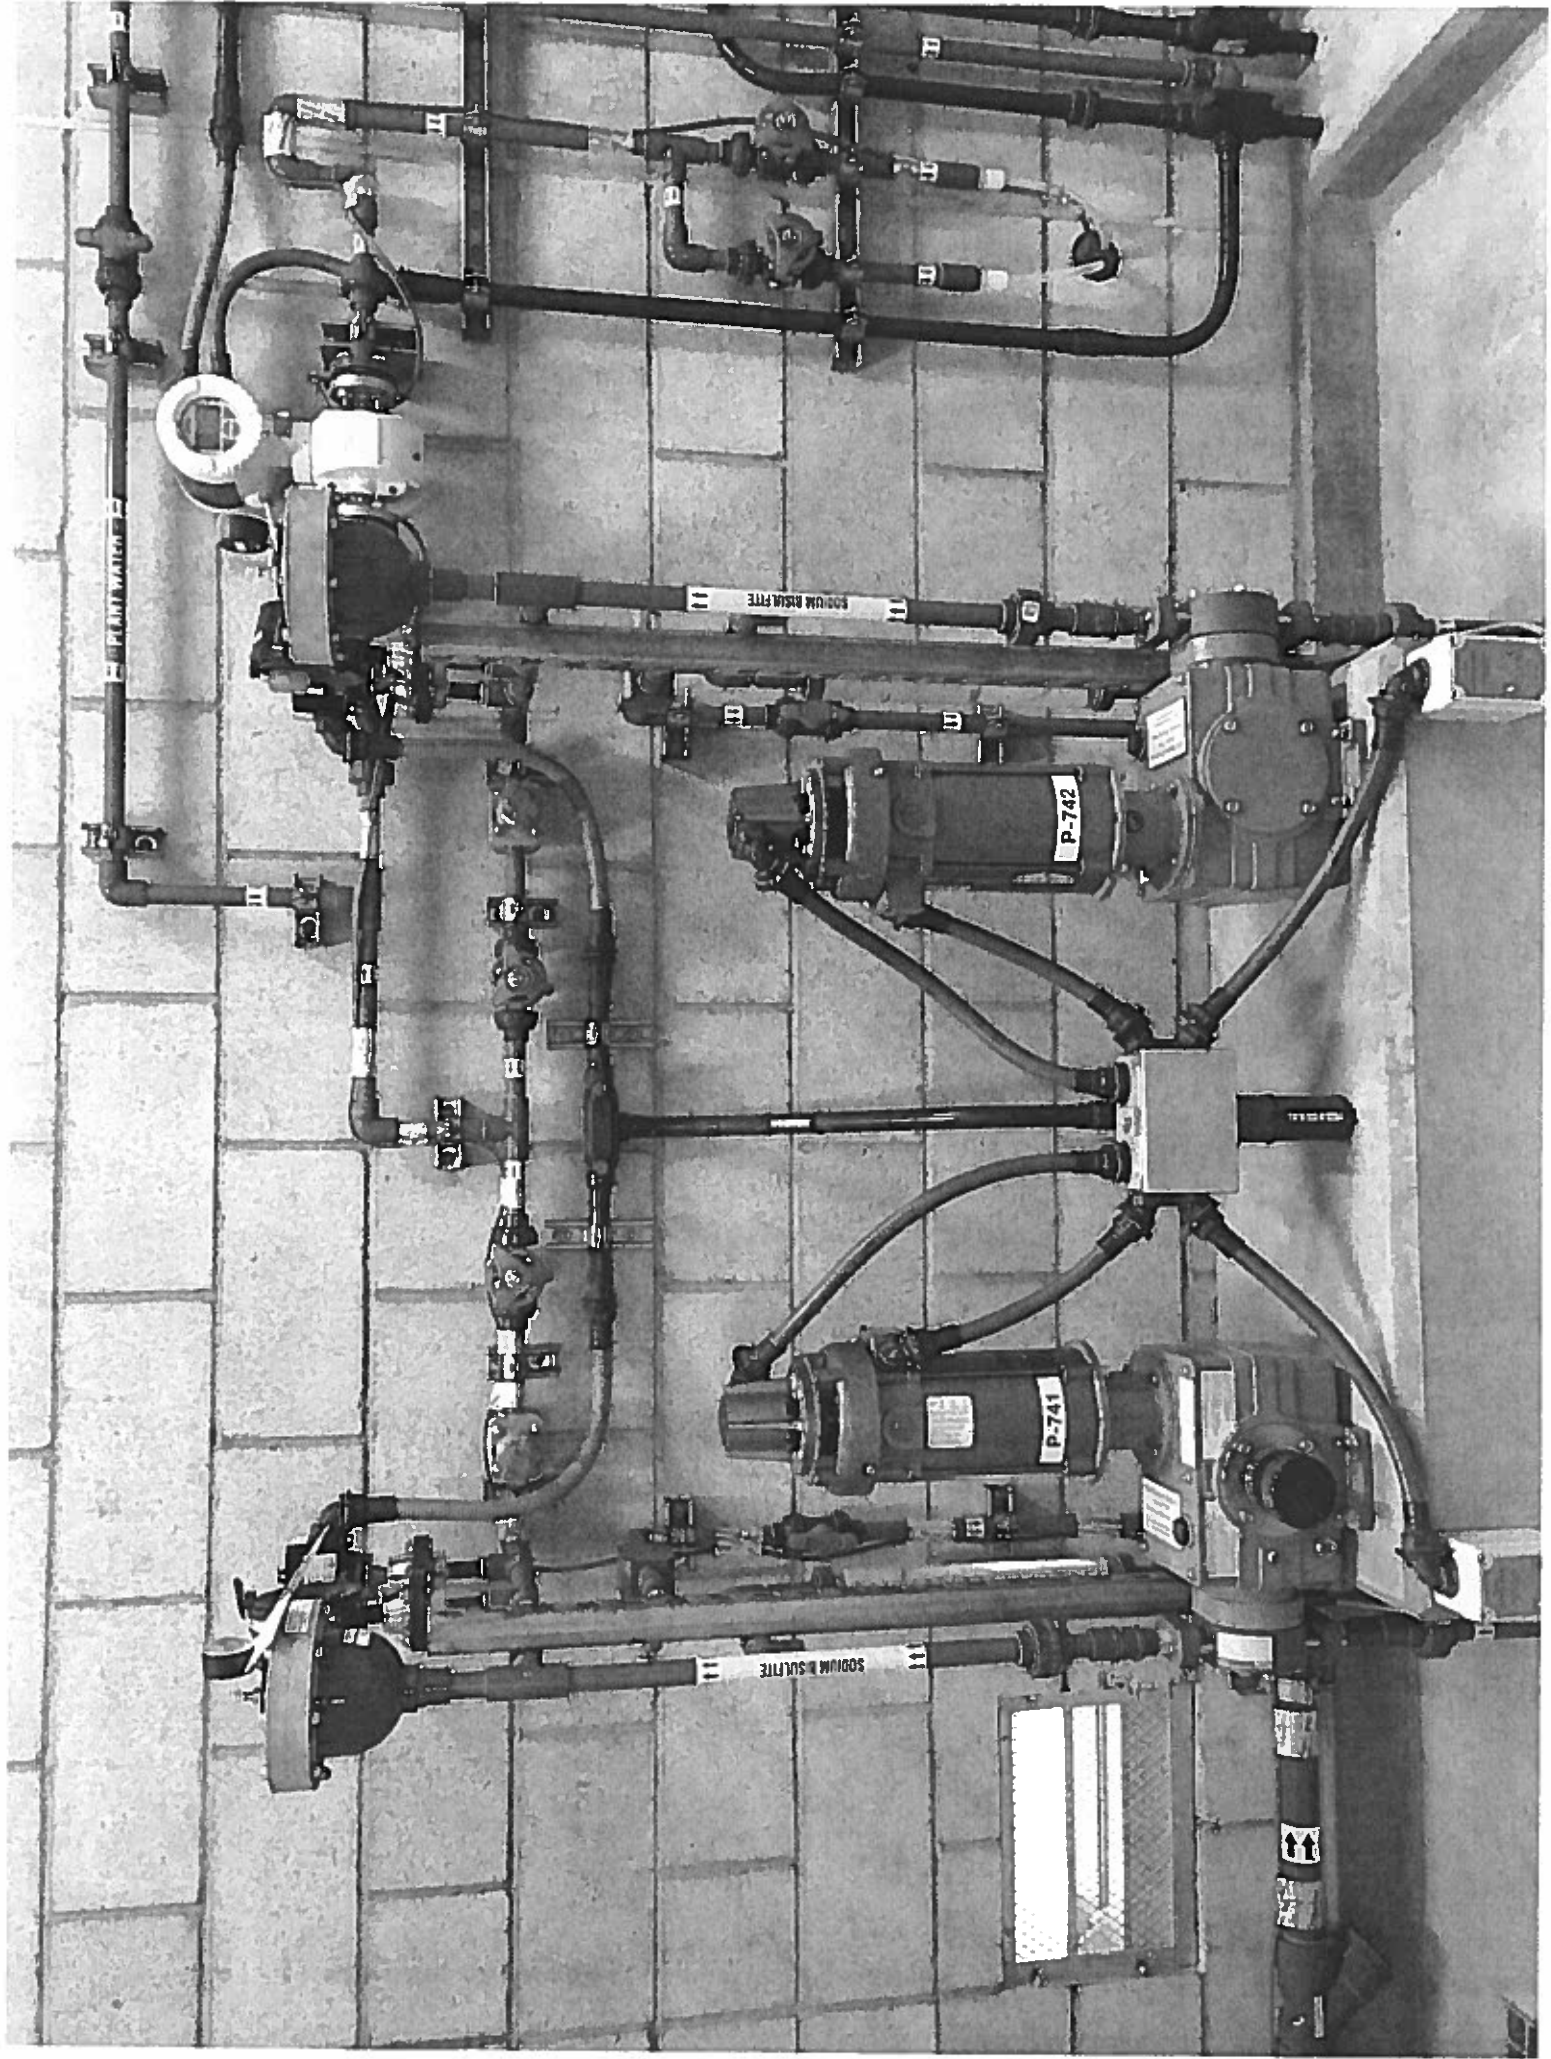

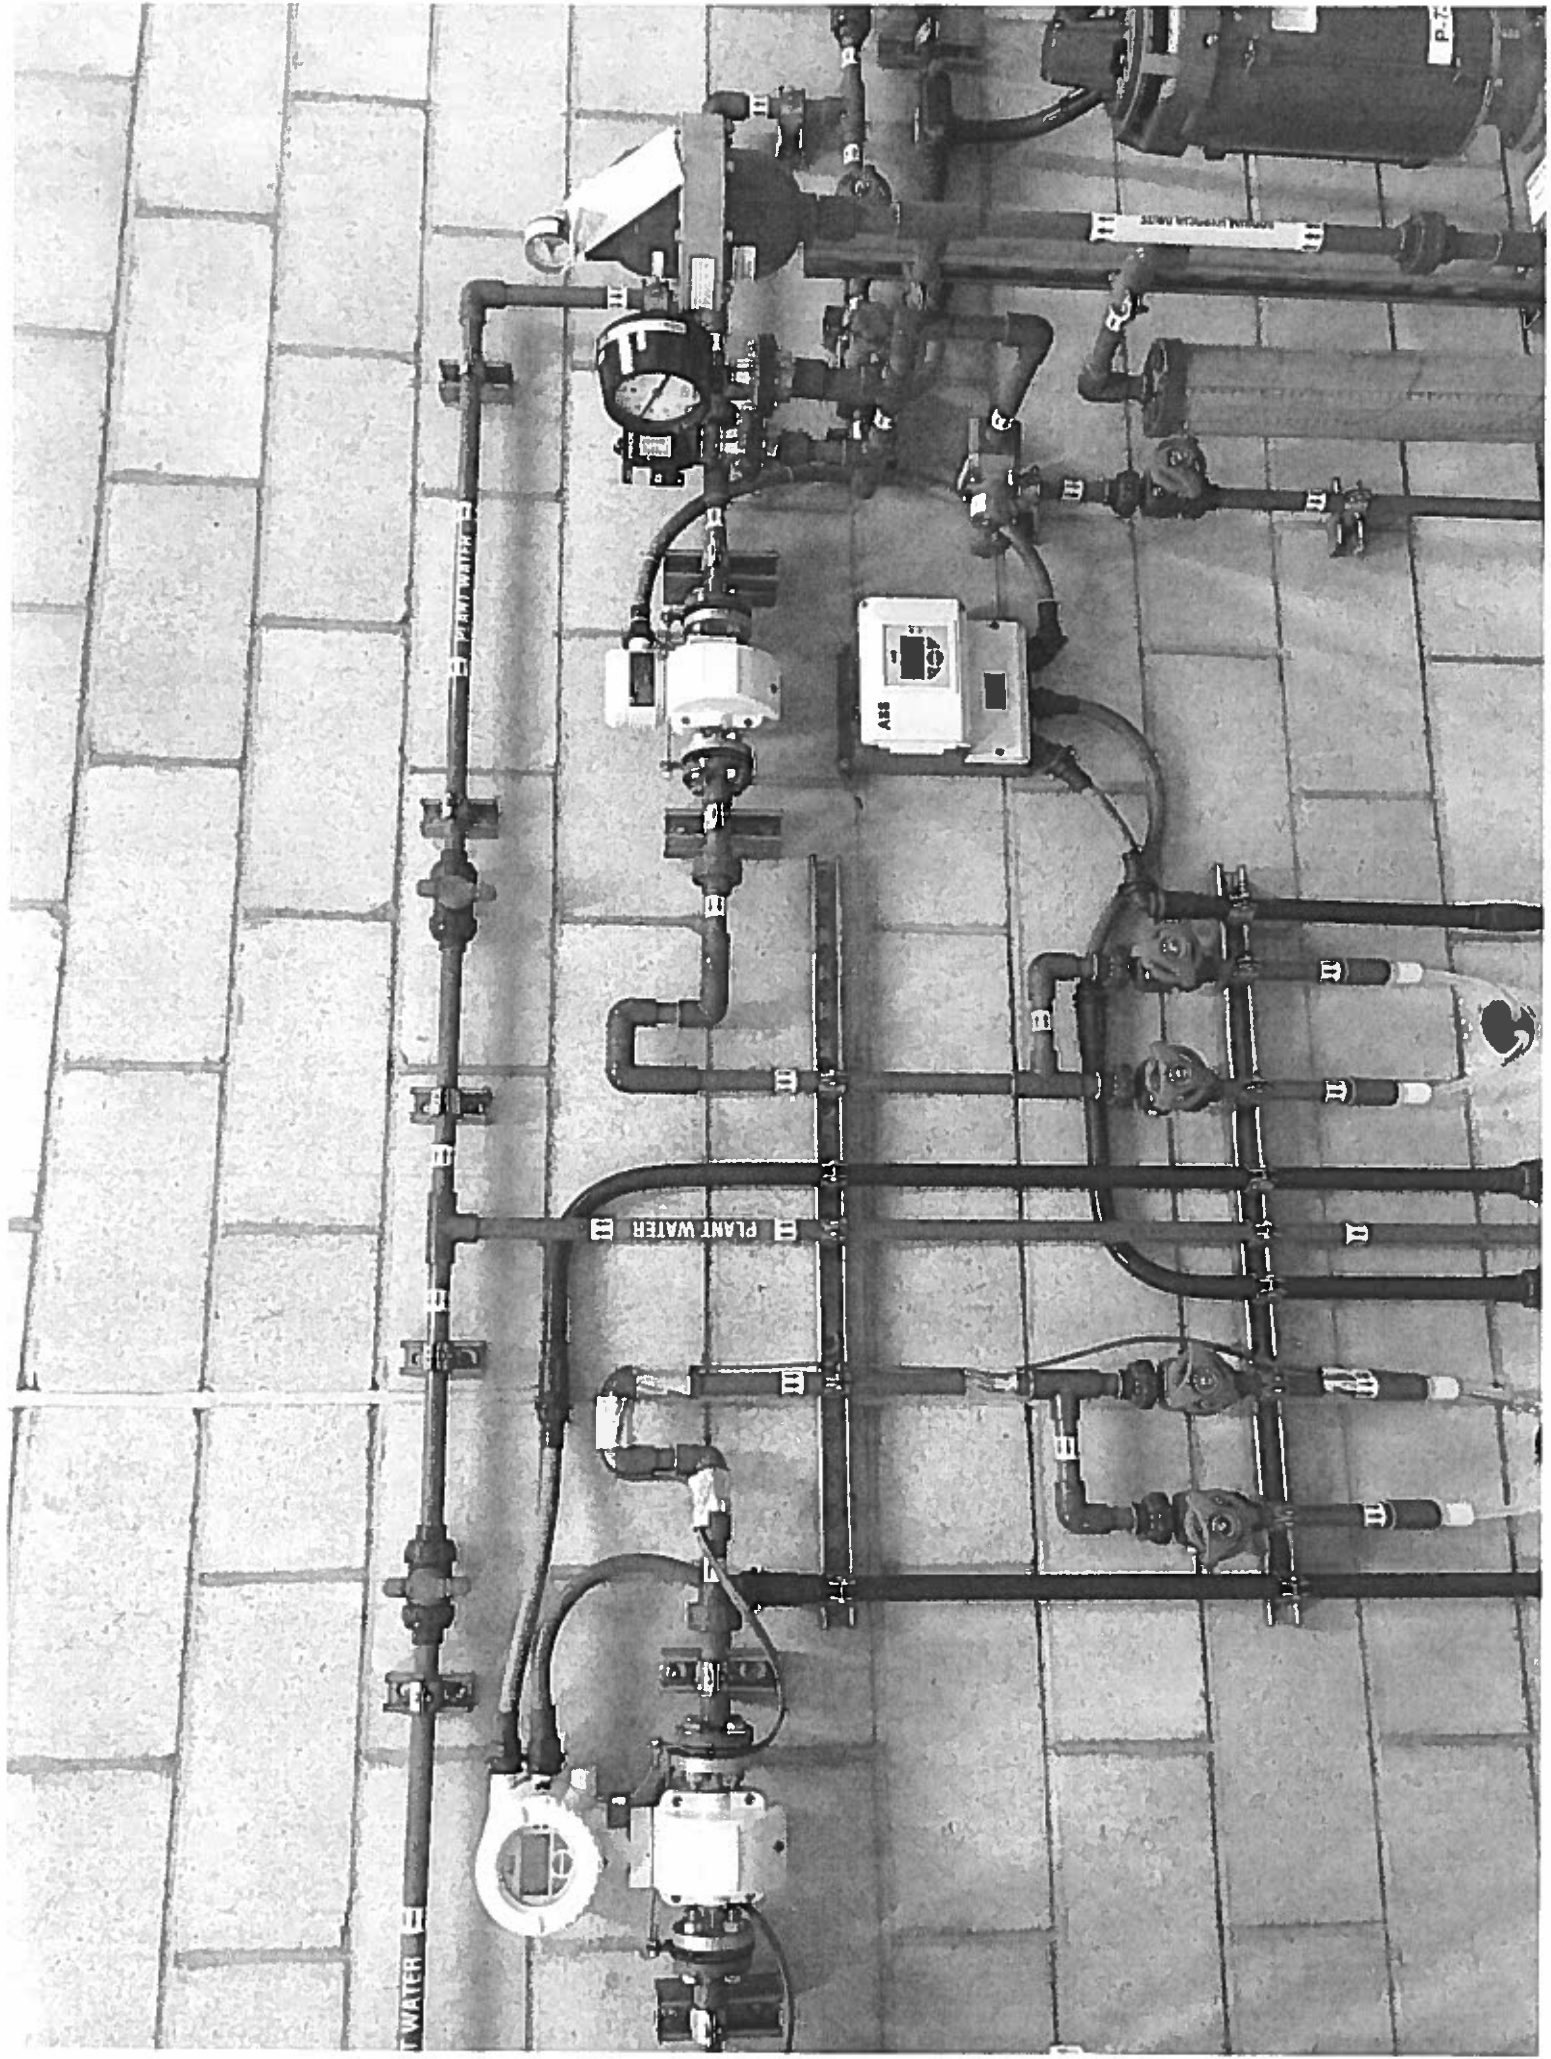


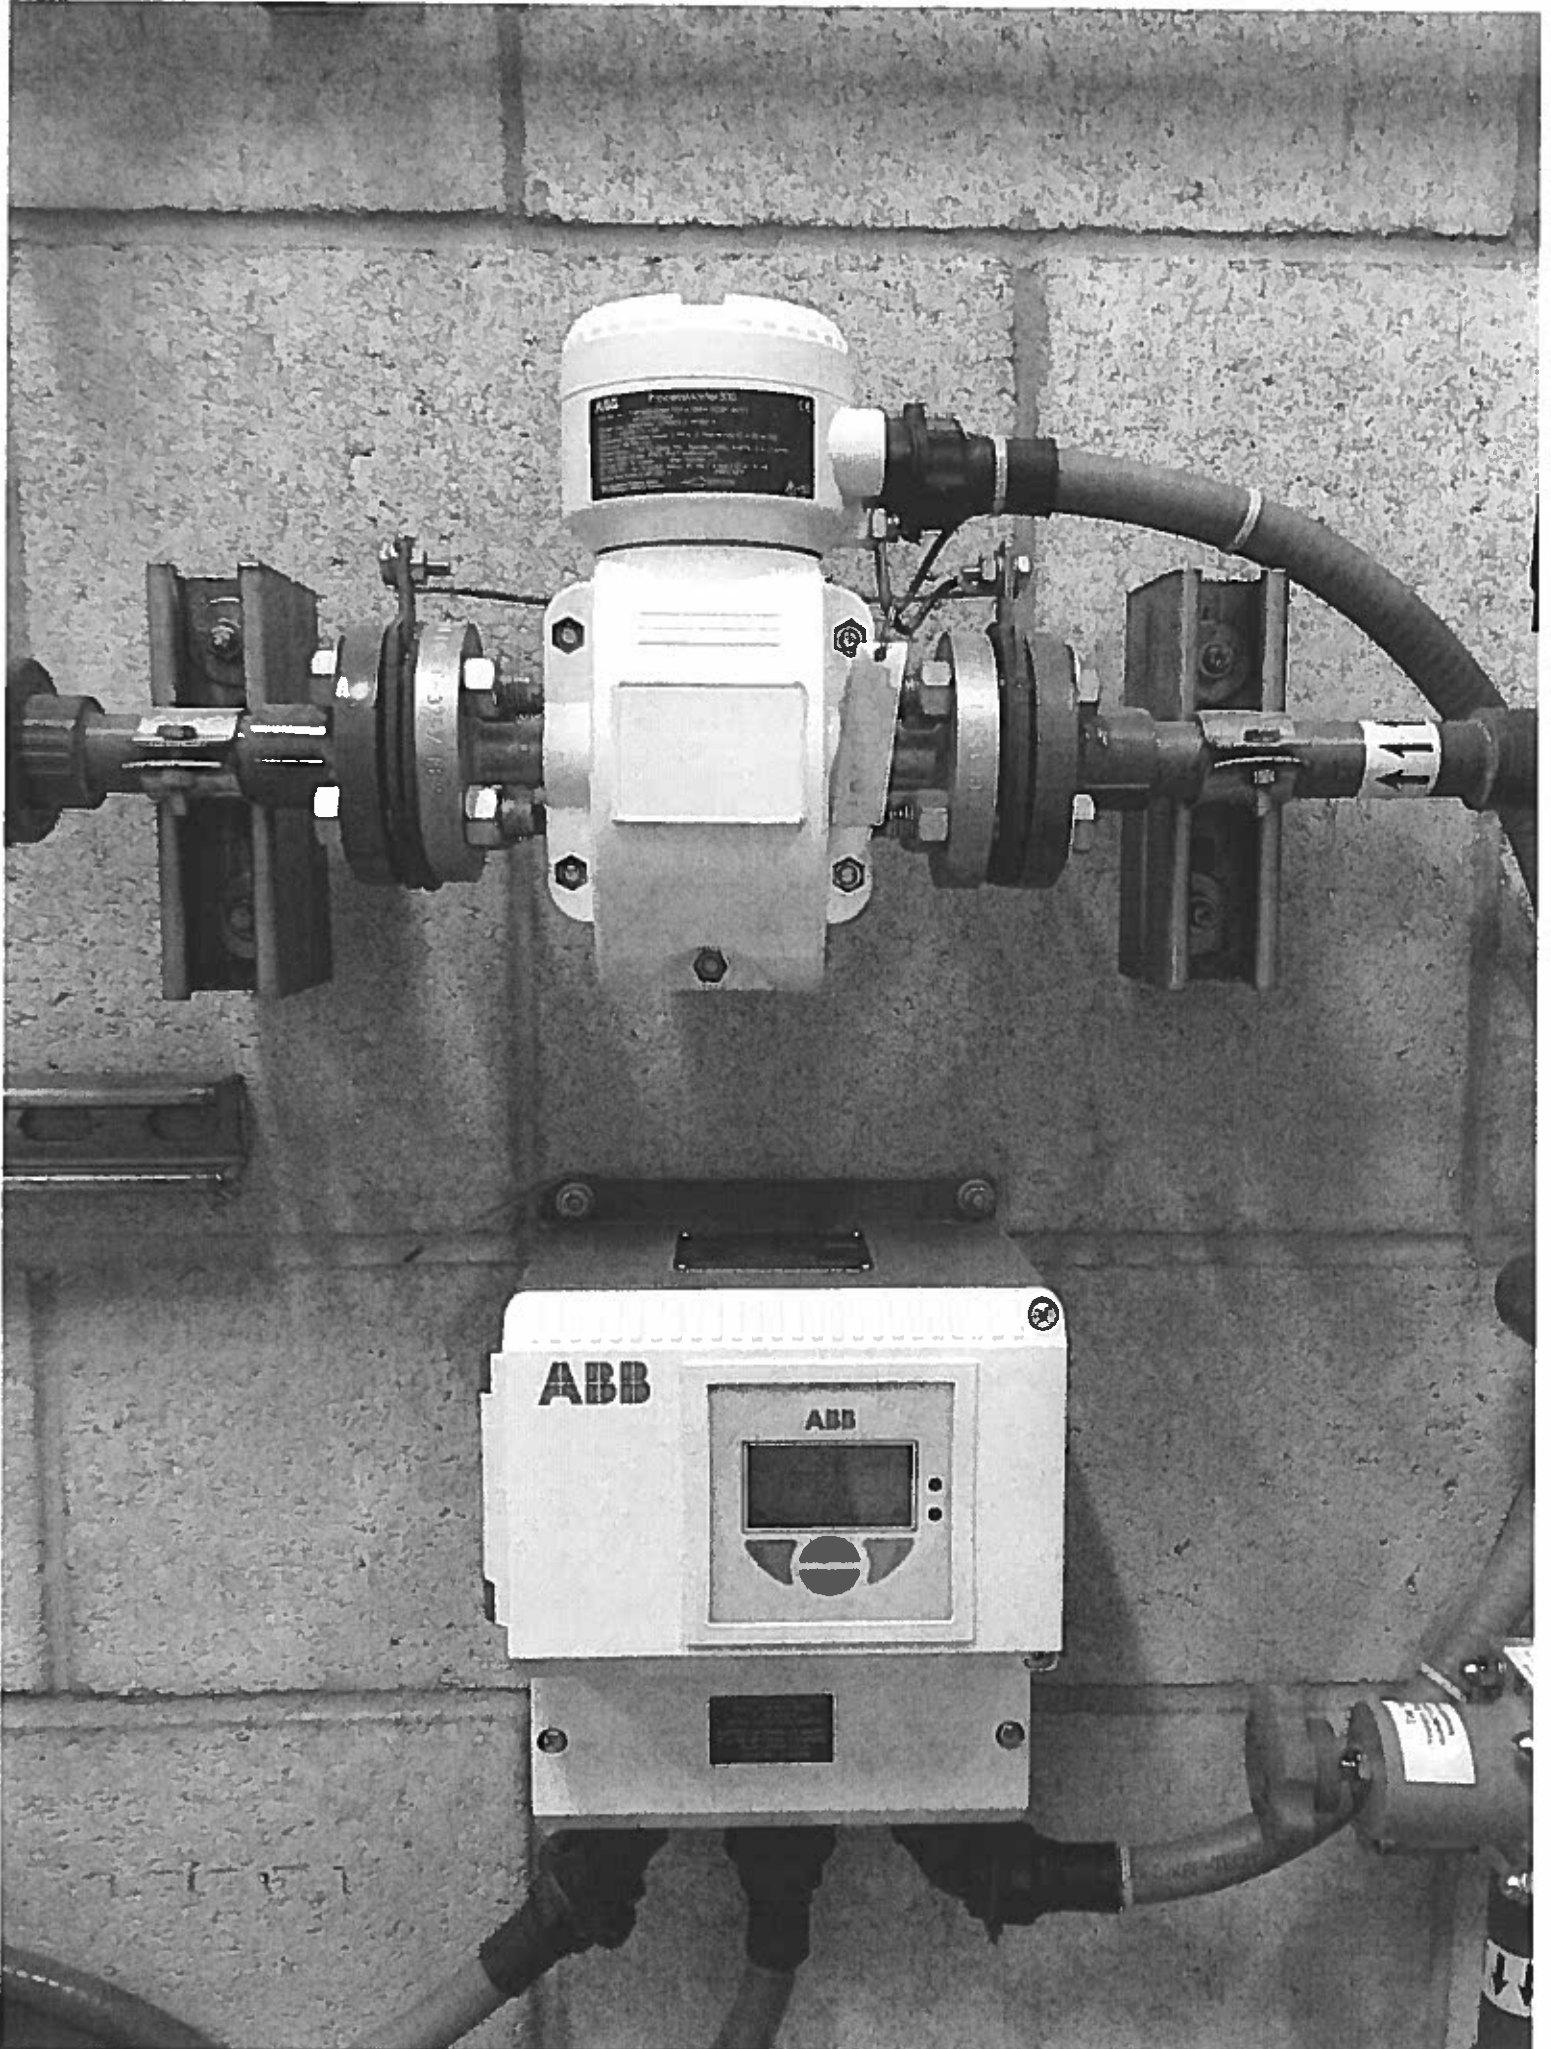

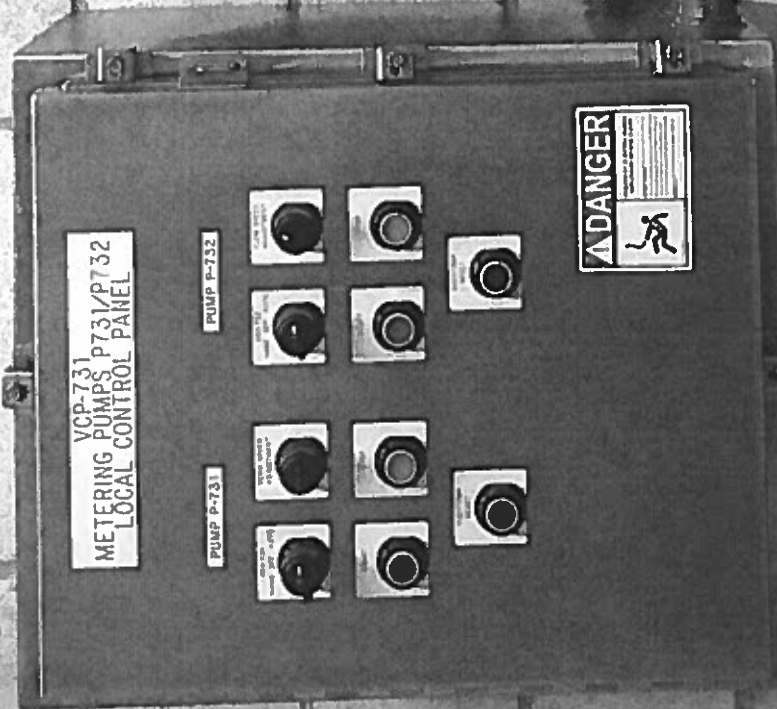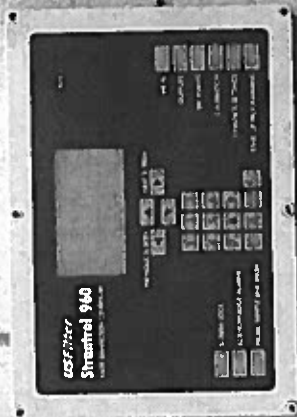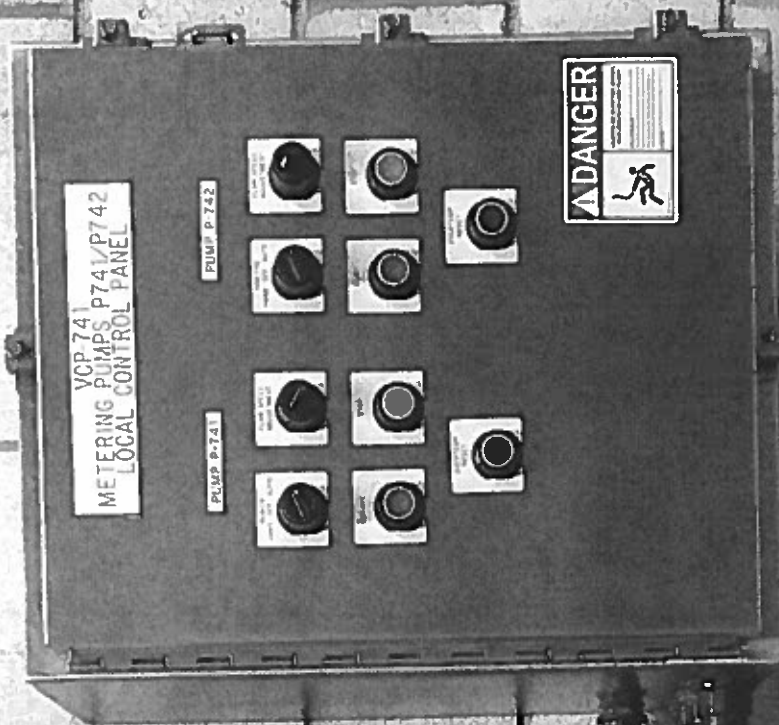


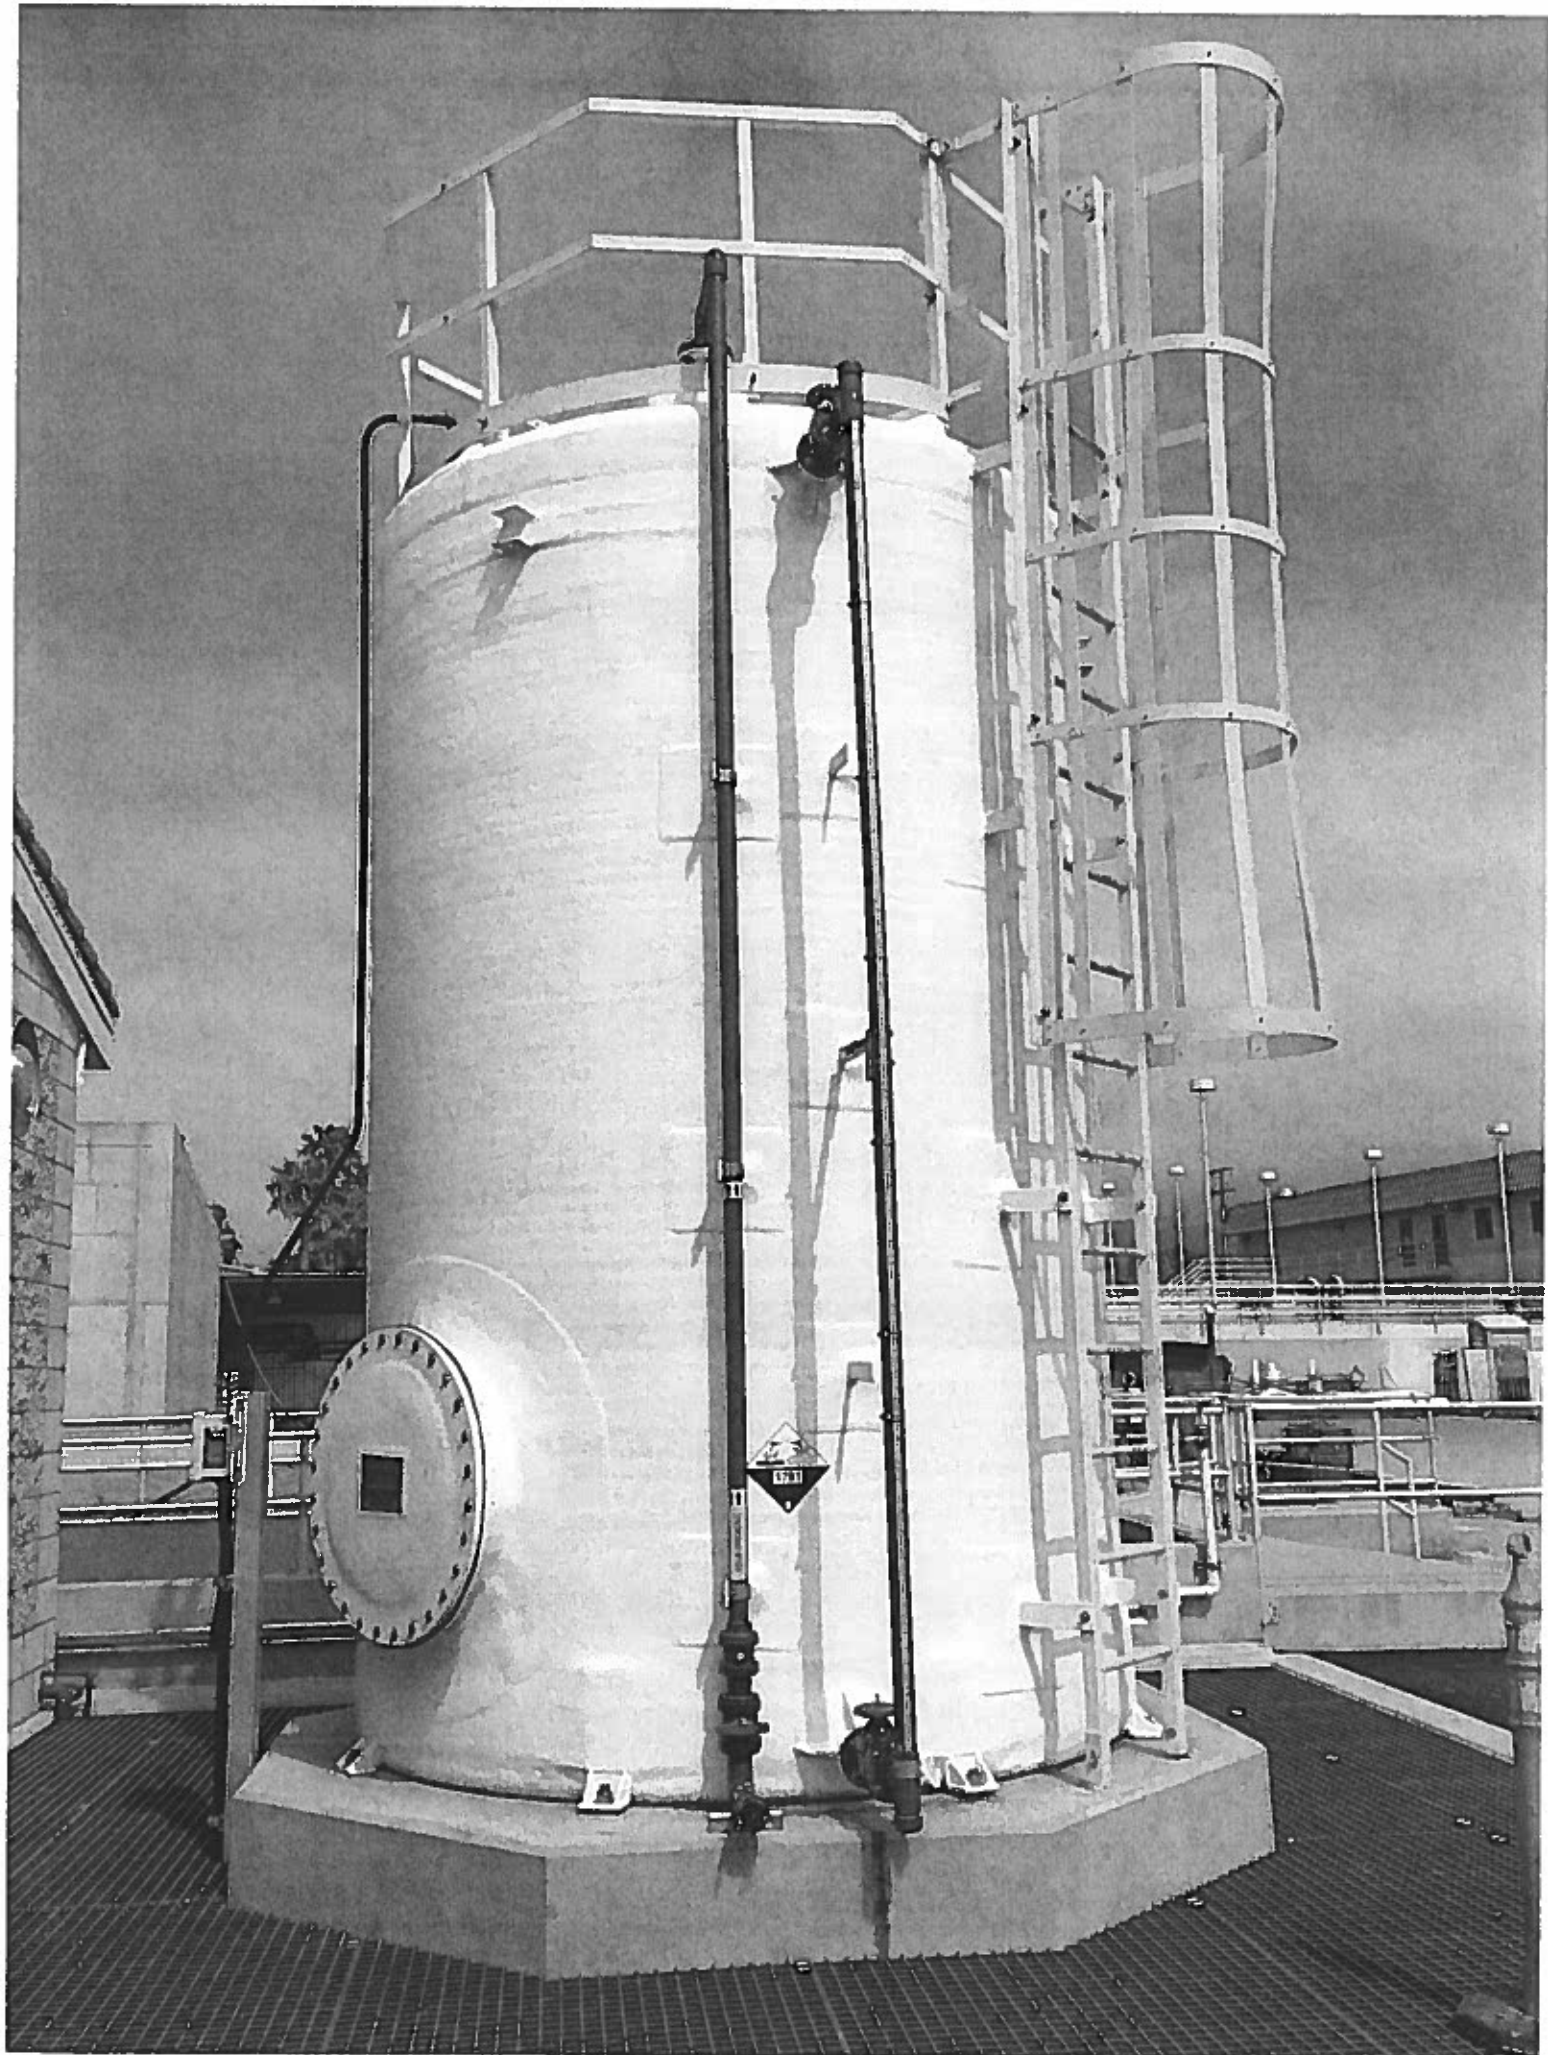

Disinfection and Plant Water

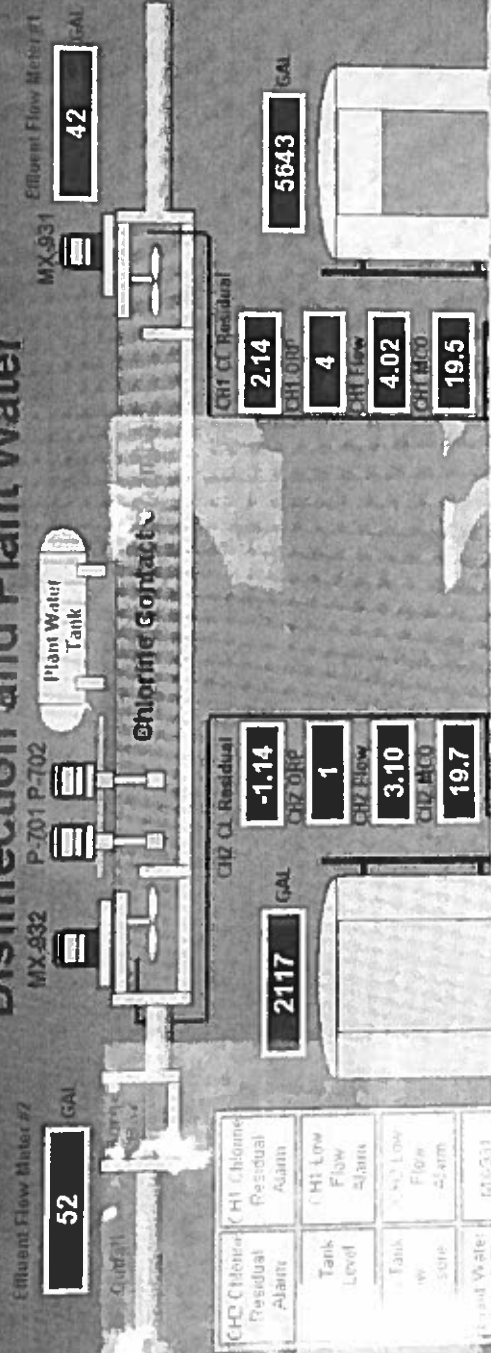

CH2 Chlorine Residual Alarm	CH1 Chlorine Residual Alarm
Tank Level Alarm	CH1 Low Flow Alarm
Tank Low Flow Alarm	CH2 Low Flow Alarm
Plant Water	MIX301

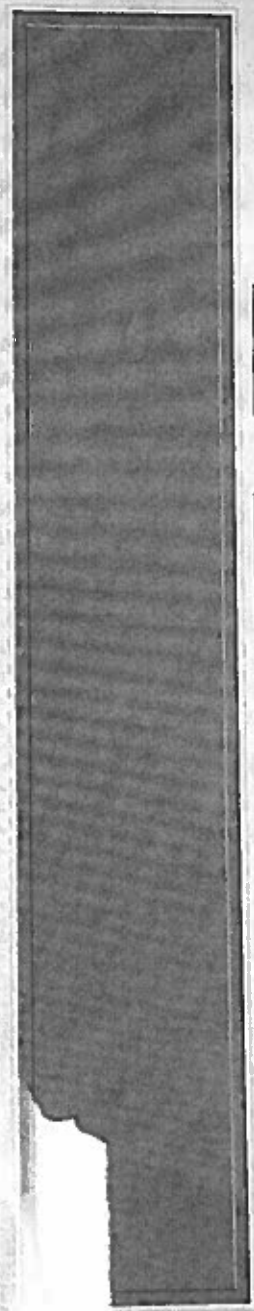

- Ack Alarm [F1]
- Silence Alarms [F2]
- Clear Alarm [F3]
- Close [F4]

22:08:28 8/21/18 07:14:18 05/17/2 04/27/53 07/27/65 08/01/6 10/01/78 Admin Only