

## Central Valley Regional Water Quality Control Board

22 July 2016

**CERTIFIED MAIL**  
**7014 2870 0000 7535 7617**

Nic Algra  
R.J. Gordon Construction, Inc.  
P.O. Box 23204  
Pleasant Hill, CA 94523

**CERTIFIED MAIL**  
**7014 2870 0000 7535 7624**

Kimberly Korth  
Ox Bow Marina Mutual Water Co.  
100 Ox Bow Marina Dr.  
Isleton, CA 95641

**CERTIFIED MAIL**  
**7014 3490 0001 3008 1896**

Chris Voelker  
Greenfields Turf, Inc.  
P.O. Box 248  
Greenfield, CA 93927

## NOTICE OF APPLICABILITY

**WATER QUALITY ORDER 2003-0003-DWQ  
STATEWIDE WASTE DISCHARGE REQUIREMENTS FOR DISCHARGES TO LAND WITH A  
LOW THREAT TO WATER QUALITY  
OX BOW MARINA MUTUAL WATER COMPANY WATER SUPPLY PROJECT  
SACRAMENTO COUNTY**

R.J Gordon Construction, Inc. submitted a Notice of Intent (NOI) dated 13 July 2016 to obtain coverage under Water Quality Order 2003-0003-DWQ, *Statewide General Waste Discharge Requirements for Discharges to Land with a Low Threat to Water Quality* (hereafter General Order) for construction dewatering at the above-referenced site. Additional information was received on 19 July and 22 July 2016. The submittals contain all the information required to evaluate applicability of the General Order; therefore, the NOI is considered complete. Based on the information provided in the NOI, the discharge meets the conditions of the General Order. The discharge is hereby covered under State Water Resources Control Board General Order 2003-0003-DWQ-0150. Please include this number on all correspondence related to this discharge.

### PROJECT LOCATION

The Ox Bow Marina Mutual Water Company Water Supply Project (Water Supply Project) is located in the City of Isleton and the Ox Bow Marina in Sacramento County and involves the connection of potable water from the City of Isleton to the Ox Bow Marina Community. The proposed water pipeline will start near the City Corp Yard on 6<sup>th</sup> Street and continues southeast across farmland to the Ox Bow Marina as shown on Attachment A.

The Water Quality Control Plan for the Sacramento River and San Joaquin River Basins, Fourth Edition, revised October 2011 (hereafter Basin Plan), designates beneficial uses, establishes water quality objectives, contains implementation plans and policies for protecting waters of the basin, and incorporates by reference plans and policies adopted by the State Water Resources Control Board. Pursuant to §13263(a) of the California Water Code (CWC), waste discharge requirements must implement the Basin Plan.

## **PROJECT DESCRIPTION**

The Water Supply Project involves the following:

1. Installation of approximately 5,300 linear feet of 12-inch diameter water line from an existing water main on 6<sup>th</sup> street, in the City of Isleton, to the Ox Bow Marina through existing farm land.
2. Installation of approximately 3,700 linear feet of 8-inch diameter and 2,000 linear feet of 4-inch diameter water line within the Ox Bow Marina community.

It is anticipated that groundwater will be encountered during the trenching operations. The encountered groundwater will be pumped into settling tanks. From the settling tanks, the water will be used during the pipeline construction activities for dust control and/or soil moisture conditioning along the pipeline corridor or discharged for irrigation use on a 37-acre farm property (APN 159-010-080) via a temporary sprinkler system. Greenfields Turf, Inc. the owner of the farm property has authorized irrigation reuse of the excavation groundwater for the duration of the project. Dewatering activities will begin shortly after receipt of this NOA and are expected to last approximately three weeks. Pumping rates are anticipated to be between 0 - 200 gallons per minute. Water discharged to the farm land will not be allowed to run off-site or pond for more the than 72 hours. To prevent run-off, the volume of water will be discharged such that the amounts will either evaporate or infiltrate the soil.

## **FACILITY-SPECIFIC REQUIREMENTS**

The General Order and this Notice of Applicability regulates construction dewatering and reuse of the dewatered groundwater at the Ox Bow Marina Mutual Water Company Water Supply Project.

1. Water generated during construction dewatering shall be disposed of as described in the Notice of Intent and in accordance with the requirements contained in the General Order.
2. Construction dewatering discharge at a location or in a manner different from that described in the Notice of Intent or this Notice of Applicability is prohibited.
3. All technical reports required herein that involve evaluation, or other work requiring interpretation and proper application of engineering or geologic sciences, shall be prepared by or under the direction of persons registered to practice in California pursuant to California Business and Professions Code, section 6735, 7835, and 7835.1. As required by these laws, completed technical reports must bear the signature(s) and seal(s) of the registered professional(s) in a manner such that all work can be clearly attributed to the professional responsible for the work.
4. The Discharger shall submit the required annual fee (as specified in the annual billing issued by the State Water Resources Control Board) until the Notice of Applicability is officially terminated. To avoid being billed for the annual fee for next fiscal year, please submit a Notice of Termination following completion of the discharge.
5. Failure to abide by the conditions of the General Order, including its monitoring and reporting requirements, and this letter authorizing applicability could result in enforcement actions, as authorized by provisions of the California Water Code.

## DOCUMENT SUBMITTALS

All monitoring reports and other correspondence should be converted to searchable Portable Document Format (PDF) and submitted electronically. Documents that are less than 50 MB should be emailed to:

*centralvalleysacramento@waterboards.ca.gov.*

To ensure that your submittal is routed to the appropriate staff person, the following information should be included in the body of the email or any documentation submitted to the mailing address for this office:

Facility Name: Ox Bow Marina Mutual Water Company Water Supply Project, Sacramento County		
Program: Non-15 Compliance	Order: 2003-0003-DWQ-0150	CIWQS Place ID: 826524

Documents that are 50 MB or larger should be transferred to a CD, DVD, or flash drive and mailed to:

Central Valley Regional Water Quality Control Board  
ECM Mailroom  
11020 Sun Center Drive, Suite 200  
Rancho Cordova, CA 95670


Now that the NOA has been issued, the Board's Compliance and Enforcement section will take over management of your case. Guy Childs is your new point of contact for any questions about the Order. In addition, all monitoring and technical reports should be submitted to him. The enclosed transmittal sheet shall be included with each monitoring report. If you find it necessary to make a change to your permitted operations, Guy will direct you to the appropriate Permitting staff. You may contact Guy at (916) 464-4648 or at *gchilds@waterboards.ca.gov*

- original signed by Andrew Altevogt -

PAMELA C. CREEDON  
Executive Officer

Enclosures: Attachment A  
Water Quality Order No. 2003-0003-DWQ  
Monitoring Report Submittal Transmittal Form

Cc w/o encl: Tim O'Brien, State Water Resources Control Board, Sacramento  
Sacramento County Environmental Management Department, Sacramento

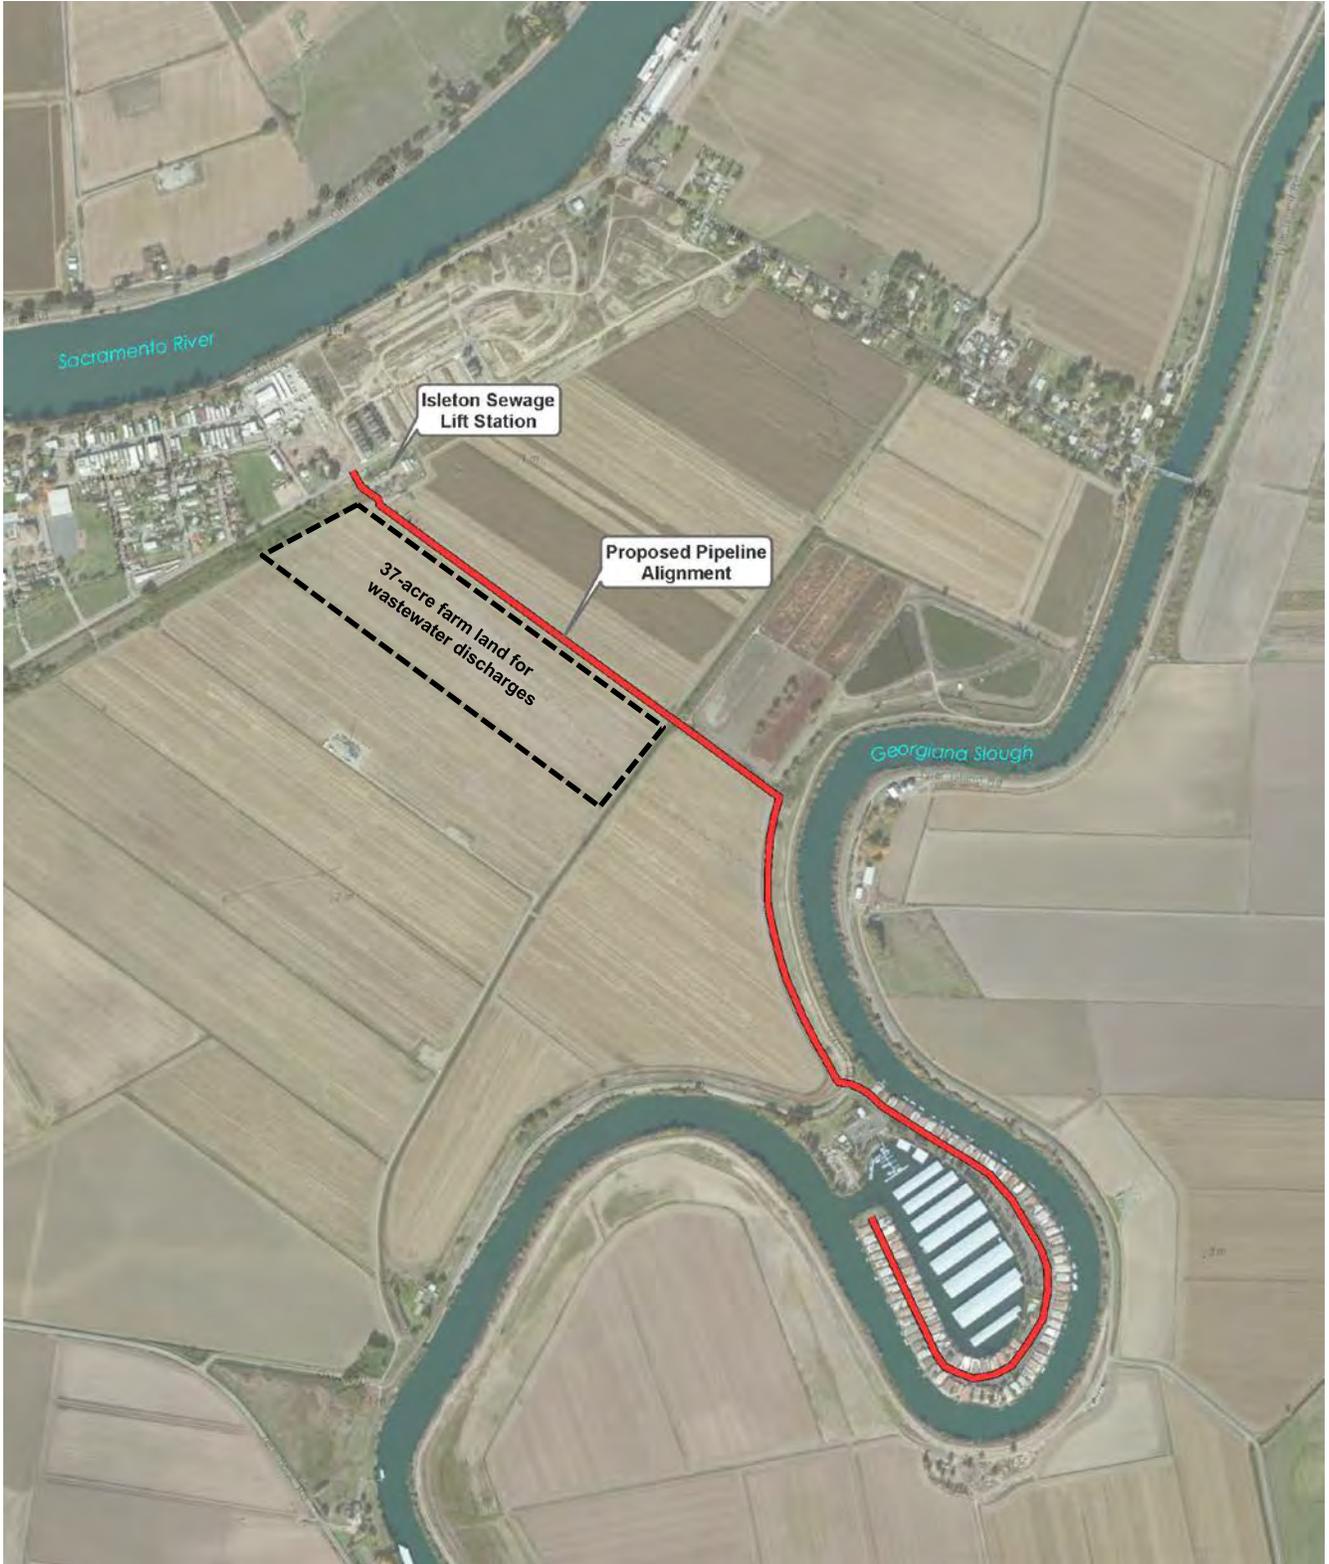

Drawing Reference:  
Initial Study/Mitigated  
Negative Declaration,  
Stantec, Dec 2014

**PROJECT LOCATION MAP**  
OX BOW MARINA MUTUAL WATER COMPANY  
WATER SUPPLY PROJECT  
SACRAMENTO COUNTY

