

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD**

**CENTRAL VALLEY REGION**

11020 Sun Center Drive, #200 Rancho Cordova, California 95670-6114  
Phone (916) 464-3291 • Fax (916) 464-4645  
<http://www.waterboards.ca.gov/centralvalley>

**ORDER R5-2013-0076**  
**NPDES NO. CA0079367**

**WASTE DISCHARGE REQUIREMENTS FOR THE  
PLACER COUNTY DEPARTMENT OF FACILITY SERVICES  
PLACER COUNTY SEWER MAINTENANCE DISTRICT 3  
WASTEWATER TREATMENT PLANT  
PLACER COUNTY**

The following Discharger is subject to waste discharge requirements as set forth in this Order:

**Table 1. Discharger Information**

<b>Discharger</b>	Placer County Department of Facility Services
<b>Name of Facility</b>	Placer County Sewer Maintenance District 3 Wastewater Treatment Plant
<b>Facility Address</b>	4928 Auburn Folsom Road
	Loomis, CA 95650
	Placer County
The U.S. Environmental Protection Agency (USEPA) and the Regional Water Quality Control Board have classified this discharge as a minor discharge.	

The discharge by the Placer County Department of Facility Services from the discharge points identified below is subject to waste discharge requirements as set forth in this Order:

**Table 2. Discharge Location**

<b>Discharge Point</b>	<b>Effluent Description</b>	<b>Discharge Point Latitude</b>	<b>Discharge Point Longitude</b>	<b>Receiving Water</b>
001	Treated Municipal Wastewater	38° 47' 51" N	121° 8' 8" W	Miners Ravine

**Table 3. Administrative Information**

This Order was adopted by the Regional Water Quality Control Board on:	<b>31 May 2013</b>
This Order shall become effective on:	<b>20 July 2013</b>
This Order shall expire on:	<b>1 May 2018</b>
The Discharger shall file a Report of Waste Discharge in accordance with title 23, California Code of Regulations, as application for issuance of new waste discharge requirements no later than:	<b>20 January 2018</b>

I, **PAMELA C. CREEDON**, Executive Officer, do hereby certify that this Order with all attachments is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on **31 May 2013**.

*Original Signed By Kenneth D. Landau for*

**PAMELA C. CREEDON**, Executive Officer

## Table of Contents

I.	Facility Information .....	3
II.	Findings .....	3
III.	Discharge Prohibitions.....	10
IV.	Effluent Limitations and Discharge Specifications .....	10
	A. Effluent Limitations – Discharge Point No. 001 .....	10
	B. Land Discharge Specifications – Not Applicable.....	11
	C. Reclamation Specifications – Not Applicable.....	11
V.	Receiving Water Limitations .....	11
	A. Surface Water Limitations.....	11
	B. Groundwater Limitations .....	14
VI.	Provisions .....	14
	A. Standard Provisions.....	14
	B. Monitoring and Reporting Program Requirements.....	18
	C. Special Provisions.....	18
	1. Reopener Provisions.....	18
	2. Special Studies, Technical Reports and Additional Monitoring Requirements.....	19
	3. Best Management Practices and Pollution Prevention .....	22
	4. Construction, Operation and Maintenance Specifications.....	22
	5. Special Provisions for Municipal Facilities (POTWs Only) .....	23
	6. Other Special Provisions.....	24
	7. Compliance Schedules .....	25
VII.	Compliance Determination .....	25

## List of Tables

Table 1.	Discharger Information .....	1
Table 2.	Discharge Location.....	1
Table 3.	Administrative Information .....	1
Table 4.	Facility Information .....	3
Table 5.	Basin Plan Beneficial Uses.....	5
Table 6.	Effluent Limitations .....	10

## List of Attachments

Attachment A – Definitions .....	A-1
Attachment B – Maps .....	B-1
Attachment C – Flow Schematic.....	C-1
Attachment D – Standard Provisions.....	D-1
Attachment E – Monitoring and Reporting Program .....	E-1
Attachment F – Fact Sheet.....	F-1
Attachment G – Summary of Reasonable Potential Analysis for Constituents of Concern....	G-1
Attachment H – Calculation of WQBELs.....	H-1
Attachment I – Effluent and Receiving Water Characterization Study .....	I-1

**I. FACILITY INFORMATION**

The following Discharger is subject to waste discharge requirements as set forth in this Order:

**Table 4. Facility Information**

<b>Discharger</b>	Placer County Department of Facility Services
<b>Name of Facility</b>	Placer County Sewer Maintenance District 3 Wastewater Treatment Plant
<b>Facility Address</b>	4928 Auburn Folsom Road
	Loomis, CA 95650
	Placer County
<b>Facility Contact, Title, and Phone</b>	Bill Zimmerman, Deputy Director of Facility Services, (530) 886-4900
<b>Mailing Address</b>	11476 C Avenue, Auburn, CA, 95603
<b>Type of Facility</b>	Publicly Owned Treatment Works (POTW)
<b>Facility Design Flow</b>	0.30 million gallons per day (MGD)

**II. FINDINGS**

The California Regional Water Quality Control Board, Central Valley Region (hereinafter Central Valley Water Board), finds:

**A. Background.** Placer County Department of Facility Services (hereinafter Discharger) is currently discharging pursuant to Order R5-2007-0070 and National Pollutant Discharge Elimination System (NPDES) Permit No. CA0079367. The Discharger submitted a Report of Waste Discharge, dated 2 December 2011 and applied for an NPDES permit renewal to discharge up to 0.30 MGD of treated wastewater from the Placer County Sewer Maintenance District 3 Wastewater Treatment Plant, hereinafter Facility. The application was deemed complete on 19 January 2012.

For the purposes of this Order, references to the “discharger” or “permittee” in applicable federal and state laws, regulations, plans, or policy are held to be equivalent to references to the Discharger herein.

**B. Facility Description.** The Discharger owns and operates a publicly owned treatment works (POTW). The treatment system consists of a primary clarifier, rock media trickling filter, secondary clarifier, flocculation, denitrifying sand filter, chlorine contact basin, and a sodium bisulfite dechlorination system. Wastewater is discharged from Discharge Point No. 001 (see table on cover page) to Miners Ravine, a water of the United States, and a tributary to Dry Creek, Natomas East Main Drainage Canal, Bannon Slough, and the Sacramento River within the Lower Sacramento watershed. Solids are temporarily stored on site and then hauled either to the Inviro Tec septage receiving station for additional handling and disposal in accordance with the industrial pretreatment permit administered by the City of Roseville, or to the Discharger’s Sewer Maintenance District 1 (SMD 1) Wastewater Treatment Plant. At the SMD 1 facility the solids are dewatered using a belt press and sludge drying beds and are disposed of at a landfill along with the solids generated by the SMD 1 facility. Attachment B provides a map of the area around the Facility. Attachment C provides a flow schematic of the Facility.

The Discharger is currently planning a regionalization project that will include construction of sewer connections and a pumping station to connect to the City of Roseville's Dry Creek Wastewater Treatment Plant. Once the connection is made, the Facility will no longer be used for wastewater treatment and discharge to Miners Ravine will cease. Pursuant to Cease and Desist Order (CDO) R5-2012-0005, the Discharger is required to complete the regionalization project by 31 December 2014.

- C. Legal Authorities.** This Order is issued pursuant to section 402 of the Clean Water Act (CWA) and implementing regulations adopted by USEPA and chapter 5.5, division 7 of the California Water Code (Water Code; commencing with section 13370). It shall serve as a NPDES permit for point source discharges from this facility to surface waters. This Order also serves as Waste Discharge Requirements (WDRs) pursuant to article 4, chapter 4, division 7 of the Water Code (commencing with section 13260).
- D. Background and Rationale for Requirements.** The Central Valley Water Board developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and other available information. The Fact Sheet (Attachment F), which contains background information and rationale for Order requirements, is hereby incorporated into this Order and constitutes part of the Findings for this Order. Attachments A through E and G through I are also incorporated into this Order.
- E. California Environmental Quality Act (CEQA).** Under Water Code section 13389, this action to adopt an NPDES permit is exempt from the provisions of CEQA, Public Resources Code sections 21100-21177.
- F. Technology-based Effluent Limitations.** Section 301(b) of the CWA and implementing USEPA permit regulations at section 122.44, title 40 of the Code of Federal Regulations (40 CFR 122.44), require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Secondary Treatment Standards at 40 CFR Part 133. A detailed discussion of the technology-based effluent limitations development is included in the Fact Sheet.
- G. Water Quality-based Effluent Limitations (WQBELs).** Section 301(b) of the CWA and 40 CFR 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards. This Order contains requirements, expressed as technology equivalence requirements, which are necessary to achieve water quality standards. The Central Valley Water Board has considered the factors listed in Water Code section 13241 in establishing these requirements. The rationale for these requirements, which consist of tertiary treatment or equivalent requirements, is discussed in the Fact Sheet.

40 CFR 122.44(d)(1)(i) mandates that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and

narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, WQBELs must be established using: (1) USEPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state’s narrative criterion, supplemented with other relevant information, as provided in 40 CFR 122.44(d)(1)(vi).

**H. Water Quality Control Plans.** The Central Valley Water Board adopted a *Water Quality Control Plan, Fourth Edition (Revised October 2011)*, for the Sacramento and San Joaquin River Basins (hereinafter Basin Plan) that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. The Basin Plan at page II-2.00 states that the “...beneficial uses of any specifically identified water body generally apply to its tributary streams.” Table II-1 of the Basin Plan identifies the beneficial uses of certain specific water bodies. The Basin Plan does not specifically identify beneficial uses for Miners Ravine, but does identify present and potential uses in Table II-1 for the Sacramento River from the Colusa Basin Drain to the “I” Street Bridge, to which Miners Ravine, via Dry Creek, Natomas East Main Drainage Canal, and Bannon Slough, is tributary. In addition, the Basin Plan implements State Water Resources Control Board (State Water Board) Resolution No. 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply. Thus, as discussed in detail in the Fact Sheet, beneficial uses applicable to Miners Ravine are as follows:

**Table 5. Basin Plan Beneficial Uses**

Discharge Point	Receiving Water Name	Beneficial Use(s)
001	Miners Ravine	<u>Existing uses from Table II-1 of the Basin Plan:</u> Municipal and domestic supply (MUN); Agricultural supply, including irrigation (AGR); Water contact recreation, including canoeing and rafting (REC-1); Non-contact water recreation (REC-2); Warm freshwater habitat (WARM); Cold freshwater habitat (COLD); Migration of aquatic organisms, warm and cold (MIGR); Spawning, reproduction, and/or early development, warm and cold (SPWN); Wildlife habitat (WILD); and Navigation (NAV).

The Basin Plan includes a list of Water Quality Limited Segments (WQLSs), which are defined as “...those sections of lakes, streams, rivers or other fresh water bodies where water quality does not meet (or is not expected to meet) water quality standards even after the application of appropriate limitations for point sources (40 CFR 130, et seq.).” The Basin Plan also states, “Additional treatment beyond minimum federal standards will be imposed on dischargers to WQLSs. Dischargers will be assigned or allocated a

*maximum allowable load of critical pollutants so that water quality objectives can be met in the segment.*” Miners Ravine is listed as a WQLS for dissolved oxygen in the 303(d) list of impaired water bodies. Receiving water limitations for dissolved oxygen are included in this Order.

Requirements of this Order implement the Basin Plan.

- I. National Toxics Rule (NTR) and California Toxics Rule (CTR).** USEPA adopted the NTR on 22 December 1992, and later amended it on 4 May 1995 and 9 November 1999. About 40 criteria in the NTR applied in California. On 18 May 2000, USEPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on 13 February 2001. These rules contain water quality criteria for priority pollutants.
- J. State Implementation Policy.** On 2 March 2000, the State Water Board adopted the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California* (State Implementation Policy or SIP). The SIP became effective on 28 April 2000 with respect to the priority pollutant criteria promulgated for California by USEPA through the NTR and to the priority pollutant objectives established by the Central Valley Water Board in the Basin Plan. The SIP became effective on 18 May 2000 with respect to the priority pollutant criteria promulgated by USEPA through the CTR. The State Water Board adopted amendments to the SIP on 24 February 2005 that became effective on 13 July 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.
- K. Compliance Schedules and Interim Requirements.** In general, an NPDES permit must include final effluent limitations that are consistent with CWA section 301 and with 40 CFR 122.44(d). There are exceptions to this general rule. The State Water Board’s *Policy for Compliance Schedules in National Pollutant Discharge Elimination System Permits* (Compliance Schedule Policy) allows compliance schedules for new, revised, or newly interpreted water quality objectives or criteria, or in accordance with a TMDL. All compliance schedules must be as short as possible, and may not exceed ten years from the effective date of the adoption, revision, or new interpretation of the applicable water quality objective or criterion, unless a TMDL allows a longer schedule. A Regional Water Board, however, is not required to include a compliance schedule, but may issue a Time Schedule Order pursuant to Water Code section 13300 or a Cease and Desist Order pursuant to Water Code section 13301 where it finds that the discharger is violating or threatening to violate the permit. The Central Valley Water Board will consider the merits of each case in determining whether it is appropriate to include a compliance schedule in a permit, and, consistent with the Compliance Schedule Policy, should consider feasibility of achieving compliance, and must impose a schedule that is as short as possible to achieve compliance with the effluent limit based on the objective or criteria.

The Compliance Schedule Policy and the SIP do not allow compliance schedules for priority pollutants beyond 18 May 2010, except for new or more stringent priority pollutant criteria adopted by USEPA after 17 December 2008.

Where a compliance schedule for a final effluent limitation exceeds one year, the Order must include interim numeric limitations for that constituent or parameter, interim milestones and compliance reporting within 14 days after each interim milestone. The permit may also include interim requirements to control the pollutant, such as pollutant minimization and source control measures. This Order includes a compliance schedule and interim operational specifications. A detailed discussion of the basis for the compliance schedule and interim operational specifications is included in the Fact Sheet (Attachment F).

- L. Alaska Rule.** On 30 March 2000, USEPA revised its regulation that specifies when new and revised state and tribal water quality standards become effective for CWA purposes. (40 CFR 131.21 and 65 FR 24641 (27 April 2000).) Under the revised regulation (also known as the Alaska rule), new and revised standards submitted to USEPA after 30 May 2000, must be approved by USEPA before being used for CWA purposes. The final rule also provides that standards already in effect and submitted to USEPA by 30 May 2000 may be used for CWA purposes, whether or not approved by USEPA.
- M. Stringency of Requirements for Individual Pollutants.** This Order contains both technology-based effluent limitations and WQBELs for individual pollutants. The technology-based effluent limitations consist of restrictions on flow and percent removal requirements for 5-day biochemical oxygen demand (BOD<sub>5</sub>) and total suspended solids (TSS). The WQBELs consist of restrictions on ammonia, BOD<sub>5</sub>, chlorine residual, copper, dibromochloromethane, dichlorobromomethane, electrical conductivity, nitrate plus nitrite, pH, total coliform organisms, total trihalomethanes, and TSS. This Order's technology-based pollutant restrictions implement the minimum, applicable federal technology-based requirements. In addition, this Order includes effluent limitations for BOD<sub>5</sub>, TSS, and total coliform organisms to meet numeric objectives or protect beneficial uses.

WQBELs have been scientifically derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable federal water quality standards. To the extent that toxic pollutant WQBELs were derived from the CTR, the CTR is the applicable standard pursuant to 40 CFR 131.38. The scientific procedures for calculating the individual WQBELs for priority pollutants are based on the CTR-SIP, which was approved by USEPA on 18 May 2000. All beneficial uses and water quality objectives contained in the Basin Plan were approved under state law and submitted to and approved by USEPA prior to 30 May 2000. Any water quality objectives and beneficial uses submitted to USEPA prior to 30 May 2000, but not approved by USEPA before that date, are nonetheless "*applicable water quality standards for purposes of the [Clean Water] Act*" pursuant to 40 CFR 131.21(c)(1). Collectively, this Order's restrictions on individual pollutants are no more stringent than required to implement the

technology-based requirements of the CWA and the applicable water quality standards for purposes of the CWA.

- N. Antidegradation Policy.** 40 CFR 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing quality of waters be maintained unless degradation is justified based on specific findings. The Central Valley Water Board's Basin Plan implements, and incorporates by reference, both the state and federal antidegradation policies. As discussed in detail in the Fact Sheet, the permitted discharge is consistent with the antidegradation provision of 40 CFR 131.12 and Resolution No. 68-16.
- O. Anti-Backsliding Requirements.** Sections 303(d)(4) and 402(o)(2) of the CWA and federal regulations at 40 CFR 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require effluent limitations in a reissued permit to be as stringent as those in the previous permit, with some exceptions. Some effluent limitations in this Order are less stringent than those in Order R5-2007-0070. As discussed in detail in the Fact Sheet, this relaxation of effluent limitations is consistent with the anti-backsliding requirements of the CWA and federal regulations.
- P. Endangered Species Act.** This Order does not authorize any act that results in the taking of a threatened or endangered species or any act that is now prohibited, or becomes prohibited in the future, under either the California Endangered Species Act (Fish and Game Code sections 2050 to 2097) or the Federal Endangered Species Act (16 U.S.C.A. sections 1531 to 1544). This Order requires compliance with effluent limits, receiving water limits, and other requirements to protect the beneficial uses of waters of the state. The Discharger is responsible for meeting all requirements of the applicable Endangered Species Act.
- Q. Monitoring and Reporting.** 40 CFR 122.48 requires that all NPDES permits specify requirements for recording and reporting monitoring results. Water Code sections 13267 and 13383 authorize the Central Valley Water Board to require technical and monitoring reports. The Monitoring and Reporting Program establishes monitoring and reporting requirements to implement federal and State requirements. The Monitoring and Reporting Program is provided in Attachment E.

The technical and monitoring reports in this Order are required in accordance with Water Code section 13267, which states the following in subsection (b)(1), *"In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable*

*relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports, and shall identify the evidence that supports requiring that person to provide the reports.”*

The monitoring reports required by this Order are necessary to determine compliance with this Order. The need for the monitoring reports is discussed in the Fact Sheet.

- R. Standard and Special Provisions.** Standard Provisions, which apply to all NPDES permits in accordance with 40 CFR 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 CFR 122.42, are provided in Attachment D. The discharger must comply with all standard provisions and with those additional conditions that are applicable under 40 CFR 122.42. The Central Valley Water Board has also included in this Order special provisions applicable to the Discharger. Some special provisions require submittal of technical reports. All technical reports are required in accordance with Water Code section 13267. The rationale for the special provisions and need for technical reports required in this Order is provided in the Fact Sheet.
- S. Provisions and Requirements Implementing State Law.** The provisions/requirements in sections V.B and VI.A.2.o and VI.C.3 and 4 of this Order are included to implement State law only. These provisions/requirements are not required or authorized under the federal CWA; consequently, violations of these provisions/requirements are not subject to the enforcement remedies that are available for NPDES violations.
- T. Notification of Interested Parties.** The Central Valley Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe WDRs for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of notification are provided in the Fact Sheet of this Order.
- U. Consideration of Public Comment.** The Central Valley Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet.

THEREFORE, IT IS HEREBY ORDERED, that Order R5-2007-0070 is rescinded upon the effective date of this Order except for enforcement purposes, and, in order to meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the federal CWA and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements in this Order.

### III. DISCHARGE PROHIBITIONS

- A. Discharge of wastewater at a location or in a manner different from that described in the Findings is prohibited.
- B. The by-pass or overflow of wastes to surface waters is prohibited, except as allowed by Federal Standard Provisions I.G. and I.H. (Attachment D).
- C. Neither the discharge nor its treatment shall create a nuisance as defined in section 13050 of the Water Code.
- D. The Discharger shall not allow pollutant-free wastewater to be discharged into the treatment or disposal system in amounts that significantly diminish the system’s capability to comply with this Order. Pollutant-free wastewater means rainfall, groundwater, cooling waters, and condensates that are essentially free of pollutants.

### IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

#### A. Effluent Limitations – Discharge Point No. 001

##### 1. Final Effluent Limitations – Discharge Point No. 001

- a. The Discharger shall maintain compliance with the following effluent limitations at Discharge Point No. 001, with compliance measured at Monitoring Location EFF-001 as described in the Monitoring and Reporting Program:

**Table 6. Effluent Limitations**

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
<b>Conventional Pollutants</b>						
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	10	15	25	--	--
	lbs/day <sup>1</sup>	25	38	63	--	--
pH	standard units	--	--	--	6.5	8.2
Total Suspended Solids	mg/L	10	15	25	--	--
	lbs/day <sup>1</sup>	25	38	63	--	--
<b>Priority Pollutants</b>						
Copper, Total Recoverable	µg/L	3.9	--	7.9	--	--
Dibromochloromethane	µg/L	0.41	--	0.98	--	--
Dichlorobromomethane	µg/L	0.56	--	1.1	--	--
<b>Non-Conventional Pollutants</b>						
Ammonia, Total (as N)	mg/L	1.2	--	3.8	--	--
	lbs/day <sup>1</sup>	3.0	--	9.5	--	--
Nitrate Plus Nitrite (as N)	mg/L	10	--	--	--	--
Total Trihalomethanes <sup>2</sup>	µg/L	80	--	--	--	--

<sup>1</sup> Mass-based effluent limitations are based on a permitted average dry weather flow of 0.30 MGD.

<sup>2</sup> Applies to the sum of bromoform, chloroform, dibromochloromethane, and dichlorobromomethane.

- b. Percent Removal.** The average monthly percent removal of BOD<sub>5</sub> and TSS shall not be less than 85 percent.
- c. Acute Whole Effluent Toxicity.** Survival of aquatic organisms in 96-hour bioassays of undiluted waste shall be no less than:
  - i. 70%, minimum for any one bioassay; and
  - ii. 90%, median for any three consecutive bioassays.
- d. Total Residual Chlorine.** Effluent total residual chlorine shall not exceed:
  - i. 0.011 mg/L, as a 4-day average; and
  - ii. 0.019 mg/L, as a 1-hour average.
- e. Chronic Whole Effluent Toxicity.** There shall be no chronic toxicity in the effluent discharge.
- f. Total Coliform Organisms.** Effluent total coliform organisms shall not exceed:
  - i. 2.2 most probable number (MPN) per 100 mL, as a 7-day median;
  - ii. 23 MPN/100 mL, more than once in any 30-day period; and
  - iii. 240 MPN/100 mL, at any time.
- g. Average Dry Weather Flow.** The average dry weather discharge flow shall not exceed 0.30 MGD.
- h. Electrical Conductivity (@ 25°C).** The monthly average effluent electrical conductivity shall not exceed 700 µmhos/cm.

## **2. Interim Effluent Limitations – Not Applicable**

### **B. Land Discharge Specifications – Not Applicable**

### **C. Reclamation Specifications – Not Applicable**

## **V. RECEIVING WATER LIMITATIONS**

### **A. Surface Water Limitations**

Receiving water limitations are based on water quality objectives contained in the Basin Plan and are a required part of this Order. The discharge shall not cause the following in Miners Ravine:

- 1. Bacteria.** The fecal coliform concentration, based on a minimum of not less than five samples for any 30-day period, to exceed a geometric mean of 200 MPN/100 mL, nor more than 10 percent of the total number of fecal coliform samples taken during any 30-day period to exceed 400 MPN/100 mL.

2. **Biostimulatory Substances.** Water to contain biostimulatory substances which promote aquatic growths in concentrations that cause nuisance or adversely affect beneficial uses.
3. **Chemical Constituents.** Chemical constituents to be present in concentrations that adversely affect beneficial uses.
4. **Color.** Discoloration that causes nuisance or adversely affects beneficial uses.
5. **Dissolved Oxygen:**
  - a. The monthly median of the mean daily dissolved oxygen concentration to fall below 85 percent of saturation in the main water mass;
  - b. The 95 percentile dissolved oxygen concentration to fall below 75 percent of saturation; nor
  - c. The dissolved oxygen concentration to be reduced below 7.0 mg/L at any time.
6. **Floating Material.** Floating material to be present in amounts that cause nuisance or adversely affect beneficial uses.
7. **Oil and Grease.** Oils, greases, waxes, or other materials to be present in concentrations that cause nuisance, result in a visible film or coating on the surface of the water or on objects in the water, or otherwise adversely affect beneficial uses.
8. **pH.** The pH to be depressed below 6.5 nor raised above 8.5.
9. **Pesticides:**
  - a. Pesticides to be present, individually or in combination, in concentrations that adversely affect beneficial uses;
  - b. Pesticides to be present in bottom sediments or aquatic life in concentrations that adversely affect beneficial uses;
  - c. Total identifiable persistent chlorinated hydrocarbon pesticides to be present in the water column at concentrations detectable within the accuracy of analytical methods approved by USEPA or the Executive Officer;
  - d. Pesticide concentrations to exceed those allowable by applicable antidegradation policies (see State Water Board Resolution No. 68-16 and 40 CFR 131.12.);
  - e. Pesticide concentrations to exceed the lowest levels technically and economically achievable;
  - f. Pesticides to be present in concentration in excess of the maximum contaminant levels set forth in CCR, Title 22, division 4, chapter 15; nor

- g. Thiobencarb to be present in excess of 1.0 µg/L.

**10. Radioactivity:**

- a. Radionuclides to be present in concentrations that are harmful to human, plant, animal, or aquatic life nor that result in the accumulation of radionuclides in the food web to an extent that presents a hazard to human, plant, animal, or aquatic life.
- b. Radionuclides to be present in excess of the maximum contaminant levels (MCLs) specified in Table 64442 of section 64442 and Table 64443 of section 64443 of Title 22 of the California Code of Regulations.

**11. Suspended Sediments.** The suspended sediment load and suspended sediment discharge rate of surface waters to be altered in such a manner as to cause nuisance or adversely affect beneficial uses.

**12. Settleable Substances.** Substances to be present in concentrations that result in the deposition of material that causes nuisance or adversely affects beneficial uses.

**13. Suspended Material.** Suspended material to be present in concentrations that cause nuisance or adversely affect beneficial uses.

**14. Taste and Odors.** Taste- or odor-producing substances to be present in concentrations that impart undesirable tastes or odors to fish flesh or other edible products of aquatic origin, or that cause nuisance, or otherwise adversely affect beneficial uses.

**15. Temperature.** The natural temperature to be increased by more than 5°F. Compliance to be determined based on the difference in temperature at Monitoring Locations RSW-001 and RSW-002.

**16. Toxicity.** Toxic substances to be present, individually or in combination, in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.

**17. Turbidity.**

- a. Shall not exceed 2 Nephelometric Turbidity Units (NTU) where natural turbidity is less than 1 NTU;
- b. Shall not increase more than 1 NTU where natural turbidity is between 1 and 5 NTUs;
- c. Shall not increase more than 20 percent where natural turbidity is between 5 and 50 NTUs;
- d. Shall not increase more than 10 NTU where natural turbidity is between 50 and 100 NTUs; nor

- e. Shall not increase more than 10 percent where natural turbidity is greater than 100 NTUs.

## **B. Groundwater Limitations**

1. Release of waste constituents from any storage, treatment, or disposal component associated with the Facility, in combination with other sources, shall not cause the underlying groundwater to contain waste constituents greater than background quality or Water Quality Objectives, whichever is greater.

## **VI. PROVISIONS**

### **A. Standard Provisions**

1. The Discharger shall comply with all Standard Provisions (federal NPDES standard conditions from 40 CFR Part 122) included in Attachment D of this Order.
2. The Discharger shall comply with the following provisions:
  - a. If the Discharger's wastewater treatment plant is publicly owned or subject to regulation by California Public Utilities Commission, it shall be supervised and operated by persons possessing certificates of appropriate grade according to Title 23, CCR, division 3, chapter 26.
  - b. After notice and opportunity for a hearing, this Order may be terminated or modified for cause, including, but not limited to:
    - i. violation of any term or condition contained in this Order;
    - ii. obtaining this Order by misrepresentation or by failing to disclose fully all relevant facts;
    - iii. a change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge; and
    - iv. a material change in the character, location, or volume of discharge.

The causes for modification include:

- *New regulations.* New regulations have been promulgated under section 405(d) of the CWA, or the standards or regulations on which the permit was based have been changed by promulgation of amended standards or regulations or by judicial decision after the permit was issued.
- *Land application plans.* When required by a permit condition to incorporate a land application plan for beneficial reuse of sewage sludge, to revise an existing land application plan, or to add a land application plan.

- *Change in sludge use or disposal practice.* Under 40 CFR 122.62(a)(1), a change in the Discharger's sludge use or disposal practice is a cause for modification of the permit. It is cause for revocation and reissuance if the Discharger requests or agrees.

The Central Valley Water Board may review and revise this Order at any time upon application of any affected person or the Central Valley Water Board's own motion.

- c. If a toxic effluent standard or prohibition (including any scheduled compliance specified in such effluent standard or prohibition) is established under section 307(a) of the CWA, or amendments thereto, for a toxic pollutant that is present in the discharge authorized herein, and such standard or prohibition is more stringent than any limitation upon such pollutant in this Order, the Central Valley Water Board will revise or modify this Order in accordance with such toxic effluent standard or prohibition.

The Discharger shall comply with effluent standards and prohibitions within the time provided in the regulations that establish those standards or prohibitions, even if this Order has not yet been modified.

- d. This Order shall be modified, or alternately revoked and reissued, to comply with any applicable effluent standard or limitation issued or approved under sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a)(2) of the CWA, if the effluent standard or limitation so issued or approved:
  - i. Contains different conditions or is otherwise more stringent than any effluent limitation in the Order; or
  - ii. Controls any pollutant limited in the Order.

The Order, as modified or reissued under this paragraph, shall also contain any other requirements of the CWA then applicable.

- e. The provisions of this Order are severable. If any provision of this Order is found invalid, the remainder of this Order shall not be affected.
- f. The Discharger shall take all reasonable steps to minimize any adverse effects to waters of the State or users of those waters resulting from any discharge or sludge use or disposal in violation of this Order. Reasonable steps shall include such accelerated or additional monitoring as necessary to determine the nature and impact of the non-complying discharge or sludge use or disposal.
- g. The Discharger shall ensure compliance with any existing or future pretreatment standard promulgated by USEPA under section 307 of the CWA, or amendment thereto, for any discharge to the municipal system.

- h.** A copy of this Order shall be maintained at the discharge facility and be available at all times to operating personnel. Key operating personnel shall be familiar with its content.
- i.** Safeguard to electric power failure:
  - i.** The Discharger shall provide safeguards to assure that, should there be reduction, loss, or failure of electric power, the discharge shall comply with the terms and conditions of this Order.
  - ii.** Upon written request by the Central Valley Water Board, the Discharger shall submit a written description of safeguards. Such safeguards may include alternate power sources, standby generators, retention capacity, operating procedures, or other means. A description of the safeguards provided shall include an analysis of the frequency, duration, and impact of power failures experienced over the past 5 years on effluent quality and on the capability of the Discharger to comply with the terms and conditions of the Order. The adequacy of the safeguards is subject to the approval of the Central Valley Water Board.
  - iii.** Should the treatment works not include safeguards against reduction, loss, or failure of electric power, or should the Central Valley Water Board not approve the existing safeguards, the Discharger shall, within 90 days of having been advised in writing by the Central Valley Water Board that the existing safeguards are inadequate, provide to the Central Valley Water Board and USEPA a schedule of compliance for providing safeguards such that in the event of reduction, loss, or failure of electric power, the Discharger shall comply with the terms and conditions of this Order. The schedule of compliance shall, upon approval of the Central Valley Water Board, become a condition of this Order.
- j.** The Discharger, upon written request of the Central Valley Water Board, shall file with the Board a technical report on its preventive (failsafe) and contingency (cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events. This report may be combined with that required under the Central Valley Water Board Standard Provision contained in section VI.A.2.i of this Order.

The technical report shall:

- i.** Identify the possible sources of spills, leaks, untreated waste by-pass, and contaminated drainage. Loading and storage areas, power outage, waste treatment unit outage, and failure of process equipment, tanks and pipes should be considered.
- ii.** Evaluate the effectiveness of present facilities and procedures and state when they became operational.

- iii. Predict the effectiveness of the proposed facilities and procedures and provide an implementation schedule containing interim and final dates when they will be constructed, implemented, or operational.

The Central Valley Water Board, after review of the technical report, may establish conditions which it deems necessary to control accidental discharges and to minimize the effects of such events. Such conditions shall be incorporated as part of this Order, upon notice to the Discharger.

- k. A publicly owned treatment works whose waste flow has been increasing, or is projected to increase, shall estimate when flows will reach hydraulic and treatment capacities of its treatment and disposal facilities. The projections shall be made in January, based on the last 3 years' average dry weather flows, peak wet weather flows and total annual flows, as appropriate. When any projection shows that capacity of any part of the facilities may be exceeded in 4 years, the Discharger shall notify the Central Valley Water Board by 31 January. A copy of the notification shall be sent to appropriate local elected officials, local permitting agencies and the press. Within 120 days of the notification, the Discharger shall submit a technical report showing how it will prevent flow volumes from exceeding capacity or how it will increase capacity to handle the larger flows. The Central Valley Water Board may extend the time for submitting the report.
- l. The Discharger shall submit technical reports as directed by the Executive Officer. All technical reports required herein that involve planning, investigation, evaluation, or design, or other work requiring interpretation and proper application of engineering or geologic sciences, shall be prepared by or under the direction of persons registered to practice in California pursuant to California Business and Professions Code, sections 6735, 7835, and 7835.1. To demonstrate compliance with Title 16, CCR, sections 415 and 3065, all technical reports must contain a statement of the qualifications of the responsible registered professional(s). As required by these laws, completed technical reports must bear the signature(s) and seal(s) of the registered professional(s) in a manner such that all work can be clearly attributed to the professional responsible for the work.
- m. The Central Valley Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13385, 13386, and 13387.
- n. For publicly owned treatment works, prior to making any change in the point of discharge, place of use, or purpose of use of treated wastewater that results in a permanent decrease of flow in any portion of a watercourse, the Discharger must file a petition with the State Water Board, Division of Water Rights, and receive approval for such a change. (Water Code section 1211).
- o. In the event the Discharger does not comply or will be unable to comply for any reason, with any prohibition, maximum daily effluent limitation, 1-hour average effluent limitation, or receiving water limitation contained in this Order, the

Discharger shall notify the Central Valley Water Board by telephone (916) 464-3291 within 24 hours of having knowledge of such noncompliance, and shall confirm this notification in writing within 5 days, unless the Central Valley Water Board waives confirmation. The written notification shall include the information required by the Standard Provision contained in Attachment D section V.E.1. [40 CFR 122.41(l)(6)(i)].

- p. Failure to comply with provisions or requirements of this Order, or violation of other applicable laws or regulations governing discharges from this facility, may subject the Discharger to administrative or civil liabilities, criminal penalties, and/or other enforcement remedies to ensure compliance. Additionally, certain violations may subject the Discharger to civil or criminal enforcement from appropriate local, state, or federal law enforcement entities.
- q. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to the Central Valley Water Board.

To assume operation under this Order, the succeeding owner or operator must apply in writing to the Executive Officer requesting transfer of the Order. The request must contain the requesting entity's full legal name, the state of incorporation if a corporation, address and telephone number of the persons responsible for contact with the Central Valley Water Board and a statement. The statement shall comply with the signatory and certification requirements in the federal Standard Provisions (Attachment D, section V.B) and state that the new owner or operator assumes full responsibility for compliance with this Order. Failure to submit the request shall be considered a discharge without requirements, a violation of the Water Code. Transfer shall be approved or disapproved in writing by the Executive Officer.

## **B. Monitoring and Reporting Program Requirements**

The Discharger shall comply with the Monitoring and Reporting Program, and future revisions thereto, in Attachment E of this Order.

## **C. Special Provisions**

### **1. Reopener Provisions**

- a. Conditions that necessitate a major modification of a permit are described in 40 CFR 122.62, including, but not limited to:
  - i. If new or amended applicable water quality standards are promulgated or approved pursuant to section 303 of the CWA, or amendments thereto, this permit may be reopened and modified in accordance with the new or amended standards.

- ii. When new information, that was not available at the time of permit issuance, would have justified different permit conditions at the time of issuance.
- b. This Order may be reopened for modification, or revocation and reissuance, as a result of the detection of a reportable priority pollutant generated by special conditions included in this Order. These special conditions may be, but are not limited to, fish tissue sampling, whole effluent toxicity, monitoring requirements on internal waste stream(s), and monitoring for surrogate parameters. Additional requirements may be included in this Order as a result of the special condition monitoring data.
- c. **Whole Effluent Toxicity.** As a result of a Toxicity Reduction Evaluation (TRE), this Order may be reopened to include a numeric chronic toxicity limitation, a new acute toxicity limitation, and/or a limitation for a specific toxicant identified in the TRE. Additionally, if the State Water Board revises the SIP's toxicity control provisions that would require the establishment of numeric chronic toxicity effluent limitations, this Order may be reopened to include a numeric chronic toxicity effluent limitation based on the new provisions.
- d. **Water Effects Ratios (WER) and Metal Translators.** A default WER of 1.0 has been used in this Order for calculating criteria for applicable inorganic constituents. In addition, default dissolved-to-total metal translators have been used to convert water quality objectives from dissolved to total recoverable when developing effluent limitations for copper. If the Discharger performs studies to determine site-specific WERs and/or site-specific dissolved-to-total metal translators, this Order may be reopened to modify the effluent limitations for the applicable inorganic constituents.
- e. **Benzene Study.** If, after review of the Benzene Study, it is determined that the discharge has reasonable potential to cause or contribute to an exceedance of a water quality objective for benzene, this Order may be reopened and effluent limitations added.
- f. **Drinking Water Policy.** The Central Valley Water Board is developing a Drinking Water Policy. This Order may be reopened to incorporate monitoring of drinking water constituents to implement the Drinking Water Policy.

## 2. Special Studies, Technical Reports and Additional Monitoring Requirements

- a. **Chronic Whole Effluent Toxicity.** For compliance with the Basin Plan's narrative toxicity objective, this Order requires the Discharger to conduct chronic whole effluent toxicity (WET) testing, as specified in the Monitoring and Reporting Program (Attachment E, section V). Furthermore, this Provision requires the Discharger to investigate the causes of, and identify corrective actions to reduce or eliminate effluent toxicity. If the discharge exhibits toxicity, as described in subsection ii below, the Discharger is required to initiate a TRE in accordance with an approved TRE Workplan, and take actions to mitigate the impact of the discharge and prevent recurrence of toxicity. A TRE is a site-specific study

conducted in a stepwise process to identify the source(s) of toxicity and the effective control measures for effluent toxicity. TREs are designed to identify the causative agents and sources of effluent toxicity, evaluate the effectiveness of the toxicity control options, and confirm the reduction in effluent toxicity. This Provision includes requirements for the Discharger to develop and submit an updated TRE Workplan and includes procedures for accelerated chronic toxicity monitoring and TRE initiation.

- i. Updated Toxicity Reduction Evaluation (TRE) Workplan.** Within 90 days of the effective date of this Order, the Discharger shall submit to the Central Valley Water Board an updated TRE Workplan for approval by the Executive Officer. The updated TRE Workplan shall outline the procedures for identifying the source(s) of, and reducing or eliminating effluent toxicity. The TRE Workplan must be developed in accordance with USEPA guidance<sup>1</sup> and be of adequate detail to allow the Discharger to immediately initiate a TRE as required in this Provision.

  - (a)** A description of the investigation and evaluation techniques that will be used to identify potential causes and sources of effluent toxicity, effluent variability, and treatment system efficiency;
  - (b)** A description of the facility's methods of maximizing in-house treatment efficiency and good housekeeping practices, and a list of all chemicals used in operation of the facility; and
  - (c)** A discussion of who will conduct the Toxicity Identification Evaluation (TIE), if necessary (e.g., an in-house expert or outside contractor).
- ii. Accelerated Monitoring and TRE Initiation.** When the numeric toxicity monitoring trigger is exceeded during regular chronic toxicity monitoring, the Discharger shall initiate accelerated monitoring as required in the Accelerated Monitoring Specifications. The Discharger shall initiate a TRE to address effluent toxicity if any WET testing results exceed the numeric toxicity monitoring trigger during accelerated monitoring.
- iii. Numeric Toxicity Monitoring Trigger**

  - (a)** The numeric toxicity monitoring trigger to initiate a TRE is  $> 4 TU_C$  (where  $TU_C = 100/NOEC$ ). The monitoring trigger is not an effluent limitation; it is the toxicity threshold at which the Discharger is required to begin accelerated monitoring and initiate a TRE when the effluent exhibits toxicity. The  $4 TU_C$  trigger is in effect unless the Discharger fails to begin construction of the regionalization project by 30 October 2013, 6 months

---

<sup>1</sup> See the Fact Sheet (Attachment F, section VII.B.2.a. for a list of USEPA guidance documents that must be considered in the development of the TRE Workplan.)

after the 30 April 2013 compliance date in the existing Cease and Desist Order R5-2012-0005.

**(b) If construction has not begun on the project to regionalize the Facility wastewater treatment plant by 30 October 2013**, the numeric toxicity monitoring trigger to initiate a TRE is  $> 1 TU_C$  (where  $TU_C = 100/NOEC$ ). The monitoring trigger is not an effluent limitation; it is the toxicity threshold at which the Discharger is required to begin accelerated monitoring and initiate a TRE when the effluent exhibits toxicity.

**iv. Accelerated Monitoring Specifications.** If the numeric toxicity monitoring trigger is exceeded during regular chronic toxicity testing, the Discharger shall initiate accelerated monitoring within 14 days of notification by the laboratory of the exceedance. Accelerated monitoring shall consist of four (4) chronic toxicity tests conducted once every 2 weeks using the species that exhibited toxicity. The following protocol shall be used for accelerated monitoring and TRE initiation:

- (a)** If the results of four (4) consecutive accelerated monitoring tests do not exceed the monitoring trigger, the Discharger may cease accelerated monitoring and resume regular chronic toxicity monitoring. However, notwithstanding the accelerated monitoring results, if there is evidence of effluent toxicity, the Executive Officer may require that the Discharger initiate a TRE.
- (b)** If the source(s) of the toxicity is easily identified (e.g., temporary plant upset), the Discharger shall make necessary corrections to the facility and shall continue accelerated monitoring until four (4) consecutive accelerated tests do not exceed the monitoring trigger. Upon confirmation that the effluent toxicity has been removed, the Discharger may cease accelerated monitoring and resume regular chronic toxicity monitoring.
- (c)** If the result of any accelerated toxicity test exceeds the monitoring trigger, the Discharger shall cease accelerated monitoring and begin a TRE to investigate the cause(s) of, and identify corrective actions to reduce or eliminate effluent toxicity. Within thirty (30) days of notification by the laboratory of any test result exceeding the monitoring trigger during accelerated monitoring, the Discharger shall submit a TRE Action Plan to the Central Valley Water Board including, at minimum:
  - (1)** Specific actions the Discharger will take to investigate and identify the cause(s) of toxicity, including a TRE WET monitoring schedule;
  - (2)** Specific actions the Discharger will take to mitigate the impact of the discharge and prevent the recurrence of toxicity; and
  - (3)** A schedule for these actions.

**b. Benzene Study.** There are indications that the discharge may contain benzene in concentrations that have a reasonable potential to cause or contribute to an instream exceedance of water quality objectives. If construction of the project to regionalize the Facility has not begun by 31 October 2013, a study shall be completed to evaluate the presence of benzene in the effluent. At a minimum, the study must contain six bimonthly samples for 1 year and as specified in Table 2a of Appendix 4 of the SIP, the minimum level to be achieved by the laboratory for benzene analysis is 0.5 µg/L. The Discharger shall conduct a constituent study to evaluate the presence of benzene in the effluent, as follows:

<u>Task</u>	<u>Compliance Date</u>
i. Submit Workplan and Time Schedule	30 January 2015
ii. Begin Study	30 July 2015
iii. Complete Study	30 July 2016
iv. Submit Study Report including findings, conclusions, and recommendations for subsequent actions.	30 January 2017

### 3. Best Management Practices and Pollution Prevention

**a. Salinity Evaluation and Minimization Plan.** If construction of the project to regionalize the Facility has not begun by **31 October 2013**, the Discharger shall update and implement the salinity evaluation and minimization plan developed by the Discharger in accordance with Order R5-2007-0070 to identify and address sources of salinity from the Facility. The plan shall be updated and submitted to the Central Valley Water Board by **20 April 2014**.

### 4. Construction, Operation and Maintenance Specifications

**a. Turbidity.** Effective **1 January 2015**, the Discharger shall operate the treatment system to ensure that turbidity prior to disinfection shall not exceed any of the following:

- i. 2 NTU, as a daily average;
- ii. 5 NTU, more than 5% of the time within a 24-hour period;
- iii. 10 NTU, at any time.

Effective immediately and ending 31 December 2014, the Discharger is not required to meet the turbidity operational specification when the receiving water flow to effluent flow ratio is greater than 20:1; however, the filters shall be used to the maximum extent possible. The Discharger is required to meet the turbidity operational specification when the receiving water flow to effluent flow ratio is less than 20:1.

**b.** The treatment facilities shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.

## 5. Special Provisions for Municipal Facilities (POTWs Only)

- a. Sludge/Biosolids Treatment or Discharge Specifications.** Sludge in this document means the solid, semisolid, and liquid residues removed during primary, secondary, or advanced wastewater treatment processes. Solid waste refers to grit and screening material generated during preliminary treatment. Residual sludge means sludge that will not be subject to further treatment at the wastewater treatment plant. Biosolids refer to sludge that has been treated and tested and shown to be capable of being beneficially and legally used pursuant to federal and state regulations as a soil amendment for agricultural, silvicultural, horticultural, and land reclamation activities as specified under 40 CFR Part 503.
- i. Collected screenings, residual sludge, biosolids, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer, and consistent with Consolidated Regulations for Treatment, Storage, Processing, or Disposal of Solid Waste, as set forth in Title 27, CCR, division 2, subdivision 1, section 20005, et seq. Removal for further treatment, storage, disposal, or reuse at sites (e.g., landfill, composting sites, soil amendment sites) that are operated in accordance with valid waste discharge requirements issued by a Regional Water Board will satisfy these specifications.
  - ii. Sludge and solid waste shall be removed from screens, sumps, ponds, clarifiers, etc. as needed to ensure optimal plant performance.
  - iii. The treatment of sludge generated at the Facility shall be confined to the Facility property and conducted in a manner that precludes infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations in section V.B. of this Order. In addition, the storage of residual sludge, solid waste, and biosolids on Facility property shall be temporary and controlled, and contained in a manner that minimizes leachate formation and precludes infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations included in section V.B. of this Order.
  - iv. The use, disposal, storage, and transportation of biosolids shall comply with existing federal and state laws and regulations, including permitting requirements and technical standards included in 40 CFR Part 503. If the State Water Board and the Central Valley Water Board are given the authority to implement regulations contained in 40 CFR Part 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR Part 503 whether or not they have been incorporated into this Order.
  - v. The Discharger shall comply with Section IX.A. Biosolids of the Monitoring and Reporting Program, Attachment E.

- vi. Any proposed change in biosolids use or disposal practice from a previously approved practice shall be reported to the Executive Officer and USEPA Regional Administrator at least 90 days in advance of the change.
- vii. **Within 180 days of the permit effective date**, the Discharger shall review and update its existing biosolids use or disposal plan, and submit it to the Central Valley Water Board. The updated plan shall describe at a minimum:
  - (a) Sources and amounts of biosolids generated annually.
  - (b) Location(s) of on-site storage and description of the containment area.
  - (c) Plans for ultimate disposal. For landfill disposal, include the Central Valley Water Board's waste discharge requirement numbers that regulate the particular landfill; the present classification of the landfill; and the name and location of the landfill.
- viii. The Discharger is encouraged to comply with the "Manual of Good Practice for Agricultural Land Application of Biosolids" developed by the California Water Environment Association.
- ix. Use of biosolids as a soil amendment shall comply with valid waste discharge requirements (WDRs) issued by the State or Regional Water Boards. In most cases, this means the WDRs contained in the State Water Resources Control Board Water Quality Order No. 2004-0012-DWQ, General Waste Discharge Requirements for the Discharge of Biosolids to Land for Use as a Soil Amendment in Agricultural, Silvicultural, Horticultural, and Land Reclamation Activities (Biosolids General Order). For a biosolids use project to be covered by the Biosolids General Order, the Discharger must file a complete Notice of Intent and receive a Notice of Applicability for each project.
- b. **Collection System.** On 2 May 2006, the State Water Board adopted State Water Resources Control Board Order No. 2006-0003-DWQ, Statewide General Waste Discharge Requirements (WDRs) for Sanitary Sewer Systems. The Discharger shall be subject to the requirements of Order No. 2006-0003-DWQ and any future revisions thereto. Order No. 2006-0003-DWQ requires that all public agencies that currently own or operate sanitary sewer systems apply for coverage under the general WDRs. The Discharger has applied for and has been approved for coverage under Order 2006-0003-DWQ for operation of its wastewater collection system.

## 6. Other Special Provisions

- a. Wastewater shall be oxidized, coagulated, filtered, and adequately disinfected pursuant to the Department of Public Health (DPH; formerly the Department of Health Services) reclamation criteria, CCR, Title 22, division 4, chapter 3, (Title 22), or equivalent.

## 7. Compliance Schedules

- a. **Title 22, or Equivalent, Requirements.** Effective immediately and ending 31 December 2014, when the receiving water flow to effluent flow ratio is greater than 20:1, the coagulation and filtration systems shall be operated to the maximum extent possible and all wastewater shall receive full secondary treatment. When the receiving water flow to effluent flow ratio is less than 20:1, wastewater discharged to Miners Ravine shall be oxidized, coagulated, filtered, and adequately disinfected, or equivalent, pursuant to DPH reclamation criteria, Title 22 CCR, Division 4, Chapter 3, (Title 22). By 1 January 2015, all wastewater discharged to Miners Ravine shall be oxidized, coagulated, filtered, and adequately disinfected pursuant to DPH reclamation criteria, Title 22 CCR, Division 4, Chapter 3, (Title 22), or equivalent.

## VII. COMPLIANCE DETERMINATION

- A. **BOD<sub>5</sub> and TSS Effluent Limitations (Section IV.A.1.a and IV.A.1.b).** Compliance with the final effluent limitations for BOD<sub>5</sub> and TSS required in Limitations and Discharge Requirements section IV.A.1.a shall be ascertained by 24-hour composite samples. Compliance with effluent limitations required in Limitations and Discharge Requirements section IV.A.1.b for percent removal shall be calculated using the arithmetic mean of BOD<sub>5</sub> and TSS in effluent samples collected over a monthly period as a percentage of the arithmetic mean of the values for influent samples collected at approximately the same times during the same period.
- B. **Average Dry Weather Flow Effluent Limitations (Section IV.A.1.g).** The average dry weather discharge flow represents the daily average flow when groundwater is at or near normal and runoff is not occurring. Compliance with the average dry weather flow effluent limitations will be determined annually based on the average daily flow over three consecutive dry weather months (e.g., July, August, and September).
- C. **Total Coliform Organisms Effluent Limitations (Section IV.A.1.f).** For each day that an effluent sample is collected and analyzed for total coliform organisms, the 7-day median shall be determined by calculating the median concentration of total coliform bacteria in the effluent utilizing the bacteriological results of the last 7 days. For example, if a sample is collected on a Wednesday, the result from that sampling event and all results from the previous 6 days (i.e., Tuesday, Monday, Sunday, Saturday, Friday, and Thursday) are used to calculate the 7-day median. If the 7-day median of total coliform organisms exceeds a most probable number (MPN) of 23 per 100 milliliters, the Discharger will be considered out of compliance.
- D. **Total Residual Chlorine Effluent Limitations (Section IV.A.1.d).** Continuous monitoring analyzers for chlorine residual or for dechlorination agent residual in the effluent are appropriate methods for compliance determination. A positive residual dechlorination agent in the effluent indicates that chlorine is not present in the discharge, which demonstrates compliance with the effluent limitations. This type of monitoring can also be used to prove that some chlorine residual exceedances are false positives. Continuous monitoring data showing either a positive dechlorination agent

residual or a chlorine residual at or below the prescribed limit are sufficient to show compliance with the total residual chlorine effluent limitations, as long as the instruments are maintained and calibrated in accordance with the manufacturer's recommendations.

Any excursion above the 1-hour average or 4-day average total residual chlorine effluent limitations is a violation. If the Discharger conducts continuous monitoring and the Discharger can demonstrate, through data collected from a back-up monitoring system, that a chlorine spike recorded by the continuous monitor was not actually due to chlorine, then any excursion resulting from the recorded spike will not be considered an exceedance, but rather reported as a false positive. Records supporting validation of false positives shall be maintained in accordance with Section IV Standard Provisions (Attachment D).

- E. Mass Effluent Limitations.** The mass effluent limitations contained in the Final Effluent Limitations IV.A.1.a are based on the permitted average dry weather flow and calculated as follows:

$$\text{Mass (lbs/day)} = \text{Flow (MGD)} \times \text{Concentration (mg/L)} \times 8.34 \text{ (conversion factor)}$$

If the effluent flow exceeds the permitted average dry weather flow during wet-weather seasons, the effluent mass limitations contained in Final Effluent Limitations IV.A.1.a shall not apply. If the effluent flow is below the permitted average dry weather flow during wet-weather seasons, the effluent mass limitations do apply.

- F. Priority Pollutant Effluent Limitations.** Compliance with effluent limitations for priority pollutants shall be determined using sample reporting protocols defined in Attachment A and Attachment E of this Order. For purposes of reporting and administrative enforcement by the Central Valley Water Board and the State Water Board, the Discharger shall be deemed out of compliance with effluent limitations if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reporting level (RL).

- G. Chronic Whole Effluent Toxicity Effluent Limitation (Section IV.A.1.e).** Compliance with the accelerated monitoring and TRE provisions of Provision VI.C.2.a shall constitute compliance with the effluent limitation.

- H. Reporting Due Dates.** Reporting requirements shall be in accordance with due dates specified in this Order. If the due date is on a Saturday, Sunday, State holiday, or a day the corresponding Water Board(s) office(s) is(are) closed, the due date shall be on the next business day.

## **ATTACHMENT A – DEFINITIONS**

### **Arithmetic Mean ( $\mu$ )**

Also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

Arithmetic mean =  $\mu = \Sigma x / n$       where:  $\Sigma x$  is the sum of the measured ambient water concentrations, and  $n$  is the number of samples.

### **Average Monthly Effluent Limitation (AMEL)**

The highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

### **Average Weekly Effluent Limitation (AWEL)**

The highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

### **Bioaccumulative**

Those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

### **Carcinogenic**

Pollutants are substances that are known to cause cancer in living organisms.

### **Coefficient of Variation (CV)**

CV is a measure of the data variability and is calculated as the estimated standard deviation divided by the arithmetic mean of the observed values.

### **Daily Discharge**

Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of 1 day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

For composite sampling, if 1 day is defined as a 24-hour period other than a calendar day, the analytical result for the 24-hour period will be considered as the result for the calendar day in which the 24-hour period ends.

### **Detected, but Not Quantified (DNQ)**

DNQ are those sample results less than the RL, but greater than or equal to the laboratory's MDL.

### **Dilution Credit**

Dilution Credit is the amount of dilution granted to a discharge in the calculation of a water quality-based effluent limitation, based on the allowance of a specified mixing zone. It is calculated from the dilution ratio or determined through conducting a mixing zone study or modeling of the discharge and receiving water.

### **Effluent Concentration Allowance (ECA)**

ECA is a value derived from the water quality criterion/objective, dilution credit, and ambient background concentration that is used, in conjunction with the coefficient of variation for the effluent monitoring data, to calculate a long-term average (LTA) discharge concentration. The ECA has the same meaning as waste load allocation (WLA) as used in USEPA guidance (Technical Support Document For Water Quality-based Toxics Control, March 1991, second printing, EPA/505/2-90-001).

### **Enclosed Bays**

Enclosed Bays means indentations along the coast that enclose an area of oceanic water within distinct headlands or harbor works. Enclosed bays include all bays where the narrowest distance between the headlands or outermost harbor works is less than 75 percent of the greatest dimension of the enclosed portion of the bay. Enclosed bays include, but are not limited to, Humboldt Bay, Bodega Harbor, Tomales Bay, Drake's Estero, San Francisco Bay, Morro Bay, Los Angeles-Long Beach Harbor, Upper and Lower Newport Bay, Mission Bay, and San Diego Bay. Enclosed bays do not include inland surface waters or ocean waters.

### **Estimated Chemical Concentration**

The estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

### **Estuaries**

Estuaries means waters, including coastal lagoons, located at the mouths of streams that serve as areas of mixing for fresh and ocean waters. Coastal lagoons and mouths of streams that are temporarily separated from the ocean by sandbars shall be considered estuaries. Estuarine waters shall be considered to extend from a bay or the open ocean to a point upstream where there is no significant mixing of fresh water and seawater. Estuarine waters included, but are not limited to, the Sacramento-San Joaquin Delta, as defined in Water Code section 12220, Suisun Bay, Carquinez Strait downstream to the Carquinez Bridge, and appropriate areas of the Smith, Mad, Eel, Noyo, Russian, Klamath, San Diego, and Otay rivers. Estuaries do not include inland surface waters or ocean waters.

### **Inland Surface Waters**

All surface waters of the State that do not include the ocean, enclosed bays, or estuaries.

### **Instantaneous Maximum Effluent Limitation**

The highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

### **Instantaneous Minimum Effluent Limitation**

The lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

### **Maximum Daily Effluent Limitation (MDEL)**

The highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

### **Median**

The middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of measurements ( $n$ ) is odd, then the median =  $X_{(n+1)/2}$ . If  $n$  is even, then the median =  $(X_{n/2} + X_{(n/2)+1})/2$  (i.e., the midpoint between the  $n/2$  and  $n/2+1$ ).

### **Method Detection Limit (MDL)**

MDL is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero, as defined in 40 CFR Part 136, Appendix B, revised as of 14 May 1999.

### **Minimum Level (ML)**

ML is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

### **Mixing Zone**

Mixing Zone is a limited volume of receiving water that is allocated for mixing with a wastewater discharge where water quality criteria can be exceeded without causing adverse effects to the overall water body.

### **Not Detected (ND)**

Sample results which are less than the laboratory's MDL.

### **Ocean Waters**

The territorial marine waters of the State as defined by California law to the extent these waters are outside of enclosed bays, estuaries, and coastal lagoons. Discharges to ocean waters are regulated in accordance with the State Water Board's California Ocean Plan.

### **Persistent Pollutants**

Persistent pollutants are substances for which degradation or decomposition in the environment is nonexistent or very slow.

### **Pollutant Minimization Program (PMP)**

Pollutant minimization means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Central Valley Water Board may consider cost effectiveness when establishing the requirements of a PMP. The PMP shall be prepared in accordance with section 2.4.5.1 of the SIP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to Water Code section 13263.3(d), shall be considered to fulfill the PMP requirements of the SIP.

### **Pollution Prevention**

Pollution Prevention means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as defined in Water Code section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the State or Regional Water Board.

### **Reporting Level (RL)**

The RL is based on the proper application of method-based analytical procedures for sample preparation and the absence of any matrix interferences. Other factors may be applied to the RL depending on the specific sample preparation steps employed. For example, the treatment typically applied in cases where there are matrix-effects is to dilute the sample or sample aliquot by a factor of ten. In such cases, this additional factor must be applied in the computation of the RL.

### **Satellite Collection System**

The portion, if any, of a sanitary sewer system owned or operated by a different public agency than the agency that owns and operates the wastewater treatment facility that a sanitary sewer system is tributary to.

### **Source of Drinking Water**

Any water designated as municipal or domestic supply (MUN) in a Regional Water Board Basin Plan.

### **Standard Deviation ( $\sigma$ )**

Standard Deviation is a measure of variability that is calculated as follows:

$$\sigma = (\sum[(x - \mu)^2]/(n - 1))^{0.5}$$

where:

x is the observed value;


$\mu$  is the arithmetic mean of the observed values; and

n is the number of samples.


### **Toxicity Reduction Evaluation (TRE)**

TRE is a study conducted in a step-wise process designed to identify the causative agents of effluent or ambient toxicity, isolate the sources of toxicity, evaluate the effectiveness of toxicity control options, and then confirm the reduction in toxicity. The first steps of the TRE consist of the collection of data relevant to the toxicity, including additional toxicity testing, and an evaluation of facility operations and maintenance practices, and best management practices. A Toxicity Identification Evaluation (TIE) may be required as part of the TRE, if appropriate. (A TIE is a set of procedures to identify the specific chemical(s) responsible for toxicity. These procedures are performed in three phases (characterization, identification, and confirmation) using aquatic organism toxicity tests.)

**ATTACHMENT B – MAPS**

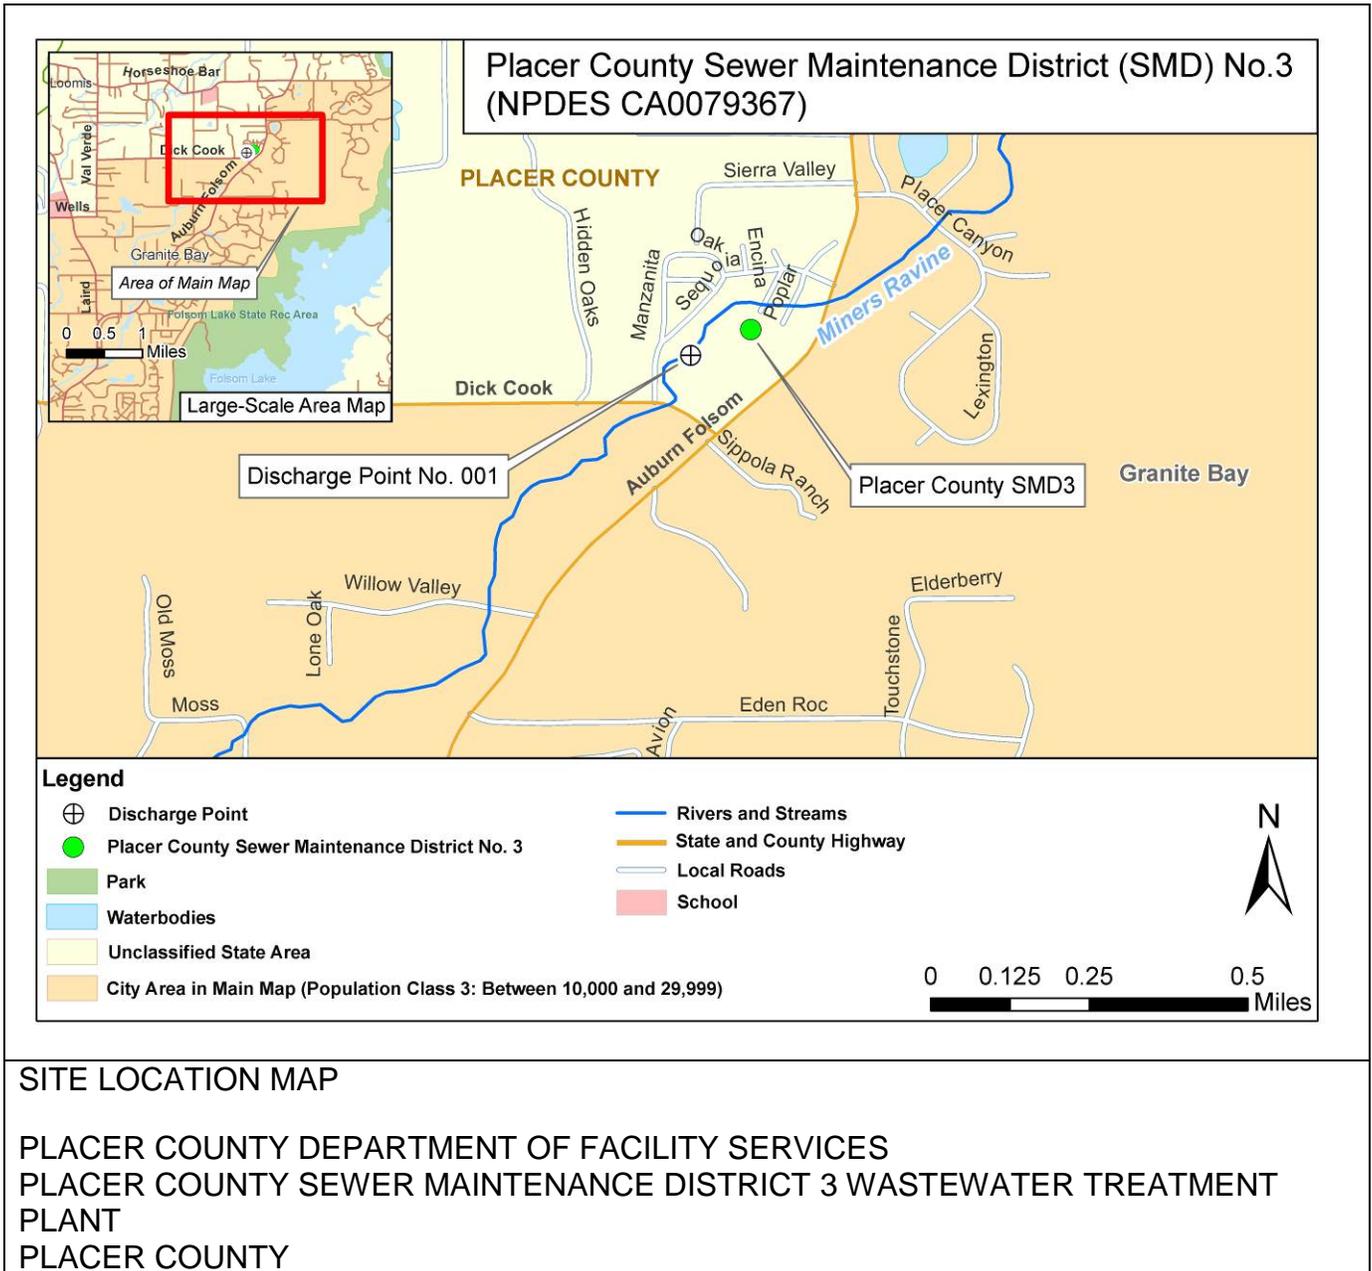

### ATTACHMENT C – FLOW SCHEMATIC

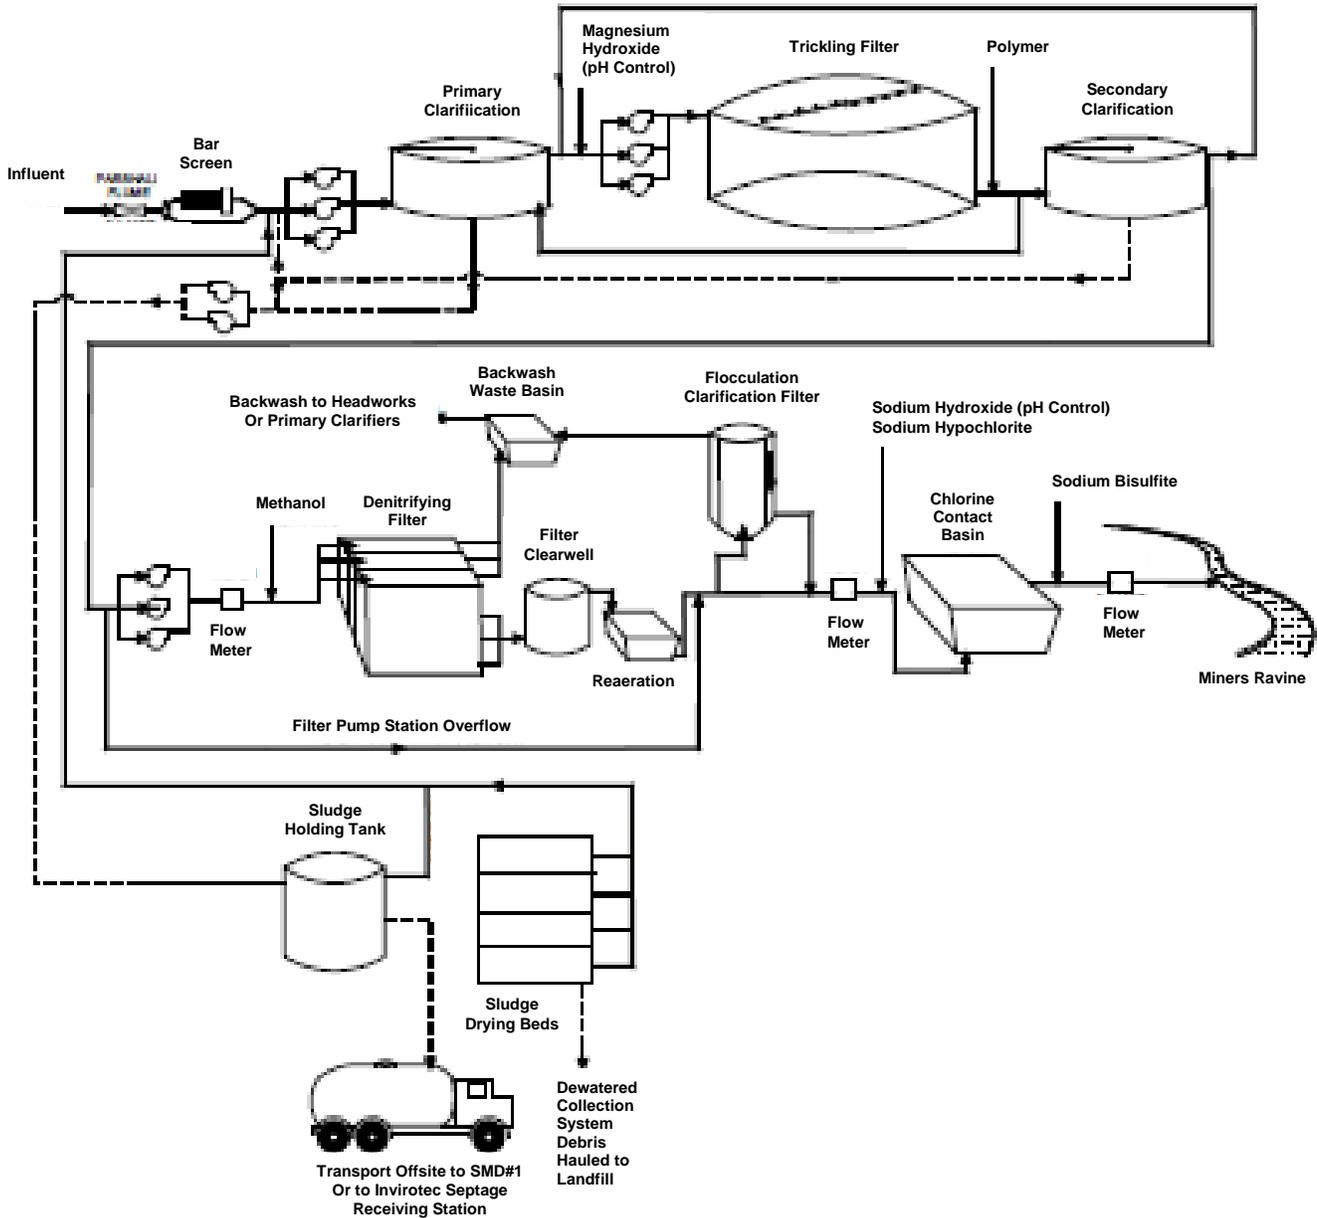

## **ATTACHMENT D – STANDARD PROVISIONS**

### **I. STANDARD PROVISIONS – PERMIT COMPLIANCE**

#### **A. Duty to Comply**

1. The Discharger must comply with all of the conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code (Water Code) and is grounds for enforcement action, for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application. (40 CFR 122.41(a).)
2. The Discharger shall comply with effluent standards or prohibitions established under section 307(a) of the CWA for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement. (40 CFR 122.41(a)(1).)

#### **B. Need to Halt or Reduce Activity Not a Defense**

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order. (40 CFR 122.41(c))

#### **C. Duty to Mitigate**

The Discharger shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment. (40 CFR 122.41(d))

#### **D. Proper Operation and Maintenance**

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order. (40 CFR 122.41(e).)

#### **E. Property Rights**

1. This Order does not convey any property rights of any sort or any exclusive privileges. (40 CFR 122.41(g))

2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of state or local law or regulations. (40 CFR 122.5(c))

## **F. Inspection and Entry**

The Discharger shall allow the Regional Water Board, State Water Board, United States Environmental Protection Agency (USEPA), and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to (40 CFR 122.41(i); Water Code section 13383):

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order (40 CFR 122.41(i)(1));
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order (40 CFR 122.41(i)(2));
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order (40 CFR 122.41(i)(3)); and
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the Water Code, any substances or parameters at any location. (40 CFR 122.41(i)(4))

## **G. Bypass**

1. Definitions
  - a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility. (40 CFR 122.41(m)(1)(i))
  - b. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production. (40 CFR 122.41(m)(1)(ii))
2. Bypass not exceeding limitations. The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3, I.G.4, and I.G.5 below. (40 CFR 122.41(m)(2))

3. Prohibition of bypass. Bypass is prohibited, and the Regional Water Board may take enforcement action against a Discharger for bypass, unless (40 CFR 122.41(m)(4)(i)):
  - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage (40 CFR 122.41(m)(4)(i)(A));
  - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance (40 CFR 122.41(m)(4)(i)(B)); and
  - c. The Discharger submitted notice to the Regional Water Board as required under Standard Provisions – Permit Compliance I.G.5 below. (40 CFR 122.41(m)(4)(i)(C))
4. The Regional Water Board may approve an anticipated bypass, after considering its adverse effects, if the Regional Water Board determines that it will meet the three conditions listed in Standard Provisions – Permit Compliance I.G.3 above. (40 CFR 122.41(m)(4)(ii))
5. Notice
  - a. Anticipated bypass. If the Discharger knows in advance of the need for a bypass, it shall submit a notice, if possible at least 10 days before the date of the bypass. (40 CFR 122.41(m)(3)(i))
  - b. Unanticipated bypass. The Discharger shall submit notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below (24-hour notice). (40 CFR 122.41(m)(3)(ii))

## H. Upset

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the Discharger. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation. (40 CFR 122.41(n)(1))

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of Standard Provisions – Permit Compliance I.H.2 below are met. No determination made during administrative review of claims that noncompliance was

caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review. (40 CFR 122.41(n)(2))

2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that (40 CFR 122.41(n)(3)):
  - a. An upset occurred and that the Discharger can identify the cause(s) of the upset (40 CFR 122.41(n)(3)(i));
  - b. The permitted facility was, at the time, being properly operated (40 CFR 122.41(n)(3)(ii));
  - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b below (24-hour notice) (40 CFR 122.41(n)(3)(iii)); and
  - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above. (40 CFR 122.41(n)(3)(iv))
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof. (40 CFR 122.41(n)(4))

## **II. STANDARD PROVISIONS – PERMIT ACTION**

### **A. General**

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition. (40 CFR 122.41(f))

### **B. Duty to Reapply**

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit. (40 CFR 122.41(b))

### **C. Transfers**

This Order is not transferable to any person except after notice to the Regional Water Board. The Regional Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the Water Code. (40 CFR 122.41(l)(3) and 122.61)

### III. STANDARD PROVISIONS – MONITORING

- A. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity. (40 CFR 122.41(j)(1))
- B. Monitoring results must be conducted according to test procedures under 40 CFR Part 136 or, in the case of sludge use or disposal, approved under 40 CFR Part 136 unless otherwise specified in 40 CFR Part 503 unless other test procedures have been specified in this Order. (40 CFR 122.41(j)(4) and 122.44(i)(1)(iv))

### IV. STANDARD PROVISIONS – RECORDS

- E. Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least 5 years (or longer as required by 40 CFR Part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Regional Water Board Executive Officer at any time. (40 CFR 122.41(j)(2))

#### F. Records of monitoring information shall include:

1. The date, exact place, and time of sampling or measurements (40 CFR 122.41(j)(3)(i));
2. The individual(s) who performed the sampling or measurements (40 CFR 122.41(j)(3)(ii));
3. The date(s) analyses were performed (40 CFR 122.41(j)(3)(iii));
4. The individual(s) who performed the analyses (40 CFR 122.41(j)(3)(iv));
5. The analytical techniques or methods used (40 CFR 122.41(j)(3)(v)); and
6. The results of such analyses. (40 CFR 122.41(j)(3)(vi))

#### G. Claims of confidentiality for the following information will be denied (40 CFR 122.7(b)):

1. The name and address of any permit applicant or Discharger (40 CFR 122.7(b)(1)); and
2. Permit applications and attachments, permits and effluent data. (40 CFR 122.7(b)(2))

## **V. STANDARD PROVISIONS – REPORTING**

### **A. Duty to Provide Information**

The Discharger shall furnish to the Regional Water Board, State Water Board, or USEPA within a reasonable time, any information which the Regional Water Board, State Water Board, or USEPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Regional Water Board, State Water Board, or USEPA copies of records required to be kept by this Order. (40 CFR 122.41(h); Wat. Code, § 13267)

### **B. Signatory and Certification Requirements**

1. All applications, reports, or information submitted to the Regional Water Board, State Water Board, and/or USEPA shall be signed and certified in accordance with Standard Provisions – Reporting V.B.2, V.B.3, V.B.4, and V.B.5 below. (40 CFR 122.41(k))
2. All permit applications shall be signed by either a principal executive officer or ranking elected official. For purposes of this provision, a principal executive officer of a federal agency includes: (i) the chief executive officer of the agency, or (ii) a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., Regional Administrators of USEPA). (40 CFR 122.22(a)(3)).
3. All reports required by this Order and other information requested by the Regional Water Board, State Water Board, or USEPA shall be signed by a person described in Standard Provisions – Reporting V.B.2 above, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
  - a. The authorization is made in writing by a person described in Standard Provisions – Reporting V.B.2 above (40 CFR 122.22(b)(1));
  - b. The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.) (40 CFR 122.22(b)(2)); and
  - c. The written authorization is submitted to the Regional Water Board and State Water Board. (40 CFR 122.22(b)(3))
4. If an authorization under Standard Provisions – Reporting V.B.3 above is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Standard

Provisions – Reporting V.B.3 above must be submitted to the Regional Water Board and State Water Board prior to or together with any reports, information, or applications, to be signed by an authorized representative. (40 CFR 122.22(c))

5. Any person signing a document under Standard Provisions – Reporting V.B.2 or V.B.3 above shall make the following certification:

*“I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.”* (40 CFR 122.22(d))

### **C. Monitoring Reports**

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program (Attachment E) in this Order. (40 CFR 122.22(l)(4))
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Regional Water Board or State Water Board for reporting results of monitoring of sludge use or disposal practices. (40 CFR 122.41(l)(4)(i))
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under 40 CFR Part 136 or, in the case of sludge use or disposal, approved under 40 CFR Part 136 unless otherwise specified in 40 CFR Part 503, or as specified in this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Regional Water Board. (40 CFR 122.41(l)(4)(ii))
4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order. (40 CFR 122.41(l)(4)(iii))

### **D. Compliance Schedules**

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date. (40 CFR 122.41(l)(5))

### **E. Twenty-Four Hour Reporting**

1. The Discharger shall notify the Office of Emergency Services of any noncompliance that may endanger health or the environment within two (2) hours from the time the Discharger becomes aware of the circumstances. The Discharger shall notify the

Central Valley Water Board of the noncompliance by telephone or fax within 24 hours from the time the Discharger becomes aware of the circumstances. A written submission shall also be provided to the Central Valley Water Board within five (5) days of the time the Discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance. (40 CFR 122.41(l)(6)(i))

2. The following shall be included as information that must be reported within 24 hours under this paragraph (40 CFR 122.41(l)(6)(ii)):
  - a. Any unanticipated bypass that exceeds any effluent limitation in this Order. (40 CFR 122.41(l)(6)(ii)(A))
  - b. Any upset that exceeds any effluent limitation in this Order. (40 CFR 122.41(l)(6)(ii)(B))
3. The Regional Water Board may waive the above-required written report under this provision on a case-by-case basis if an oral report has been received within 24 hours. (40 CFR 122.41(l)(6)(iii))

#### **F. Planned Changes**

The Discharger shall give notice to the Regional Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when (40 CFR 122.41(l)(1)):

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR 122.29(b) (40 CFR 122.41(l)(1)(i)); or
2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are not subject to effluent limitations in this Order. (40 CFR 122.41(l)(1)(ii))
3. The alteration or addition results in a significant change in the Discharger's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan. (40 CFR 122.41(l)(1)(iii))

#### **G. Anticipated Noncompliance**

The Discharger shall give advance notice to the Regional Water Board or State Water Board of any planned changes in the permitted facility or activity that may result in noncompliance with General Order requirements. (40 CFR 122.41(l)(2))

## **H. Other Noncompliance**

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting V.C, V.D, and V.E above at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E above. (40 CFR 122.41(l)(7))

## **I. Other Information**

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Regional Water Board, State Water Board, or USEPA, the Discharger shall promptly submit such facts or information. (40 CFR 122.41(l)(8))

## **VI. STANDARD PROVISIONS – ENFORCEMENT**

- A.** The Regional Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13385, 13386, and 13387.

## **VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS**

### **A. Publicly-Owned Treatment Works (POTWs)**

All POTWs shall provide adequate notice to the Regional Water Board of the following (40 CFR 122.42(b)):

- 1.** Any new introduction of pollutants into the POTW from an indirect discharger that would be subject to sections 301 or 306 of the CWA if it were directly discharging those pollutants (40 CFR 122.42(b)(1)); and
- 2.** Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of adoption of the Order. (40 CFR 122.42(b)(2))
- 3.** Adequate notice shall include information on the quality and quantity of effluent introduced into the POTW as well as any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW. (40 CFR 122.42(b)(3)).

## ATTACHMENT E – MONITORING AND REPORTING PROGRAM

### Table of Contents

I.	General Monitoring Provisions.....	E-2
II.	Monitoring Locations .....	E-4
III.	Influent Monitoring Requirements.....	E-5
	A. Monitoring Location INF-001.....	E-5
IV.	Effluent Monitoring Requirements .....	E-5
	A. Monitoring Location EFF-001.....	E-5
V.	Whole Effluent Toxicity Testing Requirements .....	E-7
VI.	Land Discharge Monitoring Requirements – Not Applicable .....	E-9
VII.	Reclamation Monitoring Requirements – Not Applicable.....	E-10
VIII.	Receiving Water Monitoring Requirements – Surface Water and Groundwater .....	E-10
	A. Monitoring Locations RSW-001 and RSW-002.....	E-10
IX.	Other Monitoring Requirements.....	E-11
	A. Biosolids .....	E-11
	B. Municipal Water Supply .....	E-11
X.	Reporting Requirements.....	E-12
	A. General Monitoring and Reporting Requirements.....	E-12
	B. Electronic Self Monitoring Reports (eSMRs).....	E-12
	C. Discharge Monitoring Reports (DMRs) – Not Applicable .....	E-16
	D. Other Reports .....	E-16

### List of Tables

Table E-1.	Monitoring Station Locations.....	E-4
Table E-2.	Influent Monitoring.....	E-5
Table E-3.	Effluent Monitoring .....	E-5
Table E-4.	Chronic Toxicity Testing Dilution Series.....	E-8
Table E-5.	Receiving Water Monitoring Requirements .....	E-10
Table E-6.	Municipal Water Supply Monitoring Requirements.....	E-11
Table E-7.	Monitoring Periods and Reporting Schedule .....	E-13
Table E-8.	Reporting Requirements for Special Provisions Reports .....	E-16

## **ATTACHMENT E – MONITORING AND REPORTING PROGRAM**

Title 40 of the Code of Federal Regulations (CFR), section 122.48 (40 CFR 122.48) requires that all NPDES permits specify monitoring and reporting requirements. California Water Code (Water Code) sections 13267 and 13383 also authorize the Regional Water Quality Control Board, Central Valley Region (Central Valley Water Board) to require technical and monitoring reports. This Monitoring and Reporting Program establishes monitoring and reporting requirements, which implement the federal and California regulations.

### **I. GENERAL MONITORING PROVISIONS**

- A.** Samples and measurements taken as required herein shall be representative of the volume and nature of the monitored discharge. All samples shall be taken at the monitoring locations specified below and, unless otherwise specified, before the monitored flow joins or is diluted by any other waste stream, body of water, or substance. Monitoring locations shall not be changed without notification to and the approval of the Central Valley Water Board.
- B.** Effluent samples shall be taken downstream of the last addition of wastes to the treatment or discharge works where a representative sample may be obtained prior to mixing with the receiving waters. Samples shall be collected at such a point and in such a manner to ensure a representative sample of the discharge.
- C.** Chemical, bacteriological, and bioassay analyses of any material required by this Order shall be conducted by a laboratory certified for such analyses by the Department of Public Health (DPH). Laboratories that perform sample analyses must be identified in all monitoring reports submitted to the Central Valley Water Board. In the event a certified laboratory is not available to the Discharger for any onsite field measurements such as pH, dissolved oxygen, turbidity, temperature and residual chlorine, such analyses performed by a noncertified laboratory will be accepted provided a Quality Assurance-Quality Control Program is instituted by the laboratory. A manual containing the steps followed in this program for any onsite field measurements such as pH, dissolved oxygen, turbidity, temperature and residual chlorine must be kept onsite in the treatment facility laboratory and shall be available for inspection by Central Valley Water Board staff. The Discharger must demonstrate sufficient capability (qualified and trained employees, properly calibrated and maintained field instruments, etc.) to adequately perform these field measurements. The Quality Assurance-Quality Control Program must conform to USEPA guidelines or to procedures approved by the Central Valley Water Board.
- D.** Appropriate flow measurement devices and methods consistent with accepted scientific practices shall be selected and used to ensure the accuracy and reliability of measurements of the volume of monitored discharges. All monitoring instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary, at least yearly, to ensure their continued accuracy. All flow measurement devices shall be calibrated at least once per year to ensure continued accuracy of the devices.

- E.** Monitoring results, including noncompliance, shall be reported at intervals and in a manner specified in this Monitoring and Reporting Program.
- F.** Laboratories analyzing monitoring samples shall be certified by DPH, in accordance with the provision of Water Code section 13176, and must include quality assurance/quality control data with their reports.
- G.** The Discharger shall conduct analysis on any sample provided by USEPA as part of the Discharge Monitoring Quality Assurance (DMQA) program. The results of any such analysis shall be submitted to USEPA's DMQA manager.
- H.** The Discharger shall file with the Central Valley Water Board technical reports on self-monitoring performed according to the detailed specifications contained in this Monitoring and Reporting Program.
- I.** The results of all monitoring required by this Order shall be reported to the Central Valley Water Board, and shall be submitted in such a format as to allow direct comparison with the limitations and requirements of this Order. Unless otherwise specified, discharge flows shall be reported in terms of the monthly average and the daily maximum discharge flows.

## II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

**Table E-1. Monitoring Station Locations**

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
--	INF-001	Treatment plant headworks.
001	EFF-001	Downstream from the last connection through which wastes can be admitted to the outfall (38° 43' 53" N, 121° 18' 58" W).
--	RSW-001	25 feet upstream from Discharge Point No. 001 in Miners Ravine.
--	RSW-002	350 feet downstream from Discharge Point No. 001 in Miners Ravine.
--	BIO-001	A location where a representative sample of the biosolids can be obtained.
--	SPL-001	A location where a representative sample of the municipal water supply can be obtained.

### III. INFLUENT MONITORING REQUIREMENTS

#### A. Monitoring Location INF-001

1. The Discharger shall monitor influent to the facility at Monitoring Location INF-001 as follows:

**Table E-2. Influent Monitoring**

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	MGD	Meter	Continuous	1
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	24-hr Composite <sup>2</sup>	1/Week	1
Total Suspended Solids	mg/L	24-hr Composite <sup>2</sup>	1/Week	1

<sup>1</sup> Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136; or by methods approved by the Central Valley Water Board or the State Water Board.

<sup>2</sup> 24-hour flow proportional composite.

### IV. EFFLUENT MONITORING REQUIREMENTS

#### A. Monitoring Location EFF-001

1. The Discharger shall monitor tertiary treated effluent at Monitoring Location EFF-001 as follows. If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding Minimum Level. Where a CTR constituent is listed in Appendix 4 of the SIP, the reporting level specified in Attachment I must be achieved by the laboratory conducting the analysis.

**Table E-3. Effluent Monitoring**

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	MGD	Meter	Continuous	1
Dilution Ratio (Miners Ravine Flow : Effluent Flow)	--	Calculate	1/Day	--
<b>Conventional Pollutants</b>				
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	24-hr Composite <sup>2</sup>	1/Week	1
	lbs/day	Calculate	1/Week	--
pH	standard units	Meter	Continuous <sup>3,4</sup>	1
Total Suspended Solids	mg/L	24-hr Composite <sup>2</sup>	1/Week	1
	lbs/day	Calculate	1/Week	--
<b>Priority Pollutants</b>				
Benzene	µg/L	Grab	<sup>6</sup>	1,5
Copper, Total Recoverable	µg/L	Grab	1/Month	1,5

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Dibromochloromethane	µg/L	Grab	1/Month	1,5
Dichlorobromomethane	µg/L	Grab	1/Month	1,5
Priority Pollutants and Other Constituents of Concern	µg/L	Att. I	Att. I	1,5
<b>Non-Conventional Pollutants</b>				
Ammonia Nitrogen, Total (as N)	mg/L	Grab	3/Week <sup>3,7</sup>	1
	lbs/day	Calculate	3/Week	--
Chlorine, Total Residual	mg/L	Meter	Continuous	1,8
Dissolved Oxygen	mg/L	Grab	1/Month	1
Electrical Conductivity @ 25°C	µmhos/cm	Grab	1/Quarter	1
Nitrate Nitrogen, Total (as N)	mg/L	Grab	1/Month <sup>9</sup>	1
Nitrite Nitrogen, Total (as N)	mg/L	Grab	1/Month <sup>9</sup>	1
Temperature	°C	Grab	3/Week <sup>3,4</sup>	1
Total Coliform Organisms	MPN/100 mL	Grab	3/Week <sup>10</sup>	1
Total Dissolved Solids	mg/L	Grab	1/Quarter	1
Total Trihalomethanes <sup>11</sup>	µg/L	Grab	1/Month	1
Turbidity	NTU	Meter	Continuous	1

<sup>1</sup> Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.

<sup>2</sup> 24-hour flow proportional composite.

<sup>3</sup> pH and temperature shall be recorded at the time of ammonia sample collection.

<sup>4</sup> A hand-held field meter may be used, provided the meter utilizes a USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

<sup>5</sup> The maximum required Reporting Level is specified in Attachment I, Table I-1, Priority Pollutants and Other Constituents of Concern. Sampling and analysis of bis (2-ethylhexyl) phthalate shall be conducted using ultra-clean techniques that eliminate the possibility of sample contamination.

<sup>6</sup> Benzene shall be sampled bi-monthly for 1 year beginning 30 July 2015 and ending 30 July 2016, for a total of six samples.

<sup>7</sup> Concurrent with whole effluent toxicity monitoring.

<sup>8</sup> Total chlorine residual must be monitored with a method sensitive to and accurate at the permitted level of 0.01 mg/L.

<sup>9</sup> Monitoring for nitrite and nitrate shall be conducted concurrently.

<sup>10</sup> Samples for total coliform organisms may be collected at any point following disinfection.

<sup>11</sup> Applies to the sum of bromoform, chloroform, dibromochloromethane, and dichlorobromomethane.

## V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

**A. Acute Toxicity Testing.** The Discharger shall conduct acute toxicity testing to determine whether the effluent is contributing acute toxicity to the receiving water. The Discharger shall meet the following acute toxicity testing requirements:

1. Monitoring Frequency – The Discharger shall perform semi-annual acute toxicity testing, concurrent with effluent ammonia sampling.
2. Sample Types – The Discharger may use flow-through, static non-renewal, or static renewal testing. For static non-renewal and static renewal testing, the samples shall be flow proportional 24-hour composites and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at Monitoring Location EFF-001.
3. Test Species – Test species shall be fathead minnows (*Pimephales promelas*).
4. Methods – The acute toxicity testing samples shall be analyzed using EPA-821-R-02-012, Fifth Edition. Temperature, total residual chlorine, and pH shall be recorded at the time of sample collection. No pH adjustment may be made unless approved by the Executive Officer.
5. Test Failure – If an acute toxicity test does not meet all test acceptability criteria, as specified in the test method, the Discharger must re-sample and re-test as soon as possible, not to exceed 7 business days following notification of test failure.

**B. Chronic Toxicity Testing.** The Discharger shall conduct three species chronic toxicity testing to determine whether the effluent is contributing chronic toxicity to the receiving water. The Discharger shall meet the following chronic toxicity testing requirements:

1. Monitoring Frequency – The Discharger shall perform semi-annual three species chronic toxicity testing.
2. Sample Types – Effluent samples shall be flow proportional 24-hour composites and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at Monitoring Location EFF-001. The receiving water control shall be a grab sample obtained from Monitoring Location RSW-001, as identified in this Monitoring and Reporting Program.
3. Sample Volumes – Adequate sample volumes shall be collected to provide renewal water to complete the test in the event that the discharge is intermittent.
4. Test Species – Chronic toxicity testing measures sublethal (e.g., reduced growth, reproduction) and/or lethal effects to test organisms exposed to an effluent compared to that of the control organisms. The Discharger shall conduct chronic toxicity tests with:

- The cladoceran, water flea, *Ceriodaphnia dubia* (survival and reproduction test);

- The fathead minnow, *Pimephales promelas* (larval survival and growth test); and
  - The green alga, *Selenastrum capricornutum* (growth test).
5. **Methods** – The presence of chronic toxicity shall be estimated as specified in *Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA/821-R-02-013, October 2002.*
  6. **Reference Toxicant** – As required by the SIP, all chronic toxicity tests shall be conducted with concurrent testing with a reference toxicant and shall be reported with the chronic toxicity test results.
  7. **Dilutions** – For regular and accelerated chronic toxicity monitoring, it is not necessary to perform the test using a dilution series. The test may be performed using 100% effluent and two controls. For TRE monitoring, the chronic toxicity testing shall be performed using the dilution series identified in Table E-4, below, unless use of an alternative diluent is detailed in the submitted TRE Action Plan, or when the receiving water is toxic.

**Table E-4. Chronic Toxicity Testing Dilution Series**

Sample	Dilutions (%)					Controls	
	100	75	50	25	12.5	Receiving Water	Laboratory Water
% Effluent	100	75	50	25	12.5	0	0
% Receiving Water	0	25	50	75	87.5	100	0
% Laboratory Water	0	0	0	0	0	0	100

8. **Test Failure** – The Discharger must re-sample and re-test as soon as possible, but no later than fourteen (14) days after receiving notification of a test failure. A test failure is defined as follows:
  - a. The reference toxicant test or the effluent test does not meet all test acceptability criteria as specified in the *Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA/821-R-02-013, October 2002 (Method Manual),* and its subsequent amendments or revisions; or
  - b. The percent minimum significant difference (PMSD) measured for the test exceeds the upper PMSD bound variability criterion in Table 6 on page 52 of the Method Manual. (A retest is only required in this case if the test results do not exceed the monitoring trigger specified in the Special Provision at section VI. 2.a.iii. of the Order.)

**C. WET Testing Notification Requirements.** The Discharger shall notify the Central Valley Water Board within 24-hours after the receipt of test results exceeding the monitoring trigger during regular or accelerated monitoring, or an exceedance of the acute toxicity effluent limitation.

**D. WET Testing Reporting Requirements.** All toxicity test reports shall include the contracting laboratory's complete report provided to the Discharger and shall be in accordance with the appropriate "Report Preparation and Test Review" sections of the method manuals. At a minimum, whole effluent toxicity monitoring shall be reported as follows:

1. **Chronic WET Reporting.** Regular chronic toxicity monitoring results shall be reported to the Central Valley Water Board within 45 days following completion of the test, and shall contain, at minimum:
  - c. The results expressed in TUc, measured as 100/NOEC, and also measured as 100/LC50, 100/EC25, 100/IC25, and 100/IC50, as appropriate.
  - d. The statistical methods used to calculate endpoints;
  - e. The statistical output page, which includes the calculation of the percent minimum significant difference (PMSD);
  - f. The dates of sample collection and initiation of each toxicity test; and
  - g. The results compared to the numeric toxicity monitoring trigger.

Additionally, the monthly discharger self-monitoring reports shall contain an updated chronology of chronic toxicity test results expressed in TUc, and organized by test species, type of test (survival, growth or reproduction), and monitoring frequency, i.e., either quarterly, monthly, accelerated, or Toxicity Reduction Evaluation (TRE).

2. **Acute WET Reporting.** Acute toxicity test results shall be submitted with the monthly discharger self-monitoring reports and reported as percent survival.
3. **TRE Reporting.** Reports for TREs shall be submitted in accordance with the schedule contained in the Discharger's approved TRE Workplan, or as amended by the Discharger's TRE Action Plan.
4. **Quality Assurance (QA).** The Discharger must provide the following information for QA purposes:
  - a. Results of the applicable reference toxicant data with the statistical output page giving the species, NOEC, LOEC, type of toxicant, dilution water used, concentrations used, PMSD, and dates tested.
  - b. The reference toxicant control charts for each endpoint, which include summaries of reference toxicant tests performed by the contracting laboratory.
  - c. Any information on deviations or problems encountered and how they were dealt with.

## **VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE**

**VII. RECLAMATION MONITORING REQUIREMENTS – NOT APPLICABLE**

**VIII. RECEIVING WATER MONITORING REQUIREMENTS – SURFACE WATER AND GROUNDWATER**

**A. Monitoring Locations RSW-001 and RSW-002**

1. The Discharger shall monitor Miners Ravine at Monitoring Locations RSW-001 and RSW-002 as follows:

**Table E-5. Receiving Water Monitoring Requirements**

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	MGD	Meter	1/Day <sup>1</sup>	--
<b>Conventional Pollutants</b>				
pH	standard units	Grab	1/Week <sup>2</sup>	3, 4
<b>Priority Pollutants</b>				
Priority Pollutants and Other Constituents of Concern <sup>1, 5</sup>	µg/L	Grab	<sup>6</sup>	3,7
<b>Non-Conventional Pollutants</b>				
Dissolved Oxygen	mg/L	Grab	1/Week	3, 4
Electrical Conductivity @ 25°C	µmhos/cm	Grab	1/Week	3, 4
Fecal Coliform Organisms	MPN/100 mL	Grab	1/Quarter	3
Turbidity	NTU	Grab	1/Week	3, 4
Temperature	°C	Grab	1/Week <sup>2</sup>	3, 4

- <sup>1</sup> Monitoring required at Monitoring Location RSW-001 only.
- <sup>2</sup> Temperature and pH shall be determined at the time of effluent ammonia sampling.
- <sup>3</sup> Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136.
- <sup>4</sup> A hand-held field meter may be used, provided the meter utilizes a USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer’s instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
- <sup>5</sup> See list of Priority Pollutants and Other Constituents of Concern in Attachment I.
- <sup>6</sup> Sampling shall be conducted quarterly during the third or fourth year following permit adoption and shall be conducted concurrently with effluent monitoring for priority pollutants. See Attachment I for more detailed requirements related to performing priority pollutant monitoring.
- <sup>7</sup> The maximum required Reporting Level is specified in Attachment I, Table I-1, Priority Pollutants and Other Constituents of Concern. Sampling and analysis of bis (2-ethylhexyl) phthalate shall be conducted using ultra-clean techniques that eliminate the possibility of sample contamination.

2. In conducting the receiving water sampling, a log shall be kept of the receiving water conditions throughout the reach bounded by Monitoring Locations RSW-001 and RSW-002. Attention shall be given to the presence or absence of:
  - a. Floating or suspended matter;
  - b. Discoloration;

- c. Bottom deposits;
- d. Aquatic life;
- e. Visible films, sheens, or coatings;
- f. Fungi, slimes, or objectionable growths; and
- g. Potential nuisance conditions.

Notes on receiving water conditions shall be summarized in the monitoring report.

**IX. OTHER MONITORING REQUIREMENTS**

**A. Biosolids**

**1. Monitoring Location BIO-001**

- a. A composite sample of sludge shall be collected annually at Monitoring Location BIO-001 in accordance with USEPA's *POTW Sludge Sampling and Analysis Guidance Document*, August 1989, and tested for the metals listed in Title 22.
- b. Sampling records shall be retained for a minimum of **5 years**. A log shall be maintained of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log must be complete enough to serve as a basis for part of the annual report.

**B. Municipal Water Supply**

**1. Monitoring Location SPL-001**

The Discharger shall monitor the municipal water supply at Monitoring Location SPL 001 as follows. Publicly available data may be used in lieu of the monitoring established in Table E-6 below to demonstrate the average quality of the water supply. The Discharger is not required to collect water supply data from private homeowner wells.

**Table E-6. Municipal Water Supply Monitoring Requirements**

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Total Dissolved Solids <sup>1</sup>	mg/L	Grab	1/Year	<sup>2</sup>
Electrical Conductivity @ 25°C <sup>1</sup>	µmhos/cm	Grab	1/Year	<sup>2</sup>

<sup>1</sup> If the water supply is from more than one public source, the total dissolved solids and electrical conductivity shall be reported as a weighted average and include copies of supporting calculations.

<sup>2</sup> Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.

## **X. REPORTING REQUIREMENTS**

### **A. General Monitoring and Reporting Requirements**

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. Upon written request of the Central Valley Water Board, the Discharger shall submit a summary monitoring report. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year(s).
3. **Compliance Time Schedules.** For compliance time schedules included in the Order, the Discharger shall submit to the Central Valley Water Board, on or before each compliance due date, the specified document or a written report detailing compliance or noncompliance with the specific date and task. If noncompliance is reported, the Discharger shall state the reasons for noncompliance and include an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Central Valley Water Board by letter when it returns to compliance with the compliance time schedule.
4. The Discharger shall report to the Central Valley Water Board any toxic chemical release data it reports to the State Emergency Response Commission within 15 days of reporting the data to the Commission pursuant to section 313 of the "*Emergency Planning and Community Right to Know Act*" of 1986.
5. Reporting requirements shall be in accordance with due dates specified in this Order. If the due date is on a Saturday, Sunday, State holiday, or a day the corresponding Water Board(s) office(s) is(are) closed, the due date shall be on the next business day.

### **B. Electronic Self Monitoring Reports (eSMRs)**

1. The Discharger shall continue to submit eSMRs using the State Water Board's CIWQS Program Web site (<http://www.waterboards.ca.gov/ciwqs/index.html>). The Discharger shall maintain sufficient staffing and resources to ensure it submits eSMRs during the effective duration of this Order. This includes provision of training and supervision of individuals (e.g., Discharger personnel or consultant) on how to prepare and submit eSMRs.
2. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

**Table E-7. Monitoring Periods and Reporting Schedule**

Sampling Frequency	Monitoring Period Begins On...	Monitoring Period	SMR Due Date
Continuous	Permit effective date	Continuous	First day of second calendar month following month of sampling
1/Week	Permit effective date	Sunday through Saturday	First day of second calendar month following month of sampling
5/Week	Permit effective date	Sunday through Saturday	First day of second calendar month following month of sampling
1/Month	Permit effective date	First day of calendar month through last day of calendar month	First day of second calendar month following month of sampling
1/Quarter	Permit effective date	1 January through 31 March 1 April through 30 June 1 July through 30 September 1 October through 31 December	1 May 1 August 1 November 1 February (of following year)
2/Year	Permit effective date	1 January through 30 June 1 July through 31 December	1 August 1 February (of following year)
1/Year	Permit effective date	1 January through 31 December	1 February

**3. Reporting Protocols.** The Discharger shall report with each sample result the applicable reported Reporting Level (RL) and the current Method Detection Limit (MDL), as determined by the procedure in 40 CFR Part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory’s MDL, shall be reported as “Detected, but Not Quantified,” or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ as well as the words “Estimated Concentration” (may be shortened to “Est. Conc.”). The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (+ a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory’s MDL shall be reported as “Not Detected,” or ND.



- b. Mass Loading Limitations.** For BOD<sub>5</sub>, TSS, and ammonia, the Discharger shall calculate and report the mass loading (lbs/day) in the SMRs. The mass loading shall be calculated as follows:

$$\text{Mass Loading (lbs/day)} = \text{Flow (MGD)} \times \text{Concentration (mg/L)} \times 8.34$$

When calculating daily mass loading, the daily average flow and constituent concentration shall be used. For weekly average mass loading, the weekly average flow and constituent concentration shall be used. For monthly average mass loading, the monthly average flow and constituent concentration shall be used.

- c. Removal Efficiency (BOD<sub>5</sub> and TSS).** The Discharger shall calculate and report the percent removal of BOD<sub>5</sub> and TSS in the SMRs. The percent removal shall be calculated as specified in Section VII.A. of the Limitations and Discharge Requirements.
- d. Total Coliform Organisms Effluent Limitations.** The Discharger shall calculate and report the 7-day median of total coliform organisms for the effluent. The 7-day median of total coliform organisms shall be calculated as specified in Section VII.C. of the Limitations and Discharge Requirements.
- e. Dissolved Oxygen Receiving Water Limitations.** The Discharger shall calculate and report monthly in the self-monitoring report: i) the dissolved oxygen concentration, ii) the percent of saturation in the main water mass, and iii) the 95th percentile dissolved oxygen concentration.
- f. Turbidity Receiving Water Limitations.** The Discharger shall calculate and report the turbidity increase in the receiving water applicable to the natural turbidity condition specified in Section V.A.17.a-e of the Limitations and Discharge Requirements.
- g. Temperature Receiving Water Limitations.** The Discharger shall calculate and report the temperature increase in the receiving water based on the difference in temperature at Monitoring Locations RSW-001 and RSW-002.
- 7. The Discharger shall submit eSMRs in accordance with the following requirements:**
- a.** When electronic submittal of data is required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS.
- b.** The Discharger shall attach a cover letter with the eSMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and the proposed time schedule for

corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.

**C. Discharge Monitoring Reports (DMRs) – Not Applicable**

**D. Other Reports**

- 1. Special Study Reports and Progress Reports.** As specified in the Special Provisions contained in section VI of the Order, special study reports and progress reports shall be submitted in accordance with the following reporting requirements. At minimum, the progress reports shall include a discussion of the status of final compliance, whether the Discharger is on schedule to meet the final compliance date, and the remaining tasks to meet the final compliance date.

**Table E-8. Reporting Requirements for Special Provisions Reports**

Special Provision	Reporting Requirements
Benzene Study Work Plan (Section VI.C.2.b)	30 January 2015 <sup>1</sup>
Benzene Study Report (Section VI.C.2.b)	30 January 2017 <sup>1</sup>
Salinity Evaluation and Minimization Plan (Section VI.C.3.a)	20 April 2014 <sup>1</sup>

<sup>1</sup> Submission of the report is only required if construction of the project to regionalize the Facility has not begun by 31 October 2013.

- 2.** The Discharger shall report the results of any special studies, chronic toxicity testing, and TRE/TIE required by Special Provisions VI.C of this Order. For any report requirements not listed in Table E-8, the Discharger shall submit reports with the first monthly SMR scheduled to be submitted on or immediately following the report due date. For chronic toxicity, the laboratory reports shall be submitted with the first monthly SMR scheduled to be submitted on or immediately following the Discharger’s receipt of the reports from the laboratory.
- 3.** Within 60 days of permit adoption, the Discharger shall submit a report outlining reporting levels (RLs), method detection limits, and analytical methods for approval. The Discharger shall comply with the monitoring and reporting requirements for CTR constituents as outlined in section 2.3 and 2.4 of the SIP. The maximum required reporting levels for priority pollutant constituents shall be based on the Minimum Levels (MLs) contained in Appendix 4 of the SIP, determined in accordance with Section 2.4.2 and Section 2.4.3 of the SIP. In accordance with Section 2.4.2 of the SIP, when there is more than one ML value for a given substance, the Central Valley Water Board shall include as RLs, in the permit, all ML values, and their associated analytical methods, listed in Appendix 4 that are below the calculated effluent limitation. The Discharger may select any one of those cited analytical methods for compliance determination. If no ML value is below the effluent limitation, then the Central Valley Water Board shall select as the RL, the lowest ML value, and its associated analytical method, listed in Appendix 4 for inclusion in the permit. Table I-1 (Attachment I) provides required maximum reporting levels in accordance with the SIP.

- 4. Annual Operations Report.** By 30 January of each year, the Discharger shall submit a written report to the Executive Officer containing the following:
- a.** The names, certificate grades, and general responsibilities of all persons employed at the Facility.
  - b.** The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
  - c.** A statement certifying when the flow meter(s) and other monitoring instruments and devices were last calibrated, including identification of who performed the calibration.
  - d.** A statement certifying whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last revised and last reviewed for adequacy.
  - e.** The Discharger may also be requested to submit an annual report to the Central Valley Water Board with both tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the compliance record. If violations have occurred, the report shall also discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

## ATTACHMENT F – FACT SHEET

### Table of Contents

I.	Permit Information .....	F-3
II.	Facility Description .....	F-4
	A. Description of Wastewater and Biosolids Treatment or Controls .....	F-4
	B. Discharge Points and Receiving Waters.....	F-4
	C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data .....	F-5
	D. Compliance Summary.....	F-7
	E. Planned Changes .....	F-8
III.	Applicable Plans, Policies, and Regulations.....	F-8
	A. Legal Authorities .....	F-9
	B. California Environmental Quality Act (CEQA) .....	F-9
	C. State and Federal Regulations, Policies, and Plans .....	F-9
	D. Impaired Water Bodies on CWA 303(d) List .....	F-10
	E. Other Plans, Policies and Regulations.....	F-11
IV.	Rationale For Effluent Limitations and Discharge Specifications.....	F-11
	A. Discharge Prohibitions .....	F-12
	B. Technology-Based Effluent Limitations.....	F-13
	1. Scope and Authority.....	F-13
	2. Applicable Technology-Based Effluent Limitations .....	F-13
	C. Water Quality-Based Effluent Limitations (WQBELs).....	F-14
	1. Scope and Authority.....	F-14
	2. Applicable Beneficial Uses and Water Quality Criteria and Objectives.....	F-15
	3. Determining the Need for WQBELs .....	F-24
	4. WQBEL Calculations .....	F-53
	5. Whole Effluent Toxicity (WET) .....	F-55
	D. Final Effluent Limitations.....	F-59
	1. Mass-based Effluent Limitations .....	F-59
	2. Averaging Periods for Effluent Limitations .....	F-59
	3. Satisfaction of Anti-Backsliding Requirements.....	F-60
	4. Satisfaction of Antidegradation Policy.....	F-65
	5. Stringency of Requirements for Individual Pollutants.....	F-66
	E. Interim Effluent Limitations – Not Applicable.....	F-67
	F. Land Discharge Specifications – Not Applicable.....	F-68
	G. Reclamation Specifications – Not Applicable.....	F-68
V.	Rationale for Receiving Water Limitations .....	F-68
	A. Surface Water.....	F-68
	B. Groundwater .....	F-70
VI.	Rationale for Monitoring and Reporting Requirements.....	F-71
	A. Influent Monitoring .....	F-71
	B. Effluent Monitoring.....	F-71
	C. Whole Effluent Toxicity Testing Requirements .....	F-73
	D. Receiving Water Monitoring.....	F-73
	1. Surface Water .....	F-73

2. Groundwater – Not Applicable .....	F-74
E. Other Monitoring Requirements .....	F-74
1. Biosolids Monitoring.....	F-74
2. Water Supply Monitoring.....	F-74
3. Effluent and Receiving Water Characterization Study .....	F-74
VII. Rationale for Provisions.....	F-75
A. Standard Provisions.....	F-75
B. Special Provisions.....	F-75
1. Reopener Provisions.....	F-75
2. Special Studies and Additional Monitoring Requirements.....	F-76
3. Best Management Practices and Pollution Prevention .....	F-80
4. Construction, Operation, and Maintenance Specifications.....	F-80
5. Special Provisions for Municipal Facilities (POTWs Only) .....	F-80
6. Other Special Provisions.....	F-81
7. Compliance Schedules .....	F-81
VIII. Public Participation .....	F-81
A. Notification of Interested Parties .....	F-82
B. Written Comments .....	F-82
C. Public Hearing .....	F-82
D. Waste Discharge Requirements Petitions.....	F-82
E. Information and Copying.....	F-83
F. Register of Interested Persons .....	F-83
G. Additional Information .....	F-83

**List of Tables**

Table F-1. Facility Information .....	F-3
Table F-2. Historic Effluent Limitations and Monitoring Data.....	F-5
Table F-3. Summary of Technology-based Effluent Limitations .....	F-14
Table F-4. Basin Plan Beneficial Uses .....	F-16
Table F-5. Copper ECA Evaluation .....	F-22
Table F-6. Lead ECA Evaluation .....	F-24
Table F-7. Summary of ECA Evaluations for CTR Hardness-dependent Metals.....	F-24
Table F-8. 6 October 2010 Persistent Chlorinated Hydrocarbon Pesticides Results.....	F-32
Table F-9. Minimum MDLs and RLs for Persistent Chlorinated Hydrocarbon Pesticides .	F-33
Table F-10. Arsenic Effluent Data .....	F-34
Table F-11. Benzene Effluent Data .....	F-36
Table F-12. Salinity Water Quality Criteria/Objectives.....	F-50
Table F-13. Total THMs.....	F-52
Table F-14. Summary of Water Quality-Based Effluent Limitations.....	F-55
Table F-15. Whole Effluent Chronic Toxicity Testing Results.....	F-57
Table F-16. Summary of Final Effluent Limitations.....	F-66

## ATTACHMENT F – FACT SHEET

As described in the Findings in section II of this Order, this Fact Sheet includes the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

This Order has been prepared under a standardized format to accommodate a broad range of discharge requirements for Dischargers in California. Only those sections or subsections of this Order that are specifically identified as “not applicable” have been determined not to apply to this Discharger. Sections or subsections of this Order not specifically identified as “not applicable” are fully applicable to this Discharger.

### I. PERMIT INFORMATION

The following table summarizes administrative information related to the Facility.

**Table F-1. Facility Information**

<b>WDID</b>	5A310104018
<b>Discharger</b>	Placer County Department of Facility Services
<b>Name of Facility</b>	Placer County Sewer Maintenance District 3 Wastewater Treatment Plant
<b>Facility Address</b>	4928 Auburn Folsom Road
	Loomis, CA 95650
	Placer County
<b>Facility Contact, Title and Phone</b>	William Zimmerman, Deputy Director, Facility Services Department, (530) 886-4986
<b>Authorized Person to Sign and Submit Reports</b>	William Zimmerman, Deputy Director, Facility Services Department, (530) 886-4986
<b>Mailing Address</b>	11476 C Avenue, Auburn, CA 95603
<b>Billing Address</b>	Same as Mailing Address
<b>Type of Facility</b>	Publicly Owned Treatment Works (POTW)
<b>Major or Minor Facility</b>	Minor
<b>Threat to Water Quality</b>	2
<b>Complexity</b>	B
<b>Pretreatment Program</b>	Not Applicable
<b>Reclamation Requirements</b>	Not Applicable
<b>Facility Permitted Flow</b>	0.30 million gallons per day (MGD)
<b>Facility Design Flow</b>	0.30 MGD
<b>Watershed</b>	Lower Sacramento
<b>Receiving Water</b>	Miners Ravine
<b>Receiving Water Type</b>	Inland Surface Water

- A. Placer County Department of Facility Services (hereinafter Discharger) is the owner and operator of the Placer County Sewer Maintenance District 3 Wastewater Treatment Plant (hereinafter Facility), a POTW.

For the purposes of this Order, references to the “discharger” or “permittee” in applicable federal and state laws, regulations, plans, or policy are held to be equivalent to references to the Discharger herein.

- B.** The Facility discharges wastewater to Miners Ravine, a water of the United States, and was regulated by Order R5-2007-0070 which was adopted on 22 June 2007 and expired on 1 June 2012. The terms and conditions of Order R5-2007-0070 were automatically continued and remained in effect until new Waste Discharge Requirements (WDRs) and National Pollutant Discharge Elimination System (NPDES) permit were adopted pursuant to this Order.
- C.** The Discharger filed a report of waste discharge (ROWD) and submitted an application for renewal of its WDRs and NPDES permit on 2 December 2011. Supplemental information was requested on 5 July 2012 and 19 July 2012 and received on 16 July 2012, 19 July 2012, and 8 August 2012. A site visit was conducted on 9 February 2012, to observe operations and collect additional data to develop permit limitations and conditions.

## **II. FACILITY DESCRIPTION**

The Discharger provides sewerage service for the Horseshoe Bar Road and Folsom Lake areas and serves a population of approximately 1,500. The Facility has a design average dry weather flow capacity of 0.30 MGD.

### **A. Description of Wastewater and Biosolids Treatment or Controls**

The treatment system at the Facility consists of a bar screen, primary clarifier, rock media trickling filter, secondary clarifier, flocculation, denitrifying sand filter, chlorine contact basin, and a sodium bisulfate dechlorination system. A flocculation/clarification filter is used for emergency storage. Solids are temporarily stored on-site and then either hauled to the Inviro-Tec septage receiving station for additional handling and disposal in accordance with the industrial pretreatment permit administered by the City of Roseville, or to the Discharger's Sewer Maintenance District 1 Wastewater Treatment Plant, where they are dewatered using a belt press and sludge drying beds. The dewatered sludge from the SMD1 facility is disposed of at a landfill. The on-site sludge drying beds are used to hold debris (e.g., soil, rocks, grit) removed from the collection system and are no longer used for dewatering.

### **B. Discharge Points and Receiving Waters**

1. The Facility is located in Section 18, T11N, R8E, MDB&M, as shown in Attachment B, a part of this Order.
2. Treated municipal wastewater is discharged at Discharge Point No. 001 to Miners Ravine, a water of the United States and a tributary to the Sacramento River via Dry Creek, Natomas East Main Drainage Canal, and Bannon Slough at a point latitude 38° 47' 51" N and longitude 121° 8' 8" W.

### C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data

Effluent limitations contained in Order R5-2007-0070 for discharges from Discharge Point No. 001 (Monitoring Location EFF-001) and representative monitoring data from the term of Order R5-2007-0070 are as follows:

**Table F-2. Historic Effluent Limitations and Monitoring Data**

Parameter	Units	Effluent Limitation			Monitoring Data (September 2007 – May 2012)		
		Average Monthly	Average Weekly	Maximum Daily	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge
Flow	MGD	--	--	0.3	--	--	0.95
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	10	15	25	14	26	26
	lbs/day <sup>1</sup>	25	38	63	20	34	34
	% removal	85	--	--	NR	--	--
Total Suspended Solids	mg/L	10	15	25	7	12	12
	lbs/day <sup>1</sup>	25	38	63	8	13	13
	% removal	85	--	--	NR	--	--
pH	standard units	--	--	6.5 – 8.2	--	--	6.4 – 8.8
Settleable Solids	mL/L	0.1	--	0.2	<0.1	--	<0.1
Electrical Conductivity @ 25°C	µmhos/cm	700	--	--	711	--	--
Nitrate Nitrogen, Total (as N)	mg/L	10	--	--	28.3	--	--
	lbs/day <sup>1</sup>	25	--	--	28	--	--
Organochlorine Pesticides	µg/L	--	--	ND <sup>2</sup>	--	--	0.011 <sup>3</sup>
4,4-DDD	µg/L	--	--	0.17 <sup>4</sup>	--	--	<0.05
		--	--	0.0017 <sup>5</sup>	--	--	<0.012
	lbs/day <sup>1</sup>	--	--	0.00043 <sup>4</sup>	--	--	<0.00006
4,4-DDT	µg/L	--	--	0.096 <sup>4</sup>	--	--	0.01 <sup>6</sup>
		--	--	0.0012 <sup>5</sup>	--	--	<0.012
	lbs/day <sup>1</sup>	--	--	0.00024 <sup>4</sup>	--	--	<0.00002
Aldrin	µg/L	--	--	0.12 <sup>4</sup>	--	--	<0.05
		--	--	0.00026 <sup>5</sup>	--	--	<0.005
	lbs/day <sup>1</sup>	--	--	0.00030 <sup>4</sup>	--	--	<0.00003
Alpha-BHC	µg/L	--	--	1.4 <sup>4</sup>	--	--	<0.012
		--	--	0.0078 <sup>5</sup>	--	--	<0.012
	lbs/day <sup>1</sup>	--	--	0.0035 <sup>4</sup>	--	--	<0.00002
Beta-Endosulfan	µg/L	--	--	0.062 <sup>4</sup>	--	--	<0.012
		--	--	0.09 <sup>5</sup> /0.22 <sup>5,7</sup>	--	--	<0.012
	lbs/day <sup>1</sup>	--	--	0.00015 <sup>4</sup>	--	--	<0.00002
Endrin	µg/L	--	--	0.065 <sup>4</sup>	--	--	<0.05
		--	--	0.06 <sup>5</sup>	--	--	<0.012
	lbs/day <sup>1</sup>	--	--	0.00016 <sup>4</sup>	--	--	<0.00003

Parameter	Units	Effluent Limitation			Monitoring Data (September 2007 – May 2012)		
		Average Monthly	Average Weekly	Maximum Daily	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge
Aluminum, Total Recoverable	µg/L	--	--	547 <sup>4</sup>	98.6	--	98.6
		71.2 <sup>8</sup>	--	142.9 <sup>8</sup>	116	--	116
	lbs/day <sup>1</sup>	--	--	1.4 <sup>4</sup>	0.150	--	0.150
		0.18 <sup>8</sup>	--	0.36 <sup>8</sup>	0.150	--	0.150
Iron, Total Recoverable	µg/L	300	--	--	92.4	--	--
	lbs/day <sup>1</sup>	0.75	--	--	0.107	--	--
Manganese, Total Recoverable	µg/L	50	--	--	50	--	--
	lbs/day <sup>1</sup>	0.13	--	--	0.068	--	--
Ammonia Nitrogen, Total (as N)	mg/L	1.2	--	3.7	--	--	11.2
	lbs/day <sup>1</sup>	3.0	--	9.3	--	--	8.4
Copper, Total Recoverable	µg/L	--	--	23 <sup>4</sup>	--	--	6.9
		2.89 <sup>8</sup>	--	5.76 <sup>8</sup>	3.4	--	3.4
	lbs/day <sup>1</sup>	--	--	0.058 <sup>4</sup>	--	--	0.0045
		0.007 <sup>8</sup>	--	0.014 <sup>8</sup>	0.0036	--	0.0036
Dibromochloromethane	µg/L	--	--	6.5 <sup>4</sup>	--	--	3.9
		0.41 <sup>8</sup>	--	0.82 <sup>8</sup>	7	--	7
	lbs/day <sup>1</sup>	--	--	0.016 <sup>4</sup>	--	--	0.0022
		0.00103 <sup>8</sup>	--	0.00205 <sup>8</sup>	0.0047	--	0.0047
Dichlorobromomethane	µg/L	--	--	59.0 <sup>4</sup>	--	--	21
		0.56 <sup>8</sup>	--	1.13 <sup>8</sup>	15	--	15
	lbs/day <sup>1</sup>	--	--	0.15 <sup>4</sup>	--	--	0.014
		0.00140 <sup>8</sup>	--	0.00283 <sup>8</sup>	0.017	--	0.017
Mercury, Total Recoverable	lbs/month	--	--	0.000606 <sup>9</sup>	--	--	0.00034
Chlorine, Total Residual	mg/L	--	0.01 <sup>10</sup>	0.02 <sup>11</sup>	--	--	<0.01
Turbidity	NTU	2 <sup>12</sup>	--	5 <sup>12</sup>	--	--	7 <sup>16</sup>
		--	5 <sup>13,14</sup>	2 <sup>13,15</sup> /10 <sup>7,13</sup>			
Total Coliform Organisms	MPN/100 mL	--	2.2 <sup>17,18</sup>	23 <sup>17</sup>	--	--	300
		23 <sup>19,20</sup>	2.2 <sup>18,19</sup>	240 <sup>7,19</sup>			
Acute Toxicity	%	--	--	21	--	--	95 <sup>22</sup>

Parameter	Units	Effluent Limitation			Monitoring Data (September 2007 – May 2012)		
		Average Monthly	Average Weekly	Maximum Daily	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge

- 1 Based on an average dry weather flow of 0.30 MGD.
- 2 The non-detectable (ND) limitation applies to each individual pesticide. No individual pesticide may be present in the discharge at detectable concentrations. The Discharger shall use USEPA standard analytical techniques with a maximum acceptable detection level of 0.05 µg/L. Organochlorine pesticides include aldrin, dieldrin, chlordane, endrin, endrin aldehyde, heptachlor, heptachlor epoxide, hexachlorocyclohexane (alpha-BHC, beta-BHC, delta-BHC, and gamma-BHC or lindane), endosulfan (alpha and beta), endosulfan sulfate, toxaphene, 4,4'DDD, 4,4'DDE, and 4,4'DDT.
- 3 Represents highest reported concentration of a persistent chlorinated hydrocarbon pesticide (endosulfan sulfate), which occurred in October 2010; however, the detection is suspected to be the result of laboratory contamination. See Section IV.C.3.b of this Fact Sheet.
- 4 Interim effluent limitation effective until 18 May 2010.
- 5 Interim effluent limitation effective 19 May 2010 until 11 August 2012.
- 6 Detection suspected to be the result of laboratory contamination. See Section IV.C.3.b of this Fact Sheet.
- 7 Applied as an instantaneous maximum effluent limitation.
- 8 Final effluent limitation effective 19 May 2010.
- 9 The total monthly mass discharge of total mercury shall not exceed 0.000606 lbs/month.
- 10 Applied as a 4-day average effluent limitation.
- 11 Applied as a 1-hour average effluent limitation.
- 12 Interim effluent limitation effective until 11 August 2010. Applicable only when the receiving water flow to effluent flow ratio is less than 20:1.
- 13 Final effluent limitation effective 12 August 2010. Applicable only when the receiving water flow to effluent flow ratio is less than 20:1.
- 14 Not to be exceeded more than 5 percent of the time within a 24-hour period.
- 15 Applied as a daily average effluent limitation.
- 16 Represents the maximum reported instantaneous maximum concentration.
- 17 Interim effluent limitation effective until 11 August 2009.
- 18 Applied as a 7-day median effluent limitation.
- 19 Final effluent limitation effective 12 August 2009.
- 20 Not to be exceeded more than once in any 30-day period.
- 21 Survival of aquatic organisms in 96-hour bioassays of undiluted waste shall be no less than:  
 Minimum for any one bioassay: 70%  
 Median for any three or more consecutive bioassays: 90%
- 22 Represents the minimum reported percent survival.

#### D. Compliance Summary

1. The Central Valley Regional Water Quality Control Board (Central Valley Water Board) issued Administrative Civil Liability (ACL) Complaint R5-2009-0514 on 16 March 2009 which proposed to assess an administrative civil liability of \$57,000 against the Discharger for 20 effluent limitation violations for ammonia, manganese, and pH from 1 January 2008 through 31 December 2008. The Discharger paid the mandatory minimum penalty of \$57,000.
2. The Central Valley Water Board issued ACL Complaint R5-2009-0556 on 12 November 2009 which proposed to assess an administrative civil liability of \$15,000 against the Discharger for five effluent limitation violations for ammonia

from 1 January 2009 through 31 August 2009. The Discharger paid the mandatory minimum penalty of \$15,000.

3. The Central Valley Water Board issued ACL Complaint R5-2010-0547 on 4 November 2010 which proposed to assess an administrative civil liability of \$30,000 against the Discharger for 13 effluent limitation violations for aluminum, copper, dibromochloromethane, dichlorobromomethane, electrical conductivity, and total coliform organisms from 1 September 2009 through 31 July 2010. The Discharger paid the mandatory minimum penalty of \$30,000.
4. The Central Valley Water Board issued ACL Complaint R5-2011-0593 on 7 October 2011 which proposed to assess an administrative civil liability of \$105,000 against the Discharger for 35 effluent limitation violations for aluminum, 5-day biochemical oxygen demand (BOD<sub>5</sub>), copper, dibromochloromethane, and dichlorobromomethane from 1 August 2010 through 31 May 2011. The Discharger paid a portion of the penalty to the State Water Pollution Cleanup and Abatement Account and the remainder funded a Supplemental Environmental Project.
5. The Central Valley Water Board adopted Cease and Desist Order (CDO) R5-2007-0031 with the previous WDRs Order R5-2007-0030. CDO R5-2007-0031 was rescinded with the adoption of Cease and Desist Order R5-2012-0005, which provides a time schedule for regionalization of the Discharger's wastewater.

## **E. Planned Changes**

The Discharger is currently planning a regionalization project that will include construction of sewer connections and a pumping station to connect to the City of Roseville's Dry Creek Wastewater Treatment Plant. Once the connection is made, the Facility will no longer be used for wastewater treatment and discharge to Miners Ravine will cease. Pursuant to Cease and Desist Order (CDO) R5-2012-0005, the Discharger is required to complete the regionalization project by 31 December 2014. The Discharger issued a Draft Environmental Assessment/Environmental Impact Report (EA/EIR) for the project in June 2012. The public comment period for the Draft EA/EIR ended 6 August 2012. In response to concerns expressed during the public comment period, the Discharger has changed the preferred alignment of the pipeline routes. The changes have delayed the environmental process and the Discharger states that compliance with "Tasks b and c" of the CDO will be delayed from 30 September to November 2012. However, the Discharger will comply with other deadlines in the CDO time schedule including advertising for bids by November 2012 and completing construction by the end of 2014.

## **III. APPLICABLE PLANS, POLICIES, AND REGULATIONS**

The requirements contained in this Order are based on the applicable plans, policies, and regulations identified in the Findings in section II of this Order. The applicable plans, policies, and regulations relevant to the discharge include the following:

## A. Legal Authorities

This Order is issued pursuant to regulations in the Clean Water Act (CWA) and the California Water Code (Water Code) as specified in the Finding contained at section II.C of this Order.

## B. California Environmental Quality Act (CEQA)

This Order meets the requirements of CEQA as specified in the Finding contained at section II.E of this Order.

## C. State and Federal Regulations, Policies, and Plans

1. **Water Quality Control Plans.** This Order implements the following water quality control plans as specified in the Finding contained at section II.H of this Order.
  - a. *Water Quality Control Plan, Fourth Edition (Revised October 2011), for the Sacramento and San Joaquin River Basins (Basin Plan)*
2. **National Toxics Rule (NTR) and California Toxics Rule (CTR).** This Order implements the NTR and CTR as specified in the Finding contained at section II.I of this Order.
3. **State Implementation Policy (SIP).** This Order implements the SIP as specified in the Finding contained at section II.J of this Order.
4. **Alaska Rule.** This Order is consistent with the Alaska Rule as specified in the Finding contained at section II.L of this Order.
5. **Antidegradation Policy.** As specified in the Finding contained at section II.N of this Order and as discussed in detail in the Fact Sheet (Attachment F, Section IV.D.4.), the discharge is consistent with the antidegradation provisions of 40 CFR 131.12 and State Water Resources Control Board (State Water Board) Resolution 68-16.
6. **Anti-Backsliding Requirements.** This Order is consistent with anti-backsliding policies as specified in the Finding contained at section II.O of this Order. Compliance with the anti-backsliding requirements is discussed in the Fact Sheet (Attachment F, Section IV.D.3).
7. **Emergency Planning and Community Right to Know Act**

*Section 13263.6(a) of the Water Code, requires that “the Regional Water Board shall prescribe effluent limitations as part of the waste discharge requirements of a POTW for all substances that the most recent toxic chemical release data reported to the state emergency response commission pursuant to Section 313 of the Emergency Planning and Community Right to Know Act of 1986 (42 U.S.C. Sec. 11023) (EPCRA) indicate as discharged into the POTW, for which the State Water Board or the Regional Water Board has established numeric water quality objectives, and has determined that the discharge is or may be discharged at a level which will cause,*

*have the reasonable potential to cause, or contribute to, an excursion above any numeric water quality objective”.*

The most recent toxic chemical data report does not indicate any reportable off-site releases or discharges to the collection system for this Facility. Therefore, a reasonable potential analysis (RPA) based on information from EPCRA cannot be conducted. Based on information from EPCRA, there is no reasonable potential to cause or contribute to an excursion above any numeric water quality objectives included within the Basin Plan or in any State Water Board plan, so no effluent limitations are included in this permit pursuant to Water Code section 13263.6(a).

However, as detailed elsewhere in this Order, available effluent data indicate that there are constituents present in the effluent that have a reasonable potential to cause or contribute to exceedances of water quality standards and require inclusion of effluent limitations based on federal and state laws and regulations.

## **8. Storm Water Requirements**

USEPA promulgated federal regulations for storm water on 16 November 1990 in 40 CFR Parts 122, 123, and 124. The NPDES Industrial Storm Water Program regulates storm water discharges from wastewater treatment facilities. Wastewater treatment plants are applicable industries under the storm water program and are obligated to comply with the federal regulations. The State Water Board does not require wastewater treatment facilities with design flows less than 1 MGD to obtain coverage under the Industrial Stormwater General Order. This Order does not regulate storm water.

- 9. Endangered Species Act.** This Order is consistent with the Endangered Species Act as specified in the Finding contained at section II.P of this Order.

## **D. Impaired Water Bodies on CWA 303(d) List**

1. Under section 303(d) of the 1972 CWA, states, territories and authorized tribes are required to develop lists of water quality limited segments. The waters on these lists do not meet water quality standards, even after point sources of pollution have installed the minimum required levels of pollution control technology. On 12 November 2010 USEPA gave final approval to California's 2010 section 303(d) List of Water Quality Limited Segments. The Basin Plan references this list of Water Quality Limited Segments (WQLSs), which are defined as “...*those sections of lakes, streams, rivers or other fresh water bodies where water quality does not meet (or is not expected to meet) water quality standards even after the application of appropriate limitations for point sources (40 CFR Part 130, et seq.)*.” The Basin Plan also states, “*Additional treatment beyond minimum federal standards will be imposed on dischargers to [WQLSs]. Dischargers will be assigned or allocated a maximum allowable load of critical pollutants so that water quality objectives can be met in the segment.*” Miners Ravine (the 9.4 miles of Miners Ravine in Placer County) is listed as a WQLS for dissolved oxygen on the 303(d) list of impaired waterbodies.

2. **Total Maximum Daily Loads (TMDLs).** USEPA requires the Central Valley Water Board to develop TMDLs for each 303(d) listed pollutant and water body combination. No TMDLs have been adopted for Miners Ravine.
3. The 303(d) listings and TMDLs have been considered in the development of the Order. A pollutant-by-pollutant evaluation of each pollutant of concern is described in section VI.C.3. of this Fact Sheet.

#### **E. Other Plans, Policies and Regulations**

1. The discharge authorized herein and the treatment and storage facilities associated with the discharge of treated municipal wastewater, except for discharges of residual sludge and solid waste, are exempt from the requirements of Title 27, California Code of Regulations (CCR), section 20005 *et seq* (hereafter Title 27). The exemption, pursuant to Title 27 CCR section 20090(a), is based on the following:
  - a. The waste consists primarily of domestic sewage and treated effluent;
  - b. The waste discharge requirements are consistent with water quality objectives; and
  - c. The treatment and storage facilities described herein are associated with a municipal wastewater treatment plant.

#### **IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS**

Effluent limitations and toxic and pretreatment effluent standards established pursuant to sections 301 (Effluent Limitations), 302 (Water Quality Related Effluent Limitations), 304 (Information and Guidelines), and 307 (Toxic and Pretreatment Effluent Standards) of the CWA and amendments thereto are applicable to the discharge.

The CWA mandates the implementation of effluent limitations that are as stringent as necessary to meet water quality standards established pursuant to state or federal law [33 U.S.C., §1311(b)(1)(C); 40 CFR 122.44(d)(1)]. NPDES permits must incorporate discharge limits necessary to ensure that water quality standards are met. This requirement applies to narrative criteria as well as to criteria specifying maximum amounts of particular pollutants. Pursuant to federal regulations, 40 CFR 122.44(d)(1)(i), NPDES permits must contain limits that control all pollutants that “*are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any state water quality standard, including state narrative criteria for water quality.*” Federal regulations, 40 CFR 122.44(d)(1)(vi), further provide that “[w]here a state has not established a water quality criterion for a specific chemical pollutant that is present in an effluent at a concentration that causes, has the reasonable potential to cause, or contributes to an excursion above a narrative criterion within an applicable State water quality standard, the permitting authority must establish effluent limits.”

The CWA requires point source dischargers to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States.

The control of pollutants discharged is established through effluent limitations and other requirements in NPDES permits. There are two principal bases for effluent limitations in the Code of Federal Regulations: 40 CFR 122.44(a) requires that permits include applicable technology-based limitations and standards; and 40 CFR 122.44(d) requires that permits include WQBELs to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water where numeric water quality objectives have not been established. The Basin Plan at page IV-17.00, contains an implementation policy, "*Policy for Application of Water Quality Objectives*", that specifies that the Central Valley Water Board "*will, on a case-by-case basis, adopt numerical limitations in orders which will implement the narrative objectives.*" This Policy complies with 40 CFR 122.44(d)(1). With respect to narrative objectives, the Central Valley Water Board must establish effluent limitations using one or more of three specified sources, including: (1) USEPA's published water quality criteria, (2) a proposed state criterion (i.e., water quality objective) or an explicit state policy interpreting its narrative water quality criteria (i.e., the Central Valley Water Board's "*Policy for Application of Water Quality Objectives*")(40 CFR 122.44(d)(1)(vi)(A), (B) or (C)), or (3) an indicator parameter.

The Basin Plan includes numeric site-specific water quality objectives and narrative objectives for toxicity, chemical constituents, discoloration, radionuclides, and tastes and odors. The narrative toxicity objective states: "*All waters shall be maintained free of toxic substances in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.*" (Basin Plan at III-8.00) The Basin Plan states that material and relevant information, including numeric criteria, and recommendations from other agencies and scientific literature will be utilized in evaluating compliance with the narrative toxicity objective. The narrative chemical constituents objective states that waters shall not contain chemical constituents in concentrations that adversely affect beneficial uses. At minimum, "*... water designated for use as domestic or municipal supply (MUN) shall not contain concentrations of chemical constituents in excess of the maximum contaminant levels (MCLs) in Title 22 of CCR.*" The Basin Plan further states that, to protect all beneficial uses, the Central Valley Water Board may apply limits more stringent than MCLs. The narrative tastes and odors objective states: "*Water shall not contain taste- or odor-producing substances in concentrations that impart undesirable tastes or odors to domestic or municipal water supplies or to fish flesh or other edible products of aquatic origin, or that cause nuisance, or otherwise adversely affect beneficial uses.*"

## **A. Discharge Prohibitions**

- 1. Prohibition III.A (No discharge or application of waste other than that described in this Order).** This prohibition is based on Water Code section 13260 that requires filing of a ROWD before discharges can occur. The Discharger submitted a ROWD for the discharges described in this Order; therefore, discharges not described in this Order are prohibited.
- 2. Prohibition III.B (No bypasses or overflow of untreated wastewater, except under the conditions at CFR Part 122.41(m)(4)).** As stated in section I.G of Attachment D, Standard Provisions, this Order prohibits bypass from any portion of the treatment facility. Federal regulations, 40 CFR 122.41(m), define "bypass" as the intentional diversion of waste streams from any portion of a treatment facility.

This section of the federal regulations, 40 CFR 122.41(m)(4), prohibits bypass unless it is unavoidable to prevent loss of life, personal injury, or severe property damage. In considering the Central Valley Water Board's prohibition of bypasses, the State Water Board adopted a precedential decision, Order No. WQO 2002-0015, which cites the federal regulations, 40 CFR 122.41(m), as allowing bypass only for essential maintenance to assure efficient operation.

3. **Prohibition III.C (No controllable condition shall create a nuisance).** This prohibition is based on Water Code section 13050 that requires water quality objectives established for the prevention of nuisance within a specific area. The Basin Plan prohibits conditions that create a nuisance
4. **Prohibition III.D (No inclusion of pollutant free wastewater shall cause improper operation of the Facility's systems).** This prohibition is based on 40 CFR 122.41 et seq. that requires the proper design and operation of treatment facilities.

## B. Technology-Based Effluent Limitations

### 1. Scope and Authority

Section 301(b) of the CWA and implementing USEPA permit regulations at 40 CFR 122.44 require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Secondary Treatment Standards at 40 CFR Part 133.

Regulations promulgated in 40 CFR 125.3(a)(1) require technology-based effluent limitations for municipal Dischargers to be placed in NPDES permits based on Secondary Treatment Standards or Equivalent to Secondary Treatment Standards.

The Federal Water Pollution Control Act Amendments of 1972 (PL 92-500) established the minimum performance requirements for POTWs [defined in section 304(d)(1)]. Section 301(b)(1)(B) of that Act requires that such treatment works must, as a minimum, meet effluent limitations based on secondary treatment as defined by the USEPA Administrator.

Based on this statutory requirement, USEPA developed secondary treatment regulations, which are specified in 40 CFR Part 133. These technology-based regulations apply to all municipal wastewater treatment plants and identify the minimum level of effluent quality attainable by secondary treatment in terms of BOD<sub>5</sub>, total suspended solids (TSS), and pH.

### 2. Applicable Technology-Based Effluent Limitations

- a. **BOD<sub>5</sub> and TSS.** Federal regulations, 40 CFR Part 133, establish the minimum weekly and monthly average level of effluent quality attainable by secondary

treatment for BOD<sub>5</sub> and TSS. This Order establishes WQBELs that are more stringent than the secondary technology-based treatment described in 40 CFR Part 133 and are necessary to protect the beneficial uses of the receiving stream. (See section VI.C.3.d of this Fact Sheet for the discussion on Pathogens which includes WQBELs for BOD<sub>5</sub> and TSS.) In addition, 40 CFR 133.102, in describing the minimum level of effluent quality attainable by secondary treatment, states that the 30-day average percent removal shall not be less than 85 percent. This Order contains a limitation requiring an average of 85 percent removal of BOD<sub>5</sub> and TSS over each calendar month.

- b. Flow.** The Facility was designed to provide a tertiary level of treatment for up to a design flow of 0.30 MGD. Therefore, this Order contains an average dry weather discharge flow effluent limitation of 0.30 MGD.
- c. pH.** The secondary treatment regulations at 40 CFR Part 133 also require that pH be maintained between 6.0 and 9.0 standard units.

**Summary of Technology-based Effluent Limitations  
 Discharge Point No. 001**

**Table F-3. Summary of Technology-based Effluent Limitations**

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Flow	MGD	--	--	0.30 <sup>1</sup>	--	--
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	30	45	--	--	--
	lbs/day <sup>2</sup>	75	113	--	--	--
	% Removal	85	--	--	--	--
pH	standard units	--	--	--	6.0	9.0
Total Suspended Solids	mg/L	30	45	--	--	--
	lbs/day <sup>2</sup>	75	113	--	--	--
	% Removal	85	--	--	--	--

<sup>1</sup> The average dry weather flow shall not exceed 0.30 MGD.

<sup>2</sup> Based upon an average dry weather flow of 0.30 MGD.

**C. Water Quality-Based Effluent Limitations (WQBELs)**

**1. Scope and Authority**

Section 301(b) of the CWA and 40 CFR 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards. This Order contains requirements, expressed as a technology equivalence requirement, more stringent than secondary treatment requirements that are necessary to meet applicable water quality standards. The rationale for these requirements, which consist of tertiary treatment or equivalent requirements, is discussed in section VI.C.3.d of this Fact Sheet.

40 CFR 122.44(d)(1)(i) mandates that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, WQBELs must be established using: (1) USEPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state's narrative criterion, supplemented with other relevant information, as provided in 40 CFR 122.44(d)(1)(vi).

The process for determining reasonable potential and calculating WQBELs when necessary is intended to protect the designated uses of the receiving water as specified in the Basin Plan, and achieve applicable water quality objectives and criteria that are contained in other state plans and policies, or any applicable water quality criteria contained in the CTR and NTR.

## **2. Applicable Beneficial Uses and Water Quality Criteria and Objectives**

The Basin Plan designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, the Basin Plan implements State Water Board Resolution No. 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply.

The Basin Plan on page II-1.00 states: "*Protection and enhancement of existing and potential beneficial uses are primary goals of water quality planning...*" and with respect to disposal of wastewaters states that "*...disposal of wastewaters is [not] a prohibited use of waters of the State; it is merely a use which cannot be satisfied to the detriment of beneficial uses.*"

The federal CWA section 101(a)(2), states: "*it is the national goal that wherever attainable, an interim goal of water quality which provides for the protection and propagation of fish, shellfish, and wildlife, and for recreation in and on the water be achieved by July 1, 1983.*" Federal Regulations, developed to implement the requirements of the CWA, create a rebuttable presumption that all waters be designated as fishable and swimmable. Federal Regulations, 40 CFR sections 131.2 and 131.10, require that all waters of the State regulated to protect the beneficial uses of public water supply, protection and propagation of fish, shell fish and wildlife, recreation in and on the water, agricultural, industrial and other purposes including navigation. Section 131.3(e), 40 CFR, defines existing beneficial uses as those uses actually attained after 28 November 1975, whether or not they are included in the water quality standards. Federal Regulation, 40 CFR 131.10 requires that uses be obtained by implementing effluent limitations, requires that all downstream uses be protected and states that in no case shall a state adopt waste

transport or waste assimilation as a beneficial use for any waters of the United States.

- a. **Receiving Water and Beneficial Uses.** Wastewater is discharged at Discharge Point No. 001 to Miners Ravine, a water of the United States and a tributary to the Sacramento River via Dry Creek, Natomas East Main Drainage Canal, and Bannon Slough.

The Basin Plan at II-2.00 states that the beneficial uses of any specifically identified water body generally apply to its tributary streams. The Basin Plan in Table II-1, Section II, does not specifically identify beneficial uses for Miners Ravine, but does identify present and potential uses for the Sacramento River from the Colusa Basin Drain to the “I” Street Bridge, to which Miners Ravine, via Dry Creek, Natomas East Main Drainage Canal, and Bannon Slough, is tributary. Thus, beneficial uses applicable to Miners Ravine are as follows:

**Table F-4. Basin Plan Beneficial Uses**

Discharge Point	Receiving Water Name	Beneficial Use(s)
001	Miners Ravine	<u>Existing uses from Table II-1 of the Basin Plan:</u> Municipal and domestic supply (MUN); Agricultural supply, including irrigation (AGR); Water contact recreation, including canoeing and rafting (REC-1); Non-contact water recreation (REC-2); Warm freshwater habitat (WARM); Cold freshwater habitat (COLD); Migration of aquatic organisms, warm and cold (MIGR); Spawning, reproduction, and/or early development, warm and cold (SPWN); Wildlife habitat (WILD); and Navigation (NAV).

- b. **Effluent and Ambient Background Data.** The RPA, as described in section IV.C.3 of this Fact Sheet, was based on data from September 2007 through May 2012, which includes effluent and ambient background data submitted in SMRs and the ROWD. Order R5-2007-0070 did not require priority pollutant sampling of the upstream receiving water; therefore, upstream receiving water data collected during the term of Order R5-2007-0070 is limited to chlorodibromomethane, dichlorobromomethane, electrical conductivity, hardness, nitrate, pH, temperature, and total dissolved solids. This Order requires monitoring for priority pollutants and other constituents of concern quarterly during the third year of the permit term, as detailed in Attachment I.
- c. **Assimilative Capacity/Mixing Zone.** Based on the available information, the worst-case dilution is assumed to be zero to provide protection for the receiving water beneficial uses. The impact of assuming zero assimilative capacity within the receiving water is that discharge limitations are end-of-pipe limits with no allowance for dilution within the receiving water.

- d. Conversion Factors.** The CTR contains aquatic life criteria for arsenic, cadmium, chromium III, chromium VI, copper, lead, nickel, silver, and zinc which are presented in dissolved concentrations. USEPA recommends conversion factors to translate dissolved concentrations to total concentrations. The default USEPA conversion factors contained in Appendix 3 of the SIP were used to convert the applicable dissolved criteria to total recoverable criteria.
- e. Hardness-Dependent CTR Metals Criteria.** The *California Toxics Rule* and the National *Toxics Rule* contain water quality criteria for seven metals that vary as a function of hardness. The lower the hardness the lower the water quality criteria. The metals with hardness-dependent criteria include cadmium, copper, chromium III, lead, nickel, silver, and zinc.

This Order has established the criteria for hardness-dependent metals based on the reasonable worst-case ambient hardness as required by the SIP<sup>1</sup>, the CTR<sup>2</sup> and State Water Board Order No. WQO 2008-0008 (City of Davis). The SIP and the CTR require the use of “receiving water” or “actual ambient” hardness, respectively, to determine effluent limitations for these metals. (SIP, § 1.2; 40 CFR § 131.38(c)(4)) The CTR does not define whether the term “ambient,” as applied in the regulations, necessarily requires the consideration of upstream as opposed to downstream hardness conditions. Therefore, where reliable, representative data are available, the hardness value for calculating criteria can be the downstream receiving water hardness, after mixing with the effluent (Order WQO 2008-0008, p. 11). The Central Valley Water Board thus has considerable discretion in determining ambient hardness (Id., p.10).

As discussed below, scientific literature provides a reliable method for calculating protective hardness-dependent CTR criteria, considering all discharge conditions. This methodology produces hardness-dependent CTR criteria based on the reasonable worst-case downstream ambient hardness that ensure these metals do not cause receiving water toxicity under any downstream receiving water condition. Under this methodology, the Central Valley Water Board considers all hardness conditions that could occur in the ambient downstream receiving water after the effluent has mixed with the water body<sup>3</sup>. This ensures that effluent limitations are fully protective of aquatic life in all areas of the receiving water affected by the discharge under all flow conditions, at the fully mixed location, and throughout the water body including at the point of discharge into the water body.

---

<sup>1</sup> The SIP does not address how to determine the hardness for application to the equations for the protection of aquatic life when using hardness-dependent metals criteria. It simply states, in Section 1.2, that the criteria shall be properly adjusted for hardness using the hardness of the receiving water.

<sup>2</sup> The CTR requires that, for waters with a hardness of 400 mg/L (as CaCO<sub>3</sub>), or less, the actual ambient hardness of the surface water must be used. It further requires that the hardness values used must be consistent with the design discharge conditions for design flows and mixing zones.

<sup>3</sup> All effluent discharges will change the ambient downstream metals concentration and hardness. It is not possible to change the metals concentration without also changing the hardness.

- i. Conducting the Reasonable Potential Analysis (RPA).** The SIP in Section 1.3 states, “*The RWQCB shall...determine whether a discharge may: (1) cause, (2) have a reasonable potential to cause, or (3) contribute to an excursion above any applicable priority pollutant criterion or objective.*” Section 1.3 provides a step-by-step procedure for conducting the RPA. The procedure requires the comparison of the maximum effluent concentration (MEC) and maximum ambient background concentration to the applicable criterion that has been properly adjusted for hardness. Unless otherwise noted, for the hardness-dependent CTR metals criteria the following procedures were followed for properly adjusting the criterion for hardness when conducting the RPA.
- (a)** The SIP requires WQBELs if the MEC is equal to or exceeds the applicable criterion, adjusted for hardness. For comparing the MEC to the applicable criterion, the “fully mixed” reasonable worst-case downstream ambient hardness was used to adjust the criterion. In this evaluation the portion of the receiving water affected by the discharge is analyzed. For hardness-dependent criteria, the hardness of the effluent has an impact on the determination of the applicable criterion in areas of the receiving water affected by the discharge. Therefore, for comparing the MEC to the applicable criterion, the reasonable worst-case downstream ambient hardness was used to adjust the criterion. For this situation it is necessary to consider the hardness of the effluent in determining the applicable hardness to adjust the criterion. The procedures for determining the applicable criterion after proper adjustment using the reasonable worst-case downstream ambient hardness after completely mixed is outlined in subsection ii, below.
- (b)** The SIP requires WQBELs if the receiving water is impaired upstream (outside the influence) of the discharge, i.e., if the maximum ambient background concentration of a pollutant exceeds the applicable criterion, adjusted for hardness<sup>1</sup>. For comparing the maximum ambient background concentration to the applicable criterion, the reasonable worst-case upstream ambient hardness was used to adjust the criteria. This is appropriate, because this area is outside the influence of the discharge. Since the discharge does not impact the upstream hardness, the effect of the effluent hardness was not included in this evaluation.
- ii. Calculating WQBELs.** The remaining discussion in this section relates to the development of WQBELs when it has been determined that the discharge has reasonable potential to cause or contribute to an exceedance of the CTR hardness-dependent metals criteria in the receiving water.

---

<sup>1</sup> The pollutant must also be detected in the effluent.

A 2006 Study<sup>1</sup> developed procedures for calculating the effluent concentration allowance (ECA)<sup>2</sup> for CTR hardness-dependent metals. The 2006 Study demonstrated that it is necessary to evaluate all discharge conditions (e.g., high and low flow conditions) and the hardness and metals concentrations of the effluent and receiving water when determining the appropriate ECA for these hardness-dependent metals. This method is superior to relying on downstream receiving water samples alone because it captures all possible mixed conditions in the receiving water. Both receiving water and effluent hardness vary based on flow and other factors, but the variability of receiving water and effluent hardness is sometimes independent. Using a calculated hardness value ensures that the Central Valley Water Board considers all possible mixed downstream values that may result from these two independent variables. Relying on receiving water sampling alone is less likely to capture all possible mixed downstream conditions.

The equation describing the total recoverable regulatory criterion, as established in the CTR<sup>3</sup>, is as follows:

$$\text{CTR Criterion} = \text{WER} \times (e^{m[\ln(H)]+b}) \quad (\text{Equation 1})$$

Where:

H = hardness (as CaCO<sub>3</sub>)<sup>4</sup>  
WER = water-effect ratio  
m, b = metal- and criterion-specific constants

In accordance with the CTR, the default value for the WER is 1. A WER study must be conducted to use a value other than 1. The constants “m” and “b” are specific to both the metal under consideration, and the type of total recoverable criterion (i.e., acute or chronic). The metal-specific values for these constants are provided in the CTR at paragraph (b)(2), Table 1.

The equation for the ECA is defined in Section 1.4, Step 2, of the SIP and is as follows:

$$\text{ECA} = C \quad (\text{when } C \leq B)^5 \quad (\text{Equation 2})$$

Where:

---

<sup>1</sup> Emerick, R.W.; Borroum, Y.; & Pedri, J.E., 2006. California and National Toxics Rule Implementation and Development of Protective Hardness Based Metal Effluent Limitations. WEFTEC, Chicago, Ill.  
<sup>2</sup> The ECA is defined in Appendix 1 of the SIP (page Appendix 1-2). The ECA is used to calculate WQBELs in accordance with Section 1.4 of the SIP.  
<sup>3</sup> 40 CFR § 131.38(b)(2).  
<sup>4</sup> For this discussion, all hardness values are in mg/L as CaCO<sub>3</sub>.  
<sup>5</sup> The 2006 Study assumes the ambient background metals concentration is equal to the CTR criterion (i.e., C ≤ B)

- C = the priority pollutant criterion/objective, adjusted for hardness (see Equation 1, above)
- B = the ambient background concentration

The 2006 Study demonstrated that the relationship between hardness and the calculated criteria is the same for some metals, so the same procedure for calculating the ECA may be used for these metals. The same procedure can be used for chronic cadmium, chromium III, copper, nickel, and zinc. These metals are hereinafter referred to as “Concave Down Metals”. “Concave Down” refers to the shape of the curve represented by the relationship between hardness and the CTR criteria in Equation 1. Another similar procedure can be used for determining the ECA for acute cadmium, lead, and acute silver, which are referred to hereafter as “Concave Up Metals”.

***ECA for Chronic Cadmium, Chromium III, Copper, Nickel, and Zinc*** – For Concave Down Metals (i.e., chronic cadmium, chromium III, copper, nickel, and zinc) the 2006 Study demonstrates that when the effluent is in compliance with the CTR criteria and the upstream receiving water is in compliance with the CTR criteria, any mixture of the effluent and receiving water will always be in compliance with the CTR criteria<sup>1</sup>. The 2006 Study proves that regardless of whether the effluent hardness is lower or greater than the upstream hardness, the reasonable worst-case flow condition is the effluent dominated condition (i.e., no receiving water flow)<sup>2</sup>. Consequently, for Concave Down Metals, the CTR criteria have been calculated using the downstream ambient hardness under this condition.

The effluent hardness ranged from 54.3 mg/L to 228 mg/L, based on 56 samples from September 2007 through May 2012. The upstream receiving water hardness varied from 16 mg/L to 100 mg/L, based on 54 samples from September 2007 through May 2012. Under the effluent dominated condition, the reasonable worst-case downstream ambient hardness is 54.3 mg/L. As demonstrated in the example shown in Table F-5, below, using this hardness to calculate the ECA for all Concave Down Metals will result in WQBELs that are protective under all flow conditions, from the effluent dominated condition to high flow condition. This example for copper assumes the following conservative conditions for the upstream receiving water:

- Upstream receiving water always at the lowest observed upstream receiving water hardness (i.e., 16 mg/L)

---

<sup>1</sup> 2006 Study, p. 5700

<sup>2</sup> There are two typographical errors in the 2006 Study in the discussion of Concave Down Metals when the effluent hardness is less than the receiving water hardness. The effluent and receiving water hardness were transposed in the discussion, but the correct hardness values were used in the calculations. The typographical errors were confirmed by the author of the 2006 Study, by email dated 1 April 2011, from Dr. Robert Emerick to Mr. James Marshall, Central Valley Water Board.

- Upstream receiving water copper concentration always at the CTR criteria (i.e., no assimilative capacity).

Using these reasonable worst-case receiving water conditions, a simple mass balance (as shown in Equation 3, below) accounts for all possible mixtures of effluent and receiving water under all flow conditions.

$$C_{MIX} = C_{RW} \times (1-EF) + C_{Eff} \times (EF) \quad \text{(Equation 3)}$$

Where:

$C_{MIX}$  = Mixed concentration (e.g. metals or hardness)

$C_{RW}$  = Upstream receiving water concentration

$C_{Eff}$  = Effluent concentration

EF = Effluent Fraction

In this example, for copper, for any receiving water flow condition (high flow to low flow), the fully-mixed downstream ambient copper concentration is in compliance with the CTR criteria<sup>1</sup>.

---

<sup>1</sup> This method considers the actual lowest observed upstream hardness and actual lowest observed effluent hardness to determine the reasonable worst-case ambient downstream hardness under all possible receiving water flow conditions. Table F-5 demonstrates that the receiving water is always in compliance with the CTR criteria at the fully-mixed location in the receiving water. It also demonstrates that the receiving water is in compliance with the CTR criteria for all mixtures from the point of discharge to the fully-mixed location. Therefore, a mixing zone is not used for compliance.

**Table F-5. Copper ECA Evaluation**

		<b>Lowest Observed Effluent Hardness</b>			<b>54.3 mg/L (as CaCO<sub>3</sub>)</b>
		<b>Lowest Observed Upstream Receiving Water Hardness</b>			<b>16 mg/L (as CaCO<sub>3</sub>)</b>
		<b>Highest Assumed Upstream Receiving Water Copper Concentration</b>			<b>1.9 µg/L<sup>1</sup></b>
		<b>Copper ECA<sub>chronic</sub><sup>2</sup></b>			<b>5.5 µg/L</b>
<b>Effluent Fraction<sup>6</sup></b>		<b>Fully Mixed Downstream Ambient Concentration</b>			
		<b>Hardness<sup>3</sup> (mg/L)</b>	<b>CTR Criteria<sup>4</sup> (µg/L)</b>	<b>Copper<sup>5</sup> (µg/L)</b>	<b>Complies with CTR Criteria</b>
High Flow Low Flow	1%	16	2.0	2.0	<b>Yes</b>
	5%	18	2.1	2.1	<b>Yes</b>
	15%	22	2.5	2.5	<b>Yes</b>
	25%	26	2.9	2.8	<b>Yes</b>
	50%	35	3.8	3.7	<b>Yes</b>
	75%	45	4.7	4.6	<b>Yes</b>
	100%	54	5.5	5.5	<b>Yes</b>

<sup>1</sup> Highest assumed upstream receiving water copper concentration calculated using Equation 1 for chronic criterion at a hardness of 16 mg/L.

<sup>2</sup> ECA calculated using Equation 1 for chronic criterion at a hardness of 54.3 mg/L.

<sup>3</sup> Fully mixed downstream ambient hardness is the mixture of the receiving water and effluent hardness at the applicable effluent fraction using Equation 3.

<sup>4</sup> Fully mixed downstream ambient criteria are the chronic criteria calculated using Equation 1 at the mixed hardness.

<sup>5</sup> Fully mixed downstream ambient copper concentration is the mixture of the receiving water and effluent copper concentrations at the applicable effluent fraction using Equation 3.

<sup>6</sup> The effluent fraction ranges from 1% at the high receiving water flow condition, to 100% at the lowest receiving water flow condition (i.e., effluent dominated).

**ECA for Acute Cadmium, Lead, and Acute Silver** – For Concave Up Metals (i.e., acute cadmium, lead, and acute silver), the relationship between hardness and the metals criteria is different than for Concave Down Metals. The 2006 Study demonstrates that for Concave Up Metals, the effluent and upstream receiving water can be in compliance with the CTR criteria, but the resulting mixture may contain metals concentrations that exceed the CTR criteria and could cause toxicity. For these metals, the 2006 Study provides a mathematical approach to calculate the ECA that is protective of aquatic life, in all areas of the receiving water affected by the discharge, under all discharge and receiving water flow conditions (see Equation 4, below).

The ECA, as calculated using Equation 4, is based on the reasonable worst-case upstream receiving water hardness, the lowest observed effluent hardness, and assuming no receiving water assimilative capacity for metals (i.e., ambient background metals concentrations are at their respective CTR criterion). Equation 4 is not used in place of the CTR equation (Equation 1). Rather, Equation 4, which is derived using the CTR equation, is used as a direct approach for calculating the ECA. This replaces an iterative approach for calculating the ECA. The CTR equation has been used to evaluate the receiving water downstream of the discharge at all discharge and flow conditions to ensure the ECA is protective (e.g., see Table F-6).

$$ECA = \left( \frac{m(H_e - H_{rw}) \left( e^{m \ln(H_{rw}) + b} \right)}{H_{rw}} \right) + e^{m \ln(H_{rw}) + b} \quad \text{(Equation 4)}$$

Where:

- m, b = criterion specific constants (from CTR)
- H<sub>e</sub> = lowest observed effluent hardness
- H<sub>rw</sub> = reasonable worst-case upstream receiving water hardness

An example similar to the Concave Down Metals is shown for lead, a Concave Up Metal, in Table F-6, below. As previously mentioned, the lowest effluent hardness is 54.3 mg/L, while the upstream receiving water hardness ranged from 16 mg/L to 100 mg/L. In this case, the reasonable worst-case upstream receiving water hardness to use in Equation 4 to calculate the ECA is 16 mg/L.

Using the procedures discussed above to calculate the ECA for all Concave Up Metals will result in WQBELs that are protective under all potential effluent/receiving water flow conditions (high flow to low flow) and under all known hardness conditions, as demonstrated in Table F-6, for lead.

**Table F-6. Lead ECA Evaluation**

		<b>Lowest Observed Effluent Hardness</b>			<b>54.3 mg/L</b>
		<b>Reasonable Worst-case Upstream Receiving Water Hardness</b>			<b>16 mg/L</b>
		<b>Reasonable Worst-case Upstream Receiving Water Lead Concentration</b>			<b>0.31 µg/L<sup>1</sup></b>
		<b>Lead ECA<sub>chronic</sub><sup>2</sup></b>			<b>1.2 µg/L</b>
		<b>Fully Mixed Downstream Ambient Concentration</b>			
		<b>Hardness<sup>3</sup> (mg/L) (as CaCO<sub>3</sub>)</b>	<b>CTR Criteria<sup>4</sup> (µg/L)</b>	<b>Lead<sup>5</sup> (µg/L)</b>	<b>Complies with CTR Criteria</b>
High Flow   Low Flow	1%	16	0.32	0.32	<b>Yes</b>
	5%	18	0.36	0.36	<b>Yes</b>
	15%	22	0.46	0.45	<b>Yes</b>
	25%	26	0.56	0.54	<b>Yes</b>
	50%	35	0.84	0.78	<b>Yes</b>
	75%	45	1.1	1.0	<b>Yes</b>
	100%	54	1.5	1.2	<b>Yes</b>

<sup>1</sup> Reasonable worst-case upstream receiving water lead concentration calculated using Equation 1 for chronic criterion at a hardness of 16 mg/L.

<sup>2</sup> ECA calculated using Equation 4 for chronic criteria.

<sup>3</sup> Fully mixed downstream ambient hardness is the mixture of the receiving water and effluent hardness at the applicable effluent fraction.

<sup>4</sup> Fully mixed downstream ambient criteria are the chronic criteria calculated using Equation 1 at the mixed hardness.

<sup>5</sup> Fully mixed downstream ambient lead concentration is the mixture of the receiving water and effluent lead concentrations at the applicable effluent fraction.

<sup>6</sup> The effluent fraction ranges from 1% at the high receiving water flow condition, to 100% at the lowest receiving water flow condition (i.e., effluent dominated).

Based on the procedures discussed above, Table F-7 lists all the CTR hardness-dependent metals and the associated ECA used in this Order.

**Table F-7. Summary of ECA Evaluations for CTR Hardness-dependent Metals**

CTR Metals	ECA (µg/L, total recoverable)	
	Acute	Chronic
Copper	7.9	5.5
Chromium III	1,053	126
Cadmium	2.1	1.5
Lead	32	1.2
Nickel	280	31
Silver	0.87	--
Zinc	71	71

### 3. Determining the Need for WQBELS

- a. The Central Valley Water Board conducted the RPA in accordance with section 1.3 of the SIP. Although the SIP applies directly to the control of CTR priority pollutants, the State Water Board has held that the Regional Water Boards may use the SIP as guidance for water quality-based toxics control.<sup>1</sup> The SIP states

<sup>1</sup> See Order WQO 2001-16 (Napa) and Order WQO 2004-0013 (Yuba City).

in the introduction “*The goal of this Policy is to establish a standardized approach for permitting discharges of toxic pollutants to non-ocean surface waters in a manner that promotes statewide consistency.*” Therefore, in this Order the RPA procedures from the SIP were used to evaluate reasonable potential for both CTR and non-CTR constituents based on information submitted as part of the application, in studies, and as directed by monitoring and reporting programs.

- b. Constituents with No Reasonable Potential.** WQBELs are not included in this Order for constituents that do not demonstrate reasonable potential (i.e., constituents were not detected in the effluent or receiving water); however, monitoring for those pollutants is established in this Order as required by the SIP. If the results of effluent monitoring demonstrate reasonable potential, this Order may be reopened and modified by adding an appropriate effluent limitation.

Most constituents with no reasonable potential are not discussed in this Order. However, the following constituents were found to have no reasonable potential after assessment of the data:

**i. Aluminum**

Aluminum is the third most abundant element in the earth’s crust and is ubiquitous in both soils and aquatic sediments. When mobilized in surface waters, aluminum has been shown to be toxic to various fish species. However, the potential for aluminum toxicity in surface waters is directly related to the chemical form of aluminum present, and the chemical form is highly dependent on water quality characteristics that ultimately determine the mechanism of aluminum toxicity. Surface water characteristics, including pH, temperature, colloidal material, fluoride and sulfate concentrations, and total organic carbon, all influence aluminum speciation and its subsequent bioavailability to aquatic life. Calcium [hardness] concentrations in surface water may also reduce aluminum toxicity by competing with monomeric aluminum ( $Al^{3+}$ ) binding to negatively charged fish gills.

- (a) WQO.** The Code of Federal Regulations promulgated criteria for priority toxic pollutants for California’s surface waters as part of section 131.38 Establishment of Numeric Criteria for Priority Toxic Pollutants for the State of California (California Toxics Rule or CTR), including metals criteria. However, aluminum criteria were not promulgated as part of the CTR. Absent numeric aquatic life criteria for aluminum, WQBEL’s in the Central Valley Region’s NPDES permits are based on the Basin Plans’ narrative toxicity objective. The Basin Plans’ *Policy for Application of Water Quality Objectives* requires the Central Valley Water Board to consider, “*on a case-by-case basis, direct evidence of beneficial use impacts, all material and relevant information submitted by the discharger and other interested parties, and relevant numerical criteria and guidelines developed and/or published by other agencies and organizations. In considering such criteria, the Board evaluates whether the specific numerical criteria which are available through these sources and through other information*

*supplied to the Board, are relevant and appropriate to the situation at hand and, therefore, should be used in determining compliance with the narrative objective.*” Relevant information includes, but is not limited to (1) USEPA Ambient Water Quality Criteria (NAWQC) and subsequent Correction, (2) site-specific conditions of Miners Ravine, the receiving water, and (3) site-specific aluminum studies conducted by dischargers within the Central Valley Region. (Basin Plan, p. IV.-17.00; see also, 40 CFR 122.44(d)(vi).)

**USEPA NAWQC.** USEPA recommended the NAWQC aluminum acute criterion at 750 µg/L based on test waters with a pH of 6.5 to 9.0. USEPA also recommended the NAWQC aluminum chronic criterion at 87 µg/L based upon the following two toxicity tests. All test waters contained hardness at 12 mg/L as CaCO<sub>3</sub>.

(1) Acute toxicity tests at various aluminum doses were conducted in various acidic waters (pH 6.0 – 6.5) on 159- and 160-day old striped bass. The 159-day old striped bass showed no mortality in waters with pH at 6.5 and aluminum doses at 390 µg/L, and the 160-day old striped bass showed 58% mortality at a dose of 174.4 µg/L in same pH waters. However, the 160-day old striped bass showed 98% mortality at aluminum dose of 87.2 µg/L in waters with pH at 6.0, which is USEPA’s basis for the 87 µg/L chronic criterion. The varied results draw into question this study and the applicability of the NAWQC chronic criterion of 87 µg/L.

(2) Chronic toxicity effects on 60-day old brook trout were evaluated in circumneutral pH waters (6.5-6.9 pH) in five cells at various aluminum doses (4, 57, 88, 169, and 350 µg/L). Chronic evaluation started upon hatching of eyed eggs of brook trout, and their weight and length were measure after 45 days and 60 days. The 60-day old brook trout showed 24% weight loss at 169 µg/L of aluminum and 4% weight loss at 88 µg/L of aluminum, which is the basis for USEPA’s chronic criteria. Though this test study shows chronic toxic effects 4% reduction in weight after exposure for 60-days, the chronic criterion is based on 4-day exposure; so again, the applicability of the NAWQC chronic criterion of 87 µg/L is questionable.

**Site-specific Conditions.** Effluent and Miners Ravine monitoring data indicate that the pH and hardness values are not similar to the low pH and hardness conditions under which the chronic criterion for aluminum was developed, as shown in the table below, and therefore, the Central Valley Water Board does not expect aluminum to be as reactive in Miners Ravine as in the previously described toxicity tests. The pH of Miners Ravine, the receiving water, ranged from 6.6 to 8.3 with an average of 7.2 based on 245 monitoring results obtained between September 2007 and May 2012. These water conditions are circumneutral pH where aluminum is predominately in the form of Al(OH)<sub>3</sub> and non-toxic to aquatic life. The

hardness of Miners Ravine ranged from 16 mg/L to 100 mg/L based on 54 samples, which is above the conditions, and thus less toxic, than the tests used to develop the chronic criterion. Miners Ravine supports aquatic species such as Chinook salmon and steelhead (rainbow trout). Brook trout and striped bass have not been surveyed nor expected to be present (<http://bios.dfg.ca.gov/>) since striped bass is non-native to California and brook trout is present in higher elevation lakes and streams.

Parameter	Units	Test Conditions for Applicability of Chronic Criterion	Effluent	Miners Ravine
pH	standard units	6.0 – 6.5	6.4 – 8.8	6.6 – 8.3
Hardness, Total (as CaCO <sub>3</sub> )	mg/L	12	54.3 – 228	16 – 100
Aluminum, Total Recoverable	µg/L	87.2 - 390	4.6 – 116	N/A

**Local Environmental Conditions and Studies.** Twenty-one site-specific aluminum toxicity tests have been conducted within the Central Valley Region. The pH and hardness of Miners Ravine are similar, as shown in the table below, and thus the results of these site-specific aluminum toxicity tests are relevant and appropriate for Miners Ravine. As shown in the following table, all EC<sub>50</sub> toxicity study result values are at concentrations of aluminum above 5,000 µg/L. Thus, the toxic effects of aluminum in surface waters within the Central Valley Region, including Miners Ravine, is less toxic (or less reactive) to aquatic species than demonstrated in the toxicity tests that USEPA used for the basis of establishing the chronic criterion of 87 µg/L. This new information, and review of the toxicity tests USEPA used to establish the chronic criterion, indicates that 87 µg/L is overly stringent and not applicable to Miners Ravine.

**Central Valley Region Site-Specific Toxicity Data**

Discharger (City)	Species	Test Waters	Hardness Value	Total Aluminum EC <sub>50</sub> Value	pH	WER
Auburn	<i>Ceriodaphnia dubia</i>	Effluent	99	>5270	7.44	>19.3
	“ “	Surface Water	16	>5160	7.44	>12.4
Manteca	“ “	Surface Water/Effluent	124	>8800	9.14	N/C
	“ “	Effluent	117	>8700	7.21	>27.8
	“ “	Surface Water	57	7823	7.58	25.0
	“ “	Effluent	139	>9500	7.97	>21.2
	“ “	Surface Water	104	>11000	8.28	>24.5
	“ “	Effluent	128	>9700	7.78	>25.0
	“ “	Surface Water	85	>9450	7.85	>25.7
	“ “	Effluent	106	>11900	7.66	>15.3
	“ “	Surface Water	146	>10650	7.81	>13.7
Modesto	“ “	Surface Water/Effluent	120/156	31604	8.96	211
Yuba City	“ “	Surface Water/Effluent	114/164 <sup>1</sup>	>8000	7.60/7.46	>53.5
Placer County	“ “	Effluent	150	>5000	7.4 – 8.7	>13.7

Discharger (City)	Species	Test Waters	Hardness Value	Total Aluminum EC <sub>50</sub> Value	pH	WER
Manteca	<i>Daphnia magna</i>	Surface Water/Effluent	124	>8350	9.14	N/C
Modesto	“ “	Surface Water/Effluent	120/156	>11900	8.96	>79.6
Yuba City	“ “	Surface Water/Effluent	114/164 <sup>1</sup>	>8000	7.60/7.46	>53.5
Manteca	<i>Oncorhynchus mykiss</i> (rainbow trout)	Surface Water/Effluent	124	>8600	9.14	N/C
Auburn	“ “	Surface Water	16	>16500	7.44	N/C
Modesto	“ “	Surface Water/Effluent	120/156	>34250	8.96	>229
Yuba City	“ “	Surface Water/Effluent	114/164 <sup>1</sup>	>8000	7.60/7.46	>53.5

<sup>1</sup> Hardness values may be biased high because the EDTA titrimetric method is subject to interferences that measure as hardness (barium, cadmium, lead, manganese, strontium, and zinc will be measured as hardness) producing hardness numbers that are likely to be greater than the calculation of hardness based upon the ICP analysis of calcium and magnesium. Upstream receiving water hardness ranged from 30 to 50.9 mg/L as CaCO<sub>3</sub> between January 2008 and August 2011. Furthermore, the upstream receiving water hardness was 37 mg/L as CaCO<sub>3</sub> on 4 October 2005, 7 days prior to the Feasibility Assessment (first phase of a Water Effects Ratio study) sample collection date of 11 October 2005. It is likely that matrix interferences from other metals were responsible for the unexpected hardness values reported by Pacific EcoRisk.

The Discharger has not conducted a toxicity test for aluminum; however, the City of Auburn conducted two toxicity tests in Auburn Ravine, shown highlighted in the previous table. The City of Auburn is located at an elevation of approximately 1,400 feet above sea level, and is surrounded by forest. As shown, the test water quality characteristics of Auburn Ravine are similar to Miners Ravine, with the pH at 7.4 and hardness at 16 mg/L as CaCO<sub>3</sub> in comparison to the mean pH at 7.2 and the minimum hardness at 16 mg/L (mean hardness at 52 mg/L) as CaCO<sub>3</sub>, respectively. Thus, based on these two similar primary water quality characteristics (pH and hardness) that drive aluminum speciation, the aluminum toxicity within Auburn Ravine is expected to be similar in Miners Ravine. Therefore, the Auburn Ravine aluminum toxicity test study is relevant and appropriate in this case for use in determining the specific numerical criteria to be used in determining compliance with the Basin Plan’s narrative toxicity objective. The Auburn Ravine aluminum toxicity study resulted in a site-specific aluminum objective at 1,079 µg/L. Thus, these results support the conclusion that the 87 µg/L chronic criterion is overly stringent for Miners Ravine.

State of California Department of Public Health (DPH) has established secondary maximum contaminant levels (MCLs) to assist public drinking water systems in managing their drinking water for aesthetic conditions such as taste, color, and odor. The secondary MCL for aluminum is 200 µg/L.

**(b) RPA Results.** NAWQC acute criterion of 750 µg/L is for protection of aquatic life. Secondary MCLs are drinking water standards contained in Title 22 of the California Code of Regulations. Title 22 requires compliance with these standards on an annual average basis, when

sampling at least quarterly. To be consistent with how compliance with the standards is determined, the RPA was conducted based on the calendar annual average effluent aluminum concentrations.

The maximum effluent concentration for aluminum was 116 µg/L and the maximum calendar annual average effluent concentration for aluminum was 42 µg/L (minimum MDL 0.4 µg/L, minimum RL 4 µg/L) based on 55 samples collected between September 2007 and May 2012. Upstream receiving water data for aluminum is not available. Therefore, the discharge does not demonstrate reasonable potential to cause or contribute to an in-stream excursion above the NAWQC acute criterion or the Secondary MCL, and the WQBELs for aluminum have not been retained in this Order. Removal of these effluent limitations is in accordance with federal anti-backsliding regulations (see section IV.D.3 of the Fact Sheet).

## ii. Iron

**(a) WQO.** The Secondary MCL – Consumer Acceptance Limit for iron is 300 µg/L, which is used to implement the Basin Plan’s chemical constituent objective for the protection of municipal and domestic supply.

**(b) RPA Results.** Secondary MCLs are drinking water standards contained in Title 22 of the California Code of Regulations. Title 22 requires compliance with these standards on an annual average basis, when sampling at least quarterly. Iron is not a priority pollutant and the RPA procedures in section 1.3 of the SIP are not required. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used best professional judgment in determining the appropriate method for conducting the RPA for this non-priority pollutant constituent. To be consistent with how compliance with the standards is determined, the RPA was conducted based on the calendar annual average effluent iron concentrations.

Order R5-2007-0070 included an effluent limitation for iron based on the Secondary MCL for the protection of human health. The maximum calendar annual average effluent concentration for iron was 45 µg/L based on 54 samples collected between September 2007 and May 2012. Upstream receiving water data for iron from the term of Order R5-2007-0070 is not available. The maximum observed upstream receiving water concentration was 740 µg/L and the maximum observed annual average upstream receiving water concentration was 532 µg/L based on four upstream receiving water samples collected between March 2002 and December 2002. The most stringent objective is the Secondary Drinking Water MCL, which is derived from human welfare considerations (e.g., taste, odor, laundry staining), not for toxicity to humans or aquatic life. Although the receiving water contains iron exceeding the Secondary MCL, the effluent iron is consistently less than the concentrations in the

receiving water and below the applicable water quality objective. Therefore, based on the effluent data, the Central Valley Water Board finds the discharge does not demonstrate reasonable potential to cause or contribute to an in-stream excursion above the Secondary MCL in the receiving water and the Facility is adequately controlling the discharge of iron. Since the discharge does not exhibit reasonable potential, the WQBEL for iron has not been retained in this Order. Based on new information collected between September 2007 and May 2012 iron was not detected in the effluent above the applicable water quality criteria, therefore, removal of the effluent limitation is in accordance with federal anti-backsliding regulations (see section IV.D.3 of the Fact Sheet).

### iii. Manganese

- (a) **WQO.** The Secondary MCL – Consumer Acceptance Limit for manganese is 50 µg/L, which is used to implement the Basin Plan’s chemical constituent objective for the protection of municipal and domestic supply.
- (b) **RPA Results.** Secondary MCLs are drinking water standards contained in Title 22 of the California Code of Regulations. Title 22 requires compliance with these standards on an annual average basis, when sampling at least quarterly. Manganese is not a priority pollutant and the RPA procedures in section 1.3 of the SIP are not required. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used best professional judgment in determining the appropriate method for conducting the RPA for this non-priority pollutant constituent. To be consistent with how compliance with the standards is determined, the RPA was conducted based on the calendar annual average effluent manganese concentrations.

Order R5-2007-0070 included an effluent limitation for manganese based on the Secondary MCL for the protection of human health. The maximum calendar annual average effluent concentration for manganese was 27 µg/L based on 54 samples collected between September 2007 and May 2012. Upstream receiving water data for manganese from the term of Order R5-2007-0070 is not available. The maximum observed upstream receiving water concentration was 96 µg/L and the maximum observed annual average upstream receiving water concentration was 57 µg/L, based on four upstream receiving water samples for total manganese collected between March 2002 and December 2002. The most stringent objective is the Secondary Drinking Water MCL, which is derived from human welfare considerations (e.g., taste, odor, laundry staining), not for toxicity to humans or aquatic life. Although the receiving water contains manganese exceeding the Secondary MCL, the effluent manganese is consistently less than the concentrations in the receiving water and below the applicable water quality objective. Therefore, based on the effluent samples, the Central Valley Water Board finds the discharge does not

demonstrate reasonable potential to cause or contribute to an in-stream excursion above the Secondary MCL in the receiving water and the Facility is adequately controlling the discharge of manganese. Since the discharge does not exhibit reasonable potential, the WQBEL for manganese has not been retained in this Order. Based on new information collected between January 2009 and December 2011 manganese was not detected in the effluent above the applicable water quality criteria, therefore, removal of the effluent limitation is in accordance with federal anti-backsliding regulations (see section IV.D.3 of the Fact Sheet).

#### iv. Mercury

**(a) WQO.** The current National Ambient Water Quality Criterion (NAWQC) for protection of freshwater aquatic life, continuous concentration, for mercury is 0.77 µg/L (30-day average, chronic criteria). The CTR contains a human health criterion (based on a threshold dose level causing neurological effects in infants) of 0.050 µg/L for waters from which both water and aquatic organisms are consumed. Both values are controversial and subject to change. In 40 CFR Part 131, USEPA acknowledges that the human health criteria may not be protective of some aquatic or endangered species and that “...*more stringent mercury limits may be determined and implemented through use of the State’s narrative criterion.*” In the CTR, USEPA reserved the mercury criteria for freshwater and aquatic life and may adopt new criteria at a later date.

No TMDL for mercury is scheduled for Miners Ravine.

**(b) RPA Results.** Order R5-2007-0070 included a performance-based effluent limitation for mercury 0.000606 lbs/month total recoverable mercury to maintain the mercury loading at the existing level until a TMDL could be established or USEPA develops mercury standards that are protective of human health. The MEC for mercury was 0.00493 µg/L based on 55 samples collected between September 2007 and May 2012. The MEC does not exceed the criteria of 0.77 µg/L or 0.050 µg/L. In addition, calculating the equivalent lbs/month results in 0.00045 lbs/month, which is less than the effluent limitation. Upstream receiving water data for mercury from the term of Order R5-2007-0070 is not available. The maximum upstream receiving water concentration for mercury was 0.0066 µg/L based on four samples collected between March 2002 and December 2002. Therefore, based on the effluent data, the discharge does not demonstrate reasonable potential to cause or contribute to an in-stream excursion above the CTR criterion, and the WQBEL for mercury has not been retained in this Order. Removal of this effluent limitation is in accordance with federal anti-backsliding regulations (see section IV.D.3. of the Fact Sheet). If mercury toxicity is detected or USEPA develops new water quality standards for mercury, this permit may be reopened and effluent limitations imposed.

**v. Persistent Chlorinated Hydrocarbon Pesticides**

**(a) WQO.** The Basin Plan requires that no individual pesticides shall be present in concentrations that adversely affect beneficial uses; discharges shall not result in pesticide concentrations in bottom sediments or aquatic life that adversely affect beneficial uses; persistent chlorinated hydrocarbon pesticides shall not be present in the water column at detectable concentrations; and pesticide concentrations shall not exceed those allowable by applicable antidegradation policies. Persistent chlorinated hydrocarbon pesticides include aldrin; alpha-BHC; beta-BHC; gamma-BHC; delta-BHC; chlordane; 4,4-DDT; 4,4-DDE; 4,4-DDD; dieldrin; alpha-endosulfan; beta-endosulfan; endosulfan sulfate; endrin; endrin aldehyde; heptachlor; heptachlor epoxide; and toxaphene. The CTR also contains water quality criteria for individual pesticides for the protection of water and organisms.

**(b) RPA Results.** Order R5-2007-0070 included effluent limitations for persistent chlorinated hydrocarbon (i.e., organochlorine) pesticides as a group based on the Basin Plan objective. Between 2007 and 2012, 4,4-DDE, 4,4-DDT, alpha-endosulfan, endosulfan sulfate, and endrin aldehyde were detected, but not quantified (DNQ) in an effluent sample collected 6 October 2010; however, several pesticides were also detected in the laboratory blank, indicating sample contamination for the 6 October 2010 sample, as shown in the following table:

**Table F-8. 6 October 2010 Persistent Chlorinated Hydrocarbon Pesticides Results**

Constituent	6 October 2010 Sample Result (µg/L)	MDL (µg/L)	RL (µg/L)	SIP ML (µg/L)	Laboratory Blank Concentration (µg/L)
Aldrin	ND	0.003	0.005	0.005	ND
alpha-BHC	ND	0.003	0.012	0.01	0.003 (DNQ)
alpha-Endosulfan	0.009 (DNQ)	0.002	0.012	0.02	ND
beta-BHC	ND	0.003	0.005	0.005	ND
beta-Endosulfan	ND	0.005	0.012	0.01	ND
Chlordane	ND	0.250	0.250	0.1	ND
4,4-DDD	ND	0.002	0.012	0.05	ND
4,4-DDE	0.008 (DNQ)	0.001	0.012	0.05	ND
4,4-DDT	0.01 (DNQ)	0.001	0.012	0.01	0.005 (DNQ)
delta-BHC	ND	0.005	0.005	0.005	ND
Dieldrin	ND	0.002	0.012	0.01	ND
Endosulfan Sulfate	0.011 (DNQ)	0.001	0.012	0.05	0.003 (DNQ)
Endrin	ND	0.002	0.012	0.01	0.003 (DNQ)
Endrin Aldehyde	0.002 (DNQ)	0.002	0.012	0.01	0.005 (DNQ)
gamma-BHC	ND	0.012	0.003	0.02	ND
Heptachlor	ND	0.004	0.012	0.01	0.004 (DNQ)
Heptachlor Epoxide	ND	0.005	0.012	0.01	ND
Toxaphene	ND	--	0.250	0.5	ND

Section 1.2 of the SIP states “*The RWQCB shall have discretion to consider if any data are inappropriate or insufficient for use in implementing this Policy. Instances where such consideration is warranted include, but are not limited to, the following: evidence that a sample has been erroneously reported or is not representative of effluent or ambient receiving water quality; questionable quality control/quality assurance practices; and varying seasonal conditions.*” The Central Valley Water Board finds that the 6 October 2010 effluent data has questionable quality assurance/quality control practices and did not use them in conducting the RPA. Excluding the 6 October 2010 sample results, effluent monitoring of the individual persistent chlorinated hydrocarbon pesticides resulted in no detected results for each individual persistent chlorinated hydrocarbon pesticide above the following minimum MDLs and RLs based on 59 effluent samples collected between September 2007 and May 2012.

**Table F-9. Minimum MDLs and RLs for Persistent Chlorinated Hydrocarbon Pesticides**

Constituent	SIP ML (µg/L)	Minimum MDL (µg/L)	Minimum RL (µg/L)
Aldrin	0.005	0.003	0.005
alpha-BHC	0.01	0.003	0.010
alpha-Endosulfan	0.02	0.002	0.012
beta-BHC	0.005	0.003	0.005
beta-Endosulfan	0.01	0.005	0.01
Chlordane	0.1	0.055	0.1
4,4-DDD	0.05	0.002	0.012
4,4-DDE	0.05	0.001	0.01
4,4-DDT	0.01	0.001	0.012
delta-BHC	0.005	0.005	0.005
Dieldrin	0.01	0.002	0.012
Endosulfan Sulfate	0.05	0.001	0.012
Endrin	0.01	0.002	0.012
Endrin Aldehyde	0.01	0.002	0.012
gamma-BHC	0.02	0.003	0.012
Heptachlor	0.01	0.004	0.01
Heptachlor Epoxide	0.01	0.005	0.01
Toxaphene	0.5	0.004	0.25

Upstream receiving water monitoring data for persistent chlorinated hydrocarbon pesticides from the term of Order R5-2007-0070 is not available. Persistent chlorinated hydrocarbon pesticides were not detected in the upstream receiving water based on four samples collected between March 2002 and December 2002.

Therefore, the discharge does not demonstrate reasonable potential to cause or contribute to an in-stream excursion above Basin Plan objective or CTR criteria for persistent chlorinated hydrocarbon pesticides and the effluent limitations for persistent chlorinated hydrocarbon pesticides have not been retained in this Order. Removal of these effluent limitations is in accordance with federal antibacksliding regulations (see section IV.D.3 of the Fact Sheet).

**vi. Settleable Solids**

**(a) WQO.** For inland surface waters, the Basin Plan contains the settleable material water quality objective which states that “[w]ater shall not contain substances in concentrations that result in the deposition of material that causes nuisance or adversely affects beneficial uses.”

**(b) RPA Results.** Order R5-2007-0070 established an AMEL of 0.1 ml/L and a maximum daily effluent limitation (MDEL) of 0.2 ml/L for settleable solids to implement the narrative settleable solids objective. Settleable solids were not detected in the effluent based on 279 samples collected between September 2007 and May 2012 (MDL and RL 0.1 ml/L). Because settleable solids have not been detected in the effluent and because the Discharger provides tertiary treatment, the discharge from the Facility does not have reasonable potential to cause or contribute to an excursion above the Basin Plan’s narrative objective for settleable solids and the effluent limitations for settleable solids have not been retained in this Order. Removal of these effluent limitations is in accordance with federal antibacksliding regulations (see section IV.D.3 of the Fact Sheet).

**c. Constituents with Insufficient or Limited Data.** Reasonable potential cannot be determined for the following constituents because effluent data are insufficient or limited or ambient background concentrations are not available. The Discharger is required to continue to monitor for these constituents in the effluent using analytical methods that provide the best feasible detection limits. When additional data become available, further analysis will be conducted to determine whether to add numeric effluent limitations or to continue monitoring.

**i. Arsenic**

**(a) WQO.** DPH has adopted a Primary MCL for arsenic of 10 µg/L, which is protective of the Basin Plan’s chemical constituent objective.

**(b) RPA Results.** The MEC for arsenic was 13.5 µg/L based on six samples collected between September 2007 and May 2012. Upstream receiving water data for arsenic is not available.

**Table F-10. Arsenic Effluent Data**

Date	Effluent Arsenic Concentration (µg/L)	Method Detection Limit (µg/L)	Reporting Level (µg/L)	SIP Minimum Level (µg/L)
8 November 2007	13.5	NR	10	1
8 October 2008	0.74	NR	0.15	1
6 January 2009	0.48	NR	0.15	1
8 July 2010	1.19	0.04	0.15	1
4 August 2010	1.85	0.04	0.15	1
7 December 2011	0.5	0.04	0.15	1

The MEC was observed on 8 November 2007. The laboratory results for the 8 November 2007 sample also indicate detections of volatile organic

compounds (VOCs) benzene, methyl tert-butyl ether, and toluene, though not at levels that exceed applicable water quality objectives (except benzene). In the cover letter for the November 2007 SMR, the Discharger indicated that illegal dumping into the collection system was suspected. Arsenic was not detected above the Primary MCL in five subsequent samples. The 8 November 2007 sample was analyzed by a different laboratory than was used for the five subsequent samples. The 8 November 2007 sample was analyzed using a RL of 10 µg/L, whereas the subsequent samples were analyzed using a more sensitive method with an RL of 0.15 µg/L, which is below the lowest SIP ML of 1 µg/L.

SIP Section 1.2 states that the Central Valley Water Board has the discretion to consider if any data are inappropriate or insufficient for use in implementing the SIP. Therefore, in accordance with Section 1.2 of the SIP, the Central Valley Board has determined that the 8 November 2007 sample is inappropriate and insufficient to be used in the RPA. In implementing its discretion, the Central Valley Water Board is not finding that arsenic does not exhibit reasonable potential to cause or contribute to an exceedance of a water quality criterion; rather the Central Valley Water Board cannot make such a determination given the data is insufficient to determine whether concentrations in the effluent exceed the water quality criterion for arsenic.

Section 1.3, Step 8 of the SIP allows the Central Valley Water Board to require additional monitoring for a pollutant in place of an effluent limitation if data are unavailable or insufficient. Therefore, the Central Valley Water Board will require additional monitoring for such constituents until such time a determination can be made in accordance with the SIP policy. Instead of limitations, additional monitoring has been established for arsenic through the study required in Attachment I of this Order. Should monitoring results indicate that the discharge has the reasonable potential to cause or contribute to an exceedance of a water quality standard, this Order may be reopened and modified by adding an appropriate effluent limitation.

## ii. Benzene

**(a) WQO.** DPH has adopted a Primary MCL for benzene of 1.0 µg/L, which is protective of the Basin Plan's chemical constituent objective.

**(b) RPA Results.** Benzene was detected in the effluent once out of 10 samples collected between September 2007 and May 2012 at a concentration of 4.6 µg/L as shown in the table below. Upstream receiving water data for benzene is not available.

**Table F-11. Benzene Effluent Data**

Date	Effluent Benzene Concentration (µg/L)	Method Detection Limit (µg/L)	Reporting Level (µg/L)	SIP Minimum Level (µg/L)
8 November 2007	4.6	0.06	0.5	0.5
5 December 2007	ND	0.06	0.5	0.5
2 January 2008	ND	0.06	0.5	0.5
6 February 2008	ND	0.06	0.5	0.5
4 September 2008	ND	0.06	0.5	0.5
9 October 2008	ND	0.06	0.5	0.5
5 February 2009	ND	0.06	0.5	0.5
4 November 2009	ND	0.06	0.5	0.5
14 July 2010	ND	0.06	0.5	0.5
7 December 2011	ND	0.06	0.5	0.5

The effluent detection was observed on 8 November 2007. The laboratory results for the 8 November 2007 sample indicate detections of additional VOCs methyl tert-butyl ether and toluene, though not at levels that exceed applicable water quality objectives. In the cover letter for the November 2007 SMR, the Discharger indicated that the detection was suspected to be caused by illegal dumping into the collection system. Benzene was not detected in nine subsequent samples.

SIP Section 1.2 states that the Central Valley Water Board has the discretion to consider if any data are inappropriate or insufficient for use in implementing the SIP. Therefore, in accordance with Section 1.2 of the SIP, the Central Valley Board has determined that the 8 November 2007 sample is inappropriate and insufficient to be used in the RPA. In implementing its discretion, the Central Valley Water Board is not finding that benzene does not exhibit reasonable potential to cause or contribute to an exceedance of a water quality criterion; rather the Central Valley Water Board cannot make such a determination given the data is insufficient to determine whether concentrations in the effluent exceed the water quality criterion for benzene.

Section 1.3, Step 8 of the SIP allows the Central Valley Water Board to require additional monitoring for a pollutant in place of an effluent limitation if data are unavailable or insufficient. Therefore, the Central Valley Water Board will require additional monitoring for such constituents until such time a determination can be made in accordance with the SIP policy. Instead of limitations, additional monitoring has been established for benzene through the study required in section VI.C.2.b of this Order. Should monitoring results indicate that the discharge has the reasonable potential to cause or contribute to an exceedance of a water quality standard, this Order may be reopened and modified by adding an appropriate effluent limitation.

- d. Constituents with Reasonable Potential.** The Central Valley Water Board finds that the discharge has a reasonable potential to cause or contribute to an in-stream excursion above a water quality standard for ammonia, BOD<sub>5</sub>, chlorine

residual, copper, dibromochloromethane, dichlorobromomethane, nitrate plus nitrite, pH, salinity, total coliform organisms, total trihalomethanes, and TSS. WQBELs for these constituents are included in this Order. A summary of the RPA is provided in Attachment G, and a detailed discussion of the RPA for each constituent is provided below.

#### **i. Ammonia**

**(a) WQO.** The NAWQC for the protection of freshwater aquatic life for total ammonia, recommends acute (1-hour average; criteria maximum concentration or CMC) standards based on pH and chronic (30-day average; criteria continuous concentration or CCC) standards based on pH and temperature. USEPA also recommends that no 4-day average concentration should exceed 2.5 times the 30-day CCC. USEPA found that as pH increased, both the acute and chronic toxicity of ammonia increased. Salmonids were more sensitive to acute toxicity effects than other species. However, while the acute toxicity of ammonia was not influenced by temperature, it was found that invertebrates and young fish experienced increasing chronic toxicity effects with increasing temperature. Because Miners Ravine has a beneficial use of cold freshwater habitat and the presence of salmonids and early fish life stages in the Miners Ravine is well-documented, the recommended criteria for waters where salmonids and early life stages are present were used.

The Basin Plan objective for pH in the receiving stream is the range of 6.5 to 8.5. As requested by the Discharger, Order R5-2007-0070 established an instantaneous maximum effluent pH limitation of 8.2 which reflects a level consistently achievable by the Facility. Data collected over the previous permit term indicate that pH in the effluent was consistently below 8.2. Therefore, this Order retains the more stringent instantaneous maximum pH limitation of 8.2. In order to protect against the worst-case short-term exposure of an organism, the permitted instantaneous maximum pH limitation of 8.2 was used to derive the acute criterion. The resulting acute criterion is 3.83 mg/L.

A chronic criterion was calculated for each day when paired temperature and pH were measured using receiving water data for temperature and pH recorded from the Discharger's SMRs from September 2007 through May 2012. Rolling 30-day average criteria were calculated from downstream data using the criteria calculated for each day and the minimum observed 30-day average criterion was established as the applicable 30-day average chronic criterion, or 30-day CCC. The resulting 30-day CCC is 2.52 mg/L (as N). The 4-day average concentration is derived in accordance with the USEPA criterion as 2.5 times the 30-day CCC. Based on the 30-day CCC of 2.52 mg/L (as N), the 4-day average concentration that should not be exceeded is 6.3 mg/L (as N).

**(b) RPA Results.** Federal regulations at 40 CFR 122.44(d)(1)(i) require that, *“Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.”* For priority pollutants, the SIP dictates the procedures for conducting the RPA. Ammonia is not a priority pollutant. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA for this non-priority pollutant constituent.

USEPA’s September 2010 NPDES Permit Writer’s Manual, page 6-30, states, *“State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBELs are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBELs for pathogens in all permits for POTWs discharging to contact recreational waters).”* USEPA’s TSD also recommends that factors other than effluent data should be considered in the RPA, *“When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data.”* With regard to POTWs, USEPA recommends that, *“POTWs should also be characterized for the possibility of chlorine and ammonia problems.”* (TSD, p. 50)

The Facility is a POTW that treats domestic wastewater. Untreated domestic wastewater contains ammonia. Nitrification is a biological process that converts ammonia to nitrite and nitrite to nitrate. Denitrification is a process that converts nitrate to nitrite or nitric oxide and then to nitrous oxide or nitrogen gas, which is then released to the atmosphere. The Discharger currently uses nitrification to remove ammonia from the waste stream. Inadequate or incomplete nitrification may result in the discharge of ammonia to the receiving stream. Ammonia is known to cause toxicity to aquatic organisms in surface waters. Discharges of ammonia in concentrations that produce detrimental physiological responses to human, plant, animal, or aquatic life would violate the Basin Plan narrative toxicity objective. Although the Discharger nitrifies the discharge, inadequate or incomplete nitrification creates the

potential for ammonia to be discharged and provides the basis for the discharge to have a reasonable potential to cause or contribute to an in-stream excursion above the NAWQC. Therefore, the Central Valley Water Board finds the discharge has reasonable potential for ammonia and WQBELs are required.

As discussed in Section 4.1 of the ROWD, the trickling filter feed pump was out of service between March and May 2008, compromising the ability of the treatment process to undergo nitrification. The Facility experienced a second period of atypical operation in late December 2011 through mid-February 2012 caused by a plant upset. Therefore, these results are not representative of effluent quality when the Facility is properly operated. Excluding data collected between March and May 2008 and late December 2011 through mid-February 2012, the maximum effluent concentration for ammonia was 11.2 mg/L (collected on 26 May 2009) based on 1,173 samples collected between September 2007 and May 2012. Upstream receiving water data for ammonia is not available.

- (c) **WQBELs.** Applying 40 CFR section 122.44(d)(1)(vi)(B), effluent limitations for ammonia were calculated based on USEPA's Ambient Water Quality Criteria for the protection of the beneficial use of freshwater aquatic habitat. This Order contains a final AMEL and MDEL for ammonia of 1.2 mg/L and 3.8 mg/L, respectively, based on the NAWQC acute criterion.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the maximum effluent concentration of 11.2 mg/L is greater than applicable WQBELs. Excluding the data from March through May 2008 and from late December 2011 through mid-February 2012, there were approximately 1135 samples collected, of which 47 samples exceeded the ammonia AMEL of 1.2 mg/L. It appears that during periods of typical operation, the facility is able to achieve the effluent limitations for ammonia a majority of the time.

## ii. Chlorine Residual

- (a) **WQO.** USEPA developed NAWQC for protection of freshwater aquatic life for chlorine residual. The recommended 4-day average (chronic) and 1-hour average (acute) criteria for chlorine residual are 0.011 mg/L and 0.019 mg/L, respectively. These criteria are protective of the Basin Plan's narrative toxicity objective.
- (b) **RPA Results.** Federal regulations at 40 CFR 122.44(d)(1)(i) require that, "*Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any*

*State water quality standard, including State narrative criteria for water quality.” For priority pollutants, the SIP dictates the procedures for conducting the RPA. Chlorine is not a priority pollutant. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used its judgment in determining the appropriate method for conducting the RPA for this non-priority pollutant constituent.*

USEPA’s September 2010 NPDES Permit Writer’s Manual, page 6-30, states, *“State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBELs are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBELs for pathogens in all permits for POTWs discharging to contact recreational waters).”* USEPA’s TSD also recommends that factors other than effluent data should be considered in the RPA, *“When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data.”* With regard to POTWs, USEPA recommends that, *“POTWs should also be characterized for the possibility of chlorine and ammonia problems.”* (TSD, p. 50)

The Discharger uses chlorine for disinfection, which is extremely toxic to aquatic organisms. Although the Discharger uses a sodium bisulfite process to dechlorinate the effluent prior to discharge to Miners Ravine, the existing chlorine use and the potential for chlorine to be discharged provides the basis for the discharge to have a reasonable potential to cause or contribute to an in-stream excursion above the NAWQC.

- (c) WQBELs.** The USEPA *Technical Support Document for Water Quality-Based Toxics Control* [EPA/505/2-90-001] contains statistical methods for converting chronic (4-day) and acute (1-hour) aquatic life criteria to average monthly and maximum daily effluent limitations based on the variability of the existing data and the expected frequency of monitoring. However, because chlorine is an acutely toxic constituent that can and will be monitored continuously, an average 1-hour limitation is considered more appropriate than an average daily limitation. This Order contains a 4-day average effluent limitation and 1-hour average effluent limitation for chlorine residual of 0.011 mg/L and 0.019 mg/L, respectively, based on USEPA’s NAWQC, which implements the Basin Plan’s narrative toxicity objective for protection of aquatic life.

- (d) Plant Performance and Attainability.** Prior to discharging, the Discharger dechlorinates the treated effluent using sodium bisulfite. The Central Valley Water Board concludes, therefore, that compliance with chlorine residual effluent limitations is feasible.

### iii. Copper

- (a) WQO.** The CTR includes hardness dependent criteria for the protection of freshwater aquatic life for copper. These criteria for copper are presented in dissolved concentrations. USEPA recommends conversion factors to translate dissolved concentrations to total concentrations. Default USEPA translators were used in this Order.
- (b) RPA Results.** Section IV.C.2.e of this Fact Sheet includes procedures for conducting the RPA for copper. Based on the lowest observed upstream receiving water hardness of 16 mg/L (as CaCO<sub>3</sub>), the applicable total recoverable criteria for evaluating the ambient background concentration are 2.5 µg/L and 1.9 µg/L for the acute and chronic criteria, respectively. Upstream receiving water data for copper from the term of Order R5-2007-0070 is not available. The maximum upstream receiving water concentration for copper was 3.73 µg/L based on four samples collected between March 2002 and December 2002.

As discussed in Section IV.C.2.e for comparing the MEC to the criteria, the reasonable worst-case downstream ambient hardness should be used. Based on a hardness of 54.3 mg/L (as CaCO<sub>3</sub>), the applicable total recoverable criteria are 7.9 µg/L and 5.5 µg/L for the acute and chronic criteria, respectively. The MEC for copper (total recoverable) was 6.9 µg/L, based on 54 samples collected by the Discharger between September 2007 and May 2012. Therefore, copper in the discharge has a reasonable potential to cause or contribute to an in-stream excursion above the CTR criterion for the protection of aquatic life.

- (c) WQBELs.** This Order contains a final AMEL and MDEL for copper of 3.9 µg/L and 7.9 µg/L, respectively, based on the CTR criterion for the protection of human health.
- (d) Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 6.9 µg/L is greater than applicable WQBELs. CDO R5-2012-0005 provides a compliance schedule to achieve compliance with the final effluent limitations for copper by 31 December 2014. Consistent with CDO R5-2012-0005, a compliance time schedule for compliance with the copper effluent limitations is established in CDO R5-2013-0089, with compliance with final effluent limitations required by 31 December 2014, in accordance with Water Code section 13300, that requires preparation and implementation of a pollution prevention plan in compliance with Water Code section 13263.3.

#### iv. Dibromochloromethane

- (a) **WQO.** The CTR includes a criterion of 0.41 µg/L for dibromochloromethane for the protection of human health for waters from which both water and organisms are consumed.
- (b) **RPA Results.** The MEC for dibromochloromethane was 7 µg/L based on 64 samples collected between September 2007 and May 2012. Dibromochloromethane was not detected in the upstream receiving water based on one sample collected on 4 March 2009. Based on the concentrations observed in the effluent, dibromochloromethane in the discharge has a reasonable potential to cause or contribute to an in-stream excursion above the CTR criterion for the protection of human health.
- (c) **WQBELs.** This Order contains a final AMEL and MDEL for dibromochloromethane of 0.41 µg/L and 0.98 µg/L, respectively, based on the CTR criterion for the protection of human health.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 7 µg/L is greater than applicable WQBELs. CDO R5-2012-0005 provides a compliance schedule to achieve compliance with the final effluent limitations for dibromochloromethane by 31 December 2014. Consistent with CDO R5-2012-0005, a compliance time schedule for compliance with the dibromochloromethane effluent limitations is established in CDO R5-2013-0089, with compliance with final effluent limitations required by 31 December 2014, in accordance with Water Code section 13300, that requires preparation and implementation of a pollution prevention plan in compliance with Water Code section 13263.3.

#### v. Dichlorobromomethane

- (a) **WQO.** The CTR includes a criterion of 0.56 µg/L for dichlorobromomethane for the protection of human health for waters from which both water and organisms are consumed.
- (b) **RPA Results.** The MEC for dichlorobromomethane was 21 µg/L based on 65 samples collected between September 2007 and May 2012. Dichlorobromomethane was not detected in the upstream receiving water based on one sample on 4 March 2009. Therefore, dichlorobromomethane in the discharge has a reasonable potential to cause or contribute to an in-stream excursion above the CTR criterion for the protection of human health.
- (c) **WQBELs.** This Order contains a final AMEL and MDEL for dichlorobromomethane of 0.56 µg/L and 1.1 µg/L, respectively, based on the CTR criterion for the protection of human health.

**(d) Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 21 µg/L is greater than applicable WQBELs. CDO R5-2012-0005 provides a compliance schedule to achieve compliance with the final effluent limitations for dichlorobromomethane by 31 December 2014. Consistent with CDO R5-2012-0005, a compliance time schedule for compliance with the dichlorobromomethane effluent limitations is established in CDO R5-2013-0089, with compliance with final effluent limitations required by 31 December 2014, in accordance with Water Code section 13300, that requires preparation and implementation of a pollution prevention plan in compliance with Water Code section 13263.3.

#### vi. Nitrate and Nitrite

**(a) WQO.** DPH has adopted Primary MCLs for the protection of human health for nitrite and nitrate that are equal to 1 mg/L and 10 mg/L (measured as nitrogen), respectively. DPH has also adopted a primary MCL of 10 mg/L for the sum of nitrate and nitrite, measured as nitrogen.

USEPA has developed a primary MCL and an MCL goal of 1 mg/L for nitrite (as nitrogen). For nitrate, USEPA has developed Drinking Water Standards (10 mg/L as Primary MCL) and NAWQC for protection of human health (10 mg/L for non-cancer health effects). Recent toxicity studies have indicated a possibility that nitrate is toxic to aquatic organisms.

**(b) RPA Results.** Federal regulations at 40 CFR 122.44(d)(1)(i) require that, *“Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.”* For priority pollutants, the SIP dictates the procedures for conducting the RPA. Nitrate and nitrite are not priority pollutants. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA for these non-priority pollutant constituents.

USEPA’s September 2010 NPDES Permit Writer’s Manual, page 6-30, states, *“State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBELs are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBELs for pathogens in all permits for POTWs*

*discharging to contact recreational waters).*” USEPA’s TSD also recommends that factors other than effluent data should be considered in the RPA, *“When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data.”* With regard to POTWS, USEPA recommends that, *“POTWs should also be characterized for the possibility of chlorine and ammonia problems.”* (TSD, p. 50)

The Facility is a POTW that treats domestic wastewater. Untreated domestic wastewater contains ammonia and this Order requires removal of ammonia (i.e., nitrification). Nitrification is a biological process that converts ammonia to nitrite and nitrite to nitrate. Denitrification is a process that converts nitrate to nitrite or nitric oxide and then to nitrous oxide or nitrogen gas, which is then released to the atmosphere. The Discharger currently uses nitrification/denitrification to remove ammonia, nitrite, and nitrate from the waste stream. Inadequate or incomplete denitrification may result in the discharge of nitrate and/or nitrite to the receiving stream. Discharges of nitrate plus nitrite in concentrations that exceed the Primary MCL would violate the Basin Plan narrative chemical constituents objective. Although the Discharger denitrifies the discharge, inadequate or incomplete denitrification creates the potential for nitrate and nitrite to be discharged and provides the basis for the discharge to have a reasonable potential to cause or contribute to an in-stream excursion above the Primary MCL. Therefore, the Central Valley Water Board finds the discharge has reasonable potential for nitrate plus nitrite and WQBELs are required.

The trickling filter provides nitrification. The Discharger installed a denitrifying sand filter which went online 8 February 2011. The maximum effluent concentration for nitrate was 8.1 mg/L based on 19 samples collected between March 2011 and May 2012 (i.e., subsequent to the installation of the denitrifying sand filter). Nitrite was detected in the effluent at 0.18 mg/L in one sample in November 2007. Monitoring data for nitrite subsequent to the installation of the denitrifying sand filter is not available.

- (c) WQBELs.** Order R5-2007-0070 included an AMEL for nitrate of 10 mg/L based on the Primary MCL. This Order contains a final AMEL for nitrate plus nitrite of 10 mg/L based on the protection of the Basin Plan’s narrative chemical constituents objective and to assure the treatment process adequately nitrifies and denitrifies the waste stream to protect the beneficial uses of municipal and domestic supply.

- (d) Plant Performance and Attainability.** Analysis of the effluent data shows that the maximum effluent concentration of 8.1 mg/L for nitrate and 0.18 mg/L is less than the applicable WQBEL. The Central Valley Water Board concludes, therefore, that immediate compliance with this effluent limitation is feasible.

## vii. Pathogens

- (a) WQO.** DPH has developed reclamation criteria, CCR, Division 4, Chapter 3 (Title 22), for the reuse of wastewater. Title 22 requires that for spray irrigation of food crops, parks, playgrounds, schoolyards, and other areas of similar public access, wastewater be adequately disinfected, oxidized, coagulated, clarified, and filtered, and that the effluent total coliform levels not exceed 2.2 MPN/100 mL as a 7-day median, 23 MPN/100 mL more than once in any 30-day period, and 240 MPN/100 mL at any time.

Title 22 also requires that recycled water used as a source of water supply for non-restricted recreational impoundments be disinfected tertiary recycled water that has been subjected to conventional treatment. A non-restricted recreational impoundment is defined as “...an impoundment of recycled water, in which no limitations are imposed on body-contact water recreational activities.” Title 22 is not directly applicable to surface waters; however, the Central Valley Water Board finds that it is appropriate to apply an equivalent level of treatment to that required by DPH’s reclamation criteria because the receiving water is used for irrigation of agricultural land and for contact recreation purposes. The stringent disinfection criteria of Title 22 are appropriate since the undiluted effluent may be used for the irrigation of food crops and/or for body-contact water recreation. Coliform organisms are intended as an indicator of the effectiveness of the entire treatment train and the effectiveness of removing other pathogens.

- (b) RPA Results.** Raw domestic wastewater inherently contains human pathogens that threaten human health and life, and constitute a threatened pollution and nuisance under CWC section 13050 if discharged untreated to the receiving water. Reasonable potential for pathogens therefore exists and WQBELs are required.

Federal regulations at 40 CFR 122.44(d)(1)(i) require that, “*Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.*” For priority pollutants, the SIP dictates the procedures for conducting the RPA. Pathogens are not priority pollutants. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-

specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA for this non-priority pollutant constituent.

USEPA's September 2010 NPDES Permit Writer's Manual, page 6-30, states, "*State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBELs are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBELs for pathogens in all permits for POTWs discharging to contact recreational waters).*" USEPA's TSD also recommends that factors other than effluent data should be considered in the RPA, "*When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data.*" (TSD, p. 50)

The beneficial uses of Miners Ravine include municipal and domestic supply, water contact recreation, and agricultural irrigation supply, and there is, at times, less than 20:1 dilution. To protect these beneficial uses, the Central Valley Water Board finds that the wastewater must be disinfected and adequately treated to prevent disease. Although the Discharger provides disinfection, inadequate or incomplete disinfection creates the potential for pathogens to be discharged and provides the basis for the discharge to have a reasonable potential to cause or contribute to an exceedance of the Basin Plan's narrative toxicity objective. Therefore, the Central Valley Water Board finds the discharge has reasonable potential for pathogens and WQBELs are required.

**(c) WQBELs.** The method of treatment is not prescribed by this Order; however, wastewater must be treated to a level equivalent to that recommended by DPH. In accordance with the requirements of Title 22, this Order includes effluent limitations for total coliform organisms of 2.2 MPN/100 mL as a 7-day median; 23 MPN/100 mL, not to be exceeded more than once in a 30-day period; and 240 MPN/100 mL as an instantaneous maximum. As coliform organisms are living and mobile, it is impracticable to quantify an exact number of coliform organisms and to establish weekly average limitations. Instead, coliform organisms are measured as a most probable number and regulated based on a 7-day median limitation.

In addition to coliform limitations, a turbidity operational specification has been included as a second indicator of the effectiveness of the treatment process and to assure compliance with the required level of treatment.

The tertiary treatment process utilized at the Facility is capable of reliably meeting a turbidity limitation of 2 nephelometric turbidity units (NTU) as a daily average. Failure of the filtration system such that virus removal is impaired would normally result in increased particles in the effluent, which result in higher effluent turbidity. Turbidity has a major advantage for monitoring filter performance, allowing immediate detection of filter failure and rapid corrective action. Coliform testing, by comparison, is not conducted continuously and requires several hours, to days, to identify high coliform concentrations. In accordance with DPH recommendations, this Order includes operational specifications for turbidity of 2 NTU as a daily average; 5 NTU, not to be exceeded more than 5% of the time within a 24-hour period; and 10 NTU as an instantaneous maximum.

This Order contains effluent limitations for BOD<sub>5</sub>, total coliform organisms, and TSS, and requires a tertiary level of treatment, or equivalent, necessary to protect the beneficial uses of the receiving water. The Central Valley Water Board has previously considered the factors in Water Code section 13241 in establishing these requirements.

Final WQBELs for BOD<sub>5</sub> and TSS are based on the technical capability of the tertiary process, which is necessary to protect the beneficial uses of the receiving water. BOD<sub>5</sub> is a measure of the amount of oxygen used in the biochemical oxidation of organic matter. The tertiary treatment standards for BOD<sub>5</sub> and TSS are indicators of the effectiveness of the tertiary treatment process. The principal design parameter for wastewater treatment plants is the daily BOD<sub>5</sub> and TSS loading rates and the corresponding removal rate of the system. The application of tertiary treatment processes results in the ability to achieve lower levels for BOD<sub>5</sub> and TSS than the secondary standards currently prescribed. Therefore, this Order requires AMELs for BOD<sub>5</sub> and TSS of 10 mg/L, which is technically based on the capability of a tertiary system. In addition to the average weekly and average monthly effluent limitations, a daily maximum effluent limitation for BOD<sub>5</sub> and TSS is included in the Order to ensure that the treatment works are not organically overloaded and operate in accordance with design capabilities.

**(d) Plant Performance and Attainability.** The Facility is designed to provide tertiary treatment, except under severe wet weather conditions. The denitrifying sand filter does not have the capacity to treat all wastewater under wet weather conditions and peak flows in excess of 0.5 MGD are directed from the secondary clarifier to the chlorine contact basin. Therefore, the Facility discharges a combination of secondary and tertiary treated wastewater under these conditions. This Order requires tertiary treatment under all flow conditions. The Discharger has indicated that the

Facility is capable of complying with the effluent limitations for total coliform organisms under all flow conditions, but is not able to comply with the operational specifications for turbidity when peak flows exceed 0.5 MGD, which would occur when at least 20:1 dilution is available. As discussed in section IV.E of this Fact Sheet, a compliance schedule has been included in this Order for compliance with Title 22 (or equivalent) requirements when there is greater than 20:1 dilution.

**viii. pH**

**(a) WQO.** The Basin Plan includes a water quality objective for surface waters (except for Goose Lake) that the “...pH shall not be depressed below 6.5 nor raised above 8.5.”

**(b) RPA Results.** Federal regulations at 40 CFR 122.44(d)(1)(i) require that, “Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.” For priority pollutants, the SIP dictates the procedures for conducting the RPA. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA for pH.

USEPA’s September 2010 NPDES Permit Writer’s Manual, page 6-30, states, “State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBELs are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBELs for pathogens in all permits for POTWs discharging to contact recreational waters).” USEPA’s TSD also recommends that factors other than effluent data should be considered in the RPA, “When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data.” (TSD, p. 50)

The Facility is a POTW that treats domestic wastewater. Although the Discharger has proper pH controls in place, the pH for the Facility’s influent varies due to the nature of municipal sewage, which provides the

basis for the discharge to have a reasonable potential to cause or contribute to an in-stream excursion above the Basin Plan's numeric objective for pH in the receiving water. Therefore, WQBELs for pH are required in this Order.

- (c) WQBELs.** An effluent limitation for pH of 6.5 as an instantaneous minimum is included in this Order based on protection of the Basin Plan objective for pH. At the Discharger's request, Order R5-2007-0070 included an instantaneous maximum pH limitation of 8.2 which reflects a level consistently achievable by the Facility. The effluent pH exceeded 8.2 on one occasion on 25 September 2011. The Discharger indicated in the ROWD that for a 14-minute period on this date, the wastewater flow was so low that the backup buffering system was unable to deliver a small enough dose to maintain proper pH, resulting in the exceedance. Except for this occasion, the effluent pH was maintained between 6.8 and 8.0. Therefore, at the request of the Discharger, this Order establishes a more stringent instantaneous maximum pH limitation of 8.2.
- (d) Plant Performance and Attainability.** Except for one occasion on 25 September 2011, the effluent pH was maintained between 6.8 and 8.0. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

## ix. Salinity

- (a) WQO.** The Basin Plan contains a chemical constituent objective that incorporates state MCLs, contains a narrative objective, and contains numeric water quality objectives for certain specified water bodies for electrical conductivity, total dissolved solids, sulfate, and chloride. The USEPA Ambient Water Quality Criteria for Chloride recommends acute and chronic criteria for the protection of aquatic life. There are no USEPA water quality criteria for the protection of aquatic life for electrical conductivity, total dissolved solids, and sulfate. Additionally, there are no USEPA numeric water quality criteria for the protection of agricultural, livestock, and industrial uses. Numeric values for the protection of these uses are typically based on site specific conditions and evaluations to determine the appropriate constituent threshold necessary to interpret the narrative chemical constituent Basin Plan objective.

The Central Valley Water Board is currently implementing the CV-SALTS initiative to develop a Basin Plan Amendment that will establish a salt and nitrate Management Plan for the Central Valley. Through this effort the Basin Plan will be amended to define how the narrative water quality objective is to be interpreted for the protection of agricultural use. All studies conducted through this Order to establish an agricultural limit to implement the narrative objective will be reviewed by and consistent with the efforts currently underway by CV-SALTS.

**Table F-12. Salinity Water Quality Criteria/Objectives**

Parameter	Secondary MCL <sup>2</sup>	USEPA NAWQC	Effluent	
			Average	Maximum
Electrical Conductivity (µmhos/cm)	900, 1600, 2200	N/A	627 <sup>3</sup>	949
Total Dissolved Solids (mg/L)	500, 1000, 1500	N/A	363 <sup>3</sup>	713
Sulfate (mg/L)	250, 500, 600	N/A	41	65.3
Chloride (mg/L)	250, 500, 600	860 1-hr 230 4-day	65	124

<sup>1</sup> Narrative chemical constituent objective of the Basin Plan. Procedures for establishing the applicable numeric limitation to implement the narrative objective can be found in the Policy for Application of Water Quality, Chapter IV, Section 8 of the Basin Plan. However, the Basin Plan does not require improvement over naturally occurring background concentrations. In cases where the natural background concentration of a particular constituent exceeds an applicable water quality objective, the natural background concentration will be considered to comply with the objective.

<sup>2</sup> The Secondary MCLs are stated as a recommended level, upper level, and a short-term maximum level.

<sup>3</sup> Maximum calendar annual average.

**(1) Chloride.** The Secondary MCL for chloride is 250 mg/L, as a recommended level, 500 mg/L as an upper level, and 600 mg/L as a short-term maximum.

**(2) Electrical Conductivity.** The Secondary MCL for electrical conductivity is 900 µmhos/cm as a recommended level, 1600 µmhos/cm as an upper level, and 2200 µmhos/cm as a short-term maximum.

**(3) Sulfate.** The Secondary MCL for sulfate is 250 mg/L as a recommended level, 500 mg/L as an upper level, and 600 mg/L as a short-term maximum.

**(4) Total Dissolved Solids.** The Secondary MCL for total dissolved solids is 500 mg/L as a recommended level, 1000 mg/L as an upper level, and 1500 mg/L as a short-term maximum.

**(b) RPA Results**

**(1) Chloride.** Chloride concentrations in the effluent ranged from 0.6 mg/L to 124 mg/L, with an average of 65.3 mg/L based on 57 samples collected between September 2007 and May 2012. These levels do not exceed the Secondary MCL. Upstream receiving water data for chloride is not available.

**(2) Electrical Conductivity.** A review of the Discharger’s monitoring reports shows an average effluent electrical conductivity of 608 µmhos/cm, with a range from 288 µmhos/cm to 949 µmhos/cm based on 1,316 samples collected between September 2007 and May 2012. The highest monthly average occurred in November 2009 at 711 µmhos/cm. The highest annual average occurred in 2010 at 627 µmhos/cm, which does not exceed the Secondary MCL. The background receiving water electrical conductivity averaged

143  $\mu\text{mhos/cm}$  based on 267 samples collected between September 2007 and May 2012.

**(3) Sulfate.** Sulfate concentrations in the effluent ranged from 26.7 mg/L to 65.3 mg/L, with an average of 41 mg/L based on 54 samples collected between September 2007 and May 2012. These levels do not exceed the Secondary MCL. Upstream receiving water data for sulfate is not available.

**(4) Total Dissolved Solids.** The average total dissolved solids effluent concentration was 363 mg/L with concentrations ranging from 70 mg/L to 713 mg/L based on 60 samples collected between September 2007 and May 2012. A total of 4 out of 60 samples exceeded 450 mg/L and 1 sample exceeded 500 mg/L. The highest annual average occurred in 2010 at 417.6 mg/L, which does not exceed the Secondary MCL. The background receiving water total dissolved solids ranged from 48 mg/L to 81 mg/L, with an average of 59 mg/L based on three samples collected between September 2007 and May 2012.

**(c) WQBELs.** The Central Valley Water Board, with cooperation of the State Water Board, has begun the process to develop a new policy for the regulation of salinity in the Central Valley. In a statement issued at the 16 March 2006, Central Valley Water Board meeting, Board Member Dr. Karl Longley recommended that the Central Valley Water Board continue to exercise its authority to regulate discharges of salt to minimize salinity increases within the Central Valley. Dr. Longley stated, *“The process of developing new salinity control policies does not, therefore, mean that we should stop regulating salt discharges until a salinity Policy is developed. In the meantime, the Board should consider all possible interim approaches to continue controlling and regulating salts in a reasonable manner, and encourage all stakeholder groups that may be affected by the Regional Board’s policy to actively participate in policy development.”*

Based on the relatively low reported salinity, the discharge does not have reasonable potential to cause or contribute to an in-stream excursion of water quality objectives for salinity. However, since the Facility discharges to Miners Ravine, a tributary to the Sacramento River and eventually the Sacramento-San Joaquin Delta, of particular concern is the salt contribution to Delta waters. Allowing the Discharger to increase its current salt loading is contrary to the Region-wide efforts to address salinity in the Central Valley. Therefore, this Order retains an effluent limitation of 700  $\mu\text{mhos/cm}$  as a monthly average for electrical conductivity from Order R5-2007-0070.

The Discharger uses several chemicals in the treatment system which may increase the salinity of the effluent, including magnesium hydroxide, sodium hydroxide, sodium hypochlorite, and sodium bisulfite. In order to ensure that the Discharger will continue to control the discharge of salinity,

this Order includes a requirement to update and continue to implement a salinity evaluation and minimization plan, and water supply monitoring is required to evaluate the relative contribution of salinity from the source water to the effluent.

**(d) Plant Performance and Attainability.** Analysis of the effluent data shows that the average effluent electrical conductivity of 608 µmhos/cm and the highest annual average of 627 µmhos/cm are less than the applicable WQBEL for electrical conductivity of 700 µmhos/cm. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

**x. Total Trihalomethanes**

**(a) WQO.** DPH has adopted a Primary MCL for total trihalomethanes of 80 µg/L, which is protective of the Basin Plan’s chemical constituent objective. Total trihalomethanes include bromoform, chloroform, dibromochloromethane, and dichlorobromomethane.

**(b) RPA Results.** The Discharger monitored total trihalomethanes as well as the four individual constituents. The maximum effluent concentration reported by the laboratory for total trihalomethanes was 65.4 µg/L based on 44 samples collected between September 2007 and May 2012. However, chloroform concentration is often used as an indication of total trihalomethane concentration and the MEC for chloroform was 86 µg/L. Bromoform was not detected in the effluent based on 10 samples collected between September 2007 and May 2012 (MDL 0.1 µg/L, RL 0.5 µg/L). The MECs for dibromochloromethane and dichlorobromomethane were 7 µg/L and 21 µg/L, respectively. Additionally, three of the four CTR constituents (chloroform, dibromochloromethane, and dichlorobormomethane) had MECs greater than the individual criteria, and the MEC sum of the four CTR constituents was 114 µg/L, which is greater than the primary MCL for total THMs of 80 µg/L. Upstream receiving water data for total trihalomethanes and the individual constituents bromoform and chloroform is not available. Dibromochloromethane and dichlorobromomethane were not detected in the upstream receiving water based on one sample (MDL 0.1 µg/L, RL 0.5 µg/L). Therefore, based on the effluent samples, total trihalomethanes in the discharge has a reasonable potential to cause or contribute to an in-stream excursion above the Primary MCL.

**Table F-13. Total THMs**

Parameter	Units	Criterion Basis	Criterion Standard	MEC
Bromoform	µg/L	CTR	4.3	<0.5
Chloroform	µg/L	CTR	80	86
Dibromochloromethane	µg/L	CTR	0.41	7

Parameter	Units	Criterion Basis	Criterion Standard	MEC
Dichlorobromomethane	µg/L	CTR	0.56	21
Total THMs <sup>1</sup>	µg/L	Primary MCL	80	65.4 <sup>2</sup> 114 <sup>3</sup>

- 1 Total THMs is the additive total of bromoform, chloroform, dibromochloromethane, and dichlorobromomethane.
- 2 Maximum value for total THMs that was reported by the laboratory.
- 3 Total achieved by addition of the MECs of the four constituents; bromoform, chloroform, dibromochloromethane, and dichlorobromomethane

**(c) WQBELs.** This Order contains an AMEL for total trihalomethanes of 80 µg/L based on the Basin Plan’s narrative chemical constituents objective for protection of the MUN beneficial use.

**(d) Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC for chloroform of 86 mg/L is greater than the applicable WQBEL. Based on the sample results for the effluent, the limitation appears to put the Discharger in immediate non-compliance. New or modified control measures may be necessary in order to comply with the effluent limitation, and the new or modified control measures cannot be designed, installed and put into operation within 30 calendar days. Furthermore, the effluent limitation for total trihalomethanes is a new regulatory requirement within this permit, which becomes applicable to the waste discharge with the adoption of this Order, which was adopted after 1 July 2000. Therefore, a compliance time schedule for compliance with the total trihalomethanes effluent limitation is established in CDO No. R5-2013-0089 in accordance with Water Code section 13300, that requires preparation and implementation of a pollution prevention plan in compliance with Water Code section 13263.3.

**4. WQBEL Calculations**

**a.** This Order includes WQBELs for ammonia, BOD<sub>5</sub>, chlorine residual, copper, dibromochloromethane, dichlorobromomethane, electrical conductivity, nitrate plus nitrite, pH, total coliform organisms, total trihalomethanes, and TSS. The general methodology for calculating WQBELs based on the different criteria/objectives is described in subsections IV.C.4.b through e, below. See Attachment H for the WQBEL calculations.

**b. Effluent Concentration Allowance.** For each water quality criterion/objective, the ECA is calculated using the following steady-state mass balance equation from Section 1.4 of the SIP:

$$\begin{aligned}
 ECA &= C + D(C - B) && \text{where } C > B, \text{ and} \\
 ECA &= C && \text{where } C \leq B
 \end{aligned}$$

where:

- ECA = effluent concentration allowance
- D = dilution credit
- C = the priority pollutant criterion/objective
- B = the ambient background concentration.

According to the SIP, the ambient background concentration (B) in the equation above shall be the observed maximum with the exception that an ECA calculated from a priority pollutant criterion/objective that is intended to protect human health from carcinogenic effects shall use the arithmetic mean concentration of the ambient background samples. For ECAs based on MCLs, which implement the Basin Plan’s chemical constituents objective and are applied as annual averages, an arithmetic mean is also used for B due to the long-term basis of the criteria.

- c. Basin Plan Objectives and MCLs.** For WQBELs based on site-specific numeric Basin Plan objectives or MCLs, the effluent limitations are applied directly as the ECA as either an MDEL, AMEL, or average annual effluent limitations, depending on the averaging period of the objective.
- d. Aquatic Toxicity Criteria.** WQBELs based on acute and chronic aquatic toxicity criteria are calculated in accordance with Section 1.4 of the SIP. The ECAs are converted to equivalent long-term averages (i.e.,  $LTA_{acute}$  and  $LTA_{chronic}$ ) using statistical multipliers and the lowest LTA is used to calculate the AMEL and MDEL using additional statistical multipliers.
- e. Human Health Criteria.** WQBELs based on human health criteria, are also calculated in accordance with Section 1.4 of the SIP. The ECAs are set equal to the AMEL and a statistical multiplier was used to calculate the MDEL.

$$AMEL = mult_{AMEL} \left[ \min \left( \overbrace{M_A ECA_{acute}}^{LTA_{acute}}, M_C ECA_{chronic} \right) \right]$$

$$MDEL = mult_{MDEL} \left[ \min \left( M_A ECA_{acute}, \underbrace{M_C ECA_{chronic}}_{LTA_{chronic}} \right) \right]$$

$$MDEL_{HH} = \left( \frac{mult_{MDEL}}{mult_{AMEL}} \right) AMEL_{HH}$$

where:

- $mult_{AMEL}$  = statistical multiplier converting minimum LTA to AMEL
- $mult_{MDEL}$  = statistical multiplier converting minimum LTA to MDEL
- $M_A$  = statistical multiplier converting acute ECA to  $LTA_{acute}$
- $M_C$  = statistical multiplier converting chronic ECA to  $LTA_{chronic}$

**Summary of Water Quality-Based Effluent Limitations  
 Discharge Point No. 001**

**Table F-14. Summary of Water Quality-Based Effluent Limitations**

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
<b>Conventional Pollutants</b>						
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	10	15	25	--	--
	lbs/day <sup>1</sup>	25	38	63	--	--
pH	standard units	--	--	--	6.5	8.2
Total Suspended Solids	mg/L	10	15	25	--	--
	lbs/day <sup>1</sup>	25	38	63	--	--
<b>Priority Pollutants</b>						
Copper, Total Recoverable	µg/L	3.9	--	7.9	--	--
Dibromochloromethane	µg/L	0.41	--	0.98	--	--
Dichlorobromomethane	µg/L	0.56	--	1.1	--	--
<b>Non-Conventional Pollutants</b>						
Ammonia, Total (as N)	mg/L	1.2	--	3.8	--	--
	lbs/day	3.0	--	9.5	--	--
Chlorine, Total Residual	mg/L	--	0.011 <sup>2</sup>	0.019 <sup>3</sup>	--	--
Electrical Conductivity @ 25°C	µmhos/cm	700	--	--	--	--
Nitrate Plus Nitrite	mg/L	10	--	--	--	--
Total Coliform Organisms	MPN/100 mL	--	2.2 <sup>4</sup>	23 <sup>5</sup>	--	240
Total Trihalomethanes <sup>6</sup>	µg/L	80	--	--	--	--

<sup>1</sup> Mass-based effluent limitations are based on a permitted average dry weather flow of 0.30 MGD.

<sup>2</sup> Applied as a 4-day average effluent limitation.

<sup>3</sup> Applied as a 1-hour average effluent limitation.

<sup>4</sup> Applied as a 7-day median effluent limitation.

<sup>5</sup> Not to be exceeded more than once in any 30-day period.

<sup>6</sup> Applies to the sum of bromoform, chloroform, dibromochloromethane, and dichlorobromomethane.

**5. Whole Effluent Toxicity (WET)**

For compliance with the Basin Plan’s narrative toxicity objective, this Order requires the Discharger to conduct whole effluent toxicity testing for acute and chronic toxicity, as specified in the Monitoring and Reporting Program (Attachment E section V.). This Order also contains effluent limitations for acute toxicity and requires the Discharger to implement best management practices to investigate the causes of, and identify corrective actions to reduce or eliminate effluent toxicity.

**a. Acute Aquatic Toxicity.** The Basin Plan contains a narrative toxicity objective that states, “All waters shall be maintained free of toxic substances in

*concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.” (Basin Plan at page III-8.00) The Basin Plan also states that, “...effluent limits based upon acute biotoxicity tests of effluents will be prescribed where appropriate...”.*

For priority pollutants, the SIP dictates the procedures for conducting the RPA. Acute toxicity is not a priority pollutant. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Acute whole effluent toxicity is not a priority pollutant. Therefore, due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA. USEPA’s September 2010 NPDES Permit Writer’s Manual, page 6-30, states, “*State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBELs are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBELs for pathogens in all permits for POTWs discharging to contact recreational waters).*” Although the discharge has been consistently in compliance with the acute toxicity effluent limitations, the Facility is a POTW that treats domestic wastewater containing ammonia and other acutely toxic pollutants. Acute toxicity effluent limits are required to ensure compliance with the Basin Plan’s narrative toxicity objective.

USEPA Region 9 provided guidance for the development of acute toxicity effluent limitations in the absence of numeric water quality objectives for toxicity in its document titled "Guidance for NPDES Permit Issuance", dated February 1994. In section B.2. "Toxicity Requirements" (pgs. 14-15) it states that, "*In the absence of specific numeric water quality objectives for acute and chronic toxicity, the narrative criterion 'no toxics in toxic amounts' applies. Achievement of the narrative criterion, as applied herein, means that ambient waters shall not demonstrate for acute toxicity: 1) less than 90% survival, 50% of the time, based on the monthly median, or 2) less than 70% survival, 10% of the time, based on any monthly median. For chronic toxicity, ambient waters shall not demonstrate a test result of greater than 1 TUc.*" Consistent with Order R5-2007-0070, effluent limitations for acute toxicity have been included in this Order as follows:

**Acute Toxicity.** Survival of aquatic organisms in 96-hour bioassays of undiluted waste shall be no less than:

Minimum for any one bioassay-----	70%
Median for any three consecutive bioassays -----	90%

- b. Chronic Aquatic Toxicity.** The Basin Plan contains a narrative toxicity objective that states, “*All waters shall be maintained free of toxic substances in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.*” (Basin Plan at page III-8.00.) As shown in the table below, based on chronic WET testing performed by the Discharger from

September 2007 through May 2012, the discharge has reasonable potential to cause or contribute to an in-stream excursion above the Basin Plan’s narrative toxicity objective.

**Table F-15. Whole Effluent Chronic Toxicity Testing Results**

Date	Water Flea <i>Ceriodaphnia dubia</i>		Fathead Minnow <i>Pimephales promelas</i>		Green Algae <i>Selenastrum capricornutum</i>
	Survival (TUc)	Growth (TUc)	Survival (TUc)	Reproduction (TUc)	Growth (TUc)
7 August 2007	1.3	4	1	1	1
28 August 2007	1	4	1	1	1
14 January 2008	1	2	1	1	1
28 January 2008	1	1.3	--	--	1
19 February 2008	1	1	--	--	1
4 March 2008	1	1	--	--	1
7 October 2008	1	1.3	1	1	1
18 November 2008	--	8	--	--	--
2 December 2008	1	~8	--	--	--
26 January 2009	1	1	1	1	1
26 January 2009	1	2	--	--	--
16 February 2009	1	4	--	--	--
16 February 2009	1	8	--	--	--
3 March 2009	1	1.3	--	--	--
16 March 2009	1	1	--	--	--
30 March 2009	1	>2	--	--	--
10 April 2009	1	2	--	--	--
17 August 2009	1	>8	1	1	1
17 September 2009	1	>2	--	--	--
21 June 2010	1	4	1	1	1.3
2 August 2010	1	1.3	1	1	1
1 August 2011	1	2	1	1	1
13 December 2011	1	1	1	1	1
24 April 2012	1	1	1	1	1

No dilution has been granted for the chronic condition. Therefore, chronic toxicity testing results exceeding 1 chronic toxicity unit (TUc) demonstrates the discharge has a reasonable potential to cause or contribute to an exceedance of the Basin Plan’s narrative toxicity objective.

In response to observed effluent toxicity, the Discharger initiated a Toxicity Reduction Evaluation (TRE) in July 2009. The Discharger also completed two Toxicity Identification Evaluations (TIEs) in April 2009 and August 2009. The results of the TIEs were inconclusive. As part of the Discharger’s toxicity reduction efforts, the Discharger also completed a Facility Performance Review (FPR) study. The FPR study recommended minor changes to the operations and sampling protocol, but did not identify any specific treatment or operational issues as the source of the observed toxicity. Due to historical non-compliance

with effluent limitations for ammonia and nitrate, the Discharger deferred additional TRE efforts until planned nitrification/denitrification improvements could be completed. The Discharger installed a denitrifying sand filter in February 2011; however, the effluent continued to exhibit chronic toxicity in subsequent toxicity testing. The Discharger is currently planning a regionalization project that will include construction of sewer connections and a pumping station to connect to the City of Roseville's Dry Creek Wastewater Treatment Plant. Once the connection is made, the Facility will no longer be used for wastewater treatment and discharge to Miners Ravine will cease. Pursuant to CDO R5-2012-0005, the Discharger is required to initiate project construction by 30 April 2013. Because existing TRE/TIE efforts have not successfully addressed the effluent chronic toxicity and the Discharger is pursuing a regionalization project that will discontinue the effluent discharge, this Order includes a numeric monitoring trigger of 4 TUc effective unless the Discharger does not commence construction of the project as required by the existing CDO.

Numeric chronic WET effluent limitations have not been included in this Order. The SIP contains implementation gaps regarding the appropriate form and implementation of chronic toxicity limits. This has resulted in the petitioning of an NPDES permit in the Los Angeles Region<sup>1</sup> that contained numeric chronic toxicity effluent limitations. To address the petition, the State Water Board adopted WQO 2003-012 directing its staff to revise the toxicity control provisions in the SIP. The State Water Board states the following in WQO 2003-012, *"In reviewing this petition and receiving comments from numerous interested persons on the propriety of including numeric effluent limitations for chronic toxicity in NPDES permits for publicly-owned treatment works that discharge to inland waters, we have determined that this issue should be considered in a regulatory setting, in order to allow for full public discussion and deliberation. We intend to modify the SIP to specifically address the issue. We anticipate that review will occur within the next year. We therefore decline to make a determination here regarding the propriety of the final numeric effluent limitations for chronic toxicity contained in these permits."* The process to revise the SIP is currently underway. Proposed changes include clarifying the appropriate form of effluent toxicity limits in NPDES permits and general expansion and standardization of toxicity control implementation related to the NPDES permitting process. Since the toxicity control provisions in the SIP are under revision it is infeasible to develop numeric effluent limitations for chronic toxicity. Therefore, this Order requires that the Discharger meet best management practices for compliance with the Basin Plan's narrative toxicity objective, as allowed under 40 CFR 122.44(k).

---

<sup>1</sup> In the Matter of the Review of Own Motion of Waste Discharge Requirements Order Nos. R4-2002-0121 [NPDES No. CA0054011] and R4-2002-0123 [NPDES NO. CA0055119] and Time Schedule Order Nos. R4-2002-0122 and R4-2002-0124 for Los Coyotes and Long Beach Wastewater Reclamation Plants Issued by the California Regional Water Quality Control Board, Los Angeles Region SWRCB/OCC FILES A-1496 AND 1496(a)

To ensure compliance with the Basin Plan’s narrative toxicity objective, the Discharger is required to conduct chronic WET testing, as specified in the Monitoring and Reporting Program (Attachment E section V.). Furthermore, the Special Provision contained at VI.C.2.a of this Order requires the Discharger to investigate the causes of, and identify and implement corrective actions to reduce or eliminate effluent toxicity. If the discharge demonstrates toxicity exceeding the numeric toxicity monitoring trigger, the Discharger is required to initiate a TRE in accordance with an approved updated TRE workplan. The numeric toxicity monitoring trigger is not an effluent limitation; it is the toxicity threshold at which the Discharger is required to perform accelerated chronic toxicity monitoring, as well as, the threshold to initiate a TRE if effluent toxicity has been demonstrated.

## **D. Final Effluent Limitations**

### **1. Mass-based Effluent Limitations**

40 CFR 122.45(f)(1) requires effluent limitations be expressed in terms of mass, with some exceptions, and 40 CFR 122.45(f)(2) allows pollutants that are limited in terms of mass to additionally be limited in terms of other units of measurement. This Order includes effluent limitations expressed in terms of mass and concentration. In addition, pursuant to the exceptions to mass limitations provided in 40 CFR 122.45(f)(1), some effluent limitations are not expressed in terms of mass, such as pH and temperature, and when the applicable standards are expressed in terms of concentration (e.g., CTR criteria and MCLs) and mass limitations are not necessary to protect the beneficial uses of the receiving water.

Mass-based effluent limitations have been established in this Order for ammonia, BOD<sub>5</sub>, and TSS because they are oxygen demanding substances. Mass-based effluent limitations were calculated based upon the design flow (Average Dry Weather Flow) permitted in section IV.A.1.g of this Order.

Except for the pollutants listed above, mass-based effluent limitations are not included in this Order for pollutant parameters for which effluent limitations are based on water quality objectives and criteria that are concentration-based.

### **2. Averaging Periods for Effluent Limitations**

40 CFR 122.45 (d) requires average weekly and average monthly discharge limitations for publicly owned treatment works (POTWs) unless impracticable. However, for toxic pollutants and pollutant parameters in water quality permitting, USEPA recommends the use of a maximum daily effluent limitation in lieu of average weekly effluent limitations for two reasons. *“First, the basis for the 7-day average for POTWs derives from the secondary treatment requirements. This basis is not related to the need for assuring achievement of water quality standards. Second, a 7-day average, which could comprise up to seven or more daily samples, could average out peak toxic concentrations and therefore the discharge’s potential for causing acute toxic effects would be missed.”* (TSD, pg. 96) This Order uses

MDELs in lieu of average weekly effluent limitations for ammonia, copper, dibromochloromethane, and dichlorobromomethane as recommended by the TSD for the achievement of water quality standards and for the protection of the beneficial uses of the receiving stream. Furthermore, for BOD<sub>5</sub>, chlorine residual, pH, total coliform organisms, and TSS, weekly average effluent limitations have been replaced or supplemented with effluent limitations utilizing shorter averaging periods. The rationale for using shorter averaging periods for these constituents is discussed in section IV.C.3 of this Fact Sheet.

### 3. Satisfaction of Anti-Backsliding Requirements

The CWA specifies that a revised permit may not include effluent limitations that are less stringent than the previous permit unless a less stringent limitation is justified based on exceptions to the anti-backsliding provisions contained in CWA sections 402(o) or 303(d)(4), or, where applicable, 40 CFR 122.44(l).

The effluent limitations in this Order are at least as stringent as the effluent limitations in Order R5-2007-0070, with the exception of effluent limitations for aluminum, copper (mass), dibromochloromethane (mass), dichlorobromomethane (mass), electrical conductivity, iron, manganese, mercury, nitrate (mass), persistent chlorinated hydrocarbon pesticides, settleable solids, and turbidity. The effluent limitations for these pollutants are less stringent than those in Order R5-2007-0070. This relaxation of effluent limitations is consistent with the anti-backsliding requirements of the CWA and federal regulations.

**a. CWA section 402(o)(1) and 303(d)(4).** CWA section 402(o)(1) specifies that, in the case of effluent limitations established on the basis of CWA section 301(b)(1)(C) (i.e., WQBELs), a permit may not be renewed, reissued, or modified to contain effluent limitations which are less stringent than the comparable effluent limitations in the previous permit except in compliance with CWA section 303(d)(4). The effluent limitations for aluminum, copper (mass), dibromochloromethane (mass), dichlorobromomethane (mass), iron, manganese, mercury, nitrate (mass), persistent chlorinated hydrocarbon pesticides, and settleable solids established in Order R5-2007-0070 are WQBELs and may be relaxed if the requirements of CWA section 303(d)(4) are satisfied.

CWA section 303(d)(4) has two parts: paragraph (A) which applies to nonattainment waters and paragraph (B) which applies to attainment waters.

**i. Non-Attainment Waters.** For waters where standards are not attained, CWA section 304(d)(4)(A) specifies that any effluent limitation based on a Total Maximum Daily Load (TMDL) or other Waste Load Allocation (WLA) may be revised only if the cumulative effect of all such revised effluent limits based on such TMDLs or WLAs will assure the attainment of such water quality standards. Miners Ravine is on the 2010 303(d) list for dissolved oxygen, which means that Miners Ravine is a Non-Attainment Water for dissolved oxygen. A TMDL for dissolved oxygen in Miners Ravine is scheduled for development in the year 2021, thus it is not yet possible to calculate a WLA

for the Facility. This Order does not contain effluent limitations for dissolved oxygen but does contain a receiving water limit such that the Facility shall not cause the dissolved oxygen concentration to be reduced below 7 mg/L.

- ii. **Attainment Waters.** For attainment waters, CWA section 303(d)(4)(B) specifies that a limitation based on a water quality standard may be relaxed where the action is consistent with the antidegradation policy. The receiving water, Miners Ravine, is an attainment water for aluminum, copper, dibromochloromethane, dichlorobromomethane, iron, manganese, mercury, nitrate, persistent chlorinated hydrocarbon pesticides, or settleable solids. The removal or relaxation of WQBELs for these pollutants is consistent with the antidegradation provisions of 40 CFR 131.12 and State Water Board Resolution No. 68-16. Therefore, the modifications to these effluent limitations do not violate anti-backsliding requirements.

Order R5-2007-0070 established final mass-based effluent limitations for copper, dibromochloromethane, dichlorobromomethane, and nitrate. 40 CFR 122.45(f)(1)(ii) states that mass limitations are not required when applicable standards and limitations are expressed in terms of other units of measurement. The numerical effluent limitations for these pollutants established in this Order are based on water quality standards and objectives, which are expressed in terms of concentration. Pursuant to 40 CFR 122.25(f)(1)(ii), expressing the effluent limitations in terms of concentration is in accordance with Federal Regulations. Compliance with the concentration-based limits will ensure that significantly less mass of the pollutants is discharged to the receiving water. Discontinuing mass-based effluent limitations for these parameters is consistent with the antidegradation provisions of 40 CFR 131.12 and State Water Board Resolution 68-16. Any impact on existing water quality will be insignificant. Therefore, the modifications to these effluent limitations do not violate anti-backsliding requirements.

- b. **CWA section 402(o)(2).** CWA section 402(o)(2) provides several exceptions to the anti-backsliding regulations. CWA 402(o)(2)(B)(i) allows a renewed, reissued, or modified permit to contain a less stringent effluent limitation for a pollutant if information is available which was not available at the time of permit issuance (other than revised regulations, guidance, or test methods) and which would have justified the application of a less stringent effluent limitation at the time of permit issuance.

As described further in section IV.C.3.b of this Fact Sheet, updated information that was not available at the time Order R5-2007-0070 was issued indicates that aluminum, iron, manganese, mercury, persistent chlorinated hydrocarbon pesticides, and settleable solids do not exhibit reasonable potential to cause or contribute to an exceedance of water quality objectives in the receiving water. The updated information that supports the relaxation of effluent limitations for these constituents includes the following:

- i. **Aluminum.** Previous Order R5-2007-0070 contained effluent limitations for aluminum. The toxic effects of aluminum in surface waters within the Central Valley Region, including Miners Ravine, is less toxic (or less reactive) to aquatic species than demonstrated in the toxicity tests that USEPA used for the basis of establishing the chronic criterion of 87 µg/L. This new information, and review of the toxicity tests USEPA used to establish the chronic criterion, indicates that 87 µg/L is overly stringent and not applicable to Miners Ravine. See Fact Sheet section IV,C.3.b.i for additional discussion of aluminum.

Fifty effluent samples collected between September 2007 and May 2012 indicated a maximum effluent concentration of 116 µg/L. In the same period, the upstream receiving water aluminum concentration was not measured. Based on this effluent data, the discharge does not demonstrate reasonable potential to cause or contribute to an in-stream excursion above USEPA recommended acute criterion of 750 µg/L for protection of aquatic life, or above the Department of Public Health Secondary MCL of 200 µg/L for drinking water aesthetic conditions. Based on new data collected between September 2007 and May 2012, aluminum was not detected in the effluent above the applicable water quality criteria. Therefore, effluent limitations for aluminum are not contained in this Order. This is consistent with the federal anti-backsliding regulations, because the new data represents new information that was not available at the time the previous Order was adopted.

- ii. **Iron.** Previous Order R5-2007-0070 contained effluent limitations for iron. The Discharger collected forty-four samples for iron analysis between September 2007 and May 2012. The maximum effluent concentration was 92.4 µg/L and the average was 30.6 µg/L which are lower than the criterion of 300 µg/L. Therefore, iron in the discharge does not demonstrate reasonable potential to cause or contribute to an in-stream excursion above the secondary MCL. In the same period, the upstream receiving water aluminum concentration was not measured. Based on new data collected between September 2007 and May 2012, iron was not detected in the effluent above the applicable water quality criteria. Therefore, effluent limitations for iron are not contained in this Order. This is consistent with the federal anti-backsliding regulations, because the new data represents new information that was not available at the time the previous Order was adopted.

- iii. **Manganese.** Previous Order R5-2007-0070 contained effluent limitations for manganese. Fifty-four effluent samples were collected and analyzed for manganese between September 2007 and May 2012. The maximum effluent concentration was 50 µg/L and the average was 15.3 µg/L, which is well below the criterion. In the same period, no receiving water samples were collected. Based on new data collected between September 2007 and May 2012, manganese was not detected in the effluent above the applicable water quality criteria. Therefore, effluent limitations for manganese are not contained in this Order. This is consistent with the federal antibacksliding

regulations, because the new data represents new information that was not available at the time the previous Order was adopted.

- iv. Mercury.** Previous Order R5-2007-0070 contained a performance-based mass effluent limitation of 0.000606 lbs/month for mercury for the effluent discharged to the receiving water. This limitation was based on maintaining the mercury loading at the existing level until a total maximum daily load (TMDL) could be established and USEPA developed mercury standards that are protective of human health. There is no reasonable potential for mercury based on current criteria and 48 samples. No TMDL is proposed for Miners Ravine. Therefore, a performance based effluent limitation for mercury is not contained in this Order. This is consistent with the federal anti-backsliding regulations, because the new information was not available at the time the previous Order was adopted. The removal of the mercury performance-based effluent limits is consistent with the state and federal Antidegradation requirements.
- v. Persistent Chlorinated Hydrocarbon Pesticides.** Previous Order R5-2007-0070 contained effluent limitations for persistent chlorinated hydrocarbon pesticides as a group based on the Basin Plan objective of no detectable concentrations. The effluent limitation for persistent chlorinated hydrocarbon pesticides as a group is not included in this Order. Laboratory results for aldrin, alpha-BHC, beta-BHC, gamma-BHC, delta-BHC, chlordane, 4,4'-DDD, 4,4'-DDE, 4,4'-DDT, dieldrin, alpha-endosulfan, beta-endosulfan, endosulfan sulfate, endrin, endrin aldehyde, heptachlor, heptachlor epoxide, and toxaphene were reviewed to determine whether there was reasonable potential for the individual pesticides to exceed criteria. 4,4-DDE, 4,4-DDT, alpha-endosulfan, endosulfan sulfate, and endrin aldehyde were detected, but not quantified (DNQ) in an effluent sample collected 6 October 2010; however, several pesticides were also detected in the laboratory blank, indicating sample contamination for the 6 October 2010 sample. Excluding the 6 October 2010 sample results, effluent monitoring of the individual persistent chlorinated hydrocarbon pesticides resulted in no detected results for each individual persistent chlorinated hydrocarbon pesticide above the minimum MDLs and RLs based on 59 samples collected between September 2007 and May 2012. Therefore, this Order does not contain effluent limitations for the individual pesticides. Monitoring of the pesticides will continue along with the other Priority Pollutants. This is consistent with the federal antibacksliding regulations, because the new data represents new information that was not available at the time the previous Order was adopted.
- vi. Settleable Solids.** Previous Order R5-2007-0070 contained effluent limitations for settleable solids. New data collected between September 2007 and May 2012 indicates that the effluent has not exceeded the effluent limitations in Order R5-2007-0070. Therefore, settleable solids in the discharge does not demonstrate reasonable potential to cause or contribute to an in-stream excursion above the Basin Plan objective, and in accordance

with section 1.3 of the SIP, WQBEL's are not required for settleable solids. Therefore, the settleable solids effluent limits are not contained in this Order. This is consistent with the federal antibacksliding regulations, because the new data represents new information that was not available at the time the previous Order was adopted. The removal of settleable solids effluent limits is consistent with the state and federal Antidegradation requirements.

- c. Turbidity.** Order R5-2007-0070 contained effluent limitations for turbidity. The prior limitations were solely an operational check to ensure the treatment system was functioning properly and could meet the limits for solids and coliform. The prior effluent limitations were not intended to regulate turbidity in the receiving water. Rather, turbidity is an operational parameter to determine proper system functioning and not a WQBEL.

This Order contains operational turbidity specifications to be met in lieu of effluent limitations. The revised Order does not include effluent limitations for turbidity. However, the performance-based specification in this Order is an equivalent limit that is not less stringent, and therefore does not constitute backsliding.

The revised operational specifications for turbidity are the same as the effluent limitations in Order R5-2007-0070. These revisions are consistent with State regulations implementing recycled water requirements. The revision in the turbidity limitation is consistent with the antidegradation provisions of 40 CFR 131.12 and State Water Board Resolution 68-16 because this Order imposes equivalent or more stringent requirements than Order R5-2007-0070 and therefore does not allow degradation.

- d. Dibromochloromethane.** For dibromochloromethane, the MDEL has been changed from Order R5-2007-0070. However, the MDEL is not less stringent. In this case, the waste load allocations (WLA)<sup>1</sup> in this Order and the previous Order are identical. The WLA provides a definition of effluent quality that is necessary to meet the water quality standards of receiving water and is used to derive WQBELs that are used to enforce the WLA.

The TSD warns that, "*Direct use of a WLA as a permit limit creates a significant risk that the WLA will be enforced incorrectly, since effluent variability and the probability basis for the limit are not considered specifically.*" (TSD, p. 96) The SIP and TSD include identical procedures for calculating WQBELs that use the statistical variability of the effluent to convert the WLA to average monthly and maximum daily effluent limits.

The new effluent data used to calculate WQBELs for this Order has different statistical variability (i.e., coefficient of variation is different) than used in the previous Order. Changes in the coefficient of variation can result in small

---

<sup>1</sup> The WLA is equivalent to the ECA used in the SIP (Section 1.4) for WQBEL calculations.

changes to the effluent limits. However, the slight changes in effluent limits do not allow for an increase in the pollutants discharged. The TSD states, “*Since effluents are variable and permit limits are developed based on a low probability of exceedence, the permit limits should consider effluent variability and ensure that the requisite loading from the WLA is not exceeded under normal conditions. In effect then, the limits must “force” treatment plant performance, which, after considering acceptable effluent variability, will only have a low statistical probability of exceeding the WLA and will achieve the desired loadings.*” (TSD, p. 97) Therefore, although there are slight differences in the effluent limits, the WLA are identical, so the level of treatment needed to maintain compliance with the effluent limits remains the same. Consequently, the effluent limits are not less stringent than the previous Order, and there is no backsliding.

WQBELs for dibromochloromethane were calculated based on 64 effluent samples collected between September 2007 and May 2012. This dataset is representative of the Facility effluent and required monitoring frequency to meet the effluent limits in the previous permit. Therefore, Central Valley Water Board staff considers the this data to be the most representative and reliable dataset to use to determine current Facility performance and development of WQBELs.

The AMEL for dibromochloromethane in this Order is the same as in previous Order R5-2007-0070. However, the MDEL was calculated as a higher value. The WQBELs in both Orders are based on the same WLA (i.e., the WLA is based on the CTR human health criterion for dibromochloromethane). The reason for the change in the MDEL is due to a change in the variability of the effluent data for dibromochloromethane. The coefficient of variation for the recent effluent data is higher than for the data used in the previous Order. Using the procedures for calculating WQBELs in Section 1.4 of the SIP, for human health criteria, a higher coefficient of variation results in a less stringent MDEL. The WQBELs, however, are equally protective of the beneficial uses. The level of treatment needed to maintain compliance with the effluent limits remains the same. Consequently, the effluent limits are not less stringent than the previous permit, and there is no backsliding.

#### **4. Satisfaction of Antidegradation Policy**

This Order does not allow for an increase in flow or mass of pollutants to the receiving water. Therefore, a complete antidegradation analysis is not necessary. The Order requires compliance with applicable federal technology-based standards and with WQBELs where the discharge could have the reasonable potential to cause or contribute to an exceedance of water quality standards. The permitted discharge is consistent with the antidegradation provisions of 40 CFR 131.12 and State Water Board Resolution No. 68-16. Compliance with these requirements will result in the use of best practicable treatment or control of the discharge. The impact on existing water quality will be insignificant.

This Order removes existing effluent limitations for constituents in which updated monitoring data demonstrates that the effluent does not cause or contribute to an

exceedance of the applicable water quality criteria or objectives in the receiving water. The Central Valley Water Board finds that the removal of the effluent limitations does not result in an allowed increase in pollutants or any additional degradation of the receiving water. Thus, removal of effluent limitations is consistent with the antidegradation provisions of 40 CFR 131.12 and State Water Board Resolution No. 68-16.

**5. Stringency of Requirements for Individual Pollutants**

This Order contains both technology-based effluent limitations and WQBELs for individual pollutants. The technology-based effluent limitations consist of restrictions on flow and percent removal requirements for BOD<sub>5</sub> and TSS. The WQBELs consist of restrictions on ammonia, BOD<sub>5</sub>, chlorine residual, copper, dibromochloromethane, dichlorobromomethane, electrical conductivity, nitrate plus nitrite, pH, total coliform organisms, total trihalomethanes, and TSS. This Order’s technology-based pollutant restrictions implement the minimum, applicable federal technology-based requirements. In addition, this Order includes effluent limitations for BOD<sub>5</sub>, TSS, and total coliform organisms to meet numeric objectives or protect beneficial uses.

WQBELs have been scientifically derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable federal water quality standards. To the extent that toxic pollutant WQBELs were derived from the CTR, the CTR is the applicable standard pursuant to 40 CFR 131.38. The scientific procedures for calculating the individual WQBELs for priority pollutants are based on the CTR-SIP, which was approved by USEPA on 18 May 2000. All beneficial uses and water quality objectives contained in the Basin Plan were approved under state law and submitted to and approved by USEPA prior to 30 May 2000. Any water quality objectives and beneficial uses submitted to USEPA prior to 30 May 2000, but not approved by USEPA before that date, are nonetheless “applicable water quality standards for purposes of the CWA” pursuant to 40 CFR 131.21(c)(1). Collectively, this Order’s restrictions on individual pollutants are no more stringent than required to implement the requirements of the CWA.

**Summary of Final Effluent Limitations  
 Discharge Point No. 001**

**Table F-16. Summary of Final Effluent Limitations**

Parameter	Units	Effluent Limitations					Basis <sup>1</sup>
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum	
Flow	MGD	--	--	0.30 <sup>2</sup>	--	--	DC
<b>Conventional Pollutants</b>							
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	10	15	25	--	--	TTC
	lbs/day <sup>3</sup>	25	38	63	--	--	
	% Removal	85	--	--	--	--	CFR

Parameter	Units	Effluent Limitations					Basis <sup>1</sup>
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum	
pH	standard units	--	--	--	6.5	8.2	BP, PB
Total Suspended Solids	mg/L	10	15	25	--	--	TTC
	lbs/day <sup>3</sup>	25	38	63	--	--	
	% Removal	85	--	--	--	--	CFR
<b>Priority Pollutants</b>							
Copper, Total Recoverable	µg/L	3.9	--	7.9	--	--	CTR
Dibromochloromethane	µg/L	0.41	--	0.98	--	--	CTR
Dichlorobromomethane	µg/L	0.56	--	1.1	--	--	CTR
<b>Non-Conventional Pollutants</b>							
Ammonia Nitrogen, Total (as N)	mg/L	1.2	--	3.8	--	--	NAWQC
	lbs/day <sup>3</sup>	3.0	--	9.5	--	--	
Chlorine, Total Residual	mg/L	--	0.011 <sup>4</sup>	0.019 <sup>5</sup>	--	--	NAWQC
Electrical Conductivity @ 25°C	µmhos/cm	700	--	--	--	--	PO
Nitrate Plus Nitrite	mg/L	10	--	--	--	--	MCL
Total Coliform Organisms	MPN/100 mL	--	2.2 <sup>6</sup>	23 <sup>7</sup>	--	240	Title 22
Total Trihalomethanes <sup>8</sup>	µg/L	80	--	--	--	--	MCL
Acute Toxicity	% Survival	--	--	<sup>9</sup>	--	--	BP
Chronic Toxicity	TUc	--	--	<sup>10</sup>	--	--	BP

<sup>1</sup> DC – Based on the design capacity of the Facility.  
 TTC – Based on tertiary treatment capability. These effluent limitations reflect the capability of a properly operated tertiary treatment plant.  
 CFR – Based on secondary treatment standards contained in 40 CFR Part 133.  
 BP – Based on water quality objectives contained in the Basin Plan.  
 MCL – Based on the Primary Maximum Contaminant Level.  
 CTR – Based on water quality criteria contained in the California Toxics Rule and applied as specified in the SIP.  
 NAWQC – Based on USEPA's National Ambient Water Quality Criteria for the protection of freshwater aquatic life.  
 PO – Based on effluent limitations established in previous Order R5-2007-0070.  
 Title 22 – Based on CA Department of Public Health Reclamation Criteria, CCR, Division 4, Chapter 3 (Title 22).

<sup>2</sup> The average dry weather flow shall not exceed 0.30 MGD.  
<sup>3</sup> Based upon an average dry weather flow of 0.30 MGD.  
<sup>4</sup> Applied as a 4-day average effluent limitation.  
<sup>5</sup> Applied as a 1-hour average effluent limitation.  
<sup>6</sup> Applied as a 7-day median effluent limitation.  
<sup>7</sup> Not to be exceeded more than once in any 30-day period.  
<sup>8</sup> Applies to the sum of bromoform, chloroform, dibromochloromethane, and dichlorobromomethane.  
<sup>9</sup> Survival of aquatic organisms in 96-hour bioassays of undiluted waste shall be no less than:  
 Minimum for any one bioassay: 70%  
 Median for any three consecutive bioassays: 90%  
<sup>10</sup> There shall be no chronic toxicity in the effluent discharge.

**E. Interim Effluent Limitations – Not Applicable**

## **F. Land Discharge Specifications – Not Applicable**

## **G. Reclamation Specifications – Not Applicable**

## **V. RATIONALE FOR RECEIVING WATER LIMITATIONS**

Basin Plan water quality objectives to protect the beneficial uses of surface water and groundwater include numeric objectives and narrative objectives, including objectives for chemical constituents, toxicity, and tastes and odors. The toxicity objective requires that surface water and groundwater be maintained free of toxic substances in concentrations that produce detrimental physiological responses in humans, plants, animals, or aquatic life. The chemical constituent objective requires that surface water and groundwater shall not contain chemical constituents in concentrations that adversely affect any beneficial use or that exceed the maximum contaminant levels (MCLs) in Title 22, CCR. The tastes and odors objective states that surface water and groundwater shall not contain taste- or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses. The Basin Plan requires the application of the most stringent objective necessary to ensure that surface water and groundwater do not contain chemical constituents, toxic substances, radionuclides, or taste and odor producing substances in concentrations that adversely affect domestic drinking water supply, agricultural supply, or any other beneficial use.

### **A. Surface Water**

1. CWA section 303(a-c), requires states to adopt water quality standards, including criteria where they are necessary to protect beneficial uses. The Central Valley Water Board adopted water quality criteria as water quality objectives in the Basin Plan. The Basin Plan states that “[t]he numerical and narrative water quality objectives define the least stringent standards that the Regional Water Board will apply to regional waters in order to protect the beneficial uses.” The Basin Plan includes numeric and narrative water quality objectives for various beneficial uses and water bodies. This Order contains receiving surface water limitations based on the Basin Plan numerical and narrative water quality objectives for bacteria, biostimulatory substances, color, chemical constituents, dissolved oxygen, floating material, oil and grease, pH, pesticides, radioactivity, suspended sediment, settleable substances, suspended material, tastes and odors, temperature, toxicity, and turbidity.
  - a. **pH.** Order R5-2007-0070 established a receiving water limitation for pH specifying that discharges from the Facility shall not cause the ambient pH to change by more than 0.5 units based on the water quality objective for pH in the Basin Plan, and allowed a 1-month averaging period for calculating pH change. The Central Valley Water Board adopted Resolution No. R5-2007-0136 on 25 October 2007, amending the Basin Plan to delete the portion of the pH water quality objective that limits the change in pH to 0.5 units and the allowance of averaging periods for pH. The Basin Plan amendment has been approved by the State Water Board, the Office of Administrative Law, and USEPA. Consistent

with the revised water quality objective in the Basin Plan, this Order does not require a receiving water limitation for pH change.

In Finding 14 of Resolution No. R5-2007-0136, the Central Valley Water Board found that the change in the pH receiving water objective is consistent with the State Water Board Resolution No. 68-16, in that the changes to water quality objectives (i) consider maximum benefit to the people of the State, (ii) will not unreasonably affect present and anticipated beneficial use of waters, and (iii) will not result in water quality less than that prescribed in policies, and is consistent with the federal Antidegradation Policy (40 CFR 131.12).

Ammonia is the only constituent in the discharge regulated by this Order directly related to pH. The fixed ammonia effluent limitations in this Order are based on reasonable worst-case conditions. Although ammonia criteria are based on pH, and the pH receiving water limitations are more lenient in this Order than in the previous permit, the fixed ammonia limits are new limits, and are developed to protect under worst-case pH conditions. Therefore the relaxation of the pH receiving water limitation will protect aquatic life and other beneficial uses and will not unreasonably affect present and anticipated beneficial uses nor result in water quality less than described in applicable policies. The relaxation of the receiving water limitation is not expected to cause other impacts on water quality. The Central Valley Water Board finds that the relaxation of the pH receiving water limitation (i) is to the maximum benefit to the people of the State, (ii) will not unreasonably affect present and anticipated beneficial use of waters, and (iii) will not result in water quality less than that prescribed in policies, and is consistent with the federal Antidegradation Policy (40 CFR 131.12).

The revised receiving water limitation for pH, which is based on the amendment to the Basin Plan's pH water quality objective, reflects current scientifically supported pH requirements for the protection of aquatic life and other beneficial uses. The revised receiving water limitation for pH is more consistent with the current USEPA recommended criteria and is fully protective of aquatic life and the other beneficial uses listed in the Basin Plan. Changes in pH when pH is maintained within the range of 6.5 to 8.5 are neither beneficial nor adverse and, therefore, are not considered to be degradation in water quality. Attempting to restrict pH changes to 0.5 pH units would incur substantial costs without demonstrable benefits to beneficial uses. Thus, any changes in pH that would occur under the revised pH limitation would not only be protective of beneficial uses, but also would be consistent with maximum benefit to people of the State. Therefore the proposed amendment will not violate antidegradation policies.

- b. Turbidity.** Order R5-2007-0070 established a receiving water limitation for turbidity specifying that discharges from the Facility shall not cause the turbidity to increase more than 1 NTU where natural turbidity is between 0 and 5 NTU based on the water quality objective for turbidity in the Basin Plan. The Central Valley Water Board adopted Resolution R5-2007-0136 on 25 October 2007, amending the Basin Plan to limit turbidity to 2 NTU when the natural turbidity is less than 1 NTU. The Basin Plan amendment has been approved by the State

Water Board, the Office of Administrative Law, and USEPA. Consistent with the revised water quality objective in the Basin Plan, this Order limits turbidity to 2 NTU when the natural turbidity is less than 1 NTU.

In Finding 14 of Resolution R5-2007-0136 the Central Valley Water Board found that the change in the turbidity receiving water objective is consistent with the State Water Board Resolution No. 68-16, in that the changes to water quality objectives (i) consider maximum benefit to the people of the State, (ii) will not unreasonably affect present and anticipated beneficial use of waters, and (iii) will not result in water quality less than that prescribed in policies, and is consistent with the federal Antidegradation Policy (40 CFR 131.12).

This Order includes operational specifications that require the Discharger to operate the treatment system to insure that turbidity shall not exceed 2 NTU as a daily average, and 5 NTU more than 5 percent of the time within a 24 hour period, and 10 NTU, at any time. Because this Order limits the average daily discharge of turbidity to 2 NTU, the Order will be protective of the receiving water under all natural background conditions as defined in the Basin Plan's revised water quality objective for turbidity. The relaxation of the turbidity receiving water limitation will protect aquatic life and other beneficial uses and will not unreasonably affect present and anticipated beneficial uses nor result in water quality less than described in applicable policies. The relaxation of the receiving water limitation is not expected to cause other impacts on water quality. The Central Valley Water Board finds that the relaxation of the turbidity receiving water limitation is to the maximum benefit to the people of the State, (ii) will not unreasonably affect present and anticipated beneficial use of waters, and (iii) will not result in water quality less than that prescribed in policies, and is consistent with the federal Antidegradation Policy (40 CFR 131.12).

The revised receiving water limitation for turbidity, which is based on the amendment to the Basin Plan's turbidity water quality objective, reflects current scientifically supported turbidity requirements for the protection of aquatic life and other beneficial uses and, therefore, will be fully protective of aquatic life and the other beneficial uses listed in the Basin Plan. Changes in turbidity allowed by the revised receiving water limitation, when ambient turbidity is below 1 NTU, would not adversely affect beneficial uses and would maintain water quality at a level higher than necessary to protect beneficial uses. Restricting low-level turbidity changes further may require costly upgrades, which would not provide any additional protection of beneficial uses. Thus, any changes in turbidity that would occur under the amended turbidity receiving water limitation would not only be protective of beneficial uses, but also would be consistent with maximum benefit to people of the State. Therefore, the relaxed receiving water limitations for turbidity will not violate antidegradation policies.

## **B. Groundwater**

1. Release of waste constituents from any storage, treatment, or disposal component associated with the Facility, in combination with other sources, shall not cause the

underlying groundwater to contain waste constituents greater than background quality or Water Quality Objectives, whichever is greater.

## **VI. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS**

40 CFR 122.48 requires that all NPDES permits specify requirements for recording and reporting monitoring results. Water Code sections 13267 and 13383 authorize the Regional Water Boards to require technical and monitoring reports. The Monitoring and Reporting Program (Attachment E) of this Order, establishes monitoring and reporting requirements to implement federal and state requirements. The following provides the rationale for the monitoring and reporting requirements contained in the Monitoring and Reporting Program for the Facility.

### **A. Influent Monitoring**

1. Influent monitoring is required to collect data on the characteristics of the wastewater and to assess compliance with effluent limitations (e.g., BOD<sub>5</sub> and TSS reduction requirements). The monitoring frequencies for flow (continuous), BOD<sub>5</sub> (weekly), and TSS (weekly) have been retained from Order R5-2007-0070.

### **B. Effluent Monitoring**

1. Pursuant to the requirements of 40 CFR 122.44(i)(2) effluent monitoring is required for all constituents with effluent limitations. Effluent monitoring is necessary to assess compliance with effluent limitations, assess the effectiveness of the treatment process, and to assess the impacts of the discharge on the receiving stream and groundwater.
2. Effluent monitoring frequencies and sample types for flow (continuous), BOD<sub>5</sub> (weekly), pH (continuous), TSS (weekly), dibromochloromethane (monthly), dichlorobromomethane (monthly), chlorine residual (continuous), nitrate (monthly), and turbidity (continuous) have been retained from Order R5-2007-0070 to determine compliance with effluent limitations for these parameters, where applicable, and to characterize the effluent.
3. Order R5-2007-0070 required monitoring for ammonia, temperature, and total coliform organisms five times per week. Monitoring data collected over the term of Order R5-2007-0070 indicates that the effluent quality for these parameters is generally consistent and has low variability. Therefore, the Central Valley Water Board finds that a reduced monitoring frequency of three times per week will provide sufficient data to characterize the discharge and determine compliance with effluent limitations, where applicable.
4. Monitoring data collected over the term of Order R5-2007-0070 for aluminum, chloride, iron, manganese, mercury, methylmercury, oil and grease, persistent chlorinated hydrocarbon pesticides, settleable solids, and sulfate did not demonstrate reasonable potential to cause or contribute to an exceedance of water quality objectives/criteria. In addition, monthly monitoring for hardness in the effluent

and receiving water is not necessary to determine compliance with effluent limitations. Thus, specific monitoring requirements for these parameters have not been retained from Order R5-2007-0070, except as required by Attachment I.

5. Monitoring data collected over the term of Order R5-2007-0070 for total trihalomethanes indicates that the discharge has reasonable potential to cause or contribute to an exceedance of water quality objectives/criteria and effluent limitations have been established in this Order. Therefore, this Order establishes monthly monitoring for total trihalomethanes to determine compliance with the applicable effluent limitations.
6. This Order establishes an effluent limitation for nitrate plus nitrite. Therefore, monthly monitoring for nitrite is required, in addition to monthly monitoring for nitrate, to determine compliance with the applicable effluent limitation.
7. Order R5-2007-0070 established effluent limitations and monthly monitoring requirements for copper. Effluent limitations for copper are retained in this Order; however, because an adequate dataset was provided over the term of Order R5-2007-0070 (54 samples), this Order reduces the monitoring frequency from monthly to quarterly.
8. As discussed in section IV.C.3.c of this Fact Sheet, due to the limited amount of data available, it is uncertain whether benzene is truly present in the effluent at concentrations that have a reasonable potential to cause or contribute to an exceedance of applicable water quality criteria. To collect the data necessary to determine the prevalence in the effluent, this Order establishes bi-monthly monitoring for 1 year and requires the Discharger to conduct a constituent study to determine potential sources of benzene.
9. Miners Ravine is listed on the 303(d) list as impaired for dissolved oxygen. In order to characterize the dissolved oxygen concentration of the effluent and assess the impacts of the discharge on dissolved oxygen concentrations in Miners Ravine, this Order establishes monthly monitoring for dissolved oxygen.
10. Order R5-2007-0070 required monitoring for electrical conductivity five times per week and for total dissolved solids monthly. Monitoring data indicates that the discharge does not have reasonable potential to cause or contribute to an exceedance of water quality objectives for electrical conductivity or total dissolved solids. However, consistent with Order R5-2007-0070 and due to the concern for salt contributions to Delta waters, this Order includes an effluent limitation for electrical conductivity. The Central Valley Water Board finds that quarterly monitoring will provide sufficient data to determine compliance with the effluent limitation for electrical conductivity and characterize the effluent for salinity. Therefore, this Order reduces the monitoring frequency for electrical conductivity from five times per week to quarterly and for total dissolved solids from monthly to quarterly.
11. Priority pollutant data for the effluent has been provided by the Discharger and was used to conduct an RPA. In accordance with Section 1.3 of the SIP, periodic

monitoring for priority pollutants for which criteria or objectives apply and for which no effluent limitations have been established is required. This Order requires monitoring quarterly during the third or fourth year of the permit term in order to collect data to conduct an RPA for the next permit renewal. See Attachment I for more detailed requirements related to performing priority pollutant monitoring.

12. California Water Code section 13176, subdivision (a), states: “*The analysis of any material required by [Water Code sections 13000-16104] shall be performed by a laboratory that has accreditation or certification to Article 3 (commencing with Section 100825) of Chapter 4 of Part 1 of Division 101 of the Health and Safety Code.*” DPH certifies laboratories through its Environmental Laboratory Accreditation Program (ELAP).

Section 13176 cannot be interpreted in a manner that would violate federal holding time requirements that apply to NPDES permits pursuant to the Clean Water Act. (Wat. Code §§ 13370, subd. (c), 13372, 13377.) Section 13176 is inapplicable to NPDES permits to the extent it is inconsistent with Clean Water Act requirements. (Wat. Code § 13372, subd. (a).) The holding time requirements are 15 minutes for chlorine residual, dissolved oxygen, and pH and immediate analysis is required for temperature. (40 C.F.R. § 136.3(e), Table II) Due to the location of the Facility, it is both legally and factually impossible for the Discharger to comply with section 13176 for constituents with short holding times.

### C. Whole Effluent Toxicity Testing Requirements

1. **Acute Toxicity.** Consistent with Order R5-2007-0070, semi-annual 96-hour bioassay testing is required to demonstrate compliance with the effluent limitation for acute toxicity.
2. **Chronic Toxicity.** Consistent with Order R5-2007-0070, semi-annual chronic whole effluent toxicity testing is required in order to demonstrate compliance with the Basin Plan’s narrative toxicity objective.

### D. Receiving Water Monitoring

#### 1. Surface Water

- a. Receiving water monitoring is necessary to assess compliance with receiving water limitations and to assess the impacts of the discharge on the receiving stream.
- b. Receiving water monitoring frequencies and sample types for pH (weekly), dissolved oxygen (weekly), electrical conductivity (weekly), fecal coliform organisms (quarterly), turbidity (weekly), and temperature (weekly) have been retained from Order R5-2007-0070.

- c. Monitoring requirements for radionuclides and hardness have not been retained from Order R5-2007-0070 as they are not necessary to determine compliance with permit requirements.
- d. This Order establishes daily receiving water monitoring for flow to calculate the receiving water to effluent dilution ratio to determine compliance with Special Provisions VI.C.4.a, VI.C.6.a and VI.C.7.a.
- e. Priority pollutant data for the receiving water has not been provided by the Discharger. In accordance with Section 1.3 of the SIP, periodic monitoring for priority pollutants for which criteria or objectives apply and for which no effluent limitations have been established. This Order requires monitoring for priority pollutants and other pollutants of concern quarterly during the third or fourth year of the permit term, concurrent with effluent monitoring, in order to collect data to conduct an RPA for the next permit renewal. See Attachment I for more detailed requirements related to performing priority pollutant monitoring.

## **2. Groundwater – Not Applicable**

### **E. Other Monitoring Requirements**

#### **1. Biosolids Monitoring**

Biosolids monitoring is required to ensure compliance with the biosolids disposal requirements contained in the Special Provision contained in section VI.C.6.a of this Order. Biosolids disposal requirements are imposed pursuant to 40 CFR Part 503 to protect public health and prevent groundwater degradation.

#### **2. Water Supply Monitoring**

Water supply monitoring is required to evaluate the source of constituents in the wastewater. Consistent with Order R5-2007-0070, this Order retains annual monitoring for total dissolved solids and electrical conductivity. Water supply monitoring for standard minerals has not been retained as it is unnecessary to evaluate the contribution of salinity to the Facility given the total dissolved solids and electrical conductivity monitoring.

#### **3. Effluent and Receiving Water Characterization Study**

An effluent and receiving water monitoring study is required to ensure adequate information is available for the next permit renewal. During the third or fourth year of this permit term, the Discharger is required to conduct quarterly monitoring of the effluent at Monitoring Location EFF-001 and of the receiving water at Monitoring Location RSW-001 for all priority pollutants and other constituents of concern as described in Attachment I.

## VII. RATIONALE FOR PROVISIONS

### A. Standard Provisions

Standard Provisions, which apply to all NPDES permits in accordance with 40 CFR 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 CFR 122.42, are provided in Attachment D. The Discharger must comply with all standard provisions and with those additional conditions that are applicable under 40 CFR 122.42.

40 CFR 122.41(a)(1) and (b) through (n) establish conditions that apply to all State-issued NPDES permits. These conditions must be incorporated into the permits either expressly or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. 40 CFR 123.25(a)(12) allows the state to omit or modify conditions to impose more stringent requirements. In accordance with 40 CFR 123.25, this Order omits federal conditions that address enforcement authority specified in 40 CFR 122.41(j)(5) and (k)(2) because the enforcement authority under the Water Code is more stringent. In lieu of these conditions, this Order incorporates by reference Water Code section 13387(e).

### B. Special Provisions

#### 1. Reopener Provisions

- a. **Whole Effluent Toxicity.** This Order requires the Discharger to investigate the causes of, and identify corrective actions to reduce or eliminate effluent toxicity through a TRE. This Order may be reopened to include a numeric chronic toxicity limitation, a new acute toxicity limitation, and/or a limitation for a specific toxicant identified in the TRE. Additionally, if a numeric chronic toxicity water quality objective is adopted by the State Water Board, this Order may be reopened to include a numeric chronic toxicity limitation based on that objective.
- b. **Water Effects Ratio (WER) and Metal Translators.** A default WER of 1.0 has been used in this Order for calculating criteria for applicable inorganic constituents. In addition, default dissolved-to-total metal translators have been used to convert water quality objectives from dissolved to total recoverable when developing effluent limitations for copper. If the Discharger performs studies to determine site-specific WERs and/or site-specific dissolved-to-total metal translators, this Order may be reopened to modify the effluent limitations for the applicable inorganic constituents.
- c. **Benzene Study.** There are indications that the discharge may contain benzene in concentrations that have a reasonable potential to cause or contribute to an exceedance of water quality objectives. This Order requires the Discharger to complete a study to determine the presence of benzene in the effluent. This reopener provision allows the Central Valley Water Board to reopen this Order for addition of effluent limitations and requirements for benzene if after review of

the study results it is determined that the discharge has reasonable potential to cause or contribute to an exceedance of a water quality objective.

## 2. Special Studies and Additional Monitoring Requirements

- a. **Chronic Whole Effluent Toxicity Requirements.** The Basin Plan contains a narrative toxicity objective that states, “*All waters shall be maintained free of toxic substances in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.*” (Basin Plan at page III-8.00.) Based on whole effluent chronic toxicity testing performed by the Discharger from September 2007 through May 2012, the discharge has reasonable potential to cause or contribute to an in-stream excursion above of the Basin Plan’s narrative toxicity objective. In response to observed effluent toxicity, the Discharger initiated a TRE in July 2009. The Discharger also completed two TIEs in April 2009 and August 2009. The results of the TIEs were inconclusive. As part of the Discharger’s toxicity reduction efforts, the Discharger also completed an FPR study. The FPR study recommended minor changes to the operations and sampling protocol, but did not identify any specific treatment or operational issues as the source of the observed toxicity. Due to historical non-compliance with effluent limitations for ammonia and nitrate, the Discharger deferred additional TRE efforts until planned nitrification/denitrification improvements could be completed. The Discharger installed a denitrifying sand filter in February 2011; however, the effluent continued to exhibit chronic toxicity in subsequent toxicity testing.

This provision requires the Discharger to develop a TRE Workplan in accordance with USEPA guidance. In addition, the provision provides a numeric toxicity monitoring trigger and requirements for accelerated monitoring, as well as, requirements for TRE initiation if toxicity has been demonstrated.

**Monitoring Trigger.** The Discharger is currently planning a regionalization project that will include construction of sewer connections and a pumping station to connect to the City of Roseville’s Dry Creek Wastewater Treatment Plant. Once the connection is made, the Facility will no longer be used for wastewater treatment and discharge to Miners Ravine will cease. Pursuant to CDO R5-2012-0005, the Discharger is required to initiate project construction by 30 April 2013. Because existing TRE/TIE efforts have not successfully addressed the effluent chronic toxicity and the Discharger is pursuing a regionalization project that will discontinue the effluent discharge, this Order includes a numeric monitoring trigger of 4 TUc (where TUc = 100/NOEC) effective unless the Discharger does not commence construction of the project as required by the existing CDO. Therefore, a TRE is triggered when the effluent exhibits toxicity at 25% effluent. If the Discharger fails to begin construction on the proposed regionalization project by 30 October 2013, then the numeric toxicity monitoring trigger of > 1 TUc becomes effective as of 30 October 2013.

**Accelerated Monitoring.** The provision requires accelerated WET testing when a regular WET test result exceeds the monitoring trigger. The purpose of

accelerated monitoring is to determine, in an expedient manner, whether there is toxicity before requiring the implementation of a TRE. Due to possible seasonality of the toxicity, the accelerated monitoring should be performed in a timely manner, preferably taking no more than 2 to 3 months to complete.

The provision requires accelerated monitoring consisting of four chronic toxicity tests in a six-week period (i.e., one test every two weeks) using the species that exhibited toxicity. Guidance regarding accelerated monitoring and TRE initiation is provided in the *Technical Support Document for Water Quality-based Toxics Control*, EPA/505/2-90-001, March 1991 (TSD). The TSD at page 118 states, “EPA recommends if toxicity is repeatedly or periodically present at levels above effluent limits more than 20 percent of the time, a TRE should be required.” Therefore, four accelerated monitoring tests are required in this provision. If no toxicity is demonstrated in the four accelerated tests, then it demonstrates that toxicity is not present at levels above the monitoring trigger more than 20 percent of the time (only 1 of 5 tests are toxic, including the initial test). However, notwithstanding the accelerated monitoring results, if there is adequate evidence of effluent toxicity (i.e. toxicity present exceeding the monitoring trigger more than 20 percent of the time), the Executive Officer may require that the Discharger initiate a TRE.


See the WET Accelerated Monitoring Flow Chart (Figure F-1), below, for further clarification of the accelerated monitoring requirements and for the decision points for determining the need for TRE initiation.

**TRE Guidance.** The Discharger is required to prepare a TRE Workplan in accordance with USEPA guidance. Numerous guidance documents are available, as identified below:

- Toxicity Reduction Evaluation Guidance for Municipal Wastewater Treatment Plants, EPA/833-B-99/002, August 1999.
- Generalized Methodology for Conducting Industrial Toxicity Reduction Evaluations (TREs), EPA/600/2-88/070, April 1989.
- Methods for Aquatic Toxicity Identification Evaluations: Phase I Toxicity Characterization Procedures, Second Edition, EPA 600/6-91/003, February 1991.
- Toxicity Identification Evaluation: Characterization of Chronically Toxic Effluents, Phase I, EPA/600/6-91/005F, May 1992.
- Methods for Aquatic Toxicity Identification Evaluations: Phase II Toxicity Identification Procedures for Samples Exhibiting Acute and Chronic Toxicity, Second Edition, EPA/600/R-92/080, September 1993.

- Methods for Aquatic Toxicity Identification Evaluations: Phase III Toxicity Confirmation Procedures for Samples Exhibiting Acute and Chronic Toxicity, Second Edition, EPA 600/R-92/081, September 1993.
- Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms, Fifth Edition, EPA-821-R-02-012, October 2002.
- Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA-821-R-02-013, October 2002.
- Technical Support Document for Water Quality-based Toxics Control, EPA/505/2-90-001, March 1991.

**Figure F-1  
 WET Accelerated Monitoring Flow Chart**

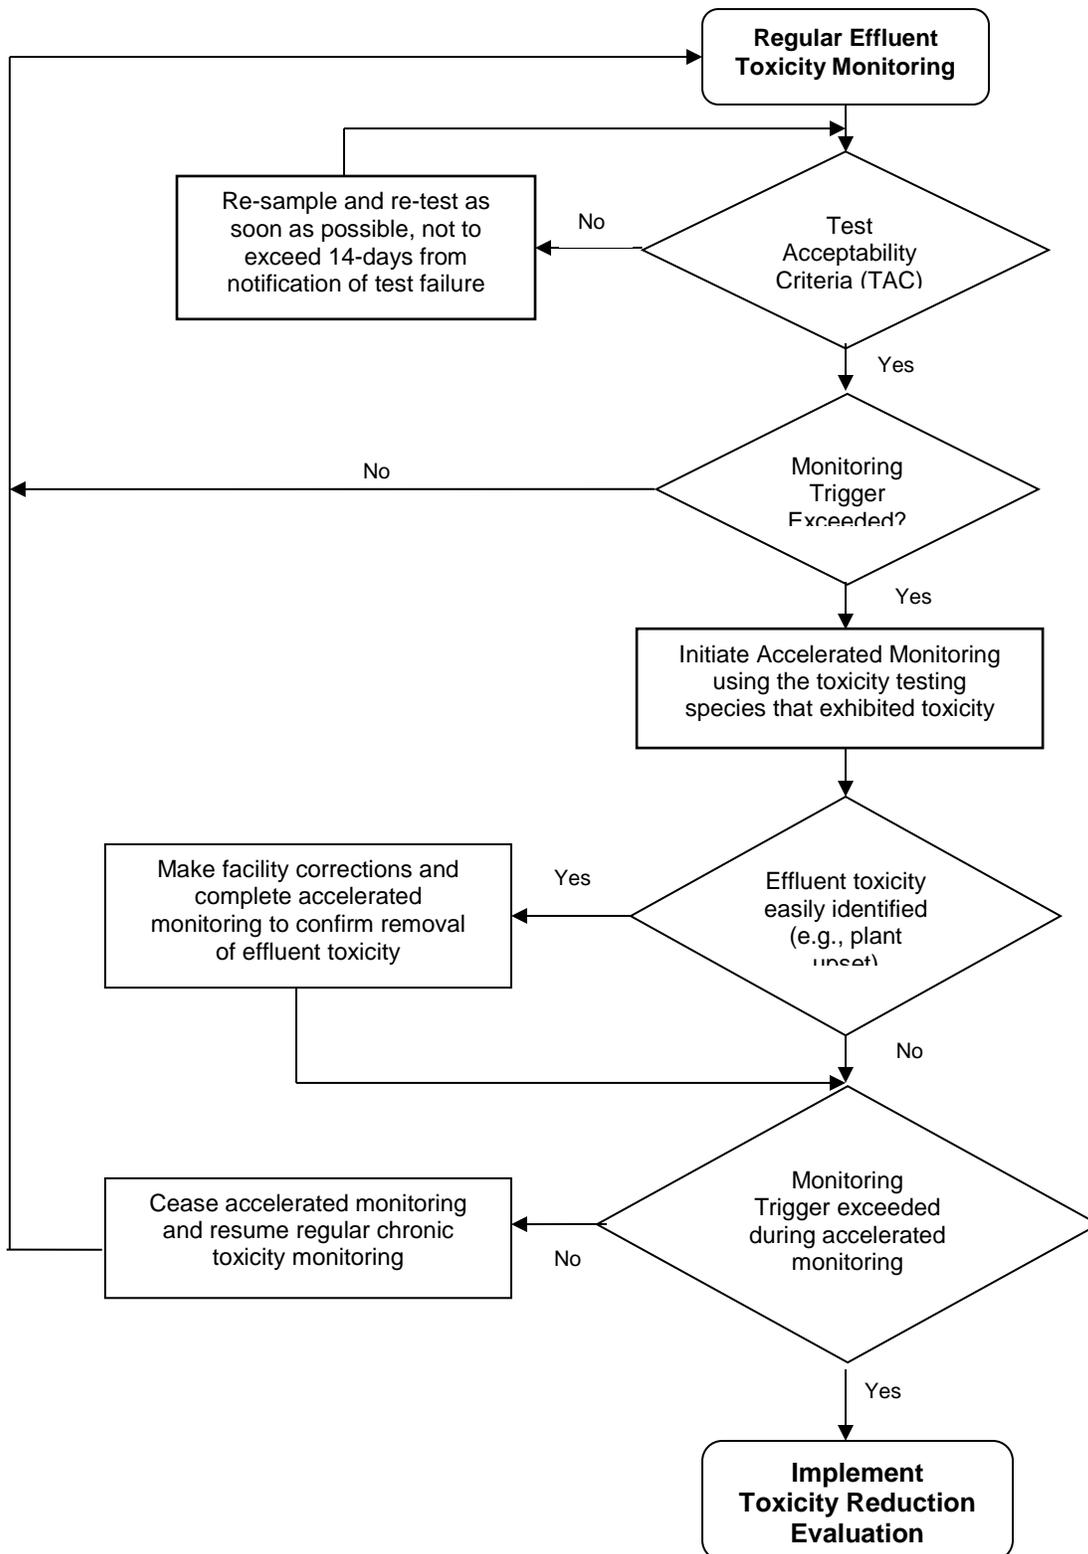

- b. Benzene Study.** There are indications that the discharge may contain benzene at concentrations that have a reasonable potential to cause or contribute to an exceedance of water quality objectives, as described further in section IV.C.3.c of this Fact Sheet. This Order requires the Discharger to complete a study to determine the presence of benzene in the effluent. If after a review of the study results it is determined that the discharge has reasonable potential to cause or contribute to an exceedance of a water quality objective, this Order may be reopened and effluent limitations added for benzene.

### **3. Best Management Practices and Pollution Prevention**

- a. Salinity Evaluation and Minimization Plan.** An Evaluation and Minimization Plan for salinity is required in this Order to ensure adequate measures are developed and implemented by the Discharger to reduce the discharge of salinity to Miners Ravine.

### **4. Construction, Operation, and Maintenance Specifications**

- a. Turbidity Operational Requirements.** Turbidity is included as an operational specification as an indicator of the effectiveness of the treatment process and to assure compliance with effluent limitations for total coliform organisms. The tertiary treatment process utilized at this Facility is capable of reliably meeting a turbidity limitation of 2 NTU as a daily average. Failure of the treatment system such that virus removal is impaired would normally result in increased particles in the effluent, which result in higher effluent turbidity. Turbidity has a major advantage for monitoring filter performance, allowing immediate detection of filter failure and rapid corrective action. The operational specification requires that turbidity shall not exceed 2 NTU as a daily average; 5 NTU, more than 5 percent of the time within a 24-hour period, and an instantaneous maximum of 10 NTU. Turbidity specifications are included as operating criteria in section VI.C.4.a of this Order to ensure that adequate disinfection of wastewater is achieved.
- b.** Consistent with Order R5-2007-0070, this Order requires that the treatment facilities be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.

### **5. Special Provisions for Municipal Facilities (POTWs Only)**

- a. Collection System.** The State Water Board issued General Waste Discharge Requirements for Sanitary Sewer Systems, Water Quality Order No. 2006-0003-DWQ (General Order) on 2 May 2006. The General Order requires public agencies that own or operate sanitary sewer systems with greater than one mile of pipes or sewer lines to enroll for coverage under the General Order. The General Order requires agencies to develop sanitary sewer management plans (SSMPs) and report all sanitary sewer overflows (SSOs), among other requirements and prohibitions.

Furthermore, the General Order contains requirements for operation and maintenance of collection systems and for reporting and mitigating sanitary sewer overflows. Inasmuch that the Discharger's collection system is part of the system that is subject to this Order, certain standard provisions are applicable as specified in Provisions, section VI.C.5. For instance, the 24-hour reporting requirements in this Order are not included in the General Order. The Discharger must comply with both the General Order and this Order. The Discharger and public agencies that are discharging wastewater into the facility were required to obtain enrollment for regulation under the General Order by 1 December 2006.

- b. Continuous Monitoring Systems.** This Order, and the Monitoring and Reporting Program which is part of this Order, requires that certain parameters be monitored on a continuous basis. The Facility is not staffed 24 hours a day. Permit violations or system upsets can go undetected during the time when there is no staff on-site. The Discharger is required to establish an electronic system for operator notification based on continuous recording device alarms. For any future Facility upgrades, the Discharger shall upgrade the continuous monitoring and notification system simultaneously.

## 6. Other Special Provisions

- a.** Consistent with Order R5-2007-0070, this Order requires wastewater to be oxidized, coagulated, filtered, and adequately disinfected pursuant to DPH reclamation criteria, CCR, Title 22, division 4, chapter 3 (Title 22), or equivalent.

## 7. Compliance Schedules

- a. Title 22, or Equivalent, Requirements.** Order No. R5-2007-0070 required a Title 22, or equivalent, level of treatment for flows when less than 20:1 dilution was available, but did not require a Title 22, or equivalent, level of treatment when greater than 20:1 dilution was available. This Order requires that all wastewater discharged to Miners Ravine be oxidized, coagulated, filtered, and adequately disinfected pursuant to DPH reclamation criteria, Title 22 CCR, Division 4, Chapter 3, (Title 22), or equivalent. The Facility is not designed to provide full tertiary treatment for wet weather flows exceeding 0.5 MGD, and discharges a blend of secondary and tertiary wastewater under those conditions. In order to provide the time necessary for the Discharger to complete the necessary upgrades, a compliance schedule has been included in this Order. The compliance schedule allows the Discharger until 1 January 2015 to complete the necessary upgrades and come into compliance with Title 22, or equivalent, requirements. This Order also requires compliance with the operational specifications for turbidity by 1 January 2015.

## VIII. PUBLIC PARTICIPATION

The Central Valley Water Board is considering the issuance of WDRs that will serve as an NPDES permit for the Facility. As a step in the WDR adoption process, the Central Valley

Water Board staff has developed tentative WDRs. The Central Valley Water Board encourages public participation in the WDR adoption process.

#### **A. Notification of Interested Parties**

The Central Valley Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Notification was provided through the following: Posting of the Notice of Public Hearing at the public entrance to the Facility, the post office nearest the facility, and the nearest city hall or county courthouse.

#### **B. Written Comments**

The staff determinations are tentative. Interested persons are invited to submit written comments concerning these tentative WDRs. Comments must be submitted either in person or by mail to the Executive Office at the Central Valley Water Board at the address above on the cover page of this Order.

To be fully responded to by staff and considered by the Central Valley Water Board, written comments must be received at the Central Valley Water Board offices by 5:00 p.m. on **22 April 2013**.

#### **C. Public Hearing**

The Central Valley Water Board will hold a public hearing on the tentative WDRs during its regular Board meeting on the following date and time and at the following location:

Date: **31 May 2013**  
Time: 8:30 a.m.  
Location: Regional Water Quality Control Board, Central Valley Region  
11020 Sun Center Dr., Suite #200  
Rancho Cordova, CA 95670

Interested persons are invited to attend. At the public hearing, the Central Valley Water Board will hear testimony, if any, pertinent to the discharge, WDRs, and permit. Oral testimony will be heard; however, for accuracy of the record, important testimony should be in writing.

Please be aware that dates and venues may change. Our Web address is [www.waterboards.ca.gov/centralvalley](http://www.waterboards.ca.gov/centralvalley) where you can access the current agenda for changes in dates and locations.

#### **D. Waste Discharge Requirements Petitions**

Any aggrieved person may petition the State Water Board to review the decision of the Central Valley Water Board regarding the final WDRs. The petition must be received by

the State Water Board within 30 days of the Central Valley Water Board's action, and must be submitted to the following address:

State Water Resources Control Board  
Office of Chief Counsel  
P.O. Box 100, 1001 I Street  
Sacramento, CA 95812-0100

#### **E. Information and Copying**

The Report of Waste Discharge, related documents, tentative effluent limitations and special provisions, comments received, and other information are on file and may be inspected at the address above at any time between 8:30 a.m. and 4:45 p.m., Monday through Friday. Copying of documents may be arranged through the Central Valley Water Board by calling (916) 464-3291.

#### **F. Register of Interested Persons**

Any person interested in being placed on the mailing list for information regarding the WDRs and NPDES permit should contact the Central Valley Water Board, reference this Facility, and provide a name, address, and phone number.

#### **G. Additional Information**

Requests for additional information or questions regarding this order should be directed to Elizabeth Thayer at (916) 464-4671.

**ATTACHMENT G – SUMMARY OF REASONABLE POTENTIAL ANALYSIS FOR CONSTITUENTS OF CONCERN**

Constituent	Units	MEC	B	C	CMC	CCC	Water & Org	Org. Only	Basin Plan	MCL	Reasonable Potential
Aluminum, Total Recoverable	µg/L	42 <sup>1</sup>	--	200	750 <sup>2</sup>	--	--	--	--	200	No
Ammonia Nitrogen, Total (as N)	mg/L	11.2	--	2.52	3.83 <sup>2</sup>	2.52 <sup>3</sup>	--	--	--	--	Yes
Arsenic, Total Recoverable	µg/L	13.5	--	10	340	150	--	--	--	10	Inconclusive
Benzene	µg/L	4.6	--	1.0	--	--	1.2	71	--	1.0	Inconclusive
Chloride	mg/L	124	--	106 <sup>4</sup>	860	230	--	--	--	250	No
Chloroform	µg/L	86	--	80 <sup>5</sup>	--	--	--	--	--	80 <sup>5</sup>	Yes
Copper, Total Recoverable	µg/L	6.9	--	5.5 <sup>6</sup> /1.9 <sup>7</sup>	7.9 <sup>6</sup> /2.5 <sup>7</sup>	5.5 <sup>6</sup> /1.9 <sup>7</sup>	1,300	--	--	1,000	Yes
4,4-DDE	µg/L	<0.001 <sup>8</sup>	--	ND	--	--	0.00059	0.00059	ND	--	No
4,4-DDT	µg/L	<0.001 <sup>8</sup>	--	ND	1.1	0.001	0.00059	0.00059	ND	--	No
Dibromochloromethane	µg/L	7	<0.5	0.41	--	--	0.41	34	--	80 <sup>5</sup>	Yes
Dichlorobromomethane	µg/L	21	<0.5	0.56	--	--	0.56	46	--	80 <sup>5</sup>	Yes
Electrical Conductivity @ 25°C	µmhos/cm	949	780	700 <sup>4</sup>	--	--	--	--	--	900	No
alpha-Endosulfan	µg/L	<0.001 <sup>8</sup>	--	ND	0.22	0.056	110	240	ND	--	No
Endosulfan Sulfate	µg/L	<0.001 <sup>8</sup>	--	ND	--	--	110	240	ND	--	No
Endrin Aldehyde	µg/L	<0.002 <sup>8</sup>	--	ND	--	--	0.76	0.81	ND	--	No
Iron, Total Recoverable	µg/L	45 <sup>1</sup>	--	300	--	--	--	--	--	300	No
Manganese, Total Recoverable	µg/L	27 <sup>1</sup>	--	50	--	--	--	--	--	50	No
Mercury, Total Recoverable	µg/L	0.00493	--	0.050	--	--	0.050	0.051	--	--	No
Nitrate Nitrogen, Total (as N)	mg/L	8.1 <sup>9</sup>	0.26	10	--	--	--	--	--	10	Yes
Nitrite Nitrogen, Total (as N)	mg/L	0.18	0.18	1.0	--	--	--	--	--	1.0	Yes
Sulfate	mg/L	65.3	--	250	--	--	--	--	--	250	No
Total Dissolved Solids	mg/L	713	81	450 <sup>4</sup>	--	--	--	--	--	500	No

Constituent	Units	MEC	B	C	CMC	CCC	Water & Org	Org. Only	Basin Plan	MCL	Reasonable Potential
-------------	-------	-----	---	---	-----	-----	-------------	-----------	------------	-----	----------------------

General Note: All inorganic concentrations are given as a total recoverable.  
 MEC = Maximum Effluent Concentration  
 B = Maximum Receiving Water Concentration or lowest detection level, if non-detect  
 C = Criterion used for Reasonable Potential Analysis  
 CMC = Criterion Maximum Concentration (CTR or NTR)  
 CCC = Criterion Continuous Concentration (CTR or NTR)  
 Water & Org = Human Health Criterion for Consumption of Water & Organisms (CTR or NTR)  
 Org. Only = Human Health Criterion for Consumption of Organisms Only (CTR or NTR)  
 Basin Plan = Numeric Site-specific Basin Plan Water Quality Objective  
 MCL = Drinking Water Standards Maximum Contaminant Level  
 NA = Not Available  
 ND = Non-detect

Footnotes:  
 (1) Represents the maximum observed annual average concentration for comparison with the Secondary MCL.  
 (2) USEPA National Recommended Ambient Water Quality Criteria, Freshwater Aquatic Life Protection, 1-hour Average.  
 (3) USEPA National Recommended Ambient Water Quality Criteria, Freshwater Aquatic Life Protection, 30-day Average.  
 (4) Agricultural Water Goal.  
 (5) Represents the Primary MCL for total trihalomethanes, which includes bromoform, chloroform, dibromochloromethane, and dichlorobromomethane.  
 (6) Criterion to be compared to the maximum effluent concentration.  
 (7) Criterion to be compared to the maximum upstream receiving water concentration.  
 (8) See Section IV.C.3.b of the Fact Sheet.  
 (9) Represents monitoring data collected since the Discharger installed a denitrifying sand filter in February 2011.

**ATTACHMENT H – CALCULATION OF WQBELS**

Parameter	Units	Most Stringent Criteria			HH Calculations <sup>1</sup>			Aquatic Life Calculations <sup>1</sup>											Final Effluent Limitations	
		HH	CMC	CCC	ECA <sub>HH</sub> = AMEL <sub>HH</sub>	AMEL/MDEL Multiplier <sub>HH</sub>	MDEL <sub>HH</sub>	ECA <sub>acute</sub>	ECA Multiplier <sub>acute</sub>	LTA <sub>acute</sub>	ECA <sub>chronic</sub>	ECA Multiplier <sub>chronic</sub>	LTA <sub>chronic</sub>	Lowest LTA	AMEL Multiplier <sub>95</sub>	AMEL <sub>AL</sub>	MDEL Multiplier <sub>99</sub>	MDEL <sub>AL</sub>	Lowest AMEL	Lowest MDEL
Ammonia Nitrogen, Total (as N)	mg/L	--	3.83	2.52	--	--	--	3.83	0.1	0.38	2.52	0.39	0.98	0.38	3.11	1.2	9.94	3.8	1.2	3.8
Copper, Total Recoverable	µg/L	1,000	7.9	5.5	1,000	2.02	2,020	7.9	0.32	2.5	5.5	0.52	2.88	2.5	1.56	3.9	3.15	7.9	3.9	7.9
Dibromochloromethane	µg/L	0.41	--	--	0.41	2.40	0.98	--	--	--	--	--	--	--	--	--	--	--	0.41	0.98
Dichlorobromomethane	µg/L	0.56	--	--	0.56	2.00	1.1	--	--	--	--	--	--	--	--	--	--	--	0.56	1.1

<sup>1</sup> As described in section IV.C.2.c of the Fact Sheet (Attachment F), calculation of effluent limitations for the protection of human health and aquatic life are determined without the allowance of dilution credits.

## ATTACHMENT I – EFFLUENT AND RECEIVING WATER CHARACTERIZATION STUDY

- I. Background.** Sections 2.4.1 through 2.4.4 of the SIP provide minimum standards for analyses and reporting. (Copies of the SIP may be obtained from the State Water Resources Control Board, or downloaded from <http://www.waterboards.ca.gov/iswp/index.html>). To implement the SIP, effluent and receiving water data are needed for all priority pollutants. Effluent and receiving water pH and hardness are required to evaluate the toxicity of certain priority pollutants (such as heavy metals) where the toxicity of the constituents varies with pH and/or hardness. Section 3 of the SIP prescribes mandatory monitoring of dioxin congeners. In addition to specific requirements of the SIP, the Central Valley Water Board is requiring the following monitoring:
- A. Drinking water constituents.** Constituents for which drinking water Maximum Contaminant Levels (MCLs) have been prescribed in the California Code of Regulation are included in the *Water Quality Control Plan, Fourth Edition, for the Sacramento and San Joaquin River Basins* (Basin Plan). The Basin Plan defines virtually all surface waters within the Central Valley Region as having existing or potential beneficial uses for municipal and domestic supply. The Basin Plan further requires that, at a minimum, water designated for use as domestic or municipal supply shall not contain concentrations of chemical constituents in excess of the MCLs contained in the California Code of Regulations.
  - B. Effluent and receiving water temperature.** This is both a concern for application of certain temperature-sensitive constituents, such as fluoride, and for compliance with the Basin Plan's thermal discharge requirements.
  - C. Effluent and receiving water hardness and pH.** These are necessary because several of the CTR constituents are hardness and pH dependent.
- II. Monitoring Requirements.**
- A. Monitoring.** Priority pollutant samples shall be collected from the effluent and upstream receiving water (Monitoring Locations EFF-001 and RSW-001) and analyzed for the constituents listed in Table I-1. Quarterly monitoring shall be conducted for 1 year (four consecutive samples, evenly distributed throughout the year) during the third year following the effective date of this Order and the results of such monitoring shall be submitted to the Central Valley Water Board in the SMR following the final sampling event. Each individual monitoring event shall provide representative sample results for the effluent and upstream receiving water.
  - B. Concurrent Sampling.** Effluent and receiving water sampling shall be performed at approximately the same time, on the same date.
  - C. Sample type.** All effluent samples shall be taken as 24-hour flow proportioned composite samples. All receiving water samples shall be taken as grab samples.

**D. Additional Monitoring/Reporting Requirements.** The Discharger shall conduct the monitoring and reporting in accordance with the General Monitoring Provisions and Reporting Requirements in Attachment E.

**Table I-1. Priority Pollutants and Other Constituents of Concern**

CTR #	Constituent	CAS Number	Maximum Reporting Level <sup>1</sup> µg/L or noted
28	1,1-Dichloroethane	75343	1
30	1,1-Dichloroethene	75354	0.5
41	1,1,1-Trichloroethane	71556	2
42	1,1,2-Trichloroethane	79005	0.5
37	1,1,2,2-Tetrachloroethane	79345	0.5
75	1,2-Dichlorobenzene	95501	2
29	1,2-Dichloroethane	107062	0.5
	cis-1,2-Dichloroethene	156592	
31	1,2-Dichloropropane	78875	0.5
101	1,2,4-Trichlorobenzene	120821	1
76	1,3-Dichlorobenzene	541731	2
32	1,3-Dichloropropene	542756	0.5
77	1,4-Dichlorobenzene	106467	2
17	Acrolein	107028	2
18	Acrylonitrile	107131	2
19	Benzene	71432	0.5
20	Bromoform	75252	2
34	Bromomethane	74839	2
21	Carbon tetrachloride	56235	0.5
22	Chlorobenzene (mono chlorobenzene)	108907	2
24	Chloroethane	75003	2
25	2- Chloroethyl vinyl ether	110758	1
26	Chloroform	67663	2
35	Chloromethane	74873	2
23	Dibromochloromethane	124481	0.5
27	Dichlorobromomethane	75274	0.5
36	Dichloromethane	75092	2
33	Ethylbenzene	100414	2
88	Hexachlorobenzene	118741	1

<sup>1</sup> The reporting levels required in these tables for priority pollutant constituents are established based on Section 2.4.2 and Appendix 4 of the SIP.

CTR #	Constituent	CAS Number	Maximum Reporting Level <sup>1</sup> µg/L or noted
89	Hexachlorobutadiene	87683	1
91	Hexachloroethane	67721	1
94	Naphthalene	91203	10
38	Tetrachloroethene	127184	0.5
39	Toluene	108883	2
40	trans-1,2-Dichloroethylene	156605	1
43	Trichloroethene	79016	2
44	Vinyl chloride	75014	0.5
	Methyl-tert-butyl ether (MTBE)	1634044	
	Trichlorofluoromethane	75694	
	1,1,2-Trichloro-1,2,2-Trifluoroethane	76131	
	Styrene	100425	
	Xylenes	1330207	
60	1,2-Benzanthracene	56553	5
85	1,2-Diphenylhydrazine	122667	1
45	2-Chlorophenol	95578	5
46	2,4-Dichlorophenol	120832	5
47	2,4-Dimethylphenol	105679	2
49	2,4-Dinitrophenol	51285	5
82	2,4-Dinitrotoluene	121142	5
55	2,4,6-Trichlorophenol	88062	10
83	2,6-Dinitrotoluene	606202	5
50	2-Nitrophenol	25154557	10
71	2-Chloronaphthalene	91587	10
78	3,3'-Dichlorobenzidine	91941	5
62	3,4-Benzofluoranthene	205992	10
52	4-Chloro-3-methylphenol	59507	5
48	4,6-Dinitro-2-methylphenol	534521	10
51	4-Nitrophenol	100027	10
69	4-Bromophenyl phenyl ether	101553	10
72	4-Chlorophenyl phenyl ether	7005723	5
56	Acenaphthene	83329	1
57	Acenaphthylene	208968	10
58	Anthracene	120127	10
59	Benzidine	92875	5
61	Benzo(a)pyrene (3,4-Benzopyrene)	50328	2

CTR #	Constituent	CAS Number	Maximum Reporting Level <sup>1</sup> µg/L or noted
63	Benzo(g,h,i)perylene	191242	5
64	Benzo(k)fluoranthene	207089	2
65	Bis(2-chloroethoxy) methane	111911	5
66	Bis(2-chloroethyl) ether	111444	1
67	Bis(2-chloroisopropyl) ether	39638329	10
68	Bis(2-ethylhexyl) phthalate	117817	5
70	Butyl benzyl phthalate	85687	10
73	Chrysene	218019	5
81	Di-n-butylphthalate	84742	10
84	Di-n-octylphthalate	117840	10
74	Dibenzo(a,h)-anthracene	53703	0.1
79	Diethyl phthalate	84662	10
80	Dimethyl phthalate	131113	10
86	Fluoranthene	206440	10
87	Fluorene	86737	10
90	Hexachlorocyclopentadiene	77474	5
92	Indeno(1,2,3-c,d)pyrene	193395	0.05
93	Isophorone	78591	1
98	N-Nitrosodiphenylamine	86306	1
96	N-Nitrosodimethylamine	62759	5
97	N-Nitrosodi-n-propylamine	621647	5
95	Nitrobenzene	98953	10
53	Pentachlorophenol	87865	1
99	Phenanthrene	85018	5
54	Phenol	108952	1
100	Pyrene	129000	10
	Aluminum	7429905	50
1	Antimony	7440360	5
2	Arsenic	7440382	10
15	Asbestos	1332214	
	Barium	7440393	
3	Beryllium	7440417	2
4	Cadmium	7440439	0.5
5a	Chromium (III)	7440473	50
5b	Chromium (VI)	18540299	10
6	Copper	7440508	0.5

CTR #	Constituent	CAS Number	Maximum Reporting Level <sup>1</sup> µg/L or noted
14	Cyanide	57125	5
	Fluoride	7782414	
	Iron	7439896	
7	Lead	7439921	0.5
8	Mercury	7439976	0.5
	Manganese	7439965	
	Molybdenum	7439987	
9	Nickel	7440020	5
10	Selenium	7782492	5
11	Silver	7440224	0.25
12	Thallium	7440280	1
	Tributyltin	688733	
13	Zinc	7440666	20
110	4,4'-DDD	72548	0.05
109	4,4'-DDE	72559	0.05
108	4,4'-DDT	50293	0.01
112	alpha-Endosulfan	959988	0.02
103	alpha-Hexachlorocyclohexane (BHC)	319846	0.01
	Alachlor	15972608	
102	Aldrin	309002	0.005
113	beta-Endosulfan	33213659	0.01
104	beta-Hexachlorocyclohexane	319857	0.005
107	Chlordane	57749	0.1
106	delta-Hexachlorocyclohexane	319868	0.005
111	Dieldrin	60571	0.01
114	Endosulfan sulfate	1031078	0.05
115	Endrin	72208	0.01
116	Endrin Aldehyde	7421934	0.01
117	Heptachlor	76448	0.01
118	Heptachlor Epoxide	1024573	0.01
105	Lindane (gamma-Hexachlorocyclohexane)	58899	0.02
119	PCB-1016	12674112	0.5
120	PCB-1221	11104282	0.5
121	PCB-1232	11141165	0.5
122	PCB-1242	53469219	0.5
123	PCB-1248	12672296	0.5

CTR #	Constituent	CAS Number	Maximum Reporting Level <sup>1</sup> µg/L or noted
124	PCB-1254	11097691	0.5
125	PCB-1260	11096825	0.5
126	Toxaphene	8001352	0.5
	Atrazine	1912249	
	Bentazon	25057890	
	Carbofuran	1563662	
	2,4-D	94757	
	Dalapon	75990	
	1,2-Dibromo-3-chloropropane (DBCP)	96128	
	Di(2-ethylhexyl)adipate	103231	
	Dinoseb	88857	
	Diquat	85007	
	Endothal	145733	
	Ethylene Dibromide	106934	
	Glyphosate	1071836	
	Methoxychlor	72435	
	Molinate (Ordram)	2212671	
	Oxamyl	23135220	
	Picloram	1918021	
	Simazine (Princep)	122349	
	Thiobencarb	28249776	
	2,4,5-TP (Silvex)	93765	
	Diazinon	333415	
	Chlorpyrifos	2921882	
	Ammonia (as N)	7664417	
	Chloride	16887006	
	Flow		
	Hardness (as CaCO <sub>3</sub> )		
	Foaming Agents (MBAS)		
	Mercury, Methyl	22967926	
	Nitrate (as N)	14797558	2,000
	Nitrite (as N)	14797650	400
	pH		0.1
	Phosphorus, Total (as P)	7723140	
	Specific conductance (EC)		
	Sulfate		500

<b>CTR #</b>	<b>Constituent</b>	<b>CAS Number</b>	<b>Maximum Reporting Level<sup>1</sup> µg/L or noted</b>
	Sulfide (as S)		
	Sulfite (as SO <sub>3</sub> )		
	Temperature		
	Total Dissolved Solids (TDS)		