

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION**

364 Knollcrest Drive, Suite #205, Redding, California 96002
Phone (530) 224-4845 • Fax (530) 224-4857
<http://www.waterboards.ca.gov/centralvalley>

ORDER R5-2016-XXXX

NPDES NO. CA0077747

**WASTE DISCHARGE REQUIREMENTS
FOR THE CHESTER PUBLIC UTILITY DISTRICT
CHESTER WASTEWATER TREATMENT PLANT
PLUMAS COUNTY**

The following Discharger is subject to the waste discharge requirements (WDR's) set forth in this Order:

Table 1. Discharger Information

Discharger	Chester Public Utility District
Name of Facility	Chester Wastewater Treatment Plant
Facility Address	881 First Avenue Chester, CA, 96020

Table 2. Discharge Location

Discharge Point	Effluent Description	Discharge Point Latitude (North)	Discharge Point Longitude (West)	Receiving Water
001	Secondary Treated Disinfected Municipal Wastewater	40.30164°	-121.22486°	Lake Almanor
002	Secondary Treated Disinfected Municipal Wastewater	40.30164°	-121.22486°	Discharge to Wetland Ponds

Table 3. Administrative Information

This Order was adopted on:	<XX February 2016>
This Order shall become effective on:	<Effective Date>
This Order shall expire on:	<Expiration Date>
The Discharger shall file a Report of Waste Discharge as an application for reissuance of WDR's in accordance with title 23, California Code of Regulations, and an application for reissuance of a National Pollutant Discharge Elimination System (NPDES) permit no later than:	<u>180 days prior to the Order expiration date</u>
The U.S. Environmental Protection Agency (U.S. EPA) and the California Regional Water Quality Control Board, Central Valley Region have classified this discharge as follows:	Minor

I, Pamela Creedon, Executive Officer, do hereby certify that this Order with all attachments is a full, true, and correct copy of the Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on **XX February 2016**.

PAMELA C. CREEDON, Executive Officer

CONTENTS

I. Facility Information 3
II. Findings 3
III. Discharge Prohibitions 4
IV. Effluent Limitations and Discharge Specifications 4
 A. Effluent Limitations – Discharge Point No. D-001 4
 1. Final Effluent Limitations – Discharge Point No. D-001 4
 2. Interim Effluent Limitations 5
 B. Land Discharge Specifications – Not Applicable 6
 C. Recycling Specifications – Not Applicable 6
V. Receiving Water Limitations 6
 A. Surface Water Limitations 6
 B. Groundwater Limitations 8
VI. Provisions 8
 A. Standard Provisions 8
 B. Monitoring and Reporting Program (MRP) Requirements 11
 C. Special Provisions 12
 1. Reopener Provisions 12
 2. Special Studies, Technical Reports and Additional Monitoring Requirements 13
 3. Best Management Practices and Pollution Prevention 15
 4. Construction, Operation and Maintenance Specifications 16
 5. Special Provisions for Municipal Facilities (POTW's Only) 17
 6. Other Special Provisions – Not Applicable 19
 7. Compliance Schedules 19
VII. Compliance Determination 20

TABLES

Table 1. Discharger Information 1
Table 2. Discharge Location 1
Table 3. Administrative Information 1
Table 4. Effluent Limitations 5
Table 5. Interim Effluent Limitations 6

ATTACHMENTS

Attachment A – Definitions A-1
Attachment B – Map B-1
Attachment C – Flow Schematic C-1
Attachment D – Standard Provisions D-1
Attachment E – Monitoring and Reporting Program E-1
Attachment F – Fact Sheet F-1
Attachment G – Summary Of Reasonable Potential Analysis G-1
Attachment H – Calculation of WQBEL'S H-1

I. FACILITY INFORMATION

Information describing the Chester Wastewater Treatment Plant (Facility) is summarized in Table 1 and in sections I and II of the Fact Sheet (Attachment F). Section I of the Fact Sheet also includes information regarding the Facility's permit application.

II. FINDINGS

The California Regional Water Quality Control Board, Central Valley Region (hereinafter Central Valley Water Board), finds:

- A. Legal Authorities.** This Order serves as WDR's pursuant to article 4, chapter 4, division 7 of the California Water Code (commencing with section 13260). This Order is also issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. EPA and chapter 5.5, division 7 of the Water Code (commencing with section 13370). It shall serve as an NPDES permit for point source discharges from this facility to surface waters.
- B. Background and Rationale for Requirements.** The Central Valley Water Board developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and other available information. The Fact Sheet (Attachment F), which contains background information and rationale for the requirements in this Order, is hereby incorporated into and constitutes Findings for this Order. Attachments A through E are also incorporated into this Order.
- C. Provisions and Requirements Implementing State Law.** The provisions/requirements in subsections IV.B, IV.C, and V.B are included to implement state law only. These provisions/requirements are not required or authorized under the federal CWA; consequently, violations of these provisions/requirements are not subject to the enforcement remedies that are available for NPDES violations.
- D. Monitoring and Reporting.** 40 CFR 122.48 requires that all NPDES permits specify requirements for recording and reporting monitoring results. Water Code sections 13267 and 13383 authorize the Central Valley Water Board to require technical and monitoring reports. The Monitoring and Reporting Program establishes monitoring and reporting requirements to implement federal and State requirements. The Monitoring and Reporting Program is provided in Attachment E.

The technical and monitoring reports in this Order are required in accordance with Water Code section 13267, which states the following in subsection (b)(1), *"In conducting an investigation specified in subdivision (a), the regional board may require that any person who has discharged, discharges, or is suspected of having discharged discharging, or who proposes to discharge waste within its region, or any citizen or domiciliary, or political agency or entity of this state who has discharged, discharges, or is suspected of having discharged or discharging, or who proposes to discharge, waste outside of its region could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the regional board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, the regional board shall provide the person with a written explanation with regard to the need for the reports, and shall identify the evidence that supports requiring that person to provide the reports."*

The Discharger owns and operates the Facility subject to this Order. The monitoring reports required by this Order are necessary to determine compliance with this Order. The need for the monitoring reports is discussed in the Fact Sheet.

- E. Notification of Interested Parties.** The Central Valley Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe WDR's for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of the notification are provided in the Fact Sheet.
- F. Consideration of Public Comment.** The Central Valley Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet.

THEREFORE, IT IS HEREBY ORDERED that Order No. R5-2009-0078 is rescinded upon the effective date of this Order except for enforcement purposes, and, in order to meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the CWA and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements in this Order. This action in no way prevents the Central Valley Water Board from taking enforcement action for past violations of the previous Order.

III. DISCHARGE PROHIBITIONS

- A.** Discharge of wastewater from the Facility that is different from the description in section II.B of the Fact Sheet in this Order is prohibited.
- B.** The by-pass or overflow of wastes to surface waters is prohibited, except as allowed by Federal Standard Provisions I.G. and I.H. (Attachment D).
- C.** Neither the discharge nor its treatment shall create a nuisance as defined in section 13050 of the Water Code.
- D.** The Discharger shall not allow pollutant-free wastewater to be discharged into the treatment or disposal system in amounts that significantly diminish the system's capability to comply with this Order. Pollutant-free wastewater means rainfall, groundwater, cooling waters, and condensates that are essentially free of pollutants.
- E.** Discharge from any wetland pond to Lake Almanor is prohibited.
- F.** Discharge of secondary treated disinfected municipal wastewater to Lake Almanor from 1 June through 30 September is prohibited.

IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

A. Effluent Limitations – Discharge Point No. D-001

1. Final Effluent Limitations – Discharge Point No. D-001

The Discharger shall maintain compliance with the following effluent limitations at Discharge Point No. D-001, with compliance measured at Monitoring Location EFF-001 as described in the Monitoring and Reporting Program, Attachment E:

- a. The Discharger shall maintain compliance with effluent limitations specified in Table 4:

Table 4. Effluent Limitations

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Conventional Pollutants						
Biochemical Oxygen Demand (5-day at 20°C)	mg/L	30	45	90	--	--
	lbs/day	130	190	380	--	--
pH	standard units	--	--	--	6	9
Total Suspended Solids	mg/L	30	45	90	--	--
	lbs/day	130	190	380	--	--
Priority Pollutants						
Copper, Total Recoverable	ug/L	34	--	43	--	--
Non-Conventional Pollutants						
Ammonia, Total (as Nitrogen)	mg/L	8.4	--	16	--	--

- b. **Percent Removal:** The average monthly percent removal of the five day biochemical oxygen demand at 20°C (BOD₅) and total suspended solids (TSS) shall not be less than 85 percent.
 - c. **Acute Whole Effluent Toxicity.** Survival of aquatic organisms in 96-hour bioassays of undiluted waste shall be no less than:
 - i. 70%, minimum for any one bioassay; and
 - ii. 90%, median for any three consecutive bioassays.
 - d. **Total Residual Chlorine.** Effluent total residual chlorine shall not exceed:
 - i. 0.011 mg/L, as a 4-day average; and
 - ii. 0.019 mg/L, as a 1-hour average.
 - e. **Total Coliform Organisms.** Effluent total coliform organisms shall not exceed:
 - i. 23 most probable number (MPN) per 100 mL, as a 7-day median; and
 - ii. 240 MPN/100 mL, more than once in any 30-day period.
 - f. **Average Dry Weather Flow.** The average dry weather flow shall not exceed 0.5 mgd.
- 2. Interim Effluent Limitations**
- a. During the period beginning on the Permit Effective Date and ending on 13 August 2019, the Discharger shall maintain compliance with the following limitations at Discharge Point 001, with compliance measured at Monitoring Location EFF-001 as described in the attached MRP. These interim effluent limitations shall apply in lieu of the corresponding final effluent limitations specified for the same parameters during the time period indicated in this provision.

Table 5. Interim Effluent Limitations

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Non-Conventional Pollutants						
Ammonia, Total (as Nitrogen)	mg/L	12	--	21	--	--

b. **Total Coliform Organisms.** Effluent total coliform organisms shall not exceed 500 MPN/100 mL, at any time.

B. Land Discharge Specifications – Not Applicable

C. Recycling Specifications – Not Applicable

V. RECEIVING WATER LIMITATIONS

A. Surface Water Limitations

1. **Bacteria.** The fecal coliform concentration, based on a minimum of not less than five samples for any 30-day period, to exceed a geometric mean of 200 MPN/100 mL, nor more than 10 percent of the total number of fecal coliform samples taken during any 30-day period to exceed 400 MPN/100 mL.
2. **Biostimulatory Substances.** Water to contain biostimulatory substances which promote aquatic growths in concentrations that cause nuisance or adversely affect beneficial uses.
3. **Chemical Constituents.** Chemical constituents to be present in concentrations that adversely affect beneficial uses.
4. **Color.** Discoloration that causes nuisance or adversely affects beneficial uses.
5. **Dissolved Oxygen:**
 - a. The monthly median of the mean daily dissolved oxygen concentration to fall below 85 percent of saturation in the main water mass;
 - b. The 95 percentile dissolved oxygen concentration to fall below 75 percent of saturation; nor
 - c. The dissolved oxygen concentration to be reduced below 7.0 mg/L at any time.
6. **Floating Material.** Floating material to be present in amounts that cause nuisance or adversely affect beneficial uses.
7. **Oil and Grease.** Oils, greases, waxes, or other materials to be present in concentrations that cause nuisance, result in a visible film or coating on the surface of the water or on objects in the water, or otherwise adversely affect beneficial uses.
8. **pH.** The pH to be depressed below 6.5 nor raised above 8.5.
9. **Pesticides:**
 - a. Pesticides to be present, individually or in combination, in concentrations that adversely affect beneficial uses;
 - b. Pesticides to be present in bottom sediments or aquatic life in concentrations that adversely affect beneficial uses;

- c. Total identifiable persistent chlorinated hydrocarbon pesticides to be present in the water column at concentrations detectable within the accuracy of analytical methods approved by USEPA or the Executive Officer;
 - d. Pesticide concentrations to exceed those allowable by applicable antidegradation policies (see State Water Board Resolution No. 68-16 and 40 CFR 131.12.);
 - e. Pesticide concentrations to exceed the lowest levels technically and economically achievable;
 - f. Pesticides to be present in concentration in excess of the maximum contaminant levels (MCL's) set forth in CCR, Title 22, division 4, chapter 15; nor
 - g. Thiobencarb to be present in excess of 1.0 µg/L.
10. **Radioactivity:**
- a. Radionuclides to be present in concentrations that are harmful to human, plant, animal, or aquatic life nor that result in the accumulation of radionuclides in the food web to an extent that presents a hazard to human, plant, animal, or aquatic life.
 - b. Radionuclides to be present in excess of the maximum contaminant levels (MCLs) specified in Table 64442 of section 64442 and Table 64443 of section 64443 of Title 22 of the California Code of Regulations.
11. **Suspended Sediments.** The suspended sediment load and suspended sediment discharge rate of surface waters to be altered in such a manner as to cause nuisance or adversely affect beneficial uses.
12. **Settleable Substances.** Substances to be present in concentrations that result in the deposition of material that causes nuisance or adversely affects beneficial uses.
13. **Suspended Material.** Suspended material to be present in concentrations that cause nuisance or adversely affect beneficial uses.
14. **Taste and Odors.** Taste or odor producing substances to be present in concentrations that impart undesirable tastes or odors to fish flesh or other edible products of aquatic origin, or that cause nuisance, or otherwise adversely affect beneficial uses.
15. **Temperature.** The natural temperature to be increased by more than 5°F. Compliance to be determined based on the difference in temperature at RSW-001 and RSW-002.
16. **Toxicity.** Toxic substances to be present, individually or in combination, in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.
17. **Turbidity.**
- a. Shall not exceed 2 Nephelometric Turbidity Units (NTU) where natural turbidity is less than 1 NTU;
 - b. Shall not increase more than 1 NTU where natural turbidity is between 1 and 5 NTUs;
 - c. Shall not increase more than 20 percent where natural turbidity is between 5 and 50 NTUs;
 - d. Shall not increase more than 10 NTU where natural turbidity is between 50 and 100 NTUs; nor
 - e. Shall not increase more than 10 percent where natural turbidity is greater than 100 NTUs.

B. Groundwater Limitations

Release of waste constituents from any portion of the Facility shall not cause groundwater to:

1. Exceed a total coliform organism level of 2.2 MPN/100 mL over any seven-day period.
2. Contain constituents in concentrations that exceed either the Primary or Secondary MCLs established in Title 22 of the California Code of Regulations.
3. Contain taste or odor-producing constituents, toxic substances, or any other constituents in concentrations that cause nuisance or adversely affect beneficial uses.

VI. PROVISIONS

A. Standard Provisions

1. The Discharger shall comply with all Standard Provisions included in Attachment D.
2. The Discharger shall comply with the following provisions. In the event that there is any conflict, duplication, or overlap between provisions specified by this Order, the more stringent provision shall apply:
 - a. If the Discharger's wastewater treatment plant is publicly owned or subject to regulation by California Public Utilities Commission, it shall be supervised and operated by persons possessing certificates of appropriate grade according to Title 23, CCR, division 3, chapter 26.
 - b. After notice and opportunity for a hearing, this Order may be terminated or modified for cause, including, but not limited to:
 - i. violation of any term or condition contained in this Order;
 - ii. obtaining this Order by misrepresentation or by failing to disclose fully all relevant facts;
 - iii. a change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge; and
 - iv. a material change in the character, location, or volume of discharge.

The causes for modification include:

- i. *New regulations.* New regulations have been promulgated under section 405(d) of the CWA, or the standards or regulations on which the permit was based have been changed by promulgation of amended standards or regulations or by judicial decision after the permit was issued.
- ii. *Land application plans.* When required by a permit condition to incorporate a land application plan for beneficial reuse of sewage sludge, to revise an existing land application plan, or to add a land application plan.
- iii. *Change in sludge use or disposal practice.* Under 40 CFR 122.62(a)(1), a change in the Discharger's sludge use or disposal practice is a cause for modification of the permit. It is cause for revocation and reissuance if the Discharger requests or agrees.

The Central Valley Water Board may review and revise this Order at any time upon application of any affected person or the Central Valley Water Board's own motion.

- c. If a toxic effluent standard or prohibition (including any scheduled compliance specified in such effluent standard or prohibition) is established under section

307(a) of the CWA, or amendments thereto, for a toxic pollutant that is present in the discharge authorized herein, and such standard or prohibition is more stringent than any limitation upon such pollutant in this Order, the Central Valley Water Board will revise or modify this Order in accordance with such toxic effluent standard or prohibition.

The Discharger shall comply with effluent standards and prohibitions within the time provided in the regulations that establish those standards or prohibitions, even if this Order has not yet been modified.

- d. This Order shall be modified, or alternately revoked and reissued, to comply with any applicable effluent standard or limitation issued or approved under sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a)(2) of the CWA, if the effluent standard or limitation so issued or approved:
 - i. Contains different conditions or is otherwise more stringent than any effluent limitation in the Order; or
 - ii. Controls any pollutant limited in the Order.

The Order, as modified or reissued under this paragraph, shall also contain any other requirements of the CWA then applicable.

- e. The provisions of this Order are severable. If any provision of this Order is found invalid, the remainder of this Order shall not be affected.
- f. The Discharger shall take all reasonable steps to minimize any adverse effects to waters of the State or users of those waters resulting from any discharge or sludge use or disposal in violation of this Order. Reasonable steps shall include such accelerated or additional monitoring as necessary to determine the nature and impact of the non-complying discharge or sludge use or disposal.
- g. The Discharger shall ensure compliance with any existing or future pretreatment standard promulgated by USEPA under section 307 of the CWA, or amendment thereto, for any discharge to the municipal system.
- h. A copy of this Order shall be maintained at the discharge facility and be available at all times to operating personnel. Key operating personnel shall be familiar with its content.
- i. Safeguard to electric power failure:
 - i. The Discharger shall provide safeguards to assure that, should there be reduction, loss, or failure of electric power, the discharge shall comply with the terms and conditions of this Order.
 - ii. Upon written request by the Central Valley Water Board, the Discharger shall submit a written description of safeguards. Such safeguards may include alternate power sources, standby generators, retention capacity, operating procedures, or other means. A description of the safeguards provided shall include an analysis of the frequency, duration, and impact of power failures experienced over the past 5 years on effluent quality and on the capability of the Discharger to comply with the terms and conditions of the Order. The adequacy of the safeguards is subject to the approval of the Central Valley Water Board.
 - iii. Should the treatment works not include safeguards against reduction, loss, or failure of electric power, or should the Central Valley Water Board not approve

the existing safeguards, the Discharger shall, within 90 days of having been advised in writing by the Central Valley Water Board that the existing safeguards are inadequate, provide to the Central Valley Water Board and USEPA a schedule of compliance for providing safeguards such that in the event of reduction, loss, or failure of electric power, the Discharger shall comply with the terms and conditions of this Order. The schedule of compliance shall, upon approval of the Central Valley Water Board, become a condition of this Order.

- j. The Discharger, upon written request of the Central Valley Water Board, shall file with the Board a technical report on its preventive (failsafe) and contingency (cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events. This report may be combined with that required under the Central Valley Water Board Standard Provision contained in section VI.A.2.i of this Order.

The technical report shall:

- i. Identify the possible sources of spills, leaks, untreated waste by-pass, and contaminated drainage. Loading and storage areas, power outage, waste treatment unit outage, and failure of process equipment, tanks and pipes should be considered.
- ii. Evaluate the effectiveness of present facilities and procedures and state when they became operational.
- iii. Predict the effectiveness of the proposed facilities and procedures and provide an implementation schedule containing interim and final dates when they will be constructed, implemented, or operational.

The Central Valley Water Board, after review of the technical report, may establish conditions which it deems necessary to control accidental discharges and to minimize the effects of such events. Such conditions shall be incorporated as part of this Order, upon notice to the Discharger.

- k. A publicly owned treatment works whose waste flow has been increasing, or is projected to increase, shall estimate when flows will reach hydraulic and treatment capacities of its treatment and disposal facilities. The projections shall be made in January, based on the last 3 years' average dry weather flows, peak wet weather flows and total annual flows, as appropriate. When any projection shows that capacity of any part of the facilities may be exceeded in 4 years, the Discharger shall notify the Central Valley Water Board by 31 January. A copy of the notification shall be sent to appropriate local elected officials, local permitting agencies and the press. Within 120 days of the notification, the Discharger shall submit a technical report showing how it will prevent flow volumes from exceeding capacity or how it will increase capacity to handle the larger flows. The Central Valley Water Board may extend the time for submitting the report.
- l. The Discharger shall submit technical reports as directed by the Executive Officer. All technical reports required herein that involve planning, investigation, evaluation, or design, or other work requiring interpretation and proper application of engineering or geologic sciences, shall be prepared by or under the direction of persons registered to practice in California pursuant to California Business and Professions Code, sections 6735, 7835, and 7835.1. To demonstrate compliance with Title 16, CCR, sections 415 and 3065, all technical reports must contain a

statement of the qualifications of the responsible registered professional(s). As required by these laws, completed technical reports must bear the signature(s) and seal(s) of the registered professional(s) in a manner such that all work can be clearly attributed to the professional responsible for the work.

- m. The Central Valley Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13385, 13386, and 13387.
- n. For publicly owned treatment works, prior to making any change in the point of discharge, place of use, or purpose of use of treated wastewater that results in a permanent decrease of flow in any portion of a watercourse, the Discharger must file a petition with the State Water Board, Division of Water Rights, and receive approval for such a change. (Water Code section 1211).
- o. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to the Central Valley Water Board.

To assume operation under this Order, the succeeding owner or operator must apply in writing to the Executive Officer requesting transfer of the Order. The request must contain the requesting entity's full legal name, the state of incorporation if a corporation, address and telephone number of the persons responsible for contact with the Central Valley Water Board and a statement. The statement shall comply with the signatory and certification requirements in the federal Standard Provisions (Attachment D, section V.B) and state that the new owner or operator assumes full responsibility for compliance with this Order. Failure to submit the request shall be considered a discharge without requirements, a violation of the Water Code. Transfer shall be approved or disapproved in writing by the Executive Officer.

- p. Failure to comply with provisions or requirements of this Order, or violation of other applicable laws or regulations governing discharges from this facility, may subject the Discharger to administrative or civil liabilities, criminal penalties, and/or other enforcement remedies to ensure compliance. Additionally, certain violations may subject the Discharger to civil or criminal enforcement from appropriate local, state, or federal law enforcement entities.
- q. In the event the Discharger does not comply or will be unable to comply for any reason, with any prohibition, maximum daily effluent limitation, average monthly effluent limitation, average weekly effluent limitation, instantaneous maximum/minimum effluent limitation, or receiving water limitation of this Order, the Discharger shall notify the Central Valley Water Board by telephone (530) 224-4845 within 24 hours of having knowledge of such noncompliance, and shall confirm this notification in writing within five days, unless the Central Valley Water Board waives confirmation. The written notification shall state the nature, time, duration, and cause of noncompliance, and shall describe the measures being taken to remedy the current noncompliance and prevent recurrence including, where applicable, a schedule of implementation. Other noncompliance requires written notification as above at the time of the normal monitoring report.

B. Monitoring and Reporting Program (MRP) Requirements

The Discharger shall comply with the MRP, and future revisions thereto, in Attachment E.

C. Special Provisions

1. Reopener Provisions

- a. Conditions that necessitate a major modification of a permit are described in 40 CFR 122.62, including, but not limited to:
 - i. If new or amended applicable water quality standards are promulgated or approved pursuant to section 303 of the CWA, or amendments thereto, this permit may be reopened and modified in accordance with the new or amended standards.
 - ii. When new information, that was not available at the time of permit issuance, would have justified different permit conditions at the time of issuance.
- b. This Order may be reopened for modification, or revocation and reissuance, as a result of the detection of a reportable priority pollutant generated by special conditions included in this Order. These special conditions may be, but are not limited to, fish tissue sampling, whole effluent toxicity, monitoring requirements on internal waste stream(s), and monitoring for surrogate parameters. Additional requirements may be included in this Order as a result of the special condition monitoring data.
- c. **Mercury.** If mercury is found to be causing toxicity based on acute or chronic toxicity test results, or if a TMDL program is adopted, this Order shall be reopened and the interim mass effluent limitation modified (higher or lower) or an effluent concentration limitation imposed. If the Central Valley Water Board determines that a mercury offset program is feasible for Dischargers subject to a NPDES permit, then this Order may be reopened to reevaluate the interim mercury mass loading limitation(s) and the need for a mercury offset program for the Discharger.
- d. **Whole Effluent Toxicity.** As a result of a Toxicity Reduction Evaluation (TRE), this Order may be reopened to include a chronic toxicity limitation, a new acute toxicity limitation, and/or a limitation for a specific toxicant identified in the TRE. Additionally, if the State Water Board revises the SIP's toxicity control provisions that would require the establishment of numeric chronic toxicity effluent limitations, this Order may be reopened to include a numeric chronic toxicity effluent limitation based on the new provisions.
- e. **Water Effects Ratios (WER) and Metal Translators.** A default WER of 1.0 has been used in this Order for calculating CTR criteria for applicable priority pollutant inorganic constituents. In addition, default dissolved-to-total metal translators have been used to convert water quality objectives from dissolved to total recoverable when developing effluent limitations for metals. If the Discharger performs studies to determine site-specific WERs and/or site-specific dissolved-to-total metal translators, this Order may be reopened to modify the effluent limitations for the applicable inorganic constituents.
- f. **Drinking Water Policy.** On 26 July 2013 the Central Valley Water Board adopted Resolution No. R5-2013-0098 amending the Basin Plan and establishing a Drinking Water Policy. The State Water Board approved the Drinking Water Policy on 3 December 2013. This Order may be reopened to incorporate monitoring of drinking water constituents to implement the Drinking Water Policy.
- g. **Diazinon and Chlorpyrifos Basin Plan Amendment.** Central Valley Water Board staff is developing a Basin Plan Amendment to provide an implementation plan for NPDES-permitted domestic wastewater dischargers. This Order may be reopened

to modify diazinon and chlorpyrifos effluent limitations, as appropriate, in accordance with an amendment to the Basin Plan.

2. Special Studies, Technical Reports and Additional Monitoring Requirements

- a. **Toxicity Reduction Evaluation Requirements.** For compliance with the Basin Plan's narrative toxicity objective, this Order requires the Discharger to conduct chronic whole effluent toxicity (WET) testing, as specified in MRP section V. Furthermore, this Provision requires the Discharger to investigate the causes of, and identify corrective actions to reduce or eliminate effluent toxicity. If the discharge exceeds the numeric toxicity monitoring trigger during accelerated monitoring established in this Provision, the Discharger is required to initiate a Toxicity Reduction Evaluation (TRE) in accordance with an approved TRE Work Plan, and take actions to mitigate the impact of the discharge and prevent recurrence of toxicity. A TRE is a site-specific study conducted in a stepwise process to identify the source(s) of toxicity and the effective control measures for effluent toxicity. TREs are designed to identify the causative agents and sources of whole effluent toxicity, evaluate the effectiveness of the toxicity control options, and confirm the reduction in effluent toxicity. This Provision includes requirements for the Discharger to develop and submit a TRE Workplan and includes procedures for accelerated chronic toxicity monitoring and TRE initiation.
 - i. **Initial Investigative TRE Workplan.** Within 90 days of the effective date of this Order, the Discharger shall submit to the Central Valley Water Board an Initial Investigative TRE Workplan for approval by the Executive Officer. This should be a one to two page document that includes, at a minimum:
 - (a) A description of the investigation and evaluation techniques that will be used to identify potential causes and sources of effluent toxicity, effluent variability, and treatment system efficiency;
 - (b) A description of the facility's methods of maximizing in-house treatment efficiency and good housekeeping practices, and a list of all chemicals used in operation of the facility; and
 - (c) A discussion of who will conduct the Toxicity Identification Evaluation (TIE), if necessary (e.g., an in-house expert or outside contractor).
 - ii. **Accelerated Monitoring and TRE Initiation.** When the numeric toxicity monitoring trigger is exceeded during regular chronic toxicity monitoring, and the testing meets all test acceptability criteria, the Discharger shall initiate accelerated monitoring as required in the Accelerated Monitoring Specifications. The Discharger shall initiate a TRE to address effluent toxicity if any WET testing results exceed the numeric toxicity monitoring trigger during accelerated monitoring.
 - iii. **Numeric Toxicity Monitoring Trigger.** The numeric toxicity monitoring trigger to initiate a TRE is $> 1 \text{ TUc}$ (where $\text{TUc} = 100/\text{NOEC}$). The monitoring trigger is not an effluent limitation; it is the toxicity threshold at which the Discharger is required to begin accelerated monitoring and initiate a TRE.
 - iv. **Accelerated Monitoring Specifications.** If the numeric toxicity monitoring trigger is exceeded during regular chronic toxicity testing, the Discharger shall initiate accelerated monitoring within 14-days of notification by the laboratory of the exceedance. Accelerated monitoring shall consist of four chronic toxicity

tests conducted once every two weeks using the species that exhibited toxicity. The following protocol shall be used for accelerated monitoring and TRE initiation:

- (a) If the results of four consecutive accelerated monitoring tests do not exceed the monitoring trigger, the Discharger may cease accelerated monitoring and resume regular chronic toxicity monitoring. However, notwithstanding the accelerated monitoring results, if there is adequate evidence of a pattern of effluent toxicity, the Executive Officer may require that the Discharger initiate a TRE.
- (b) If the source(s) of the toxicity is easily identified (e.g., temporary plant upset), the Discharger shall make necessary corrections to the facility and shall continue accelerated monitoring until four consecutive accelerated tests do not exceed the monitoring trigger. Upon confirmation that the effluent toxicity has been removed, the Discharger may cease accelerated monitoring and resume regular chronic toxicity monitoring.
- (c) If the result of any accelerated toxicity test exceeds the monitoring trigger, the Discharger shall cease accelerated monitoring and begin a TRE to investigate the cause(s) of, and identify corrective actions to reduce or eliminate effluent toxicity. Within thirty (30) days of notification by the laboratory of any test result exceeding the monitoring trigger during accelerated monitoring, the Discharger shall submit a TRE Action Plan to the Central Valley Water Board including, at minimum:
 - (1) Specific actions the Discharger will take to investigate and identify the cause(s) of toxicity, including a TRE WET monitoring schedule;
 - (2) Specific actions the Discharger will take to mitigate the impact of the discharge and prevent the recurrence of toxicity; and
 - (3) A schedule for these actions.

- b. **Groundwater Monitoring Network Verification and Groundwater Quality Characterization Study.** To determine compliance with Groundwater Limitations, Section V.B., within 30 months following adoption of this Order, the Discharger shall submit a Groundwater Monitoring Network Verification and Groundwater Quality Characterization Study. This study is an evaluation of the current groundwater monitoring network and should focus on confirming: (1) that one or more adequate background monitoring wells are present and (2) that there is a sufficient number of designated monitoring wells hydraulically downgradient of every treatment, storage, and disposal unit that does or may release waste constituents to groundwater. A scientific validation of the existing groundwater monitoring wells should be assessed in characterizing any impacts to the underlying aquifer. The groundwater quality portion of the study must show, at a minimum, a summary of monitoring data and a comparison of background groundwater water quality to all hydraulically downgradient wells. Determination of background quality shall be made using the methods described in Title 27 California Code of Regulations Section 20415(e)(10), and shall be based on data from at least eight consecutive quarterly (or more frequent) groundwater monitoring events. For each monitoring parameter/constituent, the report shall compare measured concentrations for compliance monitoring wells with the background concentration. Any Groundwater Monitoring Work Plans shall be prepared in accordance with, and including items

listed in the following document: *“Requirements for Monitoring Well Installation Work Plans and Monitoring Well Installation Reports.”* All monitoring wells shall comply with the appropriate standards as described in California Well Standards Bulletin 74-90 (June 1991) and Water Well Standards: State of California Bulletin 74-81 (December 1981), and any more stringent standards adopted by the Discharger or County pursuant to Water Code section 13801.

- c. **Best Practical Treatment or Control (BPTC).** If groundwater monitoring indicates that the discharge of waste is threatening to cause, or has caused, groundwater to contain waste constituents in concentrations statistically greater than background water quality, the Discharger shall submit, **within 48 months following adoption of this Order**, a BPTC Evaluation Work Plan that sets forth a scope and schedule for a technical evaluation of each component of the facilities’ wastewater treatment system to determine the BPTC for any waste constituents of concern. The work plan shall include a preliminary evaluation of each component of the wastewater treatment system and propose a time schedule for completing the technical evaluation. The time schedule to complete the evaluation shall be as short as practicable, and shall not exceed 1 year.

3. Best Management Practices and Pollution Prevention

a. Pollutant Minimization Program

The Discharger shall develop and conduct a Pollutant Minimization Program (PMP) as further described below when there is evidence that a priority pollutant is present in the effluent above an effluent limitation (e.g., sample results reported as DNQ when the effluent limitation is less than the MDL, sample results from analytical methods more sensitive than those methods required by this Order, presence of whole effluent toxicity, health advisories for fish consumption, results of benthic or aquatic organism tissue sampling) and either:

- i. A sample result is reported as DNQ and the effluent limitation is less than the RL; or
- ii. A sample result is reported as ND and the effluent limitation is less than the MDL, using definitions described in Attachment A and reporting protocols described in MRP section X.B.4.

The PMP shall include, but not be limited to, the following actions and submittals acceptable to the Central Valley Water Board:

- i. An annual review and semi-annual monitoring of potential sources of the reportable priority pollutant(s), which may include fish tissue monitoring and other bio-uptake sampling;
- ii. Submittal of a control strategy designed to proceed toward the goal of maintaining concentrations of the reportable priority pollutant(s) in the effluent at or below the effluent limitation;
- iii. Implementation of appropriate cost-effective control measures for the reportable priority pollutant(s), consistent with the control strategy; and
- iv. An annual status report that shall be sent to the Central Valley Water Board including:
 - (a) All PMP monitoring results for the previous year;
 - (b) A list of potential sources of the reportable priority pollutant(s);

- (c) A summary of all actions undertaken pursuant to the control strategy; and
 - (d) A description of actions to be taken in the following year.
 - b. **Pollution Prevention Plan for Total Ammonia and Total Coliform.** The Discharger shall prepare and implement a pollution prevention plan for total ammonia and total coliform in accordance with Water Code section 13263.3(d)(3). The minimum requirements for the pollution prevention plan are outlined in the Fact Sheet (Attachment F section VII.B.3.a). The pollution prevention plan shall be completed and **submitted** to the Central Valley Water Board **by 19 December 2016**.
 - c. **Salinity Evaluation and Minimization Plan.** The Discharger shall prepare a salinity evaluation and minimization plan to identify and address sources of salinity. The plan shall be completed and **submitted** to the Central Valley Water Board **within 9 months of the adoption date of this Order** for approval by the Executive Officer.
- 4. **Construction, Operation and Maintenance Specifications**
 - a. **Treatment Pond Operating Requirements.**
 - i. No waste constituent shall be released, discharged, or placed where it will cause a violation of the Groundwater Limitations of this Order.
 - ii. Wastewater treatment, storage, and disposal shall not cause pollution or a nuisance as defined by Water Code section 13050.
 - iii. The discharge shall remain within the permitted waste treatment/containment structures and land application areas at all times.
 - iv. The Discharger shall operate all systems and equipment to optimize the quality of the discharge.
 - v. All conveyance, treatment, storage, and disposal systems shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
 - vi. Objectionable odors shall not be perceivable beyond the limits of the property where the waste is generated, treated, and/or discharged at an intensity that creates or threatens to create nuisance conditions.
 - vii. As a means of discerning compliance with vi.(above), the dissolved oxygen (DO) content in the upper one foot of any wastewater pond shall not be less than 1.0 mg/L for three consecutive weekly sampling events. If DO in any single pond is below 1.0 mg/L for three consecutive sampling events, the Discharger shall report the findings to the Regional Water Board in writing within 10 days and shall include a specific plan to resolve the low DO results within 30 days.
 - viii. The Discharger shall operate and maintain all ponds sufficiently to protect the integrity of containment dams and berms and prevent overtopping and/or structural failure. Unless a California-registered civil engineer certifies (based on design, construction, and conditions of operation and maintenance) that less freeboard is adequate, the operating freeboard in any pond shall never be less than two feet (measured vertically from the lowest possible point of overflow). As a means of management and to discern compliance with this requirement, the Discharger shall install or utilize a device that clearly shows

the water level at design capacity and enables the determination of available operational freeboard.

- ix. Wastewater treatment, storage, and disposal ponds or structures shall have sufficient capacity to accommodate allowable wastewater flow, design seasonal precipitation, and ancillary inflow and infiltration during the winter while ensuring continuous compliance with all requirements of this Order. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns.
- x. On or about 1 October of each year, available capacity shall at least equal the volume necessary to comply viii. and ix (above).
- xi. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
- xii. Ponds shall be managed to prevent breeding of mosquitoes. In particular,
 - (a) An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - (b) Weeds shall be minimized.
 - (c) Vegetation, debris, and deceased algae shall not accumulate on the water surface.
- xiii. Newly constructed or rehabilitated berms or levees (excluding internal berms that separate ponds or control the flow of water within a pond) shall be designed and constructed under the supervision of a California Registered Civil Engineer.
- xiv. Wastewater contained in any unlined pond shall not have a pH less than 6.0 or greater than 9.0.
- xv. The Discharger shall monitor sludge accumulation in the wastewater treatment/storage ponds and shall periodically remove sludge as necessary to maintain adequate storage capacity. Specifically, if the estimated volume of sludge in the reservoir exceeds five percent of the permitted reservoir capacity, the Discharger shall complete sludge cleanout within 12 months after the date of the estimate.
- xvi. The discharge shall not cause degradation of any water supply.
- xvii. The discharge of waste classified as "hazardous" as defined in section 2521(a) of Title 23, California Code of Regulations (CCR) to the treatment ponds is prohibited.

5. Special Provisions for Municipal Facilities (POTW's Only)

a. Pretreatment Requirements

- i. The Discharger shall be responsible and liable for the performance of all Control Authority pretreatment requirements contained in 40 CFR Part 403, including any subsequent regulatory revisions to 40 CFR Part 403. Where 40 CFR Part 403 or subsequent revision places mandatory actions upon the Discharger as Control Authority but does not specify a timetable for completion of the actions, the Discharger shall complete the required actions within 6

months from the issuance date of this permit or the effective date of the 40 CFR Part 403 revisions, whichever comes later. For violations of pretreatment requirements, the Discharger shall be subject to enforcement actions, penalties, fines, and other remedies by USEPA or other appropriate parties, as provided in the CWA. USEPA may initiate enforcement action against a nondomestic user for noncompliance with applicable standards and requirements as provided in the CWA.

- ii. The Discharger shall enforce the requirements promulgated under sections 307(b), 307(c), 307(d), and 402(b) of the CWA with timely, appropriate and effective enforcement actions. The Discharger shall cause all nondomestic users subject to federal categorical standards to achieve compliance no later than the date specified in those requirements or, in the case of a new nondomestic user, upon commencement of the discharge.
- iii. The Discharger shall perform the pretreatment functions as required in 40 CFR Part 403 including, but not limited to:
 - (a) Implement the necessary legal authorities as provided in 40 CFR 403.8(f)(1);
 - (b) Enforce the pretreatment requirements under 40 CFR 403.5 and 403.6;
 - (c) Implement the programmatic functions as provided in 40 CFR 403.8(f)(2); and
 - (d) Provide the requisite funding and personnel to implement the pretreatment program as provided in 40 CFR 403.8(f)(3).

b. **Sludge/Biosolids Treatment or Discharge Specifications.** Sludge in this document means the solid, semisolid, and liquid residues removed during primary, secondary, or advanced wastewater treatment processes. Solid waste refers to grit and screening material generated during preliminary treatment. Residual sludge means sludge that will not be subject to further treatment at the wastewater treatment plant. Biosolids refer to sludge that has been treated and tested and shown to be capable of being beneficially and legally used pursuant to federal and state regulations as a soil amendment for agricultural, silvicultural, horticultural, and land reclamation activities as specified under 40 CFR Part 503.

- i. Collected screenings, residual sludge, biosolids, and other solids removed from liquid wastes shall be disposed of in a manner approved by the Executive Officer, and consistent with Consolidated Regulations for Treatment, Storage, Processing, or Disposal of Solid Waste, as set forth in Title 27, CCR, division 2, subdivision 1, section 20005, et seq. Removal for further treatment, storage, disposal, or reuse at sites (e.g., landfill, composting sites, soil amendment sites) that are operated in accordance with valid waste discharge requirements issued by a Regional Water Board will satisfy these specifications.

Sludge and solid waste shall be removed from screens, sumps, ponds, clarifiers, etc. as needed to ensure optimal plant performance.

The treatment of sludge generated at the Facility shall be confined to the Facility property and conducted in a manner that precludes infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations in section V.B. of this Order. In addition, the storage of residual sludge, solid waste, and biosolids on Facility property shall be temporary and

controlled, and contained in a manner that minimizes leachate formation and precludes infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations included in section V.B. of this Order.

- ii. The use, disposal, storage, and transportation of biosolids shall comply with existing federal and state laws and regulations, including permitting requirements and technical standards included in 40 CFR Part 503. If the State Water Board and the Central Valley Water Board are given the authority to implement regulations contained in 40 CFR Part 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR Part 503 whether or not they have been incorporated into this Order.
 - iii. The Discharger shall comply with Section IX.A. Biosolids of the Monitoring and Reporting Program, Attachment E.
 - iv. Any proposed change in biosolids use or disposal practice from a previously approved practice shall be reported to the Executive Officer and USEPA Regional Administrator at least **90 days** in advance of the change.
 - v. **Within 180 days of the permit effective date**, the Discharger shall submit a biosolids use or disposal plan to the Central Valley Water Board. The plan shall describe at a minimum:
 - (a) Sources and amounts of biosolids generated annually.
 - (b) Location(s) of on-site storage and description of the containment area.
 - (c) Plans for ultimate disposal. For landfill disposal, include the present classification of the landfill; and the name and location of the landfill.
- c. **Collection System.** On 2 May 2006, the State Water Board adopted State Water Board Order No. 2006-0003-DWQ, Statewide General WDR's for Sanitary Sewer Systems. The Discharger shall be subject to the requirements of Order No. 2006-0003-DWQ and any future revisions thereto. Order No. 2006-0003-DWQ requires that all public agencies that currently own or operate sanitary sewer systems apply for coverage under the general WDR's. The Discharger has applied for and has been approved for coverage under Order 2006-0003-DWQ for operation of its wastewater collection system.

6. Other Special Provisions – Not Applicable

7. Compliance Schedules

- i. **Final Effluent Limitations Compliance Schedule for Total Coliform and Total Ammonia.** This Order requires compliance with final effluent limitations for total coliform (more than once in any 30-day period limit) and total ammonia (average monthly and maximum daily) by **XX February 2021**. The Discharger shall comply with the following time schedule to ensure compliance with the final effluent limitations:

<u>Task</u>	<u>Date Due</u>
i. Submit a pollution prevention plan in accordance with CWC Section 13263.3, subdivision (d)(2). The PPP shall	19 December 2016

<u>Task</u>	<u>Date Due</u>
describe pollution prevention activities the Discharger will implement in the short-term and the long-term to reduce total ammonia and total coliform exceedances at the Facility.	
ii. Submit a preliminary engineering report that describes: (1) the existing situation, (2) potential project alternatives, (3) the suggested compliance project, (4) the projected costs, (5) a feasibility analysis of the selected project, (6) funding strategy for the project, and (7) an estimated project schedule.	18 January 2017
iii. Submit a report that provides a description of the funding sources that will be utilized for the project.	18 January 2019
iv. Submit progress reports that detail any steps taken towards the achievement of compliance with WDRs, including studies, construction progress, evaluation of implemented measures, and recommendations for additional measures as necessary to meet effluent limits by the final compliance date.	18 July 2017 18 July 2018 18 July 2019 20 July 2020
v. Full Compliance with Effluent Limits	XX February 2021
vi. Submit a final report that provides certification that the work plan has been completed and effluent water quality is in compliance with current WDRs.	XX February 2021

VII. COMPLIANCE DETERMINATION

- a. **BOD₅ and TSS Effluent Limitations (Section IV.A.1.a).** Compliance with the final effluent limitations for BOD₅ and TSS required in Limitations and Discharge Requirements section IV.A.1.a shall be ascertained by grab samples. Compliance with effluent limitations required in Limitations and Discharge Requirements section IV.A.1.b for percent removal shall be calculated using the arithmetic mean of BOD₅ and TSS in effluent samples collected over a monthly period as a percentage of the arithmetic mean of the values for influent samples collected at approximately the same times during the same period.
- b. **Average Dry Weather Flow Effluent Limitations (Section IV.A.1.f).** The average dry weather discharge flow represents the daily average flow when groundwater is at or near normal and runoff is not occurring. Compliance with the average dry weather flow effluent limitations will be determined annually based on the average daily flow over three consecutive dry weather months (e.g., July, August, and September).
- c. **Total Coliform Organisms Effluent Limitations (Section IV.A.1.e).** For each day that an effluent sample is collected and analyzed for total coliform organisms, the 7-day median shall be determined by calculating the median concentration of total coliform bacteria in the effluent utilizing the bacteriological results of the last 7 days. For example, if a sample is collected on a Wednesday, the result from that sampling event and all results from the previous 6 days (i.e., Tuesday, Monday, Sunday, Saturday, Friday, and Thursday) are used to calculate the 7-day median. If the 7-day median of total coliform organisms exceeds a most probable number (MPN) of 23 per 100 milliliters, the Discharger will be considered out of compliance.

- d. **Total Residual Chlorine Effluent Limitations (Section IV.A.1.d).** Continuous monitoring analyzers for chlorine residual or for dechlorination agent residual in the effluent are appropriate methods for compliance determination. A positive residual dechlorination agent in the effluent indicates that chlorine is not present in the discharge, which demonstrates compliance with the effluent limitations. This type of monitoring can also be used to prove that some chlorine residual exceedances are false positives. Continuous monitoring data showing either a positive dechlorination agent residual or a chlorine residual at or below the prescribed limit are sufficient to show compliance with the total residual chlorine effluent limitations, as long as the instruments are maintained and calibrated in accordance with the manufacturer's recommendations.

Any excursion above the 1-hour average or 4-day average total residual chlorine effluent limitations is a violation. If the Discharger conducts continuous monitoring and the Discharger can demonstrate, through data collected from a back-up monitoring system, that a chlorine spike recorded by the continuous monitor was not actually due to chlorine, then any excursion resulting from the recorded spike will not be considered an exceedance, but rather reported as a false positive. Records supporting validation of false positives shall be maintained in accordance with Section IV Standard Provisions (Attachment D).

- e. **Mass Effluent Limitations.** The mass effluent limitations contained in the Final Effluent Limitations IV.A.1.a are based on the permitted average dry weather flow and calculated as follows:

$$\text{Mass (lbs/day)} = \text{Flow (MGD)} \times \text{Concentration (mg/L)} \times 8.34 \text{ (conversion factor)}$$

If the effluent flow exceeds the permitted average dry weather flow during wet-weather seasons, the effluent mass limitations contained in Final Effluent Limitations IV.A.1.a shall not apply. If the effluent flow is below the permitted average dry weather flow during wet-weather seasons, the effluent mass limitations do apply.

- f. **Priority Pollutant Effluent Limitations.** Compliance with effluent limitations for priority pollutants shall be determined in accordance with Section 2.4.5 of the SIP, as follows:
- i. Dischargers shall be deemed out of compliance with an effluent limitation, if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reporting level (RL).
 - ii. Dischargers shall be required to conduct a Pollutant Minimization Program (PMP) in accordance with section 2.4.5.1 of the SIP when there is evidence that the priority pollutant is present in the effluent above an effluent limitation and either:
 - (a) A sample result is reported as detected, but not quantified (DNQ) and the effluent limitation is less than the RL; or
 - (b) A sample result is reported as non-detect (ND) and the effluent limitation is less than the method detection limit (MDL).
 - iii. When determining compliance with an average monthly effluent limitation (AMEL) and more than one sample result is available in a month, the discharger shall compute the arithmetic mean unless the data set contains one

or more reported determinations of DNQ or ND. In those cases, the discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:

- (a) The data set shall be ranked from low to high, reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - (b) The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
- iv. If a sample result, or the arithmetic mean or median of multiple sample results, is below the RL, and there is evidence that the priority pollutant is present in the effluent above an effluent limitation and the discharger conducts a PMP (as described in section 2.4.5.1), the discharger shall not be deemed out of compliance.

ATTACHMENT A – DEFINITIONS

Arithmetic Mean (μ)

Also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

Arithmetic mean = $\mu = \Sigma x / n$ where: Σx is the sum of the measured ambient water concentrations, and n is the number of samples.

Average Monthly Effluent Limitation (AMEL)

The highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

Average Weekly Effluent Limitation (AWEL)

The highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

Bioaccumulative

Those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

Carcinogenic

Pollutants are substances that are known to cause cancer in living organisms.

Coefficient of Variation (CV)

CV is a measure of the data variability and is calculated as the estimated standard deviation divided by the arithmetic mean of the observed values.

Daily Discharge

Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of one day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

For composite sampling, if 1 day is defined as a 24-hour period other than a calendar day, the analytical result for the 24-hour period will be considered as the result for the calendar day in which the 24-hour period ends.

Detected, but Not Quantified (DNQ)

DNQ are those sample results less than the RL, but greater than or equal to the laboratory's MDL. Sample results reported as DNQ are estimated concentrations.

Dilution Credit

Dilution Credit is the amount of dilution granted to a discharge in the calculation of a water quality-based effluent limitation, based on the allowance of a specified mixing zone. It is calculated from the dilution ratio or determined through conducting a mixing zone study or modeling of the discharge and receiving water.

Effluent Concentration Allowance (ECA)

ECA is a value derived from the water quality criterion/objective, dilution credit, and ambient background concentration that is used, in conjunction with the coefficient of variation for the effluent monitoring data, to calculate a long-term average (LTA) discharge concentration. The ECA has the same meaning as waste load allocation (WLA) as used in U.S. EPA guidance (Technical Support Document For Water Quality-based Toxics Control, March 1991, second printing, EPA/505/2-90-001).

Enclosed Bays

Enclosed Bays means indentations along the coast that enclose an area of oceanic water within distinct headlands or harbor works. Enclosed bays include all bays where the narrowest distance between the headlands or outermost harbor works is less than 75 percent of the greatest dimension of the enclosed portion of the bay. Enclosed bays include, but are not limited to, Humboldt Bay, Bodega Harbor, Tomales Bay, Drake's Estero, San Francisco Bay, Morro Bay, Los Angeles-Long Beach Harbor, Upper and Lower Newport Bay, Mission Bay, and San Diego Bay. Enclosed bays do not include inland surface waters or ocean waters.

Estimated Chemical Concentration

The estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

Estuaries

Estuaries means waters, including coastal lagoons, located at the mouths of streams that serve as areas of mixing for fresh and ocean waters. Coastal lagoons and mouths of streams that are temporarily separated from the ocean by sandbars shall be considered estuaries. Estuarine waters shall be considered to extend from a bay or the open ocean to a point upstream where there is no significant mixing of fresh water and seawater. Estuarine waters included, but are not limited to, the Sacramento-San Joaquin Delta, as defined in Water Code section 12220, Suisun Bay, Carquinez Strait downstream to the Carquinez Bridge, and appropriate areas of the Smith, Mad, Eel, Noyo, Russian, Klamath, San Diego, and Otay rivers. Estuaries do not include inland surface waters or ocean waters.

Inland Surface Waters

All surface waters of the state that do not include the ocean, enclosed bays, or estuaries.

Instantaneous Maximum Effluent Limitation

The highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

Instantaneous Minimum Effluent Limitation

The lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

Maximum Daily Effluent Limitation (MDEL)

The highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

Median

The middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of

measurements (n) is odd, then the median = $X_{(n+1)/2}$. If n is even, then the median = $(X_{n/2} + X_{(n/2)+1})/2$ (i.e., the midpoint between the n/2 and n/2+1).

Method Detection Limit (MDL)

MDL is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero, as defined in in 40 C.F.R. part 136, Attachment B, revised as of July 3, 1999.

Minimum Level (ML)

ML is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

Mixing Zone

Mixing Zone is a limited volume of receiving water that is allocated for mixing with a wastewater discharge where water quality criteria can be exceeded without causing adverse effects to the overall water body.

Not Detected (ND)

Sample results which are less than the laboratory's MDL.

Ocean Waters

The territorial marine waters of the State as defined by California law to the extent these waters are outside of enclosed bays, estuaries, and coastal lagoons. Discharges to ocean waters are regulated in accordance with the State Water Board's California Ocean Plan.

Persistent Pollutants

Persistent pollutants are substances for which degradation or decomposition in the environment is nonexistent or very slow.

Pollutant Minimization Program (PMP)

PMP means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Central Valley Water Board may consider cost effectiveness when establishing the requirements of a PMP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to Water Code section 13263.3(d), shall be considered to fulfill the PMP requirements.

Pollution Prevention

Pollution Prevention means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as defined in Water Code section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the State Water Resources Control Board (State Water Board) or Central Valley Water Board.

Satellite Collection System

The portion, if any, of a sanitary sewer system owned or operated by a different public agency than the agency that owns and operates the wastewater treatment facility that a sanitary sewer system is tributary to.

Source of Drinking Water

Any water designated as municipal or domestic supply (MUN) in a Central Valley Water Board Basin Plan.

Standard Deviation (σ)

Standard Deviation is a measure of variability that is calculated as follows:

$$\sigma = (\sum[(x - \mu)^2]/(n - 1))^{0.5}$$

where:

x is the observed value;


μ is the arithmetic mean of the observed values; and

n is the number of samples.


Toxicity Reduction Evaluation (TRE)

TRE is a study conducted in a step-wise process designed to identify the causative agents of effluent or ambient toxicity, isolate the sources of toxicity, evaluate the effectiveness of toxicity control options, and then confirm the reduction in toxicity. The first steps of the TRE consist of the collection of data relevant to the toxicity, including additional toxicity testing, and an evaluation of facility operations and maintenance practices, and best management practices. A Toxicity Identification Evaluation (TIE) may be required as part of the TRE, if appropriate. (A TIE is a set of procedures to identify the specific chemical(s) responsible for toxicity. These procedures are performed in three phases (characterization, identification, and confirmation) using aquatic organism toxicity tests.)

ATTACHMENT B – MAP

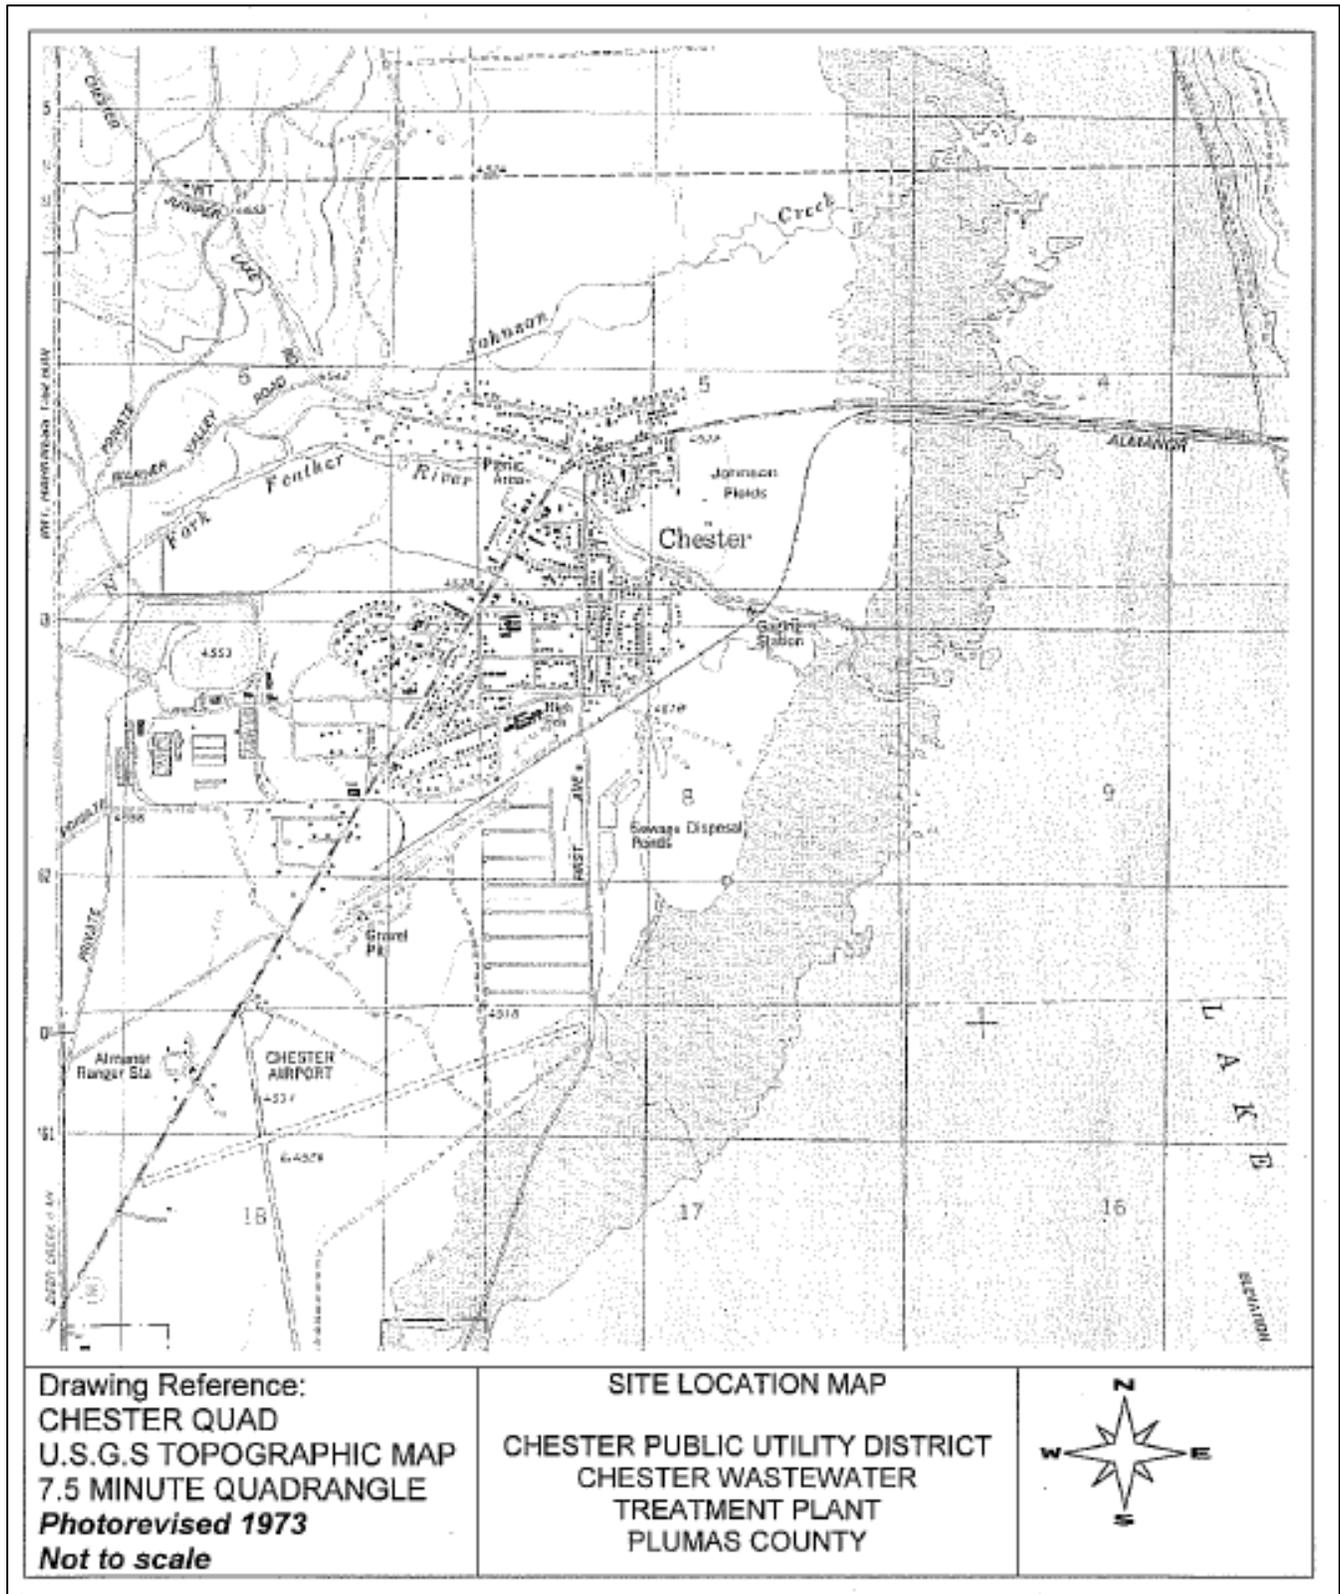

ATTACHMENT C – FLOW SCHEMATIC

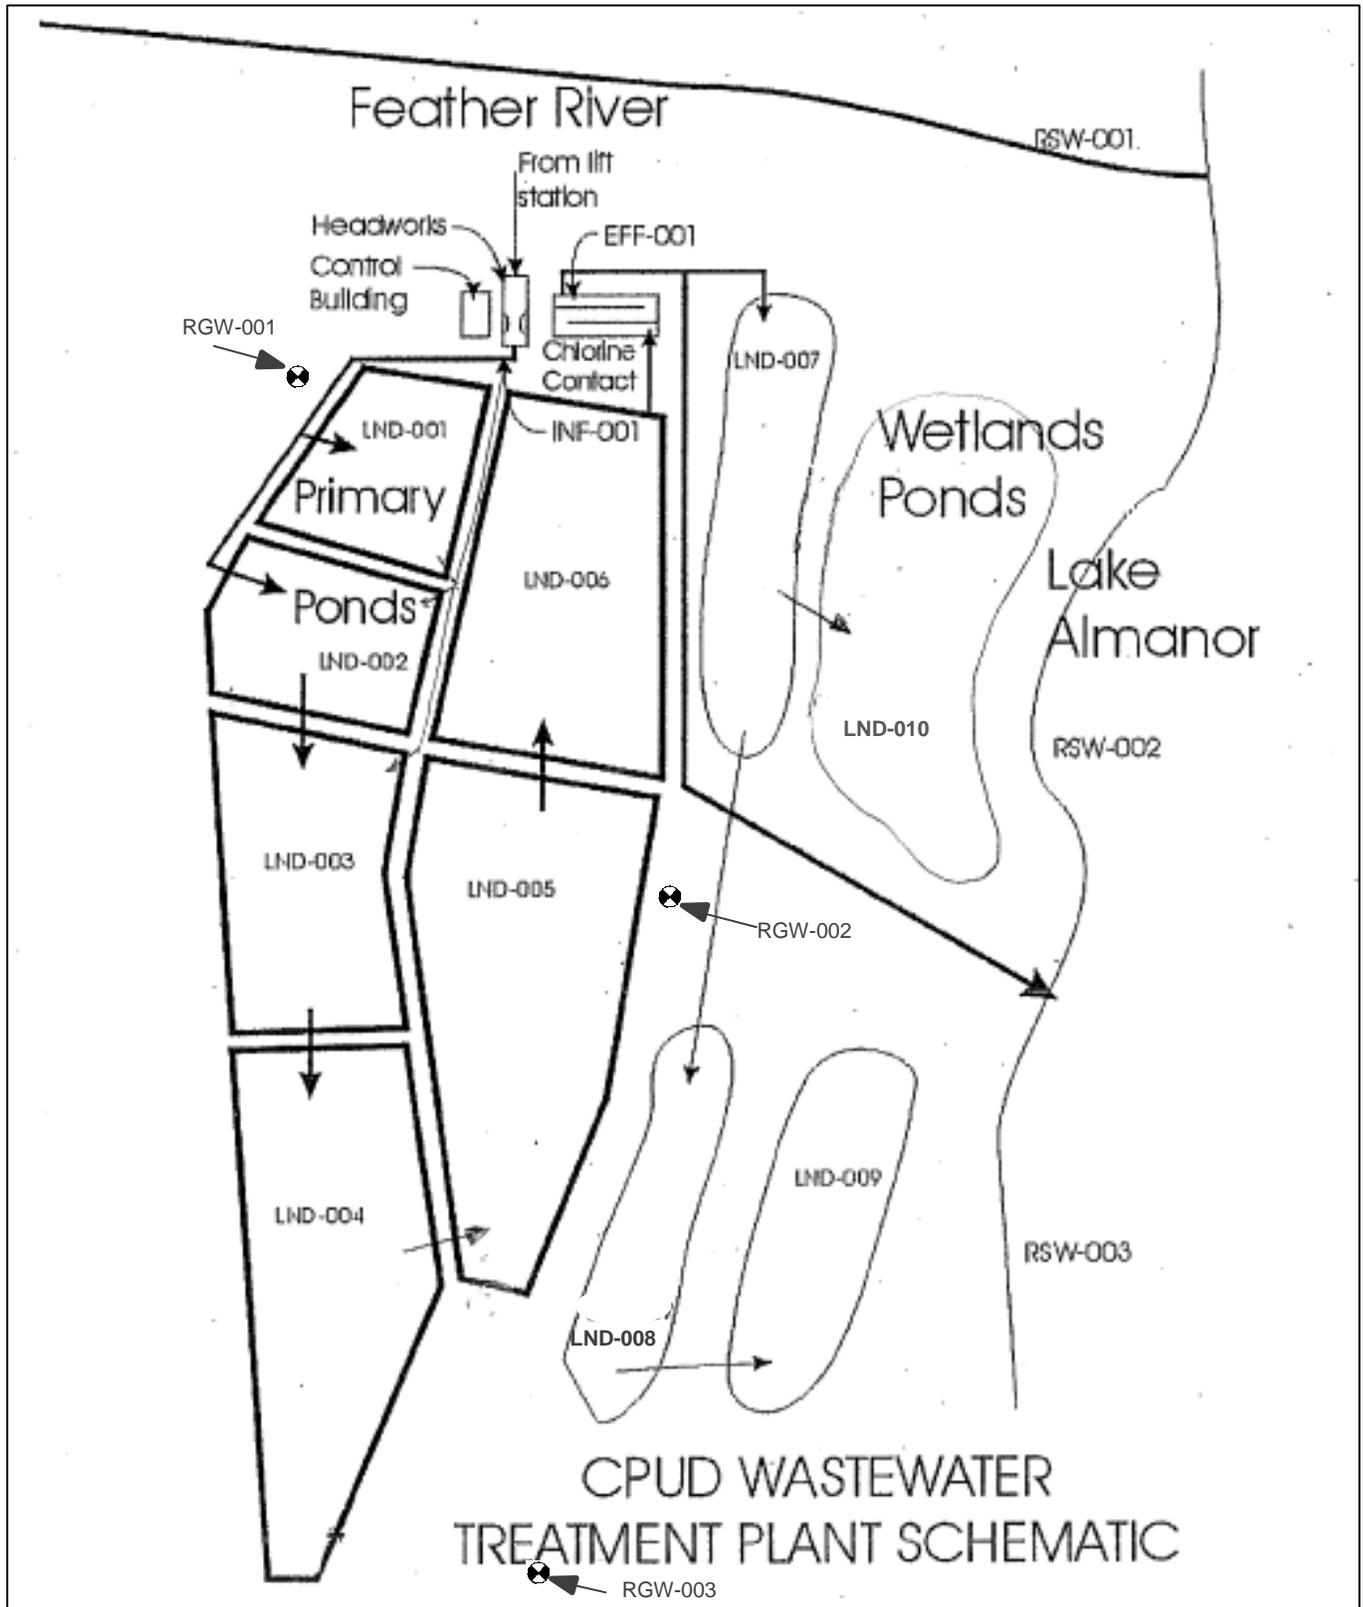

ATTACHMENT D – STANDARD PROVISIONS

I. STANDARD PROVISIONS – PERMIT COMPLIANCE

A. Duty to Comply

1. The Discharger must comply with all of the terms, requirements, and conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code and is grounds for enforcement action; permit termination, revocation and reissuance, or modification; denial of a permit renewal application; or a combination thereof. (40 C.F.R. § 122.41(a); Wat. Code, §§ 13261, 13263, 13265, 13268, 13000, 13001, 13304, 13350, 13385.)
2. The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants and with standards for sewage sludge use or disposal established under Section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement. (40 C.F.R. § 122.41(a)(1).)

B. Need to Halt or Reduce Activity Not a Defense

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order. (40 C.F.R. § 122.41(c).)

C. Duty to Mitigate

The Discharger shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment. (40 C.F.R. § 122.41(d).)

D. Proper Operation and Maintenance

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order. (40 C.F.R. § 122.41(e).)

E. Property Rights

1. This Order does not convey any property rights of any sort or any exclusive privileges. (40 C.F.R. § 122.41(g).)
2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of state or local law or regulations. (40 C.F.R. § 122.5(c).)

F. Inspection and Entry

The Discharger shall allow the Central Valley Water Board, State Water Board, U.S. EPA, and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to (33 U.S.C. § 1318(a)(4)(B); 40 C.F.R. § 122.41(i); Wat. Code, § 13267, 13383):

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order (33 U.S.C § 1318(a)(4)(B)(ii); 40 C.F.R. § 122.41(i)(1); Wat. Code, §§ 13267, 13383);
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order (33 U.S.C. § 1318(a)(4)(B)(ii); 40 C.F.R. § 122.41(i)(2); Wat. Code, §§ 13267, 13383);
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order (33 U.S.C § 1318(a)(4)(B)(ii); 40 C.F.R. § 122.41(i)(3); Wat. Code, § 13267, 13383); and
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the Water Code, any substances or parameters at any location. (33 U.S.C § 1318(a)(4)(B); 40 C.F.R. § 122.41(i)(4); Wat. Code, §§ 13267, 13383.)

G. Bypass

1. Definitions
 - a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility. (40 C.F.R. § 122.41(m)(1)(i).)
 - b. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production. (40 C.F.R. § 122.41(m)(1)(ii).)
2. Bypass not exceeding limitations. The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3, I.G.4, and I.G.5 below. (40 C.F.R. § 122.41(m)(2).)
3. Prohibition of bypass. Bypass is prohibited, and the Central Valley Water Board may take enforcement action against a Discharger for bypass, unless (40 C.F.R. § 122.41(m)(4)(i)):
 - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage (40 C.F.R. § 122.41(m)(4)(i)(A));
 - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance (40 C.F.R. § 122.41(m)(4)(i)(B)); and
 - c. The Discharger submitted notice to the Central Valley Water Board as required under Standard Provisions – Permit Compliance I.G.5 below. (40 C.F.R. § 122.41(m)(4)(i)(C).)

4. The Central Valley Water Board may approve an anticipated bypass, after considering its adverse effects, if the Central Valley Water Board determines that it will meet the three conditions listed in Standard Provisions – Permit Compliance I.G.3 above. (40 C.F.R. § 122.41(m)(4)(ii).)
5. Notice
 - a. Anticipated bypass. If the Discharger knows in advance of the need for a bypass, it shall submit a notice, if possible at least 10 days before the date of the bypass. (40 C.F.R. § 122.41(m)(3)(i).)
 - b. Unanticipated bypass. The Discharger shall submit notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below (24-hour notice). (40 C.F.R. § 122.41(m)(3)(ii).)

H. Upset

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the Discharger. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation. (40 C.F.R. § 122.41(n)(1).)

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of Standard Provisions – Permit Compliance I.H.2 below are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review. (40 C.F.R. § 122.41(n)(2).)
2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that (40 C.F.R. § 122.41(n)(3)):
 - a. An upset occurred and that the Discharger can identify the cause(s) of the upset (40 C.F.R. § 122.41(n)(3)(i));
 - b. The permitted facility was, at the time, being properly operated (40 C.F.R. § 122.41(n)(3)(ii));
 - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b below (24-hour notice) (40 C.F.R. § 122.41(n)(3)(iii)); and
 - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above. (40 C.F.R. § 122.41(n)(3)(iv).)
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof. (40 C.F.R. § 122.41(n)(4).)

II. STANDARD PROVISIONS – PERMIT ACTION

A. General

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition. (40 C.F.R. § 122.41(f).)

B. Duty to Reapply

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit. (40 C.F.R. § 122.41(b).)

C. Transfers

This Order is not transferable to any person except after notice to the Central Valley Water Board. The Central Valley Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the Water Code. (40 C.F.R. § 122.41(l)(3); 122.61.)

III. STANDARD PROVISIONS – MONITORING

- A.** Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity. (40 C.F.R. § 122.41(j)(1).)
- B.** Monitoring results must be conducted according to test procedures approved under 40 C.F.R. part 136 for the analyses of pollutants unless another method is required under 40 C.F.R. subchapters N or O. In the case of pollutants for which there are no approved methods under 40 C.F.R. part 136 or otherwise required under 40 C.F.R. subchapters N or O, monitoring must be conducted according to a test procedure specified in this Order for such pollutants. (40 C.F.R. § 122.41(j)(4); 122.44(i)(1)(iv).)

IV. STANDARD PROVISIONS – RECORDS

- A.** Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 C.F.R. part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Central Valley Water Board Executive Officer at any time. (40 C.F.R. § 122.41(j)(2).)
- B.** Records of monitoring information shall include:
 - 1. The date, exact place, and time of sampling or measurements (40 C.F.R. § 122.41(j)(3)(i));
 - 2. The individual(s) who performed the sampling or measurements (40 C.F.R. § 122.41(j)(3)(ii));
 - 3. The date(s) analyses were performed (40 C.F.R. § 122.41(j)(3)(iii));
 - 4. The individual(s) who performed the analyses (40 C.F.R. § 122.41(j)(3)(iv));
 - 5. The analytical techniques or methods used (40 C.F.R. § 122.41(j)(3)(v)); and
 - 6. The results of such analyses. (40 C.F.R. § 122.41(j)(3)(vi).)
- C.** Claims of confidentiality for the following information will be denied (40 C.F.R. § 122.7(b)):
 - 1. The name and address of any permit applicant or Discharger (40 C.F.R. § 122.7(b)(1)); and
 - 2. Permit applications and attachments, permits and effluent data. (40 C.F.R. § 122.7(b)(2).)

V. STANDARD PROVISIONS – REPORTING

A. Duty to Provide Information

The Discharger shall furnish to the Central Valley Water Board, State Water Board, or U.S. EPA within a reasonable time, any information which the Central Valley Water Board, State Water Board, or U.S. EPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Central Valley Water Board, State Water Board, or U.S. EPA copies of records required to be kept by this Order (40 C.F.R. § 122.41(h); Wat. Code, §§ 13267, 13383.).

B. Signatory and Certification Requirements

1. All applications, reports, or information submitted to the Central Valley Water Board, State Water Board, and/or U.S. EPA shall be signed and certified in accordance with Standard Provisions – Reporting V.B.2, V.B.3, V.B.4, and V.B.5 below. (40 C.F.R. § 122.41(k).)
2. All permit applications shall be signed by either a principal executive officer or ranking elected official. For purposes of this provision, a principal executive officer of a federal agency includes: (i) the chief executive officer of the agency, or (ii) a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., Regional Administrators of U.S. EPA). (40 C.F.R. § 122.22(a)(3).)
3. All reports required by this Order and other information requested by the Central Valley Water Board, State Water Board, or U.S. EPA shall be signed by a person described in Standard Provisions – Reporting V.B.2 above, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by a person described in Standard Provisions – Reporting V.B.2 above (40 C.F.R. § 122.22(b)(1));
 - b. The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.) (40 C.F.R. § 122.22(b)(2)); and
 - c. The written authorization is submitted to the Central Valley Water Board and State Water Board. (40 C.F.R. § 122.22(b)(3).)
4. If an authorization under Standard Provisions – Reporting V.B.3 above is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Standard Provisions – Reporting V.B.3 above must be submitted to the Central Valley Water Board and State Water Board prior to or together with any reports, information, or applications, to be signed by an authorized representative. (40 C.F.R. § 122.22(c).)
5. Any person signing a document under Standard Provisions – Reporting V.B.2 or V.B.3 above shall make the following certification:

“I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my

inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.” (40 C.F.R. § 122.22(d).)

C. Monitoring Reports

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program (Attachment E) in this Order. (40 C.F.R. § 122.41(l)(4).)
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Central Valley Water Board or State Water Board for reporting results of monitoring of sludge use or disposal practices. (40 C.F.R. § 122.41(l)(4)(i).)
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under 40 C.F.R. part 136, or another method required for an industry-specific waste stream under 40 C.F.R. subchapters N or O, the results of such monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Central Valley Water Board. (40 C.F.R. § 122.41(l)(4)(ii).)
4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order. (40 C.F.R. § 122.41(l)(4)(iii).)

D. Compliance Schedules

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date. (40 C.F.R. § 122.41(l)(5).)

E. Twenty-Four Hour Reporting

1. The Discharger shall report any noncompliance that may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the Discharger becomes aware of the circumstances. A written submission shall also be provided within five (5) days of the time the Discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance. (40 C.F.R. § 122.41(l)(6)(i).)
2. The following shall be included as information that must be reported within 24 hours under this paragraph (40 C.F.R. § 122.41(l)(6)(ii)):
 - a. Any unanticipated bypass that exceeds any effluent limitation in this Order. (40 C.F.R. § 122.41(l)(6)(ii)(A).)
 - b. Any upset that exceeds any effluent limitation in this Order. (40 C.F.R. § 122.41(l)(6)(ii)(B).)
3. The Central Valley Water Board may waive the above-required written report under this provision on a case-by-case basis if an oral report has been received within 24 hours. (40 C.F.R. § 122.41(l)(6)(iii).)

F. Planned Changes

The Discharger shall give notice to the Central Valley Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when (40 C.F.R. § 122.41(l)(1)):

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in section 122.29(b) (40 C.F.R. § 122.41(l)(1)(i)); or
2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are not subject to effluent limitations in this Order. (40 C.F.R. § 122.41(l)(1)(ii).)
3. The alteration or addition results in a significant change in the Discharger's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan. (40 C.F.R. § 122.41(l)(1)(iii).)

G. Anticipated Noncompliance

The Discharger shall give advance notice to the Central Valley Water Board or State Water Board of any planned changes in the permitted facility or activity that may result in noncompliance with this Order's requirements. (40 C.F.R. § 122.41(l)(2).)

H. Other Noncompliance

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting V.C, V.D, and V.E above at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E above. (40 C.F.R. § 122.41(l)(7).)

I. Other Information

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Central Valley Water Board, State Water Board, or U.S. EPA, the Discharger shall promptly submit such facts or information. (40 C.F.R. § 122.41(l)(8).)

VI. STANDARD PROVISIONS – ENFORCEMENT

- A. The Central Valley Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13385, 13386, and 13387.

VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS

A. Publicly-Owned Treatment Works (POTW's)

All POTW's shall provide adequate notice to the Central Valley Water Board of the following (40 C.F.R. § 122.42(b)):

1. Any new introduction of pollutants into the POTW from an indirect discharger that would be subject to sections 301 or 306 of the CWA if it were directly discharging those pollutants (40 C.F.R. § 122.42(b)(1)); and
2. Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of adoption of the Order. (40 C.F.R. § 122.42(b)(2).)

3. Adequate notice shall include information on the quality and quantity of effluent introduced into the POTW as well as any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW. (40 C.F.R. § 122.42(b)(3).)

ATTACHMENT E – MONITORING AND REPORTING PROGRAM

Contents

I. General Monitoring Provisions E-2

II. Monitoring Locations E-3

III. Influent Monitoring Requirements..... E-4

 A. Monitoring Location INF-001 E-4

IV. Effluent Monitoring Requirements E-4

 A. Monitoring Location EFF-001 E-4

 B. Monitoring Location LND-007 E-5

V. Whole Effluent Toxicity Testing Requirements E-7

VI. Land Discharge Monitoring Requirements – not applicable E-9

VII. Recycling Monitoring Requirements – not applicable E-9

VIII. Receiving Water Monitoring Requirements E-9

 A. Monitoring Locations RSW-001 and RSW-002 E-10

 B. Monitoring Location RGW-001, RGW-002, and RGW-003..... E-11

IX. Other Monitoring Requirements E-12

 A. Biosolids E-12

 B. Municipal Water Supply E-12

 C. Pond Monitoring..... E-13

 D. Effluent and Receiving Water Characterization E-13

X. Reporting Requirements E-17

 A. General Monitoring and Reporting Requirements E-17

 B. Self-Monitoring Reports (SMRs) E-18

 C. Discharge Monitoring Reports (DMRs) – Not Applicable E-20

 D. Reports E-20

Tables

Table E-1. Monitoring Station Locations E-3

Table E-2. Influent Monitoring E-4

Table E-3. D-001 Monitoring For Discharges to Lake Almanor E-4

Table E-4. D-002 Monitoring For Discharges to LND-007 E-6

Table E-6. RSW-001 and RSW-002 Monitoring Requirements E-10

Table E-7. Groundwater Monitoring Requirements E-11

Table E-8. Municipal Water Supply Monitoring Requirements..... E-12

Table E-9. Pond Monitoring Requirements E-13

Table E-10. Effluent and Receiving Water Characterization Monitoring E-14

Table E-11. Monitoring Periods and Reporting Schedule..... E-18

Table E-17. Report Requirements E-21

ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP)

The Code of Federal Regulations (40 C.F.R. § 122.48) requires that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Central Valley Water Board to require technical and monitoring reports. This MRP establishes monitoring and reporting requirements that implement federal and California regulations.

I. GENERAL MONITORING PROVISIONS

- A. Samples and measurements taken as required herein shall be representative of the volume and nature of the monitored discharge. All samples shall be taken at the monitoring locations specified below and, unless otherwise specified, before the monitored flow joins or is diluted by any other waste stream, body of water, or substance. Monitoring locations shall not be changed without notification to and the approval of the Central Valley Water Board.
- B. Effluent samples shall be taken downstream of the last addition of wastes to the treatment or discharge works where a representative sample may be obtained prior to mixing with the receiving waters. Samples shall be collected at such a point and in such a manner to ensure a representative sample of the discharge.
- C. Chemical, bacteriological, and bioassay analyses of any material required by this Order shall be conducted by a laboratory certified for such analyses by the State Water Resources Control Board (State Water Board), Division of Drinking Water (DDW; formerly the Department of Public Health). Laboratories that perform sample analyses must be identified in all monitoring reports submitted to the Central Valley Water Board. In the event a certified laboratory is not available to the Discharger for any onsite field measurements such as pH, dissolved oxygen (DO), turbidity, temperature, and residual chlorine, such analyses performed by a noncertified laboratory will be accepted provided a quality assurance-quality control program is instituted by the laboratory. A manual containing the steps followed in this program for any onsite field measurements such as pH, DO, turbidity, temperature, and residual chlorine must be kept onsite in the treatment facility laboratory and shall be available for inspection by Central Valley Water Board staff. The Discharger must demonstrate sufficient capability (qualified and trained employees, properly calibrated and maintained field instruments, etc.) to adequately perform these field measurements. The quality assurance-quality control program must conform to USEPA guidelines or to procedures approved by the Central Valley Water Board.
- D. Appropriate flow measurement devices and methods consistent with accepted scientific practices shall be selected and used to ensure the accuracy and reliability of measurements of the volume of monitored discharges. All monitoring instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary, at least yearly, to ensure their continued accuracy. All flow measurement devices shall be calibrated at least once per year to ensure continued accuracy of the devices.
- E. Monitoring results, including noncompliance, shall be reported at intervals and in a manner specified in this Monitoring and Reporting Program.
- F. Laboratories analyzing monitoring samples shall be certified by the DDW, in accordance with the provision of Water Code section 13176, and must include quality assurance/quality control data with their reports.
- G. The Discharger shall ensure that the results of the Discharge Monitoring Report-Quality Assurance (DMR-QA) Study or the most recent Water Pollution Performance Evaluation

Study are submitted annually to the State Water Resources Control Board at the following address:

State Water Resources Control Board Quality Assurance Program Officer
 Office of Information Management and Analysis
 State Water Resources Control Board
 1001 I Street, Sacramento, CA 95814

- H. The Discharger shall file with the Central Valley Water Board technical reports on self-monitoring performed according to the detailed specifications contained in this Monitoring and Reporting Program.
- I. The results of all monitoring required by this Order shall be reported to the Central Valley Water Board, and shall be submitted in such a format as to allow direct comparison with the limitations and requirements of this Order. Unless otherwise specified, discharge flows shall be reported in terms of the monthly average and the daily maximum discharge flows.

II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

Table E-1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description ¹
--	INF-001	At a location where a representative sample of influent into the Facility can be collected prior to entrance into any treatment process Latitude: 40.30165° Longitude: -121.22499°
D-001	EFF-001	At a location where a representative effluent sample can be collected when discharge to Lake Almanor occurs Latitude: 40.30164° Longitude: -121.22486°
--	RSW-001	Lake Almanor – Department of Water Resources Station Identification Number 45546 Latitude: 40.3083° Longitude: -121.1972°
--	RSW-002	Lake Almanor – Department of Water Resources Station Identification Number 45545 Latitude: 40.2750° Longitude: -121.1792°
--	LND-001	Facultative Pond 1
--	LND-002	Facultative Pond 2
--	LND-003	Facultative Pond 3
--	LND-004	Facultative Pond 4
--	LND-005	Facultative Pond 5
--	LND-006	Facultative Pond 6
D-002	LND-007	At a location where a representative effluent sample can be collected before discharge into Wetland Pond 1 Latitude: 40.30164° Longitude: -121.22486°
--	LND-008	Wetland Pond 2
--	LND-009	Wetland Pond 3
--	LND-010	Wetland Pond 4
--	RGW-001	Monitoring Well 1
--	RGW-002	Monitoring Well 2
--	RGW-003	Monitoring Well 3
--	BIO-001	Biosolids Storage Area

--	SPL-001	Water Supply
----	---------	--------------

¹ The north latitude and west longitude information in Table 1 are approximate and for administrative purposes.

III. INFLUENT MONITORING REQUIREMENTS

A. Monitoring Location INF-001

1. The Discharger shall monitor influent to the Facility at INF-001 as follows:

Table E-2. Influent Monitoring

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	MGD	Meter	Continuous	--
Conventional Pollutants				
Biochemical Oxygen Demand (5-day at 20°C)	mg/L	Grab ²	1/Week	1
	lbs/day	Calculate	1/Week	--
pH	standard units	Grab ²	1/Week	1,3
Total Suspended Solids	mg/L	Grab ²	1/Week	1
	lbs/day	Calculate	1/Week	--

¹ Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136; or by methods approved by the Central Valley Water Board or the State Water Board.

² Grab samples shall not be collected at the same time each week in order to get a complete representation of variations in the influent.

³ A hand-held field monitor may be used, provided the meter utilizes as USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer’s instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

IV. EFFLUENT MONITORING REQUIREMENTS

A. Monitoring Location EFF-001

1. The Discharger shall monitor D-001 when discharging to Lake Almanor, at a location where a representative effluent sample can be collected, for parameters shown in Table E-3. If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding minimum level:

Table E-3. D-001 Monitoring For Discharges to Lake Almanor

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	mgd	Meter	Continuous	--
Conventional Pollutants				
Biochemical Oxygen Demand (5-day at 20°C)	mg/L	Grab	1/Week	1
	lbs/day	Calculate	1/Week	--
pH	standard units	Grab	Daily ²	1,3
Total Suspended Solids	mg/L	Grab	1/Week	1
	lbs/day	Calculate	1/Week	--
Priority Pollutants				

Copper, Dissolved	µg/L	Grab	1/Quarter	1,4
Copper, Total Recoverable	µg/L	Grab	1/Quarter ⁹	1,4
Priority Pollutants and Other Constituents of Concern	µg/L	Grab	2,5,6	1,4
Zinc, Dissolved	µg/L	Grab	1/Quarter	1,4
Zinc, Total Recoverable	µg/L	Grab	1/Quarter ⁹	1,4
Non-Conventional Pollutants				
Aluminum, Dissolved	µg/L	Grab	1/Quarter	1
Aluminum, Total Recoverable	µg/L	Grab	1/Quarter	1
Ammonia, Total (as Nitrogen)	mg/L	Grab	1/Month ^{2,8}	1
Electrical Conductivity (at 25°C)	µmhos/cm	Grab	1/Week	1,3
Hardness (as CaCO ₃)	mg/L	Grab	1/Month ⁹	1
Nitrate (as Nitrogen)	mg/L	Grab	1/Month ¹⁰	1
Nitrite (as Nitrogen)	mg/L	Grab	1/Month ¹⁰	1
Standard Minerals	mg/L	Grab	1/Year ¹¹	1
Temperature	°F	Grab	Daily ²	1,3
Total Dissolved Solids	mg/L	Grab	1/Month	1
Total Coliform Organisms	MPN/100 mL	Grab	1/Week ¹²	1
Total Residual Chlorine	mg/L	Meter	Continuous	1,3,7
Whole Effluent Toxicity (see Section V. below)	--	--	--	--

- ¹ Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
- ² pH and temperature shall be recorded at the time of ammonia sample collection.
- ³ A hand-held field meter may be used, provided the meter utilizes a USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
- ⁴ For priority pollutant constituents, the reporting level shall be consistent with Sections 2.4.2 and 2.4.3 of the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (See Attachment E, Section IX.D, Table E-10).
- ⁵ Volatile constituents shall be sampled in accordance with 40 CFR Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
- ⁶ See list of Priority Pollutants and Other Constituents of Concern in *Effluent and Receiving Water Characterization Study*, Attachment E, Section IX.D, Table E-10.
- ⁷ Total residual chlorine must be monitored with a method sensitive to and accurate at the permitted level of 0.01 mg/L.
- ⁸ Concurrent with whole effluent toxicity monitoring.
- ⁹ Hardness samples shall be collected concurrently with metal samples.
- ¹⁰ Monitoring for nitrite and nitrate shall be collected concurrently.
- ¹¹ Standard minerals shall include the following: boron, calcium, chloride, iron, magnesium, manganese, phosphate, potassium, sodium, sulfate, and total alkalinity (including alkalinity series), and include verification that the analysis is complete (i.e., cation/anion balance).
- ¹² Samples for total coliform organisms may be collected at any location subsequent to the disinfection process.

B. Monitoring Location LND-007

2. The Discharger shall monitor D-002, when discharging to LND-007, at a location where a representative effluent sample can be collected for parameters shown in Table E-4. If

more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding minimum level:

Table E-4. D-002 Monitoring For Discharges to LND-007

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Flow	mgd	Meter	Continuous	--
Conventional Pollutants				
Biochemical Oxygen Demand (5-day at 20°C)	mg/L	Grab	1/Week	1
	lbs/day	Calculate	1/Week	--
pH	standard units	Grab	Daily ²	1,3
Total Suspended Solids	mg/L	Grab	1/Week	1
	lbs/day	Calculate	1/Week	--
Priority Pollutants				
Copper, Dissolved	µg/L	Grab	1/Quarter	1,4
Copper, Total Recoverable	µg/L	Grab	1/Quarter ⁸	1,4
Zinc, Dissolved	µg/L	Grab	1/Quarter	1,4
Zinc, Total Recoverable	µg/L	Grab	1/Quarter ⁸	1,4
Non-Conventional Pollutants				
Aluminum, Dissolved	µg/L	Grab	1/Quarter	1
Aluminum, Total Recoverable	µg/L	Grab	1/Quarter	1
Ammonia, Total (as NH ₄ ⁺)	mg/L	Grab	1/Month	1
Electrical Conductivity (at 25°C)	µmhos/cm	Grab	1/Week	1,3
Hardness (as CaCO ₃)	mg/L	Grab	1/Quarter ⁸	1
Nitrate (as Nitrogen)	mg/L	Grab	1/Month ⁵	1
Nitrite (as Nitrogen)	mg/L	Grab	1/Month ⁵	1
Standard Minerals	mg/L	Grab	1/Year ⁶	1
Temperature	°F	Grab	Daily ²	1,3
Total Dissolved Solids	mg/L	Grab	1/Month	1
Total Coliform Organisms	MPN/100 mL	Grab	1/Week ⁷	1

¹ Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.

² pH and temperature shall be recorded at the time of ammonia sample collection.

³ A hand-held field meter may be used, provided the meter utilizes a USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

⁴ For priority pollutant constituents, the reporting level shall be consistent with Sections 2.4.2 and 2.4.3 of the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (See Attachment E, Section IX.D, Table E-10).

⁵ Monitoring for nitrite and nitrate shall be sampled concurrently.

⁶ Standard minerals shall include the following: boron, calcium, chloride, iron, magnesium, manganese, phosphate, potassium, sodium, sulfate, and total alkalinity (including alkalinity series), and include verification that the analysis is complete (i.e., cation/anion balance).

⁷ Samples for total coliform organisms may be collected at any location subsequent to the disinfection process.

⁸ Hardness samples shall be collected concurrently with metal samples.

V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

- A. Acute Toxicity Testing.** The Discharger shall conduct acute toxicity testing to determine whether the effluent is contributing acute toxicity to the receiving water. The Discharger shall meet the following acute toxicity testing requirements:
1. Monitoring Frequency – The Discharger shall perform **quarterly acute toxicity testing**, concurrent with effluent ammonia sampling. Acute toxicity testing is only required during the months of allowable discharge and only when a discharge to Lake Almanor has occurred. Acute toxicity testing must be completed within one week of the first day of a discharge to Lake Almanor.
 2. Sample Types – The Discharger may use flow-through or static renewal testing. For static renewal testing, the samples shall be grab samples and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at the effluent monitoring location EFF-001.
 3. Test Species – Test species shall be rainbow trout (*Onchorhynchus Mykiss*).
 4. Methods – The acute toxicity testing samples shall be analyzed using EPA-821-R-02-012, Fifth Edition. Temperature, total residual chlorine, and pH shall be recorded at the time of sample collection. No pH adjustment may be made unless approved by the Executive Officer.
 5. Test Failure – If an acute toxicity test does not meet all test acceptability criteria, as specified in the test method, the Discharger must re-sample and re-test as soon as possible, not to exceed 7 days following notification of test failure.
- B. Chronic Toxicity Testing.** The Discharger shall conduct three species chronic toxicity testing to determine whether the effluent is contributing chronic toxicity to the receiving water. The Discharger shall meet the following chronic toxicity testing requirements:
1. Monitoring Frequency – The Discharger shall perform three species chronic toxicity testing **once before expiration of this permit**. Chronic toxicity testing must be sampled during the months of allowable discharge and should be completed within one week of the first discharge to Lake Almanor for the permit term. If discharge to Lake Almanor does not occur, chronic toxicity testing is not required.
 2. Sample Types – Effluent samples shall grab samples and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at effluent monitoring location EFF-001. The receiving water control shall be a grab sample obtained from the RSW-001 sampling location, as identified in this Monitoring and Reporting Program.
 3. Sample Volumes – Adequate sample volumes shall be collected to provide renewal water to complete the test in the event that the discharge is intermittent.
 4. Test Species – Chronic toxicity testing measures sublethal (e.g., reduced growth, reproduction) and/or lethal effects to test organisms exposed to an effluent compared to that of the control organisms. The Discharger shall conduct chronic toxicity tests with:
 - a. The cladoceran, water flea, *Ceriodaphnia dubia* (survival and reproduction test);
 - b. The fathead minnow, *Pimephales promelas* (larval survival and growth test); and
 - c. The green alga, *Selenastrum capricornutum* (growth test).
 5. Methods – The presence of chronic toxicity shall be estimated as specified in Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA/821-R-02-013, October 2002.

6. Reference Toxicant – As required by the SIP, all chronic toxicity tests shall be conducted with concurrent testing with a reference toxicant and shall be reported with the chronic toxicity test results.
7. Dilutions – For routine and accelerated chronic toxicity monitoring, it is not necessary to perform the test using a dilution series. The test may be performed using 100% effluent and one control. For TRE monitoring, the chronic toxicity testing shall be performed using the dilution series identified in Table E-5, below, unless an alternative dilution series is detailed in the submitted TRE Action Plan. A receiving water control or laboratory water control may be used as the diluent.

Table E-5. Chronic Toxicity Testing Dilution Series

Sample	Dilutions ^a (%)					Control
	100	75	50	25	12.5	
% Effluent	100	75	50	25	12.5	0
% Control Water	0	25	50	75	87.5	100

^a Receiving water control or laboratory water control may be used as the diluent.

8. Test Failure – The Discharger must re-sample and re-test as soon as possible, but no later than fourteen (14) days after receiving notification of a test failure. A test failure is defined as follows:
 - a. The reference toxicant test or the effluent test does not meet all test acceptability criteria as specified in the Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA/821-R-02-013, October 2002 (Method Manual), and its subsequent amendments or revisions; or
 - b. The percent minimum significant difference (PMSD) measured for the test exceeds the upper PMSD bound variability criterion in Table 6 on page 52 of the Method Manual (A retest is only required in this case if the test results do not exceed the monitoring trigger specified in the Special Provision at section VI.2.a.iii. of the Order).
- C. WET Testing Notification Requirements.** The Discharger shall notify the Central Valley Water Board within 24-hours after the receipt of test results exceeding the monitoring trigger during regular or accelerated monitoring, or an exceedance of the acute toxicity effluent limitation.
- D. WET Testing Reporting Requirements.** All toxicity test reports shall include the contracting laboratory’s complete report provided to the Discharger and shall be in accordance with the appropriate “Report Preparation and Test Review” sections of the method manuals. At a minimum, whole effluent toxicity monitoring shall be reported as follows:
1. **Chronic WET Reporting.** Regular chronic toxicity monitoring results shall be reported to the Central Valley Water Board within 30 days following completion of the test, and shall contain, at minimum:
 - a. The results expressed in TUC, measured as 100/NOEC, and also measured as 100/LC50, 100/EC25, 100/IC25, and 100/IC50, as appropriate.
 - b. The statistical methods used to calculate endpoints;
 - c. The statistical output page, which includes the calculation of the percent minimum significant difference (PMSD);
 - d. The dates of sample collection and initiation of each toxicity test; and

- e. The results compared to the numeric toxicity monitoring trigger.
Additionally, the monthly self-monitoring reports shall contain an updated chronology of chronic toxicity test results expressed in TUc, and organized by test species, type of test (survival, growth or reproduction), and monitoring frequency, i.e., either quarterly, monthly, accelerated, or Toxicity Reduction Evaluation (TRE).
2. **Acute WET Reporting.** Acute toxicity test results shall be submitted with the monthly discharger self-monitoring reports and reported as percent survival.
3. **TRE Reporting.** Reports for TREs shall be submitted in accordance with the schedule contained in the Discharger's approved TRE Workplan, or as amended by the Discharger's TRE Action Plan.
4. **Quality Assurance (QA).** The Discharger must provide the following information for QA purposes:
 - a. Results of the applicable reference toxicant data with the statistical output page giving the species, NOEC, LOEC, type of toxicant, dilution water used, concentrations used, PMSD, and dates tested.
 - b. The reference toxicant control charts for each endpoint, which include summaries of reference toxicant tests performed by the contracting laboratory.
 - c. Any information on deviations or problems encountered and how they were dealt with.

VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE

VII. RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE

VIII. RECEIVING WATER MONITORING REQUIREMENTS

Obtaining representative water samples is problematic for upgradient and downgradient receiving water sampling near the Facilities discharge into Lake Almanor. Prior to discharge into Lake Almanor, the secondary treated disinfected municipal wastewater is transferred through a 3,000 foot open channel that varies in length depending on the water elevation in Lake Almanor. Slope in the area of the discharge channel is minimal and the general landscape can be characterized as a marsh, which makes access by foot difficult and unsafe. In addition, because of marsh topography near the location of discharge into Lake Almanor, effluent can become diluted by water from the marsh resulting in the addition of pollutants such as biochemical oxygen demand, total suspended solids, etc. In accordance with a dilution study completed by Flow Science, Inc., the depth of water near the outfall varies from 4 to 18 inches. In accordance with the 1956 United States Geological Survey's Chester, CA, 15 minute Quadrangle, the location of discharge is shallow from the normal point of discharge towards Lake Almanor for at least 0.75 miles. Therefore, obtaining uncontaminated samples would be difficult.

In addition, the dilution study provided indication that the "wind may play a significant role in tracer transport ...," implying that the discharge plume could be effected by wind forces. The dilution study also showed that buoyant forces are highly dependent on daily diurnal fluctuations of water temperature in Lake Almanor. Therefore, it is difficult to identify a reasonable upgradient and downgradient sampling location because wind and buoyant forces can cause effluent to flow in any direction.

The climate of Lake Almanor is typically characterized as a cold weather climate in the winter months. Discharge into Lake Almanor is permitted from 1 October, for any given year, through 31 May of the subsequent year. During water quality sampling, Facility staff persons that collect samples are at risk of falling into Lake Almanor and potentially succumbing to hypothermia. Most boaters, including rescue

boat operators, avoid Lake Almanor in the winter and early spring, unless such access is necessitated by rescue operations.

The above stated reasons were utilized to determine an appropriate receiving water sampling location. Utilizing California Department of Water Resources sampling locations can not only reduce permit costs associated with receiving water sampling, but also provide representative receiving water quality data.

A. Monitoring Locations RSW-001 and RSW-002

1. The Discharger shall monitor Lake Almanor at RSW-001 and RSW-002 for the parameters listed in Table E-6. The California Department of Water Resources (DWR) has monitored Lake Almanor at these two locations historically. DWR sampling results can be utilized to meet monitoring requirements as prescribed in this monitoring and reporting program. However, the Discharger is obligated to gather all water quality data required by this monitoring and reporting program even if sampling is not completed by the DWR. Sampling efforts should be coordinated with the DWR whenever possible.

Table E-6. RSW-001 and RSW-002 Monitoring Requirements

Parameter	Units	Sample Type	Minimum Sampling Frequency ⁵	Required Analytical Test Method
Conventional Pollutants				
pH	Standard	Grab	1/Week	1,2
Priority Pollutants				
Copper, Dissolved	µg/L	Grab	1/Month	1,4
Copper, Total Recoverable	µg/L	Grab	1/Month ⁷	1,4
Priority Pollutants	µg/L	Grab	^{3,6,7}	1,4
Zinc, Dissolved	µg/L	Grab	1/Month	1,4
Zinc, Total Recoverable	µg/L	Grab	1/Month ⁷	1,4
Non-Conventional Pollutants				
Aluminum, Dissolved	µg/L	Grab	1/Quarter	1
Aluminum, Total Recoverable	µg/L	Grab	1/Quarter	1
Ammonia, Total (as Nitrogen)	mg/L	Grab	1/Month	1
Chloride	mg/L	Grab	1/Year	1
Electrical Conductivity (at 25°C)	µmhos/cm	Grab	1/Year	1,2
Dissolved Oxygen	mg/L	Grab	1/Week	1,2
Hardness	mg/L	Grab	1/Month ⁷	1,
Sulfate	mg/L	Grab	1/Year	1
TDS	mg/L	Grab	1/Year	1
Temperature	°F	Grab	1/Week	1,2

¹ Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.

² A hand-held field meter may be used, provided the meter utilizes a USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

- ³ See list of Priority Pollutants and Other Constituents of Concern in *Effluent and Receiving Water Characterization Study*, Attachment E, Section IX.D., Table E-10.
- ⁴ For priority pollutant constituents, the reporting level shall be consistent with Sections 2.4.2 and 2.4.3 of the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (See Attachment E, Section IX.D, Table E-10).
- ⁵ Sampling is only required during the months of allowable discharge (from 1 October, for any given year, through 31 May, of the following year). If there is no discharge from the Facility into Lake Almanor, receiving water sampling is not required. However, receiving water data is necessary for the permit renewal process. Therefore, sampling should be completed at least twice in any given year during the allowable period of discharge.
- ⁶ Sampling only required at RSW-001.
- ⁷ Hardness samples shall be collected concurrently with metal samples.

B. Monitoring Location RGW-001, RGW-002, and RGW-003

- 1. Prior to construction and/or beginning a sampling program of any new groundwater monitoring wells, the Discharger shall submit plans and specifications to the Central Valley Water Board for approval. Once installed, all new wells shall be added to the monitoring network (which currently consists of Monitoring Location RGW-001, RGW-002 and RGW-003) and shall be sampled and analyzed according to the schedule below. All samples shall be collected using approved EPA methods. Water table elevations shall be calculated to determine groundwater gradient and direction of flow.
- 2. Prior to sampling, the groundwater elevations shall be measured and the wells shall be purged of at least three well volumes until temperature, pH, and electrical conductivity have stabilized. Depth to groundwater shall be measured to the nearest 0.01 feet. Groundwater monitoring at RGW-001, RGW-002, RGW-003, and any new groundwater monitoring wells shall include, at a minimum, the following:

Table E-7. Groundwater Monitoring Requirements

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Depth to Groundwater	±0.01 feet	Measurement	1/Quarter	--
Groundwater Elevation	±0.01 feet	Calculated	1/Quarter ¹	--
Gradient	feet/feet	Calculated	1/Quarter	--
Gradient Direction	degrees	Calculated	1/Quarter	--
Conventional Pollutants				
pH	standard units	Grab	1/Quarter	2,4
Non-Conventional Pollutants				
Ammonia (as NH ₄ ⁺)	mg/L	Grab	1/Quarter	2
Dissolved Oxygen	mg/L	Grab	1/Quarter	2,4
Electrical Conductivity (at 25°C)	µmhos/cm	Grab	1/Quarter	2,4
Total Dissolved Solids	mg/L	Grab	1/Quarter	2
Metals ⁵	µg/L	Grab	1/Quarter	2
Nitrate (as Nitrogen)	mg/L	Grab	1/Quarter	2
Nitrite (as Nitrogen)	mg/L	Grab	1/Quarter	2
Standard Minerals	µg/L	Grab	1/Year ³	2
Temperature	°F	Grab	1/Quarter	2,4
Total Coliform Organisms	MPN/100 mL	Grab	1/Quarter	2
Total Kjeldahl Nitrogen	mg/L	Grab	1/Quarter	2

- ¹ Groundwater elevation shall be determined based on depth-to-water measurements from a surveyed measuring point elevation on the well. The groundwater elevation shall be used to calculate the direction and gradient of groundwater flow, which must be reported.
- ² Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
- ³ Standard minerals shall include the following: aluminum, boron, calcium, chloride, hardness, magnesium, phosphate, potassium, sodium, sulfate, and total alkalinity (including alkalinity series), and include verification that the analysis is complete (i.e., cation/anion balance).
- ⁴ A hand-held field meter may be used, provided the meter utilizes a USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
- ⁵ At a minimum, the following metals shall be included: arsenic, copper, lead, iron, manganese, nickel, and zinc. Analytical methods shall be selected to provide reporting limits below water quality limit for each constituent.

IX. OTHER MONITORING REQUIREMENTS

A. Biosolids

1. Monitoring Location BIO-001
 - a. A composite sample of sludge shall be collected annually or any time that sludge is removed from the ponds, whichever is less frequent, at Monitoring Location BIO-001, in accordance with EPA's *POTW Sludge Sampling and Analysis Guidance Document*, August 1989, and tested for metals listed in Table 64431-A, Title 22, section 64431, California Code of Regulations.
 - b. Biosolids monitoring shall be conducted using the methods in Test Methods for Evaluating Solid Waste, Physical/Chemical methods (EPA publication SW-846), as required in 40 CFR 503.8(b)(4). All results must be reported on a 100% dry weight basis. Records of all analyses must state on each page of the laboratory report whether the results are expressed in "100% dry weight" or "as is."
 - c. Sampling records shall be retained for a minimum of **5 years**. A log shall be maintained of sludge quantities generated and of handling and disposal activities. The frequency of entries is discretionary; however, the log must be complete enough to serve as a basis for part of the annual report.

B. Municipal Water Supply

1. Monitoring Location SPL-001
 - a. The Discharger shall monitor the municipal water supply at SPL-001 as follows. A sampling station shall be established where a representative sample of the municipal water supply can be obtained. Municipal water supply samples shall be collected at approximately the same time as effluent samples.

Table E-8. Municipal Water Supply Monitoring Requirements

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Copper, Total Recoverable	µg/L	Grab	1/year	²
Electrical Conductivity at 25°C	µmhos/cm	Grab	4/year ¹	^{2,4}
Standard Minerals	mg/L	Grab	1/year ³	²
Total Dissolved Solids	mg/L	Grab	1/year ¹	²
Zinc, Total Recoverable	µg/L	Grab	1/year	²

- 1 If the water supply is from more than one source, the total dissolved solids and electrical conductivity shall be reported as a weighted average and include copies of supporting calculations.
- 2 Pollutants shall be analyzed using the analytical methods described in 40 CFR part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
- 3 Standard minerals shall include the following: aluminum, boron, calcium, chloride, hardness, iron, magnesium, manganese, phosphate, potassium, sodium, sulfate, and total alkalinity (including alkalinity series), and include verification that the analysis is complete (i.e., cation/anion balance).
- 4 A hand-held field meter may be used, provided the meter utilizes a USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

C. Pond Monitoring

Monitoring locations LND-001, LND-002, LND-003, LND-004, LND-005, LND-006, LND-007, LND-008, LND-009, and LND-010. The Discharger shall monitor as follows:

Table E-9. Pond Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Required Analytical Test Method
Measured				
Dissolved Oxygen	mg/L	Grab	1/Month ¹	2,3
Electrical Conductivity (at 25°C)	µmhos/cm	Grab	1/Month ¹	2,3
Liquid Depth and Freeboard	Feet	Visual	1/Month	Visual or Measured
pH	Standard Units	Grab	1/Month ¹	2,3
Observations				
Seepage through pond dikes	Presence/Absence	Visual	1/Month	Visual
Excessive odors or other nuisances	Presence/Absence	Observation	1/Month	Visual
Excessive weed growth in pond	Presence/Absence	Visual	1/Month	Visual

- 1 For LND-001 and LND-002 only. When weather conditions inhibit safe collecting procedures and/or result in unrepresentative samples the Discharger can collect samples from one or both ponds to satisfy monitoring requirements (e.g., when samples cannot be collected because one or more pond surfaces are frozen).
- 2 Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
- 3 A hand-held field meter may be used, provided the meter utilizes a USEPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

D. Effluent and Receiving Water Characterization

Monitoring. Samples shall be collected from the effluent and upstream receiving water (EFF-001 and RSW-001) and analyzed for the constituents listed in Table E-10, below. During the allowed discharge period, constituents listed in Table E-10 shall be sampled for once during the third year following permit adoption. Sampling should be completed during a time of discharge to Lake Almanor, and, if discharge to lake Almanor does not occur, please sample for the listed constituents while discharging to the wetland ponds before the end of an allowable discharge period.

2. **Concurrent Sampling.** Effluent and receiving water sampling shall be performed at approximately the same time, on the same date.
3. **Sample type.** All receiving water samples shall be taken as grab samples. Effluent samples shall be taken as described in Table E-10, below.

Table E-10. Effluent and Receiving Water Characterization Monitoring

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
2-Chloroethyl vinyl ether	µg/L	Grab	1
Acrolein	µg/L	Grab	2
Acrylonitrile	µg/L	Grab	2
Benzene	µg/L	Grab	0.5
Bromoform	µg/L	Grab	0.5
Carbon Tetrachloride	µg/L	Grab	0.5
Chlorobenzene	µg/L	Grab	0.5
Chloroethane	µg/L	Grab	0.5
Chloroform	µg/L	Grab	2
Chloromethane	µg/L	Grab	2
Dibromochloromethane	µg/L	Grab	0.5
Dichlorobromomethane	µg/L	Grab	0.5
Dichloromethane	µg/L	Grab	2
Ethylbenzene	µg/L	Grab	2
Hexachlorobenzene	µg/L	Grab	1
Hexachlorobutadiene	µg/L	Grab	1
Hexachloroethane	µg/L	Grab	1
Methyl bromide (Bromomethane)	µg/L	Grab	1
Naphthalene	µg/L	Grab	10
Parachlorometa cresol	µg/L	Grab	--
Tetrachloroethene	µg/L	Grab	0.5
Toluene	µg/L	Grab	2
trans-1,2-Dichloroethylene	µg/L	Grab	1
Trichloroethene	µg/L	Grab	2
Vinyl chloride	µg/L	Grab	0.5
Methyl-tert-butyl ether (MTBE)	µg/L	Grab	--
Trichlorofluoromethane	µg/L	Grab	--
1,1,1-Trichloroethane	µg/L	Grab	0.5
1,1-dichloroethane	µg/L	Grab	0.5
1,1-dichloroethylene	µg/L	Grab	0.5
1,2-dichloropropane	µg/L	Grab	0.5
1,3-dichloropropylene	µg/L	Grab	0.5
1,1,2,2-tetrachloroethane	µg/L	Grab	0.5
1,1,2-Trichloro-1,2,2-Trifluoroethane	µg/L	Grab	0.5
1,2,4-trichlorobenzene	µg/L	Grab	1
1,2-dichloroethane	µg/L	Grab	0.5
1,2-dichlorobenzene	µg/L	Grab	0.5
1,3-dichlorobenzene	µg/L	Grab	0.5
1,4-dichlorobenzene	µg/L	Grab	0.5
Styrene	µg/L	Grab	--
Xylenes	µg/L	Grab	--
1,2-Benzanthracene	µg/L	Grab	5
1,2-Diphenylhydrazine	µg/L	Grab	1
2-Chlorophenol	µg/L	Grab	5
2,4-Dichlorophenol	µg/L	Grab	5
2,4-Dimethylphenol	µg/L	Grab	2
2,4-Dinitrophenol	µg/L	Grab	5
2,4-Dinitrotoluene	µg/L	Grab	5
2,4,6-Trichlorophenol	µg/L	Grab	10
2,6-Dinitrotoluene	µg/L	Grab	5

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
2-Nitrophenol	µg/L	Grab	10
2-Chloronaphthalene	µg/L	Grab	10
3,3'-Dichlorobenzidine	µg/L	Grab	5
3,4-Benzofluoranthene	µg/L	Grab	10
4-Chloro-3-methylphenol	µg/L	Grab	5
4,6-Dinitro-2-methylphenol	µg/L	Grab	10
4-Nitrophenol	µg/L	Grab	10
4-Bromophenyl phenyl ether	µg/L	Grab	10
4-Chlorophenyl phenyl ether	µg/L	Grab	5
Acenaphthene	µg/L	Grab	1
Acenaphthylene	µg/L	Grab	10
Anthracene	µg/L	Grab	10
Benzidine	µg/L	Grab	5
Benzo(a)pyrene (3,4-Benzopyrene)	µg/L	Grab	2
Benzo(g,h,i)perylene	µg/L	Grab	5
Benzo(k)fluoranthene	µg/L	Grab	2
Bis(2-chloroethoxy) methane	µg/L	Grab	5
Bis(2-chloroethyl) ether	µg/L	Grab	1
Bis(2-chloroisopropyl) ether	µg/L	Grab	10
Bis(2-ethylhexyl) phthalate ²	µg/L	Grab	5
Butyl benzyl phthalate	µg/L	Grab	10
Chrysene	µg/L	Grab	5
Di-n-butylphthalate	µg/L	Grab	10
Di-n-octylphthalate	µg/L	Grab	10
Dibenzo(a,h)-anthracene	µg/L	Grab	0.1
Diethyl phthalate	µg/L	Grab	10
Dimethyl phthalate	µg/L	Grab	10
Fluoranthene	µg/L	Grab	10
Fluorene	µg/L	Grab	10
Hexachlorocyclopentadiene	µg/L	Grab	5
Indeno(1,2,3-c,d)pyrene	µg/L	Grab	0.05
Isophorone	µg/L	Grab	1
N-Nitrosodiphenylamine	µg/L	Grab	1
N-Nitrosodimethylamine	µg/L	Grab	5
N-Nitrosodi-n-propylamine	µg/L	Grab	5
Nitrobenzene	µg/L	Grab	10
Pentachlorophenol	µg/L	Grab	1
Phenanthrene	µg/L	Grab	5
Phenol	µg/L	Grab	1
Pyrene	µg/L	Grab	10
Aluminum	µg/L	Grab	
Antimony	µg/L	Grab	5
Arsenic	µg/L	Grab	10
Asbestos	µg/L	Grab	--
Barium	µg/L	Grab	--
Beryllium	µg/L	Grab	2
Cadmium	µg/L	Grab	0.5
Chromium (III)	µg/L	Grab	50
Chromium (VI)	µg/L	Grab	10
Cyanide	µg/L	Grab	5
Fluoride	µg/L	Grab	--

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
Iron	µg/L	Grab	--
Lead	µg/L	Grab	0.5
Mercury	µg/L	Grab	0.5
Manganese	µg/L	Grab	--
Molybdenum	µg/L	Grab	--
Nickel	µg/L	Grab	20
Selenium	µg/L	Grab	5
Silver	µg/L	Grab	0.25
Thallium	µg/L	Grab	1
Tributyltin	µg/L	Grab	--
Zinc ³	µg/L	Grab	20
4,4'-DDD	µg/L	Grab	0.05
4,4'-DDE	µg/L	Grab	0.05
4,4'-DDT	µg/L	Grab	0.01
alpha-Endosulfan	µg/L	Grab	0.02
alpha-Hexachlorocyclohexane (BHC)	µg/L	Grab	0.01
Alachlor	µg/L	Grab	--
Aldrin	µg/L	Grab	0.005
beta-Endosulfan	µg/L	Grab	0.01
beta-Hexachlorocyclohexane	µg/L	Grab	0.005
Chlordane	µg/L	Grab	0.1
delta-Hexachlorocyclohexane	µg/L	Grab	0.005
Dieldrin	µg/L	Grab	0.01
Endosulfan sulfate	µg/L	Grab	0.01
Endrin	µg/L	Grab	0.01
Endrin Aldehyde	µg/L	Grab	0.01
Heptachlor	µg/L	Grab	0.01
Heptachlor Epoxide	µg/L	Grab	0.02
Lindane (gamma-Hexachlorocyclohexane)	µg/L	Grab	0.5
PCB-1016	µg/L	Grab	0.5
PCB-1221	µg/L	Grab	0.5
PCB-1232	µg/L	Grab	0.5
PCB-1242	µg/L	Grab	0.5
PCB-1248	µg/L	Grab	0.5
PCB-1254	µg/L	Grab	0.5
PCB-1260	µg/L	Grab	0.5
Toxaphene	µg/L	Grab	--
Atrazine	µg/L	Grab	--
Bentazon	µg/L	Grab	--
Carbofuran	µg/L	Grab	--
2,4-D	µg/L	Grab	--
Dalapon	µg/L	Grab	--
1,2-Dibromo-3-chloropropane (DBCP)	µg/L	Grab	--
Di(2-ethylhexyl)adipate	µg/L	Grab	--
Dinoseb	µg/L	Grab	--
Diquat	µg/L	Grab	--
Endothal	µg/L	Grab	--
Ethylene Dibromide	µg/L	Grab	--
Methoxychlor	µg/L	Grab	--
Molinate (Ordram)	µg/L	Grab	--

Parameter	Units	Effluent Sample Type	Maximum Reporting Level ¹
Oxamyl	µg/L	Grab	--
Picloram	µg/L	Grab	--
Simazine (Princep)	µg/L	Grab	--
Thiobencarb	µg/L	Grab	--
2,3,7,8-TCDD (Dioxin)	µg/L	Grab	--
2,4,5-TP (Silvex)	µg/L	Grab	--
Diazinon	µg/L	Grab	--
Chlorpyrifos	µg/L	Grab	--
Ammonia, Total (as N)	mg/L	Grab	--
Boron	µg/L	Grab	--
Chloride	mg/L	Grab	--
Flow	MGD	Meter	--
Hardness (as CaCO ₃)	mg/L	Grab	--
Foaming Agents (MBAS)	µg/L	Grab	--
Mercury, Methyl	ng/L	Grab	--
Nitrate (as N)	mg/L	Grab	--
Nitrite (as N)	mg/L	Grab	--
pH	Standard Units	Grab	--
Phosphorus, Total (as P)	mg/L	Grab	--
Specific conductance (EC)	µmhos/cm	Grab	--
Sulfate	mg/L	Grab	--
Sulfide (as S)	mg/L	Grab	--
Sulfite (as SO ₃)	mg/L	Grab	--
Temperature	°F	Grab	--
Total Dissolved Solids (TDS)	mg/L	Grab	--

- ¹ The reporting levels required in this table for priority pollutant constituents are established based on Section 2.4.2 and Appendix 4 of the SIP.
- ² In order to verify if bis (2-ethylhexyl) phthalate is truly present, the Discharger shall take steps to assure that sample containers, sampling apparatus, and analytical equipment are not sources of the detected contaminant.
- ³ The Discharger is not required to conduct effluent monitoring for constituents that have already been sampled in a given month, as required in Table E-3, except for hardness, pH, and temperature, which shall be conducted concurrently with effluent sampling.

X. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. Upon written request of the Central Valley Water Board, the Discharger shall submit a summary monitoring report. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year(s).
3. **Compliance Time Schedules.** For compliance time schedules included in the Order, the Discharger shall submit to the Central Valley Water Board, on or before compliance due dates, the specified document or a written report detailing compliance or noncompliance with the specific date and task. If noncompliance is reported, the Discharger shall state the reasons for noncompliance and include an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Central

Valley Water Board by letter when it returns to compliance with the compliance time schedule.

4. The Discharger shall report to the Central Valley Water Board any toxic chemical release data it reports to the State Emergency Response Commission within 15 days of reporting the data to the Commission pursuant to section 313 of the "Emergency Planning and Community Right to Know Act" of 1986.

B. Self-Monitoring Reports (SMRs)

1. The Discharger shall electronically submit SMRs using the State Water Board's California Integrated Water Quality System (CIWQS) Program Web site (<http://www.waterboards.ca.gov/ciwqs/index.html>). The CIWQS Web site will provide additional information for SMR submittal in the event there will be a planned service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through IX. The Discharger shall submit monthly, quarterly, and annual SMRs including the results of all required monitoring using U.S. EPA-approved test methods or other test methods specified in this Order. SMRs are to include all new monitoring results obtained since the last SMR was submitted. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.
3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

Table E-11. Monitoring Periods and Reporting Schedule

Sampling Frequency	Monitoring Period Begins On...	Monitoring Period	SMR Due Date
Continuous	Permit effective date	All	Submit with monthly SMR
1/Day	Permit effective date	(Midnight through 11:59 PM) or any 24-hour period that reasonably represents a calendar day for purposes of sampling.	Submit with monthly SMR
1/Week	Permit effective date	Sunday through Saturday	Submit with monthly SMR
1/Month	Permit effective date	1 st day of calendar month through last day of calendar month	First day of second calendar month following month of sampling
1/Quarter	Permit effective date	1 January through 31 March 1 April through 30 June 1 July through 30 September 1 October through 31 December	1 May 1 August 1 November 1 February of following year
1/Year	Permit effective date	January 1 through December 31	1 February of following year

4. **Reporting Protocols.** The Discharger shall report with each sample result the applicable Reporting Level (RL) and the current laboratory's Method Detection Limit (MDL), as determined by the procedure in 40 C.F.R. part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).

- b. Sample results less than the RL, but greater than or equal to the laboratory's MDL, shall be reported as "Detected, but Not Quantified," or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ. The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (\pm a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.
 - c. Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.
 - d. Dischargers are to instruct laboratories to establish calibration standards so that the Minimum Level (ML) value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.
5. **Multiple Sample Data.** When determining compliance with an AMEL or MDEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
- a. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
6. The Discharger shall submit SMRs in accordance with the following requirements:
- a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data is required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDR's; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.

- c. The Discharger shall attach all laboratory analysis sheets, including quality assurance/quality control information, with all its SMRs for which sample analyses were performed.
7. The Discharger shall submit in the SMRs calculations and reports in accordance with the following requirements:
 - a. **Calendar Annual Average Limitations.** For constituents with effluent limitations specified as “calendar annual average” (aluminum, electrical conductivity, iron, and manganese) the Discharger shall report the calendar annual average in the December SMR. The annual average shall be calculated as the average of the samples gathered for the calendar year.
 - b. **Mass Loading Limitations.** For BOD₅, TSS, and ammonia, the Discharger shall calculate and report the mass loading (lbs/day) in the SMRs. The mass loading shall be calculated as follows:
$$\text{Mass Loading (lbs/day)} = \text{Flow (MGD)} \times \text{Concentration (mg/L)} \times 8.34$$

When calculating daily mass loading, the daily average flow and constituent concentration shall be used. For weekly average mass loading, the weekly average flow and constituent concentration shall be used. For monthly average mass loading, the monthly average flow and constituent concentration shall be used.
 - c. **Removal Efficiency (BOD₅ and TSS).** The Discharger shall calculate and report the percent removal of BOD₅ and TSS in the SMRs. The percent removal shall be calculated as specified in Section VII.a. of the Limitations and Discharge Requirements.
 - d. **Total Coliform Organisms Effluent Limitations.** The Discharger shall calculate and report the 7-day median of total coliform organisms for the effluent. The 7 day median of total coliform organisms shall be calculated as specified in Section VII.c. of the Limitations and Discharge Requirements.
 - e. **Dissolved Oxygen Receiving Water Limitations.** The Discharger shall calculate and report monthly in the self-monitoring report: i) the dissolved oxygen concentration, ii) the percent of saturation in the main water mass, and iii) the 95th percentile dissolved oxygen concentration.
 - f. **Turbidity Receiving Water Limitations.** The Discharger shall calculate and report the turbidity increase in the receiving water applicable to the natural turbidity condition specified in Section V.A.17.a-e. of the Limitations and Discharge Requirements.
 - g. **Temperature Receiving Water Limitations.** The Discharger shall calculate and report the temperature increase in the receiving water based on the difference in temperature at RSW-002 and RSW-003.

C. Discharge Monitoring Reports (DMRs) – Not Applicable

D. Reports

1. The following reports are required during the term of this permit.

Table E-17. Report Requirements

Reports	Reporting Due Date
Reporting Levels, Method Detection Limits, and Analytical Methods Report (Attachment E, Section X.D.2, page E-21)	Within 60 days following adoption of this Order
Initial Investigative TRE Workplan (Section VI.C.2.a, page 13)	Within 90 days of the effective date of this Order
Pollution Prevention Plan for Total Ammonia and Total Coliform (Section VI.C.3.b, page 16)	19 December 2016
Biosolids Use or Disposal Plan (Section VI.C.5.b, page 18)	Within 180 days of the permit effective date
Groundwater Monitoring Network Verification and Groundwater Quality Characterization Study (Section VI.C.2.b, page 14)	Within 30 months following adoption of this Order
Best Practical Treatment or Control (Section VI.C.2.c, page 15)	Within 48 months following adoption of this Order
Salinity Evaluation and Minimization Plan (Section VI.C.3.c, page 16)	Within 9 months of the adoption date of this Order
Outline of reporting levels, method detection limits, and analytical methods for the constituents listed Table E-10 (Attachment E, Section X.D.2, page E-21)	No less than 6 months prior to conducting the effluent and receiving water characterization monitoring required in Section IX. D
Annual Operations Report (Attachment E, Section X.D.3, page E-21)	Annually on 1 February each year following the permit effective date

2. **Within 60 days of permit adoption**, the Discharger shall submit a report outlining reporting levels (RL's), method detection limits, and analytical methods for the constituents listed in Tables E-2, E-3, E-5, E-6, E-7, E-8, and E-9. In addition, **no less than 6 months prior** to conducting the effluent and receiving water characterization monitoring required in Section IX. D, the Discharger shall submit a report outlining RL's, MDL's, and analytical methods for the constituents listed in Table E-10. The Discharger shall comply with the monitoring and reporting requirements for CTR constituents as outlined in Section 2.3 and 2.4 of the SIP. The maximum required reporting levels for priority pollutant constituents shall be based on the Minimum Levels (ML's) contained in Appendix 4 of the SIP, determined in accordance with Section 2.4.2 and Section 2.4.3 of the SIP. In accordance with Section 2.4.2 of the SIP, when there is more than one ML value for a given substance, the Central Valley Water Board shall include as RL's, in the permit, all ML values, and their associated analytical methods, listed in Appendix 4 that are below the calculated effluent limitation. The Discharger may select any one of those cited analytical methods for compliance determination. If no ML value is below the effluent limitation, then the Central Valley Water Board shall select as the RL, the lowest ML value, and its associated analytical method, listed in Appendix 4 for inclusion in the permit. Table E-10 (Attachment E) provides required maximum reporting levels in accordance with the SIP.
3. **By 30 January of each year**, the Discharger shall submit an annual operations report to the Executive Officer containing the following:
 - a. The names, certificate grades, and general responsibilities of all persons employed at the Facility.

- b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
- c. A statement certifying when the flow meter(s) and other monitoring instruments and devices were last calibrated, including identification of who performed the calibration.
- d. A statement certifying whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last revised and last reviewed for adequacy.
- e. The Discharger may also be requested to submit an annual report to the Central Valley Water Board with both tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the compliance record. If violations have occurred, the report shall also discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

ATTACHMENT F – FACT SHEET

Contents

I.	Permit Information.....	F-3
II.	Facility Description.....	F-4
	A. Description of Wastewater and Biosolids Treatment and Controls.....	F-4
	B. Discharge Points and Receiving Waters.....	F-4
	C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data.....	F-5
	D. Compliance Summary.....	F-5
	E. Planned Changes – Not Applicable.....	F-7
III.	Applicable Plans, Policies, and Regulations.....	F-7
	A. Legal Authorities.....	F-7
	B. California Environmental Quality Act (CEQA).....	F-7
	C. State and Federal Laws, Regulations, Policies, and Plans.....	F-7
	D. Impaired Water Bodies on CWA 303(d) List.....	F-9
	E. Other Plans, Policies and Regulations.....	F-10
IV.	Rationale For Effluent Limitations and Discharge Specifications.....	F-10
	A. Discharge Prohibitions.....	F-11
	B. Technology-Based Effluent Limitations.....	F-12
	1. Scope and Authority.....	F-12
	2. Applicable Technology-Based Effluent Limitations.....	F-12
	C. Water Quality-Based Effluent Limitations (WQBEL's).....	F-13
	1. Scope and Authority.....	F-13
	2. Applicable Beneficial Uses and Water Quality Criteria and Objectives.....	F-14
	3. Determining the Need for WQBEL's.....	F-23
	4. WQBEL Calculations.....	F-33
	5. Whole Effluent Toxicity (WET).....	F-35
	D. Final Effluent Limitation Considerations.....	F-37
	1. Mass-based Effluent Limitations.....	F-37
	2. Averaging Periods for Effluent Limitations.....	F-38
	3. Satisfaction of Anti-Backsliding Requirements.....	F-38
	4. Antidegradation Policies.....	F-39
	5. Stringency of Requirements for Individual Pollutants.....	F-40
	E. Interim Effluent Limitations.....	F-41
	F. Land Discharge Specifications– Not Applicable.....	F-43
	G. Recycling Specifications– Not Applicable.....	F-44
V.	Rationale for Receiving Water Limitations.....	F-44
	A. Surface Water.....	F-44
	B. Groundwater.....	F-44
VI.	Rationale for Provisions.....	F-44
	A. Standard Provisions.....	F-44
	B. Special Provisions.....	F-45
	1. Reopener Provisions.....	F-45
	2. Special Studies and Additional Monitoring Requirements.....	F-45
	3. Best Management Practices and Pollution Prevention.....	F-49
	4. Construction, Operation, and Maintenance Specifications.....	F-50
	5. Special Provisions for Municipal Facilities (POTW's Only).....	F-50
	6. Compliance Schedules.....	F-51
VII.	Rationale for Monitoring and Reporting Requirements.....	F-52

A.	Influent Monitoring	F-52
B.	Effluent Monitoring	F-52
C.	Whole Effluent Toxicity Testing Requirements	F-53
D.	Receiving Water Monitoring	F-53
1.	Surface Water	F-53
2.	Groundwater.....	F-53
E.	Other Monitoring Requirements	F-54
VIII.	Public Participation.....	F-54
A.	Notification of Interested Parties	F-54
B.	Written Comments	F-55
C.	Public Hearing	F-55
D.	Reconsideration of Waste Discharge Requirements	F-55
E.	Information and Copying.....	F-55
F.	Register of Interested Persons.....	F-55
G.	Additional Information	F-56

Tables

Table F-1.	Facility Information.....	F-3
Table F-2.	Historic Effluent Limitations and Monitoring Data.....	F-5
Table F-3.	Basin Plan Beneficial Uses	F-7
Table F-4.	303 (d) List for Lake Almanor.....	F-10
Table F-5.	Summary of Technology-based Effluent Limitations	F-13
Table F-6.	CTR Compliance with Cadmium, Copper, Chromium III, Lead, Nickel, Silver, and Zinc given Mixed Downgradient Conditions (Design Ambient Hardness = 46 mg/L).	F-21
Table F-7.	Summary of ECA Evaluations for CTR Hardness-dependent Metals	F-23
Table F-8.	Summary of Water Quality-Based Effluent Limitations.....	F-34
Table F-9.	Summary of Final Effluent Limitations.....	F-40
Table F-11.	Interim Effluent Limitation Calculation Summary.....	F-43

ATTACHMENT F – FACT SHEET

As described in section II.B of this Order, the Central Valley Water Board incorporates this Fact Sheet as findings of the Central Valley Water Board supporting the issuance of this Order. This Fact Sheet includes the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

This Order has been prepared under a standardized format to accommodate a broad range of discharge requirements for Dischargers in California. Only those sections or subsections of this Order that are specifically identified as “not applicable” have been determined not to apply to this Discharger. Sections or subsections of this Order not specifically identified as “not applicable” are fully applicable to this Discharger.

I. PERMIT INFORMATION

The following table summarizes administrative information related to the facility.

Table F-1. Facility Information

WDID	5A320100001
Discharger	Chester Public Utility District
Name of Facility	Chester Wastewater Treatment Plant
Facility Address	881 First Avenue Chester, CA 96020 Plumas County
Facility Contact, Title and Phone	Joe Waterman, General Manager, (530) 258-2171 Andrew Capella, Wastewater Treatment Operator, Grade II, (530) 258-2171
Authorized Person to Sign and Submit Reports	Andrew Capella, Wastewater Treatment Operator, Grade II, (530) 258-2171
Mailing Address	P.O. Box 503, Chester, CA, 96020
Billing Address	P.O. Box 503, Chester, CA, 96020
Type of Facility	Publicly Owned Treatment Works (POTW)
Major or Minor Facility	Minor
Threat to Water Quality	2
Complexity	B
Pretreatment Program	N
Recycling Requirements	N/A
Facility Permitted Flow	0.5 million gallons per day (MGD) (average dry weather flow)
Facility Design Flow	0.75 MGD
Watershed	Lake Almanor Hydrologic Area (518.41)
Receiving Water	Lake Almanor
Receiving Water Type	Inland Surface Water

- A.** The Chester Public Utility District (hereinafter Discharger) is the owner and operator of the Chester Wastewater Treatment Plant (hereinafter Facility), a POTW.

For the purposes of this Order, references to the “discharger” or “permittee” in applicable federal and state laws, regulations, plans, or policy are held to be equivalent to references to the Discharger herein.

- B.** Wastewater is discharged from the Facility to Lake Almanor, a water of the United States. The Discharger was previously regulated by Order R5-2009-0078 and National Pollutant

Discharge Elimination System (NPDES) Permit No. CA0077747 adopted on 13 August 2009, which expired on 1 August 2014. Attachment B provides a map of the area around the Facility. Attachment C provides a flow schematic of the Facility.

Prior to making any change in the point of discharge, place of use, or purpose of use of treated wastewater that results in a decrease of flow in any portion of a watercourse, the Discharger must file a petition with the State Water Board, Division of Water Rights, and receive approval for such a change. The State Water Board retains the jurisdictional authority to enforce such requirements under Water Code section 1211.

- C. The Discharger filed a report of waste discharge (ROWD) and submitted an application for reissuance of its WDR's and NPDES permit on 19 July 2013. Supplemental information was requested on 13 August 2013 and received on 18 March 2014. The application was deemed complete on 24 March 2014.

II. FACILITY DESCRIPTION

The Discharger provides sewerage service for the community of Chester, CA, a community of approximately 2,144 people. The average dry weather flow of the Facility is 0.5 million gallons per day (MGD).

A. Description of Wastewater and Biosolids Treatment and Controls

Pumped raw sewage enters the Facility through a bar screen and subsequently flow is measured through a Parshall flume prior to splitting flow between ponds 1 and 2 (LND-001 and LND-002). After preliminary treatment wastewater is sent through four additional stabilization ponds connected in series. Total pond area is approximately 19 acres with a holding capacity of approximately 31 million gallons. After passing through all stabilization ponds, over a period of approximately 48-days, effluent is conveyed through a chlorine detention basin and disinfected prior to release to either the wetland ponds or Lake Almanor via an open 1/2-mile long channel; effluent is dechlorinated when discharging to Lake Almanor. Secondary treated disinfected municipal wastewater is not de-chlorinated when discharged to the wetland ponds (LND-007, LND-008, LND-009, and LND-010). Solar powered circulators float in the center of each pond; circulators are equipped with direct electrical back-up if needed. Flow through the pond system is continuous (unless a manually operated gate valve at the end of the chlorine detention basin is closed) and is either directed into the wetland ponds between 1 June and 30 September, and/or to Lake Almanor between 1 October and 30 May of the subsequent year. The total capacity of the wetland ponds is approximately 9.5 million gallons. Stabilization ponds are surrounded by raised levees and are not influenced by stormwater runoff; any storm drains onsite are separate from the sanitary sewer collection system.

According to on-site personnel, sludge is not frequently removed from the stabilization ponds. Depending on operation of the ponds, the necessity to drain and remove sludge from the stabilization ponds is not necessary until about 20-25 years from the date of any previous sludge removal. For sludge removal purposes, LND-001 or LND-002 can be dewatered and allowed to dry before being disked and scraped. Dried sludge, usually no more than an inch or two thick, is hauled offsite and disposed of as required.

B. Discharge Points and Receiving Waters

1. The Facility is located in Section 8, T28N, R7E, MDB&M, as shown in Attachment B, a part of this Order.

2. Secondary treated disinfected municipal wastewater is discharged at Discharge Point No. 001 to Lake Almanor, a water of the United States at a point of latitude 40°18'06"N and longitude 121°13'29"W.
3. Secondary treated disinfected municipal wastewater is discharged at Discharge Point No. 002 to wetland ponds at a point of latitude 40°18'06"N and longitude 121°13'29"W.

C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data

Effluent limitations contained in Order R5-2009-0078 for discharges from Discharge Point No. D-001 (Monitoring Location EFF-001) and representative monitoring data from the term of Order R5-2009-0078 are as follows:

Table F-2. Historic Effluent Limitations and Monitoring Data

Parameter	Units	Effluent Limitation					Monitoring Data (From 10/1/2012 – 10/1/15)		
		Avg. Monthly	Avg. Weekly	Max. Daily	4-Day Avg.	7-Day Median	Highest Avg. Monthly	Highest Avg. Weekly	Highest Daily
Biochemical Oxygen Demand (5-day at 20°C)	mg/L	30	45	90	--	--	23	30	30
	Minimum % Removal	85	--	--	--	--	58 ⁶	31 ⁶	31 ⁶
pH ¹	Standard Units	--	--	6.0-9.0	--	--	7.9	8.2	9.1
Total Suspended Solids	mg/L	30	45	90	--	--	35	40	40
	Minimum % Removal	85	--	--	--	--	44 ⁶	14 ⁶	14 ⁶
Priority Pollutants									
Copper, Total Recoverable	ug/L	22	--	36	--	--	10	10	10
Non-Conventional Pollutants									
Ammonia, Total (as Nitrogen)	mg/L	5.4	--	10.8	--	--	9.9	9.9	9.9
Total Coliform Organisms	MPN/100mL	--	--	240 ⁴	--	23 ⁵	600	900	900
Total Residual Chlorine	mg/L	--	--	0.019 ²	0.011 ³	--	ND	ND	ND
Acute Toxicity	% Survival	--	--	70 ⁷ /90 ⁸	--	--	100 ⁹	100 ⁹	100 ⁹

¹ pH shall be between 6.0 and 9.0.
² Applied as a 1-hour average effluent limitation.
³ Applied as a 4-day average effluent limitation.
⁴ Not to be exceeded more than once in a 30-day period.
⁵ Applied as a monthly median effluent limitation.
⁶ Represents the minimum observed percent removal.
⁷ Minimum for any one bioassay.
⁸ Median for three consecutive bioassays.
⁹ Represents the minimum observed percent survival.

D. Compliance Summary

Generally, during times of discharge to the wetland ponds, the Discharger has had difficulty meeting limits for BOD percent removal, TSS percent removal, pathogen removal, and total ammonia (as nitrogen). The Discharger was under Cease and Desist Order (CDO) No. R5-2009-0080, which was developed to encourage the Discharger to repair their

wastewater collection system. The following repairs/projects have been completed since 1998:

1998: Replaced 3,000 linear feet of 10-inch sewer line on Feather River Drive and Main Street; replaced 2,300 linear feet of 4-inch sewer laterals, acquired adjacent land from Pacific Gas and Electric Company (PG&E) for future treatment plant expansion, constructed two additional wetland ponds on a portion of the newly acquired land adjacent to waste stabilization ponds, modified and improved the main sewer lift station, and implemented a supervisory control and data acquisition monitoring system to record the volume and pumping times of the three sewer lift stations. The total cost of this project was approximately \$850,000 and was funded by the State of California Small Community Grant Program.

2003: Replaced 3,000 linear feet of 6-inch and 8-inch sewer lines, 2,500 linear feet of 4-inch sewer laterals, and other ancillary work. The majority of the effort was completed on First Avenue and Second Avenue. The total cost of the project was approximately \$650,000 and was self-funded by the Discharger.

2006: Replaced 4,800 linear feet of 8-inch and 6-inch sewer main and 1,700 linear feet of 4-inch sewer laterals on Highway 36 in the southern part of Chester, CA. The total cost of this project was approximately \$1,175,000 and was funded by the State of California Small Community Grant Program.

2009: Replaced 3,320 linear feet of sewer main line, replaced 1,740 linear feet of sewer laterals on Lassen Street and Stover Road, and constructed a sewer lift station near the intersection of Feather River Drive and Stover Road. The total cost of this project was approximately \$650,000.

2010: Replaced sewer lines, purchased and installed solar bee aerators, completed a record of survey around the perimeter of the Facility, including the property acquired from PG&E in 1998, and installed a 6-foot high chain-link fence around the Facility boundaries. The total cost of the projects was approximately \$320,000.

2011: Replaced sewer lines, purchased SolarBees, and constructed a fourth wetland pond with a holding capacity of approximately 3.6 million gallons. The total cost of the projects was approximately \$108,000.

2012: Replaced sewer lines and purchased SolarBees. The total cost of the projects was approximately \$60,000.

2013: Replaced sewer lines, reconstructed (widened and reshaped) levees at the Facility, covered the headworks with a roof. The total cost of the projects was approximately \$254,000.

2014: Three groundwater monitoring wells were installed and gutters were added to buildings at the Facility. The total cost of the projects was approximately \$17,000.

2015: Upgraded chlorine storage room and made repairs to property fence line. The total cost of the projects was approximately \$35,000.

Proposed Future Improvements:

2015-2016: Replacement of the sewer main and laterals on Third Street.

2018-2019: Replacement of the sewer main on First Street, Third Avenue and Fourth Avenue.

E. Planned Changes – Not Applicable

III. APPLICABLE PLANS, POLICIES, AND REGULATIONS

The requirements contained in this Order are based on the requirements and authorities described in this section.

A. Legal Authorities

This Order serves as WDR’s pursuant to article 4, chapter 4, division 7 of the California Water Code (commencing with section 13260). This Order is also issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. EPA and chapter 5.5, division 7 of the Water Code (commencing with section 13370). It shall serve as an NPDES permit for point source discharges from this facility to surface waters.

B. California Environmental Quality Act (CEQA)

Under Water Code section 13389, this action to adopt an NPDES permit is exempt from the provisions of Chapter 3 of CEQA, (commencing with section 21100) of Division 13 of the Public Resources Code.

C. State and Federal Laws, Regulations, Policies, and Plans

1. **Water Quality Control Plan.** Requirements of this Order specifically implement the applicable Water Quality Control Plans.
 - a. **Basin Plan.** The Central Valley Water Board adopted the Water Quality Control Plan for the Sacramento River Basin and the San Joaquin River Basin, Fourth Edition, revised June 2015 (hereinafter Basin Plan) that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. Requirements in this Order implement the Basin Plan. In addition, the Basin Plan implements State Water Board Resolution 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply. Thus, beneficial uses applicable to Lake Almanor are as follows:

Table F-3. Basin Plan Beneficial Uses

Discharge Point	Receiving Water Name	Beneficial Use(s)
001	Lake Almanor	<p><u>Existing:</u> Hydropower generation (POW); water contact recreation (REC-1); warm freshwater habitat (WARM); cold freshwater habitat (COLD); warm water spawning (SPWN); and wildlife habitat (WILD).</p> <p><u>Potential:</u> Municipal and domestic water supply (MUN).</p> <p><u>Groundwater:</u> Municipal and domestic water supply (MUN); agricultural supply (AGR); industrial service supply (IND); and industrial process supply (PRO).</p>

2. **National Toxics Rule (NTR) and California Toxics Rule (CTR).** U.S. EPA adopted the NTR on 22 December 1992, and later amended it on 4 May 1995 and 9 November 1999. About forty criteria in the NTR applied in California. On 18 May 2000, U.S. EPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on 13 February 2001. These rules contain federal water quality criteria for priority pollutants.
3. **State Implementation Policy.** On 2 March 2000, the State Water Board adopted the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (State Implementation Policy or SIP). The SIP became effective on 28 April 2000, with respect to the priority pollutant criteria promulgated for California by the U.S. EPA through the NTR and to the priority pollutant objectives established by the Central Valley Water Board in the Basin Plan. The SIP became effective on 18 May 2000, with respect to the priority pollutant criteria promulgated by the U.S. EPA through the CTR. The State Water Board adopted amendments to the SIP on 24 February 2005, that became effective on 13 July 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.
4. **Antidegradation Policy.** Federal regulation 40 C.F.R. section 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution 68-16 ("Statement of Policy with Respect to Maintaining High Quality of Waters in California"). Resolution 68-16 is deemed to incorporate the federal antidegradation policy where the federal policy applies under federal law. Resolution 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Central Valley Water Board's Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies. The permitted discharge must be consistent with the antidegradation provision of 40 C.F.R. section 131.12 and State Water Board Resolution 68-16.
5. **Anti-Backsliding Requirements.** Sections 402(o) and 303(d)(4) of the CWA and federal regulations at 40 C.F.R. section 122.44(l) restrict backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed.
6. **Domestic Water Quality.** In compliance with Water Code section 106.3, it is the policy of the State of California that every human being has the right to safe, clean, affordable, and accessible water adequate for human consumption, cooking, and sanitary purposes. This Order promotes that policy by requiring discharges to meet maximum contaminant levels designed to protect human health and ensure that water is safe for domestic use.
7. **Endangered Species Act Requirements.** This Order does not authorize any act that results in the taking of a threatened or endangered species or any act that is now prohibited, or becomes prohibited in the future, under either the California Endangered Species Act (Fish and Game Code, §§ 2050 to 2097) or the Federal Endangered Species Act (16 U.S.C.A. §§ 1531 to 1544). This Order requires compliance with effluent limits, receiving water limits, and other requirements to protect the beneficial uses of waters of the state. The discharger is responsible for meeting all requirements of the applicable Endangered Species Act.
8. **Emergency Planning and Community Right to Know Act.** Section 13263.6(a) of the Water Code, requires that *"the Regional Water Board shall prescribe effluent limitations*

as part of the waste discharge requirements of a POTW for all substances that the most recent toxic chemical release data reported to the state emergency response commission pursuant to Section 313 of the Emergency Planning and Community Right to Know Act of 1986 (42 U.S.C. Sec. 11023) (EPCRA) indicate as discharged into the POTW, for which the State Water Board or the Regional Water Board has established numeric water quality objectives, and has determined that the discharge is or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to, an excursion above any numeric water quality objective”.

The most recent toxic chemical data report does not indicate any reportable off-site releases or discharges to the collection system for this Facility. Therefore, a reasonable potential analysis based on information from EPCRA cannot be conducted. Based on information from EPCRA, there is no reasonable potential to cause or contribute to an excursion above any numeric water quality objectives included within the Basin Plan or in any State Water Board plan, so no effluent limitations are included in this permit pursuant to Water Code section 13263.6(a).

However, as detailed elsewhere in this Order, available effluent data indicate that there are constituents present in the effluent that have a reasonable potential to cause or contribute to exceedances of water quality standards and require inclusion of effluent limitations based on federal and state laws and regulations.

9. **Storm Water Requirements.** USEPA promulgated federal regulations for storm water on 16 November 1990 in 40 CFR Parts 122, 123, and 124. The NPDES Industrial Storm Water Program regulates storm water discharges from wastewater treatment facilities. Wastewater treatment plants are applicable industries under the storm water program and are obligated to comply with the federal regulations. The State Water Board does not require wastewater treatment facilities with design flows less than 1 MGD to obtain coverage under the Industrial Storm water General Order. Therefore, this Order does not regulate storm water.

D. Impaired Water Bodies on CWA 303(d) List

1. Under section 303(d) of the 1972 CWA, states, territories and authorized tribes are required to develop lists of water quality limited segments. The waters on these lists do not meet water quality standards, even after point sources of pollution have installed the minimum required levels of pollution control technology. On 11 October 2011 USEPA gave final approval to California's 2008-2010 section 303(d) List of Water Quality Limited Segments. The Basin Plan references this list of Water Quality Limited Segments (WQLSs), which are defined as “...those sections of lakes, streams, rivers or other fresh water bodies where water quality does not meet (or is not expected to meet) water quality standards even after the application of appropriate limitations for point sources (40 C.F.R. part 130, et seq.)” The Basin Plan also states, “Additional treatment beyond minimum federal standards will be imposed on dischargers to [WQLSs]. Dischargers will be assigned or allocated a maximum allowable load of critical pollutants so that water quality objectives can be met in the segment.”
2. **Total Maximum Daily Loads (TMDL’s).** USEPA requires the Central Valley Water Board to develop TMDL’s for each 303(d) listed pollutant and water body combination. Table F-4, below, identifies the 303(d) listing and the mercury TMDL status.

Table F-4. 303 (d) List for Lake Almanor

Pollutant	Potential Sources	TMDL Completion ¹
Mercury	Resource Extraction	2021

3. The 303(d) listing and TMDL has been considered in the development of this Order. A pollutant-by-pollutant evaluation of the pollutant of concern is described in section VI.C.3 of this Fact Sheet.

E. Other Plans, Polices and Regulations

1. **Title 27.** The discharge authorized herein and the treatment and storage facilities associated with the discharge of treated municipal wastewater, except for discharges of residual sludge and solid waste, are exempt from the requirements of Title 27, California Code of Regulations (CCR), section 20005 et seq. (hereafter Title 27). The exemption, pursuant to Title 27 CCR section 20090(a), is based on the following:
 - a. The waste consists primarily of domestic sewage and treated effluent;
 - b. The waste discharge requirements are consistent with water quality objectives; and
 - c. The treatment and storage facilities described herein are associated with a municipal wastewater treatment plant.

IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

Effluent limitations and toxic and pretreatment effluent standards established pursuant to sections 301 (Effluent Limitations), 302 (Water Quality Related Effluent Limitations), 304 (Information and Guidelines), and 307 (Toxic and Pretreatment Effluent Standards) of the CWA and amendments thereto are applicable to the discharge.

The CWA mandates the implementation of effluent limitations that are as stringent as necessary to meet water quality standards established pursuant to state or federal law [33 U.S.C., §1311(b)(1)(C); 40 CFR 122.44(d)(1)]. NPDES permits must incorporate discharge limits necessary to ensure that water quality standards are met. This requirement applies to narrative criteria as well as to criteria specifying maximum amounts of particular pollutants. Pursuant to federal regulations, 40 CFR 122.44(d)(1)(i), NPDES permits must contain limits that control all pollutants that “*are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any state water quality standard, including state narrative criteria for water quality.*” Federal regulations, 40 CFR 122.44(d)(1)(vi), further provide that “[w]here a state has not established a water quality criterion for a specific chemical pollutant that is present in an effluent at a concentration that causes, has the reasonable potential to cause, or contributes to an excursion above a narrative criterion within an applicable State water quality standard, the permitting authority must establish effluent limits.”

The CWA requires point source dischargers to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States. The control of pollutants discharged is established through effluent limitations and other requirements in NPDES permits. There are two principal bases for effluent limitations in the Code of Federal Regulations: 40 CFR 122.44(a) requires that permits include applicable technology-based limitations and standards; and 40 CFR 122.44(d) requires that permits include WQBEL’s to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water where numeric water quality objectives have not been established. The

Basin Plan at page IV-17.00, contains an implementation policy, “Policy for Application of Water Quality Objectives”, that specifies that the Central Valley Water Board “*will, on a case-by-case basis, adopt numerical limitations in orders which will implement the narrative objectives.*” This Policy complies with 40 CFR 122.44(d)(1). With respect to narrative objectives, the Central Valley Water Board must establish effluent limitations using one or more of three specified sources, including: (1) USEPA’s published water quality criteria, (2) a proposed state criterion (i.e., water quality objective) or an explicit state policy interpreting its narrative water quality criteria (i.e., the Central Valley Water Board’s “Policy for Application of Water Quality Objectives”)(40 CFR 122.44(d)(1)(vi)(A), (B) or (C)), or (3) an indicator parameter.

The Basin Plan includes numeric site-specific water quality objectives and narrative objectives for toxicity, chemical constituents, discoloration, radionuclides, and tastes and odors. The narrative toxicity objective states: “*All waters shall be maintained free of toxic substances in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.*” (Basin Plan at III-8.00) The Basin Plan states that material and relevant information, including numeric criteria, and recommendations from other agencies and scientific literature will be utilized in evaluating compliance with the narrative toxicity objective. The narrative chemical constituents objective states that waters shall not contain chemical constituents in concentrations that adversely affect beneficial uses. At minimum, “*...water designated for use as domestic or municipal supply (MUN) shall not contain concentrations of chemical constituents in excess of the maximum contaminant levels (MCLs)*” in Title 22 of CCR. The Basin Plan further states that, to protect all beneficial uses, the Central Valley Water Board may apply limits more stringent than MCLs. The narrative tastes and odors objective states: “*Water shall not contain taste- or odor-producing substances in concentrations that impart undesirable tastes or odors to domestic or municipal water supplies or to fish flesh or other edible products of aquatic origin, or that cause nuisance, or otherwise adversely affect beneficial uses.*”

A. Discharge Prohibitions

1. **Prohibition III.A (No discharge or application of waste other than that described in this Order).** This prohibition is based on Water Code section 13260 that requires filing of a report of waste discharge (ROWD) before a discharge can occur. The Discharger submitted a ROWD for discharges described in this Order; therefore, discharges not described in this Order are prohibited.
2. **Prohibition III.B (No bypasses or overflow of untreated wastewater, except under the conditions at CFR Part 122.41(m)(4)).** As stated in section I.G of Attachment D, Standard Provisions, this Order prohibits bypass from any portion of the treatment facility. Federal regulations, 40 CFR 122.41(m), define “bypass” as the intentional diversion of waste streams from any portion of a treatment facility. This section of the federal regulations, 40 CFR 122.41(m)(4), prohibits bypass unless it is unavoidable to prevent loss of life, personal injury, or severe property damage. In considering the Regional Water Board’s prohibition of bypasses, the State Water Board adopted a precedential decision, Order No. WQO 2002-0015, which cites the federal regulation, 40 CFR 122.41(m), as allowing bypass only for essential maintenance to assure efficient operation.
3. **Prohibition III.C (No controllable condition shall create a nuisance).** This prohibition is based on Water Code section 13050 that requires water quality objectives established for the prevention of nuisance within a specific area. The Basin Plan prohibits conditions that create a nuisance
4. **Prohibition III.D (No addition of pollutant free wastewater shall cause improper operation of the Facility’s systems).** This prohibition is based on CFR Part 122.41 et seq. that requires the proper design and operation of treatment facilities.

5. **Prohibition III.E (Discharge from any wetland pond to Lake Almanor is prohibited).** Discharge from any wetland pond to Lake Almanor is prohibited as the contents of the wetland ponds may contain constituents above water quality limits.
6. **Prohibition III.F (Discharge to Lake Almanor from 1 June through 30 September is prohibited).** This prohibition is based on the peak recreational season for the community surrounding Lake Almanor. The peak recreational period for Lake Almanor goes from 1 June through 30 September of each year. This prohibition is applied in order to minimize body contact, reduce ingestion, and prevent potential nutrient enrichment issues caused by discharge from the Facility during peak recreational months.

B. Technology-Based Effluent Limitations

1. Scope and Authority

Section 301(b) of the CWA and implementing U.S. EPA permit regulations at 40 C.F.R. section 122.44 require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Secondary Treatment Standards at 40 C.F.R. part 133.

Regulations promulgated in 40 C.F.R. section 125.3(a)(1) require technology-based effluent limitations for municipal Dischargers to be placed in NPDES permits based on Secondary Treatment Standards or Equivalent to Secondary Treatment Standards.

The Federal Water Pollution Control Act Amendments of 1972 (PL 92-500) established the minimum performance requirements for POTW's [defined in section 304(d)(1)]. Section 301(b)(1)(B) of that Act requires that such treatment works must, as a minimum, meet effluent limitations based on secondary treatment as defined by the U.S. EPA Administrator.

Based on this statutory requirement, U.S. EPA developed secondary treatment regulations, which are specified in 40 C.F.R. part 133. These technology-based regulations apply to all municipal wastewater treatment plants and identify the minimum level of effluent quality attainable by secondary treatment in terms of biochemical oxygen demand (BOD₅), total suspended solids (TSS), and pH.

2. Applicable Technology-Based Effluent Limitations

- a. **BOD₅ and TSS.** Federal regulations at 40 CFR Part 133, establish the minimum weekly and monthly average level of effluent quality attainable by secondary treatment for BOD₅ and TSS. A daily maximum effluent limitation for BOD₅ and TSS is also included in the Order to ensure that the treatment works are not organically overloaded and operate in accordance with design capabilities. In addition, 40 CFR 133.102, in describing the minimum level of effluent quality attainable by secondary treatment, states that the 30-day average percent removal shall not be less than 85 percent. For facilities with pond or trickling filter systems, treatment equivalent to secondary treatment is authorized requiring BOD and TSS removal of a minimum of 65%. Since the Discharger has historically been able to meet an average monthly effluent equal to 30 mg/L for BOD and TSS on most occasions, that treatment level is retained in this Order. As I/I becomes progressively less of a problem due to repairs being made on the collection system, it may become more difficult for the Discharger to meet these effluent limitations, due to higher strength wastewater.

- b. **Flow.** The Facility was designed to provide secondary treatment of municipal wastewater for up to a dry weather flow of 0.5 mgd; the design flow for the Facility is 0.75 mgd. This Order contains an average dry weather flow limit of 0.5 mgd.
- c. **pH.** The secondary treatment regulations at 40 CFR Part 133 also require that pH be maintained between 6.0 and 9.0 standard units.

**Summary of Technology-based Effluent Limitations
 Discharge Point No. D-001**

Table F-5. Summary of Technology-based Effluent Limitations

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Flow ¹	MGD	--	--	0.5	--	--
Conventional Pollutants						
Biochemical Oxygen Demand (5-day at 20°C)	mg/L	30	45	--	--	--
	lbs/day ²	130	190	--	--	--
	% Removal	85	--	--	--	--
pH ³	Standard Units	--	--	--	6.0	9.0
Total Suspended Solids	mg/L	30	45	--	--	--
	lbs/day ²	130	190	--	--	--
	% Removal	85	--	--	--	--

¹ The average dry weather flow shall not exceed 0.5 mgd.
² Based upon an average dry weather flow of 0.5 mgd.
³ Final effluent limitations for pH are water quality-based effluent limitations and not technology-based effluent limitations.

C. Water Quality-Based Effluent Limitations (WQBEL's)

1. Scope and Authority

CWA Section 301(b) and 40 C.F.R. section 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards.

Section 122.44(d)(1)(i) of 40 C.F.R. requires that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, water quality-based effluent limitations (WQBEL's) must be established using: (1) U.S. EPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state's narrative criterion, supplemented with other relevant information, as provided in section 122.44(d)(1)(vi).

The process for determining reasonable potential and calculating WQBEL's when necessary is intended to protect the designated uses of the receiving water as specified in the Basin Plan, and achieve applicable water quality objectives and criteria that are

contained in other state plans and policies, or any applicable water quality criteria contained in the CTR and NTR.

2. **Applicable Beneficial Uses and Water Quality Criteria and Objectives**

The Basin Plan designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, the Basin Plan implements State Water Board Resolution No. 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply.

The Basin Plan on page II-1.00 states: *“Protection and enhancement of existing and potential beneficial uses are primary goals of water quality planning...”* and with respect to disposal of wastewaters states that *“...disposal of wastewaters is [not] a prohibited use of waters of the State; it is merely a use which cannot be satisfied to the detriment of beneficial uses.”*

The federal CWA section 101(a)(2), states: *“it is the national goal that wherever attainable, an interim goal of water quality which provides for the protection and propagation of fish, shellfish, and wildlife, and for recreation in and on the water be achieved by July 1, 1983.”* Federal Regulations, developed to implement the requirements of the CWA, create a rebuttable presumption that all waters be designated as fishable and swimmable. Federal Regulations, 40 CFR sections 131.2 and 131.10, require that all waters of the State regulated to protect the beneficial uses of public water supply, protection and propagation of fish, shell fish and wildlife, recreation in and on the water, agricultural, industrial and other purposes including navigation. Section 131.3(e), 40 CFR, defines existing beneficial uses as those uses actually attained after 28 November 1975, whether or not they are included in the water quality standards. Federal Regulation, 40 CFR section 131.10 requires that uses be obtained by implementing effluent limitations, requires that all downstream uses be protected and states that in no case shall a state adopt waste transport or waste assimilation as a beneficial use for any waters of the United States.

- a. **Receiving Water and Beneficial Uses.** Refer to section III.C.1. for a complete description of the receiving water and beneficial uses.
- b. **Effluent and Ambient Background Data.** The reasonable potential analysis (RPA), as described in section IV.C.3 of this Fact Sheet, was based on data from October 2012 through October 2015, which includes effluent and ambient background data submitted in SMRs, the Report of Waste Discharge (ROWD), etc.
- c. **Assimilative Capacity/Mixing Zone.** The CWA directs the states to adopt water quality standards to protect the quality of its waters. USEPA’s current water quality standards regulation authorizes states to adopt general policies, such as mixing zones, to implement state water quality standards (40 CFR § 122.44 and 122.45). The USEPA allows states to have broad flexibility in designing its mixing zone policies. Primary policy and guidance on determining mixing zone and dilution credits is provided by the SIP and the Basin Plan. If no procedure applies in the SIP or the Basin Plan, then the Central Valley Water Board may use the USEPA *Technical Support Document for Water Quality-Based Toxics Control* (EPA/505/2-90-001)(TSD).

For non-Priority Pollutant constituents the allowance of mixing zones by the Central Valley Water Board is discussed in the Basin Plan, *Policy for Application of Water Quality Objectives*, which states in part, *“In conjunction with the issuance of NPDES*

and storm water permits, the Regional Board may designate mixing zones within which water quality objectives will not apply provided the discharger has demonstrated to the satisfaction of the Regional Board that the mixing zone will not adversely impact beneficial uses. If allowed, different mixing zones may be designated for different types of objectives, including, but not limited to, acute aquatic life objectives, chronic aquatic life objectives, human health objectives, and acute and chronic whole effluent toxicity objectives, depending in part on the averaging period over which the objectives apply. In determining the size of such mixing zones, the Regional Board will consider the applicable procedures and guidelines in the EPA's Water Quality Standards Handbook and the [TSD]. Pursuant to EPA guidelines, mixing zones designated for acute aquatic life objectives will generally be limited to a small zone of initial dilution in the immediate vicinity of the discharge."

For Priority Pollutants, the SIP supersedes the Basin Plan mixing zone provisions. Section 1.4.2 of the SIP states, in part, "...with the exception of effluent limitations derived from TMDL's, in establishing and determining compliance with effluent limitations for applicable human health, acute aquatic life, or chronic aquatic life priority pollutant criteria/objectives or the toxicity objective for aquatic life protection in a basin plan, the Regional Board may grant mixing zones and dilution credits to dischargers...The applicable priority pollutant criteria and objectives are to be met through a water body except within any mixing zone granted by the Regional Board. **The allowance of mixing zones is discretionary and shall be determined on a discharge-by-discharge basis.** The Regional Board may consider allowing mixing zones and dilution credits only for discharges with a physically identifiable point of discharge that is regulated through an NPDES permit issued by the Regional Board." [emphasis added]

For incompletely-mixed discharges, the Discharger must complete an independent mixing zone study to demonstrate to the Central Valley Water Board that a dilution credit is appropriate. In granting a mixing zone, Section 1.4.2.2 of the SIP requires the following to be met:

"A mixing zone shall be as small as practicable. The following conditions must be met in allowing a mixing zone: [emphasis added]

A: A mixing zone shall not:

- (1) *compromise the integrity of the entire water body;*
- (2) *cause acutely toxic conditions to aquatic life passing through the mixing zone;*
- (3) *restrict the passage of aquatic life;*
- (4) *adversely impact biologically sensitive or critical habitats, including, but not limited to, habitat of species listed under federal or State endangered species laws;*
- (5) *produce undesirable or nuisance aquatic life;*
- (6) *result in floating debris, oil, or scum;*
- (7) *produce objectionable color, odor, taste, or turbidity;*
- (8) *cause objectionable bottom deposits;*
- (9) *cause nuisance;*
- (10) *dominate the receiving water body or overlap a mixing zone from different outfalls; or*
- (11) *be allowed at or near any drinking water intake. A mixing zone is not a*

source of drinking water. To the extent of any conflict between this determination and the Sources of Drinking Water Policy (Resolution No. 88-63), this SIP supersedes the provisions of that policy.”

Section 1.4.2.1 of the SIP establishes the authority for the Central Valley Water Board to consider dilution credits based on the mixing zone conditions in the receiving water. Section 1.4.2.1 in part states:

*“The dilution credit, D, is a numerical value associated with the mixing zone that accounts for the receiving water entrained into the discharge. The dilution credit is a value used in the calculation of effluent limitations (described in Section 1.4). **Dilution credits may be limited or denied on a pollutant-by-pollutant basis, which may result in a dilution credit for all, some, or no priority pollutants in the discharge.**” [emphasis added]*

Dilution credits allowed for in this Order are in accordance with Section 1.4.2.2 of the SIP. The allowance of a mixing zone and dilution credits are a discretionary act by the Central Valley Water Board. The Central Valley Water Board has determined that the maximum dilution credits on a constituent-by-constituent basis needed for this discharge are shown in the following table (also discussed further in section IV.C.3.c).

Discharge from the Facility flows through an open channel within a marsh on its flow path to Lake Almanor. During wastewater travel through the marsh, the wastewater flow is augmented by water in the marsh. Upon entering Lake Almanor, the effluent encounters a large area that is very shallow—several inches to several feet. In addition, the effluent may be subject to wind action and may be more or less buoyant than the existing water within Lake Almanor, which would depend on time of day and weather conditions.

Effluent travels through a 3,000 ft. drainage channel before discharging into Lake Almanor. Flow Science, Inc. completed a 2005 dilution study for the Discharger and determined that available dilution of about 5:1 to 8:1 occurred in the drainage channel approximately 400 ft upstream of Lake Almanor (in the drainage ditch). Inflow of freshwater from the surrounding marsh provided dilution before effluent flowed into Lake Almanor. Dilution ratios upwards of about 658:1 were determined at approximately 550 ft from the shoreline. WDR Order R5-2009-0078 maintained a 6.34:1 and 7:1 dilution in calculating limits for total ammonia (as nitrogen) and total recoverable copper, respectively. The dilution ratios in WDR Order R5-2009-0078 were kept in this Order for calculating effluent limits for total ammonia (as nitrogen) and total recoverable copper. This Order incorporates dilution credits for both acute and chronic dilution at effluent flows of up to 0.5 mgd, which is the Facility’s average dry weather flow rate. The suggested dilutions were used because standard methodologies in USEPA support documents for using a 1Q10, 7Q10, or harmonic mean flow for the receiving water are not applicable for lake discharges. The Discharger must perform additional effluent dilution studies at higher effluent flows to demonstrate adequate dilution if they wish to acquire dilution ratios at discharge flows greater than 0.5 mgd.

To fully comply with all applicable laws, regulations and policies of the State, Central Valley Water Board approved a mixing zone and the associated dilution credits based on the following:

- i. Mixing zones are allowed under the SIP provided all elements contained in Section 1.4.2.2 are met. Based on the mixing zone study conducted by the Discharger, the Central Valley Water Board has determined that these factors are met.
- ii. Section 1.4.2.2. of the SIP requires mixing zones to be as small as practicable. Based on the mixing zone study conducted by the Discharger the Central Valley Water Board has determined the mixing zone is as small as practicable.
- iii. In accordance with Section 1.4.2.2 of the SIP, the Board has determined the mixing zone is as small as practicable, will not compromise the integrity of the entire water body, restrict the passage of aquatic life, dominate the water body or overlap existing mixing zones from different outfalls. The mixing zone is small relative to the large volume of Lake Almanor, is not at or near a drinking water intake, and does not overlap a mixing zone from a different outfall.
- iv. The Central Valley Water Board has determined the discharge will not adversely impact biologically sensitive or critical habitats, including, but not limited to, habitat of species listed under the federal or State endangered species laws, because the mixing zone is relatively small and acutely toxic conditions will not occur in the mixing zone. The discharge will not produce undesirable or nuisance aquatic life, result in floating debris, oil, or scum, produce objectionable odor, taste, or turbidity, cause objectionable bottom deposits, or cause nuisance, because the proposed Order establishes end-of-pipe effluent limitations (e.g., for BOD₅ and TSS) and discharge prohibitions to prevent these conditions from occurring.
- v. As required by the SIP, in determining the extent of or whether to allow a mixing zone and dilution credit, the Central Valley Water Board has considered the presence of pollutants in the discharge that are carcinogenic, mutagenic, teratogenic, persistent, bioaccumulative, or attractive to aquatic organisms, and concluded that the allowance of the mixing zone and dilution credit is adequately protective of the beneficial uses of the receiving water.
- vi. The Central Valley Water Board has determined mixing zone complies with the SIP for priority pollutants.
- vii. Section 1.4.2.2B of the SIP, in part states, *“The RWQCB shall deny or significantly limit a mixing zone and dilution credits as necessary to protect beneficial uses, meet the conditions of this Policy, or comply with other regulatory requirements.”*
- viii. The Central Valley Water Board has determined the mixing zone complies with the Basin Plan for non-priority pollutants. The Basin Plan requires a mixing zone not adversely impact beneficial uses. Beneficial uses will not be adversely affected for the same reasons discussed above. In determining the size of the mixing zone, the Central Valley Water Board has considered the procedures and guidelines in Section 5.1 of USEPA’s *Water Quality Standards Handbook*, 2nd Edition (updated July 2007) and Section 2.2.2 of the TSD. The SIP incorporates the same guidelines.
- ix. The Central Valley Water Board has determined that allowing dilution factors that exceed those proposed by this Order would not comply with the State Anti-degradation Policy for receiving waters outside the allowable mixing zone for copper (total recoverable) and total ammonia (as nitrogen). The State Water Board established California’s antidegradation policy in State Water Board

Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy and requires that existing quality of waters be maintained unless degradation is justified based on specific findings. Item 2 of Resolution 68-16 states:

“Any activity which produces or may produce a waste or increased volume or concentration of waste and which dischargers or proposed to discharge to existing high quality waters will be required to meet waste discharge requirements which will result in the best practicable treatment or control of the discharge necessary to assure that (a) a pollution or nuisance will not occur and (b) the highest water quality consistent with maximum benefit to the people of the State will be maintained.”

The effluent limitations established in the Order for total ammonia (as nitrogen) and total recoverable copper that have been adjusted using dilution credits and were developed based on performance of the Discharger’s current wastewater treatment capabilities. Therefore, the Central Valley Water Board determined the effluent limitations required by this Order will result in the Discharger implementing best practicable treatment or control of the discharge necessary to assure that pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

The Central Valley Water Board also determined establishing effluent limitations for total ammonia (as nitrogen) and total recoverable copper that have been adjusted for dilution credits are consistent with Section 1.4.2.2B of the SIP that requires the Central Valley Water Board to shall deny or significantly limit a mixing zone and dilution credits as necessary to comply with other regulatory requirements.

- x. Therefore, the Central Valley Water Board has determined the effluent limitations established in the Order for total ammonia (as nitrogen) and total recoverable copper, that have been adjusted for dilution credits, are appropriate and necessary to comply with the Basin Plan, SIP, Federal anti-degradation regulations and Resolution 68-16.
- d. **Conversion Factors.** The CTR contains aquatic life criteria for arsenic, cadmium, chromium III, chromium VI, copper, lead, nickel, silver, and zinc, which are presented in dissolved concentrations. USEPA recommends conversion factors to translate dissolved concentrations to total concentrations. The default USEPA conversion factors contained in Appendix 3 of the SIP were used to convert the applicable dissolved criteria to total recoverable criteria.
- e. **Hardness-Dependent CTR Metals Criteria.** The *California Toxics Rule* and the *National Toxics Rule* contain water quality criteria for seven metals that vary as a function of hardness. The lower the hardness the lower the water quality criteria. The metals with hardness-dependent criteria include cadmium, copper, chromium III, lead, nickel, silver, and zinc.

This Order has established criteria for hardness-dependent metals based on the receiving water hardness (actual ambient hardness) as required by the SIP¹ and the

¹ The SIP does not address how to determine the hardness for application to the equations for the protection of aquatic life when using hardness-dependent metals criteria. It simply states, in Section 1.2, that the criteria shall be properly adjusted for hardness using the hardness of the receiving water.

CTR¹. The SIP and the CTR require the use of “receiving water” or actual ambient” hardness, respectively, to determine effluent limitations for these metals. The CTR requires that hardness values used be consistent with design discharge conditions for design flows and mixing zones². Where design flows for aquatic life criteria include the lowest one-day flow with an average reoccurrence frequency of once in ten years (1Q10) and the lowest average seven consecutive day flow with an average reoccurrence frequency of once in ten years (7Q10)³. This section of the CTR also indicates that design conditions should be established such that appropriate criteria are not exceeded more than once in a three year period on average.⁴ The CTR requires that when mixing zones are allowed CTR criteria apply at the mixing zone edge, otherwise the criteria apply throughout the water body including at the point of discharge.⁵ The CTR does not define whether the term “ambient,” as applied in the regulations, necessarily requires the consideration of upstream as opposed to downstream hardness conditions.

The State Water Board provided direction regarding the selection of hardness in two precedential water quality orders; WQO 2008-0008 for the City of Davis Wastewater Treatment Plant and WQO 2004-0013 for the Yuba City Wastewater Treatment Plant. The State Water Board recognized that the SIP and the CTR do not discuss the manner in which hardness is to be ascertained, thus regional water boards have considerable discretion in determining ambient hardness. (Davis Order, p.10). The State Water Board explained that it is necessary that, “The [hardness] value selected should provide protection for all times of discharge under varying hardness conditions.” (Yuba City Order, p. 8). The Davis Order also provides that, “Regardless of the hardness used, the resulting limits must always be protective of water quality criteria under all flow conditions.” (Davis Order, p. 11)

The equation describing the total recoverable regulatory criterion, as established in the CTR⁶, is as follows:

$$\text{CTR Criterion} = \text{WER} \times (e^{m[\ln(H)]+b}) \quad (\text{Equation 1})$$

Where:

H = hardness (as CaCO₃)⁷

WER = water-effect ratio

m, b = metal- and criterion-specific constants

In accordance with the CTR, the default value for the WER is 1. A WER study must be conducted to use a value other than 1. The constants “m” and “b” are specific to both the metal under consideration, and the type of total recoverable criterion (i.e., acute or chronic). The metal-specific values for these constants are provided in the CTR at paragraph (b)(2), Table 1.

¹ The CTR requires that, for waters with a hardness of 400 mg/L (as CaCO₃), or less, the actual ambient hardness of the surface water must be used. It further requires that the hardness values used must be consistent with the design discharge conditions for design flows and mixing zones.

² 40 C.F.R. §131.38(c)(4)(ii)

³ 40 C.F.R. §131.38(c)(2)(iii) Table 4

⁴ 40 C.F.R. §131.38(c)(2)(iii) Table 4, notes 1 and 2

⁵ 40 C.F.R. §131.38(c)(2)(i)

⁶ 40 CFR § 131.38(b)(2).

⁷ For this discussion, all hardness values are in mg/L as CaCO₃.

The receiving water used for discharge of secondary treated disinfected wastewater is Lake Almanor. Because the receiving water is a lake, water quality characterization is represented by downgradient and upgradient conditions rather than upstream and downstream conditions. The downgradient receiving water hardness varied between 42 mg/L and 50 mg/L during the allowable months of discharge, which is based on three samples collected by DWR personnel between April 2014 and April 2015. No upgradient receiving water data was available, but because of the available hydraulic dilution in the lake, hardness conditions were assumed nearly constant between upgradient and downgradient receiving water locations. For calculating the CTR criteria, the downgradient ambient hardness has been used. The SIP, CTR, and State Water Board do not require use of the minimum observed ambient hardness in the CTR equations. The hardness used must be consistent with design conditions and protective of water quality criteria under all flow conditions.

Lake Almanor is not effluent dominated and there is not sufficient data available to determine whether the receiving water hardness demonstrates a clear relationship between flow and hardness. Additionally, because there is no upgradient receiving water hardness data available, the downgradient receiving water hardness was considered for use in CTR equations. Using the downgradient receiving water hardness is reasonable considering that the hydraulic dilution ratio is large and upgradient and downgradient receiving water hardness would be nearly equivalent. Therefore, the average of the three downgradient receiving water hardness values was used (i.e., the design ambient hardness). In this Order a design ambient hardness of 46 mg/L has been selected to calculate CTR criteria.

The Facility discharges both hardness and metals, which must be considered in the downgradient ambient receiving water to ensure criteria are protective under all flow conditions. The tables below examine how the downgradient ambient conditions change with varying mixtures of effluent and upgradient receiving water. The calculations determine whether or not toxicity could result from one or more metals using the selected design ambient hardness to calculate CTR criteria.

A simple mass balance (Equation 2) is used to model the ambient concentrations of hardness and metals in the receiving water downgradient of the discharge for all possible mixtures of effluent and upgradient receiving water under all flow conditions.

$$C_{\text{downstream}} = C_{\text{upstream}} \times (1-\text{MIX}) + C_{\text{effluent}} \times (\text{MIX}) \quad (\text{Equation 2})$$

Where:

- $C_{\text{downstream}}$ = Downgradient receiving water concentration
- C_{upstream} = Upgradient receiving water concentration
- C_{effluent} = Effluent concentration
- MIX = Fraction of effluent in downgradient ambient receiving water

For each of several downgradient ambient mixtures of upgradient receiving water and effluent, the potential for toxicity is examined. The hardness of the mixture is calculated, and the resultant water quality criterion is calculated from the CTR equation. The metal concentration is also calculated for the mixture of upgradient receiving water and effluent. If the metal concentration complies with the CTR

criterion for that mixture, the ambient mixture is not toxic, and “Yes” is indicated in the far right column. If the metals concentration exceeds the CTR criterion for that mixture, the ambient concentration is toxic, and “No” is indicated in the far right column. The results of these evaluations for the metals with hardness-dependent criteria are summarized in the following Tables.

For this evaluation, the following conservative assumptions were made:

- Upgradient receiving water at the lowest observed receiving water hardness (i.e., minimum observed downgradient hardness was assumed equivalent to the minimum observed upgradient hardness, which was 42 mg/L).
- No assimilative capacity for each metal in the upgradient receiving water (i.e., metal concentration is equal to calculated CTR criteria).
- The median observed effluent hardness was 50.5 mg/L.

Table F-6. CTR Compliance with Cadmium, Copper, Chromium III, Lead, Nickel, Silver, and Zinc given Mixed Downgradient Conditions (Design Ambient Hardness = 46 mg/L).

CADMIUM					
Assumed Upgradient Receiving Water Cadmium Concentration ¹					1.25
Cadmium Chronic Criterion ²					1.34
Mix ⁶	Mixed Downgradient Ambient Concentration				Complies with CTR Criteria
	Hardness ³ (mg/L)	CTR Criteria ⁴ (µg/L)	Cadmium ⁵ (µg/L)		
High Flow	1%	42	1.25	1.25	Yes
Low Flow	5%	42	1.26	1.25	Yes
COPPER					
Assumed Upgradient Receiving Water Copper Concentration ¹					4.4
Copper Chronic Criterion ²					4.8
Mix ⁶	Mixed Downgradient Ambient Concentration				Complies with CTR Criteria
	Hardness ³ (mg/L)	CTR Criteria ⁴ (µg/L)	Cadmium ⁵ (µg/L)		
High Flow	1%	42	4.5	4.4	Yes
Low Flow	5%	42	4.5	4.5	Yes
CHROMIUM III					
Assumed Upgradient Receiving Water Chromium III Concentration ¹					101.7
Chromium III Chronic Criterion ²					109.6
Mix ⁶	Mixed Downgradient Ambient Concentration				Complies with CTR Criteria
	Hardness ³ (mg/L)	CTR Criteria ⁴ (µg/L)	Cadmium ⁵ (µg/L)		

High Flow	1%	42	101.9	101.8	Yes
Low Flow	5%	42	102.6	102.1	Yes
LEAD					
Assumed Upgradient Receiving Water Lead Concentration ¹					1.05
Lead Chronic Criterion ²					1.18
Mix ⁶		Mixed Downgradient Ambient Concentration			Complies with CTR Criteria
		Hardness ³ (mg/L)	CTR Criteria ⁴ (µg/L)	Cadmium ⁵ (µg/L)	
High Flow	1%	42	1.06	1.1	Yes
Low Flow	5%	42	1.07	1.1	Yes
NICKEL					
Assumed Upgradient Receiving Water Nickel Concentration ¹					25.0
Nickel Chronic Criterion ²					27.0
Mix ⁶		Mixed Downgradient Ambient Concentration			Complies with CTR Criteria
		Hardness ³ (mg/L)	CTR Criteria ⁴ (µg/L)	Cadmium ⁵ (µg/L)	
High Flow	1%	42	25.1	25.1	Yes
Low Flow	5%	42	25.3	25.1	Yes
SILVER					
Assumed Upgradient Receiving Water Silver Concentration ¹					0.91
Silver Chronic Criterion ²					1.07
Mix ⁶		Mixed Downgradient Ambient Concentration			Complies with CTR Criteria
		Hardness ³ (mg/L)	CTR Criteria ⁴ (µg/L)	Cadmium ⁵ (µg/L)	
High Flow	1%	42	0.92	0.9	Yes
Low Flow	5%	42	0.93	0.9	Yes
ZINC					
Assumed Upgradient Receiving Water Zinc Concentration ¹					57.5
Zinc Chronic Criterion ²					62.1
Mix ⁶		Mixed Downgradient Ambient Concentration			Complies with CTR Criteria
		Hardness ³ (mg/L)	CTR Criteria ⁴ (µg/L)	Cadmium ⁵ (µg/L)	

High Flow	1%	42	57.6	57.5	Yes
Low Flow	5%	42	57.9	57.7	Yes

¹ Assumed upgradient receiving water metal concentrations calculated using CTR equation (Equation 1) for chronic/acute criterion at a minimum hardness of 42 mg/L.

² CTR Criteria calculated using CTR equation (Equation 1) for chronic/acute criterion at the design ambient hardness (46 mg/L).

³ Downgradient ambient hardness is the mixture of the receiving water and effluent hardness using Equation 2.

⁴ Downgradient ambient criteria are the chronic/acute criteria calculated using the CTR equation (Equation 1) at the mixed hardness.

⁵ Downgradient ambient metals concentration is a mixture of the receiving water and effluent metal concentrations using Equation 2.

⁶ The mixture percentage represents the fraction of effluent in the downgradient ambient receiving water. The mixture ranges from 1% to 5%. Because effluent is discharged to a lake and the design flow would provide minimal changes to lake volume, the possibility of a 1% or 5% mixture is not probable but is conservatively used to show that mixed conditions comply with CTR criteria.

Based on the procedures discussed above, Table F-8 lists all the CTR hardness-dependent metals and the associated ECA used in this Order.

Table F-7. Summary of ECA Evaluations for CTR Hardness-dependent Metals

CTR Metals	ECA (µg/L, Total Recoverable) ¹	
	Acute	Chronic
Copper	6.7	4.8
Chromium III	920	110
Cadmium	1.9	1.3
Lead	30	1.2
Nickel	240	27
Silver	1.1	--
Zinc	62	62

¹ Metal criteria rounded to two significant figures in accordance with the CTR. ECA are shown without dilution using an average downgradient receiving water hardness of 46 mg/L (as CaCO₃).

3. Determining the Need for WQBEL's

- a. **Constituents with No Reasonable Potential.** WQBELS are not included in this Order for constituents that do not demonstrate reasonable potential (i.e., constituents were not detected in the effluent or receiving water); however, monitoring for those pollutants is established in this Order as required by the SIP. If the results of effluent monitoring demonstrate reasonable potential, this Order may be reopened and modified by adding an appropriate effluent limitation.

The following constituents were found to have no reasonable potential after assessment of the data and are no longer a part of the effluent monitoring and reporting schedule: total trihalomethanes (1/quarter), carbon tetrachloride (1/quarter), and iron (total recoverable and dissolved) (1/year).

- b. **Constituents with No Data or Insufficient Data.** WQBEL's are not included in this Order for constituents that do not demonstrate reasonable potential (i.e. constituents were not detected in the effluent or receiving water); however, monitoring for those pollutants is established in this Order as required by the SIP. If the results of effluent monitoring demonstrate reasonable potential, this Order may be reopened and modified by adding an appropriate effluent limitation.
 - i. **Aluminum, Total Recoverable**

- (a) **WQO.** Aluminum is not a CTR constituent. The Basin Plan includes the narrative toxicity objective, which states that, “*All waters shall be maintained free of toxic substances in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.*” (Basin Plan at III-8.00) The Basin Plan’s Policy for Application of Water Quality Objectives requires the Central Valley Water Board to consider, “*on a case-by case basis, direct evidence of beneficial use impacts, all material and relevant information submitted by the discharger and other interested parties, and relevant numerical criteria and guidelines developed and/or published by other agencies and organizations. In considering such criteria, the Board evaluates whether the specific numerical criteria which are available through these sources and through other information supplied to the Board, are relevant and appropriate to the situation at hand and, therefore, should be used in determining compliance with the narrative objective.*” (Basin Plan, p. IV.-17.00; see also, 40 CFR 122.44(d)(vi).)
- (b) **RPA Results.** The maximum effluent concentration for aluminum (total recoverable) was 100 µg/L based on one sample detection on 26 September 2012. The sampling result occurred when the Discharger was discharging effluent to the wetland ponds and thus does not represent effluent water quality entering Lake Almanor during the allowable discharge period, per Section 1.2 of the SIP. Section 1.3, Step 8, of the SIP allows the Central Valley Water Board to require additional monitoring for a pollutant in place of an effluent limitation if data are unavailable or insufficient. Instead of limitations, additional monitoring has been established for aluminum. This Order may be reopened and modified to include appropriate effluent limitations for aluminum should monitoring results indicate that the discharge has the reasonable potential to cause or contribute to an exceedance of a water quality standard.

ii. **Zinc, Total Recoverable**

- (a) **WQO.** The CTR includes hardness-dependent criteria for the protection of freshwater aquatic life for total recoverable zinc. These criteria for zinc (total recoverable) are presented in dissolved concentrations, as 1-hour acute criteria and 4-day chronic criteria. USEPA recommends conversion factors to translate dissolved concentrations to total concentrations. Default USEPA translators were used for the receiving water and effluent.
- (b) **RPA Results.** Section IV.C.2.e of this Fact Sheet includes procedures for conducting the RPA for hardness-dependent CTR metals, such as zinc. The CTR includes hardness-dependent criteria for zinc for the receiving water. Zinc was tested and detected once in the effluent on 26 September 2012 at a concentration of 40 µg/L. The sampling result occurred when the Discharger was conveying effluent to the wetland ponds and thus does not represent effluent water quality entering Lake Almanor during the allowable discharge period, per Section 1.2 of the SIP. Section 1.3, Step 8, of the SIP allows the Central Valley Water Board to require additional monitoring for a pollutant in place of an effluent limitation if data are unavailable or insufficient. Instead of limitations, additional monitoring has been established for zinc. This Order may be reopened and modified to include appropriate effluent limitations for total recoverable zinc should monitoring results indicate that the discharge has

the reasonable potential to cause or contribute to an exceedance of a water quality standard.

- c. **Constituents with Reasonable Potential.** The Central Valley Water Board finds that the discharge has a reasonable potential to cause or contribute to an in-stream excursion above a water quality standard for ammonia, chlorine residual, copper, pH, and pathogens. WQBEL's for these constituents are included in this Order. A summary of the RPA is provided in Attachment G, and a detailed discussion of the RPA for each constituent is provided below.

i. **Ammonia**

(a) **WQO.**

The 1999 USEPA National Ambient Water Quality Criteria (NAWQC) used for protection of freshwater aquatic life with regards to total ammonia (the "1999 Criteria"), provides recommendation for acute standards (1-hour average; criteria maximum concentration or CMC) based on pH and chronic standards (30-day average; criteria continuous concentration or CCC) based on pH and temperature. USEPA also recommends that 4-day average concentrations should not exceed 2.5 times the 30-day CCC. USEPA found that as pH increases, both the acute and chronic toxicity of ammonia increases; Salmonids were more sensitive to acute toxicity effects than other species. While the acute toxicity of ammonia was not influenced by temperature, it was found that invertebrates and young fish experienced increasing chronic toxicity effects with increasing temperature. Because Lake Almanor has a beneficial use of cold freshwater habitat and the presence of salmonids and early fish life stages in the Lake Almanor is well-documented, the recommended criteria for waters where salmonids and early life stages are present were used.

The USEPA recently published national recommended water quality criteria for the protection of aquatic life from the toxic effects of ammonia in freshwater ("2013 Criteria")¹. The 2013 Criteria is an update to USEPA's 1999 Criteria, and varies based on pH and temperature. Although the 2013 Criteria reflects the latest scientific knowledge on the toxicity of ammonia to certain freshwater aquatic life, including new toxicity data on sensitive freshwater mussels in the Unionidae family, the species tested for development of the 2013 Criteria may not be present in some Central Valley waterways. The 2013 Criteria document therefore states that, "*unionid mussel species are not prevalent in some waters, such as the arid west ...*" and provides that, "*In the case of ammonia, where a state demonstrates that mussels are not present on a site-specific basis, the recalculation procedure may be used to remove the mussel species from the national criteria dataset to better represent the species present at the site.*"

The Central Valley Water Board issued a 3 April 2014 *California Water Code Section 13267 Order for Information: 2013 Final Ammonia Criteria for Protection of Freshwater Aquatic Life* (13267 Order) requiring the Discharger to either participate in an individual or group study to determine

¹ *Aquatic Life Ambient Water Quality Criteria for Ammonia – Freshwater*, published August 2013 [EPA 822-R-13-001]

the presence of mussels or submit a method of compliance for complying with effluent limitations calculated assuming mussels present using the 2013 Criteria. The Discharger submitted a letter to the Central Valley Water Board on 10 July 2014 indicating their participation in the Central Valley Clean Water Association Freshwater Collaborative Mussel Study. Studies are currently underway to determine the toxicity of ammonia reflected in the 2013 Criteria and the implementation of those criteria in the Central Valley Region as part of a Basin Planning effort. Until the Basin Planning process is completed, the Central Valley Water Board will continue to implement the 1999 Criteria to interpret the Basin Plan's narrative toxicity objective.

The temperature of the effluent varies seasonally, however, discharge to surface water is only allowed from 1 October through 31 May of a following year. Since there is limited data for total ammonia (as nitrogen) when discharging to Lake Almanor, only analytical results collected during the allowed months of discharge were used from October 2012 through October 2015.

Based on 418 effluent samples from October 2012 through October 2015, the effluent pH ranged from 6.1-9.1 standard units. In order to protect against a reasonable worst-case short-term exposure, and stay within Basin Plan objectives for pH, a pH of 8.5 standard units was used to derive acute criterion. The resulting acute criterion is 2.14 mg/L.

The California DWR collected six sets of paired pH and temperature data in Lake Almanor between April 2014 and April 2015. Because three of the six sample pairs were collected outside of the allowed discharge months, only three of the paired results were used to determine the CCC. The downstream analytical results were averaged between the following sampling locations: (1) 40°16'13.24" latitude, 121°10'56.70" longitude and (2) 40°10'36.87" latitude, -121°5'10.73" longitude. Because of limited available receiving water temperature and pH data, the CCC was calculated for all paired pH and temperature data. A CCC protective of aquatic life was determined by taking the 95th percentile of the calculated CCC's. Using a pH value of 8.3 and temperature value of 12.6°C (highest average pH and temperature of Lake Almanor during allowed discharge months), the resulting 30-day CCC for total ammonia (as nitrogen) was calculated as 1.5 mg/L, prior to any dilution allowance. The 4-day average concentration is derived in accordance with the USEPA criterion as 2.5 times the 30-day CCC. Based on the 30-day CCC for total ammonia (as nitrogen), the resulting 4-day average concentration for total ammonia (as nitrogen) was 3.8 mg/L, prior to any dilution allowance.

- (b) **RPA Results.** The Facility is a POTW that treats domestic wastewater. Untreated domestic wastewater contains ammonia in concentrations that, without treatment, would be harmful to fish and would violate the Basin Plan narrative toxicity objective if discharged to the receiving water. Reasonable potential therefore exists and effluent limitations are required.

Federal regulations at 40 C.F.R. §122.44(d)(1)(i) requires that, "*Limitations must control all pollutants or pollutant parameters (either conventional,*

nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.” For priority pollutants, procedures are outlined in the SIP for completing the RPA. However, ammonia is not a priority pollutant and the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining an appropriate method for conducting the RPA for this non-priority pollutant constituent.

USEPA’s September 2010 NPDES Permit Writer’s Manual, page 6-30, states, *“State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBEL’s are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBEL’s for pathogens in all permits for POTW’s discharging to contact recreational waters).”* USEPA’s TSD also recommends that factors other than effluent data should be considered in the RPA, *“When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data.”* With regard to POTW’s, USEPA recommends that, *“POTW’s should also be characterized for the possibility of chlorine and ammonia problems.”* (TSD, p. 50)

Nitrification is a biological process that converts ammonia to nitrite and nitrite to nitrate. Denitrification is a process that converts nitrate to nitrite or nitric oxide and then to nitrous oxide or nitrogen gas, which is then released to the atmosphere. Inadequate or incomplete nitrification may result in the discharge of ammonia to the receiving water body. Ammonia is known to cause toxicity to aquatic organisms in surface waters. Discharge of ammonia in concentrations that produce detrimental physiological responses to human, plant, animal, or aquatic life would violate the Basin Plan narrative toxicity objective. Inadequate or incomplete nitrification creates the potential for ammonia to be discharged and provides the basis for the discharge to have a reasonable potential to cause or contribute to an in-stream excursion above the NAWQC. Therefore, the Central Valley Water Board finds the discharge has reasonable potential for ammonia and WQBEL’s are required.

- (c) **WQBEL’s.** The Central Valley Water Board calculates WQBEL’s in accordance with SIP procedures for non-CTR constituents, and ammonia is a non-CTR constituent. The SIP procedure assumes a 4 day averaging period for calculating the long-term average discharge condition (LTA). However, USEPA recommends modifying the procedure for calculating permit limits for ammonia using a 30-day averaging period for the

calculation of the LTA corresponding to the 30-day CCC. Therefore, while the LTAs corresponding to the acute and 4-day chronic criteria were calculated according to SIP procedures, the LTA corresponding to the 30-day CCC was calculated assuming a 30-day averaging period. The lowest LTA representing the acute, 4-day CCC, and 30-day CCC is then selected for deriving the average monthly effluent limitation (AMEL) and the maximum daily effluent limitation (MDEL). The remainder of the WQBEL calculation for ammonia was performed according to the SIP procedures. This Order contains a final average monthly effluent limitation (AMEL) and maximum daily effluent limitation (MDEL) for total ammonia (as nitrogen) of 8.4 mg/L and 16 mg/L, respectively, based on the 1-hour average CMC.

- (d) **Plant Performance and Attainability.** Based on 18 analytical sample results, collected between October 2012 and October 2015, during the months of allowable discharge, the maximum monthly average effluent concentration of total ammonia (as nitrogen) was 9.9 mg/L, which is more than the applicable WQBEL's. As discussed in section IV.E of this Fact Sheet, a compliance schedule has been included in this Order.

ii. **Chlorine Residual**

- (a) **WQO.** USEPA developed NAWQC for protection of freshwater aquatic life for chlorine residual. The recommended 4-day average (chronic) and 1-hour average (acute) criteria for chlorine residual are 0.011 mg/L and 0.019 mg/L, respectively. These criteria are protective of the Basin Plan's narrative toxicity objective.
- (b) **RPA Results.** The concentrations of chlorine used to disinfect wastewater are high enough to harm aquatic life and violate the Basin Plan narrative toxicity objective if discharged to the receiving water. Reasonable potential therefore does exist and effluent limits are required.

Federal regulations at 40 C.F.R. §122.44(d)(1)(i) requires that, "*Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.*" For priority pollutants, the SIP dictates the procedures for conducting the RPA. Chlorine is not a priority pollutant. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used its judgment in determining the appropriate method for conducting the RPA for this non-priority pollutant constituent.

USEPA's September 2010 NPDES Permit Writer's Manual, page 6-30, states, "*State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBEL's are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBEL's for pathogens in all permits for POTW's*

discharging to contact recreational waters).” USEPA’s TSD also recommends that factors other than effluent data should be considered in the RPA, *“When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data.”* With regard to POTW’s, USEPA recommends that, *“POTW’s should also be characterized for the possibility of chlorine and ammonia problems.”* (TSD, p. 50)

The Discharger uses chlorine for disinfection, which is extremely toxic to aquatic organisms. Although the Discharger uses a sulfur dioxide process to dechlorinate the effluent prior to discharge to Lake Almanor, the existing chlorine use and the potential for chlorine to be discharged provides the basis for the discharge to have a reasonable potential to cause or contribute to an in-stream excursion above the NAWQC.

- (c) **WQBEL’s.** The USEPA *Technical Support Document for Water Quality-Based Toxics Control* [EPA/505/2-90-001] contains statistical methods for converting chronic (4-day) and acute (1-hour) aquatic life criteria to average monthly and maximum daily effluent limitations based on the variability of the existing data and the expected frequency of monitoring. However, because chlorine is an acutely toxic constituent that can and will be monitored continuously, an average 1-hour limitation is considered more appropriate than an average daily limitation. This Order contains a 4-day average effluent limitation and 1-hour average effluent limitation for chlorine residual of 0.011 mg/L and 0.019 mg/L, respectively, based on USEPA’s NAWQC, which implements the Basin Plan’s narrative toxicity objective for protection of aquatic life.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that total residual chlorine is less than applicable WQBEL’s. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

iii. **Copper, Total Recoverable**

- (a) **WQO.** The CTR includes hardness-dependent criteria for the protection of freshwater aquatic life for total recoverable copper. These criteria for total recoverable copper are presented in dissolved concentrations, as 1-hour acute criteria and 4-day chronic criteria. USEPA recommends conversion factors to translate dissolved concentrations to total concentrations. Default USEPA translators were used for the receiving water and effluent.
- (b) **RPA Results.** Section IV.C.2 of this Fact Sheet includes procedures for conducting the RPA for hardness-dependent CTR metals, such as copper. The CTR includes hardness-dependent criteria for copper for the receiving water. The maximum observed upstream receiving water copper concentration was 10 µg/L, based on 16 samples collected between October 2012 and October 2015. The RPA was conducted using the average downgradient receiving water hardness to calculate the criteria for comparison to the maximum ambient background concentration, and

likewise using the reasonable average downgradient hardness for comparison to the maximum effluent concentration. The table below shows the specific criteria used for the RPA.

	CTR Chronic Criterion (Total Recoverable)	Maximum Concentration (Total Recoverable)	Reasonable Potential? (Y/N)
Receiving Water	4.8 ¹	0.33 µg/L	No ²
Effluent	4.8 µg/L ¹	10 µg/L	Yes ³

¹ Based on an average downgradient receiving water hardness of 46 mg/L (as CaCO₃)

² Per Section 1.3, step 4 of the SIP.

³ Per Section 1.3, step 6 of the SIP.

Based on the available data, copper in the discharge has a reasonable potential to cause or contribute to an in-stream excursion above the CTR criteria for the protection of freshwater aquatic life

- (c) **WQBEL's.** The receiving water contains assimilative capacity for copper, therefore, a dilution credit of 7:1 was allowed in development of the WQBEL's for copper. Based on the previous three years of analytical data, the average monthly effluent limitation (AMEL) and maximum daily effluent limitation (MDEL) was calculated as 34 µg/L and 43 µg/L, respectively.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 10 µg/L is less than applicable WQBEL's. The Central Valley Water Board therefore concludes that immediate compliance with these effluent limitations is feasible.

iv. **Pathogens**

- (a) **WQO.** DDW has developed reclamation criteria, CCR, Division 4, Chapter 3 (Title 22), for the reuse of wastewater. Title 22 requires that for spray irrigation of food crops, parks, playgrounds, schoolyards, and other areas of similar public access, wastewater be adequately disinfected, oxidized, coagulated, clarified, and filtered, and that the effluent total coliform levels not exceed 2.2 MPN/100 mL as a 7-day median; 23 MPN/100 mL, not to be exceeded more than once in a 30-day period; and 240 MPN/100 mL, at any time.

Title 22 also requires that recycled water used as a source of water supply for non-restricted recreational impoundments be disinfected tertiary recycled water that has been subjected to conventional treatment. A non-restricted recreational impoundment is defined as "...an impoundment of recycled water, in which no limitations are imposed on body-contact water recreational activities." Title 22 is not directly applicable to surface waters; however, the Central Valley Water Board finds that it is appropriate to apply an equivalent level of treatment to that required by the DDW's reclamation criteria because the receiving water is used for irrigation of agricultural land and for contact recreation purposes. The stringent disinfection criteria of Title 22 are appropriate since the undiluted effluent may be used for the irrigation of food crops and/or for body-contact water recreation. Coliform organisms are intended as an indicator of the

effectiveness of the entire treatment train and the effectiveness of removing other pathogens.

In a letter to the Central Valley Water Board dated 8 April 1999, DDW indicated it would consider wastewater discharged to water bodies with identified beneficial uses of irrigation or contact recreation and where the wastewater receives dilution of more than 20:1 to be adequately disinfected if the effluent coliform concentration does not exceed 23 MPN/100 mL as a 7-day median and if the effluent coliform concentration does not exceed 240 MPN/100 mL more than once in any 30 day period.

- (b) **RPA Results.** Raw domestic wastewater inherently contains human pathogens that threaten human health and life, and constitute a threatened pollution and nuisance under CWC Section 13050 if discharged untreated to the receiving water. Reasonable potential for pathogens therefore exists and WQBEL's are required.

Federal regulations at 40 C.F.R. §122.44(d)(1)(i) requires that, "*Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.*" For priority pollutants, the SIP dictates the procedures for conducting the RPA. Pathogens are not priority pollutants. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA for this non-priority pollutant constituent.

USEPA's September 2010 NPDES Permit Writer's Manual, page 6-30, states, "*State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBEL's are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBEL's for pathogens in all permits for POTW's discharging to contact recreational waters).*" USEPA's TSD also recommends that factors other than effluent data should be considered in the RPA, "*When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data*" (TSD, p. 50).

Water contact recreation is included in the beneficial uses of Lake Almanor. To protect this beneficial use, the Central Valley Water Board finds that the wastewater must be disinfected and adequately treated to prevent disease. Although the Discharger provides disinfection, inadequate or incomplete disinfection creates the potential for pathogens

to be discharged. Therefore, the Central Valley Water Board finds the discharge has reasonable potential for pathogens and WQBEL's are required.

(c) **WQBEL's.**

Pursuant to guidance from DDW, this Order includes effluent limitations for total coliform organisms of 23 MPN/100 mL as a 7-day median and 240 MPN/100 mL, not to be exceeded more than once in a 30-day period. These coliform limits are imposed to protect the beneficial uses of the receiving water, including public health through contact recreation.

(d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 900 MPN/100 mL is greater than applicable WQBEL's. Based on the sample results for the effluent, the limitations appear to put the Discharger in immediate non-compliance. As discussed in section IV.E of this Fact Sheet, a compliance schedule has been included in this Order for total coliform.

v. **pH**

(a) **WQO.** The Basin Plan includes a water quality objective for surface waters (except for Goose Lake) that the "...pH shall not be depressed below 6.5 nor raised above 8.5."

(b) **RPA Results.** Raw domestic wastewater inherently has variable pH. Additionally, some wastewater treatment processes can increase or decrease wastewater pH which if not properly controlled, would violate the Basin Plan's numeric objective for pH in the receiving water. Therefore, reasonable potential exists for pH and WQBEL's are required.

Federal regulations at 40 C.F.R. §122.44(d)(1)(i) requires that, "*Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.*" For priority pollutants, the SIP dictates the procedures for conducting the RPA. pH is not a priority pollutant. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA for this non-priority pollutant constituent.

USEPA's September 2010 NPDES Permit Writer's Manual, page 6-30, states, "*State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBEL's are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBEL's for pathogens in all permits for POTW's discharging to contact recreational waters).*" USEPA's TSD also recommends that factors other than effluent data should be considered in the RPA, "*When determining whether or not a discharge causes, has the*

reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data” (TSD, p. 50).

The Facility is a POTW that treats domestic wastewater. Based on 418 samples taken between October 2012 and October 2015, during periods when the Discharger was allowed to send effluent to Lake Almanor, the maximum pH reported was 9.1 standard units and the minimum pH was 6.1 standard units. The pH for the Facility’s influent varies due to the nature of municipal sewage and the volume of infiltration and inflow entering the collection system, which provides the basis for the discharge to have a reasonable potential to cause or contribute to an in-stream excursion above the Basin Plan’s numeric objective for pH in the receiving water. Therefore, WQBEL’s for pH are required in this Order.

- (c) **WQBEL’s.** Based on the Discharger’s analytical data, effluent water quality has not resulted in exceedances of receiving water quality objectives for pH. Additionally, significant dilution is available in the receiving water and consequently extensive buffering capacity. The effluent limitation for pH in this Order has been set to a minimum of 6.0 and maximum of 9.0 standard units.
- (d) **Plant Performance and Attainability.** The Discharger reported pH values between 6.0 and 9.0 standard units approximately 99.8% of reporting time between October 2012 and October 2015. Therefore, the Central Valley Water Board concludes that immediate compliance with these effluent limitations is feasible.

4. WQBEL Calculations

- a. This Order includes WQBEL’s for ammonia, biochemical oxygen demand (5-day at 25°C), copper, pH, total coliform organisms, and total suspended solids. The general methodology for calculating WQBEL’s based on the different criteria/objectives is described in subsections IV.C.5.b through IV.C.5.e, below. See Attachment H for the WQBEL calculations.
- b. **Effluent Concentration Allowance.** For each water quality criterion/objective, the ECA is calculated using the following steady-state mass balance equation from Section 1.4 of the SIP:

$$\begin{aligned} ECA &= C + D(C - B) && \text{where } C > B, \text{ and} \\ ECA &= C && \text{where } C \leq B \end{aligned}$$

where:

- ECA = effluent concentration allowance
- D = dilution credit
- C = the priority pollutant criterion/objective
- B = the ambient background concentration.

According to the SIP, the ambient background concentration (B) in the equation above shall be the observed maximum with the exception that an ECA calculated from a

priority pollutant criterion/objective that is intended to protect human health from carcinogenic effects shall use the arithmetic mean concentration of the ambient background samples. For ECAs based on MCLs, which implement the Basin Plan’s chemical constituents objective and are applied as annual averages, an arithmetic mean is also used for B due to the long-term basis of the criteria.

- c. **Basin Plan Objectives and MCLs.** For WQBEL’s based on site-specific numeric Basin Plan objectives or MCLs, the effluent limitations are applied directly as the ECA as either an MDEL, AMEL, or average annual effluent limitations, depending on the averaging period of the objective.
- d. **Aquatic Toxicity Criteria.** WQBEL’s based on acute and chronic aquatic toxicity criteria are calculated in accordance with Section 1.4 of the SIP. The ECAs are converted to equivalent long-term averages (i.e. LTAacute and LTAchronic) using statistical multipliers and the lowest LTA is used to calculate the AMEL and MDEL using additional statistical multipliers.
- e. **Human Health Criteria.** WQBEL’s based on human health criteria, are also calculated in accordance with Section 1.4 of the SIP. The AMEL is set equal to ECA and a statistical multiplier was used to calculate the MDEL.

$$AMEL = mult_{AMEL} \left[\min \left(\overbrace{M_A ECA_{acute}, M_C ECA_{chronic}}^{LTA_{acute}} \right) \right]$$

$$MDEL = mult_{MDEL} \left[\min \left(\underbrace{M_A ECA_{acute}, M_C ECA_{chronic}}_{LTA_{chronic}} \right) \right]$$

$$MDEL_{HH} = \left(\frac{mult_{MDEL}}{mult_{AMEL}} \right) AMEL_{HH}$$

where:

- $mult_{AMEL}$ = statistical multiplier converting minimum LTA to AMEL
- $mult_{MDEL}$ = statistical multiplier converting minimum LTA to MDEL
- M_A = statistical multiplier converting acute ECA to LTA_{acute}
- M_C = statistical multiplier converting chronic ECA to $LTA_{chronic}$

**Summary of Water Quality-Based Effluent Limitations
 Discharge Point No. D-001**

Table F-8. Summary of Water Quality-Based Effluent Limitations

Parameter	Units	Effluent Limitations				
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
Conventional Pollutants						
Biochemical Oxygen Demand (5-day at 20°C)	mg/L	30	45	90	--	--
	lbs/day ¹	130	190	380	--	--
pH	standard units	--	--	--	6	9
Total Suspended	mg/L	30	45	90	--	--

Solids	lbs/day ¹	130	190	380	--	--
Priority Pollutants						
Copper, Total Recoverable	ug/L	34	--	43	--	--
Non-Conventional Pollutants						
Ammonia, Total (as Nitrogen)	mg/L	8.4	--	16	--	--
Chlorine, Total Residual	mg/L	--	0.011 ²	0.019 ³	--	--
Total Coliform Organisms	MPN/100mL	--	23 ⁴	240 ⁵	--	--

¹ Based on an average dry weather flow of 0.5 MGD.
² Applied as a 4-day average effluent limitation.
³ Applied as a 1-hour average effluent limitation.
⁴ Applied as a 7-day median effluent limitation.
⁵ Not to be exceeded more than once in any 30-day period.

5. Whole Effluent Toxicity (WET)

For compliance with the Basin Plan’s narrative toxicity objective, this Order requires the Discharger to conduct whole effluent toxicity testing for acute and chronic toxicity, as specified in the Monitoring and Reporting Program (Attachment E section V.). This Order also contains effluent limitations for acute toxicity and requires the Discharger to implement best management practices to investigate the causes of, and identify corrective actions to reduce or eliminate effluent toxicity.

- a. **Acute Aquatic Toxicity.** The Basin Plan contains a narrative toxicity objective that states, “All waters shall be maintained free of toxic substances in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.” (Basin Plan at page III-8.00) The Basin Plan also states that, “...effluent limits based upon acute biotoxicity tests of effluents will be prescribed where appropriate...”

For priority pollutants, the SIP dictates the procedures for conducting the RPA. Acute toxicity is not a priority pollutant. Therefore, the Central Valley Water Board is not restricted to one particular RPA method. Acute whole effluent toxicity is not a priority pollutant. Therefore, due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA. USEPA’s September 2010 NPDES Permit Writer’s Manual, page 6-30, states, “State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBEL’s are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBEL’s for pathogens in all permits for POTW’s discharging to contact recreational waters).” Although the discharge has been consistently in compliance with the acute effluent limitations, the Facility is a POTW that treats domestic wastewater containing ammonia and other acutely toxic pollutants. Acute toxicity effluent limits are required to ensure compliance with the Basin Plan’s narrative toxicity objective.

USEPA Region 9 provided guidance for the development of acute toxicity effluent limitations in the absence of numeric water quality objectives for toxicity in its document titled "Guidance for NPDES Permit Issuance", dated February 1994. In section B.2. "Toxicity Requirements" (pgs. 14-15) it states that, "*In the absence of specific numeric water quality objectives for acute and chronic toxicity, the narrative criterion 'no toxics in toxic amounts' applies. Achievement of the narrative criterion, as applied herein, means that ambient waters shall not demonstrate for acute toxicity: 1) less than 90% survival, 50% of the time, based on the monthly median, or 2) less than 70% survival, 10% of the time, based on any monthly median. For chronic toxicity, ambient waters shall not demonstrate a test result of greater than 1 TUc.*" Accordingly, effluent limitations for acute toxicity have been included in this Order as follows:

Acute Toxicity. Survival of aquatic organisms in 96-hour bioassays of undiluted waste shall be no less than:

Minimum for any one bioassay----- 70%
Median for any three consecutive bioassays ----- 90%

- b. **Chronic Aquatic Toxicity.** The Basin Plan contains a narrative toxicity objective that states, "*All waters shall be maintained free of toxic substances in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.*" (Basin Plan at page III-8.00.) Adequate chronic WET data is not available to determine if the discharge has reasonable potential to cause or contribute to an in-stream excursion above the Basin Plan's narrative toxicity objective.

No dilution has been granted for the chronic condition. Therefore, chronic toxicity testing results exceeding 1 chronic toxicity unit (TUc) demonstrates the discharge has a reasonable potential to cause or contribute to an exceedance of the Basin Plan's narrative toxicity objective.

The Monitoring and Reporting Program of this Order requires chronic WET monitoring **once before expiration of the permit** (to be completed within one week of the first discharge to Lake Almanor for the permit term) for demonstration of compliance with the narrative toxicity objective. In addition to WET monitoring, the Special Provision in section VI.C.2.a of the Order requires the Discharger to submit to the Central Valley Water Board an Initial Investigative TRE Workplan for approval by the Executive Officer, to ensure the Discharger has a plan to immediately move forward with the initial tiers of a TRE, in the event effluent toxicity is encountered in the future. The provision also includes a numeric toxicity monitoring trigger, requirements for accelerated monitoring, and requirements for TRE initiation if toxicity is demonstrated.

Numeric chronic WET effluent limitations have not been included in this Order. The SIP contains implementation gaps regarding the appropriate form and implementation of chronic toxicity limits. This has resulted in the petitioning of a NPDES permit in the Los Angeles Region¹ that contained numeric chronic toxicity

¹ In the Matter of the Review of Own Motion of Waste Discharge Requirements Order Nos. R4-2002-0121 [NPDES No. CA0054011] and R4-2002-0123 [NPDES NO. CA0055119] and Time Schedule Order Nos. R4-2002-0122 and R4-2002-0124 for Los Coyotes and Long Beach Wastewater Reclamation Plants Issued by

effluent limitations. To address the petition, the State Water Board adopted WQO 2003-012 directing its staff to revise the toxicity control provisions in the SIP. The State Water Board states the following in WQO 2003-012, *“In reviewing this petition and receiving comments from numerous interested persons on the propriety of including numeric effluent limitations for chronic toxicity in NPDES permits for publicly-owned treatment works that discharge to inland waters, we have determined that this issue should be considered in a regulatory setting, in order to allow for full public discussion and deliberation. We intend to modify the SIP to specifically address the issue. We anticipate that review will occur within the next year. We therefore decline to make a determination here regarding the propriety of the final numeric effluent limitations for chronic toxicity contained in these permits.”* The process to revise the SIP is currently underway. Proposed changes include clarifying the appropriate form of effluent toxicity limits in NPDES permits and general expansion and standardization of toxicity control implementation related to the NPDES permitting process. Since the toxicity control provisions in the SIP are under revision it is infeasible to develop numeric effluent limitations for chronic toxicity. Therefore, this Order requires that the Discharger meet best management practices for compliance with the Basin Plan’s narrative toxicity objective, as allowed under 40 CFR 122.44(k).

To ensure compliance with the Basin Plan’s narrative toxicity objective, the Discharger is required to conduct chronic WET testing, as specified in the Monitoring and Reporting Program (Attachment E section V.). Furthermore, the Special Provision contained at VI.C.2.a. of this Order requires the Discharger to investigate the causes of, and identify and implement corrective actions to reduce or eliminate effluent toxicity. If the discharge demonstrates toxicity exceeding the numeric toxicity monitoring trigger, the Discharger is required to initiate a Toxicity Reduction Evaluation (TRE) in accordance with an approved TRE workplan. The numeric toxicity monitoring trigger is not an effluent limitation; it is the toxicity threshold at which the Discharger is required to perform accelerated chronic toxicity monitoring, as well as, the threshold to initiate a TRE if effluent toxicity has been demonstrated.

D. Final Effluent Limitation Considerations

1. Mass-based Effluent Limitations

40 CFR 122.45(f)(1) requires effluent limitations be expressed in terms of mass, with some exceptions, and 40 CFR 122.45(f)(2) allows pollutants that are limited in terms of mass to additionally be limited in terms of other units of measurement. This Order includes effluent limitations expressed in terms of mass and concentration. In addition, pursuant to the exceptions to mass limitations provided in 40 CFR 122.45(f)(1), some effluent limitations are not expressed in terms of mass, such as pH and temperature, and when the applicable standards are expressed in terms of concentration (e.g., CTR criteria and MCLs) and mass limitations are not necessary to protect the beneficial uses of the receiving water.

Mass-based effluent limitations were calculated based upon the design flow (Average Dry Weather Flow) permitted in section IV.A.1.f of this Order.

2. Averaging Periods for Effluent Limitations

40 CFR 122.45 (d) requires average weekly and average monthly discharge limitations for publicly owned treatment works (POTW's) unless impracticable. However, for toxic pollutants and pollutant parameters in water quality permitting, USEPA recommends the use of a maximum daily effluent limitation in lieu of average weekly effluent limitations for two reasons. *"First, the basis for the 7-day average for POTW's derives from the secondary treatment requirements. This basis is not related to the need for assuring achievement of water quality standards. Second, a 7-day average, which could comprise up to seven or more daily samples, could average out peak toxic concentrations and therefore the discharge's potential for causing acute toxic effects would be missed."* (TSD, pg. 96) This Order uses maximum daily effluent limitations in lieu of average weekly effluent limitations for ammonia and copper as recommended by the TSD for the achievement of water quality standards and for the protection of the beneficial uses of the receiving stream. Furthermore, for BOD₅, chlorine residual, pH, total suspended solids, and total coliform organisms, weekly average effluent limitations have been replaced or supplemented with effluent limitations utilizing shorter averaging periods. The rationale for using shorter averaging periods for these constituents is discussed in section IV.C.3 of this Fact Sheet.

3. Satisfaction of Anti-Backsliding Requirements

The Clean Water Act specifies that a revised permit may not include effluent limitations that are less stringent than the previous permit unless a less stringent limitation is justified based on exceptions to the anti-backsliding provisions contained in Clean Water Act sections 402(o) or 303(d)(4), or, where applicable, 40 CFR 122.44(l).

The effluent limitations in this Order are at least as stringent as the effluent limitations in Order R5-2009-0078, with the exception of effluent limitations for total ammonia (as nitrogen) and copper (total recoverable). The effluent limitations for these pollutants are less stringent than those in Order R5-2009-0078. This relaxation of effluent limitations is consistent with the anti-backsliding requirements of the CWA and federal regulations.

a. CWA section 402(o)(1) and 303(d)(4). CWA section 402(c)(1) prohibits the establishment of less stringent water quality-based effluent limits "except in compliance with Section 303(d)(4)." CWA section 303(d)(4) has two parts: paragraph (A) which applies to nonattainment waters and paragraph (B) which applies to attainment waters.

- i. For waters where standards are not attained, CWA section 304(d)(4)(A) specifies that any effluent limit based on a TMDL or other WLA may be revised only if the cumulative effect of all such revised effluent limits based on such TMDLs or WLAs will assure the attainment of such water quality standards.
- ii. For attainment waters, CWA section 303(d)(4)(B) specifies that a limitation based on a water quality standard may be relaxed where the action is consistent with the antidegradation policy.

Lake Almanor is considered attainment water for a total ammonia (as nitrogen) and copper (total recoverable) because the receiving water is not listed as impaired on the 303(d) list for these constituents¹. As discussed in section IV.D.4, below, removal or relaxation of the effluent limits complies with federal and state antidegradation

¹ "The exceptions in Section 303(d)(4) address both waters in attainment with water quality standards and those not in attainment, i.e. waters on the section 303(d) impaired waters list." State Water Board Order WQ 2008-0006, Berry Petroleum Company, Poso Creek/McVan Facility.

requirements. Thus, removal or relaxation of the effluent limitations for ammonia and copper from Order R5-2009-0078 meets the exception in CWA section 303(d)(4)(B).

b. CWA section 402(o)(2). CWA section 402(c)(2) provides several exceptions to the anti-backsliding regulations. CWA 402(o)(2)(B)(i) allows a renewed, reissued, or modified permit to contain a less stringent effluent limitation for a pollutant if information is available which was not available at the time of permit issuance (other than revised regulations, guidance, or test methods) and which would have justified the application of a less stringent effluent limitation at the time of permit issuance. Updated information that was not available at the time Order R5-2009-0078 was issued indicates that less stringent effluent limitations for total ammonia (as nitrogen) and copper (total recoverable) based on available dilution credits satisfy requirements in CWA section 402(c)(2).

4. Antidegradation Policies

a. **Surface Water.** This Order does not allow for an increase in flow or mass of pollutants to the receiving water. Therefore, a complete antidegradation analysis is not necessary. The Order requires compliance with applicable federal technology-based standards and with WQBEL's where the discharge could have the reasonable potential to cause or contribute to an exceedance of water quality standards. The permitted discharge is consistent with the antidegradation provisions of 40 CFR 131.12 and State Water Board Resolution No. 68-16. Compliance with these requirements will result in the use of best practicable treatment or control of the discharge. The impact on existing water quality will be insignificant.

This Order relaxes existing effluent limitations for copper (total recoverable) and total ammonia (as nitrogen) based on applicable criteria evaluated with updated information. The relaxation of WQBELs for copper (total recoverable) and total ammonia (as nitrogen) will not result in an increase in pollutant concentration or loading, a decrease in the level of treatment or control, or a reduction of water quality. Therefore, the Central Valley Water Board finds that the relaxation of effluent limitations does not result in an allowed increase in pollutants or any additional degradation of the receiving water. Thus, the removal and relaxation of effluent limitations is consistent with antidegradation provisions of 40 CFR 131.12 and State Water Board Resolution No. 68 16.

b. **Groundwater.** The Discharger utilizes facultative treatment ponds. Domestic wastewater contains constituents such as total dissolved solids (TDS), specific conductivity, pathogens, nitrates, organics, metals, and oxygen demanding substances. Percolation from the facultative treatment ponds may result in an increase in the concentration of these constituents in groundwater. The increase in the concentration of these constituents in groundwater must be consistent with Resolution No. 68-16. Any increase in pollutant concentrations in groundwater must be necessary to allow wastewater utility service, must be necessary to accommodate housing and economic expansion in the area, and must be consistent with maximum benefit to the people of the State of California. Some degradation of groundwater by the Discharger is consistent with Resolution No. 68-16 provided that:

i. the degradation is limited in extent;

- ii. the degradation after effective source control, treatment, and control is limited to waste constituents typically encountered in municipal wastewater as specified in the groundwater limitations in this Order;
- iii. the Discharger minimizes the degradation by fully implementing, regularly maintaining, and optimally operating best practicable treatment and control (BPTC) measures; and
- iv. the degradation does not result in water quality less than that prescribed in the Basin Plan.

Groundwater limitations for ammonia (as NH₄⁺), electrical conductivity, pH, and total dissolved solids have been removed. Groundwater monitoring wells were installed in November 2014 and recent groundwater sampling has not resulted in a sufficient number of samples to develop limits for the subject constituents. Instead, only Basin Plan objectives are implemented to allow the Discharger more time to collect and evaluate groundwater data. Newly prescribed limits are protective of groundwater.

5. Stringency of Requirements for Individual Pollutants

This Order contains both technology-based effluent limitations and WQBEL’s for individual pollutants. The technology-based effluent limitations consist of restrictions on flow, BOD₅, TSS, pH, and percent removal requirements for BOD₅ and TSS. Restrictions on flow, BOD₅, TSS, and pH are discussed in IV.B of this Fact Sheet. This Order’s technology-based pollutant restrictions implement the minimum, applicable federal technology-based requirements. In addition, this Order contains effluent limitations more stringent than the minimum, federal technology-based requirements that are necessary to meet water quality standards.

WQBEL’s have been derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable federal water quality standards. To the extent that toxic pollutant WQBEL’s were derived from the CTR, the CTR is the applicable standard pursuant to 40 C.F.R. section 131.38. The procedures for calculating the individual water quality-based effluent limitations for priority pollutants are based on the CTR implemented by the SIP, which was approved by U.S. EPA on 18 May, 2000. All beneficial uses and water quality objectives contained in the Basin Plan were approved under state law and submitted to and approved by U.S. EPA prior to 30 May, 2000. Any water quality objectives and beneficial uses submitted to U.S. EPA prior to 30 May, 2000, but not approved by U.S. EPA before that date, are nonetheless “applicable water quality standards for purposes of the CWA” pursuant to 40 C.F.R. section 131.21(c)(1). Collectively, this Order’s restrictions on individual pollutants are no more stringent than required to implement the requirements of the CWA.

**Summary of Final Effluent Limitations
 Discharge Point No. D-001**

Table F-9. Summary of Final Effluent Limitations

Parameter	Units	Effluent Limitations					Basis ¹
		Average Monthly	Average Weekly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum	
Conventional Pollutants							
Biochemical Oxygen	mg/L	30	45	90	--	--	CFR
	lbs/day ²	130	190	380	--	--	

Demand (5-day at 20°C)	% Removal	85	--	--	--	--	
pH	standard units	--	--	--	6	9	BP
Total Suspended Solids	mg/L	30	45	90	--	--	CFR
	lbs/day ²	130	190	380	--	--	
	% Removal	85	--	--	--	--	
Priority Pollutants							
Copper, Total Recoverable	ug/L	34	--	43	--	--	CTR
Non-Conventional Pollutants							
Acute Toxicity	% Survival	--	--	70 ³ /90 ⁴	--	--	BP
Ammonia, Total (as Nitrogen)	mg/L	8.4	--	16	--	--	NAWQC
Chlorine, Total Residual	mg/L	--	0.011 ⁵	0.019 ⁶	--	--	NAWQC
Total Coliform Organisms	MPN/100mL	--	23 ⁷	240 ⁸	--	--	Title 22

¹ CFR – Based on secondary treatment standards contained in 40 CFR Part 133.
 BP – Based on water quality objectives contained in the Basin Plan.
 CTR – Based on water quality criteria contained in the California Toxics Rule and applied as specified in the SIP.
 NAWQC – Based on USEPA’s National Ambient Water Quality Criteria for the protection of freshwater aquatic life.
² Based on an average dry weather flow of 2.0 MGD.
³ 70% minimum of any one bioassay.
⁴ 90% median for any three consecutive bioassays.
⁵ Applied as a 4-day average effluent limitation.
⁶ Applied as a 1-hour average effluent limitation.
⁷ Applied as a 7-day median effluent limitation.
⁸ Not to be exceeded more than once in any 30-day period.

E. Interim Effluent Limitations

The State Water Board’s Resolution 2008-0025 “Policy for Compliance Schedules in National Pollutant Discharge Elimination System Permits” (Compliance Schedule Policy) requires the Central Valley Water Board to establish interim numeric effluent limitations in this Order for compliance schedules longer than one year. As discussed in section VI.B.6 of this Fact Sheet, the Central Valley Water Board is approving a compliance schedule longer than one year for total ammonia and total coliform (more than once in any 30-day period limit). The Compliance Schedule Policy requires that interim effluent limitations must be based on current treatment plant performance or existing permit limitations, whichever is more stringent.

The interim effluent limitation for total ammonia is performance-based. The interim effluent limitation for total coliform (more than once in any 30-day period limit) is set to the R5-2004-0051 permit limitation, a limit that the Discharger has previously met and is therefore operationally attainable.

- 1. Compliance Schedule for Total Ammonia and Total Coliform.** The permit limitations in WDR Order R5-2009-0078 for total ammonia and total coliform (more than once in any 30-day period limit) were more stringent or new limitations than those previously imposed. Those limitations were based on the new or revised objectives. The Discharger has complied with the application requirements in paragraph 4 of the State Water Board’s Compliance Schedule Policy, and the Discharger’s application

demonstrates the need for additional time to implement actions to comply with the new limitations, as described below. Therefore, a compliance schedule for compliance with the effluent limitations for total ammonia and total coliform (more than once in any 30-day period limit) is established in this Order.

A compliance schedule is necessary because the Discharger must implement actions that include: (1) development of a preliminary engineering report, (2) application and acquisition of funding for a selected compliance project, (3) design of a selected alternative, and (4) construction of the selected alternative.

The Discharger has made diligent efforts to quantify pollutant levels in the discharge and the sources of the pollutant in the waste stream, and the results of those efforts over the previous permit cycle. The Discharger has also made efforts to improve treatment components and investigative measures at the Facility, which included: replacement of piping in the sanitary sewer collection system (e.g., sewer crossings, laterals, mainlines, and submains), construction of additional wetland ponds for land disposal of effluent, installation of circulators in the stabilization ponds, heightening of the stabilization pond levee system, and installation of groundwater monitoring wells.

The compliance schedule is provided from the effective date of this Order until 13 August 2019 according to the Basin Plan, which implements State Water Resources Control Board Resolution No. 2008-0025, Policy for Compliance Schedules in National Pollutant Discharge Elimination System Permits. The compliance schedule is extended in a Cease and Desist Order from 13 August 2019 until the expiration date of this Order pursuant to Water Code section 13385, subdivision (j)(3)(A) through (D).

The compliance schedule is as short as possible and within the regulatory confinement allowed under California and federal laws for the constituents of concern. The Discharger is attempting to obtain compliance by the end of this permit cycle, which is an aggressive timeline to complete engineering studies, attain funding, and construct infrastructure.

Interim performance-based limitations have been established in this Order. The interim limitations were determined as described in section IV.E.2., below, and are in effect through until the final limitations take effect. (As part of the compliance schedule, this Order requires the Discharger to submit a corrective action plan and implementation schedule to assure compliance with the final effluent limitations for total ammonia and total coliform (more than once in any 30-day period limit). In addition, the Discharger shall submit, prepare, and implement a pollution prevention plan that is in compliance with Water Code section 13263.3(d)(3). The interim numeric effluent limitations and source control measures will result in the highest discharge quality that can reasonably be achieved until final compliance is attained.

2. Interim Limits for Total Ammonia and Total Coliform. The Compliance Schedule Policy requires the Central Valley Water Board to establish interim requirements and dates for their achievement in the NPDES permit. Interim numeric effluent limitations are required for compliance schedules longer than one year. Interim effluent limitations must be based on current treatment plant performance or previous final permit limitations, whichever is more stringent. When feasible, interim limitations must correspond with final permit effluent limitations with respect to averaging bases (e.g., AMEL, MDEL, average monthly, etc.) for effluent limitations for which compliance protection is intended.

The interim limitations for total ammonia in this Order are based on the current treatment plant performance. In developing the interim limitation, where there are 10 sampling data points or more, sampling and laboratory variability is accounted for by establishing interim limits that are based on normally distributed data where 99.9% of the data points will lie within 3.3 standard deviations of the mean (Basic Statistical Methods for Engineers and Scientists, Kennedy and Neville, Harper and Row). Therefore, the interim limitations in this Order are established as the mean plus 3.3 standard deviations of the available data.

When there are less than 10 sampling data points available, the EPA Technical Support Document for Water Quality-based Toxics Control ((EPA/505/2-90-001), TSD) recommends a coefficient of variation of 0.6 be utilized as representative of wastewater effluent sampling. The TSD recognizes that a minimum of 10 data points is necessary to conduct a valid statistical analysis. The multipliers contained in Table 5-2 of the TSD are used to determine a maximum daily limitation based on a long-term average objective. In this case, the long-term average objective is to maintain, at a minimum, the current plant performance level. Therefore, when there are less than 10 sampling points for a constituent, interim limitations are based on 3.11 times the maximum observed effluent concentration to obtain the daily maximum interim limitation (TSD, Table 5 2).

The Central Valley Water Board finds that the Discharger can undertake source control and treatment plant measures to maintain compliance with the interim limitations included in this Order. Interim limitations are established when compliance with final effluent limitations cannot be achieved by the existing discharge. Discharge of constituents in concentrations that are in excess of final effluent limitations, but in compliance with interim effluent limitations, can significantly degrade water quality and adversely affect beneficial uses of the receiving stream on a long-term basis. The interim limitations, however, establish an enforceable ceiling concentration until compliance with an effluent limitation can be achieved. The limited, short-term degradation associated with the compliance schedule is consistent with state and federal policies and is authorized by 40 CFR 122.47 and the Compliance Schedule Policy.

The following table summarizes the calculations of interim effluent limitations for total ammonia and total coliform:

Table F-11. Interim Effluent Limitation Calculation Summary

Parameter	Units	Maximum Effluent Concentration	Mean	Standard Deviation	Number of Samples	Interim Limitation (Average Monthly)	Interim Limitation (Maximum Daily)
Ammonia, Total (as Nitrogen)	mg/L	9.9	4.6	2.2	18	12	21
Total Coliform Organisms ¹	MPN/100mL	900	78	180	63	--	500 ²

¹ The interim limitation for total coliform is set to the R5-2004-0051 permit limitation. This is a limitation that the Discharger has previously met and is therefore operationally attainable. Maximum effluent concentration, mean, median, and standard deviation values are included for reference but were not used in calculating the interim total coliform limit.

² This is the total coliform interim limit for the “more than once in any 30-day period” limit.

F. Land Discharge Specifications– Not Applicable

G. Recycling Specifications– Not Applicable

V. RATIONALE FOR RECEIVING WATER LIMITATIONS

A. Surface Water

1. CWA section 303(a-c), requires states to adopt water quality standards, including criteria where they are necessary to protect beneficial uses. The Central Valley Water Board adopted water quality criteria as water quality objectives in the Basin Plan. The Basin Plan states that “[t]he numerical and narrative water quality objectives define the least stringent standards that the Regional Water Board will apply to regional waters in order to protect the beneficial uses.” The Basin Plan includes numeric and narrative water quality objectives for various beneficial uses and water bodies. This Order contains receiving surface water limitations based on the Basin Plan numerical and narrative water quality objectives for bacteria, biostimulatory substances, color, chemical constituents, dissolved oxygen, floating material, oil and grease, pH, pesticides, radioactivity, suspended sediment, settleable substances, suspended material, tastes and odors, temperature, toxicity, and turbidity.

B. Groundwater

1. The beneficial uses of the underlying groundwater are municipal and domestic supply, industrial service supply, industrial process supply, and agricultural supply.
2. Basin Plan water quality objectives include narrative objectives for chemical constituents, tastes and odors, and toxicity of groundwater. The toxicity objective requires that groundwater be maintained free of toxic substances in concentrations that produce detrimental physiological responses in humans, plants, animals, or aquatic life. The chemical constituent objective states groundwater shall not contain chemical constituents in concentrations that adversely affect any beneficial use. The tastes and odors objective prohibits taste- or odor-producing substances in concentrations that cause nuisance or adversely affect beneficial uses. The Basin Plan also establishes numerical water quality objectives for chemical constituents and radioactivity in groundwater designated as municipal supply. These include, at a minimum, compliance with MCLs in Title 22 of the CCR. The bacteria objective prohibits coliform organisms at or above 2.2 MPN/100 mL. The Basin Plan requires the application of the most stringent objective necessary to ensure that waters do not contain chemical constituents, toxic substances, radionuclides, taste- or odor-producing substances, or bacteria in concentrations that adversely affect municipal or domestic supply, agricultural supply, industrial supply or some other beneficial use.

VI. RATIONALE FOR PROVISIONS

A. Standard Provisions

Standard Provisions, which apply to all NPDES permits in accordance with 40 C.F.R. section 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 C.F.R. section 122.42, are provided in Attachment D. The discharger must comply with all standard provisions and with those additional conditions that are applicable under section 122.42.

Sections 122.41(a)(1) and (b) through (n) of 40 C.F.R. establish conditions that apply to all state-issued NPDES permits. These conditions must be incorporated into the permits either expressly or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. Section 123.25(a)(12) of 40 C.F.R. allows the state to omit or modify conditions to impose more stringent requirements. In accordance with 40 C.F.R. section 123.25, this Order omits federal conditions that address enforcement authority

specified in 40 C.F.R. sections 122.41(j)(5) and (k)(2) because the enforcement authority under the Water Code is more stringent. In lieu of these conditions, this Order incorporates by reference Water Code section 13387(e).

B. Special Provisions

1. Reopener Provisions

- a. **Mercury.** This provision allows the Central Valley Water Board to reopen this Order in the event mercury is found to be causing toxicity based on acute or chronic toxicity test results, or if a TMDL program is adopted. In addition, this Order may be reopened if the Central Valley Water Board determines that a mercury offset program is feasible for dischargers subject to NPDES permits.
- b. **Whole Effluent Toxicity.** This Order requires the Discharger to investigate the causes of, and identify corrective actions to reduce or eliminate effluent toxicity through a Toxicity Reduction Evaluation (TRE). This Order may be reopened to include a numeric chronic toxicity limitation, a new acute toxicity limitation, and/or a limitation for a specific toxicant identified in the TRE. Additionally, if a numeric chronic toxicity water quality objective is adopted by the State Water Board, this Order may be reopened to include a numeric chronic toxicity limitation based on that objective.
- c. **Water Effects Ratio (WER) and Metal Translators.** A default WER of 1.0 has been used in this Order for calculating CTR criteria for applicable priority pollutant inorganic constituents. In addition, default dissolved-to-total metal translators have been used to convert water quality objectives from dissolved to total recoverable when developing effluent limitations for copper. If the Discharger performs studies to determine site-specific WERs and/or site-specific dissolved-to-total metal translators, this Order may be reopened to modify the effluent limitations for the applicable inorganic constituents.

2. Special Studies and Additional Monitoring Requirements

- a. **Chronic Whole Effluent Toxicity Requirements.** The Basin Plan contains a narrative toxicity objective that states, “*All waters shall be maintained free of toxic substances in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.*” (Basin Plan at page III-8.00.) Adequate WET data is not available to determine if the discharge has reasonable potential to cause or contribute to an in-stream excursion above the Basin Plan’s narrative toxicity objective.

The Monitoring and Reporting Program of this Order requires chronic WET monitoring for demonstration of compliance with the narrative toxicity objective. In addition to WET monitoring, this provision requires the Discharger to submit to the Central Valley Water Board an Initial Investigative TRE Workplan for approval by the Executive Officer, to ensure the Discharger has a plan to immediately move forward with the initial tiers of a TRE, in the event effluent toxicity is encountered in the future. The provision also includes a numeric toxicity monitoring trigger, requirements for accelerated monitoring, and requirements for TRE initiation if toxicity is demonstrated.

Monitoring Trigger. A numeric toxicity monitoring trigger of $> 1 \text{ TUc}$ (where $\text{TUc} = 100/\text{NOEC}$) is applied in the provision, because this Order does not allow any dilution for the chronic condition. Therefore, a TRE is triggered when the effluent exhibits toxicity at 100% effluent.

Accelerated Monitoring. The provision requires accelerated WET testing when a regular WET test result exceeds the monitoring trigger. The purpose of accelerated monitoring is to determine, in an expedient manner, whether there is toxicity before requiring the implementation of a TRE. Due to possible seasonality of the toxicity, the accelerated monitoring should be performed in a timely manner, preferably taking no more than 2 to 3 months to complete.

The provision requires accelerated monitoring consisting of four chronic toxicity tests in a six-week period (i.e., one test every two weeks) using the species that exhibited toxicity. Guidance regarding accelerated monitoring and TRE initiation is provided in the *Technical Support Document for Water Quality-based Toxics Control*, EPA/505/2-90-001, March 1991 (TSD). The TSD at page 118 states, “EPA recommends if toxicity is repeatedly or periodically present at levels above effluent limits more than 20 percent of the time, a TRE should be required.” Therefore, four accelerated monitoring tests are required in this provision. If no toxicity is demonstrated in the four accelerated tests, then it demonstrates that toxicity is not present at levels above the monitoring trigger more than 20 percent of the time (only 1 of 5 tests are toxic, including the initial test). However, notwithstanding the accelerated monitoring results, if there is adequate evidence of effluent toxicity (i.e. toxicity present exceeding the monitoring trigger more than 20 percent of the time), the Executive Officer may require that the Discharger initiate a TRE.


See the WET Accelerated Monitoring Flow Chart (Figure F-1), below, for further clarification of the accelerated monitoring requirements and for the decision points for determining the need for TRE initiation.

TRE Guidance. The Discharger is required to prepare a TRE Workplan in accordance with USEPA guidance. Numerous guidance documents are available, as identified below:

- i. Toxicity Reduction Evaluation Guidance for Municipal Wastewater Treatment Plants, EPA/833-B-99/002, August 1999.
- ii. Generalized Methodology for Conducting Industrial Toxicity Reduction Evaluations (TREs), EPA/600/2-88/070, April 1989.
- iii. Methods for Aquatic Toxicity Identification Evaluations: Phase I Toxicity Characterization Procedures, Second Edition, EPA 600/6-91/003, February 1991.
- iv. Toxicity Identification Evaluation: Characterization of Chronically Toxic Effluents, Phase I, EPA/600/6-91/005F, May 1992.
- v. Methods for Aquatic Toxicity Identification Evaluations: Phase II Toxicity Identification Procedures for Samples Exhibiting Acute and Chronic Toxicity, Second Edition, EPA/600/R-92/080, September 1993.
- vi. Methods for Aquatic Toxicity Identification Evaluations: Phase III Toxicity Confirmation Procedures for Samples Exhibiting Acute and Chronic Toxicity, Second Edition, EPA 600/R-92/081, September 1993.
- vii. Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms, Fifth Edition, EPA-821-R-02-012, October 2002.

- viii. Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA-821-R-02-013, October 2002.
- ix. Technical Support Document for Water Quality-based Toxics Control, EPA/505/2-90-001, March 1991.

Figure F-1
WET Accelerated Monitoring Flow Chart

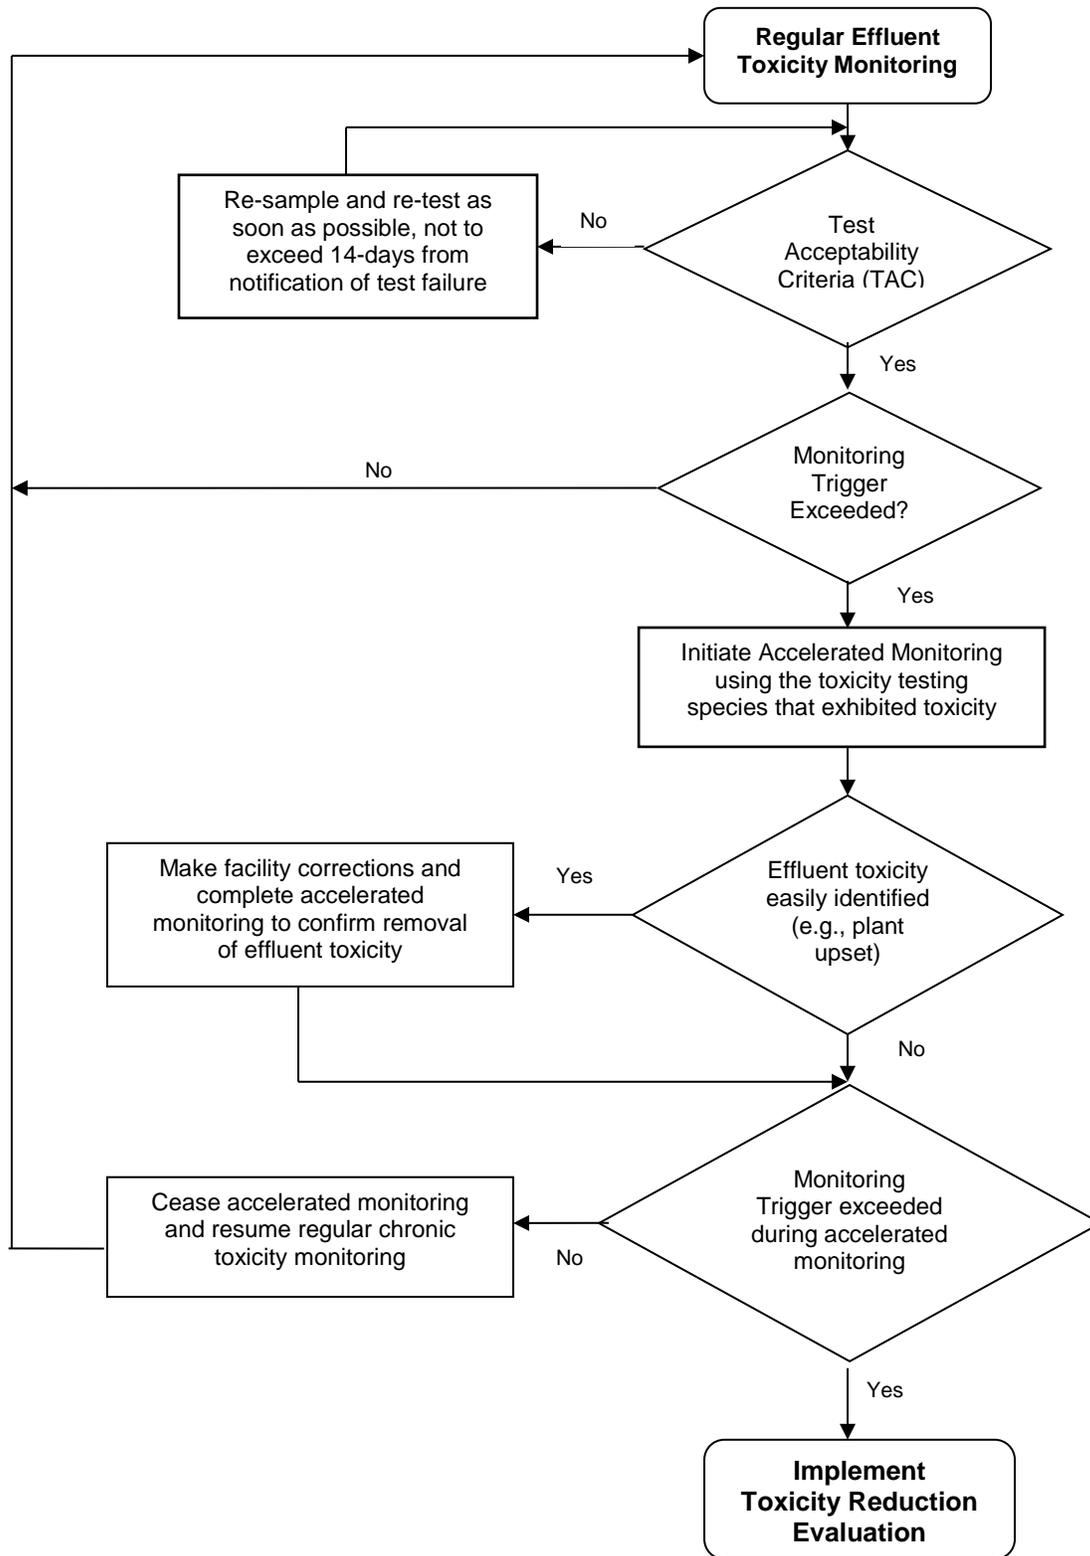

- b. **Groundwater Monitoring Network Verification and Groundwater Quality Characterization Study.** To determine compliance with Groundwater Limitations, Section V.B., **within 30 months following adoption of this Order**, the Discharger shall submit a Groundwater Monitoring Network Verification and Groundwater Quality Characterization Study. This study is an evaluation of the current groundwater monitoring network and should focus on confirming: (1) that one or more adequate background monitoring wells are present and (2) that there is a sufficient number of designated monitoring wells hydraulically downgradient of every treatment, storage, and disposal unit that does or may release waste constituents to groundwater. A scientific validation of the existing groundwater monitoring wells should be assessed in characterizing any impacts to the underlying aquifer. The groundwater quality portion of the study must show, at a minimum, a summary of monitoring data and a comparison of background groundwater water quality to all hydraulically downgradient wells. Determination of background quality shall be made using the methods described in Title 27 California Code of Regulations Section 20415(e)(10), and shall be based on data from at least eight consecutive quarterly (or more frequent) groundwater monitoring events. For each monitoring parameter/constituent, the report shall compare measured concentrations for compliance monitoring wells with the background concentration. Any Groundwater Monitoring Work Plans shall be prepared in accordance with, and including items listed in the following document: *Requirements for Monitoring Well Installation Work Plans and Monitoring Well Installation Reports*. All monitoring wells shall comply with the appropriate standards as described in California Well Standards Bulletin 74-90 (June 1991) and Water Well Standards: State of California Bulletin 74-81 (December 1981), and any more stringent standards adopted by the Discharger or County pursuant to Water Code section 13801.
 - c. **Best Practical Treatment or Control (BPTC).** If groundwater monitoring indicates that the discharge of waste is threatening to cause, or has caused, groundwater to contain waste constituents in concentrations statistically greater than background water quality, the Discharger shall submit, **within 48 months following adoption of this Order**, a BPTC Evaluation Work Plan that sets forth a scope and schedule for a technical evaluation of each component of the facilities' wastewater treatment system to determine BPTC for any waste constituents of concern. The work plan shall include a preliminary evaluation of each component of the wastewater treatment system and propose a time schedule for completing the technical evaluation. The time schedule to complete the evaluation shall be as short as practicable, and shall not exceed 1 year.
- 3. Best Management Practices and Pollution Prevention**
- a. **Water Code Section 13263.3(d)(3) Pollution Prevention Plans.** A pollution prevention plan for total ammonia and total coliform is required in this Order per Water Code section 13263.3(d)(1)(C). The pollution prevention plans required in section VI.C.3.b. of this Order, shall, at a minimum, meet the requirements outlined in Water Code section 13263.3(d)(3). The minimum requirements for the pollution prevention plans include the following:
 - i. An estimate of all of the sources of a pollutant contributing, or potentially contributing, to the loadings of a pollutant in the treatment plant influent.
 - ii. An analysis of the methods that could be used to prevent the discharge of the pollutants into the Facility, including application of local limits to industrial or commercial dischargers regarding pollution prevention techniques, public

education and outreach, or other innovative and alternative approaches to reduce discharges of the pollutant to the Facility. The analysis also shall identify sources, or potential sources, not within the ability or authority of the Discharger to control, such as pollutants in the potable water supply, airborne pollutants, pharmaceuticals, or pesticides, and estimate the magnitude of those sources, to the extent feasible.

- iii. An estimate of load reductions that may be attained through the methods identified in subparagraph ii.
- iv. A plan for monitoring the results of the pollution prevention program.
- v. A description of the tasks, cost, and time required to investigate and implement various elements in the pollution prevention plan.
- vi. A statement of the Discharger's pollution prevention goals and strategies, including priorities for short-term and long-term action, and a description of the Discharger's intended pollution prevention activities for the immediate future.
- vii. A description of the Discharger's existing pollution prevention programs.
- viii. An analysis, to the extent feasible, of any adverse environmental impacts, including cross-media impacts or substitute chemicals that may result from the implementation of the pollution prevention program.
- ix. An analysis, to the extent feasible, of the costs and benefits that may be incurred to implement the pollution prevention program.

- b. **Salinity Evaluation and Minimization Plan.** An Evaluation and Minimization Plan for salinity is required in this Order to ensure adequate measures are developed and implemented by the Discharger to reduce the discharge of salinity to Lake Almanor.

4. Construction, Operation, and Maintenance Specifications

- a. The operation and maintenance specifications for the facultative ponds are necessary to protect the beneficial uses of the groundwater. The specifications included in this Order are retained from R5-2009-0078. In addition, reporting requirements related to use of the facultative ponds are required to monitor their use and the potential impact on groundwater.

5. Special Provisions for Municipal Facilities (POTW's Only)

The State Water Board issued General Waste Discharge Requirements for Sanitary Sewer Systems, Water Quality Order 2006-0003-DWQ (General Order) on May 2, 2006. The Monitoring and Reporting Requirements for the General Order were amended by Water Quality Order WQ 2008-0002-EXEC on February 20, 2008. The General Order requires public agencies that own or operate sanitary sewer systems with greater than one mile of pipes or sewer lines to enroll for coverage under the General Order. The General Order requires agencies to develop sanitary sewer management plans (SSMPs) and report all sanitary sewer overflows (SSOs), among other requirements and prohibitions.

Furthermore, the General Order contains requirements for operation and maintenance of collection systems and for reporting and mitigating sanitary sewer overflows. Inasmuch that the Discharger's collection system is part of the system that is subject to this Order, certain standard provisions are applicable as specified in Provisions, section VI.C.5. For instance, the 24-hour reporting requirements in this Order are not included in the General Order. The Discharger must comply with both the General Order and this Order.

The Discharger and public agencies that are discharging wastewater into the facility were required to obtain enrollment for regulation under the General Order by December 1, 2006.

6. Compliance Schedules

In general, an NPDES permit must include final effluent limitations that are consistent with CWA section 301 and with 40 C.F.R. section 122.44(d). There are exceptions to this general rule. The State Water Board's Resolution 2008-0025 "Policy for Compliance Schedules in National Pollutant Discharge Elimination System Permits" (Compliance Schedule Policy) allows compliance schedules for new, revised, or newly interpreted water quality objectives or criteria, or in accordance with a Total Maximum Daily Load (TMDL). All compliance schedules must be as short as possible, and may not exceed ten years from the effective date of the adoption, revision, or new interpretation of the applicable water quality objective or criterion, unless a TMDL allows a longer schedule. Where a compliance schedule for a final effluent limitation exceeds one year, the Order must include interim numeric effluent limitations for that constituent or parameter, interim requirements and dates toward achieving compliance, and compliance reporting within 14 days after each interim date. The Order may also include interim requirements to control the pollutant, such as pollutant minimization and source control measures.

The permit limitations for total ammonia (average monthly and maximum daily) and total coliform (more than once in any 30-day period limit) were more stringent or new limitations in WDR Order No. R5-2009-0078. The Discharger has complied with the application requirements in paragraph 4 of the Compliance Schedule Policy and the Discharger's application demonstrates the need for additional time to implement actions to comply with the new limitations. Therefore, a compliance schedule for compliance with final effluent limitations for total ammonia and total coliform are established in this Order.

A compliance schedule is necessary because the Discharger must implement actions that include: (1) development of a preliminary engineering report, (2) application and acquisition of funding for a selected compliance project, (3) design of selected a alternative, and (4) construction of the selected alternative.

The Discharger has made diligent efforts to quantify pollutant levels in the discharge and the sources of the pollutant in the waste stream, and the results of those efforts over the previous permit cycle. The Discharger has also made efforts to improve treatment components and investigative measures at the Facility, which included: replacement of piping in the sanitary sewer collection system (e.g., sewer crossings, laterals, mainlines, and submains), construction of additional wetland ponds for land disposal of effluent, installation of circulators in the stabilization ponds, heightening of the stabilization pond levee system, and installation of groundwater monitoring wells.

The compliance schedule is provided from the effective date of this Order until 13 August 2019 according to the Basin Plan, which implements State Water Resources Control Board Resolution No. 2008-0025, Policy for Compliance Schedules in National Pollutant Discharge Elimination System Permits. The compliance schedule is extended in a Cease and Desist Order from 13 August 2019 until the expiration date of this Order pursuant to Water Code section 13385, subdivision (j)(3)(A) through (D).

The compliance schedule is as short as possible and within the regulatory confinement allowed under California and federal laws for the constituents of concern. The Discharger

is attempting to obtain compliance by the end of this permit cycle, which is an aggressive timeline to complete engineering studies, attain funding, and construct infrastructure.

The compliance schedule for total ammonia and total coliform (more than once in any 30-day period limit) is included in Special Provisions section VI.C.7.

VII. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS

CWA section 308 and 40 C.F.R. sections 122.41(h), (j)-(l), 122.44(i), and 122.48 require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Central Valley Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. The Monitoring and Reporting Program (MRP), Attachment E of this Order establishes monitoring, reporting, and recordkeeping requirements that implement federal and state requirements. The following provides the rationale for the monitoring and reporting requirements contained in the MRP for this facility.

A. Influent Monitoring

1. Influent monitoring is required to collect data on the characteristics of the wastewater and to assess compliance with effluent limitations (e.g., BOD₅ and TSS reduction requirements). The monitoring frequencies for flow (continuous), BOD₅, and TSS (1/week) have been retained from Order No. R5-2009-0078. Influent monitoring requirements for pH (1/week) has been established to characterize the influent.

B. Effluent Monitoring

1. Pursuant to the requirements of 40 CFR 122.44(i)(2) effluent monitoring is required for all constituents with effluent limitations. Effluent monitoring is necessary to assess compliance with effluent limitations, assess the effectiveness of the treatment process, and to assess the impacts of the discharge on the receiving stream and groundwater.
2. Effluent monitoring frequencies and sample types for flow (continuous), total residual chlorine (continuous), temperature (daily), pH (daily), BOD₅ (1/week), TSS (1/week), total coliform organisms (1/week), electrical conductivity (1/week), total recoverable copper (1/quarter), hardness (1/quarter), and ammonia (1/month) have been retained from Order No. R5-2009-0078 to determine compliance with effluent limitations for these parameters. To better characterize the effluent, the monitoring frequencies for nitrate (as nitrogen) and nitrite (as nitrogen) have been changed from the frequency of 1/quarter, stipulated in Order No. R5-2009-0078, to a 1/month frequency.
3. Monitoring data collected over the previous permit term for total trihalomethanes and iron (total recoverable and dissolved) did not demonstrate reasonable potential to exceed water quality objectives/criteria. Thus, specific monitoring requirements for these parameters have not been retained from Order No. R5-2009-0078.
4. In accordance with Section 1.3 of the SIP, periodic monitoring for priority pollutants for which criteria or objectives apply and for which no effluent limitations have been established is required. This Order requires monitoring for priority pollutants once during the third year of the permit term in order to collect data for the RPA in the next permit renewal. See section IX.D of the MRP for more detailed requirements related to performing priority pollutant monitoring.
5. California Water Code section 13176, subdivision (a), states: "*The analysis of any material required by [Water Code sections 13000-16104] shall be performed by a*

laboratory that has accreditation or certification pursuant to Article 3 (commencing with Section 100825) of Chapter 4 of Part 1 of Division 101 of the Health and Safety Code.” The DDW certifies laboratories through its Environmental Laboratory Accreditation Program (ELAP).

Section 13176 cannot be interpreted in a manner that would violate federal holding time requirements that apply to NPDES permits pursuant to the Clean Water Act. (Wat. Code §§ 13370, subd. (c), 13372, 13377.) Section 13176 is inapplicable to NPDES permits to the extent it is inconsistent with Clean Water Act requirements. (Wat. Code § 13372, subd. (a).) The holding time requirements are 15 minutes for chlorine residual, dissolved oxygen, and pH, and immediate analysis is required for temperature (40 C.F.R. § 136.3(e), Table II). Due to the location of the Facility, it is both legally and factually impossible for the Discharger to comply with section 13176 for constituents with short holding times.

C. Whole Effluent Toxicity Testing Requirements

1. **Acute Toxicity.** Quarterly 96-hour bioassay testing is required to demonstrate compliance with the effluent limitation for acute toxicity.
2. **Chronic Toxicity.** Chronic whole effluent toxicity testing is required once during the permit term in order to demonstrate compliance with the Basin Plan’s narrative toxicity objective.

D. Receiving Water Monitoring

1. Surface Water

- a. Receiving water monitoring is necessary to assess compliance with receiving water limitations and to assess the impacts of the discharge on the receiving water.

2. Groundwater

- a. Water Code section 13267 states, in part, “(a) A Regional Water Board, in establishing...waste discharge requirements... may investigate the quality of any waters of the state within its region” and “(b) (1) In conducting an investigation..., the Regional Water Board may require that any person who... discharges... waste...that could affect the quality of waters within its region shall furnish, under penalty of perjury, technical or monitoring program reports which the Regional Water Board requires. The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports.” The burden, including costs, of these reports shall bear a reasonable relationship to the need for the report and the benefits to be obtained from the reports. In requiring those reports, a Regional Water Board shall provide the person with a written explanation with regard to the need for the reports, and shall identify the evidence that supports requiring that person to provide the reports. The Monitoring and Reporting Program is issued pursuant to Water Code section 13267. The groundwater monitoring and reporting program required by this Order and the Monitoring and Reporting Program are necessary to assure compliance with these waste discharge requirements. The Discharger is responsible for the discharges of waste at the facility subject to this Order.
- b. Monitoring of the groundwater must be conducted to determine if the discharge has caused an increase in constituent concentrations, when compared to background. The monitoring must, at a minimum, require a complete assessment of groundwater impacts including the vertical and lateral extent of degradation, an assessment of all wastewater-related constituents which may have migrated to groundwater, an

analysis of whether additional or different methods of treatment or control of the discharge are necessary to provide best practicable treatment or control to comply with Resolution No. 68-16. Economic analysis is only one of many factors considered in determining best practicable treatment or control. If monitoring indicates that the discharge has incrementally increased constituent concentrations in groundwater above background, this permit may be reopened and modified. Until groundwater monitoring is sufficient, this Order contains Groundwater Limitations that allow groundwater quality to be degraded for certain constituents when compared to background groundwater quality, but not to exceed water quality objectives. If groundwater quality has been degraded by the discharge, the incremental change in pollutant concentration (when compared with background) may not be increased. If groundwater quality has been or may be degraded by the discharge, this Order may be reopened and specific numeric limitations established consistent with Resolution No. 68-16 and the Basin Plan.

- c. This Order requires the Discharger to continue groundwater monitoring and includes a regular schedule of groundwater monitoring in the attached Monitoring and Reporting Program. The groundwater monitoring reports are necessary to evaluate impacts to waters of the State to assure protection of beneficial uses and compliance with Central Valley Water Board plans and policies, including Resolution No. 68-16. Evidence in the record includes effluent monitoring data that indicates the presence of constituents that may degrade groundwater and surface water.

E. Other Monitoring Requirements

1. Biosolids Monitoring

Biosolids monitoring is required to ensure compliance with the biosolids disposal requirements contained in the Special Provision contained in section VI.C.6.a. of this Order. Biosolids disposal requirements are imposed pursuant to 40 CFR Part 503 to protect public health and prevent groundwater degradation.

2. Water Supply Monitoring

Water supply monitoring is required to evaluate the source of constituents in the wastewater.

3. Pond Monitoring

Treatment pond monitoring is required to ensure proper operation of the ponds. Monthly monitoring for freeboard, dissolved oxygen, and odors has been retained from Order No. R5-2009-0078. Monthly monitoring for pH and electrical conductivity has been added to maintain consistency with other permitted entities and to collect information on pond water quality.

VIII. PUBLIC PARTICIPATION

The Central Valley Water Board has considered the issuance of WDR's that will serve as an NPDES permit for Chester Wastewater Treatment Plant. As a step in the WDR adoption process, the Central Valley Water Board staff has developed tentative WDR's and has encouraged public participation in the WDR adoption process.

A. Notification of Interested Parties

The Central Valley Water Board notified the Discharger and interested agencies and persons of its intent to prescribe WDR's for the discharge and provided an opportunity to submit written comments and recommendations. Notification was provided through physical posting at the Facility, publication in the local newspaper, and by internet posting on the Central

Valley Water Board's website.

The public had access to the agenda and any changes in dates and locations through the Central Valley Water Board's website at:

http://www.waterboards.ca.gov/centralvalley/board_info/meetings/

B. Written Comments

Interested persons were invited to submit written comments concerning tentative WDR's as provided through the notification process. Comments were due either in person or by mail to the Executive Office at the Central Valley Water Board at the address on the cover page of this Order.

To be fully responded to by staff and considered by the Central Valley Water Board, the written comments were due at the Central Valley Water Board office by 5:00 p.m. on 11 January 2016.

C. Public Hearing

The Central Valley Water Board held a public hearing on the tentative WDR's during its regular Board meeting on the following date and time and at the following location:

Date: 18/19 February 2016
Time: 8:30 a.m.
Location: Regional Water Quality Control Board, Central Valley Region
11020 Sun Center Dr., Suite #200
Rancho Cordova, CA 95670

Interested persons were invited to attend. At the public hearing, the Central Valley Water Board heard testimony pertinent to the discharge, WDR's, and permit. For accuracy of the record, important testimony was requested in writing.

D. Reconsideration of Waste Discharge Requirements

Any aggrieved person may petition the State Water Board to review the decision of the Central Valley Water Board regarding the final WDR's. The petition must be received by the State Water Board at the following address within 30 calendar days of the Central Valley Water Board's action:

State Water Resources Control Board
Office of Chief Counsel
P.O. Box 100, 1001 I Street
Sacramento, CA 95812-0100

For instructions on how to file a petition for review, see http://www.waterboards.ca.gov/public_notices/petitions/water_quality/wqpetition_instr.shtml

E. Information and Copying

The Report of Waste Discharge, other supporting documents, and comments received are on file and may be inspected at the address above at any time between 8:30 a.m. and 4:45 p.m., Monday through Friday. Copying of documents may be arranged through the Central Valley Water Board by calling (530) 224-4845.

F. Register of Interested Persons

Any person interested in being placed on the mailing list for information regarding the WDR's and NPDES permit should contact the Central Valley Water Board, reference this facility, and provide a name, address, and phone number.

G. Additional Information

Requests for additional information or questions regarding this order should be directed to Zack Chandler at (530) 224-4206.

ATTACHMENT G – SUMMARY OF REASONABLE POTENTIAL ANALYSIS

Constituent	Units	MEC	B	C	CMC	CCC	Water & Org	Org. Only	Basin Plan	MCL	Reasonable Potential
Ammonia, Total (as Nitrogen)	mg/L	9.9	<0.2	1.5	2.1 ¹	1.5 ² 3.8 ³	NA	NA	NA	NA	Yes (MEC>C)
Copper (Total Recoverable)	ug/L	10	0.33	4.8 ⁴	6.7 ⁴ 7.4 ⁵	4.8 ⁴ 5.2 ⁵	1,300	NA	NA	1,000	Yes (MEC>C)

General Note: All inorganic concentrations are given as a total recoverable.

MEC = Maximum Effluent Concentration

B = Maximum Receiving Water Concentration or lowest detection level, if non-detect

C = Criterion used for Reasonable Potential Analysis

CMC = Criterion Maximum Concentration (CTR or NTR)

CCC = Criterion Continuous Concentration (CTR or NTR)

Water & Org = Human Health Criterion for Consumption of Water & Organisms (CTR or NTR)

Org. Only = Human Health Criterion for Consumption of Organisms Only (CTR or NTR)

Basin Plan = Numeric Site-specific Basin Plan Water Quality Objective

MCL = Drinking Water Standards Maximum Contaminant Level

NA = Not Available

ND = Non-detect

Footnotes:

- 1) U.S. EPA National Recommended Ambient Water Quality Criteria, Freshwater Aquatic Life Protection, 1-hour average.
- 2) U.S. EPA National Recommended Ambient Water Quality Criteria, Freshwater Aquatic Life Protection, 30-day average.
- 3) U.S. EPA National Recommended Ambient Water Quality Criteria, Freshwater Aquatic Life Protection, 4-day average.
- 4) Criterion to be compared to the maximum upstream receiving water concentration, based on an average downgradient receiving water hardness of 46 mg/L (as CaCO₃).
- 5) Criterion to be compared to the MEC, based on a median effluent hardness of 50.5 mg/L (as CaCO₃).

ATTACHMENT H – CALCULATION OF WQBEL'S

Aquatic Life WQBEL's Calculations															
Parameter	Units	Criteria		Dilution Factors		Aquatic Life Calculations						Final Effluent Limitations			
		CMC	CCC	CMC	CCC	ECA Multiplier _{acute}	LTA _{acute}	ECA Multiplier _{chronic}	LTA _{chronic}	AMEL Multiplier ₉₅	AWEL Multiplier	MDEL Multiplier ₉₉	AMEL ¹	AWEL ²	MDEL ³
Ammonia, Total (as Nitrogen)	mg/L	2.1	1.4	6.34	6.34	0.36	5.6	N/A	11	1.5	N/A	2.8	8.4	N/A	16
Copper, Total Recoverable	µg/L	6.7 ⁴	4.8 ⁴	7	7	0.69	36	0.83	30	1.1	N/A	1.4	34	N/A	43

¹ Average Monthly Effluent Limitations are calculated according to Section 1.4 of the SIP using a 95th percentile occurrence probability.

² Average Weekly Effluent Limitations are calculated according to Section 1.4 of the SIP using a 98th percentile occurrence probability.

³ Maximum Daily Effluent Limitations are calculated according to Section 1.4 of the SIP using a 99th percentile occurrence probability.

⁴ Water quality criteria determined using an average downgradient receiving water hardness of 46 mg/L (as CaCO₃).