

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
COLORADO RIVER BASIN REGION

ORDER NO. 79-113

WASTE DISCHARGE REQUIREMENTS  
FOR  
COACHELLA VALLEY COUNTY WATER DISTRICT  
IVEY RANCH-1000 PALMS MOBILE HOME ESTATES, PHASE I  
Southeast of 1000 Palms, Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region finds that:

1. Coachella Valley County Water District (hereinafter also referred to as the discharger), P.O. Box 1058, Coachella, CA 92236, submitted a Report of Waste Discharge, dated September 25, 1979.
2. The discharger proposes to discharge a maximum of 94,000 gallons per day of domestic sewage from the first phase of a mobile home park. This phase would have 369 spaces discharging into a centralized collection system. The wastewater would be disposed of by means of a septic tank/seepage pit disposal field to be located in the SW 1/4 of the SE 1/4 of Section 28, T4S, R6E, SBB&M.
3. The discharger is reserving an area of sufficient size for possible future 100 percent replacement of the seepage pits.
4. There are no domestic wells within 200 feet of the proposed discharge facilities described in Findings No. 2 and 3 (above).
5. The Water Quality Control Plan for the West Colorado River Basin was adopted by the Board on April 10, 1975. The Basin Plan contains water quality objectives for the Coachella Hydrologic Subunit.
6. The beneficial uses of the groundwater of the Coachella Hydrologic Subunit are:
  - a. Municipal supply
  - b. Industrial supply
  - c. Agricultural supply

*Cancelled  
5/19/82  
ly8227*

7. The Board has notified the discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the proposed discharge.
8. The Board in a public meeting heard and considered all comments pertaining to the proposed discharge.
9. The Riverside County Planning Department has prepared Negative Declaration No. EA 9403 (filing date November 20, 1978) for this proposed park. The Regional Board has reviewed this Negative Declaration. The below waste discharge requirements are designed to assure against any significant adverse effects on water quality.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications


1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage shall be discharged at this location.
3. Wastewater discharged subsurface shall be retained underground with no surfacing.
4. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
5. Septic tank cleanings shall be discharged only by a duly authorized service.

B. Provisions


1. Sufficient land area shall be reserved for possible future 100 percent replacement of the seepage pits, until such time as this park is connected to a municipal sewerage system.
2. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the treatment and discharge of wastes.

3. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
4. Prior to any change of ownership of this mobile home park, the discharger shall:
  - a. Specify as a condition of transfer that the area specified in Provision B.1. (above) remain servient to the development, for the purpose of providing additional subsurface sewage disposal capacity, until such time as this development is connected to a municipal sewerage system.
  - b. Notify the succeeding owner, in writing, of the existence of this Order, and forward a copy of said correspondence to the Regional Board.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on November 28, 1979.

  
\_\_\_\_\_  
Executive Officer


November 28, 1979  
Date

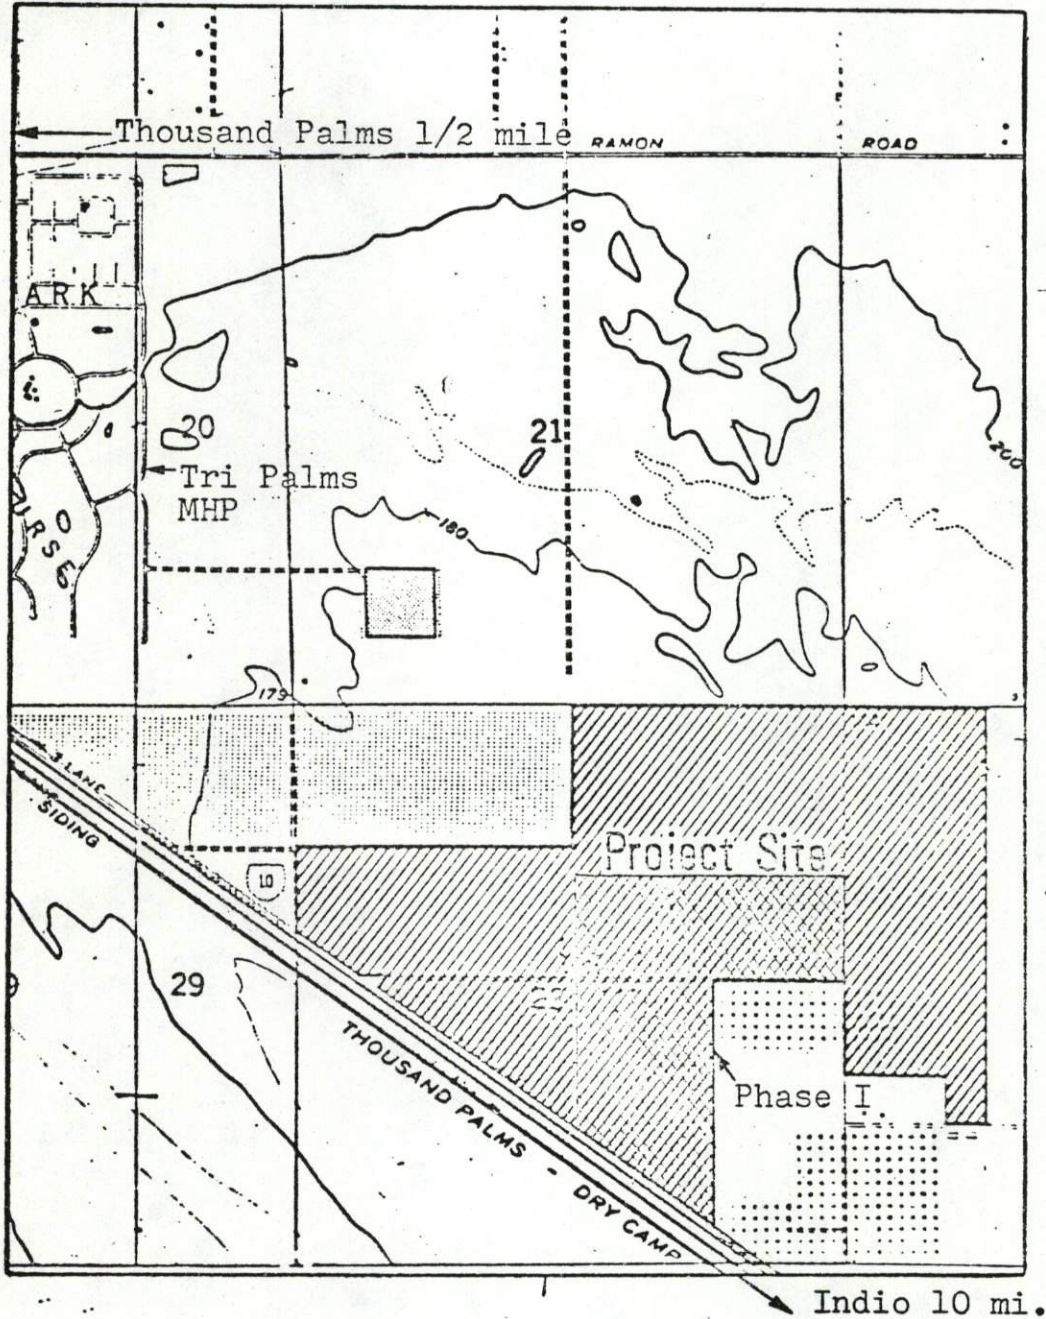

SITE MAP

COACHELLA VALLEY COUNTY WATER DISTRICT  
IVEY RANCH-1000 PALMS MOBILE HOME ESTATES, PHASE I  
Southeast of 1000 Palms, Riverside County

Order No. 79-113

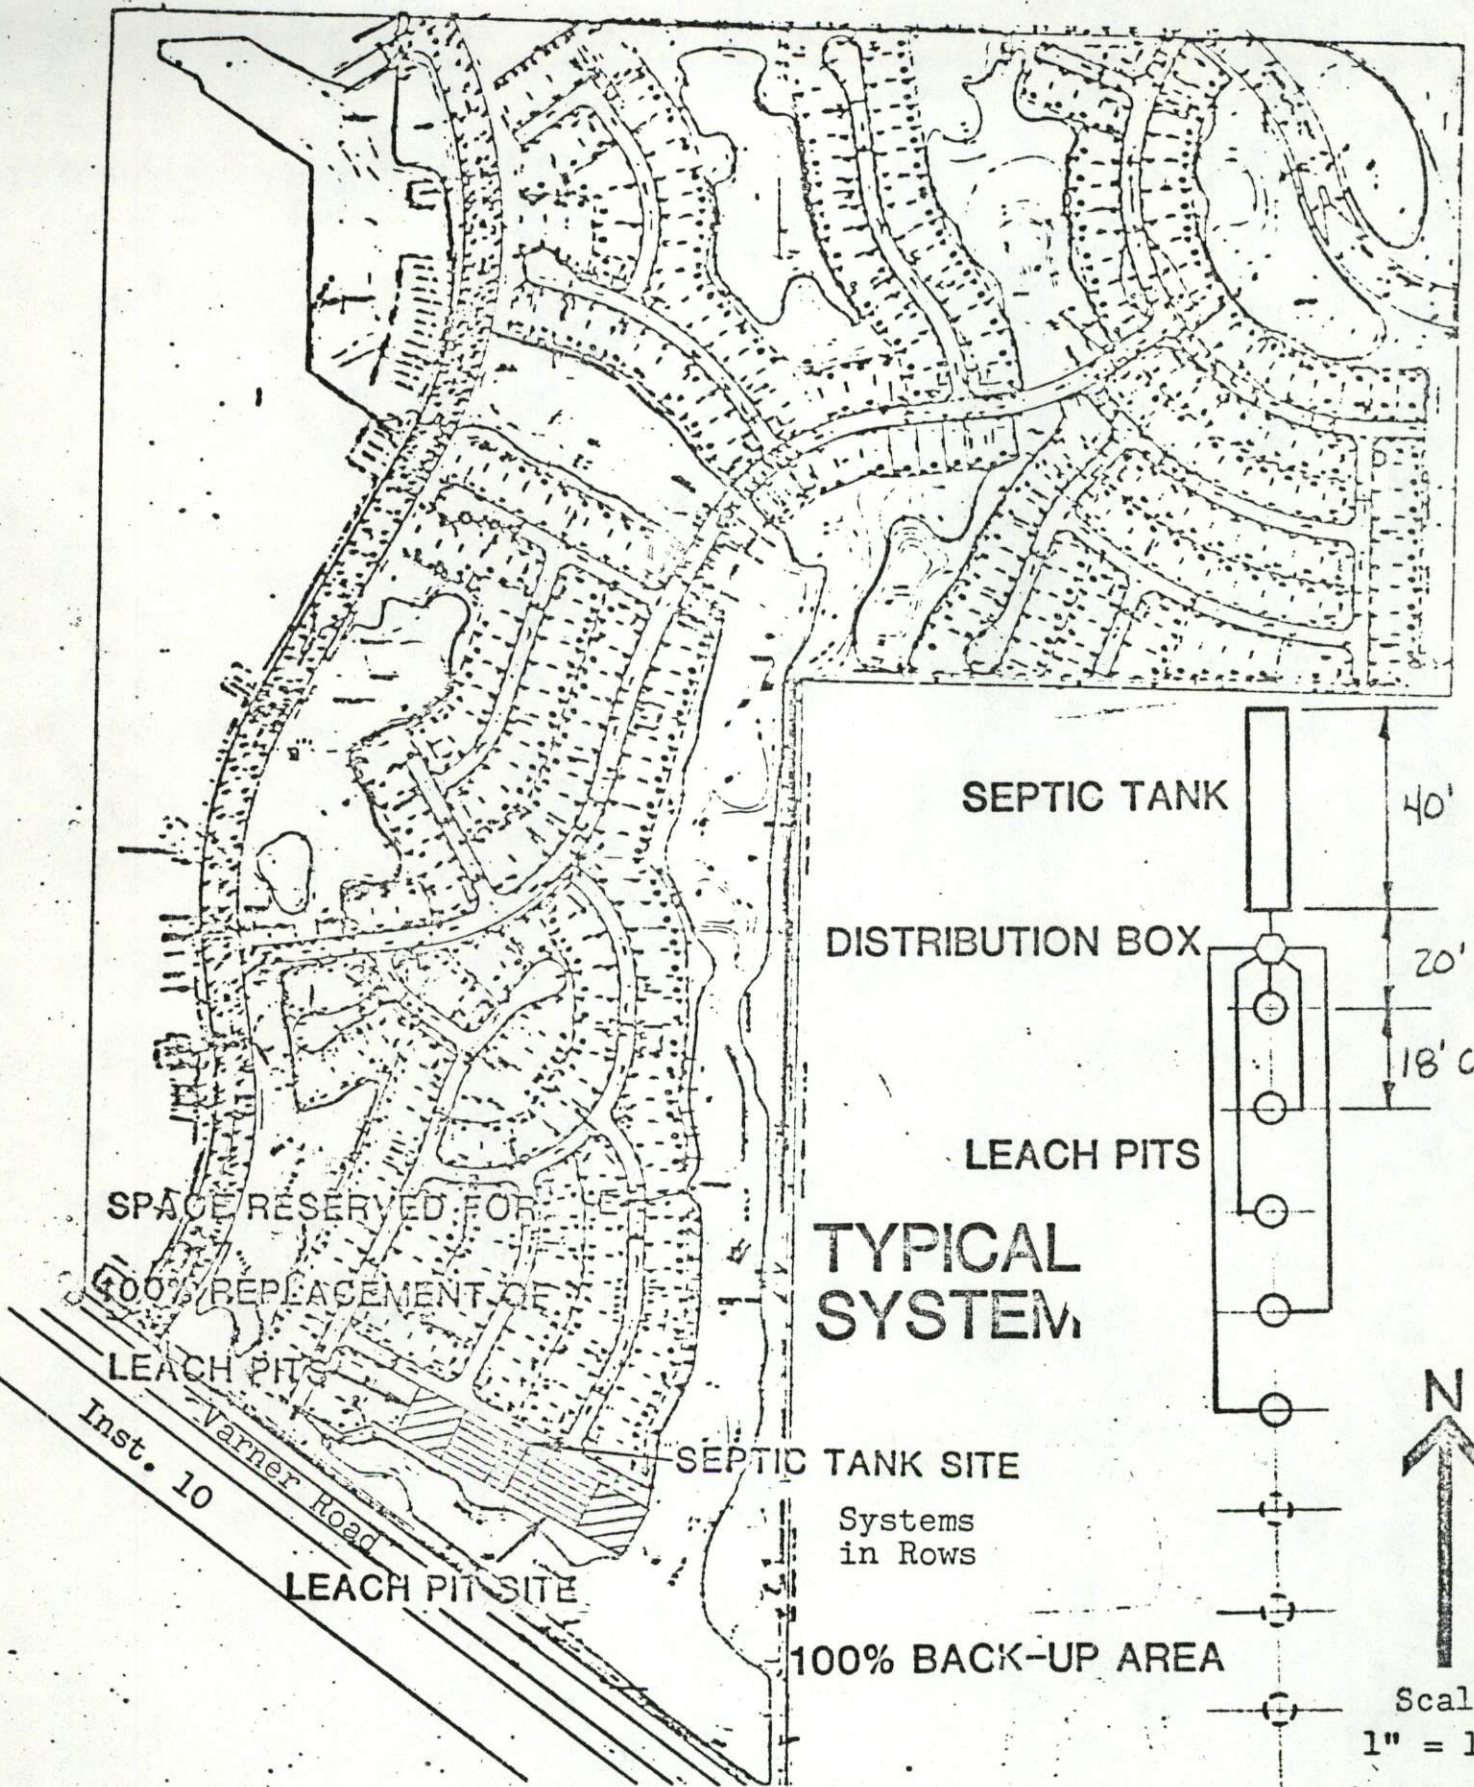

**TYPICAL SYSTEM**

PRELIMINARY SEWAGE DISPOSAL FACILITIES SKETCH  
 COACHELLA VALLEY COUNTY WATER DISTRICT  
 IVEY RANCH-1000 PALMS MOBILE HOME ESTATES, PHASE I  
 Southeast of 1000 Palms, Riverside County