

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

ORDER NO. 85-83

**WASTE DISCHARGE REQUIREMENTS
FOR
AGUA CALIENTE COUNTY PARK
Southeast of Julian - San Diego County**

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. The County of San Diego Parks and Recreation Department (hereinafter also referred to as the discharger), 5201 Ruffin Road, Suite P, San Diego, California, 92123, verified on June 12, 1985, via the park ranger, that the information contained in Findings No. 2, 3, and 4, is accurate.
2. The discharger is discharging a maximum of 18,000 gallons-per-day of domestic sewage from a campground having (4) four mobile homes, 140 camp sites, including 52 with sewage hook-ups, and (4) four restrooms. The wastewater is discharged through septic tanks into leach fields located in the SW $\frac{1}{4}$ of the SE $\frac{1}{4}$ of Section 18, T14S, R7E, SBB&M.
3. The discharger has reserved an area of sufficient size for 100 percent replacement of the leach fields.
4. The discharger states that wastewater from swimming pools and hot pools is periodically discharged into an irrigation ditch that provides water for landscape plantings.
5. The discharge from this campground has been subject to waste discharge requirements adopted in Board Order No. 78-80.
6. There are no domestic wells within 200 feet of the discharge facilities described in Findings No. 2 and 3 (above). Water is obtained from springs uphill of the development.
7. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984. The Basin Plan contains water quality objectives for the Anza-Borrego Hydrologic Subunit.
8. The beneficial uses of the ground waters of the Anza-Borrego Hydrologic Subunit are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply

6-25-97
Rescinded Order
No. 97-075

6-25-97 Covered by
~~Appointed by~~
general 97-500
Order.

9. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
10. The Board in a public meeting heard and considered all comments pertaining to the discharge.
11. This treatment facility constitutes an ongoing project in accordance with the provisions of the California Environmental Quality Act (Public Resources Code Section 21000 et. seq.), and Title 14, California Administrative Code, Article 6.5, Section 15070, because the governmental approvals on or after April 15, 1973, do not involve a greater degree of responsibility or control over such activity than the governmental approvals received prior to that date.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications

1. The treatment or discharge of wastewater shall not cause pollution or a nuisance as defined in Section 13050 (l) and 13050 (m) of the California Water Code.
2. No wastewater other than domestic sewage and swimming and hot pool wastewater shall be discharged at this location.
3. Wastewater discharged subsurface shall be retained underground with no surfacing.
4. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
5. Septic tank cleanings shall be discharged only by a duly authorized service.
6. Swimming pool and hot pool wastewater shall not be discharged into a sewage disposal system.

B. Provisions

1. The area reserved for 100 percent replacement of the leach fields, shall at all times be retained servient to this campground, for the purpose of providing additional subsurface sewage disposal capacity, until such time as this park is connected to a municipal sewerage system.
2. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the discharge of wastes.
3. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report thereon in writing to the Regional Board.

4. In the event of any change in the operation, or in control or ownership of land and/or waste disposal facilities owned or controlled by the discharger, the discharger shall:
 - a. Notify the Board of such change; and
 - b. Notify the succeeding owner of this Order, a copy of which shall be filed with this Board.
5. This Order supersedes Board Order No. 78-80.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on August 7, 1985.



Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

**MONITORING AND REPORTING PROGRAM NO. 85-83
FOR
AGUA CALIENTE COUNTY PARK
Southeast of Julian - San Diego County**

Location: Portion of the SW $\frac{1}{4}$, SE $\frac{1}{4}$ of Section 18, T14S, R7E, SBB&M

MONITORING

This discharger shall submit an annual status report on the following:

1. Number of restrooms and RV spaces presently connected to the sewerage system.
2. List any proposed changes in the sewage disposal facilities during the upcoming year.

REPORTING

1. Annual reports are to be submitted by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260


2. Immediate reporting of any surfacing of wastewater or other failures of the system by telephone and follow-up by letter.

ORDERED BY:

Arthur Sevajian
Executive Officer

July 20, 1987
Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

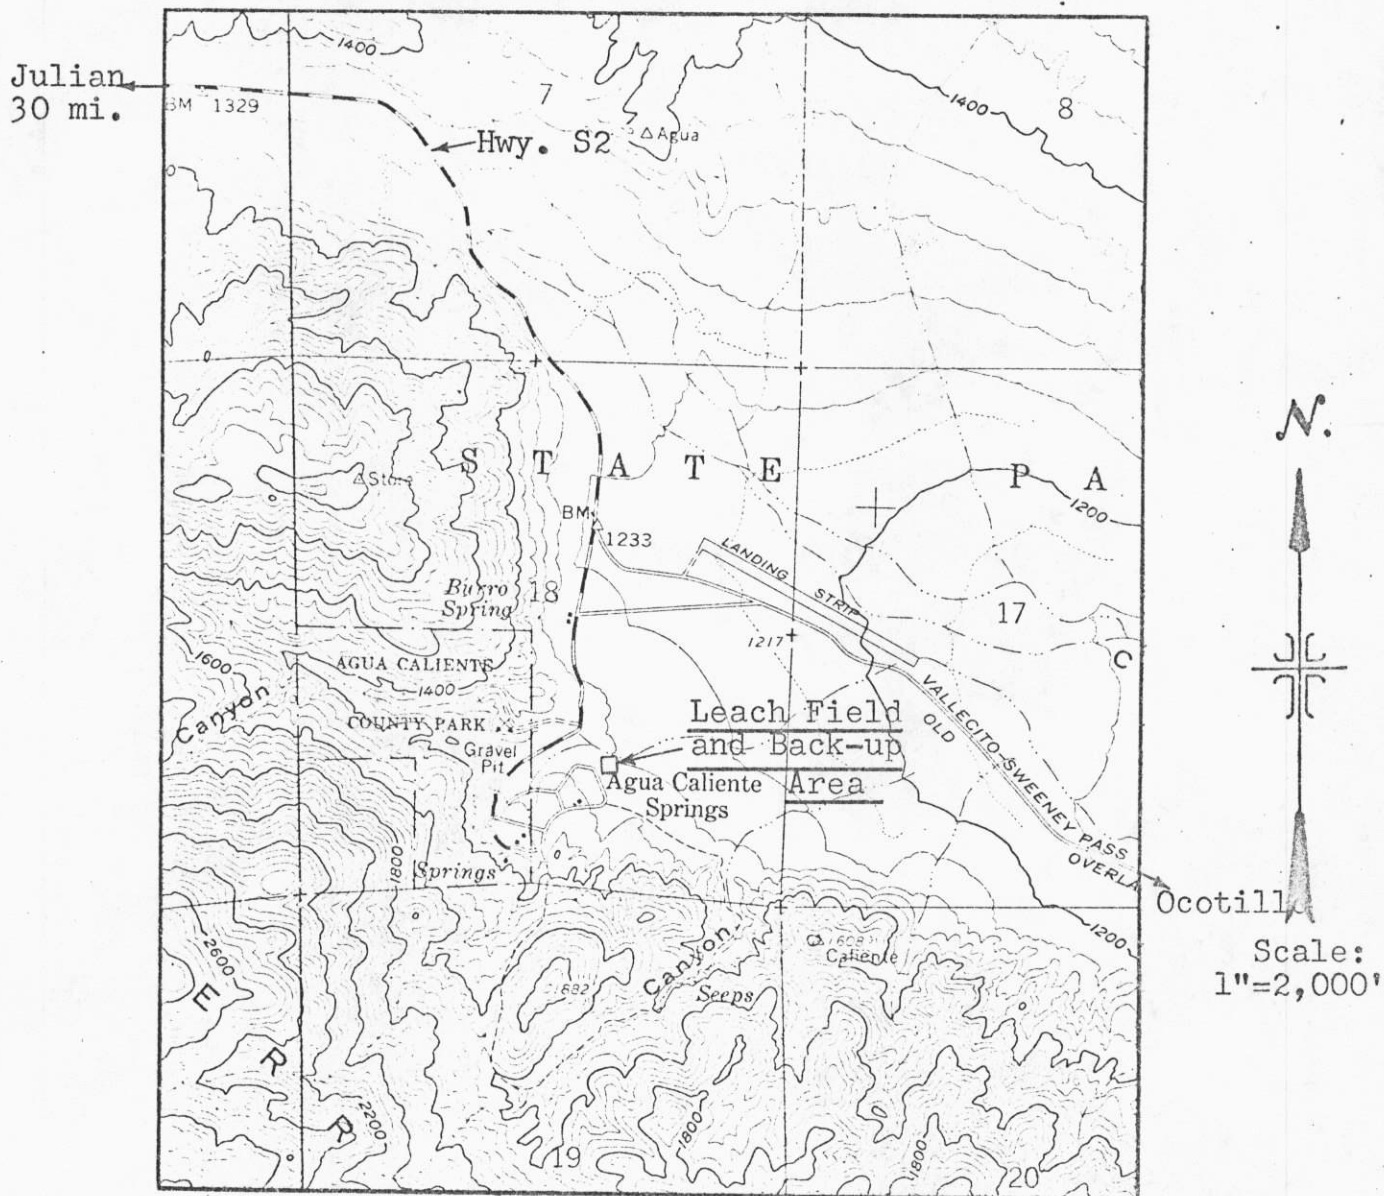

SITE MAP

AGUA CALIENTE COUNTY PARK

Southeast of Julian - San Diego County


Location of Discharge: SW $\frac{1}{4}$, SE $\frac{1}{4}$ of Section 18,

T14S, R7E, SBB&M

USGS Agua Caliente Springs 7.5 min. Topographic Map

Order No. 85-83

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

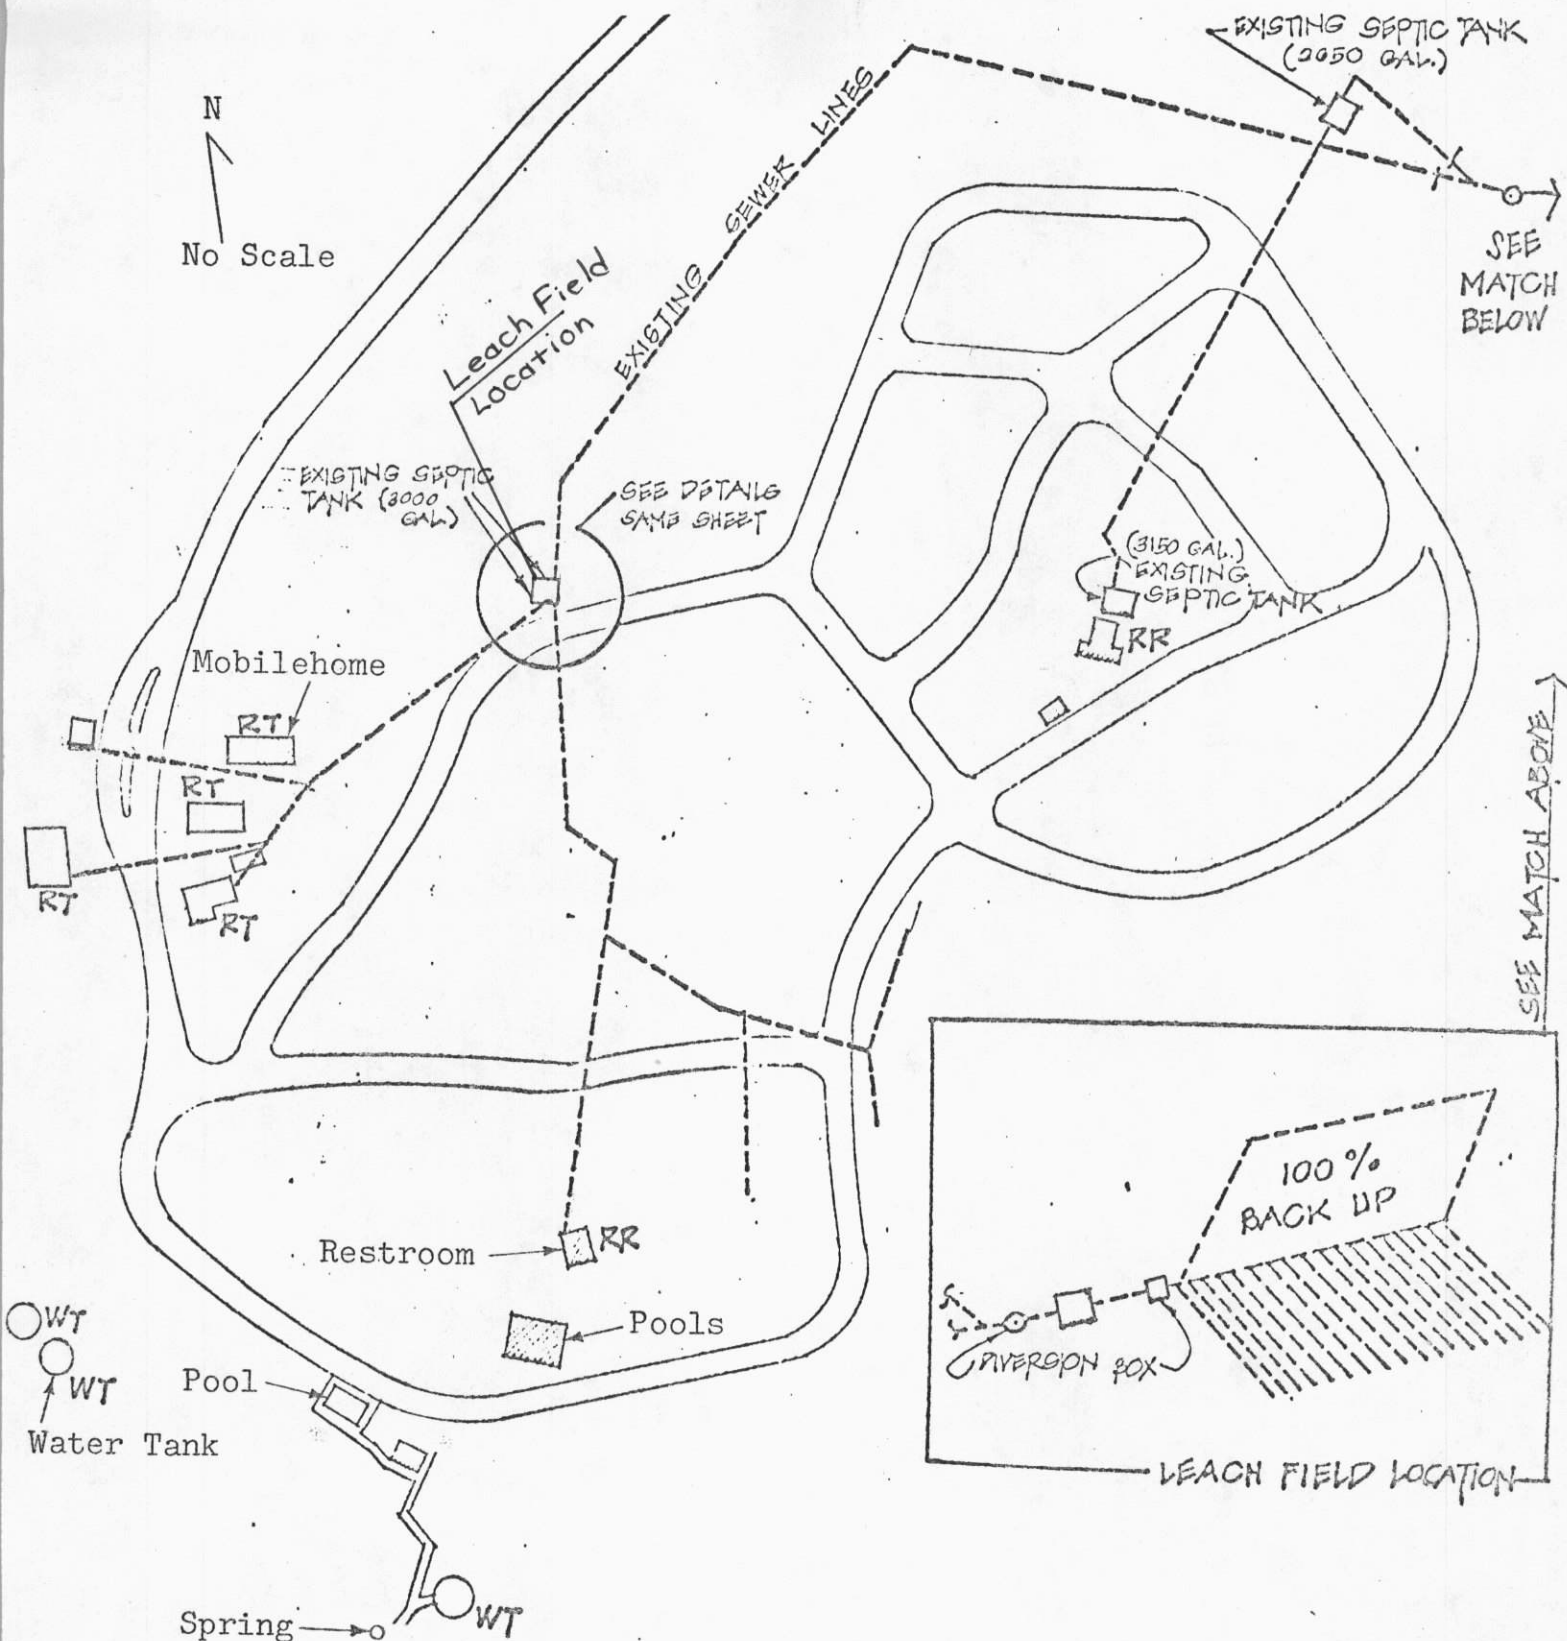

AGUA CALIENTE COUNTY PARK
Southeast of Julian - San Diego County

Order No. 85-83