

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 90-009

WASTE DISCHARGE REQUIREMENTS
FOR
RED ROOSTER CAMP
North of Blythe - Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Red Rooster Camp, Stanley K. Burson, Owner (hereinafter also referred to as the discharger), HCR 20, Box 2725, Blythe, California 92225, supplied the updated information on the discharge of waste on November 2, 1989.
2. The discharger is discharging a maximum of 4,000 gallons-per-day of domestic sewage from a mobile home park consisting of 32 mobile home spaces, 11 campsites and four restrooms. The wastewater from this camp is discharged into one septic tank/leach line system, which occasionally becomes saturated and is then pumped to an oxidation basin for disposal by infiltration and evaporation. The site is located in the S $\frac{1}{2}$ of Section 25, T3S, R23E, SBB&M.
3. This discharge has been subject to waste discharge requirements adopted in Board Order No. 84-112.
4. The discharge site is leased by Stanley K. Burson from the United States Department of the Interior, Bureau of Indian Affairs, Colorado River Agency, Route 1, Box 9-1C, Parker, Arizona 85344, trustee for the Colorado River Indian Tribes.
5. There are no domestic wells within 200 feet of the discharge facilities described in Finding No. 2, above.
6. The discharger states that the wastewater disposal facilities are more than 200 feet from the high water line of the Colorado River.
7. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984.
8. The discharge is located in the Colorado Hydrologic Unit. The beneficial uses of surface waters and ground waters of the Colorado Hydrologic Unit are:
 - a. Municipal Supply (MUN)
 - b. Industrial Supply (IND)
 - c. Agricultural Supply (AGR)
9. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
10. The Board in a public meeting heard and considered all comments pertaining to the existing discharge.

*Revised
by Bd. Ord. # 95-012
1/25/95*

11. In accordance with Section 15301, Chapter 3, Title 14, of the California Code of Regulations, the issuance of these waste discharge requirements, which govern the operation of an existing facility involving negligible or no expansion of use beyond that previously existing, is exempt from the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000 et seq.).


IT IS HEREBY ORDERED, the discharger shall comply with the following specifications:

1. Neither the treatment nor the discharge of wastewater shall create pollution or nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic wastewater shall be discharged into the sewage disposal system described in Finding No. 2, above.
3. A minimum freeboard of two feet shall be maintained in the oxidation basin.
4. Treated or untreated sludge or similar solid waste material shall be disposed only at locations approved by the Regional Board.
5. Adequate measures shall be taken to assure that unauthorized persons are effectively excluded from contact with the wastewater.
6. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
7. There shall be no surface flow of wastewater away from the discharge facilities.
8. There shall be no discharge, bypass, or flow of treated or untreated wastewater to any drainage channel which drains to surface waters.
9. Disposal by ponding shall be conducted in such a manner that there shall be no stranded or exposed sewage solids.
10. A surface aerobic environment shall be maintained in the oxidation basin.
11. The infiltration facility (basin) shall be maintained and operated so as to maximize infiltration and minimize the increase in salinity of the infiltrating wastewater by evaporation.
12. Standby facilities shall be provided in the event of pump and/or commercial power failure.
13. Wastewater discharged subsurface shall be retained underground with no surfacing.
14. Septic tank cleanings shall be discharged only by a duly authorized service.
15. There shall be no discharge of sewage within 200 feet of the regulated high water line of the Colorado River.
16. Sufficient land area shall be reserved for possible future 100 percent replacement of the leach lines, until such time as this facility is connected to a municipal sewerage system.
17. The discharger shall comply with the attached "Monitoring and Reporting Program No. 90-009", and future revisions thereto, as specified by the Executive Officer.

18. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.
19. In the event of any change in operation, or in control or ownership of land or waste disposal facilities owned or controlled by the discharger, the discharger shall:
 - a. Notify this Board of such change; and
 - b. Transmit a copy of this Order to the succeeding owner or operator, and file a copy of the transmittal letter with this Board.

IT IS FURTHER ORDERED that Board Order No. 84-112 be superseded by this Order.

I, Philip A. Gruenberg, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on January 17, 1990.

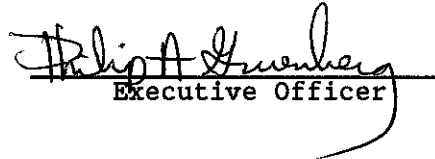
Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 90-009
FOR
RED ROOSTER CAMP
North of Blythe - Riverside County

Location of Discharge: S $\frac{1}{2}$ of Section 25, T3S, R23E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Estimate of maximum daily flow (gpd) of sewage discharged to basin.
2. Number of mobile home spaces, campsites and restrooms presently connected to the sewerage system.
3. List any proposed changes in the sewage disposal facilities during the upcoming year.

REPORTING

Annual reports shall be submitted to the Regional Board by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

Immediately report to this office by telephone and follow-up by letter any failures of the sewage system.


ORDERED BY:


Executive Officer

January 17, 1990

Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

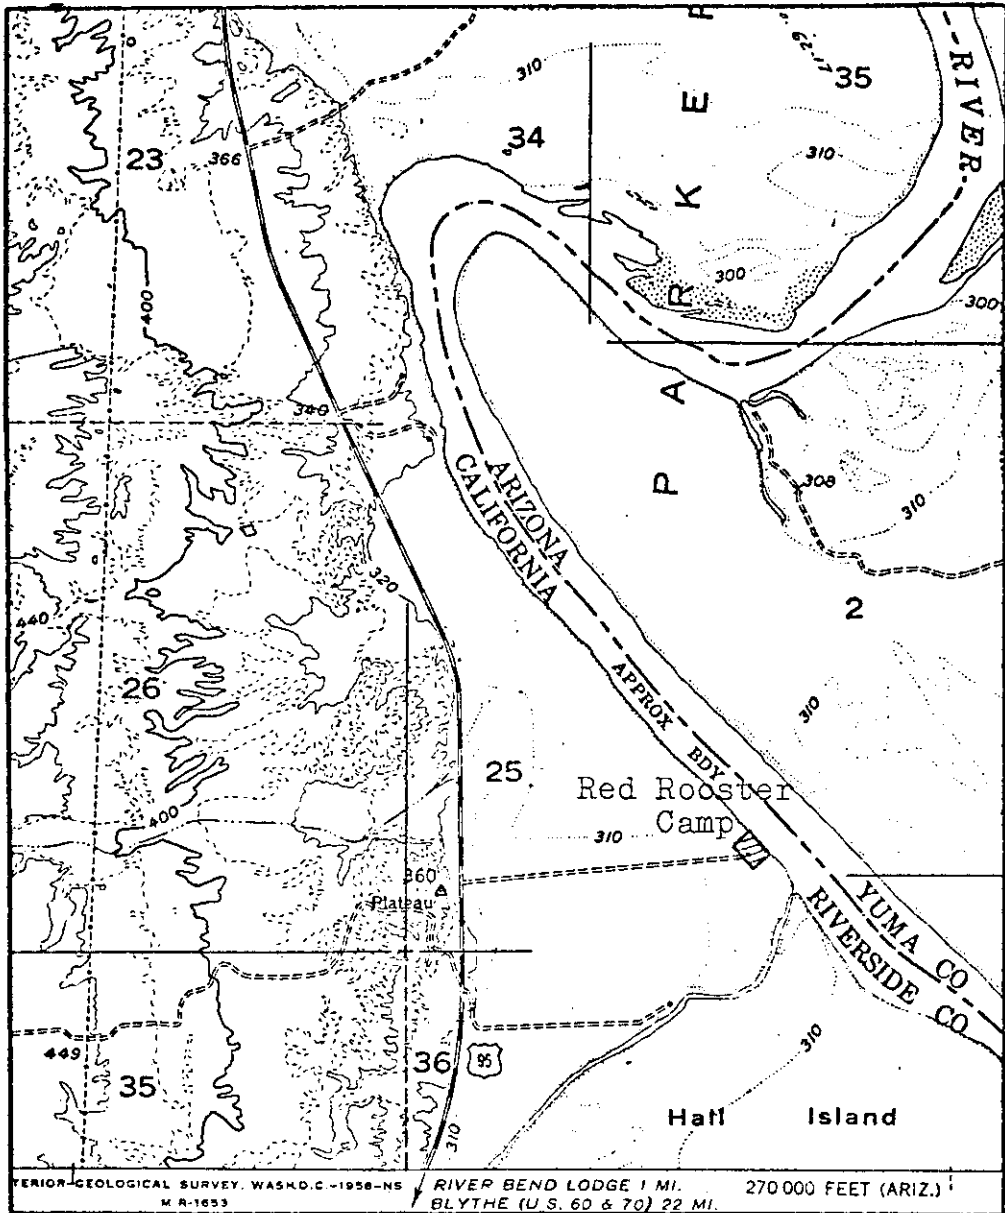

N.

 Scale:
 1" = 2000'

SITE MAP

RED ROOSTER CAMP
 North of Blythe - Riverside County
 S½ of Section 25, T3S, R23E, SBB&M
 USGS Big Maria Mountains NE 7.5 min. Topographic Map

Order No. 90-009