

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

ORDER NO. R7-2009-0026

**WASTE DISCHARGE REQUIREMENTS
FOR**

**MT. SAN JACINTO WINTER PARK AUTHORITY, OWNER/OPERATOR
PALM SPRINGS AERIAL TRAMWAY – VALLEY STATION WASTEWATER TREATMENT AND
DISPOSAL SYSTEM**

City of Palm Springs, and San Jacinto State Park, Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region (Regional Water Board) finds that:

1. The Mt. San Jacinto Winter Park Authority, also known as the Palm Springs Aerial Tramway (hereinafter referred to as Discharger), One Tramway Road, Palm Springs, CA 92262, submitted an updated Report of Waste Discharge (ROWD), dated June 26, 2008, to discharge treated domestic wastes via leach lines servicing its Valley Station. An Engineering Report, dated January 15, 2008, was also submitted in support of the ROWD.
2. The Discharger operates an existing septic tank-based wastewater treatment and disposal systems located at its facility in Riverside County. The Aerial Tramway received over 400,000 visitors between April 2006 and March 2007. The Valley Station is located in Section 7, T4S, R4E, San Bernardino Baseline and Meridian (SBB&M), as shown on Attachment A, attached hereto and made part of this Order by reference.

Wastewater Systems and Discharges

3. The Discharger proposes to upgrade the Valley Station WWTF to provide secondary treatment with denitrification. The Valley Station WWTF will include capacity for a remodeled 40 seat restaurant, and is expected to treat up to 1,750 gallons per day (gpd) of wastewater.
4. The Valley Station wastewater treatment facility (WWTF) will consist of a 4,000 gallon grease interceptor, two 7,500 gallon septic tanks, an AdvanTex secondary treatment system with a 1,400 gallon recirculation tank and two AX100 pods (manufacturers term) for secondary treatment, and a 1,500 gallon denitrification/dosing tank with carbon supplementation. Effluent from the WWTF will be sent to the existing leach field via pressure distribution. The leach field serving this WWTF is located under the asphalt parking lot, and is approximately 50 feet west of Chino creek. Monitoring wells were recently installed near the leach field to depths of 34 and 41 feet below ground surface (bgs). Boring logs from these wells indicate the area's soils consist of large granite boulders with sand lenses and gravel. The facility will include metering instrumentation, and computerized controls with telemetry and an auto-dialer. Solids and sludge removed from the treatment train by a licensed septage hauler will be disposed of in accordance with state regulations.

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

5. The Discharger proposes to have operating personnel trained and certified in the operations of the WWTF by the manufacturer of the secondary treatment devices, Orenco Systems Inc.
6. The Valley Station WWTF upgrade is expected to be completed by May 2009.

Hydrogeologic Conditions

7. Valley Station is located at an elevation of 2,643 feet above sea level and straddles Chino Creek.
8. Potable water to all of the Discharger’s facilities is supplied by Desert Water Agency (DWA), which operates a catch basin and chlorine disinfection process upstream of the Valley Station. The water has a total dissolved solids (TDS) concentration of about 150 mg/L.
9. Water Quality analyses from the facility’s water supply is provided below. The analyses are for a sample collected on 03/22/06 by DWA:

<u>Constituent</u>	<u>Units</u>	<u>Concentration</u>
Aluminum	µg/L ¹	91
Arsenic	µg/L	ND ²
Fluoride	mg/L ³	ND
Iron	µg/L	190
Nickel	µg/L	14
Nitrate + Nitrite (as N)	µg/L	580
Total Dissolved Solids	mg/L	150
Bicarbonate	mg/L	120
Chloride	mg/L	2.2
Sodium	mg/l	10
Sulfate	mg/L	7.4

¹ Micrograms per liter

² Non-detect

³ Milligrams per liter

Basin Plan, Beneficial Uses, and Regulatory Considerations

10. The Water Quality Control Plan for the Colorado River Basin Region of California (Basin Plan), as amended to date, designates the beneficial uses of ground and surface waters in this Region.
11. The proposed discharges are within the Coachella Hydrologic Subunit. The beneficial uses of groundwater in the Coachella Hydrologic Subunit designated in the Basin Plan are:
 - a. Municipal supply (MUN),
 - b. Industrial supply (IND), and
 - c. Agricultural supply (AGR)

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

12. The wastewater disposal system for the Valley Station is situated in the Chino Canyon Creek watershed. The water in Chino creek has the following designated beneficial uses:
- Municipal and domestic supply (MUN)
 - Ground Water Recharge (GWR)
 - Water Contact Recreation (REC I)
 - Non-contact Water Recreation (REC II)
 - Warm Freshwater Habitat (WARM)
 - Wildlife Habitat (WILD)

13. Waste Discharge Requirements (WDRs) implement narrative and numeric water quality objectives for ground and surface waters established by the Basin Plan. The numeric objectives for groundwater designated for municipal and domestic supply are the maximum contaminant levels (MCLs), and bacteriological limits specified in Section 64421 et seq. of Title 22, California Code of Regulations (CCR). The narrative objectives are:

“Groundwater...shall not contain taste or odor producing substances in concentrations that adversely affect beneficial uses as a result of human activity...” (Basin Plan, page 3-9)

“Discharges of water softener regeneration brines...to disposal facilities which ultimately discharge in areas where such wastes can percolate to ground water usable for domestic and municipal purposes are prohibited.” (Basin Plan, page 3-9).

14. The discharge authorized in this Board Order and the treatment and storage facilities associated with the discharge of treated municipal wastewater, except for discharges of residual sludge and solid waste, are exempt from the solid waste requirements of Title 27, CCR, Section 20005 et seq. (hereinafter Title 27). This exemption is based on Section 20090(b) of Title 27, which states in relevant part that discharges of sewage or treated effluent are exempt so long as such discharges meet the following preconditions:
- Wastes consist primarily of domestic sewage and treated effluent;
 - Wastes are regulated by WDRs issued or waived;
 - WDRs are consistent with applicable water quality objectives; and
 - Treatment and disposal facilities described herein are associated with a municipal wastewater treatment plant.

Groundwater Degradation

15. State Water Resources Control Board (State Water Board) Resolution No. 68-16 (“Policy with Respect to Maintaining High Quality Waters of the State”) (hereinafter Resolution No. 68-16) requires a regional board in regulating the discharge of waste to maintain high quality waters of the state (i.e., background water quality) until it is demonstrated that any change in quality will be consistent with maximum benefit to the people of the State, will not unreasonably affect beneficial uses, and will not result in water quality less than as described in plans and policies (e.g., violation of any water quality objective). Moreover, the discharge is required to meet WDRs that result in the best practicable treatment or

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

control (BPTC) of the discharge necessary to assure pollution or nuisance will not occur, and highest water quality consistent with maximum benefit to the people will be maintained.

16. Some degradation of groundwater from the discharge to the leach lines is consistent with Resolution No. 68-16, provided that this degradation:
 - a. Is confined to a reasonable area;
 - b. Is minimized by means of full implementation, regular maintenance, and optimal operation of BPTC measures;
 - c. Is limited to waste constituents typically encountered in domestic wastewater; and
 - d. Does not result in water quality less than that prescribed in the applicable basin plan, and is not in violation of any water quality objective.

17. The discharge of wastewater from the WWTF, as permitted herein, reflects best practicable treatment and control. The controls assure the discharge does not create a condition of pollution or nuisance, and that the highest water quality defined by the physical and chemical nature of the local groundwater will be maintained, which is consistent with the anti-degradation provisions of Resolution No. 68-16. The WWTF incorporates:
 - a. Technology for secondary treated domestic wastewater;
 - b. Sludge handling facilities;
 - c. An operation and maintenance manual;
 - d. Staffing to assure proper operation and maintenance; and
 - e. A standby emergency power generator of sufficient size to operate the treatment plant and ancillary equipment during periods of loss of commercial power.

18. Constituents in domestic WWTF effluent that present the greatest risk to groundwater quality are nitrogen, coliforms (pathogen-indicator organisms), and dissolved salts (TDS). The proposed WWTF provides substantial removal of soluble organic matter, solids, and nitrogen, however, the WWTF, leach lines, and soils beneath the disposal areas are not likely to prevent groundwater degradation by TDS. Therefore, degradation to groundwater, if any, should be limited to the area underlying the disposal areas and to salinity constituents.

19. The typical incremental addition of dissolved salts from domestic water usage is 150 to 380 mg/L. Restaurant wastewater is considered to be “high strength” in comparison to domestic wastewater, typically containing higher concentrations of conventional pollutants. Considering the average TDS of the source water, the TDS increases in the Valley Station WWTF effluent is projected to be higher than domestic wastewater. Studies of actual TDS concentrations in this facility’s wastewater flow and assessments of management practices and source control methods are required to determine what the appropriate discharge specification should be for this constituent.

20. Groundwater limits equal to water quality objectives for indicator waste constituents are appropriate as well as a more restrictive limit for TDS in groundwater than that prescribed by Title 22, CCR. The Aerial Tramway's facilities contribute to economic activity in the area. This factor and the associated increase in TDS are consistent with maximum benefit to the people of the State. Accordingly, the discharge as authorized is consistent with the anti-degradation provisions of Resolution 68-16.

Storm Water

21. Federal regulations for storm water discharges were promulgated by the United States Environmental Protection Agency (USEPA; 40 CFR Parts 122, 123, and 124). The regulations require specific categories of facilities discharging storm water associated with industrial activity to obtain National Pollutant Discharge Elimination System (NPDES) permits and to implement Best Conventional Pollutant Technology and Best Available Technology Economically Achievable to reduce or eliminate industrial storm water pollution.
22. Construction of the Valley Station WWTP involves less than one acre of soil disturbance and is therefore exempt from State Water Board Order No. 99-03-DWQ (General Permit No. CAS000001), specifying WDRs for discharges of storm water associated with construction activities.
23. Pursuant to California Water Code Section 13263(g), the discharge of waste is a privilege, not a right, and adoption of this Order does not create a vested right to continue the discharge.

CEQA and Public Participation

24. The facility is categorically exempt from the provisions of the California Environmental Quality Act (CEQA), in accordance with Title 14, CCRs, Section 15301 (Existing Facilities), which applies to negligible or no expansion of an existing use.
25. The Board has notified the Discharger and all known interested agencies and persons of its intent to draft WDRs for this discharge, and has provided them with an opportunity for a public meeting and an opportunity to submit comments.
26. The Board, in a public meeting, heard and considered all comments pertaining to this discharge.

IT IS HEREBY ORDERED, that in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, the Discharger shall comply with the following:

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

A. Discharge Prohibitions

1. Discharge of wastes to surface waters or surface water drainage courses is prohibited.
2. Discharge of waste classified as 'hazardous,' as defined in Section 2521(a) of Title 23, CCR, Section 2510 et seq., or 'designated,' as defined in California Water Code Section 13173, is prohibited.
3. Bypass or overflow of untreated or partially treated waste is prohibited, except as allowed in Provision E.15.
4. Discharge of waste from the sanitary sewer system at any point upstream of the WWTF is prohibited.
5. Discharge of wastewater from the WWTF, other than into the disposal system and leach lines described in Finding Nos. 3, 4, 5 and 6, above, is prohibited.
6. The WWTF and all leach lines shall be maintained so that at no time is sewage or treated effluent permitted to surface or overflow at any location.

B. Discharge Specifications

1. The 30-day monthly average daily discharge flow from the Valley Station WWTF shall not exceed 1,750 gpd. The flow limit shall be applied to the flow leaving the WWTF.
2. Effluent from the Valley Station WWTF shall not have a pH below 6.0 or above 9.0.
3. Operation of the WWTF and the treatment or disposal of wastes from the facility shall not cause pollution or nuisance, as defined in Sections 13050(l) and 13050(m) of Division 7 of the California Water Code.
4. Public contact with wastewater shall be precluded or controlled through such means as fences and signs, or acceptable alternatives.
5. The Discharger shall not cause degradation of any water supply.
6. All treatment, storage, and disposal areas shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

7. The Valley Station WWTF effluent shall not exceed the following effluent limits:

Total Suspended Solids	mg/L	30	45	65
Nitrogen (as Total Nitrogen)	mg/L	10	15	20
Total Dissolved Solids (TDS)	mg/L	tbd ²	--	--
¹ 5-day biochemical oxygen demand at 20 °C. ² Appropriate TDS limits to be determined (tbd) after studies of source control and management practices have been completed.				

C. Sludge Disposal

1. Collected screenings, biosolids, grease and oil, and other solids removed from liquid wastes shall be disposed of in a manner that is consistent with Title 27 and approved by the Executive Officer.
2. Any proposed change in biosolids use or disposal practice from a previously approved practice shall be reported to the Executive Officer and U.S. Environmental Protection Agency Regional Administrator at least 90 days in advance of the change.
3. Use and disposal of sludge shall comply with existing Federal and State laws and regulations, including permitting requirements and technical standards included in 40 CFR Part 503. If the State Water Resources Control Board and the Regional Water Quality Control Boards are given the authority to implement regulations contained in 40 CFR Part 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 CFR part 503 whether or not they have been incorporated into this Order.

D. Groundwater Limitations

1. Discharge of waste constituents from the leach lines shall not cause groundwater to:
 - a. Contain any of the following constituents in concentrations greater than listed:

Constituent	Units	Limitation
Ammonia (as NH ₄)	mg/L	1.5
Boron	mg/L	0.7
Chloride	mg/L	106
Iron	mg/L	0.3
Manganese	mg/L	0.05
Sodium	mg/L	60
Total Coliform Organisms	MPN ¹ /100 mL	< 2.2
Total Dissolved Solids	mg/L	500
Nitrite (as N)	mg/L	1
Nitrate (as N)	mg/L	10

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

¹ Most Probable Number

- b. Exhibit a pH of less than 6.5 or greater than 8.5 pH units.
- c. Impart to groundwater taste, odor, toxicity, or color that creates nuisance or impairs any beneficial use.

E. Provisions

1. The Discharger shall comply with Monitoring and Reporting Program (MRP) No. R7-2009-0026, and future revisions thereto, as specified by the Regional Water Board Executive Officer.
2. When determining compliance with monthly or weekly average Discharge Specifications, and only one sample is available for that reporting period because of the prescribed monitoring frequency of MRP No. R7-2009-0026, the value of that sample shall be used to determine compliance with the average Discharge Specifications.
3. Prior to any modification at this facility, which would result in a material change in the quality or quantity of wastewater treated or discharged, or any material change in the location of discharge, the Discharger shall report all pertinent information in writing to the Regional Water Board and obtain revised requirements before any modifications are implemented.
4. Prior to any change in ownership or management of this operation, the Discharger shall transmit a copy of this Board Order to the succeeding owner/operator, and forward a copy of the transmittal letter to the Regional Water Board.
5. The Discharger shall ensure that all site-operating personnel are familiar with the content of this Board Order, and shall maintain a copy of this Board Order at the site.
6. This Board Order does not authorize violation of any federal, state, or local laws or regulations.
7. Standby power generating facilities shall be available to operate the plant during a commercial power failure.
8. The Discharger shall comply with all of the conditions of this Board Order. Any noncompliance with this Board Order constitutes a violation of the Porter-Cologne Water Quality Control Act (Cal. Water Code, § 13000 et seq.), and is grounds for enforcement action.
9. **No later than 30 days after beginning operations and waste discharge from the Valley Station WWTF**, the Discharger shall submit an engineering report pursuant to Section 13267 of the California Water Code. The report shall be prepared by a registered civil engineer experienced in the design of domestic wastewater treatment and disposal facilities, and provide:

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

- a. A description of the as-built WWTF and disposal system;
- b. A description of the type and location of flow metering instruments installed to comply with the effluent flow limit and MRP No. R7-2009-0026;
- c. A description of the subsurface disposal systems, including: the number, size, and construction specifications of the leach lines; the area covered by the leach lines, and available standby area for 100% replacement of the leach lines;
- d. Maps to scale (1 inch = 200 feet, or less) showing the location of the WWTF and disposal area;
- e. The Operation and Maintenance (O&M) Plans for the WWTF and subsurface disposal area; and
- f. Certification that the facility was designed and built to comply with the terms of this order.

The O&M Plans shall:

- i. Instruct field personnel to manage daily discharge operations at the WWTF to comply with the terms and conditions of this Order and to make field adjustments to prevent nuisance conditions (e.g., surfacing water);
 - ii. Include a nuisance condition troubleshooting flowchart for the WWTF and disposal area, with notification requirements in case of an emergency;
 - iii. Include an Inspection and Maintenance Plan describing the procedures and schedule for inspecting and testing the sewage collection system and necessary maintenance; and
 - iv. Provide instructions to determine when to remove grease/scum/sludge from the WWTF and the proper procedures for disposal of removed solids.
10. **No later than 30 days after start-up of the Valley Station WWTF**, the Discharger shall submit a technical report in the form of a Quality Assurance Project Plan (QAPP) to conduct and submit the results of a study to characterize the sources contributing to the Total Dissolved Solids (TDS) concentrations of the effluent for the system. The report shall be submitted to the Regional Water Board's Executive Officer for approval and contain a proposed time schedule for implementation and quality assurance (QA) procedures to:
- a. Obtain representative samples and analyses of the facility's source water for general minerals;
 - b. Identify and describe salt sources, processes, and operations in the facility that have the potential to contribute to the increased TDS of the influent into the wastewater treatment plant;
 - c. Obtain representative samples and analyses of the sources, processes, and operations cited in Item b., above; and;
 - d. Compare the TDS of the effluent with the TDS of the source water.
11. Following completion of, and based on the results of, the study requested in Provision 10, above, and **within 60 days of receiving the Regional Water Board Executive Officer's approval**, the Discharger shall submit a technical report in the form of a Source Control Plan to enable the Regional Water Board to establish, if necessary, a

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

TDS effluent limitation. The report shall identify and/or evaluate alternatives to control, to the maximum extent practicable, TDS sources, processes, and operations in that facility. In evaluating alternatives, the report shall address/provide:

- a. The cost per pound of salt removed from the discharge of each alternative plan, for each source identified in Provision 10, above;
 - b. The Discharger's financial and technical capability to implement the alternatives for source control;
 - c. Proposed alternatives for source control and proposed amount of incremental increase; and
 - d. A justification for the proposed incremental increase.
12. **Within 60 days following receipt of a complete Source Control Plan identified in Provision 11, above**, if the Executive Officer determines that implementation of the Discharger's proposed source control alternative, coupled with the other terms of this Order, ensure compliance with the Basin Plan water quality standards, the Executive Officer shall approve the incremental increase in writing. Alternatively, the Executive Officer shall recommend to the Regional Water Board an appropriate TDS effluent limitation.
13. The Discharger shall at all times properly operate and maintain all systems and components of collection, treatment and control, installed or used by the Discharger to achieve compliance with the conditions of this Board Order. Proper operation and maintenance includes effective performance, adequate process controls, and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems when necessary to achieve compliance with the conditions of this Board Order. All systems in service or reserved shall be inspected and maintained on a regular basis. Records of inspection results and maintenance performed shall be kept and made available to the Regional Water Board Executive Officer upon demand.
14. The Discharger shall report any noncompliance that may endanger human health or the environment. The Discharger shall immediately report orally to the Regional Water Board Executive Officer and the Office of Emergency Services information of the noncompliance as soon as: (1) the Discharger has knowledge of the discharge, (2) notification is possible, and (3) notification can be provided without substantially impeding cleanup or other emergency measures. During non-business hours, the Discharger shall leave a message on the Regional Water Board office voice recorder. A written report shall be provided within five (5) business days of the time the Discharger is aware of the incident. The written report shall contain a description of the noncompliance and the cause, the period of noncompliance, the anticipated time to achieve full compliance, and steps taken or planned, to reduce, eliminate, and prevent recurrence of the noncompliance. The Discharger shall report all intentional or unintentional spills occurring within the facility or collection system to the Regional Water Board office in accordance with the above time limits.
15. By-pass (i.e., the intentional diversion of waste streams from any portion of a treatment facility, except diversions designed to meet variable effluent limits) is prohibited. The Regional Water Board may take enforcement action against the Discharger for by-pass

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

unless:

- a. (1) By-pass was unavoidable to prevent loss of life, personal injury, or severe property damage. Severe property damage means substantial physical damage to property, damage to the treatment facilities that causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a by-pass. Severe property damage does not mean economic loss caused by delays in production; and
(2) There were no feasible alternatives to by-pass, such as the use of auxiliary treatment facilities or retention of untreated waste. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a by-pass that would otherwise occur during normal periods of equipment downtime or preventive maintenance;
- b. (1) By-pass is required for essential maintenance to assure efficient operation; and
(2) Neither effluent nor receiving water limitations are exceeded; and
(3) The Discharger notifies the Regional Water Board ten (10) days in advance.

The Discharger shall report to the Executive Officer, as soon as possible but in no event later than two (2) days, any unanticipated by-pass that has occurred.

16. The Discharger shall allow the Regional Water Board, or an authorized representative, upon presentation of credentials and other documents as may be required by law, to:
 - a. Enter upon the premises regulated by this Board Order, or the place where records must be kept under the conditions of this Board Order;
 - b. Have access to and copy, at reasonable times, any records that shall be kept under the conditions of this Board Order;
 - c. Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Board Order; and
 - d. Sample or monitor at reasonable times, for the purpose of assuring compliance with this Board Order or as otherwise authorized by the California Water Code, any substances or parameters at this location.
17. The Discharger shall comply with the following:
 - a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
 - b. The Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Board Order, and records of all data used to complete the application for this Board Order, for a period of at least five (5) years from the date of the sample, measurement, report or application.

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

- c. Records of monitoring information shall include:
 - (1) The date, exact place, and time of sampling or measurements;
 - (2) The individual(s) who performed the sampling or measurements;
 - (3) The date(s) analyses were performed;
 - (4) The individual(s) who performed the analyses;
 - (5) The analytical techniques or method used; and
 - (6) The results of such analyses.
18. Unless otherwise approved by the Regional Water Board Executive Officer, all analyses shall be conducted at a laboratory certified for such analyses by the California Department of Public Health. All analyses shall be conducted in accordance with the latest edition of "Guidelines Establishing Test Procedures for Analysis of Pollutants", promulgated by the United States Environmental Protection Agency.
19. The Discharger is the responsible party for the WDRs and the Monitoring and Reporting Program (MRP) for the WWTF. The Discharger shall comply with all conditions of these WDRs. Violations may result in enforcement action, including Regional Water Board orders or court orders that require corrective action or impose civil monetary liability, or modification or revocation of these WDRs by the Regional Water Board.
20. The Discharger shall provide adequate notice to the Regional Water Board Executive Officer of the following:
 - a. The introduction of pollutants into any of the treatment facilities described in the Findings of this Board Order from an indirect Discharger, who would be subject to Section 301 or 306 of the Clean Water Act if the pollutants were discharged directly;
 - b. Any substantial change in the volume or character of pollutants being introduced into any of the treatment facilities described in the Findings of this Board Order by an existing or new source; and
 - c. Any planned physical alterations or additions to the facilities described in this Board Order, or changes planned in the Discharger's sludge use or disposal practice, where such alterations, additions, or changes may justify the application of Board Order conditions that are different from or absent in the existing Board Order, including notification of additional disposal sites not reported during the Board Order application process, or not reported pursuant to an approved land application plan.
21. The Discharger shall report all instances of noncompliance. Reports of noncompliance shall be submitted with the Discharger's next scheduled self-monitoring report or earlier if requested by the Regional Water Board Executive Officer, or if required by an applicable standard for sludge use and disposal.
22. The Discharger shall apply for coverage under the NPDES General Permit for storm water discharges from construction activities for the site.
23. Adequate measures shall be taken to assure that flood or surface drainage waters do not

Palm Springs Aerial Tramway – Valley Station
Waste Discharge Requirements

- erode or otherwise render portions of the discharge facilities inoperable.
24. The Discharger shall maintain a permanent log of all solids hauled away from the treatment facility for use/disposal elsewhere and shall provide a summary of the volume, type (screenings, grit, raw sludge, digested sludge), use (agricultural, composting, etc.), and the destination in accordance with the MRP of this Board Order.
 25. This Board Order does not convey property rights of any sort, or any exclusive privileges, nor does it authorize injury to private property or invasion of personal rights, or infringement of federal, state, or local laws or regulations.
 26. This Board Order may be modified, rescinded, and reissued, for cause. The filing of a request by the Discharger for a Board Order modification, rescission, and reissuance, or a notification of planned changes or anticipated noncompliance does not stay any Board Order condition. Causes for modification include the promulgation of new regulations, modification of land application plans, or modification in sludge use or disposal practices, or adoption of new regulations by the State Water Resources Control Board or the Regional Water Board, including revisions to the Basin Plan.

I, Robert Perdue, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on May 21, 2009.

Ordered by: _____

ROBERT PERDUE
Executive Officer

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION**

MONITORING AND REPORTING PROGRAM NO. R7-2009-0026
FOR

MT. SAN JACINTO WINTER PARK AUTHORITY, OWNER/OPERATOR
PALM SPRINGS AERIAL TRAMWAY – VALLEY STATION WASTEWATER TREATMENT AND
DISPOSAL SYSTEM

City of Palm Springs and San Jacinto State Park, Riverside County

Location of Valley Station Wastewater Treatment Facility (WWTF) and Discharge:
City of Palm Springs, Latitude/Longitude, 33.837° N / 116.614° W

MONITORING

1. The collection, preservation and holding times of all samples shall be in accordance with United States Environmental Protection Agency (USEPA) approved procedures. Unless otherwise approved by the Regional Board Executive Officer, all analyses shall be conducted by a laboratory certified by the California Department of Public Health. All analyses shall be conducted in accordance with the latest edition of the “Guidelines Establishing Test Procedures for Analysis of Pollutants” (40 CFR Part 136), promulgated by the USEPA.
2. Samples shall be collected at the location specified in the Permit. If no location is specified, sampling shall be conducted at the most representative sampling point available.
3. If the facility is not in operation, or there is no discharge during a required reporting period, the Discharger shall forward a letter to the Regional Water Board indicating that there has been no activity during the required reporting period.

SECONDARY EFFLUENT MONITORING FOR VALLEY STATION WWTF

A sampling station shall be established at the point of discharge from the WWTF and the effluent shall be sampled as follows:

Constituents	Units	Type of Sample	Sampling Frequency	Reporting Frequency
Flow	gpd ²	Calculation ³	Weekly	Monthly
pH	pH units	Grab	Monthly	Monthly
20° C BOD ₅	mg/L	Grab	Monthly	Monthly
Suspended Solids	mg/L	Grab	Monthly	Monthly
Total Nitrogen	mg/L	Grab	Monthly	Monthly
Total Dissolved Solids	mg/L	Grab	Monthly	Monthly
VOCs	µg/L	Grab	Annually	Annually

Palm Springs Aerial Tramway – Valley Station
Monitoring And Reporting Program

¹ When analysis show noncompliance with the limitations prescribed by Discharge Specification No. B.8, the Discharger shall increase the sampling frequency, for the constituents that are in noncompliance, to one (1) sample per week, and continue sampling at that minimum frequency until either (a) the sampling shows compliance for two consecutive months or (b) it is notified by the Executive Officer that it can resume the normal sampling schedule.

² Gallons per day

³ Average daily flow calculated from weekly meter readings.

WATER SUPPLY TO THE FACILITY

The Discharger shall establish a sampling station where a representative sample of the domestic water supply to the facility can be obtained and shall provide written notification to the Executive Officer of the proposed sampling station. The sampling station is subject to the approval of the Executive Officer. Water supply monitoring shall include at least the following:

Constituents	Units	Sampling Frequency
TDS	mg/L	Monthly
pH	pH units	Monthly
Standard Minerals ¹	mg/l	Annually
¹ Standard Minerals shall include, at a minimum, the following elements/compounds: Barium, Calcium, Magnesium, Nitrogen, Potassium, Sulfate, Total Alkalinity (including alkalinity series), and Hardness		

CHINO CREEK

The Discharger shall establish sampling stations in Chino Creek, upstream and downstream of the wastewater disposal area, and shall provide written notification to the Executive Officer of the proposed sampling stations. The sampling stations are subject to the approval of the Executive Officer. When flow is present, the creek shall be monitored as follows:

Constituents	Units	Sampling Frequency
Dissolved Oxygen	mg/L	Quarterly
pH	pH units	Quarterly
E. Coli ¹	mg/l	Quarterly
¹ Escherichia coli		

REPORTING

1. The Discharger shall arrange the data in tabular form so that the specified information is readily discernible. The data shall be summarized in such a manner as to clearly illustrate whether the facility is operating in compliance with Waste Discharge Requirements (WDRs). Where appropriate, the Discharger shall include supporting calculations (e.g., for monthly averages).
2. Records of monitoring information shall include:
 - a. The date, exact place, and time of sampling or measurement(s);
 - b. The individual(s) who performed the sampling or measurement(s);
 - c. The date(s) analyses were performed;

Palm Springs Aerial Tramway – Valley Station
Monitoring And Reporting Program

- d. The individual(s) who performed the analyses;
 - e. The analytical technique or method used; and
 - f. The results of such analyses.
3. The results of any analysis taken, more frequently than required at the locations specified in this Monitoring and Reporting Program (MRP) shall be reported to the Regional Water Board.
 4. Monitoring reports shall be certified under penalty of perjury to be true and correct, and shall contain the required information at the frequency designated in this monitoring report.
 5. Each report shall contain the following statement:

"I declare under the penalty of law that I have personally examined and am familiar with the information submitted in this document, and that based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of a fine and imprisonment for knowing violations".
 6. The MRP and other information requested by the Regional Water Board shall be signed by a principal executive officer or ranking elected official.
 7. A duly authorized representative of the Discharger may sign the documents if:
 - a. The authorization is made in writing by the person described above;
 - b. The authorization specifies an individual or person having responsibility for the overall operation of the regulated disposal system; and
 - c. The written authorization is submitted to the Regional Water Board Executive Officer.
 8. Reporting of any failure in the facility (wastewater treatment plant, and collection and disposal systems) shall be as described in Provision No. E.14. Results of any analysis performed as a result of a failure of the facility shall be provided within ten (10) days after collection of the samples.
 9. The Discharger shall attach a cover letter to the Self Monitoring Report. The information contained in the cover letter shall clearly identify violations of the Waste Discharge Requirements, discuss corrective actions taken or planned, and the proposed a time schedule for corrective action. Identified violations should include a description of the requirement that was violated and a description of the violation.
 10. Daily, weekly and monthly monitoring reports shall be submitted to the Regional Water Board by the 15th day of the following month. Quarterly monitoring reports shall be

Palm Springs Aerial Tramway – Valley Station
Monitoring And Reporting Program

11. The Discharger shall submit monitoring reports to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-720 Fred Waring, Suite 100
Palm Desert, CA 92260

Ordered by:




ROBERT PERDUE
Executive Officer

May 21, 2009

Date

California Regional Water Quality Control Board
Colorado River Basin Region

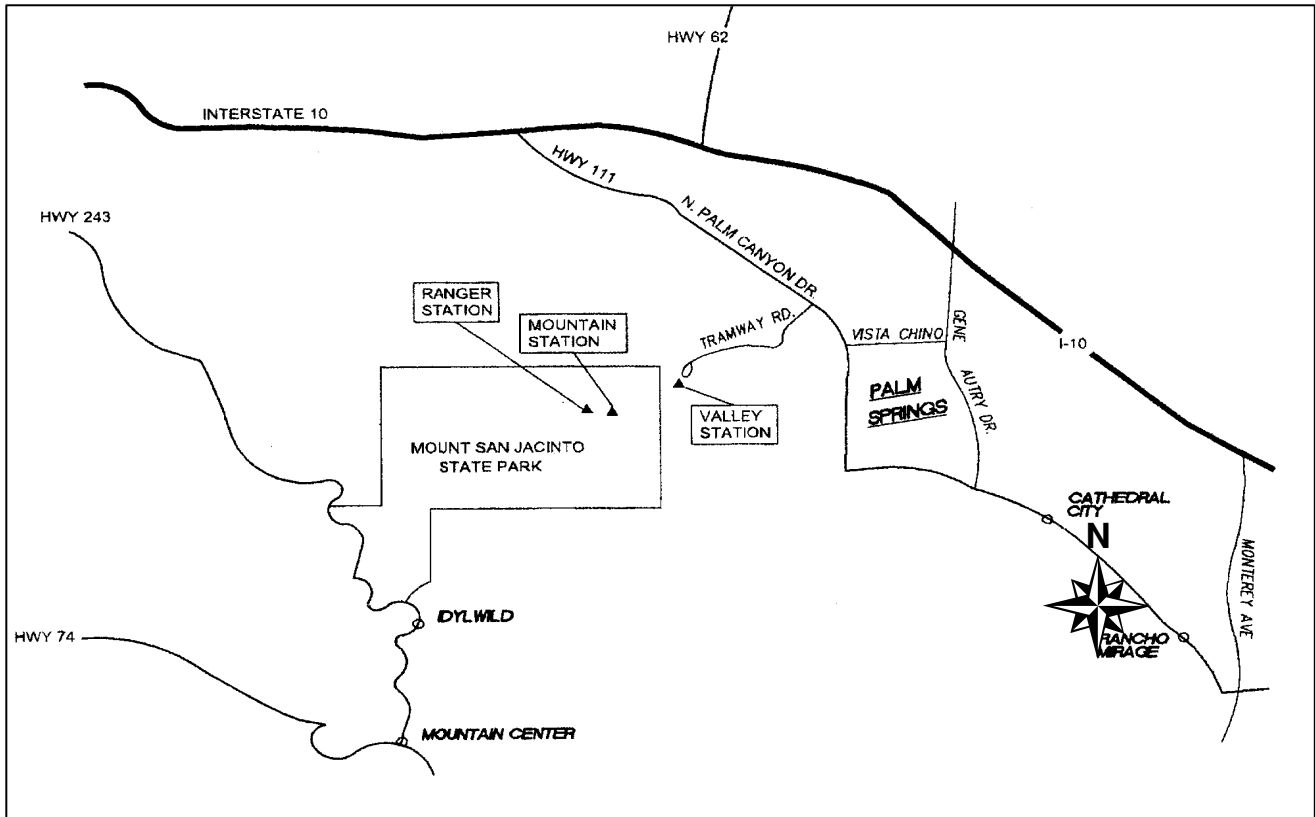


Attachment A - Palm Springs Aerial Tramway Area Map

San Jacinto Winter Park Authority
Palm Springs Aerial Tramway – Valley Station
Riverside County

Board Order No. R7-2009-0026

California Regional Water Quality Control Board
Colorado River Basin Region

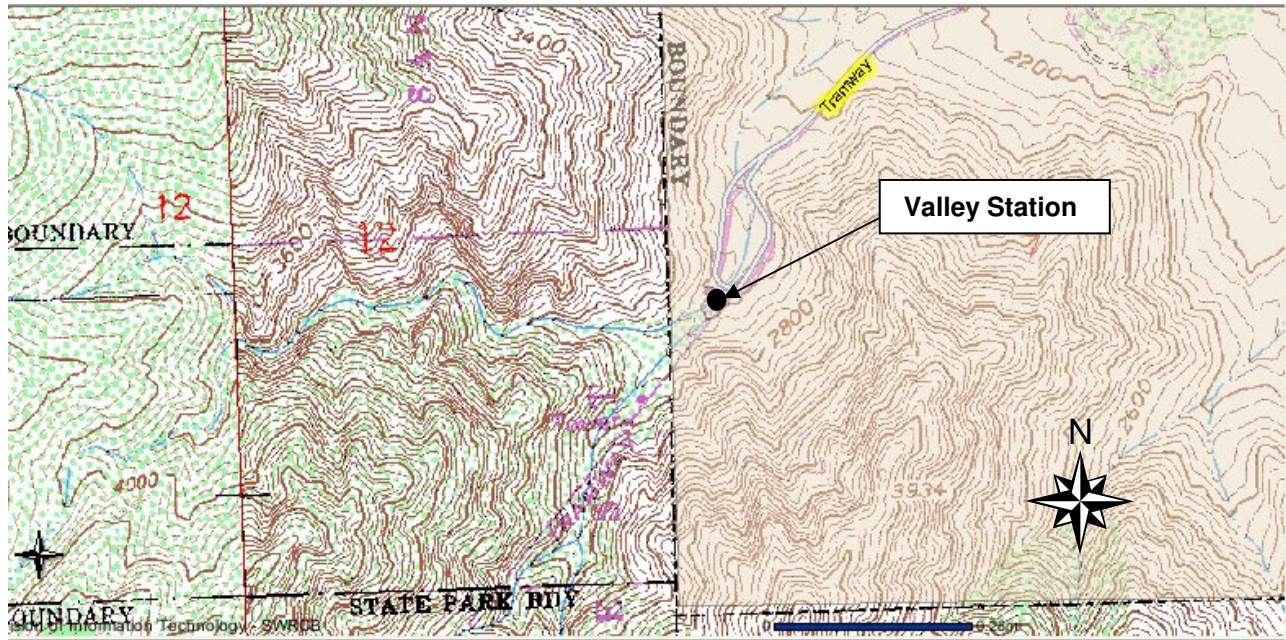

Attachment B – Valley Station Site Map

San Jacinto Winter Park Authority
Palm Springs Aerial Tramway – Valley Station
City of Palm Springs, Riverside County

Facility Location 33.812° N Latitude and 116.642° W Longitude

Board Order No. R7-2009-0026