STATE OF CALIFORNIA CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD LOS ANGELES REGION 320 West 4th Street, Suite 200, Los Angeles, California 90013

REVISED FACT SHEET WASTE DISCHARGE REQUIREMENTS FOR CITY OF COMPTON (MUNICIPAL WATER SUPPLY WELLS)

NPDES NO. CAG994005 SERIES NO. 067 CI-8147

FACILITY ADDRESS

FACILITY MAILING ADDRESS

(Various locations within City of Compton, See Table below) 205 S. Willowbrook Avenue Compton, CA 90220

PROJECT DESCRIPTION:

City of Compton Municipal Water Department currently operates five potable water supply wells located within its city boundary. This Fact Sheet is being revised to include coverage for discharge of groundwater from Well No. 16 located at 525 E. Weber St. and a new Well No. 19 to be located at 1119 E Tucker St. The discharges covered by this permit include groundwater from potable water supply wells generated during well purging for data collection purposes, groundwater generated from major well-rehabilitation and redevelopment activities, and groundwater generated from well drilling, construction and development.

The well rehabilitation process requires shutting down the well, removing the well pump, adding acid into the well, and swabbing the well casing. After the reaction period, the sediments are airlifted into a holding tank. The pH will then be adjusted and the sediments will be allowed to settle in the tank. The final step of the rehabilitation process is to surge and chlorinate the well. Subsequently, the pump is reinstalled and the well is developed. The pumped groundwater will be collected into sedimentation tanks and will be dechlorinated before being discharged into the storm drain.

Well Number	Location	Latitude	Longitude	Receiving Waterbody
11	841 West Greenleaf	33° 52' 51"	118° 14' 19"	Compton Creek
13	760 E. Caldwell	33° 53' 05"	118° 12' 49"	Compton Creek
15	345 West Glencoe	33° 52' 54"	118° 13' 36"	Compton Creek
16	525 E. Weber St.	33° 55' 13"	118° 13' 14"	Compton Creek

The City of Compton operates the following potable water supply wells:

City of Compton Compton Municipal Water Department

Well Number	Location	Latitude	Longitude	Receiving Waterbody
17	480 W. Compton Blvd.	33° 53' 44"	118° 13' 47"	Compton Creek
18	1806 N. Santa Fe	33° 54' 34"	118° 12' 54"	Compton Creek
19	1119 E Tucker St.	33° 54' 27"	118° 12' 40"	Compton Creek

VOLUME AND DESCRIPTION OF DISCHARGE:

Approximately 3 million gallons per day of groundwater will be discharged per well during well development and subsequent pumping and aquifer tests. This high rate of discharge is necessary to properly test the aquifer to determine the productive capacity and to properly size the well pumps. This high flow, short-term discharge will last up to 24 hours. The discharge flows into the storm water catch basins located near the facility that drains into Compton Creek, thence to the Los Angeles River, a water of the United States. The site location map is shown in Figures 1.

APPLICABLE EFFLUENT LIMITATIONS

Based on the information provided, the analytical data did not show reasonable potential for toxics to exist in groundwater above the Screening Levels for Potential Pollutants of Concern in Potable Groundwater in Attachment A. Therefore, the effluent limits for toxic compounds in Section E.2. are not applicable to your discharge. The discharge flows into Compton Creek that has a designated beneficial use of MUN(Potential). The effluent limitations in Attachment B.7.e. are applicable to your discharge.

This table lists the specific constituents and effluent limitations applicable to the discharge.

		Discharge Limitations		
Constituents	Units	Daily Maximum	Monthly Average	
Total Dissolved Solids	mg/L	1500		
Sulfate	mg/L	350		
Chloride	mg/L	150		
Nitrogen ¹	mg/L	8		
Total Suspended Solids	mg/L	150	50	
Turbidity	NTU	150	50	
BOD₅ 20°C	mg/L	30	20	
Settleable Solids	ml/L	0.3	0.1	
Residual Chlorine	mg/L	0.1		
Methyl tertiary butyl ether	μg/L	5		

¹

Nitrate-nitrogen plus nitrite nitrogen.

FREQUENCY OF DISCHARGE:


The discharge of groundwater will be intermittent and short duration lasting up to 24 hours.

REUSE OF WATER:

Offsite disposal of waste is not feasible due to high cost of disposal. Discharge to the sewer is not feasible because of inaccessibility and the high cost of sewer connection. The property and the immediate vicinity have no landscaped areas that require irrigation. Since there are no feasible reuse options, the groundwater will be discharged to the storm drain in compliance with the attached Order.

CAG994005

City of Compton Compton Municipal Water Department

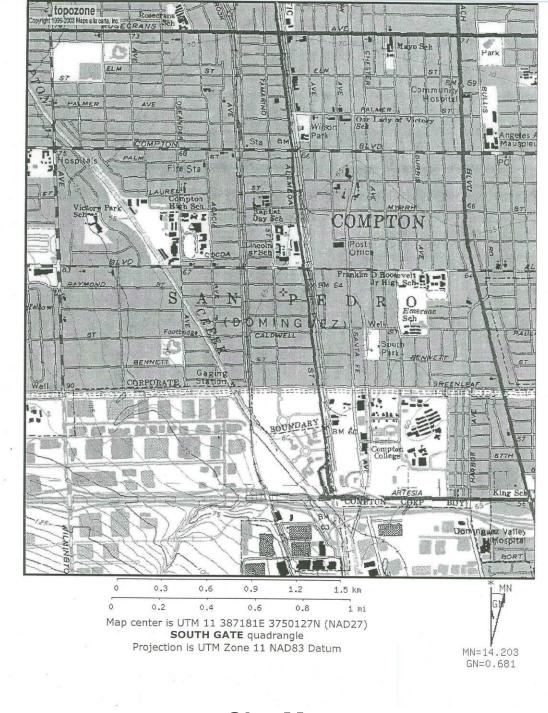

Site Map Figure 1