



California Regional Water Quality Control Board

Los Angeles Region



320 West Fourth Street, Suite 200, Los Angeles, California 90013

(213) 576-6600 • Fax (213) 576-6640
<http://www.waterboards.ca.gov/losangeles>

Linda S. Adams
Acting Secretary for
Environmental Protection

Edmund G. Brown Jr.
Governor

June 27, 2011

Mr. Thomas P. Schmidt, Project Coordinator
Hermetic Seal Corporation
4232 Temple City Blvd
Rosemead, CA 91770

Certified Mail
Return Receipt Requested
Claim No. 7000 0006 0029 1196 7277

Dear Mr. Schmidt:

COVERAGE UNDER GENERAL NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM AND WASTE DISCHARGE REQUIREMENTS—HERMETIC SEAL CORPORATION, WEST EL MONTE OPERABLE UNIT 4232 TEMPLE CITY BOLEVOURD, ROSEMEAD, CALIFORNIA (NPDES NO. CAG994004, CI-9721)

We have completed our review of your application for a permit to discharge groundwater under the National Pollutant Discharge Elimination System (NPDES).

Based on the information provided, the proposed discharge of groundwater from the potable water supply well construction project at the above-referenced facility meets the conditions to be regulated under Order No. R4-2008-0032, *General National Pollutant Discharge Elimination System and Waste Discharge Requirements for Discharges of Groundwater from Construction and Project Dewatering to Surface Waters in Coastal Watersheds of Los Angeles and Ventura Counties*, adopted by this Board on June 5, 2008.

Enclosed are your Waste Discharge Requirements, which also serve as your NPDES permit, consisting of Order No. R4-2008-0032 and Monitoring and Reporting Program No. CI-9721. The discharge limitations in Part V.1. Table 1, Table 2 and Table 5 of Order No. R4-2008-0032 for the specific constituents listed on the Table with the enclosed Fact Sheet are applicable to your discharge. The groundwater discharge flows into Eaton Wash thence to Rio Hondo a tributary to Los Angeles River. Therefore, discharge limitations in Attachment B.7.g of Order No. R4-2008-0032 are applicable to your discharge. In addition, Los Angeles River heavy metal Total Daily Maximum Load (TMDL) effluent limitations are applicable to your discharge. Prior to starting discharge, a representative sample of the effluent shall be obtained and analyzed to determine compliance with the discharge limitations.

The Monitoring and Reporting Program requires you to implement the monitoring program on the effective date of coverage under this permit. All monitoring reports should be sent to the Regional Board, ATTN: Information Technology Unit. When submitting monitoring or technical reports to the Regional Board per these requirements, please include a reference to "Compliance File No. CI-9721 and NPDES No. CAG994004", which will assure that the reports are directed to the appropriate file and staff. Also, please do not combine other reports with your monitoring reports. Submit each type of report as a separate document.

California Environmental Protection Agency

Mr. Thomas P. Schmidt, Project Coordinator - 2 -
Hermetic Seal Corporation


June 27, 2011

To avoid paying future annual fees, please submit written request for termination of your enrollment under the general permit in a separate letter, when your project has been completed and the permit is no longer needed.

We are sending a copy of Order No. R4-2008-0032 only to the applicant. For those on the mailing list, please refer to the Board Order sent to you previously or download a copy of the Order from our website at http://www.waterboards.ca.gov/losangeles/board_decisions.

If you have any questions, please contact Namiraj Jain at (213) 620-6003.

Sincerely,


Samuel Unger
Executive Officer

Enclosures:

Order No. R4-2008-0032, General NPDES Permit No. CAG994004
Fact Sheet
Monitoring and Reporting Program No. CI-9721

cc: Environmental Protection Agency, Region 9, Permit Section (WTR-5)
State Water Resources Control Board, NPDES_Wastewater@waterboards.ca.gov
U.S. Army Corps of Engineers
NOAA, National Marine Fisheries Service
Department of Interior, U.S. Fish and Wildlife Service
California Department of Fish and Game, Marine Resources, Region 5
California Department of Health Services, Drinking Water and Field Operations Branch
Los Angeles County Department of Public Works, Flood Control and Drainage
Los Angeles County Department of Environmental Program
Jae Kim, Tetrattech
Jeff Bamer, CDM
Bella Dizon, USEPA

/nj

STATE OF CALIFORNIA
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LOS ANGELES REGION
320 West 4th Street, Suite 200, Los Angeles, California 90013

**FACT SHEET
WASTE DISCHARGE REQUIREMENTS
FOR**

**WEST EL MONTE OPERABLE UNIT
(HERMETIC SEAL CORPORATION)
(ORDER NO. R4-2008-0032)
NPDES NO. CAG994004, SERIES NO.090
CI-9721**

FACILITY ADDRESS

4232 Temple City Blvd
Rosemead, CA 91770

FACILITY MAILING ADDRESS

4232 Temple City Blvd
Rosemead, CA 91770

PROJECT DESCRIPTION:

Hermetic Seal Corporation (Discharger) proposes to discharge treated groundwater from West Side El Monte Operable Unit (EMOU) located at 4232 Temple City Boulevard, Rosemead. EMOU is an Operable Unit of the San Gabriel Valley Superfund Site. EMOU addresses several square-mile-area of groundwater contamination extending beneath portions of El Monte, Rosemead and Temple City in Los Angeles County. The groundwater is impacted with trichloroethylene, tetrachloroethylene, perchlorate, hexavalent chromium and 1,4-dioxane. Pursuant to the Consent Decree for Civil Action No. CV 04-1490-RSWL dated April 2004, Discharger planning to install groundwater treatment system at the Hermetic Seal Corporation's parking lot facility to mitigate the contaminated portions of groundwater at Western Shallow and Northern Deep Portions of the EMOU's aquifer.

The contaminated groundwater will be extracted and conveyed to Hermetic Seal Corporation's parking facility for further treatment. The contaminated groundwater will be passed through a treatment system consisting of liquid-phase granular activated carbon to treat VOCs, and an anoxic fluidized bed bio-reactor to reduce the level of background nitrate, and to treat for perchlorate and hexavalent chromium. Electron donor and nutrients will be fed to the bacteria in the form of acetic acid and phosphoric acid respectively. Sodium hydroxide may be added to adjust pH of the influent water and ferrous chloride may be used to assist with the reduction of hexavalent chromium. The treated groundwater will be discharged to Eaton Wash a tributary to Rio Hondo. The site location map and treatment schematic are shown in Figure 1 and Figure 2 respectively.

VOLUME AND DESCRIPTION OF DISCHARGE:

Up to 0.36 million gallons per day of groundwater will be discharged from the project to the Eaton Wash at Discharge Point M-001 (Latitude: 34°4'50" Longitude: 118°22'30"), thence to Rio Hondo a tributary to Los Angeles River, waters of United States.

APPLICABLE EFFLUENT LIMITATIONS

Based on the information provided in the NPDES Application Supplemental Requirements, the following constituents listed in the Table below have been determined to show reasonable potential to exist in the discharge. The discharge flows to Eaton Wash thence to Rio Hondo a tributary to Los Angeles River which is designated as MUN (Potential) beneficial use. Therefore effluent limitations listed in Other Waters column in the Order apply to your discharge. The discharge limitations in Attachment B.7.g of Order No. R4-2008-0032 are applicable to your discharge. In addition, Los Angeles River mandatory heavy metals Total Maximum Daily Limitations (TMDL) are applicable to your discharge.

This Table lists the specific constituents and effluent limitations applicable to the discharge.

Constituents	Units	Discharge Limitations	
		Daily Maximum	Monthly Average
Total Suspended Solids	mg/L	150	50
Turbidity	NTU	150	50
BOD ₅ 20°C	mg/L	30	20
Settleable Solids	ml/L	0.3	0.1
Residual Chlorine	mg/L	0.1	---
Total Dissolved Solids	mg/L	750	---
Sulfate	mg/L	300	---
Chloride	mg/L	150	---
Nitrogen (Nitrate-nitrogen + Nitrite-nitrogen)	mg/L	8	---
Tetrachloroethylene	µg/L	5	---
Trichloroethylene	µg/L	5	---
1,1-Dichloroethylene	µg/L	6	3.2
Perchlorate	µg/L	6	---
1,4-Dioxane	µg/L	3	---
Chromium III	µg/L	50	---
Chromium IV	µg/L	16	8
Los Angeles River Heavy Metals TMDL			
Copper	µg/L	13	12.5
Lead	µg/L	5	2.5
Zinc	µg/L	131	65.5
Cadmium	µg/L	3.1	1.6

FREQUENCY OF DISCHARGE:

The discharge of groundwater will be intermittent and last for 30 years.

REUSE OF WATER:

In the vicinity of the project site, there are no landscaped areas that require irrigation using the groundwater discharge. Since there are no other feasible reuse options, the groundwater will be discharged to the storm drain in compliance with the requirements of the attached Order.


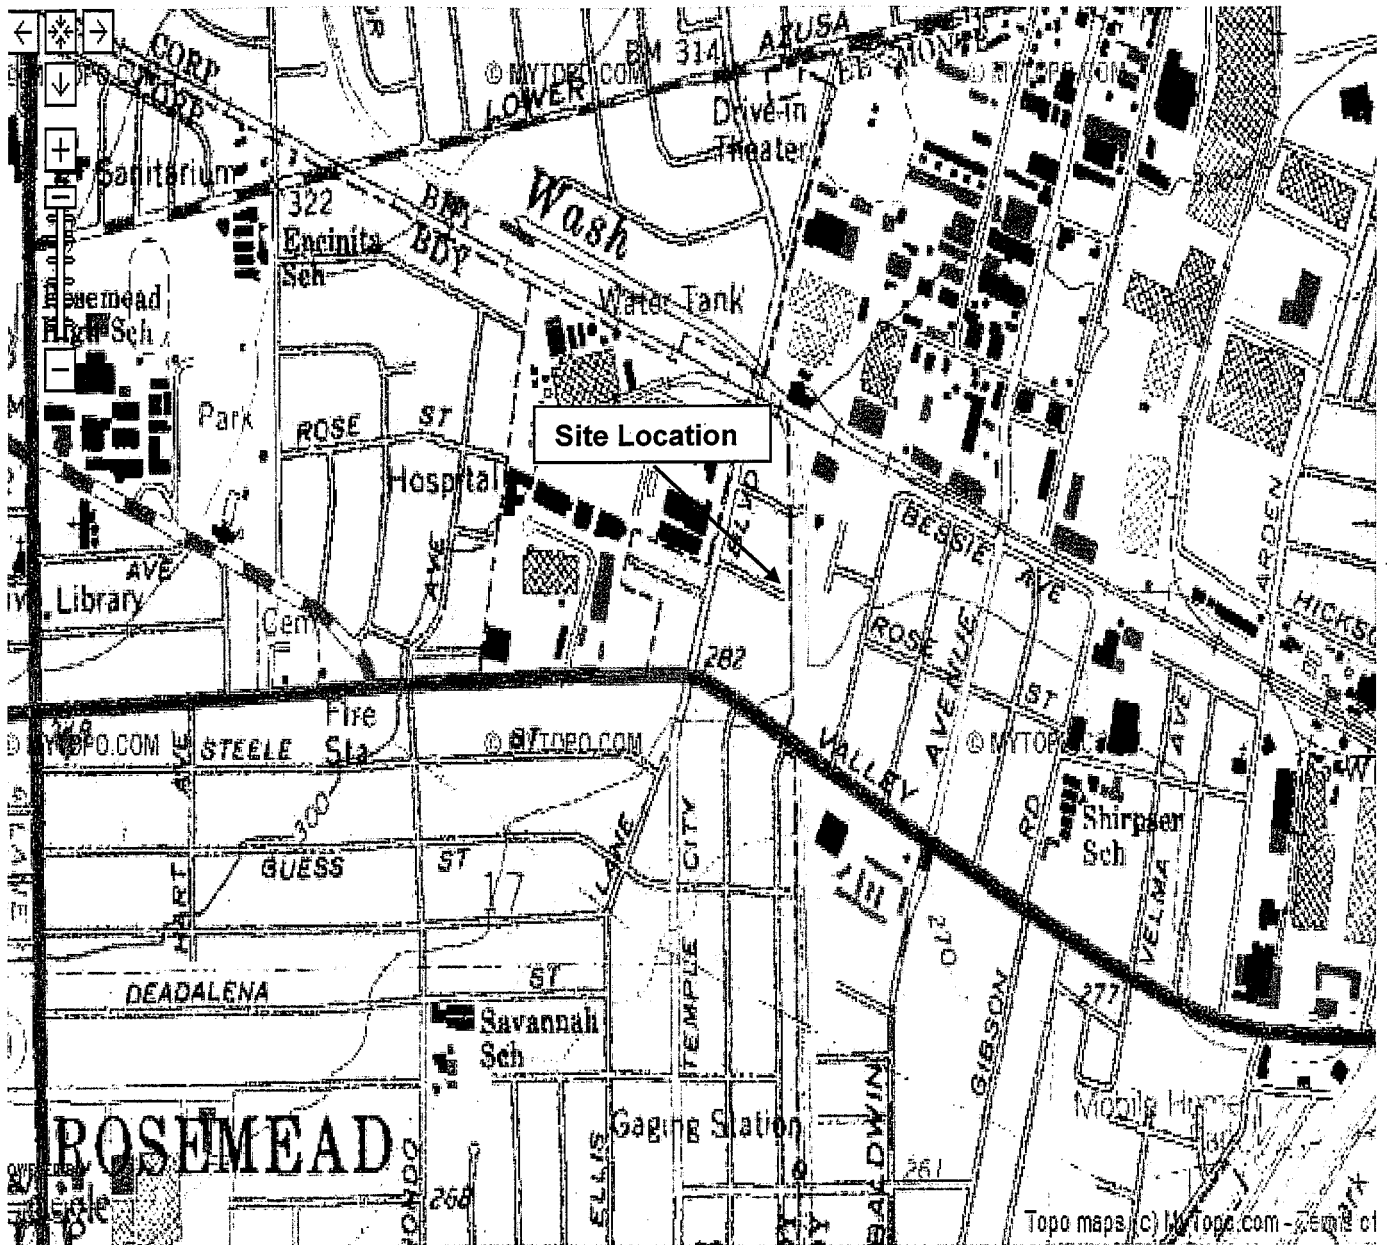


Figure 1. Site Location Map

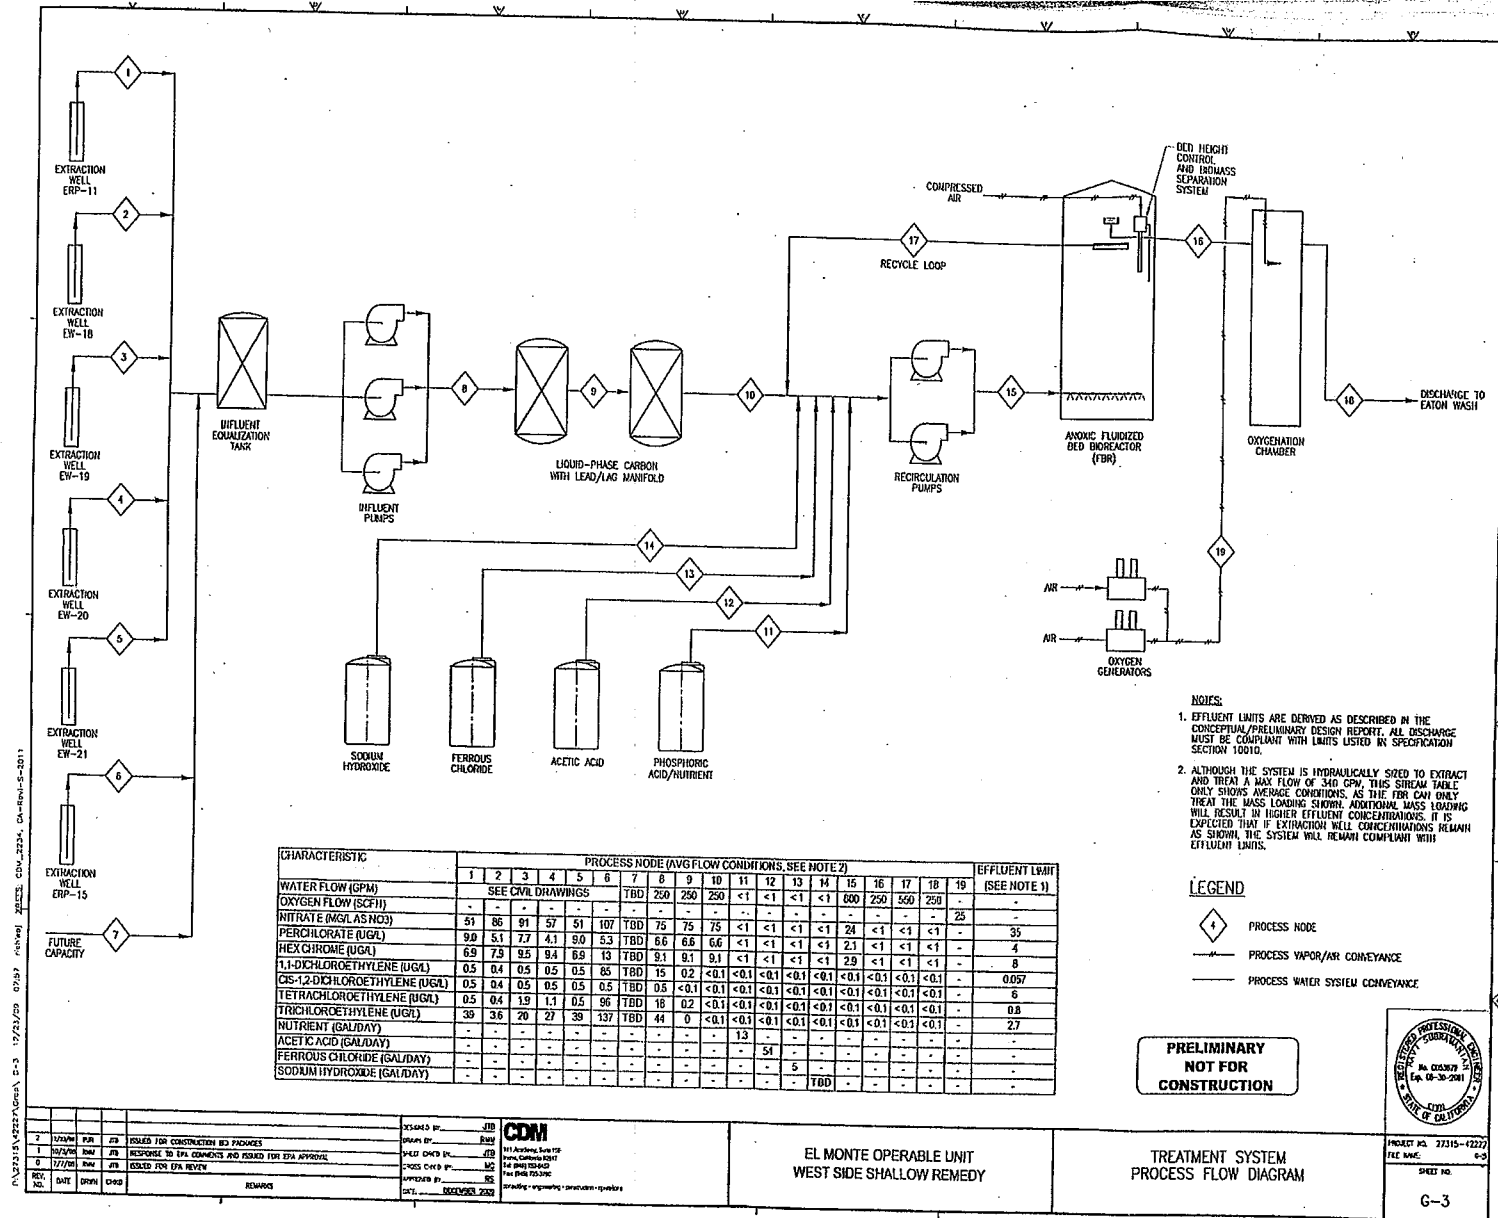

CHARACTERISTIC	PROCESS NODE (AVG FLOW CONDITIONS, SEE NOTE 2)																			EFFLUENT LIMIT (SEE NOTE 1)
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	
WATER FLOW (GPM)	SEE CIVIL DRAWINGS																			
OXYGEN FLOW (SCFH)	-	-	-	-	-	-	TBD	220	250	250	<1	<1	<1	<1	600	250	350	250	-	
NITRATE (MG/L AS NO3)	51	86	91	57	51	107	TBD	75	75	75	<1	<1	<1	<1	24	<1	<1	<1	25	
PERCHLORATE (UG/L)	9.0	5.1	7.7	4.1	8.0	5.3	TBD	6.6	6.6	6.6	<1	<1	<1	2.1	<1	<1	<1	<1	35	
HEXACHROME (UG/L)	6.9	7.9	9.5	9.4	6.9	13	TBD	9.1	9.1	9.1	<1	<1	<1	2.9	<1	<1	<1	<1	4	
1,1-DICHLOROETHYLENE (UG/L)	0.5	0.4	0.5	0.5	0.5	0.5	TBD	15	0.2	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	8	
CIS-1,2-DICHLOROETHYLENE (UG/L)	0.5	0.4	0.5	0.5	0.5	0.5	TBD	0.5	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	0.057	
TETRACHLOROETHYLENE (UG/L)	0.5	0.4	1.9	1.1	0.5	96	TBD	18	0.2	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	6	
TRICHLOROETHYLENE (UG/L)	39	3.6	20	27	39	137	TBD	44	0	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	0.8	
NUTRIENT (GAL/DAY)	-	-	-	-	-	-	-	-	-	-	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	2.7	
ACETIC ACID (GAL/DAY)	-	-	-	-	-	-	-	-	-	-	13	-	-	-	-	-	-	-	-	
FERRIC CHLORIDE (GAL/DAY)	-	-	-	-	-	-	-	-	-	-	54	-	-	-	-	-	-	-	-	
SODIUM HYDROXIDE (GAL/DAY)	-	-	-	-	-	-	-	-	-	-	-	5	-	-	-	-	-	-	-	
	-	-	-	-	-	-	-	-	-	-	-	-	TBD	-	-	-	-	-	-	

- NOTES:
- EFFLUENT LIMITS ARE DERIVED AS DESCRIBED IN THE CONCEPTUAL/PRELIMINARY DESIGN REPORT. ALL DISCHARGE MUST BE COMPLIANT WITH LIMITS LISTED IN SPECIFICATION SECTION 10010.
 - ALTHOUGH THE SYSTEM IS HYDRAULICALLY SIZED TO EXTRACT AND TREAT A MAX FLOW OF 340 GPM, THIS STREAM TABLE ONLY SHOWS AVERAGE CONDITIONS, AS THE FBR CAN ONLY TREAT THE MASS LOADING SHOWN. ADDITIONAL MASS LOADING WILL RESULT IN HIGHER EFFLUENT CONCENTRATIONS. IT IS EXPECTED THAT IF EXTRACTING WELL CONCENTRATIONS REMAIN AS SHOWN, THE SYSTEM WILL REMAIN COMPLIANT WITH EFFLUENT LIMITS.

LEGEND

- ◇ PROCESS NODE
- PROCESS VAPOR/AIR CONVEYANCE
- PROCESS WATER SYSTEM CONVEYANCE

PRELIMINARY
NOT FOR
CONSTRUCTION



EL MONTE OPERABLE UNIT
WEST SIDE SHALLOW REMEDY

TREATMENT SYSTEM
PROCESS FLOW DIAGRAM

PROJECT NO. 27315-1222
FILE NAME: 00
SHEET NO.

Treatment Schematic-Figure-2

STATE OF CALIFORNIA
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LOS ANGELES REGION

MONITORING AND REPORTING PROGRAM NO. CI-9721
FOR
DISCHARGES OF GROUDWATER FROM CONSTRUCTION AND PROJECT
DEWATERING TO SURFACE WATERS
IN
COASTAL WATERSHEDS OF LOS ANGELES AND VENTURA COUNTIES
(GENERAL NPDES PERMIT NO. CAG994004, SERIES NO.090)

This Order was adopted by the Regional Water Board on:	June 5, 2008
This Order shall become effective on:	June 27, 2011
This Order shall expire on:	June 5, 2013
The U.S. Environmental Protection Agency (USEPA) and the Regional Water Board have classified this discharge as a minor discharge.	

Ordered By: Samuel Unger
Samuel Unger
Executive Officer

Date: June 27, 2011

TABLE OF CONTENTS

ATTACHMENT E - Monitoring and Reporting Program (MRP)

Table of Contents 1

I. General Monitoring Provisions 2

II. Monitoring Locations 6

III. Effluent Monitoring Requirements 6

IV. Whole Effluent Toxicity Testing Requirements 7

 A. Definition of Toxicity 7

 Acute Toxicity 7

 B. Acute Toxicity Effluent Monitoring Program 7

 C. Reporting 8

V. Land Discharge Monitoring Requirements 9

VI. Reclamation Monitoring Requirements 9

VIII. Other Monitoring Requirements 9

IX. Reporting Requirements 9

 A. General Monitoring and Reporting Requirements 9

 B. Self Monitoring Reports (SMRs) 10

 C. Notification 12

 D. Monitoring Frequencies Adjustment 12

 E. Discharge Monitoring Reports (DMRS) 12

LIST OF TABLES

Table 1. Monitoring Location 6

Table 2. Monitoring Constituents 6

Table 3. Monitoring Periods and Reporting Schedule 10

Attachment E – Monitoring and Reporting Program (MRP)

The Code of Federal Regulations section 122.48 requires that all NPDES permits specify monitoring and reporting requirements. Water Code Sections 13267 and 13383 also authorize the Regional Water Quality Control Board (Regional Water Board) to require technical and monitoring reports. This MRP establishes monitoring and reporting requirements, which implement the federal and California regulations.

I. GENERAL MONITORING PROVISIONS

- A. An effluent sampling station shall be established for Discharge Point M-001 and shall be located where representative samples of that effluent can be obtained. Provisions shall be made to enable visual inspections before discharge. In the event of presence of oil sheen, debris, and/or other objectionable materials or odors, discharge shall not commence until compliance with the requirements is demonstrated. All visual observations shall be included in the monitoring report.
- B. This Regional Board shall be notified in writing of any change in the sampling stations once established or in the methods for determining the quantities of pollutants in the individual waste streams.
- C. Effluent samples shall be taken downstream of any addition to treatment works and prior to mixing with the receiving waters.
- D. This Regional Water Board shall be notified in writing of any change in the sampling stations once established or in the methods for determining the quantities of pollutants in the individual waste streams.
- E. Pollutants shall be analyzed using the analytical methods described in 40 CFR §§136.3, 136.4, and 136.5 (revised May 14, 1999); or, where no methods are specified for a given pollutant, by methods approved by this Regional Water Board or the State Water Board.
- F. Laboratories analyzing effluent samples and receiving water samples shall be certified by the California Department of Public Health Environmental Laboratory Accreditation Program (ELAP) or approved by the Executive Officer and must include QA/QC data in their reports. A copy of the laboratory certification shall be provided each time a new certification and/or renewal of the certification is obtained from ELAP.
- G. For any analyses performed for which no procedure is specified in the USEPA guidelines or in the MRP, the constituent or parameter analyzed and the method or procedure used must be specified in the monitoring report.
- H. Each monitoring report must affirm in writing that "all analyses were conducted at a laboratory certified for such analyses by the Department of Public Health or approved by the Executive Officer and in accordance with current USEPA guideline procedures or as specified in this Monitoring and Reporting Program".

- I. The monitoring reports shall specify the analytical method used, the MDL, and the ML for each pollutant. For the purpose of reporting compliance with numerical limitations, performance goals, and receiving water limitations, analytical data shall be reported by one of the following methods, as appropriate:
 1. An actual numerical value for sample results greater than or equal to the ML; or
 2. "DNQ" if results are greater than or equal to the laboratory's MDL but less than the ML; or,
 3. "ND" for sample results less than the laboratory's MDL with the MDL indicated for the analytical method used.

Analytical data reported as "less than" for the purpose of reporting compliance with permit limitations shall be the same or lower than the permit limit(s) established for the given parameter.

Current MLs (Attachment G) are those published by the State Water Resources Control Board in the *Policy for the Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California*, March 2, 2000.

- J. Where possible, the MLs employed for effluent analyses shall be lower than the permit limitations established for a given parameter. If the ML value is not below the effluent limitation, then the lowest ML value and its associated analytical method shall be selected for compliance purposes. At least once a year, the Discharger shall submit a list of the analytical methods employed for each test and associated laboratory QA/QC procedures.

The Regional Water Board, in consultation with the State Water Board Quality Assurance Program, shall establish a ML that is not contained in Attachment G to be included in the Discharger's permit in any of the following situations:

1. When the pollutant under consideration is not included in Attachment G;
2. When the Discharger and Regional Water Board agree to include in the permit a test method that is more sensitive than that specified in 40 CFR Part 136 (revised May 14, 1999);
3. When the Discharger agrees to use an ML that is lower than that listed in Attachment G;
4. When the Discharger demonstrates that the calibration standard matrix is sufficiently different from that used to establish the ML in Attachment G, and proposes an appropriate ML for their matrix; or,
5. When the Discharger uses a method whose quantification practices are not consistent with the definition of an ML. Examples of such methods are the USEPA-approved method 1613 for dioxins and furans, method 1624 for volatile organic substances, and method 1625 for semi-volatile organic substances. In

such cases, the Discharger, the Regional Water Board, and the State Water Board shall agree on a lowest quantifiable limit and that limit will substitute for the ML for reporting and compliance determination purposes.

- K. Water/wastewater samples must be analyzed within allowable holding time limits as specified in 40 CFR §136.3. All QA/QC items must be run on the same dates the samples were actually analyzed, and the results shall be reported in the Regional Water Board format, when it becomes available, and submitted with the laboratory reports. Proper chain of custody procedures must be followed, and a copy of the chain of custody shall be submitted with the report.
- L. All analyses shall be accompanied by the chain of custody, including but not limited to data and time of sampling, sample identification, and name of person who performed sampling, date of analysis, name of person who performed analysis, QA/QC data, method detection limits, analytical methods, copy of laboratory certification, and a perjury statement executed by the person responsible for the laboratory.
- M. The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments and to insure accuracy of measurements, or shall insure that both equipment activities will be conducted.
- N. The analytical laboratory shall have an acceptable written quality assurance (QA) plan for laboratory analyses. The annual monitoring report shall also summarize the QA activities for the previous year. Duplicate chemical analyses must be conducted on a minimum of ten percent (10%) of the samples, or at least one sample per sampling period, whichever is greater. A similar frequency shall be maintained for analyzing spiked samples.
- O. When requested by the Regional Water Board or USEPA, the Discharger will participate in the NPDES discharge monitoring report QA performance study. The Discharger must have a success rate equal to or greater than 80%.
- P. For parameters that both monthly average and daily maximum limitations are specified and the monitoring frequency is less than four times a month, the following shall apply. If an analytical result is greater than the monthly average limitation, the Discharger shall collect four additional samples at approximately equal intervals during the month, until compliance with the monthly average limitation has been demonstrated. All five analytical results shall be reported in the monitoring report for that month, or 45 days after results for the additional samples were received, whichever is later. In the event of noncompliance with a monthly average effluent limitation, the sampling frequency for that constituent shall be increased to weekly and shall continue at this level until compliance with the monthly average effluent limitation has been demonstrated. The Discharger shall provide for the approval of the Executive Officer a program to ensure future compliance with the monthly average limitation.
- Q. In the event wastes are transported to a different disposal site during the report period, the following shall be reported in the monitoring report:

1. Types of wastes and quantity of each type;
2. Name and address for each hauler of wastes (or method of transport if other than by hauling); and
3. Location of the final point(s) of disposal for each type of waste.

If no wastes are transported off-site during the reporting period, a statement to that effect shall be submitted.

- R. Each monitoring report shall state whether or not there was any change in the discharge as described in the Order during the reporting period.
- S. All monitoring reports shall include the discharge limitations in the Order, tabulated analytical data, the chain of custody form, and the laboratory report (including but not limited to date and time of sampling, date of analyses, method of analysis and detection limits).
- T. Sample collection requirements (as appropriate)
1. Daily samples shall be collected each day.
 2. Weekly samples shall be collected on a representative day of each week.
 3. Monthly samples shall be collected on a representative day of each month.
 4. Quarterly samples shall be collected in February, May, August, and November.
 5. Semi-annual samples shall be collected in May and November.
 6. Annual samples shall be collected in November.
- U. Before commencing a new discharge, a representative sample of the effluent shall be collected and analyzed for toxicity and for all the constituents listed in Fact Sheet, and the test results must meet all applicable limitations of Order No. R4-2008-0032.

II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

Table 1. Monitoring Location

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
Discharge Point 1	M-001	Wastewater effluent before contact with the receiving water and/or dilution by any other water or waste.
Discharge Point 2	M-002	If more than one discharge point is authorized under the General Permit, compliance monitoring locations shall be named M-002, M-003, etc. and shall be located so as to allow collection of wastewater effluent before contact with receiving water and/or dilution by any other water or waste.

III. EFFLUENT MONITORING REQUIREMENTS

- A. The Discharger shall monitor the effluent at Discharge Point M-001 in Table 2 as follows.

Table 2. Monitoring Constituents

Constituent	Unit	Type of Sample	Minimum Frequency of Analysis
Total Waste Flow	gal/day	totalizer	Continuously ¹
pH	pH unit	grab	monthly
Temperature	°F	grab	monthly
Total Suspended Solids	mg/L	grab	monthly
Turbidity	NTU	grab	monthly
BOD ₅ 20°C	mg/L	grab	monthly
Settleable Solids	ml/L	grab	monthly
Residual Chlorine	mg/L	grab	monthly
Total Dissolved Solids	mg/L	grab	monthly
Sulfate	mg/L	grab	monthly
Chloride	mg/L	grab	monthly
Nitrogen (Nitrate-nitrogen + Nitrite-nitrogen)	mg/L	grab	monthly
Tetrachloroethylene	µg/L	grab	weekly ²
Trichloroethylene	µg/L	grab	weekly ²
1,1-Dichloroethylene	µg/L	grab	weekly ²

Constituent	Unit	Type of Sample	Minimum Frequency of Analysis
Perchlorate	µg/L	grab	weekly ²
1,4-Dioxane	µg/L	grab	weekly ²
Chromium III	µg/L	grab	weekly ²
Chromium IV	µg/L	grab	weekly ²
Copper	µg/L	grab	quarterly
Lead	µg/L	grab	quarterly
Zinc	µg/L	grab	quarterly
Cadmium	µg/L	grab	quarterly
Acute Toxicity	% survival	grab	annually

- ¹ Record the monthly total flow and report the calculated daily average flow and monthly flow in the quarterly and annual reports, as appropriate.
- ² Weekly for the first 30 days of discharge and monthly thereafter, if no exceedance is observed.

IV. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

A. Definition of Toxicity

Acute Toxicity

The MRP requires an annual test for acute toxicity which measures primarily lethal effects that occur over a 96-hour period. Acute toxicity shall be measured in percent survival measured in undiluted (100%) effluent.

B. Acute Toxicity Effluent Monitoring Program

1. The Discharger shall conduct acute toxicity tests on effluent grab samples by methods specified in 40 CFR Part 136 which cites USEPA's *Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms*, Fifth Edition, October 2002, USEPA, Office of Water, Washington D.C. (EPA/821-R-02-012) or a more recent edition to ensure compliance in 100 % effluent.
2. The fathead minnow, *Pimephales promelas*, shall be used as the test species for fresh water discharges and the topsmelt, *Atherinops affinis*, shall be used as the test species for brackish effluent. The method for topsmelt is found in USEPA's *Short-term Method for Estimating the Chronic Toxicity of Effluents and Receiving Waters to West Coast Marine and Estuarine Organisms*, First Edition, August 1995 (EPA/600/R-95/136), or a more recent edition.

3. In lieu of conducting the standard acute toxicity testing with the fathead minnow, the Discharger may elect to report the results or endpoint from the first 48 hours of the chronic toxicity test as the results of the acute toxicity test.
4. Accelerated Toxicity Monitoring: If the results of the toxicity test yields a survival of less than 90%, then the frequency of analyses shall increase to monthly until at least three test results have been obtained and full compliance with effluent limitations has been demonstrated, after which the frequency of analyses shall revert to annually. Results of toxicity tests shall be included in the first monitoring report following sampling.
5. Effluent samples shall be collected after all treatment processes and before discharge to the receiving water.

C. Reporting

1. The Discharger shall submit a full report of the toxicity test results, including any accelerated testing conducted during the month as required by this permit. Test results shall be reported as % survival for acute toxicity test results with the self monitoring reports (SMR) for the month in which the test is conducted.
2. If an initial investigation indicates the source of toxicity and accelerated testing is unnecessary, then those results also shall be submitted with the SMR for the period in which the investigation occurred.
 - a. The full report shall be submitted on or before the end of the month in which the SMR is submitted.
 - b. The full report shall consist of (1) the results; (2) the dates of sample collection and initiation of each toxicity test; (3) the acute toxicity average limit.
3. Test results for toxicity tests also shall be reported according to the appropriate manual chapter on Report Preparation and shall be attached to the SMR. Routine reporting shall include, at a minimum, as applicable, for each test:
 - a. Sample date(s);
 - b. Test initiation date;
 - c. Test species;
 - d. End point values for each dilution (e.g., number of young, growth rate, percent survival);
 - e. Any applicable charts; and,

- f. Available water quality measurements for each test (e.g., pH, D.O., temperature, conductivity, hardness, salinity, ammonia).
4. The Discharger shall provide a compliance summary, which includes a summary table of toxicity data from all samples collected during that year.

The Discharger shall notify by telephone or electronically, this Regional Water Board of any toxicity exceedance of the limit or trigger within 24 hours of receipt of the results followed by a written report within 14 calendar days of receipt of the results. The verbal or electronic notification shall include the exceedance and the plan the Discharger has taken or will take to investigate and correct the cause(s) of toxicity. It may also include a status report on any actions required by the permit, with a schedule for actions not yet completed. If no actions have been taken, the reasons shall be given.

V. LAND DISCHARGE MONITORING REQUIREMENTS

Not Applicable.

VI. RECLAMATION MONITORING REQUIREMENTS

Not Applicable.

VII. RECEIVING WATER MONITORING REQUIREMENTS – SURFACE WATER AND GROUNDWATER

Not Applicable.

VIII. OTHER MONITORING REQUIREMENTS

Not Applicable.

IX. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. If there is no discharge during any reporting period, the report shall so state.
3. Each monitoring report shall contain a separate section titled "Summary of Non-Compliance" which discusses the compliance record and corrective actions taken or planned that may be needed to bring the discharge into full compliance with waste discharge requirements. This section shall clearly list all non-compliance with waste discharge requirements, as well as all excursions of effluent limitations.

4. The Discharger shall inform the Regional Water Board well in advance of any proposed construction activity that could potentially affect compliance with applicable requirements.

B. Self Monitoring Reports (SMRs)

1. At any time during the term of this permit, the State or Regional Water Board may notify the Discharger to electronically submit Self-Monitoring Reports (SMRs) using the State Water Board's California Integrated Water Quality System (CIWQS) Program Web site (<http://www.waterboards.ca.gov/ciwqs/index.html>). Until such notification is given, the Discharger shall submit hard copy SMRs. The CIWQS Web site will provide additional directions for SMR submittal in the event there will be service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP. The Discharger shall submit SMRs including the results of all required monitoring using USEPA-approved test methods or other test methods specified in this Order. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.
3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

Table 3. Monitoring Periods and Reporting Schedule

Sampling Frequency	Monitoring Period Begins On	Monitoring Period	SMR Due Date
Continuous	June 27, 2011	All	Submit with quarterly SMR
Weekly	Sunday following permit effective date or on permit effective date if on a Sunday	Sunday through Saturday	Submit with quarterly SMR
Monthly	First day of calendar month following permit effective date or on permit effective date if that date is first day of the month	1 st day of calendar month through last day of calendar month	Submit with quarterly SMR
Quarterly	Closest of January 1, April 1, July 1, or October 1	January 1 through March 31. April 1 through June 30. July 1 through September 30. October 1 through December 31	45 days from the end of the monitoring period
Annually	January 1	January 1 through December 31	45 days from the end of the monitoring period

4. Reporting Protocols. The Discharger shall report with each sample result the applicable Reporting Level (RL) and the current Method Detection Limit (MDL), as determined by the procedure in Part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory's MDL, shall be reported as "Detected, but Not Quantified," or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ as well as the words "Estimated Concentration" (may be shortened to "Est. Conc."). The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (\pm a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.
 - d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from *extrapolation* beyond the lowest point of the calibration curve.
5. The Discharger shall submit SMRs in accordance with the following requirements:
 - a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data is required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and the proposed time

schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.

- c. SMRs must be submitted to the Regional Water Board, signed and certified as required by the Standard Provisions (Attachment D), to the address listed below:

C. Notification

1. The Discharger shall notify the Executive Officer in writing prior to discharge of any chemical that may be toxic to aquatic life. Such notification shall include:
 - a. Name and general composition of the chemical,
 - b. Frequency of use,
 - c. Quantities to be used,
 - d. Proposed discharge concentrations, and
 - e. EPA registration number, if applicable.

No discharge of such chemical shall be made prior to obtaining the Executive Officer's approval.

2. The Discharger shall notify the Regional Board via telephone and/or fax within 24 hours of noticing an exceedance above the effluent limits in Order No. R4-2008-0032. The Discharger shall provide to the Regional Board within 14 days of observing the exceedance a detailed statement of the actions undertaken or proposed that will bring the discharge into full compliance with the requirements and submit a timetable for correction.

D. Monitoring Frequencies Adjustment

Monitoring frequencies may be adjusted by the Executive Officer to a less frequent basis if the Discharger requests same and the request is backed by statistical trends of monitoring data submitted.

E. Discharge Monitoring Reports (DMRS)

1. At any time during the term of this permit, the State or Regional Water Board may notify the Discharger to electronically submit SMRs that will satisfy federal requirements for submittal of Discharge Monitoring Reports (DMRs). Until such notification is given, the Discharger shall submit SMRs in accordance with the requirements described below.

2. SMRs must be signed and certified as required by the standard provisions (Attachment D). The Discharge shall submit the original SMR to the address listed below:

California Regional Water Quality Control Board
Los Angeles Region
320 W. 4th Street, Suite 200
Los Angeles, CA 90013
Attention: Information and Technology Unit.