

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD

LOS ANGELES REGION

320 W. 4th Street, Suite 200, Los Angeles, California 90013
Phone (213) 576 - 6600 • Fax (213) 576 - 6640
<http://www.waterboards.ca.gov>

ORDER NO. R4-2010-XXXX
NPDES NO. CA0064297

WASTE DISCHARGE REQUIREMENTS FOR THE CITY OF REDONDO BEACH, SEASIDE LAGOON

The following Discharger is subject to waste discharge requirements as set forth in this Order:

Table 1. Discharger Information

Discharger	City of Redondo Beach
Name of Facility	Seaside Lagoon, City of Redondo Beach
Facility Address	200 Portofino Way
	Redondo Beach, CA 90277
	Los Angeles County
The U.S. Environmental Protection Agency (USEPA) and the Regional Water Quality Control Board have classified this discharge as a minor discharge.	

The discharge by the City of Redondo Beach from the discharge points identified below is subject to waste discharge requirements as set forth in this Order:

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

February 18, 2010
Revised: July 12, 2010
Revised September 21, 2010

Table 2. Discharge Location

Discharge Point No.	Effluent Description	Discharge Point Latitude	Discharge Point Longitude	Receiving Water
001	Swimming Lagoon Discharge	33 ° 50' 38" N	118 ° 23' 41" W	King Harbor

Table 3. Administrative Information

This Order was adopted by the Regional Water Quality Control Board on:	October 7, 2010
This Order shall become effective on:	November 6, 2010
This Order shall expire on:	September 10, 2015
The Discharger shall file a Report of Waste Discharge in accordance with title 23, California Code of Regulations, as application for issuance of new waste discharge requirements no later than:	180 days prior to the Order expiration date

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

February 18, 2010
Revised: July 12, 2010
Revised September 21, 2010

IT IS HEREBY ORDERED, that Order No. R4-2005-0016 is terminated upon the effective date of this Order except for enforcement purposes, and, in order to meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the federal Clean Water Act (CWA) and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements in this Order.

I, Samuel Unger, ~~Interim~~ Executive Officer, do hereby certify that this Order with all attachments is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Los Angeles Region, on October 7, 2010.

Samuel Unger, ~~Interim~~ Executive Officer

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

February 18, 2010
Revised: July 12, 2010
Revised September 21, 2010

Table of Contents

I.	Facility Information	6
II.	Findings	7
III.	Discharge Prohibitions.....	16
IV.	Effluent Limitations and Discharge Specifications	16
	A. Effluent Limitations – Discharge Point No. 001	16
	B. Land Discharge Specifications.....	19
	C. Reclamation Specifications.....	19
V.	Receiving Water Limitations	20
	A. Surface Water Limitation.....	20
	B. Groundwater Limitations	21
VI.	Provisions	22
	A. Standard Provisions.....	22
	B. Monitoring and Reporting Program (MRP) Requirements	25
	C. Special Provisions.....	25
VII.	Compliance Determination	27
	A. Single Constituent Effluent Limitation.	27
	B. Mass-based Effluent Limitations.	27
	C. Multiple Sample Data.....	28
	D. Average Monthly Effluent Limitation (AMEL).	28
	E. Maximum Daily Effluent Limitations (MDEL).....	29
	F. Instantaneous Minimum Effluent Limitation.	29
	G. Instantaneous Maximum Effluent Limitation.	29

List of Tables

Table 1.	Discharger Information	1
Table 2.	Discharge Location.....	2
Table 3.	Administrative Information	2
Table 4.	Facility Information	6
Table 5.	Basin Plan Beneficial Uses.....	11
Table 6.	Effluent Limitations for Discharge Point No. 001	17

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

List of Attachments

Attachment A – Definitions	A-1
Attachment B – Map	B-1
Attachment C – Flow Schematic.....	C-1
Attachment D – Standard Provisions	D-1
Attachment E – Monitoring and Reporting Program (MRP No. 8034)	E-1
Attachment F – Fact Sheet	F-1
Attachment G – State Water Boards Minimum levels	G-1
Attachment H – List Of Priority Pollutants.....	H-1
Attachment I – RPA Analysis.....	I-1
Attachment J – Photos of Facility	J-1

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

I. FACILITY INFORMATION

The following Discharger is subject to waste discharge requirements as set forth in this Order:

Table 4. Facility Information

Discharger	City of Redondo Beach
Name of Facility	Seaside Lagoon
Facility Address	200 Portofino Way
	Redondo Beach, CA 90277
	Los Angeles County
Facility Contact, Title, and Phone	Maggie Healy Acting Recreation & Community Services Director Tel.: (310)-318-0671
Mailing Address	320 Knob Hill Redondo Beach, CA 90277 Los Angeles County
Type of Facility	Swimming Lagoon
Facility Design Flow	2.3 million gallons per day (MGD)

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

II. FINDINGS

The California Regional Water Quality Control Board, Los Angeles Region (hereinafter Regional Water Board), finds:

- A. **Facility Description.** The Seaside Lagoon Facility (Seaside Lagoon or Facility) is located at 200 Portofino Way, Redondo Beach, California, and is owned and operated by the City of Redondo Beach (hereinafter, the City or Discharger). The Facility is a city park and consists of a 1.4 million gallon man-made saltwater lagoon, artificial beaches, children's play area, snack bar facilities, and other recreational areas. The Lagoon was constructed in 1962 and has since been open to the public for swimming from Memorial Day to Labor Day (operating season)_each year. At other times, the City may allow the use of the Facility for social functions which may result in discharges into the receiving water outside the designated operational season. The surface area of the water in the Lagoon is approximately 1.2 acres with a maximum depth of 7 feet. Wastewater is discharged from Discharge Point No. 001 (see table on cover page) to the King Harbor, a water of the United States.
- B. **Discharge Description.** Water for the Lagoon comes from a nearby Redondo Beach Generating Station (RBGS or Power Plant) where the seawater is used to cool turbines. The Power Plant is located at 1100 Harbor Drive, Redondo Beach. RBGS currently operates four steam generating units (Units 5 – 8) in the city of Redondo Beach, Los Angeles County. The RBGS is owned and operated by AES Redondo Beach, LLC. Four other steam units (Units 1-4) have been retired but remain at the facility. The power plant is a "peak-demand" generation facility and as such operates intermittently. Cooling water for Units 5 and 6 is withdrawn through two submerged conduits extending into King Harbor and the Redondo Beach Marina. Cooling water for Units 7 and 8 is withdrawn through a submerged conduit that extends approximately 3000 feet from the facility and is located at the mouth of King Harbor. When operated at design capacity, the AES Power Plant discharges up to 898 million gallons per day (mgd) of once-through cooling water through two outfalls; one discharges to Pacific Ocean and the second one discharges to King Harbor. The Outfall which discharges to King Harbor is permitted to discharge up to 674 mgd. These discharges from RBGS are regulated under separate waste discharge requirements (WDRs) contained in Board Order No. 00-085.

The Lagoon influent is the Power Plant cooling water outfall conduit source that discharges to King Harbor. Approximately 3,200 gallons per minute (gpm), which is equivalent to approximately 2.3 mgd, of once-through cooling water, is directed to the Lagoon from the Power Plant Outfall that discharges to King Harbor. When the Power Plant is not in operation, the Lagoon influent is the King Harbor water that is in the discharge pipe as a result of tidal influences. Thus the King Harbor seawater serves as the source water for the Lagoon influent and the receiving water for Lagoon effluent.

The City is using only a small portion (0.26 %) of the cooling water from the Power Plant for recreational beneficial use, which would otherwise be discharged directly to

the King Harbor. To maintain the water level in the Seaside Lagoon, the City discharges roughly 3,200 gpm (approximately 2.3 mgd) of dechlorinated saltwater to King Harbor when the Lagoon is in use. The water is discharged through three overflow structures located along the northwest edge of the Lagoon. The water then flows by gravity to a manhole, then to a conduit that empties into King Harbor (see Table on cover page) at the shoreline (Latitude 33° 50' 38" N and Longitude 118° 23' 47" W) embankment through Discharge Serial 001. During periods when the Lagoon is not open for public use, the lagoon water will be flushed periodically.

The Seaside Lagoon is equipped with both chlorination and de-chlorination facilities. The treatment system consists of adding sodium hypochlorite solution to the influent to maintain a residual chlorine level of approximately 1.0 parts per million (ppm or mg/L) in the lagoon. Effluent is dechlorinated with sodium bisulfite to reduce the residual chlorine below 10 parts per billion (ppb or µg/L). The chlorination system consists of one, 1,000-gallon storage tank which holds 17% sodium hypochlorite, dual chemical feed pumps with manual controls, and related piping. The de-chlorination system consists of one, 1,000-gallon storage tank which holds 38% bi-sulfate, dual chemical feed pumps with manual controls, and related piping. The de-chlorination piping terminates at the overflow structures at which point the bi-sulfite solution is added to the effluent. Bi-sulfite is added at all three overflow structures. Attachment B provides a map of the area around the facility. Attachment C provides flow schematics of the Facility.

Sampling Conditions: The sample collection location is tidally influenced. During high tide conditions, the sampling vault would be almost completely inundated with sea water and the effluent pipe would be completely submerged. Therefore, the grab samples collected during high tide may not be representative of the effluent. Sampling should be conducted when there is a discharge and during low tide conditions based on data provided by the National Oceanic and Atmospheric Administration's (NOAA), Station No. 9410840 (Santa Monica, CA).

C. Observation of Temporal Variability – Influent/Effluent Sampling Results

The monitoring data collected for metals showed temporal variability in the collected influent and effluent sample results. The water samples collected from the same locations on different days displayed large differences in metal concentrations and effluent samples collected at different times during the same day also displayed considerable variability. This variability coupled with the limited number of samples available (five samples with only one sample with contaminant concentration that exceeded the applicable water quality criteria) make it difficult to utilize statistics to calculate appropriate interim effluent concentrations (95 or 99 percentile concentration) or to determine reasonable potential. This permit includes a requirement to develop a Work Plan and conduct a study which includes enhanced monitoring to provide a more robust data set, address sample variability, and determine sampling logistics in order to have the best data set for determining reasonable potential, intake credits, and other permit provisions related to metals.

R
E
V
I
S
E
D

T
E
M
P
O
R
A
L
V
E

- D. **Legal Authorities.** This Order is issued pursuant to section 402 of the federal CWA and implementing regulations adopted by the USEPA and chapter 5.5, division 7 of the California Water Code (commencing with section 13370). It shall serve as a National Pollutant Discharge Elimination System (NPDES) permit for point source discharges from this facility to surface waters. This Order also serves as Waste Discharge Requirements (WDRs) pursuant to article 4, chapter 4, division 7 of the Water Code (commencing with section 13260).
- E. **Background and Rationale for Requirements.** The Regional Water Quality Control Board, Los Angeles Region (Regional Water Board) developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and other available information. The Fact Sheet (Attachment F), which contains background information and rationale for Order requirements, is hereby incorporated into this Order and constitutes part of the Findings for this Order. Attachments A through F and G and I are also incorporated into this Order.
- F. **California Environmental Quality Act (CEQA).** Under Water Code section 13389, this action to adopt an NPDES permit is exempt from the provisions of CEQA, Public Resources Code sections 21100-21177.
- G. **Technology-based Effluent Limitations.** Section 301(b) of the CWA and implementing USEPA permit regulations at section 122.44, title 40 of the Code of Federal Regulations¹, require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Best Professional Judgment (BPJ) in accordance with Part 125, section 125.3. A detailed discussion of the technology-based effluent limitations development is included in the Fact Sheet (Attachment F).
- H. **Water Quality-Based Effluent Limitations.** Section 301(b) of the CWA and section 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards.

Section 122.44(d)(1)(i) mandates that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, water quality-based effluent limitations (WQBELs) must be established using: (1) USEPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state

¹ All further statutory references are to title 40 of the Code of Federal Regulations unless otherwise indicated.

criterion or policy interpreting the state's narrative criterion, supplemented with other relevant information, as provided in section 122.44(d)(1)(vi).

I. Watershed Management Approach and Total Maximum Daily Loads (TMDLs)

The Regional Water Board has implemented the Watershed Management Approach to address water quality issues in the region. Watershed management may include diverse issues as defined by stakeholders to identify comprehensive solutions to protect maintain, enhance, and restore water quality and beneficial uses. To achieve this goal, the Watershed Management Approach integrates the Regional Water Board's many diverse programs, particularly TMDLs, to better assess cumulative impacts of pollutants from all point and nonpoint sources. A TMDL is a tool for implementing water quality standards and is based on the relationship between pollution sources and in-stream water quality conditions. The TMDL establishes the allowable loadings or other quantifiable parameters for a waterbody and thereby provides the basis to establish water quality based controls. These controls should provide the pollution reduction necessary for a waterbody to meet water quality standards. This process facilitates the development of watershed-specific solutions that balance the environmental and economic impacts within the watershed. The TMDLs will establish waste load allocations (WLAs) and load allocations (LAs) for point and non-point sources, and will result in achieving water quality standards for the waterbody.

The USEPA approved the State's 2006 303(d) list of impaired water bodies on June 28, 2007. Certain receiving waters in the Los Angeles and Ventura County watersheds do not fully support beneficial uses and therefore have been classified as impaired on the 2006 303(d) list and have been scheduled for TMDL development. The facility discharges directly into King Harbor. King Harbor receives discharges from highly industrial areas. However, the 2006 State Board's California 303(d) List does not classify King Harbor as impaired.

- J. Water Quality Control Plans.** The Regional Water Board adopted a Water Quality Control Plan for the Los Angeles Region (hereinafter Basin Plan) on June 13, 1994, that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, the Basin Plan implements State Water Resources Control Board (State Water Board) Resolution No. 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply. Beneficial uses applicable to the King Harbor located in the Santa Monica Bay are as follows:

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Table 5. Basin Plan Beneficial Uses

Discharge Point No.	Receiving Water Name	Beneficial Use(s)
001	King Harbor	<u>Existing:</u> Industrial service supply (IND), navigation (NAV), contact (REC-1) and non-contact (REC-2) water recreation, commercial and sport fishing (COMM), marine habitat (MAR), wildlife habitat (WILD), preservation or rare, threatened or endangered species (RARE).

Requirements of this Order implement the Basin Plan.

Thermal Plan. The State Water Board adopted the *Water Quality Control Plan for Control of Temperature in the Coastal and Interstate Water and Enclosed Bays and Estuaries of California* (Thermal Plan) on May 18, 1972, and amended this plan on September 18, 1975. This plan contains temperature objectives for inland and coastal surface waters. Requirements of this Order implement the Thermal Plan.

Ammonia Basin Plan Amendment. The 1994 Basin Plan provided water quality objectives for ammonia to protect aquatic life, in Table 3-1 through Table 3-4.

However, those ammonia objectives were revised on March 4, 2004, by the Regional Water Board with the adoption of Resolution No. 2004-022, *Amendment to the Water Quality Plan for the Los Angeles Region to Update the Ammonia Objectives for Inland Surface Waters Not Characteristic of Freshwater (including enclosed bays, estuaries and wetlands) with the Beneficial Use Designations for Protection of "Aquatic Life"*. The ammonia Basin Plan amendment was approved by the Office of Administrative Law on September 15, 2004 and by USEPA on May 19, 2005. The amendment revised the Basin Plan by updating the ammonia objectives for inland surface waters not characteristic of freshwater such that they are consistent with the USEPA "Ambient Water Quality Criteria for Ammonia (Saltwater) – 1989." The amendment revised the regulatory provisions of the Basin Plan by adding language to Chapter 3, "Water Quality Objectives."

The amendment contains objectives for a 4-day average concentration of un-ionized ammonia of 0.035 mg/L, and a 1-hour average concentration of un-ionized ammonia of 0.233 mg/L. The objectives are fixed concentrations of un-ionized ammonia, independent of pH, temperature, or salinity. The amendment also contains an implementation procedure to convert un-ionized ammonia objectives to total ammonia effluent limitations.

Bays and Estuaries Policy. The Water Quality Control Policy for the Enclosed Bays and Estuaries of California (Enclosed Bay and Estuaries Policy), adopted by the State Water Board as Resolution No. 95-84 on November 16, 1995, states that:

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

"It is the policy of the State Board that the discharge of municipal wastewaters and industrial process waters (exclusive of cooling water discharges) to enclosed bays and estuaries, other than the San Francisco Bay-Delta system, shall be phased out at the earliest practicable date. Exceptions to this provision may be granted by a Regional Board only when the Regional Board finds that the wastewater in question would consistently be treated and discharged in such a manner that it would enhance the quality of receiving waters above that which would occur in the absence of the discharge."

While the effluent from the Facility discharges into King Harbor, within the Santa Monica Bay, the wastewater is comprised primarily of once-through cooling water from AES Redondo Beach Power Plant, and therefore is not considered to be industrial process wastewater. Nonetheless, this Order contains provisions necessary to protect all beneficial uses.

- K. **National Toxics Rule (NTR) and California Toxics Rule (CTR).** USEPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995 and November 9, 1999. About forty criteria in the NTR applied in California. On May 18, 2000, USEPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on February 13, 2001. These rules contain water quality criteria for priority pollutants.
- L. **State Implementation Policy.** On March 2, 2000, the State Water Board adopted the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (State Implementation Policy or SIP). The SIP became effective on April 28, 2000, with respect to the priority pollutant criteria promulgated for California by the USEPA through the NTR and to the priority pollutant objectives established by the Regional Water Board in the Basin Plan. The SIP became effective on May 18, 2000, with respect to the priority pollutant criteria promulgated by the USEPA through the CTR. The State Water Board adopted amendments to the SIP on February 24, 2005, that became effective on July 13, 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.

Intake Water Credits. Section 1.4.4 of the SIP provides that, intake water credits for a pollutant may be established in an NPDES permit based on a Discharger's demonstration that the following conditions are met:

1. The observed maximum ambient background concentration, as determined in section 1.4.3.1, and the intake water concentration of the pollutant exceeds the most stringent applicable criterion/objective for that pollutant;
2. The intake water credits provided are consistent with any total maximum daily load (TMDL) applicable to the discharge that has been approved by the Regional Water Board, State Water Board, and USEPA;
3. The intake water is from the same water body as the receiving water body. The discharger may demonstrate this condition by showing that:

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- a. the ambient background concentration of the pollutant in the receiving water, excluding any amount of the pollutant in the facility's discharge, is similar to that of the intake water;
- b. there is a direct hydrological connection between the intake and discharge points;
- c. the water quality characteristics are similar in the intake and receiving waters; and
- d. the intake water pollutant would have reached the vicinity of the discharge point in the receiving water within a reasonable period of time and with the same effect had it not been diverted by the discharger.

The Regional Water Board may also consider other factors when determining whether the intake water is from the same water body as the receiving water body;

4. The facility does not alter the intake water pollutant chemically or physically in a manner that adversely affects water quality and beneficial uses; and
5. The timing and location of the discharge does not cause adverse effects on water quality and beneficial uses that would not occur if the intake water pollutant had been left in the receiving water body.

Based on the monitoring data submitted as part of Source Identification Study in 2007 and additional information, the Discharger has demonstrated that the above conditions are met. Therefore, this Order includes effluent limitations for TSS, ~~arsenic, cadmium, copper, nickel, selenium, silver, thallium, and zinc~~ based on the intake water credits. A detailed discussion of the basis for the intake water credits is included in the Fact Sheet (Attachment F)

- M. Compliance Schedules and Interim Requirements.** Section 2.1 of the SIP provides that, based on a Discharger's request and demonstration that it is infeasible for an existing Discharger to achieve immediate compliance with an effluent limitation derived from a CTR criterion, compliance schedules may be allowed in an NPDES permit. Unless an exception has been granted under section 5.3 of the SIP, a compliance schedule may not exceed 5 years from the date that the permit is issued or reissued, nor may it extend beyond 10 years from the effective date of the SIP (or May 18, 2010) to establish and comply with CTR criterion-based effluent limitations. Where a compliance schedule for a final effluent limitation exceeds 1 year, the Order must include interim numeric limitations for that constituent or parameter. Where allowed by the Water Quality Control Plan Los Angeles Region, compliance schedules and interim effluent limitations or discharge specifications may also be granted to allow time to implement a new or revised water quality objective. This Order does not include compliance schedules and interim effluent limitations and/or discharge specifications.
- N. Alaska Rule.** On March 30, 2000, USEPA revised its regulation that specifies when new and revised state and tribal water quality standards (WQS) become effective for CWA purposes (40 CFR § 131.21; 65 Fed. Reg. 24641 (April 27, 2000)). Under the revised regulation (also known as the Alaska rule), new and revised standards submitted to USEPA after May 30, 2000, must be approved by USEPA before being

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

used for CWA purposes. The final rule also provides that standards already in effect and submitted to USEPA by May 30, 2000, may be used for CWA purposes, whether or not approved by USEPA.

- O. **Stringency of Requirements for Individual Pollutants.** This Order contains both technology-based and water quality-based effluent limitations for individual pollutants. The technology-based effluent limitations consist of restrictions on turbidity, 5-day biochemical oxygen demand (BOD), oil and grease, total suspended solids (TSS), and total residual chlorine. Restrictions on turbidity, BOD, oil and grease, TSS, pH, and total residual chlorine are discussed in section IV.B.2 of the Fact Sheet. This Order's technology-based pollutant restrictions implement the minimum, applicable federal technology-based requirements. These limitations are not more stringent than required by the CWA.

Water quality-based effluent limitations for ammonia, ~~arsenic, cadmium, copper, nickel, selenium, silver, thallium, and zinc~~ have been established in this Order. Water quality-based effluent limitations have been scientifically derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable federal water quality standards. To the extent that toxic pollutant water quality-based effluent limitations were derived from the CTR, the CTR is the applicable standard pursuant to section 131.38. The scientific procedures for calculating the individual water quality-based effluent limitations for priority pollutants are based on the CTR-SIP, which was approved by USEPA on May 18, 2000. All beneficial uses and water quality objectives contained in the Basin Plan were approved under state law and submitted to and approved by USEPA prior to May 30, 2000. Any water quality objectives and beneficial uses submitted to USEPA prior to May 30, 2000, but not approved by USEPA before that date, are nonetheless "applicable water quality standards for purposes of the CWA" pursuant to section 131.21(c)(1). Collectively, this Order's restrictions on individual pollutants are no more stringent than required to implement the requirements of the CWA.

- P. **Antidegradation Policy.** Section 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing quality of waters be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the state and federal antidegradation policies. As discussed in detail in the Fact Sheet the permitted discharge is consistent with the antidegradation provision of Section 131.12 and State Water Board Resolution No. 68-16.
- Q. **Anti-Backsliding Requirements.** Sections 402(o)(2) and 303(d)(4) of the CWA and federal regulations at title 40, Code of Federal Regulations section 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require effluent limitations in a reissued permit to be as stringent as those in the previous permit, with some exceptions where limitations may be relaxed. All effluent limitations in this Order

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

are at least as stringent as the effluent limitations in the previous Order (No. R4-2005-0016).

- R. **Endangered Species Act.** This Order does not authorize any act that results in the taking of a threatened or endangered species or any act that is now prohibited, or becomes prohibited in the future, under either the California Endangered Species Act (Fish and Game Code sections 2050 to 2097) or the Federal Endangered Species Act (16 U.S.C.A. sections 1531 to 1544). This Order requires compliance with effluent limits, receiving water limits, and other requirements to protect the beneficial uses of waters of the state. The discharger is responsible for meeting all requirements of the applicable Endangered Species Act.
- S. **Monitoring and Reporting.** Section 122.48 requires that all NPDES permits specify requirements for recording and reporting monitoring results. Water Code sections 13267 and 13383 authorizes the Regional Water Board to require technical and monitoring reports. The Monitoring and Reporting Program establishes monitoring and reporting requirements to implement federal and State requirements. This Monitoring and Reporting Program is provided in Attachment E.
- T. **Standard and Special Provisions.** Standard Provisions, which apply to all NPDES permits in accordance with section 122.41, and additional conditions applicable to specified categories of permits in accordance with section 122.42, are provided in Attachment D. The discharger must comply with all standard provisions and with those additional conditions that are applicable under section 122.42. The Regional Water Board has also included in this Order special provisions applicable to the Discharger. A rationale for the special provisions contained in this Order is provided in the attached Fact Sheet.
- U. **Provisions and Requirements Implementing State Law.** The provisions/requirements in subsections VI.C.2 of this Order are included to implement state law only. These provisions/requirements are not required or authorized under the federal CWA; consequently, violations of these provisions/requirements are not subject to the enforcement remedies that are available for NPDES violations.
- V. **Notification of Interested Parties.** The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe Waste Discharge Requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of notification are provided in the Fact Sheet of this Order.
- W. **Consideration of Public Comment.** The Regional Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet of this Order.

THEREFORE, IT IS HEREBY ORDERED, that this Order supercedes Order No. R4-2005-0016 except for enforcement purposes, and, in order to meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

thereunder, and the provisions of the federal CWA and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements in this Order.

III. DISCHARGE PROHIBITIONS

- A. Wastes discharged shall be limited to a maximum of 2.3 MGD of dechlorinated wastewater as described in the findings. The discharge of wastes from accidental spills or other sources is prohibited.
- B. Discharges of water, materials, thermal wastes, elevated temperature wastes, toxic wastes, deleterious substances, or wastes other than those authorized by this Order, to a storm drain system, King Harbor, or other waters of the State, are prohibited.
- C. Neither the treatment nor the discharge of pollutants shall create pollution, contamination, or a nuisance as defined by Section 13050 of the Water Code.
- D. Wastes discharged shall not contain any substances in concentrations toxic to human, animal, plant, or aquatic life.
- E. The discharge shall not cause a violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or the State Water Resources Control Board as required by the Federal CWA and regulations adopted thereunder. If more stringent applicable water quality standards are promulgated or approved pursuant to section 303 of the Federal CWA, and amendments thereto, the Board will revise and modify this Order in accordance with such more stringent standards.
- F. The discharge of any radiological, chemical, or biological warfare agent or high level radiological waste is prohibited.
- G. Any discharge of wastes at any point(s) other than specifically described in this Order is prohibited, and constitutes a violation of the Order.

IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

- A. Effluent Limitations – Discharge Point No. 001
 - 1. Final Effluent Limitations – Discharge Point No. 001
 - a. The Discharger shall maintain compliance with the following effluent limitations at Discharge Point No. 001, with compliance measured at Monitoring Location EFF-001 as described in the attached MRP (Attachment E):

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Table 6. Effluent Limitations for Discharge Point No. 001

Parameter	Units	Effluent Limitations			
		Average Monthly ¹	Maximum Daily	Instantaneous	
				Minimum	Maximum
pH	Std. units	--	--	6.5	8.5
BOD (5-day @ 20 Deg. C)	mg/L	20	30	--	--
	lbs/day ²	384	575	--	--
TSS ⁸	mg/L	50 ⁸	75 ⁸	--	--
	lbs/day ²	960	1,439	--	--
Oil and Grease	mg/L	10	15	--	--
	lbs/day ²	192	288	--	--
Turbidity	NTU	50	75	--	--
Temperature	°F	--	--	--	86 ³
Chlorine, Total Residual	µg/L	2	8	--	--
	lbs/day ²	0.038	0.15	--	--
Total Coliform	mpn/100ml	1,000 ^{4,5}	10,000	--	--
Fecal Coliform	mpn/100ml	200 ^{5,6}	400	--	--
Enterococcus	mpn/100ml	35 ^{5,7}	104	--	--
Arsenic, Total Recoverable ⁸	µg/L	30 ⁸	59 ⁸	--	--
	lbs/day ²	0.6	1.2	--	--
Cadmium, Total Recoverable ⁸	µg/L	7.7 ⁸	15.4 ⁸	--	--
	lbs/day ²	0.15	0.3	--	--
Copper, Total Recoverable ⁸	µg/L	3 ⁸	6 ⁸	--	--
	lbs/day ²	0.06	0.12	--	--
Nickel, Total Recoverable ⁸	µg/L	6.8 ⁸	14 ⁸	--	--
	lbs/day ²	0.13	0.27	--	--
Selenium, Total Recoverable ⁸	µg/L	58 ⁸	117 ⁸	--	--
	lbs/day ²	1.2	2.3	--	--
Silver, Total Recoverable ⁸	µg/L	1.1 ⁸	2.2 ⁸	--	--
	lbs/day ²	0.03	0.05	--	--
Thallium, Total Recoverable ⁸	µg/L	6.3 ⁸	13 ⁸	--	--
	lbs/day ²	0.12	0.25	--	--
Zinc, Total Recoverable ⁸	µg/L	47 ⁸	95 ⁸	--	--
	lbs/day ²	0.90	1.8	--	--

¹ If only one sample is collected during the operating season in May, then this result may be included in the June monthly average.

- 2 Mass based effluent limitations calculated using the following formula based on an average daily
flow of 2.3 MGD: $(\text{lbs/day}) = 2.3 \text{ MGD} \times 8.34 \times \text{effluent limitation (mg/L)}$
- 3 The Temperature must not be greater than 86°F at any time. In addition, the maximum
temperature of the discharge shall not exceed the natural receiving water temperature by more
than 20°F.
- 4 The geometric mean density of total coliform organisms shall be less than 1,000 per 100 ml (10
per ml): provided that not more than 20% of the samples, in any 30-day period, may exceed
1,000 per 100 ml (10 per ml), and provided further that no single sample when verified by a
repeat sample taken within 48 hours shall exceed 10,000 per 100 ml (100 per ml). Also, the total
coliform density shall not exceed 1,000 per 100 ml if the ratio of fecal to total coliform exceeds
0.1.
- 5 The geometric mean values should be calculated based on a statistically sufficient number of
samples (generally not less than 5 samples equally spaced over a 30-day period). If any of the
single sample limits are exceeded, the Regional Water Board may require repeat sampling on a
daily basis until the sample falls below the single sample limit in order to determine the
persistence of the exceedance. When repeat sampling is required because of an exceedance of
any one single sample limit, values from all samples collected during that 30-day period shall be
used to calculate the geometric mean.
- 6 The fecal coliform density for any 30-day period, shall not exceed a geometric mean of 200 per
100 ml (2 per ml) and provided that no single sample when verified by a repeat sample taken
within 48 hours shall exceed 400 per 100 ml (4 per ml) nor shall more than 10% of the total
samples during any 60-day period exceed 400 per 100 ml.
- 7 The geometric mean enterococcus density of the discharge shall not exceed 35 organisms per
100 ml for a 30-day period, nor more than 12 organisms per 100 ml for a 6-month period. and
provided that no single sample when verified by a repeat sample taken within 48 hours shall
exceed 104 per ml.
- 8 If the influent water pollutant concentration (measured at influent to the lagoon) does not exceed the
average monthly limitation then the limitations are applied as noted in the Table. If the influent water
pollutant concentration exceeds the average monthly limitation but does not exceed the maximum
daily limitation then compliance with the average monthly limitation will be determined based on intake
water credits and compliance with the maximum daily limitation is applied as noted in the Table. If the
influent water pollutant concentration exceeds the maximum daily limitation then compliance with both
the average monthly and the maximum daily will be determined based on intake water credits.
- When determining compliance based on intake water credit, the pollutant effluent limitation is equal
to the maximum pollutant concentration in the influent water. The equation is as follows:
- Pollutant Effluent Limitation with Intake Water Credit = Maximum Pollutant Influent Water
Concentration
- If the concentration limitation is based on intake credits; the associated mass limitation must be
calculated using the equation in footnote 2 above.
- b. Ammonia. Total un-ionized ammonia (NH₃) water quality objectives of 0.035
mg/L for the 4-day average and 0.233 mg/L for the 1-hour average. These
values are to be translated utilizing the implementation procedure included in
Resolution No. 2004-022 which revised the saltwater ammonia water quality
objectives in the 1994 Basin Plan.

The implementation procedure requires:

- (a). Determine the downstream applicable water quality objectives for ammonia
for the receiving water immediately downstream of the discharge (utilize the

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Determination of Freshwater, Brackish Water, or Saltwater Conditions included in the Implementation section of Resolution No. 2004-022).

(b). Since there is no mixing zone established:

$$ECA = WQO$$

(c). To adjust the un-ionized saltwater ammonia objective to an ECA expressed as total ammonia, the following equation shall be used:

$$[NH_4^+] + [NH_3] = [NH_3] + NH_3 \cdot 10^{(pK_a^s + 0.0324 (298 - T) + 0.0415 P/T - pH)}$$

Where: $P = 1 \text{ atm}$

$T = \text{temperature } (^{\circ}\text{K})$

$pK_a^s = 0.116 \cdot i + 9.245$, the stoichiometric acid hydrolysis constant of ammonium ions in saltwater based on i

$i = 19.9273 S (1000 - 1.005109 S)^{-1}$, the molal ionic strength of saltwater based on S

$S = \text{salinity}$

(Per USEPA Ambient Water Quality Criteria for Ammonia (Saltwater) – 1989)

- c. The acute toxicity of the effluent shall be such that:
- the average survival in the undiluted effluent for any three (3) consecutive 96-hour static or continuous flow bioassay test shall be at least 90%, and
 - no single test producing less than 70% survival. Compliance with the toxicity objectives will be determined by the method described in Section V of the MRP (Attachment E).
- d. The chronic toxicity of the effluent shall not exceed the monthly median trigger of 1.0 TUc in a critical life stage test. The monthly median trigger of 1.0 TUc for chronic toxicity is based on *USEPA Regions 9 & 10 Guidance for Implementing Whole Effluent Toxicity (WET) Programs* Final May 31, 1996. It is not an effluent limitation. However, if the effluent exceeds 1.0 TUc, the Discharger shall immediately implement accelerated chronic toxicity testing, as required in section V of the MRP (Attachment E).

B. Land Discharge Specifications

Not Applicable

C. Reclamation Specifications

Not Applicable

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

V. RECEIVING WATER LIMITATIONS

A. Surface Water Limitation

Receiving water limitations are based on water quality objectives contained in the Basin Plan and are a required part of this Order. The discharge shall not cause the following in King Harbor:

1. The normal ambient pH to fall below 6.5 nor exceed 8.5 units nor vary from normal ambient pH levels by more than 0.2 units.
2. Surface water temperature to rise greater than 5°F above the natural temperature of the receiving waters at any time or place.
3. Water Contact Standards

- a. State/Regional Water Board Water Contact Standards:

In marine water designated for water contact recreation (REC-1), the waste discharged shall not cause the following bacterial standards to be exceeded in the receiving water:

Geometric Mean Limits

- i. Total coliform density shall not exceed 1,000/100 ml.
- ii. Fecal coliform density shall not exceed 200/100 ml.
- iii. Enterococcus density shall not exceed 35/100 ml.

Single Sample Maximum (SSM) Limits

- i. Total coliform density shall not exceed 10,000/100 ml.
- ii. Fecal coliform density shall not exceed 400/100 ml.
- iii. Enterococcus density shall not exceed 104/100 ml.
- iv. Total coliform density shall not exceed 1,000/100 ml, when the fecal coliform/total coliform ratio exceeds 0.1.

4. Depress the concentration of dissolved oxygen to fall below 5.0 mg/L anytime, and the median dissolved oxygen concentration for any three consecutive months shall not be less than 80 percent of the dissolved oxygen content at saturation.
5. Exceed total ammonia (as N) concentrations specified in the Regional Water Board Resolution No. 2004-022. Resolution No. 2004-022 revised the ammonia water quality objectives for inland surface waters not characteristic of freshwater in the 1994 Basin Plan, to be consistent with USEPA's *"Ambient Water Quality Criteria for Ammonia (Saltwater) – 1989."* Adopted on March 4, 2004, Resolution No. 2004-022 was approved by State Water Board, Office of Administrative Law (OAL) and USEPA on July 22, 2004, September 14, 2004, and May 19, 2005, respectively and is now in effect.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

6. The presence of visible, floating, suspended or deposited macroscopic particulate matter or foam.
7. Oils, greases, waxes, or other materials in concentrations that result in a visible film or coating on the surface of the receiving water or on objects in the water.
8. Suspended or settleable materials, chemical substances or pesticides in amounts that cause nuisance or adversely affect any designated beneficial use.
9. Toxic or other deleterious substances in concentrations or quantities which cause deleterious effects on aquatic biota, wildlife, or waterfowl or render any of these unfit for human consumption either at levels created in the receiving waters or as a result of biological concentration.
10. Accumulation of bottom deposits or aquatic growths.
11. Biostimulatory substances at concentrations that promote aquatic growth to the extent that such growth causes nuisance or adversely affects beneficial uses.
12. The presence of substances that result in increases of BOD that adversely affect beneficial uses.
13. Taste or odor-producing substances in concentrations that alter the natural taste, odor, and/or color of fish, shellfish, or other edible aquatic resources; cause nuisance; or adversely affect beneficial uses.
14. Alteration of turbidity, or apparent color beyond present natural background levels.
15. Damage, discolor, nor cause formation of sludge deposits on flood control structures or facilities nor overload the design capacity.
16. Degrade surface water communities and populations including vertebrate, invertebrate, and plant species.
17. Problems associated with breeding of mosquitoes, gnats, black flies, midges, or other pests.
18. Create nuisance, or adversely effect beneficial uses of the receiving water.
19. Violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or State Water Board. If more stringent applicable water quality standards are promulgated or approved pursuant to section 303 of the CWA, or amendments thereto, the Regional Water Board will revise or modify this Order in accordance with such standards.

B. Groundwater Limitations

Not Applicable

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

VI. PROVISIONS

A. Standard Provisions

1. Federal Standard Provisions. The Discharger shall comply with all Standard Provisions included in Attachment D of this Order.
2. Regional Water Board Standard Provisions. The Discharger shall comply with the following provisions:
 - a. This Order may be modified, revoked, reissued, or terminated in accordance with the provisions of sections 122.44, 122.62, 122.63, 122.64, 125.62 and 125.64. Causes for taking such actions include, but are not limited to: failure to comply with any condition of this Order; endangerment to human health or the environment resulting from the permitted activity; or acquisition of newly-obtained information which would have justified the application of different conditions if known at the time of Order adoption. The filing of a request by the Discharger for an Order modification, revocation, and issuance or termination, or a notification of planned changes or anticipated noncompliance does not stay any condition of this Order.
 - b. The Discharger must comply with the lawful requirements of municipalities, counties, drainage districts, and other local agencies regarding discharges of storm water to storm drain systems or other water courses under their jurisdiction; including applicable requirements in municipal storm water management program developed to comply with NPDES permits issued by the Regional Water Board to local agencies.
 - c. Discharge of wastes to any point other than specifically described in this Order and permit is prohibited and constitutes a violation thereof.
 - d. The Discharger shall comply with all applicable effluent limitations, national standards of performance, toxic effluent standards, and all federal regulations established pursuant to sections 301, 302, 303(d), 304, 306, 307, 316, 318, 405, and 423 of the Federal CWA and amendments thereto.
 - e. These requirements do not exempt the operator of the waste disposal facility from compliance with any other laws, regulations, or ordinances which may be applicable; they do not legalize this waste disposal facility, and they leave unaffected any further restraints on the disposal of wastes at this site which may be contained in other statutes or required by other agencies.
 - f. Oil or oily material, chemicals, refuse, or other pollutionable materials shall not be stored or deposited in areas where they may be picked up by rainfall and carried off of the property and/or discharged to surface waters. Any such spill of such materials shall be contained and removed immediately.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- g. A copy of these waste discharge specifications shall be maintained at the discharge facility so as to be available at all times to operating personnel.
- h. After notice and opportunity for a hearing, this Order may be terminated or modified for cause, including, but not limited to:
 - i. Violation of any term or condition contained in this Order;
 - ii. Obtaining this Order by misrepresentation, or failure to disclose all relevant facts;
 - iii. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.
- i. If there is any storage of hazardous or toxic materials or hydrocarbons at this facility and if the facility is not manned at all times, a 24-hour emergency response telephone number shall be prominently posted where it can easily be read from the outside.
- j. The Discharger shall notify the Regional Water Board not later than 120 days in advance of implementation of any plans to alter production capacity of the product line of the manufacturing, producing or processing facility by more than ten percent. Such notification shall include estimates of proposed production rate, the type of process, and projected effects on effluent quality. Notification shall include submittal of a new report of waste discharge appropriate filing fee.
- k. The Discharger shall file with the Regional Water Board a report of waste discharge at least 120 days before making any material change or proposed change in the character, location or volume of the discharge.
- l. All existing manufacturing, commercial, mining, and silvicultural dischargers must notify the Regional Water Board as soon as they know or have reason to believe that they have begun or expect to begin to use or manufacture intermediate or final product or byproduct of any toxic pollutant that was not reported on their application.
- m. In the event of any change in name, ownership, or control of these waste disposal facilities, the discharger shall notify this Regional Water Board of such change and shall notify the succeeding owner or operator of the existence of this Order by letter, copy of which shall be forwarded to the Regional Water Board.
- n. The Water Code provides that any person who violates a waste discharge requirement or a provision of the Water Code is subject to civil penalties of up to \$5,000 per day, \$10,000 per day, or \$25,000 per day of violation, or when the violation involves the discharge of pollutants, is subject to civil penalties of up to \$10 per gallon per day or \$25 per gallon per day of violation; or some combination thereof, depending on the violation, or upon the combination of violations.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Violation of any of the provisions of the NPDES program or of any of the provisions of this Order may subject the violator to any of the penalties described herein, or any combination thereof, at the discretion of the prosecuting authority; except that only one kind of penalty may be applied for each kind of violation.

- o. The discharge of any product registered under the Federal Insecticide, Fungicide, and Rodenticide Act to any waste stream which may ultimately be released to waters of the United States, is prohibited unless specifically authorized elsewhere in this permit or another NPDES permit. This requirement is not applicable to products used for lawn and agricultural purposes.
- p. The discharge of any waste resulting from the combustion of toxic or hazardous wastes to any waste stream that ultimately discharges to waters of the United States is prohibited, unless specifically authorized elsewhere in this permit.
- q. The Discharger shall notify the Executive Officer in writing no later than 6 months prior to the planned discharge of any chemical, other than the products previously reported to the Executive Officer, which may be toxic to aquatic life. Such notification shall include:
 - i. Name and general composition of the chemical,
 - ii. Frequency of use,
 - iii. Quantities to be used,
 - iv. Proposed discharge concentrations, and
 - v. USEPA registration number, if applicable.
- r. Failure to comply with provisions or requirements of this Order, or violation of other applicable laws or regulations governing discharges from this facility, may subject the Discharger to administrative or civil liabilities, criminal penalties, and/or other enforcement remedies to ensure compliance. Additionally, certain violations may subject the Discharger to civil or criminal enforcement from appropriate local, state, or federal law enforcement entities.
- s. In the event the Discharger does not comply or will be unable to comply for any reason, with any prohibition, maximum daily effluent limitation, monthly average limitation, median, geometric mean, instantaneous limitation, or receiving water limitation of this Order, the Discharger shall notify the Regional Water Board by telephone (213) 620-6375 within 24 hours of having knowledge of such noncompliance, and shall confirm this notification in writing within five days, unless the Regional Water Board waives confirmation. The written notification shall state the nature, time, duration, and cause of noncompliance, and shall describe the measures being taken to remedy the current noncompliance and, prevent recurrence including, where applicable, a schedule of implementation.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Other noncompliance requires written notification as above at the time of the normal monitoring report.

- t. Prior to making any change in the point of discharge, place of use, or purpose of use of treated wastewater that results in a decrease of flow in any portion of a watercourse, the Discharger must file a petition with the State Water Board, Division of Water Rights, and receive approval for such a change. (Wat. Code § 1211.)

B. Monitoring and Reporting Program (MRP) Requirements

The Discharger shall comply with the MRP, and future revisions thereto, in Attachment E of this Order.

C. Special Provisions

1. Reopener Provisions

- a. If more stringent applicable water quality standards are promulgated or approved pursuant to Section 303 of the Federal CWA, and amendments thereto, the Regional Water Board will revise and modify this Order in accordance with such more stringent standards.
- b. This Order may be reopened to include effluent limitations for toxic constituents determined to be present in significant amounts in the discharge through a more comprehensive monitoring program included as part of this Order and based on the results of the RPA.
- c. This Order may be reopened on or before the end of 1st Quarter of 2013 (March 31, 2013), if the Special Study results necessitates changes to the permit.
- d. This Order may be reopened and modified, in accordance with the provisions set forth in 40 CFR Parts 122 and 124, to include requirements for the implementation of the watershed management approach or to include new MLs.
- e. This Order may be reopened upon submission by the Discharger of adequate information, as determined by the Regional Water Board, to provide for dilution credits or a mixing zone, as may be appropriate.
- f. This Order may be reopened for modification, or revocation and reissuance, as a result of the detection of a reportable priority pollutant generated by special conditions included in this Order. These special conditions may be, but are not limited to, fish tissue sampling, whole effluent toxicity, monitoring requirements on internal waste stream(s), and monitoring for surrogate parameters. Additional requirements may be included in this Order as a result of the special condition monitoring data.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. Work Plan for Special Study

a. The City will submit a Work Plan by February 7, 2011, for approval by the Executive Officer of the Regional Water Board. The objectives of the Work Plan are to design a study to:

- develop and implement an accelerated monitoring program (weekly sampling, at a minimum) for metals in the influent and effluent,
- refine sampling protocols (grab vs. composite),
- refine data collection points,
- refine data collection timing and other logistics in order to have the best data set for determining reasonable potential, intake credits and other permit provisions,
- examine sampling and laboratory protocols to insure adequate QA/QC.

3. Special Studies, Technical Reports and Additional Monitoring Requirements

- a. Chronic Toxicity Trigger and Monitoring Requirements: The Order contains a chronic toxicity trigger defined as an exceedance of 1.0 TUc in a critical life stage test for 100% effluent. The Discharger shall monitor the effluent once per year for chronic toxicity. If the effluent chronic toxicity exceeds 1.0 TUc (defined in Section V.A of the Monitoring and Reporting Program, Attachment E), the Discharger shall immediately implement accelerated chronic toxicity testing, as required in Section V of the Monitoring and Reporting Program, Attachment E).
- b. Initial Investigation Toxicity Reduction Evaluation (TRE) Workplan. The Discharger shall submit to the Regional Water Board an Initial Investigation Toxicity Reduction Evaluation (TRE) workplan (1-2 pages) within 90 days of the effective date of this permit. This plan shall describe the steps the permittee intends to follow in the event that toxicity is detected, and should include at a minimum:
- i. A description of the investigation and evaluation techniques that will be used to identify potential causes/sources of toxicity, effluent variability, and treatment system efficiency;
 - ii. A description of the facility's method of maximizing in-house treatment efficiency and good housekeeping practices, and a list of all chemicals used in operation of the facility;
 - iii. If a toxicity identification evaluation (TIE) is necessary, an indication of the person who would conduct the TIEs (i.e., an in-house expert or an outside contractor) (Section V of the MRP, Attachment E) provides references for the guidance manuals that should be used for performing TIEs).

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

4. Best Management Practices and Pollution Prevention

a. Best Management Practice Plan (BMPP)

Within 90 days of the effective date of this permit, the Discharger is required to submit a Best Management Practice Plan (BMPP) to the Regional Water Board. The BMPP should contain at least the following: statement of BMP policy, cleaning and maintenance procedures, schedules of activities, prohibited practices, treatment methods, and employee training. The Discharger shall report on the status and progress of the BMPP annually, in accordance with the specification discussed in section IX.A of the MRP, Attachment E.

5. Construction, Operation and Maintenance Specifications

- a. The Discharger shall at all times properly operate and maintain all facilities and systems installed or used to achieve compliance with this Order.

6. Other Special Provisions

Not Applicable

7. Compliance Schedules

Not Applicable

VII. COMPLIANCE DETERMINATION

Compliance with the effluent limitations contained in section IV of this Order will be determined as specified below:

A. Single Constituent Effluent Limitation.

If the concentration of the pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reported Minimum Level (see Reporting Requirement I.G. of the MRP), then the Discharger is out of compliance.

B. Mass-based Effluent Limitations.

In calculating mass emission rates from the monthly average concentrations, use one half of the method detection limit for "Not Detected" (ND) and the estimated concentration for "Detected, but Not Quantified" (DNQ) for the calculation of the monthly average concentration. To be consistent with Limitations and Discharge Requirements, Section VII.B, if all pollutants belonging to the same group are reported as ND or DNQ, the sum of the individual pollutant concentrations should be considered as zero for the calculation of the monthly average concentration.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

C. Multiple Sample Data.

When determining compliance with an MDEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of “Detected, but Not Quantified” (DNQ) or “Not Detected” (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:

1. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
2. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.

D. Average Monthly Effluent Limitation (AMEL).

If the average (or when applicable, the median determined by subsection E above for multiple sample data) of daily discharges over a calendar month exceeds the AMEL for a given parameter, this will represent a single violation, though the Discharger will be considered out of compliance for each day of that month for that parameter (e.g., resulting in 31 days of non-compliance in a 31-day month). If only a single sample is taken during the calendar month and the analytical result for that sample exceeds the AMEL, the Discharger will be considered out of compliance for that calendar month. For any one calendar month during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar month.

In determining compliance with the AMEL, the following provisions shall also apply to all constituents:

1. If the analytical result of a single sample, monitored monthly, quarterly, semiannually, or annually, does not exceed the AMEL for that constituent, the Discharger has demonstrated compliance with the AMEL for that month;
2. If the analytical result of a single sample, monitored monthly, quarterly, semiannually, or annually, exceeds the AMEL for any constituent, the Discharger shall collect four additional samples at approximately equal intervals during the month. All five analytical results shall be reported in the monitoring report for that month, or 45 days after results for the additional samples were received, whichever is later.

When all sample results are greater than or equal to the reported Minimum Level (see Reporting Requirement I.G. of the MRP), the numerical average of the analytical results of these five samples will be used for compliance determination.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

When one or more sample results are reported as “Not-Detected (ND)” or “Detected, but Not Quantified (DNQ)” (see Reporting Requirement I.G. of the MRP), the median value of these four samples shall be used for compliance determination. If one or both of the middle values is ND or DNQ, the median shall be the lower of the two middle values.

3. In the event of noncompliance with an AMEL, the sampling frequency for that constituent shall be increased to weekly and shall continue at this level until compliance with the AMEL has been demonstrated.
4. If only one sample was obtained for the month or more than a monthly period and the result exceeds the AMEL, then the Discharger is in violation of the AMEL.

E. Maximum Daily Effluent Limitations (MDEL).

If a daily discharge exceeds the MDEL for a given parameter, an alleged violation will be flagged and the discharger will be considered out of compliance for that parameter for that 1 day only within the reporting period. For any 1 day during which no sample is taken, no compliance determination can be made for that day.

F. Instantaneous Minimum Effluent Limitation.

If the analytical result of a single grab sample is lower than the instantaneous minimum effluent limitation for a parameter, a violation will be flagged and the discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both are lower than the instantaneous minimum effluent limitation would result in two instances of non-compliance with the instantaneous minimum effluent limitation).

G. Instantaneous Maximum Effluent Limitation.

If the analytical result of a single grab sample is higher than the instantaneous maximum effluent limitation for a parameter, a violation will be flagged and the discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both exceed the instantaneous maximum effluent limitation would result in two instances of non-compliance with the instantaneous maximum effluent limitation).

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT A – DEFINITIONS

Arithmetic Mean (μ)

Also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

Arithmetic mean = $\mu = \Sigma x / n$ where: Σx is the sum of the measured ambient water concentrations, and n is the number of samples.

Average Monthly Effluent Limitation (AMEL)

The highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

Average Weekly Effluent Limitation (AWEL)

The highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

Bioaccumulative

Those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

Carcinogenic

Pollutants are substances that are known to cause cancer in living organisms.

Coefficient of Variation (CV)

CV is a measure of the data variability and is calculated as the estimated standard deviation divided by the arithmetic mean of the observed values.

Daily Discharge

Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of one day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

For composite sampling, if 1 day is defined as a 24-hour period other than a calendar day, the analytical result for the 24-hour period will be considered as the result for the calendar day in which the 24-hour period ends.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Detected, but Not Quantified (DNQ)

DNQ are those sample results less than the RL, but greater than or equal to the laboratory's MDL.

Dilution Credit

Dilution Credit is the amount of dilution granted to a discharge in the calculation of a water quality-based effluent limitation, based on the allowance of a specified mixing zone. It is calculated from the dilution ratio or determined through conducting a mixing zone study or modeling of the discharge and receiving water.

Effluent Concentration Allowance (ECA)

ECA is a value derived from the water quality criterion/objective, dilution credit, and ambient background concentration that is used, in conjunction with the coefficient of variation for the effluent monitoring data, to calculate a long-term average (LTA) discharge concentration. The ECA has the same meaning as waste load allocation (WLA) as used in USEPA guidance (Technical Support Document For Water Quality-based Toxics Control, March 1991, second printing, EPA/505/2-90-001).

Enclosed Bays

Enclosed Bays means indentations along the coast that enclose an area of oceanic water within distinct headlands or harbor works. Enclosed bays include all bays where the narrowest distance between the headlands or outermost harbor works is less than 75 percent of the greatest dimension of the enclosed portion of the bay. Enclosed bays include, but are not limited to, Humboldt Bay, Bodega Harbor, Tomales Bay, Drake's Estero, San Francisco Bay, Morro Bay, Los Angeles-Long Beach Harbor, Upper and Lower Newport Bay, Mission Bay, and San Diego Bay. Enclosed bays do not include inland surface waters or ocean waters.

Estimated Chemical Concentration

The estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

Estuaries

Estuaries means waters, including coastal lagoons, located at the mouths of streams that serve as areas of mixing for fresh and ocean waters. Coastal lagoons and mouths of streams that are temporarily separated from the ocean by sandbars shall be considered estuaries. Estuarine waters shall be considered to extend from a bay or the open ocean to a point upstream where there is no significant mixing of fresh water and seawater. Estuarine waters included, but are not limited to, the Sacramento-San Joaquin Delta, as defined in Water Code section 12220, Suisun Bay, Carquinez Strait downstream to the Carquinez Bridge, and appropriate areas of the Smith, Mad, Eel, Noyo, Russian, Klamath, San Diego, and Otay rivers. Estuaries do not include inland surface waters or ocean waters.

Inland Surface Waters

All surface waters of the State that do not include the ocean, enclosed bays, or estuaries.

Instantaneous Maximum Effluent Limitation

The highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Instantaneous Minimum Effluent Limitation

The lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

Maximum Daily Effluent Limitation (MDEL)

The highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

Median

The middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of measurements (n) is odd, then the median = $X_{(n+1)/2}$. If n is even, then the median = $(X_{n/2} + X_{(n/2)+1})/2$ (i.e., the midpoint between the $n/2$ and $n/2+1$).

Method Detection Limit (MDL)

MDL is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero, as defined in title 40 of the Code of Federal Regulations, Part 136, Attachment B, revised as of July 3, 1999.

Minimum Level (ML)

ML is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

Mixing Zone

Mixing Zone is a limited volume of receiving water that is allocated for mixing with a wastewater discharge where water quality criteria can be exceeded without causing adverse effects to the overall water body.

Not Detected (ND)

Sample results which are less than the laboratory's MDL.

Ocean Waters

The territorial marine waters of the State as defined by California law to the extent these waters are outside of enclosed bays, estuaries, and coastal lagoons. Discharges to ocean waters are regulated in accordance with the State Water Board's California Ocean Plan.

Persistent Pollutants

Persistent pollutants are substances for which degradation or decomposition in the environment is nonexistent or very slow.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Pollutant Minimization Program (PMP)

PMP means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Regional Water Board may consider cost effectiveness when establishing the requirements of a PMP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to Water Code section 13263.3(d), shall be considered to fulfill the PMP requirements.

Pollution Prevention

Pollution Prevention means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as defined in Water Code section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the State or Regional Water Board.

Reporting Level (RL)

RL is the ML (and its associated analytical method) chosen by the Discharger for reporting and compliance determination from the MLs included in this Order. The MLs included in this Order correspond to approved analytical methods for reporting a sample result that are selected by the Regional Water Board either from Appendix 4 of the SIP in accordance with section 2.4.2 of the SIP or established in accordance with section 2.4.3 of the SIP. The ML is based on the proper application of method-based analytical procedures for sample preparation and the absence of any matrix interferences. Other factors may be applied to the ML depending on the specific sample preparation steps employed. For example, the treatment typically applied in cases where there are matrix-effects is to dilute the sample or sample aliquot by a factor of ten. In such cases, this additional factor must be applied to the ML in the computation of the RL.

Satellite Collection System

The portion, if any, of a sanitary sewer system owned or operated by a different public agency than the agency that owns and operates the wastewater treatment facility that a sanitary sewer system is tributary to.

Source of Drinking Water

Any water designated as municipal or domestic supply (MUN) in a Regional Water Board Basin Plan.

Standard Deviation (σ)

Standard Deviation is a measure of variability that is calculated as follows:

$$\sigma = (\sum[(x - \mu)^2]/(n - 1))^{0.5}$$

where:

x is the observed value;

μ is the arithmetic mean of the observed values; and

n is the number of samples.

Toxicity Reduction Evaluation (TRE)

TRE is a study conducted in a step-wise process designed to identify the causative agents of effluent or ambient toxicity, isolate the sources of toxicity, evaluate the effectiveness of toxicity control options, and then confirm the reduction in toxicity. The first steps of the TRE consist of the collection of data relevant to the toxicity, including additional toxicity testing, and an evaluation of facility operations and maintenance practices, and best management practices. A Toxicity Identification Evaluation (TIE) may be required as part of the TRE, if appropriate. (A TIE is a set of procedures to identify the specific chemical(s) responsible for toxicity. These procedures are performed in three phases (characterization, identification, and confirmation) using aquatic organism toxicity tests.)

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ACRONYMS AND ABBREVIATIONS

AMEL	Average Monthly Effluent Limitation
B	Background Concentration
BAT	Best Available Technology Economically Achievable
Basin Plan	<i>Water Quality Control Plan for the Coastal Watersheds of Los Angeles and Ventura Counties</i>
BCT	Best Conventional Pollutant Control Technology
BMP	Best Management Practices
BMPPP	Best Management Practices Plan
BPJ	Best Professional Judgment
BOD	Biochemical Oxygen Demand 5-day @ 20 °C
BPT	Best Practicable Treatment Control Technology
C	Water Quality Objective
CCR	California Code of Regulations
CEQA	California Environmental Quality Act
CFR	Code of Federal Regulations
CTR	California Toxics Rule
CV	Coefficient of Variation
CWA	Clean Water Act
CWC	California Water Code
Discharger	City of Redondo Beach
DMR	Discharge Monitoring Report
DNQ	Detected But Not Quantified
ELAP	California Department of Health Services Environmental Laboratory Accreditation Program
ELG	Effluent Limitations, Guidelines and Standards
Facility	Seaside Lagoon
gpd	gallons per day
IC	Inhibition Coefficient
IC ₁₅	Concentration at which the organism is 15% inhibited
IC ₂₅	Concentration at which the organism is 25% inhibited
IC ₄₀	Concentration at which the organism is 40% inhibited
IC ₅₀	Concentration at which the organism is 50% inhibited
LA	Load Allocations
LOEC	Lowest Observed Effect Concentration
µg/L	micrograms per Liter
mg/L	milligrams per Liter
MDEL	Maximum Daily Effluent Limitation
MEC	Maximum Effluent Concentration
MGD	Million Gallons Per Day
ML	Minimum Level
MRP	Monitoring and Reporting Program
ND	Not Detected
NOEC	No Observable Effect Concentration
NPDES	National Pollutant Discharge Elimination System
NSPS	New Source Performance Standards

R
E
V
I
S
E
D


T
E
N
T
A
T
I
V
E

NTR	National Toxics Rule
OAL	Office of Administrative Law
PMEL	Proposed Maximum Daily Effluent Limitation
PMP	Pollutant Minimization Plan
POTW	Publicly Owned Treatment Works
QA	Quality Assurance
QA/QC	Quality Assurance/Quality Control
Ocean Plan	<i>Water Quality Control Plan for Ocean Waters of California</i>
Regional Water Board	California Regional Water Quality Control Board, Los Angeles Region
RPA	Reasonable Potential Analysis
SCP	Spill Contingency Plan
SIP	State Implementation Policy (<i>Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California</i>)
SMR	Self Monitoring Reports
State Water Board	California State Water Resources Control Board
SWPPP	Storm Water Pollution Prevention Plan
TAC	Test Acceptability Criteria
Thermal Plan	<i>Water Quality Control Plan for Control of Temperature in the Coastal and Interstate Water and Enclosed Bays and Estuaries of California</i>
TIE	Toxicity Identification Evaluation
TMDL	Total Maximum Daily Load
TOC	Total Organic Carbon
TRE	Toxicity Reduction Evaluation
TSD	Technical Support Document
TSS	Total Suspended Solid
TU _c	Chronic Toxicity Unit
USEPA	United States Environmental Protection Agency
WDR	Waste Discharge Requirements
WET	Whole Effluent Toxicity
WLA	Waste Load Allocations
WQBELs	Water Quality-Based Effluent Limitations
WQS	Water Quality Standards
%	Percent

R
E
V
I
S
E
D


T
E
N
T
A
T
I
V
E

ATTACHMENT B – MAP

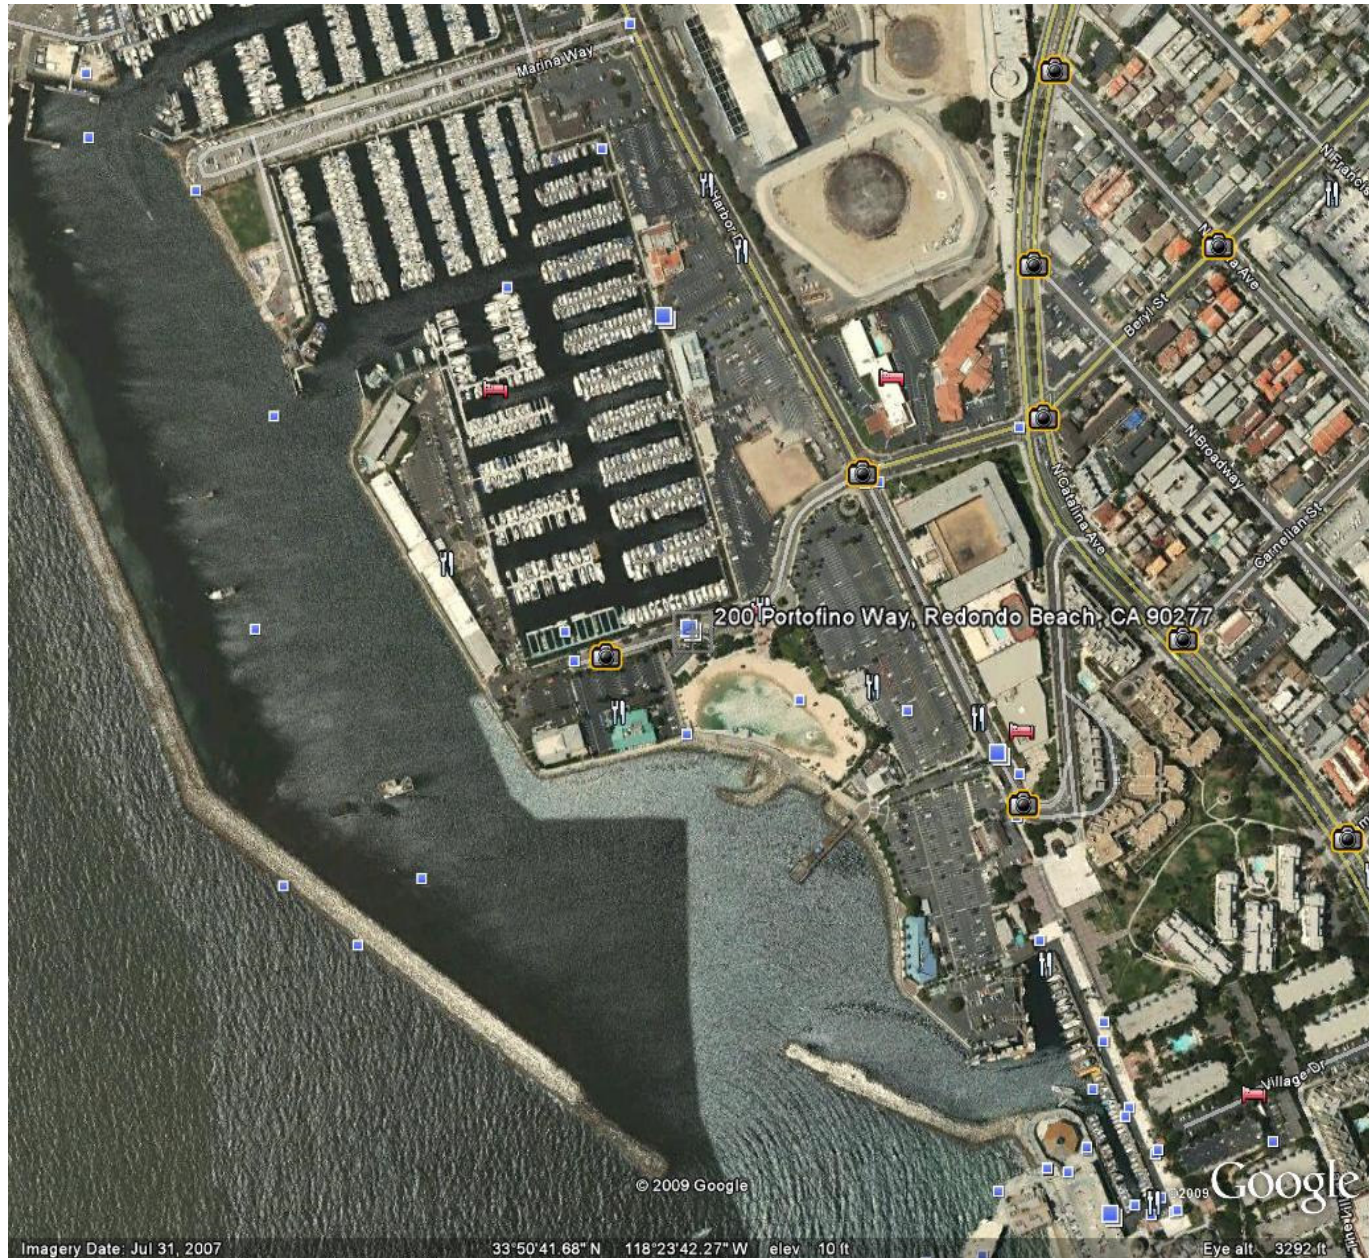

REVISED
TENTATIVE


ATTACHMENT C – FLOW SCHEMATIC

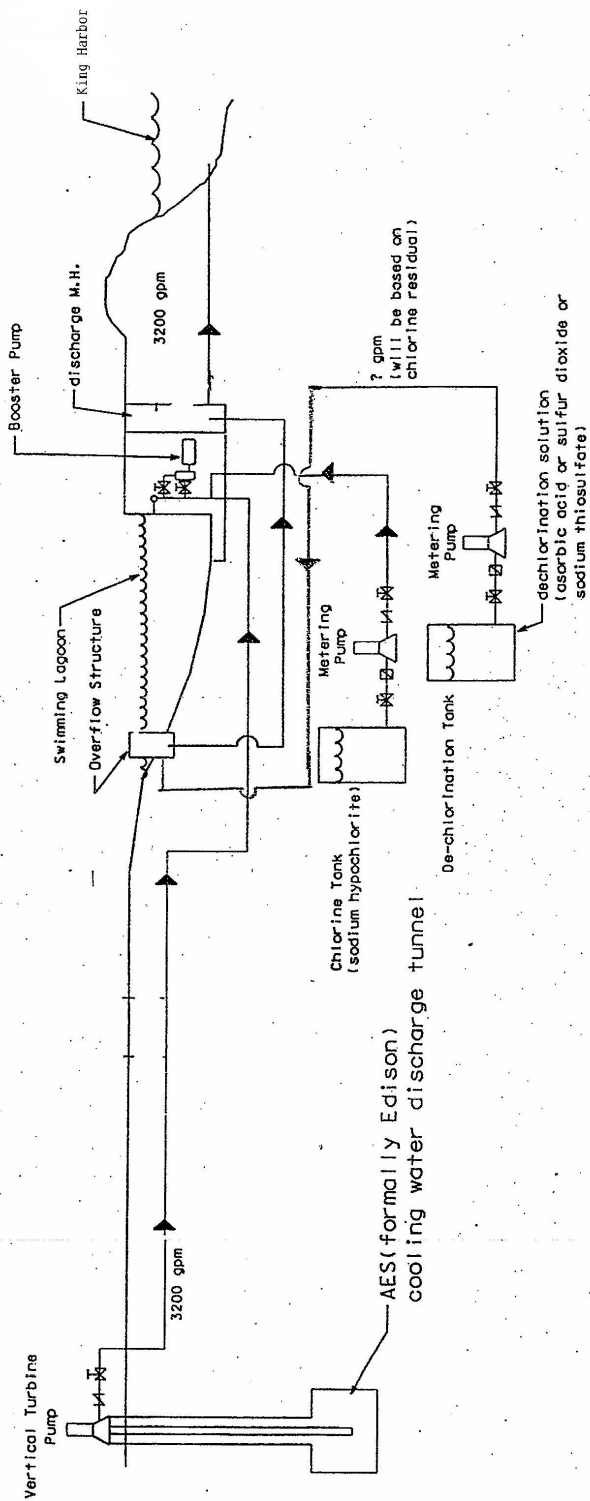

PUMPING SYSTEM SCHEMATIC DIAGRAM

Attachment B

REVISED TENTATIVE

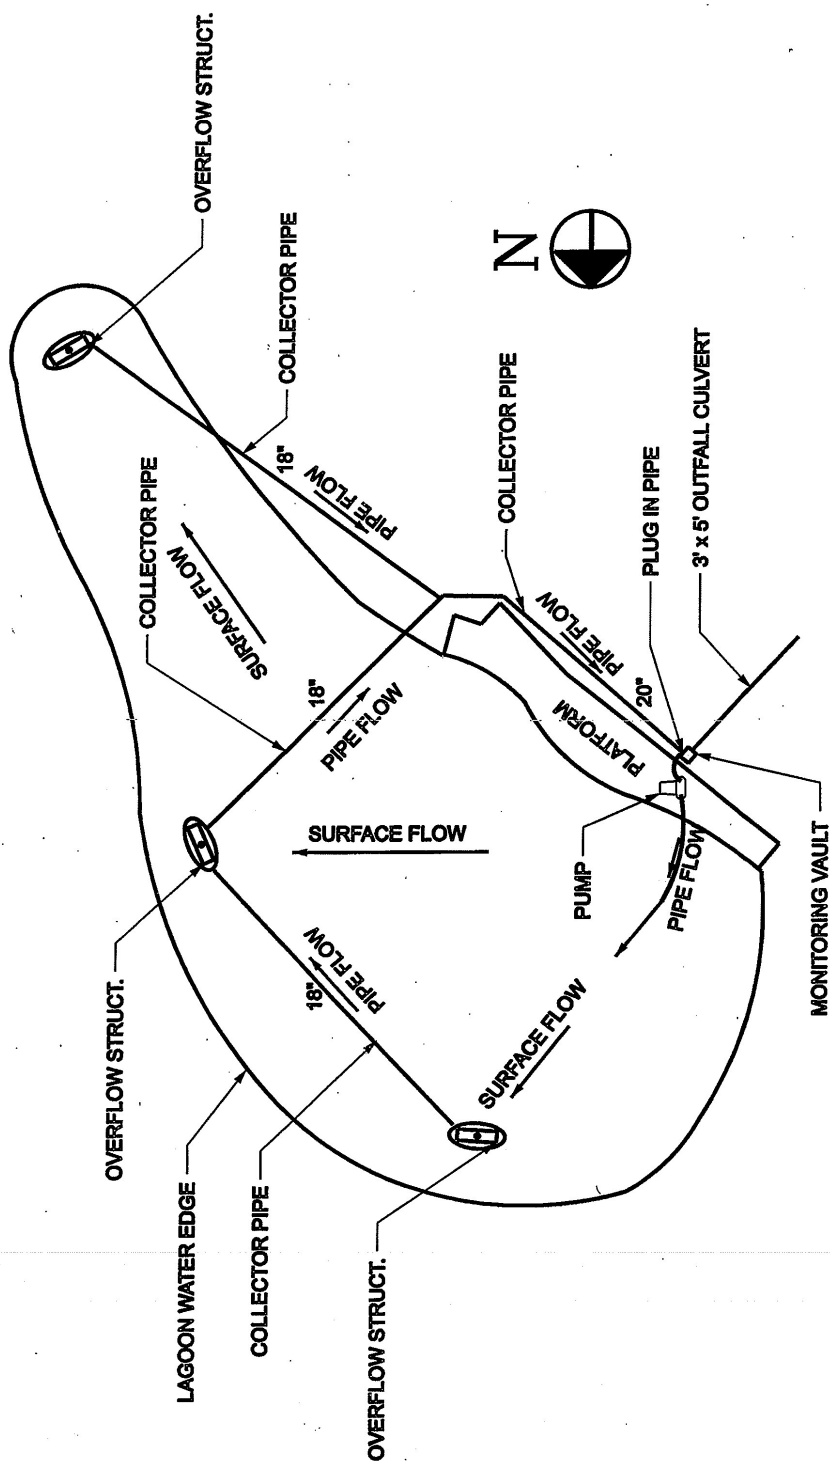

COLLECTOR PIPE RE-CIRCULATION PLAN

Attachment C

REVISED
TENTATIVE

ATTACHMENT D – STANDARD PROVISIONS

I. STANDARD PROVISIONS – PERMIT COMPLIANCE

A. Duty to Comply

1. The Discharger must comply with all of the conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code and is grounds for enforcement action, for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application [section 122.41(a)].
2. The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants and with standards for sewage sludge use or disposal established under Section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement [section 122.41(a)(1)].

B. Need to Halt or Reduce Activity Not a Defense

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order [section 122.41(c)].

C. Duty to Mitigate

The Discharger shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment [section 122.41(d)].

D. Proper Operation and Maintenance

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order [section 122.41(e)].

E. Property Rights

1. This Order does not convey any property rights of any sort or any exclusive privileges [section 122.41(g)].

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of state or local law or regulations [section 122.5(c)].

F. Inspection and Entry

The Discharger shall allow the Regional Water Board, State Water Board, United States Environmental Protection Agency (USEPA), and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to [section 122.41(i)] [Water Code section 13383]:

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order [section 122.41(i)(1)];
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order [section 122.41(i)(2)];
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order [section 122.41(i)(3)]; and
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the Water Code, any substances or parameters at any location [section 122.41(i)(4)].

G. Bypass

1. Definitions
 - i. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility [section 122.41(m)(1)(i)].
 - ii. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production [section 122.41(m)(1)(ii)].
2. Bypass not exceeding limitations. The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3, I.G.4, and I.G.5 below [section 122.41(m)(2)].

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

3. Prohibition of bypass. Bypass is prohibited, and the Regional Water Board may take enforcement action against a Discharger for bypass, unless [section 122.41(m)(4)(i)]:
 - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage [section 122.41(m)(4)(i)(A)];
 - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance [section 122.41(m)(4)(i)(B)]; and
 - c. The Discharger submitted notice to the Regional Water Board as required under Standard Provisions – Permit Compliance I.G.5 below [section 122.41(m)(4)(i)(C)].
4. The Regional Water Board may approve an anticipated bypass, after considering its adverse effects, if the Regional Water Board determines that it will meet the three conditions listed in Standard Provisions – Permit Compliance I.G.3 above [section 122.41(m)(4)(ii)].
5. Notice
 - a. Anticipated bypass. If the Discharger knows in advance of the need for a bypass, it shall submit a notice, if possible at least 10 days before the date of the bypass [section 122.41(m)(3)(i)].
 - b. Unanticipated bypass. The Discharger shall submit notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below (24-hour notice) [section 122.41(m)(3)(ii)].

H. Upset

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology-based permit effluent limitations because of factors beyond the reasonable control of the Discharger. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation [section 122.41(n)(1)].

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology-based permit effluent limitations if the requirements of Standard Provisions – Permit Compliance I.H.2 below are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review [section 122.41(n)(2)].

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that [section 122.41(n)(3)]:
 - a. An upset occurred and that the Discharger can identify the cause(s) of the upset [section 122.41(n)(3)(i)];
 - b. The permitted facility was, at the time, being properly operated [section 122.41(n)(3)(ii)];
 - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b below (24-hour notice) [section 122.41(n)(3)(iii)]; and
 - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above [section 122.41(n)(3)(iv)].
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof [section 122.41(n)(4)].

II. STANDARD PROVISIONS – PERMIT ACTION

A. General

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition [section 122.41(f)].

B. Duty to Reapply

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit [section 122.41(b)].

C. Transfers

This Order is not transferable to any person except after notice to the Regional Water Board. The Regional Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the Water Code [section 122.41(l)(3) and section 122.61].

III. STANDARD PROVISIONS – MONITORING

- A. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity [section 122.41(j)(1)].

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- B. Monitoring results must be conducted according to test procedures under Part 136 or, in the case of sludge use or disposal, approved under Part 136 unless otherwise specified in Part 503 unless other test procedures have been specified in this Order [section 122.41(j)(4) and section 122.44(i)(1)(iv)].

IV. STANDARD PROVISIONS – RECORDS

- A. Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by Part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Regional Water Board Executive Officer at any time [section 122.41(j)(2)].

- B. Records of monitoring information shall include:

1. The date, exact place, and time of sampling or measurements [section 122.41(j)(3)(i)];
2. The individual(s) who performed the sampling or measurements [section 122.41(j)(3)(ii)];
3. The date(s) analyses were performed [section 122.41(j)(3)(iii)];
4. The individual(s) who performed the analyses [section 122.41(j)(3)(iv)];
5. The analytical techniques or methods used [section 122.41(j)(3)(v)]; and
6. The results of such analyses [section 122.41(j)(3)(vi)].

- C. Claims of confidentiality for the following information will be denied [section 122.7(b)]:

1. The name and address of any permit applicant or Discharger [section 122.7(b)(1)]; and
2. Permit applications and attachments, permits and effluent data [section 122.7(b)(2)].

V. STANDARD PROVISIONS – REPORTING

- A. Duty to Provide Information

The Discharger shall furnish to the Regional Water Board, State Water Board, or USEPA within a reasonable time, any information which the Regional Water Board, State Water Board, or USEPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Regional Water

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Board, State Water Board, or USEPA copies of records required to be kept by this Order [section 122.41(h)] [Water Code section 13267].

B. Signatory and Certification Requirements

1. All applications, reports, or information submitted to the Regional Water Board, State Water Board, and/or USEPA shall be signed and certified in accordance with Standard Provisions – Reporting V.B.2, V.B.3, V.B.4, and V.B.5 below [section 122.41(k)].
2. All permit applications shall be signed by either a principal executive officer or ranking elected official. For purposes of this provision, a principal executive officer of a federal agency includes: (i) the chief executive officer of the agency, or (ii) a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., Regional Administrators of USEPA) [section 122.22(a)(3)].
3. All reports required by this Order and other information requested by the Regional Water Board, State Water Board, or USEPA shall be signed by a person described in Standard Provisions – Reporting V.B.2 above, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by a person described in Standard Provisions – Reporting V.B.2 above [section 122.22(b)(1)];
 - b. The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.) [section 122.22(b)(2)]; and
 - c. The written authorization is submitted to the Regional Water Board and State Water Board [section 122.22(b)(3)].
4. If an authorization under Standard Provisions – Reporting V.B.3 above is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Standard Provisions – Reporting V.B.3 above must be submitted to the Regional Water Board and State Water Board prior to or together with any reports, information, or applications, to be signed by an authorized representative [section 122.22(c)].
5. Any person signing a document under Standard Provisions – Reporting V.B.2 or V.B.3 above shall make the following certification:

“I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.” [section 122.22(d)].

C. Monitoring Reports

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program (Attachment E) in this Order [section 122.22(l)(4)].
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Regional Water Board or State Water Board for reporting results of monitoring of sludge use or disposal practices [section 122.41(l)(4)(i)].
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under Part 136 or, in the case of sludge use or disposal, approved under Part 136 unless otherwise specified in Part 503, or as specified in this Order, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Regional Water Board [section 122.41(l)(4)(ii)].
4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order [section 122.41(l)(4)(iii)].

D. Compliance Schedules

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date [section 122.41(l)(5)].

E. Twenty-Four Hour Reporting

1. The Discharger shall report any noncompliance that may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the Discharger becomes aware of the circumstances. A written submission shall also be provided within five (5) days of the time the Discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance [section 122.41(l)(6)(i)].
2. The following shall be included as information that must be reported within 24 hours under this paragraph [section 122.41(l)(6)(ii)]:

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- a. Any unanticipated bypass that exceeds any effluent limitation in this Order [section 122.41(l)(6)(ii)(A)].
 - b. Any upset that exceeds any effluent limitation in this Order [section 122.41(l)(6)(ii)(B)].
3. The Regional Water Board may waive the above-required written report under this provision on a case-by-case basis if an oral report has been received within 24 hours [section 122.41(l)(6)(iii)].

F. Planned Changes

The Discharger shall give notice to the Regional Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when [section 122.41(l)(1)]:

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in section 122.29(b) [section 122.41(l)(1)(i)]; or
2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are not subject to effluent limitations in this Order [section 122.41(l)(1)(ii)].

The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are subject neither to effluent limitations in this Order nor to notification requirements under section 122.42(a)(1) (see Additional Provisions—Notification Levels VII.A.1) [section 122.41(l)(1)(ii)].

G. Anticipated Noncompliance

The Discharger shall give advance notice to the Regional Water Board or State Water Board of any planned changes in the permitted facility or activity that may result in noncompliance with General Order requirements [section 122.41(l)(2)].

H. Other Noncompliance

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting V.C, V.D, and V.E above at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E above [section 122.41(l)(7)].

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

I. Other Information

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Regional Water Board, State Water Board, or USEPA, the Discharger shall promptly submit such facts or information [section 122.41(l)(8)].

VI. STANDARD PROVISIONS – ENFORCEMENT

- A.** The Regional Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13385, 13386, and 13387.
- B.** The CWA provides that any person who violates section 301, 302, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any such sections in a permit issued under section 402, or any requirement imposed in a pretreatment program approved under sections 402(a)(3) or 402(b)(8) of the Act, is subject to a civil penalty not to exceed \$25,000 per day for each violation. The CWA provides that any person who negligently violates sections 301, 302, 306, 307, 308, 318, or 405 of the Act, or any condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, or any requirement imposed in a pretreatment program approved under section 402(a)(3) or 402(b)(8) of the Act, is subject to criminal penalties of \$2,500 to \$25,000 per day of violation, or imprisonment of not more than one (1) year, or both. In the case of a second or subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation, or by imprisonment of not more than two (2) years, or both. Any person who knowingly violates such sections, or such conditions or limitations is subject to criminal penalties of \$5,000 to \$50,000 per day of violation, or imprisonment for not more than three (3) years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than six (6) years, or both. Any person who knowingly violates section 301, 302, 303, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine of not more than \$250,000 or imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the CWA, shall, upon conviction of violating the imminent danger provision, be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions [section 122.41(a)(2)] [Water Code sections 13385 and 13387].
- C.** Any person may be assessed an administrative penalty by the Regional Water Board for violating section 301, 302, 306, 307, 308, 318 or 405 of this Act, or any permit

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

condition or limitation implementing any of such sections in a permit issued under section 402 of this Act. Administrative penalties for Class I violations are not to exceed \$10,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$25,000. Penalties for Class II violations are not to exceed \$10,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$125,000 [section 122.41(a)(3)].

- D. The CWA provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this permit shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than 2 years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than 4 years, or both [section 122.41(j)(5)].
- E. The CWA provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this Order, including monitoring reports or reports of compliance or noncompliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six months per violation, or by both [section 122.41(k)(2)].

VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS

A. Non-Municipal Facilities

Existing manufacturing, commercial, mining, and silvicultural Dischargers shall notify the Regional Water Board as soon as they know or have reason to believe [section 122.42(a)]:

1. That any activity has occurred or will occur that would result in the discharge, on a routine or frequent basis, of any toxic pollutant that is not limited in this Order, if that discharge will exceed the highest of the following "notification levels" [section 122.42(a)(1)]:
 - a. 100 micrograms per liter (µg/L) [section 122.42(a)(1)(i)];
 - b. 200 µg/L for acrolein and acrylonitrile; 500 µg/L for 2,4-dinitrophenol and 2-methyl-4,6-dinitrophenol; and 1 milligram per liter (mg/L) for antimony [section 122.42(a)(1)(ii)];
 - c. Five (5) times the maximum concentration value reported for that pollutant in the Report of Waste Discharge [section 122.42(a)(1)(iii)]; or
 - d. The level established by the Regional Water Board in accordance with section 122.44(f) [section 122.42(a)(1)(iv)].

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. That any activity has occurred or will occur that would result in the discharge, on a non-routine or infrequent basis, of any toxic pollutant that is not limited in this Order, if that discharge will exceed the highest of the following "notification levels" [section 122.42(a)(2)]:
 - a. 500 micrograms per liter ($\mu\text{g/L}$) [section 122.42(a)(2)(i)];
 - b. 1 milligram per liter (mg/L) for antimony [section 122.42(a)(2)(ii)];
 - c. Ten (10) times the maximum concentration value reported for that pollutant in the Report of Waste Discharge [section 122.42(a)(2)(iii)]; or
 - d. The level established by the Regional Water Board in accordance with section 122.44(f) [section 122.42(a)(2)(iv)].

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP NO. 8034)

Table of Contents

I.	General Monitoring Provisions.....	E-2
II.	Monitoring Locations	E-5
III.	Influent Monitoring Requirements.....	E-6
IV.	Effluent Monitoring Requirements	E-7
	A. Monitoring Location – Discharge Point No. 001	E-7
V.	Work Plan – Monitoring Requirements	E-11
VI.	Whole Effluent Toxicity Testing Requirements	E-12
	A. Definition of Toxicity.....	E-12
	B. Acute Toxicity Effluent Monitoring Program	E-13
	C. Chronic Toxicity Effluent Monitoring Program	E-13
	D. Quality Assurance.....	E-14
	E. Accelerated Monitoring and Initial Investigation TRE Trigger	E-14
	F. Toxicity Reduction Evaluation (TRE)/Toxicity Identification Eval.(TIE) Trigger	E-15
	G. Steps in TRE and TIE Procedures.....	E-15
	H. Ammonia Removal.....	E-17
	I. Reporting	E-17
VII.	Land Discharge Monitoring Requirements	E-19
VIII.	Reclamation Monitoring Requirements.....	E-19
IX.	Receiving Water Monitoring Requirements – Surface Water and Groundwater	E-19
	A. Monitoring Location – RSW-001	E-19
X.	Other Monitoring Requirements.....	E-21
	A. BMPP Status and Effectiveness Report.....	E-21
XI.	Reporting Requirements.....	E-21
	A. General Monitoring and Reporting Requirements.....	E-21
	B. Self Monitoring Reports (SMRs)	E-22
	C. Discharge Monitoring Reports (DMRs)	E-24
	D. Other Reports	E-25

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

List of Tables

Table E-1.	Monitoring Station Locations.....	E-5
Table E-2.	Influent Monitoring – Regular Season (Memorial Day to Labor Day)	E-6
Table E-3.	Influent Monitoring – Off Season.....	E-6
Table E-4.	Effluent Monitoring – Regular Season (Memorial Day to Labor Day).....	E-7
Table E-5.	Effluent Monitoring – Off-Season	E-10
Table E-6.	Work Plan – Influent and Effluent Monitoring – 2011 and 2012 Regular Season .. (Memorial Day to Labor Day)	E-12
Table E-7.	Receiving Water Monitoring Requirements	E-19
Table E-8.	Monitoring Periods and Reporting Schedule.....	E-22

ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP) NO. 8034

The Code of Federal Regulations (CFR) Section 122.48 requires that all NPDES permits specify monitoring and reporting requirements. Water Code Sections 13267 and 13383 also authorize the Regional Water Quality Control Board (Regional Water Board) to require technical and monitoring reports. This MRP establishes monitoring and reporting requirements, which implement the federal and California regulations.

I. GENERAL MONITORING PROVISIONS

- A. An effluent sampling station shall be established for the point of discharge (Discharge Point No. 001 Latitude 33°50'38", Longitude 118°23'41") and shall be located where representative samples of that effluent can be obtained. The existing sample collection location, is tidally influenced. Sampling should be conducted when there is a discharge and during low tide conditions based on data provided by the National Oceanic and Atmospheric Administration's (NOAA), Station No. 9410840 (Santa Monica, CA). (During high tide conditions, the sampling vault would be almost completely inundated with sea water and the effluent pipe would be completely submerged. Therefore, the grab samples during high tide may not be representative of the effluent.)
- B. Effluent samples shall be taken downstream of any addition to treatment works and prior to mixing with the receiving waters.
- C. The Regional Water Board shall be notified in writing of any change in the sampling stations once established or in the methods for determining the quantities of pollutants in the individual waste streams.
- D. Pollutants shall be analyzed using the analytical methods described in sections 136.3, 136.4, and 136.5 (revised March 12, 2007); or, where no methods are specified for a given pollutant, by methods approved by this Regional Water Board or the State Water Resources Control Board (State Water Board). Laboratories analyzing effluent samples and receiving water samples shall be certified by the California Department of Public Health Environmental Laboratory Accreditation Program (ELAP) or approved by the Executive Officer and must include quality assurance/quality control (QA/QC) data in their reports. A copy of the laboratory certification shall be provided each time a new certification and/or renewal of the certification is obtained from ELAP.
- E. For any analyses performed for which no procedure is specified in the United States Environmental Protection Agency (USEPA) guidelines or in the MRP, the constituent or parameter analyzed and the method or procedure used must be specified in the monitoring report.
- F. Each monitoring report must affirm in writing that "all analyses were conducted at a laboratory certified for such analyses by the Department of Public Health or approved by the Executive Officer and in accordance with current USEPA guideline procedures or as specified in this MRP".

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

G. The monitoring reports shall specify the analytical method used, the Method Detection Limit (MDL), and the Minimum Level (ML) for each pollutant. For the purpose of reporting compliance with numerical limitations, performance goals, and receiving water limitations, analytical data shall be reported by one of the following methods, as appropriate:

1. An actual numerical value for sample results greater than or equal to the ML; or
2. "Detected, but Not Quantified (DNQ)" if results are greater than or equal to the laboratory's MDL but less than the ML; or,
3. "Not-Detected (ND)" for sample results less than the laboratory's MDL with the MDL indicated for the analytical method used.

Analytical data reported as "less than" for the purpose of reporting compliance with permit limitations shall be the same or lower than the permit limit(s) established for the given parameter.

Current MLs (Attachment G) are those published by the State Water Board in the Policy for the Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California, February 24, 2005.

H. Where possible, the MLs employed for effluent analyses shall be lower than the permit limitations established for a given parameter. If the ML value is not below the effluent limitation, then the lowest ML value and its associated analytical method shall be selected for compliance purposes. At least once a year, the Discharger shall submit a list of the analytical methods employed for each test and associated laboratory QA/QC procedures.

The Regional Water Board, in consultation with the State Water Board Quality Assurance Program, shall establish a ML that is not contained in Attachment G to be included in the Discharger's permit in any of the following situations:

1. When the pollutant under consideration is not included in Attachment G;
2. When the Discharger and Regional Water Board agree to include in the permit a test method that is more sensitive than that specified in 40 CFR Part 136 (revised March 12, 2007);
3. When the Discharger agrees to use an ML that is lower than that listed in Attachment G;
4. When the Discharger demonstrates that the calibration standard matrix is sufficiently different from that used to establish the ML in Attachment G, and proposes an appropriate ML for their matrix; or,

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

5. When the Discharger uses a method whose quantification practices are not consistent with the definition of an ML. Examples of such methods are the USEPA-approved method 1613 for dioxins and furans, method 1624 for volatile organic substances, and method 1625 for semi-volatile organic substances. In such cases, the Discharger, the Regional Water Board, and the State Water Board shall agree on a lowest quantifiable limit and that limit will substitute for the ML for reporting and compliance determination purposes.
- I. Water/wastewater samples must be analyzed within allowable holding time limits as specified in section 136.3. All QA/QC items must be run on the same dates the samples were actually analyzed, and the results shall be reported in the Regional Water Board format, when it becomes available, and submitted with the laboratory reports. Proper chain of custody procedures must be followed, and a copy of the chain of custody shall be submitted with the report.
- J. All analyses shall be accompanied by the chain of custody, including but not limited to data and time of sampling, sample identification, and name of person who performed sampling, date of analysis, name of person who performed analysis, QA/QC data, method detection limits, analytical methods, copy of laboratory certification, and a perjury statement executed by the person responsible for the laboratory.
- K. The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments and to insure accuracy of measurements, or shall insure that both equipment activities will be conducted.
- L. The Discharger shall have, and implement, an acceptable written quality assurance (QA) plan for laboratory analyses. The annual monitoring report required in Section X.D.3 shall also summarize the QA activities for the previous year. Duplicate chemical analyses must be conducted on a minimum of ten percent (10%) of the samples, or at least one sample per sampling period, whichever is greater. A similar frequency shall be maintained for analyzing spiked samples.
- M. When requested by the Regional Water Board or USEPA, the Discharger will participate in the NPDES discharge monitoring report QA performance study. The Discharger must have a success rate equal to or greater than 80%.
- N. For parameters that both average monthly and daily maximum limits are specified and the monitoring frequency is less than four times a month, the following shall apply. If an analytical result is greater than the average monthly limit, the Discharger shall collect four additional samples at approximately equal intervals during the month, until compliance with the average monthly limit has been demonstrated. All five analytical results shall be reported in the monitoring report for that month, or 45 days after results for the additional samples were received, whichever is later. In the event of noncompliance with an average monthly effluent limitation, the sampling frequency for that constituent shall be increased to weekly and shall continue at this level until compliance with the average monthly effluent limitation has been demonstrated. The

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Discharger shall provide for the approval of the Executive Officer a program to ensure future compliance with the average monthly limit.

O. In the event wastes are transported to a different disposal site during the report period, the following shall be reported in the monitoring report:

1. Types of wastes and quantity of each type;
2. Name and address for each hauler of wastes (or method of transport if other than by hauling); and
3. Location of the final point(s) of disposal for each type of waste.

If no wastes are transported off-site during the reporting period, a statement to that effect shall be submitted.

P. Each monitoring report shall state whether or not there was any change in the discharge as described in the Order during the reporting period.

Q. Laboratories analyzing monitoring samples shall be certified by the Department of Public Health, in accordance with the provision of Water Code section 13176, and must include quality assurance/quality control data with their reports.

II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

Table E-1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description (include Latitude and Longitude when available)
--	INF-001	Shall be located at the entrance of the intake water to the lagoon.
Discharge Point No. 001	EFF-001	Discharge manhole before contact with King Harbor, prior to mixing with receiving water (latitude 33° 50' 38" N, longitude 118° 23' 41" W)
--	RSW-001	A location within 50 feet from the discharge point, outside the influence of the discharge, in King Harbor.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

III. INFLUENT MONITORING REQUIREMENTS**Table E-2. Influent Monitoring – Regular Season (Memorial Day to Labor Day)**

Parameter	Units	Sample Type	Minimum Sampling Frequency ¹	Required Analytical Test Method
Total Suspended Solids (TSS)	mg/l	Grab	1/Week	²
Antimony, Total Recoverable	µg/L	Grab	1/Month	²
Arsenic, Total Recoverable	µg/L	Grab	1/Month	²
Cadmium, Total Recoverable	µg/L	Grab	1/Month	²
Copper, Total Recoverable	µg/L	Grab	1/Month	²
Nickel, Total Recoverable	µg/L	Grab	1/Month	²
Selenium, Total Recoverable	µg/L	Grab	1/Month	²
Silver, Total Recoverable	µg/L	Grab	1/Month	²
Thallium, Total Recoverable	µg/L	Grab	1/Month	²
Zinc, Total Recoverable	µg/L	Grab	1/Month	²

- Two influent samples shall be collected at the specified frequency and should be representative of the intake water for the period sampled. The first influent sample shall be collected two hours prior to the effluent sample. The second influent sample shall be collected at approximately the same time as the effluent sample.
- Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136; for priority pollutants. The methods must meet the lowest minimum levels (MLs) specified in Attachment 4 of the SIP, provided as Attachment G.

Table E-3. Influent Monitoring – Off Season

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Total Suspended Solids (TSS)	mg/l	Grab	1/Discharge ²	¹
Antimony, Total Recoverable	µg/L	Grab	1/Discharge ²	¹
Arsenic, Total Recoverable	µg/L	Grab	1/Discharge ²	¹

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Cadmium, Total Recoverable	µg/L	Grab	1/Discharge ²	¹
Copper, Total Recoverable	µg/L	Grab	1/Discharge ²	¹
Nickel, Total Recoverable	µg/L	Grab	1/Discharge ²	¹
Selenium, Total Recoverable	µg/L	Grab	1/Discharge ²	¹
Silver, Total Recoverable	µg/L	Grab	1/Discharge ²	¹
Thallium, Total Recoverable	µg/L	Grab	1/Discharge ²	¹
Zinc, Total Recoverable	µg/L	Grab	1/Discharge ²	¹

1. Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136; for priority pollutants. The methods must meet the lowest minimum levels (MLs) specified in Attachment 4 of the SIP, provided as Attachment G
2. Not more than one sample per week shall be collected.

IV. EFFLUENT MONITORING REQUIREMENTS

A. Monitoring Location – Discharge Point No. 001

1. The Discharger shall monitor dechlorinated wastewater at EFF-001 during discharge and low tide conditions as follows. If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding Minimum Level:

Table E-4. Effluent Monitoring – Regular Season (Memorial Day to Labor Day)

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Total Waste Flow	MGD	Estimated	1/Day	¹
pH	s.u.	Grab	1/Year	¹
Biochemical Oxygen Demand (BOD) (5-day @ 20 Deg. C) ³	mg/L	Grab	1/Month	¹
Total Suspended Solids (TSS) ³	mg/l	Grab	1/Week	¹
Oil and Grease ³	mg/L	Grab	1/Year	¹
Turbidity	NTU	Grab	1/Month	¹
Temperature	°F	Grab	1/Month	¹

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Chlorine, Total Residual ³	µg/l	Grab	1/Week	^{1, 2}
Ammonia ³	mg/L	Grab	1/Month	¹
Fecal Coliform	mpn/100 ml	Grab	1/Week ⁴	¹
Total Coliform	mpn/100 ml	Grab	1/Week ⁴	¹
Enterococcus	mpn/100 ml	Grab	1/Week ⁴	¹
Arsenic, Total Recoverable ³	µg/L	Grab	1/Month	¹
Cadmium, Total Recoverable ³	µg/L	Grab	1/Month	¹
Copper, Total Recoverable ³	µg/L	Grab	1/Month	¹
Nickel, Total Recoverable ³	µg/L	Grab	1/Month	¹
Selenium, Total Recoverable ³	µg/L	Grab	1/Month	¹
Silver, Total Recoverable ³	µg/L	Grab	1/Month	¹
Thallium, Total Recoverable ³	µg/L	Grab	1/Month	¹
Zinc, Total Recoverable	µg/L	Grab	1/Month	¹
TCDD – Equivalents ⁵	ng/L	Grab	1/Permit Term	¹
Remaining Priority Pollutants ⁶	µg/l	Grab	1/Year	¹
Acute Toxicity	% survival	Grab	1/Year	⁷
Chronic Toxicity	T.U. _c	Grab	1/Year	⁷

¹ Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136; for priority pollutants. The methods must meet the lowest minimum levels (MLs) specified in Attachment 4 of the SIP, provided as Attachment G. Where no methods are specified for a given pollutant, the methods must be approved by this Regional Water Board or the State Water Board.

² If there is no analytical method with a detection level below the effluent limitation, then the most sensitive method must be used. If the sample result is non-detect, the Discharger shall report the results as less than the method detection level and provide the actual detection level achieved.

³ The mass emission (lbs/day) for the discharges EFF-001 shall be calculated and reported using the limitation concentration and the actual flow rate measured at the time of discharge, using the formula:

$$m = 0.00834 \times C_e \times Q$$

where: m = mass discharge for a pollutant, lb/day

C_e = limitation concentration for a pollutant, µg/L

Q = actual discharge flow rate, mgd

R E V I S E D T E N T A T I V E

- 4 The geometric mean values should be calculated based on a statistically sufficient number of samples (generally not less than 5 samples equally spaced over a 30-day period). If any of the single sample limits are exceeded, the Regional Water Board may require repeat sampling on a daily basis until the sample falls below the single sample limit in order to determine the persistence of the exceedance. When repeat sampling is required because of an exceedance of any one single sample limit, values from all samples collected during that 30-day period shall be used to calculate the geometric mean.
- 5 The Discharger must monitor the effluent for the presence of the 17 congeners of 2,3,7,8-TCDD listed below, once over the term of the permit, as early as practical (i.e., discharge occurs) . To determining compliance with effluent limits or for conduction of Reasonable Potential Analysis, this Order requires the Discharger to calculate and report dioxin-toxicity equivalencies (TEQs) using the following formula, where the toxicity equivalency factors (TEFs) and bioaccumulation equivalency factor (BEF)BEFs are as listed in Table below:

$$\text{Dioxin-TEQ} = \sum(C_x \times \text{TEF}_x \times \text{BEF}_x)$$

Table: Toxicity Equivalency Factors and Bioaccumulation Equivalency Factors

Dioxin or Furan Congener	Toxicity Equivalency Factor (TEF)	Bioaccumulation Equivalency Factor (BEF)
2,3,7,8-tetra CDD	1.0	1.0
1,2,3,7,8-penta CDD	1.0	0.9
1,2,3,4,7,8-hexa CDD	0.1	0.3
1,2,3,6,7,8-hexa CDD	0.1	0.1
1,2,3,7,8,9-hexa CDD	0.1	0.1
1,2,3,4,6,7,8-hepta CDD	0.01	0.05
Octa CDD	0.0001	0.01
2,3,7,8-tetra CDF	0.1	0.8
1,2,3,7,8-penta CDF	0.05	0.2
1,2,3,4,7,8-hexa CDF	0.1	0.08
1,2,3,6,7,8-hexa CDF	0.1	0.2
1,2,3,7,8,9-hexa CDF	0.1	0.6
2,3,4,6,7,8-hexa CDF	0.1	0.7
1,2,3,4,6,7,8-hepta CDF	0.01	0.01
1,2,3,4,7,8,9-hepta CDF	0.01	0.4
Octa CDF	0.0001	0.02

where:

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

C_x = concentration of dioxin or furan congener x

TEF_x = TEF for congener x

BEF_x = BEF for congener x

6. Priority Pollutants as defined by California Toxics Rule (CTR) and included as Attachment H.
7. Acute and Chronic Toxicity monitoring requirements are described in section V of this Monitoring and Reporting Program.

Table E-5. Effluent Monitoring – Off-Season

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Total Waste Flow	MGD	Estimated	1/Day During Discharge	²
pH	S.U.	Grab	1/Discharge ¹	²
BOD (5-day @ 20 Deg. C) ³	mg/L	Grab	1/Discharge ¹	²
TSS ³	mg/l	Grab	1/Discharge ¹	²
Oil and Grease ³	mg/L	Grab	1/Discharge ¹	²
Turbidity	NTU	Grab	1/Discharge ¹	²
Temperature	°F	Grab	1/Discharge ¹	²
Chlorine, Total Residual ^{3,4}	µg/l	Grab	1/Discharge ¹	²
Fecal Coliform	mpn/100 ml	Grab	1/Discharge ¹	²
Total Coliform	mpn/100 ml	Grab	1/Discharge ¹	²
Enterococcus	mpn/100 ml	Grab	1/Discharge ¹	²
Ammonia ³	mg/L	Grab	1/Discharge ¹	²
Arsenic, Total Recoverable ³	µg/L	Grab	1/Discharge ¹	²
Cadmium, Total Recoverable ³	µg/L	Grab	1/Discharge ¹	²
Copper, Total Recoverable ³	µg/L	Grab	1/Discharge ¹	²
Nickel, Total Recoverable ³	µg/L	Grab	1/Discharge ¹	²
Selenium, Total Recoverable ³	µg/L	Grab	1/Discharge ¹	²
Silver, Total Recoverable ³	µg/L	Grab	1/Discharge ¹	²
Thallium, Total Recoverable ³	µg/L	Grab	1/Discharge ¹	²
Zinc, Total Recoverable ³	µg/L	Grab	1/Discharge ¹	²

¹ Not more than one sample per week shall be collected.

² Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136; for priority pollutants. The methods must meet the lowest minimum levels (MLs) specified in Attachment 4 of the SIP, provided as Attachment G. Where no methods are specified for a given pollutant, the methods must be approved by this Regional Water Board or the State Water Board.

³ The mass emission (lbs/day) for the discharges EFF-001 shall be calculated and reported using the limitation concentration and the actual flow rate measured at the time of discharge, using the formula:

$$m = 0.00834 \times C_e \times Q$$

where: m = mass discharge for a pollutant, lb/day
 C_e = limitation concentration for a pollutant, $\mu\text{g/L}$
 Q = actual discharge flow rate, mgd

⁴ If there is no analytical method with a detection level below the effluent limitation, then the most sensitive method must be used. If the sample result is non-detect, the Discharger shall report the results as less than the method detection level and provide the actual detection level achieved

V. Special Study – Monitoring Requirements

1. The City of Redondo Beach's Work Plan for Seaside Lagoon is due to the Regional Water Board on February 7, 2011, for Executive Officer approval. The objectives of the Work Plan are to design a study to:
 - develop and implement an accelerated monitoring program (weekly sampling, at a minimum) for metals in the influent and effluent,
 - refine sampling protocols (grab vs. composite),
 - refine data collection points,
 - refine data collection timing and other logistics in order to have the best data set for determining reasonable potential, intake credits and other permit provisions,
 - examine sampling and laboratory protocols to insure adequate QA/QC.
2. The first phase of the study should occur during the 2011 operating season.
3. In the Fall of 2011, City of Redondo Beach staff shall schedule a meeting with Regional Water Board staff to review and analyze the data. If the Regional Water Board staff determines that the data set is adequate, it will be used to re-evaluate reasonable potential, intake credits, etc. If the data set is not adequate then a second season of monitoring (Summer 2012) shall be planned and executed.
4. If the data indicates the inclusion of new limitation for the metals is warranted, the permit will be reopened to include them.

This permit includes a reopener for 1st Quarter of 2013 (March 31, 2013) at the latest, to address the results of the Special Study Monitoring.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

VI. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

A. Definition of Toxicity

1. Acute Toxicity.

Acute toxicity is a measure of primarily lethal effects that occur over a 96-hour period. Acute toxicity shall be measured in percent survival measured in undiluted (100%) effluent.

- a. The average survival in the undiluted effluent for any three (3) consecutive 96-hour static or continuous flow bioassay tests shall be at least 90%, and
- b. No single test shall produce less than 70% survival.

2. Chronic Toxicity.

Chronic toxicity measures a sublethal effect (e.g., reduced growth, reproduction) to experimental test organisms exposed to an effluent or ambient waters compared to that of the control organisms. Chronic toxicity shall be measured in TU_c , where $TU_c = 100/NOEC$. The No Observable Effect Concentration (NOEC) is expressed as the maximum percent effluent concentration that causes no observable effect on test organisms, as determined by the results of a critical life stage toxicity test.

- a. This Order includes a chronic testing toxicity trigger defined as an exceedance of 1.0 TU_c in a critical life stage test for 100% effluent. (The monthly median for chronic toxicity of 100% effluent shall not exceed, 1 TU_c in a critical life stage test.)

3. Accelerated Monitoring. If either of the above requirements is not met, the Discharger shall conduct six additional tests over a 6-week period. The Discharger shall ensure that they receive results of a failing toxicity test within 24 hours of the close of the test and the additional tests shall begin within 3 business days of the receipt of the result. If the additional tests indicate compliance with the toxicity limitation, the Discharger may resume regular testing. However, if the results of any two of the six accelerated tests are less than the stipulated requirements, then the Discharger shall begin a Toxicity Identification Evaluation (TIE). The TIE shall include all reasonable steps to identify the sources of toxicity. Once the sources are identified, the Discharger shall take all reasonable steps to reduce toxicity to meet the objective.

If the initial test and any of the additional six acute toxicity bioassay tests result in less than 60% survival, including the initial test, the Discharger shall immediately begin a TIE.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

B. Acute Toxicity Effluent Monitoring Program

1. Method. The Discharger shall conduct acute toxicity tests on 24-hour composite 100% effluent samples, generally by methods specified in 40 CFR Part 136 which cites USEPA's *Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms*, Fifth Edition, October 2002, USEPA, Office of Water, Washington D.C. (EPA/821/R-02/012) or a more recent edition to ensure compliance. Effluent samples shall be collected after all treatment processes and before discharge to the receiving water.
2. Test Species. The fathead minnow, *Pimephales promelas* (Acute Toxicity Test Method 2000.0), shall be used as the test species for fresh water discharges and the topsmelt, *Atherinops affinis*, shall be used as the test species for brackish effluent. However, if the salinity of the receiving water is between 1 to 32 parts per thousand (ppt), the Discharger may have the option of using the inland silverside, *Menidia beryllina* (Acute Toxicity Test Method 2006.0), instead of the topsmelt. The method for topsmelt (Larval Survival and Growth Test Method 1006.0) is found in USEPA's *Short-term Methods for Estimating the Chronic Toxicity of Effluent and Receiving Waters to West Coast Marine and Estuarine Organisms*, First Edition, August 1995 (EPA/600/R-95/136).
3. Alternate Reporting. For the acute toxicity testing with topsmelt, the Discharger may elect to report the results or endpoint from the first 96 hours of the chronic toxicity test as the results of the acute toxicity test, using USEPA's August 1995 method (EPA/600/R-95/136) to conduct the chronic toxicity test.
4. Acute Toxicity Accelerated Monitoring. If either of the above requirements (sections 1.a and 1.b) is not met, the Discharger shall conduct six additional tests, approximately every two weeks, over a 12-week period. The Discharger shall ensure that they receive results of a failing toxicity test within 24 hours of the close of the test and the additional tests shall begin within 5 business days of the receipt of the result. If the additional tests indicate compliance with the toxicity limitation, the Discharger may resume regular testing.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

C. Chronic Toxicity Effluent Monitoring Program

1. Effluent samples shall be collected after all treatment processes and before discharge to the receiving water.
2. Test Species and Methods:
 - a. The Discharger shall conduct critical life stage chronic toxicity tests on grab 100 % effluent samples in accordance with USEPA's *Short Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms*, Fourth Edition, October 2002 (EPA/21-R-02-013) or USEPA's *Short Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving*

Waters to Marine and Estuarine Organisms, Third Edition, October 2002, (EPA/821/R-02-014), or a more recent edition.

- b. The Discharger shall conduct tests as follows: with a vertebrate, an invertebrate, and a plant for the first three suites of tests. After the screening period, monitoring shall be conducted using the most sensitive species.
- c. Re-screening is required every 36 months. The Discharger shall re-screen with the three species listed above and continue to monitor with the most sensitive species. If the first suite of re-screening tests demonstrates that the same species is the most sensitive then re-screening does not need to include more than one suite of tests. If a different species is the most sensitive or if there is ambiguity then the Discharger shall proceed with suites of screening tests for a minimum of three, but not to exceed five suites.
- d. In brackish waters, the presence of chronic toxicity may be estimated as specified using West Coast marine organisms according to USEPA's *Short-Term Methods for Estimating Chronic Toxicity of Effluent and Receiving Waters to West Coast Marine and Estuarine Organisms*, August 1995 (EPA/600/R-95/136), or a more recent edition.

D. Quality Assurance

1. Concurrent testing with a reference toxicant shall be conducted. Reference toxicant tests shall be conducted using the same test conditions as the effluent toxicity tests (e.g., same test duration, etc).
2. If either the reference toxicant test or effluent test does not meet all test acceptability criteria (TAC) as specified in the test methods manuals (EPA/600/4-91/002 and EPA/821-R-02-014), then the Discharger must re-sample and re-test at the earliest time possible.
3. Control and dilution water should be receiving water or laboratory water, as appropriate, as described in the manual. If the dilution water used is different from the culture water, a second control using culture water shall be used.

E. Accelerated Monitoring and Initial Investigation TRE Trigger

1. If toxicity exceeds the limitations (as defined in section V.A.1, above), then the Discharger shall immediately implement accelerated testing, as specified in section V.A.2, above. The Discharger shall ensure that they receive results of a failing toxicity test within 24 hours of the completion of the test and the additional tests shall begin within 3 business days of receipt of the results or at the first opportunity of discharge. If the accelerated testing shows consistent toxicity, the Discharger shall immediately implement the Initial Investigation of the TRE Workplan.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. If implementation of the Initial Investigation TRE Workplan indicates the source of toxicity (e.g., temporary plant upset, etc.), then the Discharger may discontinue the TIE.
3. The first step in the Initial Investigation TRE Workplan for downstream receiving water toxicity can be a toxicity test protocol designed to determine if the effluent from Discharge Point No. 001 causes or contributes to the measured downstream acute toxicity. If this first step TRE testing shows that the Discharge Point No. 001 effluent does not cause or contribute to downstream acute toxicity, using USEPA's *Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms*, Fifth Edition, October 2002, USEPA, Office of Water, Washington D.C. (EPA/821-R-02-012) then a report on this testing shall be submitted to the Regional Water Board and the Initial Investigation TRE will be considered to be completed. Routine testing in accordance with the MRP shall be continued thereafter.

F. Toxicity Reduction Evaluation (TRE)/Toxicity Identification Evaluation (TIE) Trigger

1. If the accelerated testing shows consistent toxicity as defined below:
 - a. Acute Toxicity:
 - i. If the results of any two of the six accelerated tests are less than 90% survival, or
 - ii. If the initial test and any of the additional six acute toxicity bioassay tests result in less than 70% survival.
 - b. Chronic Toxicity
 - i. If the results of two of the six accelerated tests exceed 1.0 TU_c
- then, the Discharger shall immediately implement the TRE as described below.

G. Steps in TRE and TIE Procedures

1. Following a TRE trigger, the Discharger shall initiate a TRE in accordance with the facility's Initial Investigation TRE workplan. At a minimum, the Discharger shall use USEPA manuals EPA/600/2-88/070 (industrial) or EPA/833B-99/002 (municipal) as guidance. The Discharger shall expeditiously develop a more detailed TRE workplan for submittal to the Executive Officer within 30 days of the trigger, which will include, but not be limited to:
 - a. Further actions to investigate and identify the cause of toxicity;
 - b. Actions the Discharger will take to mitigate the impact of the discharge and prevent the recurrence of toxicity;

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- c. Standards the Discharger will apply to consider the TRE complete and to return to normal sampling frequency; and,
 - d. A schedule for these actions.
2. The following is a stepwise approach in conducting the TRE:
 - a. Step 1 - Basic data collection. Data collected for the accelerated monitoring requirements may be used to conduct the TRE;
 - b. Step 2 - Evaluates optimization of the treatment system operation, facility housekeeping, and the selection and use of in-plant process chemicals;
 - c. Step 3 – If Steps 1 and 2 are unsuccessful, Step 3 implements a Toxicity Identification Evaluation (TIE) by employing all reasonable efforts and using currently available TIE methodologies. The Discharger shall use the USEPA acute and chronic manuals, EPA/600/6-91/005F (Phase I)/EPA/600/R-96-054 (for marine), EPA/600/R-92/080 (Phase II), and EPA-600/R-92/081 (Phase III) as guidance. The objective of the TIE is to identify the substance or combination of substances causing the observed toxicity;
 - d. Step 4 – Assuming successful identification or characterization of the toxicant(s), Step 4 evaluates final effluent treatment options;
 - e. Step 5 evaluates in-plant treatment options; and,
 - f. Step 6 consists of confirmation once a toxicity control method has been implemented.

Many recommended TRE elements parallel source control, pollution prevention, and storm water control program best management practices (BMPs). To prevent duplication of efforts, evidence of implementation of these control measures may be sufficient to comply with TRE requirements. By requiring the first steps of a TRE to be accelerated testing and review of the facility's TRE workplan, a TRE may be ended in its early stages. All reasonable steps shall be taken to reduce toxicity to the required level. The TRE may be ended at any stage if monitoring indicates there is no longer toxicity (or six consecutive chronic toxicity test results are less than or equal to 1.0 TU_c or six consecutive acute toxicity test results are greater than 90% survival).

3. If a TRE/TIE is initiated prior to completion of the accelerated testing schedule required by this permit, then the accelerated testing schedule may be terminated, or used as necessary in performing the TRE/TIE, as determined by the Executive Officer.
 4. Toxicity tests conducted as part of a TRE/TIE may also be used for compliance determination, if appropriate.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

5. The Regional Water Board recognizes that toxicity may be episodic and identification of causes of and reduction of sources of toxicity may not be successful in all cases. Consideration of enforcement action by the Regional Water Board will be based in part on the Discharger's actions and efforts to identify and control or reduce sources of consistent toxicity.

H. Ammonia Removal

1. Except with prior approval from the Executive Officer of the Regional Water Board, ammonia shall not be removed from bioassay samples. The Discharger *must* demonstrate *the effluent toxicity is caused by ammonia because of* increasing test pH when conducting the toxicity test. It is important to distinguish the potential toxic effects of ammonia from other pH sensitive chemicals, such as certain heavy metals, sulfide, and cyanide. The following may be steps to demonstrate that the toxicity is caused by ammonia and not other toxicants before the Executive Officer would allow for control of pH in the test.
 - a. There is consistent toxicity in the effluent and the maximum pH in the toxicity test is in the range to cause toxicity due to increased pH.
 - b. Chronic ammonia concentrations in the effluent are greater than 4 mg/L total ammonia.
 - c. Conduct graduated pH tests as specified in the toxicity identification evaluation methods. For example, mortality should be higher at pH 8 and lower at pH 6.
 - d. Treat the effluent with a zeolite column to remove ammonia. Mortality in the zeolite treated effluent should be lower than the non-zeolite treated effluent. Then add ammonia back to the zeolite-treated samples to confirm toxicity due to ammonia.

When it has been demonstrated that toxicity is due to ammonia because of increasing test pH, pH may be controlled using appropriate procedures which do not significantly alter the nature of the effluent, after submitting a written request to the Regional Water Board, and receiving written permission expressing approval from the Executive Officer of the Regional Water Board.

I. Reporting

1. The Discharger shall submit a full report of the toxicity test results, including any accelerated testing conducted during the month as required by this permit. Test results shall be reported as % survival for acute toxicity test results and as TU_c for chronic toxicity test results with the self monitoring reports (SMR) for the month in which the test is conducted.
2. If an initial investigation indicates the source of toxicity and accelerated testing is unnecessary, then those results also shall be submitted with the SMR for the period in which the investigation occurred.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- a. The full report shall be submitted on or before the end of the month in which the SMR is submitted.
 - b. The full report shall consist of (1) the results; (2) the dates of sample collection and initiation of each toxicity test; (3) the acute toxicity average limit or chronic toxicity limit or trigger and (4) Printout of the ToxCalc or CETIS program results.
3. Test results for toxicity tests also shall be reported according to the appropriate manual chapter on Report Preparation and shall be attached to the SMR. Routine reporting shall include, at a minimum, as applicable, for each test:
- a. Sample date(s);
 - b. Test initiation date;
 - c. Test species;
 - d. End point values for each dilution (e.g., number of young, growth rate, percent survival);
 - e. NOEC value(s) in percent effluent;
 - f. IC_{15} , IC_{25} , IC_{40} and IC_{50} values in percent effluent;
 - g. TU_c values $\left(TU_c = \frac{100}{NOEC} \right)$;
 - h. Mean percent mortality (+standard deviation) after 96 hours in 100% effluent (if applicable);
 - i. NOEC and LOEC values for reference toxicant test(s);
 - j. IC_{25} value for reference toxicant test(s);
 - k. Any applicable charts; and
 - l. Available water quality measurements for each test (e.g., pH, D.O., temperature, conductivity, hardness, salinity, ammonia).
4. The Discharger shall provide a compliance summary, which includes a summary table of toxicity data from all samples collected during that year.

The Discharger shall notify by telephone or electronically, this Regional Water Board of any toxicity exceedance of the limit or trigger within 24 hours of receipt of the results followed by a written report within 14 calendar days of receipt of the results. The verbal or electronic notification shall include the exceedance and the plan the Discharger has taken or will take to investigate and correct the cause(s) of toxicity. It may also include a status report on any actions required by the permit, with a

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

schedule for actions not yet completed. If no actions have been taken, the reasons shall be given.

VII. LAND DISCHARGE MONITORING REQUIREMENTS

Not Applicable

VIII. RECLAMATION MONITORING REQUIREMENTS

Not Applicable

IX. RECEIVING WATER MONITORING REQUIREMENTS – SURFACE WATER AND GROUNDWATER

A. Monitoring Location – RSW-001

1. The Discharger shall monitor King Harbor at RSW-001 as follows:

Table E-7. Receiving Water Monitoring Requirements

Parameter	Units	Sample Type	Minimum Sampling Frequency ⁶	Required Analytical Test Method
pH	s.u.	Grab	1/Year	1,2
Hardness (as CaCO ₃)	mg/L	Grab	1/Year	1,2
Antimony, Total Recoverable	µg/L	Grab	1/Month	1
Arsenic, Total Recoverable	µg/L	Grab	1/Month	1
Cadmium, Total Recoverable	µg/L	Grab	1/Month	1
Copper, Total Recoverable	µg/L	Grab	1/Month	1
Nickel, Total Recoverable	µg/L	Grab	1/Month	1
Selenium, Total Recoverable	µg/L	Grab	1/Month	1
Silver, Total Recoverable	µg/L	Grab	1/Month	1
Thallium, Total Recoverable	µg/L	Grab	1/Month	1
Zinc, Total Recoverable	µg/L	Grab	1/Month	1
Salinity	g/L	Grab	1/Year	1,2
TSS	mg/L	Grab	1/Week ³	1
Turbidity	NTU	Grab	1/Month	1
Temperature	°F	Grab	1/Month	1,2
TCDD – Equivalents ⁴	ng/L	Grab	1/Permit Term	1

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Parameter	Units	Sample Type	Minimum Sampling Frequency ⁶	Required Analytical Test Method
Remaining Priority Pollutants ⁵	µg/L	Grab	1/Year	1,2

¹ Pollutants shall be analyzed using the analytical methods described in 40 CFR Part 136; for Priority Pollutants the methods must meet the lowest minimum levels (MLs) specified in Attachment 4 of the SIP, provided as Attachment G. Where no methods are specified for a given pollutant, the methods must be approved by this Regional Water Board or the State Water Board.

² Receiving water pH, salinity, and temperature must be analyzed at the same time the samples are collected for Priority Pollutants analysis and effluent temperature is measured.

³ During off season discharge, TSS is to be monitored at a frequency of 1/discharge, with a maximum frequency of 1/week during the operating season.

⁴ The Discharger must monitor the effluent and receiving water for the presence of the 17 congeners of 2,3,7,8-TCDD listed below, once over the term of the permit, as early as practical (i.e., discharge occurs) . To determining compliance with effluent limits or for conduction of Reasonable Potential Analysis, this Order requires the Discharger to calculate and report dioxin-toxicity equivalencies (TEQs) using the following formula, where the toxicity equivalency factors (TEFs) and bioaccumulation equivalency factor (BEF)BEFs are as listed in Table below:

$$\text{Dioxin-TEQ} = \sum(C_x \times \text{TEF}_x \times \text{BEF}_x)$$

Table: Toxicity Equivalency Factors and Bioaccumulation Equivalency Factors

Dioxin or Furan Congener	Toxicity Equivalency Factor (TEF)	Bioaccumulation Equivalency Factor (BEF)
2,3,7,8-tetra CDD	1.0	1.0
1,2,3,7,8-penta CDD	1.0	0.9
1,2,3,4,7,8-hexa CDD	0.1	0.3
1,2,3,6,7,8-hexa CDD	0.1	0.1
1,2,3,7,8,9-hexa CDD	0.1	0.1
1,2,3,4,6,7,8-hepta CDD	0.01	0.05
Octa CDD	0.0001	0.01
2,3,7,8-tetra CDF	0.1	0.8
1,2,3,7,8-penta CDF	0.05	0.2
1,2,3,4,7,8-hexa CDF	0.1	0.08
1,2,3,6,7,8-hexa CDF	0.1	0.2
1,2,3,7,8,9-hexa CDF	0.1	0.6

R E V I S E D T E N T A T I V E

Dioxin or Furan Congener	Toxicity Equivalency Factor (TEF)	Bioaccumulation Equivalency Factor (BEF)
2,3,4,6,7,8-hexa CDF	0.1	0.7
1,2,3,4,6,7,8-hepta CDF	0.01	0.01
1,2,3,4,7,8,9-hepta CDF	0.01	0.4
Octa CDF	0.0001	0.02

where:

C_x = concentration of dioxin or furan congener x

TEF_x = TEF for congener x

BEF_x = BEF for congener x

- ⁵ Priority Pollutants as defined by the California Toxics Rule (CTR) defined in Finding II.I of the Limitations and Discharge Requirements of this Order, and included as Attachment H.
- ⁶ The receiving water sample shall be collected at approximately the same time as the effluent sample

X. OTHER MONITORING REQUIREMENTS

A. BMPP Status and Effectiveness Report

1. As required under Special Provision VI.C.3 of this Order, the Discharger shall submit an updated BMPP to the Executive Officer of the Regional Water Board within 90 days of the effective date of this permit.
2. Annually the Discharger shall report the status of the implementation and the effectiveness of the BMPP required under Special Provision VI.C.3 of this Order. The BMPP shall be reviewed at a minimum once per year and updated as needed to ensure all actual or potential sources of pollutants in wastewater discharged from the facility are addressed in the BMPP. All changes or revisions to the BMPP will be summarized in the annual report required under Attachment E, Monitoring and Reporting, section X.D.

XI. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. If there is no discharge during any reporting period, the report shall so state.

3. Each monitoring report shall contain a separate section titled "Summary of Non-Compliance" which discusses the compliance record and corrective actions taken or planned that may be needed to bring the discharge into full compliance with waste discharge requirements. This section shall clearly list all non-compliance with waste discharge requirements, as well as all excursions of effluent limitations.
4. The Discharger shall inform the Regional Water Board well in advance of any proposed construction activity that could potentially affect compliance with applicable requirements.
5. The Discharger shall report the results of acute and chronic toxicity testing, TRE and TIE as required in the Attachment E, Monitoring and Reporting, section V.H.

B. Self Monitoring Reports (SMRs)

1. At any time during the term of this permit, the State or Regional Water Board may notify the Discharger to electronically submit Self-Monitoring Reports (SMRs) using the State Water Board's California Integrated Water Quality System (CIWQS) Program Web site (<http://www.waterboards.ca.gov/ciwqs/index.html>). Until such notification is given, the Discharger shall submit hard copy SMRs. The CIWQS Web site will provide additional directions for SMR submittal in the event there will be service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through IX. The Discharger shall submit SMRs including the results of all required monitoring using USEPA-approved test methods or other test methods specified in this Order according to the following schedule:

Table E-8. Monitoring Periods and Reporting Schedule

Reporting Period	Report Due
Start of Operation – June 30	August 1
July 1 – July 31	September 1
August 1 – End of Operation	October 1
Annual Summary Report	March 1 of each year

Monitoring reports for off-season discharges shall be submitted 45 days after sampling. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.

3. Reporting Protocols. The Discharger shall report with each sample result the applicable reported Minimum Level (ML) and the current Method Detection Limit (MDL), as determined by the procedure in Part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- a. Sample results greater than or equal to the reported ML shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory's MDL, shall be reported as "Detected, but Not Quantified," or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ as well as the words "Estimated Concentration" (may be shortened to "Est. Conc."). The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (+ a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.
 - d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.
4. Compliance Determination. Compliance with effluent limitations for priority pollutants shall be determined using sample reporting protocols defined above and Attachment A of this Order. For purposes of reporting and administrative enforcement by the Regional and State Water Boards, the Discharger shall be deemed out of compliance with effluent limitations if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reporting level (RL).
 5. Multiple Sample Data. When determining compliance with an AMEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
 - a. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.

6. The Discharger shall submit SMRs in accordance with the following requirements:
 - a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data is required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.
 - c. SMRs must be submitted to the Regional Water Board, signed and certified as required by the Standard Provisions (Attachment D), to the address listed below:

**California Regional Water Quality Control Board
Los Angeles Region
320 W. 4th Street, Suite 200
Los Angeles, CA 90013**

C. Discharge Monitoring Reports (DMRs)

1. As described in section X.B.1 above, at any time during the term of this permit, the State or Regional Water Board may notify the Discharger to electronically submit SMRs that will satisfy federal requirements for submittal of Discharge Monitoring Reports (DMRs). Until such notification is given, the Discharger shall submit DMRs in accordance with the requirements described below.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. DMRs must be signed and certified as required by the standard provisions (Attachment D). The Discharger shall submit the original DMR and one copy of the DMR to the address listed below:

STANDARD MAIL	FEDEX/UPS/ OTHER PRIVATE CARRIERS
State Water Resources Control Board Division of Water Quality c/o DMR Processing Center PO Box 100 Sacramento, CA 95812-1000	State Water Resources Control Board Division of Water Quality c/o DMR Processing Center 1001 I Street, 15 th Floor Sacramento, CA 95814

3. All discharge monitoring results must be reported on the official USEPA pre-printed DMR forms (EPA Form 3320-1). Forms that are self-generated will not be accepted unless they follow the exact same format of EPA Form 3320-1.

D. Other Reports

1. The Discharger shall report the results of any toxicity testing, TRE/TIE, or BMPP, required by Special Provisions in Sections VI.C.2.a and b and VI.C.3.a of the Order. The Discharger shall submit reports with the first monthly SMR scheduled to be submitted on or immediately following the report due date.
2. Within 90 days of the effective date of this permit, the Discharger is required to submit the following to the Regional Water Board:
 - a. Initial Investigation TRE workplan
 - b. Updated BMPP
3. By March 1 of each year, the Discharger shall submit an annual report to the Regional Water Board. The report shall contain the following:
 - a. Both tabular and graphical summaries of the monitoring data obtained during the previous year,
 - b. A discussion on the compliance record and the corrective actions taken or planned to bring the discharge into full compliance with the waste discharge requirements,
 - c. A report discussing the following: 1) operation/maintenance problems; 2) changes to the facility operations and activities; 3) potential discharge of the pollutants associated with the changes and how these changes are addressed in the BMPP; 3) calibration of flow meters or other equipment/device used to demonstrate compliance with effluent limitations of this Order.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- d. A report summarizing the quantities of all chemicals, listed by both trade and chemical names, which are used at the facility and which are discharged or have the potential to be discharged (See section VI.A.2.q of the Order).
 - e. A report on the status of the implementation and the effectiveness of the BMPP.
4. As discussed in section VI.A.2.q of the Order, the Discharger shall submit to the Regional Water Board, together with the first monitoring report required by this permit, a list of all chemicals and proprietary additives which could affect this waste discharge, including quantities of each. Any subsequent changes in types and/or quantities shall be reported promptly.
5. If the Discharger wishes to participate in a coordinated receiving water, biomonitoring, and sediment monitoring program with other dischargers to the King Harbor, then, the Discharger shall submit a report seeking approval of the Regional Water Board.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT F – FACT SHEET

Table of Contents

I.	Permit Information	F-3
II.	Facility Description.....	F-4
	A. Description of Wastewater	F-5
	B. Discharge Points and Receiving Waters	F-5
	C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data	F-6
	D. Compliance Summary	F-8
	E. Planned Changes.....	F-11
III.	Applicable Plans, Policies, and Regulations	F-11
	A. Legal Authorities	F-11
	B. California Environmental Quality Act (CEQA)	F-11
	C. State and Federal Regulations, Policies, and Plans.....	F-11
	D. Impaired Water Bodies on CWA 303(d) List	F-14
	E. Other Plans, Policies and Regulations.....	F-15
IV.	Rationale For Effluent Limitations and Discharge Specifications	F-15
	A. Discharge Prohibitions	F-15
	B. Technology-Based Effluent Limitations	F-15
	1. Scope and Authority	F-15
	2. Applicable Technology-Based Effluent Limitations.....	F-16
	C. Water Quality-Based Effluent Limitations (WQBELs).....	F-18
	1. Scope and Authority	F-18
	2. Applicable Beneficial Uses and Water Quality Criteria and Objectives	F-19
	3. Determining the Need for WQBELs	F-21
	4. WQBEL Calculations.....	F-24
	5. WQBELs based on Basin Plan Objectives	F-30
	6. Whole Effluent Toxicity (WET)	F-31
	7. Final WQBELs	F-32
	D. Final Effluent Limitations	F-33
	1. Satisfaction of Anti-Backsliding Requirements.....	F-33
	2. Satisfaction of Antidegradation Policy	F-33
	3. Stringency of Requirements for Individual Pollutants	F-34
	4. Mass-based Effluent Limitations	F-36
	E. Interim Effluent Limitations	F-36
	F. Land Discharge Specifications.....	F-36
	G. Reclamation Specifications	F-36
V.	Rationale for Receiving Water Limitations	F-36
	A. Surface Water	F-36
	B. Groundwater	F-36
VI.	Rationale for Monitoring and Reporting Requirements	F-37
	A. Influent Monitoring.....	F-37
	B. Effluent Monitoring	F-37
	C. Whole Effluent Toxicity Testing Requirements.....	F-38
	D. Receiving Water Monitoring	F-39

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

1. Surface Water	F-39
2. Groundwater	F-39
E. Other Monitoring Requirements	F-39
VII. Rationale for Provisions	F-39
A. Standard Provisions	F-39
B. Special Provisions	F-40
1. Reopener Provisions	F-40
2. Special Studies and Additional Monitoring Requirements	F-40
3. Best Management Practices and Pollution Prevention	F-41
4. Construction, Operation, and Maintenance Specifications	F-41
5. Other Special Provisions	F-41
6. Compliance Schedules	F-41
VIII. Public Participation	F-41
A. Notification of Interested Parties	F-41
B. Written Comments	F-42
C. Public Hearing	F-42
D. Nature of Hearing	F-42
E. Parties to the Hearing	F-42
F. Public Comments and Submittal of Evidence	F-43
G. Hearing Procedure	F-43
H. Waste Discharge Requirements Petitions	F-43
I. Information and Copying	F-44
J. Register of Interested Persons	F-44
K. Additional Information	F-44

List of Tables

Table F-1. Facility Information	F-3
Table F-2. Historic Effluent Limitations and Monitoring Data	F-6
Table F-3. Summary of Compliance History	F-8
Table F-4. Basin Plan Beneficial Uses	F-12
Table F-5. Summary of Technology-based Effluent Limitations	F-18
Table F-6. Applicable Water Quality Criteria	F-21
Table F-7. Summary Reasonable Potential Analysis	F-23
Table F-8. Summary of Water Quality-based Effluent Limitations	F-32
Table F-9. Summary of Final Effluent Limitations	F-34

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT F – FACT SHEET

As described in section II of this Order, this Fact Sheet includes the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

This Order has been prepared under a standardized format to accommodate a broad range of discharge requirements for dischargers in California. Only those sections or subsections of this Order that are specifically identified as “not applicable” have been determined not to apply to this Discharger. Sections or subsections of this Order not specifically identified as “not applicable” are fully applicable to this Discharger.

I. PERMIT INFORMATION

The following table summarizes administrative information related to the facility.

Table F-1. Facility Information

WDID	4B190143001
Discharger	City of Redondo Beach
Name of Facility	Seaside Lagoon
Facility Address	200 Portofino Way
	Redondo Beach, CA 90277
	Los Angeles County
Facility Contact, Title and Phone	Maggie Healy Acting Recreation & Community Services Director Tel.: (310)-318-0671
Authorized Person to Sign and Submit Reports	Director of Recreation & Community Service Department
Mailing Address	320 Knob Hill, Redondo Beach, CA 90277
Billing Address	SAME
Type of Facility	Swimming Lagoon
Major or Minor Facility	Minor
Threat to Water Quality	3
Complexity	C
Pretreatment Program	N
Reclamation Requirements	N/A
Facility Permitted Flow	N/A
Facility Design Flow	2.3 million gallons per day (MGD)/Annual average = 0.63 MGD
Watershed	Santa Monica Bay Watershed Management Area
Receiving Water	King Harbor
Receiving Water Type	Enclosed Bay

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

- A. The City of Redondo Beach (hereinafter Discharger) is the owner and operator of Seaside Lagoon (hereinafter Facility), a city park used for recreational activities.

For the purposes of this Order, references to the “discharger” or “permittee” in applicable federal and state laws, regulations, plans, or policy are held to be equivalent to references to the Discharger herein.

- B. The Facility discharges wastewater to King Harbor, a water of the United States, and is currently regulated by Order R4-2005-0016 which was adopted on March 3, 2005, and expires on February 10, 2010. The terms and conditions of the current Order as per 40 CFR Part 122.6 remain in effect until new Waste Discharge Requirements (WDRs) and a National Pollutant Discharge Elimination System (NPDES) permit are adopted.
- C. The Discharger filed a report of waste discharge (ROWD) and submitted an application for renewal of its WDRs and NPDES Permit on August 13, 2009. Supplemental information was requested on October 21, 2009, and received on October 22, 2009.

II. FACILITY DESCRIPTION

The Facility is a city park that includes a 1.4 million gallon, man-made, saltwater swimming lagoon. Other features include artificial beaches, play areas, and a snack bar (See Photos in Attachment J). Water for the Lagoon comes from the Redondo Beach Generating Station (RBGS or Power Plant) where the seawater is used to cool turbines. The Power Plant is located at 1100 Harbor Drive, Redondo Beach. RBGS currently operates four steam generating units (Units 5 – 8) in the city of Redondo Beach. The RBGS is owned and operated by AES Redondo Beach, LLC. Four other steam units (Units 1-4) have been retired but remain at the facility. The Power Plant is a “peak-demand” generation facility and as such operates intermittently. Cooling water for Units 5 and 6 is withdrawn through two submerged conduits extending into King Harbor and the Redondo Beach Marina. Cooling water for Units 7 and 8 is withdrawn through a submerged conduit that extends approximately 3000 feet from the facility and is located at the mouth of King Harbor.

When operated at design capacity, the AES Power Plant discharges up to 898 MGD of once-through non-contact cooling water through two discharge outfalls (one discharges to Pacific Ocean and the second one discharges to King Harbor). The discharges are regulated under separate WDRs contained in Regional Water Quality Control Board, Los Angeles Region (Regional Water Board) Order No. 00-085. Approximately 3,200 gallons per minute (GPM) over a 12-hour operating day, which is equivalent to 2.3 MGD (approximately 0.26 % of total discharge from RBGS), of Power Plant once-through cooling water (that discharges to King Harbor) is directed to the Seaside Lagoon.

Seaside Lagoon is open to the public for swimming from Memorial Day through Labor Day. Discharges mainly occur during this period, however, the Discharger occasionally allows the use of the Facility for social functions outside of the normal operating period which would also result in discharges.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

The city also operates an ice rink at the Facility location, in a sandy area adjacent to the swimming lagoon. Following seasonal use, water from the ice rink is allowed to evaporate and percolate into the sand. The water from the ice rink is not discharged and it is not covered by this Order.

A. Description of Wastewater

The lagoon is constructed of a rock revetment, with underlying sand. A 140 feet by 30 feet concrete structure was constructed adjacent to the revetment to house the water distribution system and provide a platform for installing recreational equipment (slides) used to enter the lagoon. The revetment and sand surfaces are pervious and therefore a constant inflow of water is needed to maintain the designed water surface elevation.

The water supply system is equipped with both chlorination and dechlorination facilities. The chlorination system consists of one, 1,000-gallon storage tank, which holds 17% sodium hypochlorite; dual chemical feed pumps with manual controls; and related piping. The dechlorination system consists of one, 1,000-gallon storage tank which holds 38% bisulfite; dual chemical feed pumps with manual controls; and related piping. The dechlorination piping terminates at the overflow structures at which point the bisulfite solution is added to the effluent. Bisulfite is added at all three overflow structures.

B. Discharge Points and Receiving Waters

The Lagoon influent is the Power Plant once through non-contact cooling water outfall conduit that discharges to King Harbor when the Power plant is operating. When the Power Plant is not in operation, Lagoon influent is the tidal backwater from the discharge end of the Power Plant outfall. Thus the King Harbor seawater serves as the source water for the Lagoon influent and the receiving water for Lagoon effluent.

Up to 2.3 MGD of dechlorinated wastewater is discharged into the King Harbor, a water of the United States, through Discharge Point No. 001, located at latitude 33°50'38" North and longitude 118°23'41" West. The effluent leaves the lagoon through three overflow structures located along the northwest edge of the Facility. The water then flows by gravity to a discharge manhole, and finally through a 60 feet long conduit into Inner King Harbor at the edge of the revetment. Samples for compliance monitoring are taken from the discharge manhole.

The existing sample collection location, is tidally influenced and therefore samples collected in the manhole may not be representative of the discharge. Sampling should be conducted when there is a discharge and during low tide conditions based on data provided by the National Oceanic and Atmospheric Administration's (NOAA), Station No. 9410840 (Santa Monica, CA). During high tide conditions, the sampling vault would be almost completely inundated with sea water and the effluent pipe would be completely submerged. Therefore, the grab samples during high tide may not be representative of the effluent.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data

Effluent limitations contained in the existing Order for discharges from Discharge Point No. 001. (Monitoring Location EFF-001) and representative monitoring data from the term of the previous Order are as follows:

Table F-2. Historic Effluent Limitations and Monitoring Data

Parameter	Units	Effluent Limitation		Monitoring Data (From May 30, 2005 to August 31, 2009)		
		Average Monthly	Maximum Daily	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge
Flow	MGD	--	2.3	--	--	2.3
pH	s.u.	6.5-8.5 ¹		5.95 min – 8.05 max		
Biochemical Oxygen Demand (BOD) (5-day @ 20 Deg. C)	mg/L	20	30	95	--	97.7
BOD Interim Limitations in TSO R4-2007-0024 ²	mg/L	100 ²	100 ²	< 2 ²	--	2 ²
Total Suspended Solids (TSS)	mg/L	50	75	184	--	286
TSS Interim Limitations in TSO R4-2007-0024 ²	mg/L	200 ²	250 ²	41 ²	--	62 ²
TSS Interim Limitations in TSO R4-2008-0002 ³	mg/L	60 ³	120 ³	86 ³	--	86 ³
Antimony	mg/L	--	--	--	--	4.45
Arsenic	mg/L	--	--	--	--	0.73
Cadmium	mg/L	--	--	--	--	0.04
Copper	mg/L	--	--	--	--	0.088
Nickel	mg/L	--	--	--	--	0.1
Selenium	mg/L	--	--	--	--	3.21
Silver	mg/L	--	--	--	--	1.23
Thallium	mg/L	--	--	--	--	3.17
Zinc	mg/L	--	--	--	--	0.114
Oil and Grease	mg/L	10	15	162	--	318
Turbidity	NTU	50	75	7	--	7
Temperature	°F	--	86 ⁴	--	--	80.4
Chlorine, Total Residual	µg/L	2	8	2.1	--	2.1

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Parameter	Units	Effluent Limitation		Monitoring Data (From May 30, 2005 to August 31, 2009)		
		Average Monthly	Maximum Daily	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge
Fecal Coliform	MPN/100 mL	200 ⁵	400	180 ⁶	--	464
Total Coliform	MPN/100 mL	1,000 ⁷	10,000	2,789	--	6,867
Enterococcus	MPN/100 mL	35 ⁸	104	16	--	457
Ammonia	mg/L	1.02 ⁹	2.05 ⁹	0.1	--	0.1
Acute Toxicity	% Survival	10		90% ¹¹		

¹ pH must be between 6.5 and 8.5 at all times.

² Interim limitations effective May 1, 2007 through January 31, 2008. Monitoring data reflects this time period.

³ Interim limitations effective February 1, 2008 through February 28, 2010. Monitoring data reflects this time period.

⁴ Temperature must not exceed 86 and the maximum temperature of the discharge must not exceed the natural receiving water temperature by more than 20 °F

⁵ The fecal coliform density for any 30-day period, shall not exceed a geometric mean of 200 per 100 ml nor shall more than 10 percent of the total samples during any 60-day period exceed 400 per 100ml.

⁶ Highest 30 day geometric mean.

⁷ The geometric mean density of total coliform organisms shall be less than 1,000 per 100 ml (10 per ml): provided that not more than 20 percent of the samples, in any 30-day period, may exceed 1,000 per 100 ml (10 per ml), and provided further that no single sample when verified by a repeat sample taken within 48 hours shall exceed 10,000 per 100 ml (100 per ml). Also, the total coliform density shall not exceed 1000 per 100 ml if the ratio of fecal to total coliform exceeds 0.1.

⁸ The geometric mean enterococcus density of the discharge shall not exceed 35 organisms per 100 ml for a 30-day period or 12 organisms per 100 ml for a six-month period.

⁹ The Discharger must comply with the ammonia water quality objectives in the Basin Plan Table 3-2 (for one hour average concentration limit) and Table 3-4 (for four day average concentration limit). This effluent limitation will stay in effect until the ammonia objectives revised on March 4, 2004, by the Regional Water Board with the adoption of Resolution No. 2004-022, *Amendment to the Water Quality Control Plan for the Los Angeles Region to Update the Ammonia Objectives for Inland Surface Waters Not Characteristic of Freshwater (including enclosed bays, estuaries and wetlands) with Beneficial Use Designations for Protection of Aquatic Life* are approved by the State Board, the Office of Administrative Law, and the United States Environmental Protection Agency (USEPA), to become effective.

¹⁰ Average survival in effluent for any three consecutive 96-hour static or continuous flow bioassay tests shall be at least 90%, with no single test producing less than 70% survival.

¹¹ Lowest percent survival of annual monitoring 2005 through 2008.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

D. Compliance Summary

On February 13, 2007, the Regional Water Board and the Discharger met to discuss the problems the Facility was having meeting the TSS and BOD limitations and possible solutions. On April 3, 2007, the City Council held a workshop to review the issue with the Regional Water Board Executive Officer. Subsequently, the Regional Water Board issued a Time Schedule Order (TSO) No. R4-2007-0024, which temporarily modified the TSS and BOD limits and directed the City to conduct a source identification study and submit a Source Identification Report (SIR) to the Regional Water Board. The TSO expired January 31, 2008.

The SIR found that the Facility contributed approximately 6% of the TSS to the effluent concentration. On January 15, 2008, the Regional Water Board issued a second TSO (No. R4-2008-0002) that established interim TSS limitations at 60 mg/L (monthly average) and 120 mg/L (daily maximum) and required the Facility to submit a workplan to *"determine the source of the TSS, treat the discharge to meet the final effluent limits, divert the discharge, or eliminate the discharge from Seaside Lagoon"*. The TSO expired on February 28, 2010. In the workplan submitted to the Regional Water Board on July 31, 2008, the Facility indicated that it would pursue a closed water circulation and filtration system. However, in the ROWD, received August 17, 2009, the Facility indicated that it could not obtain funding for the proposed reconstruction.

The Discharger and Lagoon users requested TSS relief for an additional period in January 2010. On May 5, 2010, the Regional Water Board issued a third TSO (Order No. R4-2010-0066). The interim limitations in the third TSO for TSS are same as the second expired TSO. The third TSO is scheduled to expire on September 10, 2013.

Data submitted to the Regional Water Board indicate that the Discharger has reported monitoring results at concentrations greater than existing permit limitations as outlined in the table below:

Table F-3. Summary of Compliance History¹

Date	Monitoring Period	Violation Type	Pollutant	Reported Value	Permit Limitation	Units
8/15/2005	August 2005	Instant. Maximum	pH	6.13	6.5-8.5	s.u..
8/15/2005	August 2005	Daily Maximum	BOD	75	30	mg/l
8/31/2005	August 2005	Average Monthly	BOD	75	20	mg/l
9/26/2005	September 2005	Daily Maximum	TSS	80	75	mg/l
9/26/2005	September 2005	Daily Maximum	Fecal Coliform	464	400	mpn/100ml
10/3/2005	October 2005	Instant. Maximum	pH	5.95	6.5-8.5	S.U.
10/3/2005	October 2005	Daily Maximum	BOD	40	30	mg/l

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Date	Monitoring Period	Violation Type	Pollutant	Reported Value	Permit Limitation	Units
10/5/2005 - 10/31/2005	October 2005	30-Day Geometric Mean	Total Coliform	1430-1741	1000	mpn/100ml
6/5/2006	June 2006	Daily Maximum	TSS	112	75	mg/l
6/30/2006	June 2006	Average Monthly	TSS	112	50	mg/l
7/3/2006	July 2006	Daily Maximum	Enterococcus	183	104	mpn/100ml
7/18/2006	July 2006	Daily Maximum	TSS	96	75	mg/l
7/24/2006	July 2006	Daily Maximum	TSS	81	75	mg/l
8/7/2006	August 2006	Daily Maximum	TSS	286	75	mg/l
8/28/2006	August 2006	Instant. Maximum	pH	6.25	6.5-8.5	S.U.
8/28/2006	August 2006	Daily Maximum	TSS	81	75	mg/l
8/28/2006	August 2006	Daily Maximum	BOD	75.5	30	mg/l
8/31/2006	August 2006	Average Monthly	TSS	184	50	mg/l
8/31/2006	August 2006	Average Monthly	BOD	76	20	mg/l
9/11/2006	September 2006	Daily Maximum	TSS	76	75	mg/l
9/11/2006	September 2006	Daily Maximum	BOD	71.9	30	mg/l
9/25/2006	September 2006	Daily Maximum	Total Residual Chlorine	1000	8	µg/l
9/25/2006	September 2006	Daily Maximum	TSS	76	75	mg/l
9/25/2006	September 2006	Daily Maximum	BOD	72.1	30	mg/l
9/30/2006	September 2006	Average Monthly	BOD	72	20	mg/l
10/2/2006	October 2006	Daily Maximum	TSS	86	75	mg/l
10/2/2006	October 2006	Daily Maximum	BOD	92.4	30	mg/l

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Date	Monitoring Period	Violation Type	Pollutant	Reported Value	Permit Limitation	Units
10/9/2006	October 2006	Daily Maximum	TSS	146	75	mg/l
10/9/2006	October 2006	Daily Maximum	Oil & Grease	318	15	mg/l
10/9/2006	October 2006	Daily Maximum	BOD	97.7	30	mg/l
10/31/2006	October 2006	Average Monthly	TSS	116	50	mg/l
10/31/2006	October 2006	Average Monthly	BOD	95	20	mg/l
10/31/2006	October 2006	Average Monthly	Oil & Grease	162	10	mg/l
8/28/2007	August 2007	Daily Maximum	Total Residual Chlorine	1500	8	µg/l
9/24/2007	September 2007	Daily Maximum	Total Residual Chlorine	710	8	µg/l
9/24/2007	September 2007	Daily Maximum	Enterococcus	457	104	mpn/100ml
10/6/2007	October 2007	Daily Maximum	Total Residual Chlorine	2100	8	µg/l
10/31/2007	October 2007	Average Monthly	Total Residual Chlorine	2100	2	µg/l
7/28/2008	July 2008	Daily Maximum	Total Residual Chlorine	200	8	µg/l
5/31/2009	May 2009	Monthly Average	TSS	86	60	mg/L

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

¹ Compliance with TSS effluent limitations during the period of May 1, 2007 through February 28, 2010 is based on interim effluent limitations in TSOs R4-2007-0024 and R4-2008-0002. Compliance with BOD effluent limitations during the period of May 1, 2007 through January 31, 2008 is based on interim effluent limitations in TSO R4-2007-0024.

A Notice of Violation letter was faxed to the Discharger on February 17, 2010. The enforcement action case was heard by a Hearing Panel of the Regional Water Board and their recommendations were affirmed by the full Regional Water Board on September 2, 2010. A Directive for Administrative Civil Liability (ACL) was sent to the City on September 15, 2010.

E. Planned Changes

Not Applicable

III. APPLICABLE PLANS, POLICIES, AND REGULATIONS

The requirements contained in the proposed Order are based on the requirements and authorities described in this section.

A. Legal Authorities

This Order is issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (USEPA) and chapter 5.5, division 7 of the California Water Code (commencing with section 13370). It shall serve as an NPDES permit for point source discharges from this facility to surface waters. This Order also serves as WDRs pursuant to article 4, chapter 4, division 7 of the Water Code (commencing with section 13260).

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

B. California Environmental Quality Act (CEQA)

Under Water Code section 13389, this action to adopt an NPDES permit is exempt from the provisions of CEQA, Public Resources Code sections 21100 through 21177.

C. State and Federal Regulations, Policies, and Plans

1. Water Quality Control Plans. The Regional Water Board adopted a Water Quality Control Plan for the Los Angeles Region (hereinafter Basin Plan) on June 13, 1994, that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, the Basin Plan implements State Water Resources Control Board (State Water Board) Resolution No. 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply. King Harbor is a marine water with associated salinity, therefore the municipal or domestic water supply beneficial use does not apply. Beneficial uses applicable to King Harbor are as follows:

Table F-4. Basin Plan Beneficial Uses

Discharge Point No.	Receiving Water Name	Beneficial Use(s)
001	King Harbor	<u>Existing:</u> Industrial service supply (IND), navigation (NAV), water contact recreation (REC-1), non-contact water recreation (REC-2), commercial and sport fishing (COMM), , marine habitat (MAR), wildlife habitat (WILD), and rare, threatened, or endangered species (RARE)

Requirements of this Order implement the Basin Plan.

2. Thermal Plan. The State Board adopted the *Water Quality Control Plan for Control of Temperature in the Coastal and Interstate Water and Enclosed Bays and Estuaries of California* (Thermal Plan) on May 18, 1972, and amended this plan on September 18, 1975. This plan contains temperature objectives for inland and coastal surface waters. Requirements of this Order implement the Thermal Plan and a white paper developed by Regional Water Board staff entitled *Temperature and Dissolved Oxygen Impacts on Biota in Tidal Estuaries and Enclosed Bays in the Los Angeles Region*. The white paper evaluated the optimum temperatures for steelhead, topsmelt, ghost shrimp, brown rock crab, jackknife clam, and blue mussel. The effluent temperature limit of 86°F is protective of aquatic organisms. .
3. Ammonia Basin Plan Amendment: The 1994 Basin Plan provided water quality objectives for ammonia to protect aquatic life, in Tables 3-1 through 3-4. However, those ammonia objectives were revised on March 4, 2004, by the Regional Water Board with the adoption of Resolution No. 2004-022, *Amendment to the Water Quality Plan for the Los Angeles Region to Update the Ammonia Objectives for Inland Surface Waters Not Characteristic of Freshwater (including enclosed bays, estuaries and wetlands) with the Beneficial Use designations for protection of "Aquatic Life"*. The ammonia Basin Plan amendment was approved by the State Water Board on July 22, 2004, Office of Administrative Law on September 15, 2004, and by USEPA on May 19, 2005. The amendment revised the Basin Plan by updating the ammonia objectives for inland surface waters not characteristic of freshwater such that they are consistent with USEPA's *"Ambient Water Quality Criteria for Ammonia (Saltwater) – 1989."* The amendment revised the regulatory provisions of the Basin Plan by adding language to Chapter 3, "Water Quality Objectives."

For inland surface waters not characteristic of freshwater (including enclosed bays, estuaries, and wetlands), the proposed objectives are a 4-day average concentration of unionized ammonia of 0.035 mg/L, and a one-hour average concentration of unionized ammonia of 0.233 mg/L. The proposed objectives are fixed concentrations of unionized ammonia, independent of pH, temperature, or salinity. The proposed amendment includes an implementation procedure to convert un-ionized ammonia objectives to total ammonia effluent limits. The proposed amendment also simplifies the implementation procedures for translating ammonia objectives into effluent limits in

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

situations where a mixing zone has been authorized by the Regional Water Board. Finally, the proposed amendment revises the implementation procedure for determining saltwater, brackish or freshwater conditions, to be consistent with the proposed objectives. The proposed objectives will apply only to inland surface waters not characteristic of freshwater (including enclosed bays, estuaries and wetlands) and do not impact the Ammonia Water Quality Objectives for ocean waters contained in the California Ocean Plan.

4. Enclosed Bays and Estuaries Policy. The Water Quality Control Policy for the Enclosed Bays and Estuaries of California (Enclosed Bay and Estuaries Policy), adopted by the State Water Board as Resolution No. 95-84 on November 16, 1995, states that:

"It is the policy of the State Board that the discharge of municipal wastewaters and industrial process waters (exclusive of cooling water discharges) to enclosed bays and estuaries, other than the San Francisco Bay-Delta system, shall be phased out at the earliest practicable date. Exceptions to this provision may be granted by a Regional Board only when the Regional Board finds that the wastewater in question would consistently be treated and discharged in such a manner that it would enhance the quality of receiving waters above that which would occur in the absence of the discharge."

While the Facility discharges into King Harbor, within the enclosed bay, the swimming lagoon effluent is comprised primarily of dechlorinated, non-contact cooling water, and therefore is exclusive of the policy. Nonetheless, this Order contains provisions necessary to protect all beneficial uses of the receiving water.

5. National Toxics Rule (NTR) and California Toxics Rule (CTR). USEPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995, and November 9, 1999. About forty criteria in the NTR applied in California. On May 18, 2000, USEPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on February 13, 2001. These rules contain water quality criteria for priority pollutants.
6. State Implementation Policy. On March 2, 2000, the State Water Board adopted the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California* (State Implementation Policy or SIP). The SIP became effective on April 28, 2000 with respect to the priority pollutant criteria promulgated for California by the USEPA through the NTR and to the priority pollutant objectives established by the Regional Water Board in the Basin Plan. The SIP became effective on May 18, 2000 with respect to the priority pollutant criteria promulgated by the USEPA through the CTR. The State Water Board adopted amendments to the SIP on February 24, 2005, that became effective on July 13, 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

7. **Alaska Rule.** On March 30, 2000, USEPA revised its regulation that specifies when new and revised state and tribal water quality standards (WQS) become effective for CWA purposes (40 CFR § 131.21, 65 Fed. Reg. 24641 (April 27, 2000)). Under the revised regulation (also known as the Alaska rule), new and revised standards submitted to USEPA after May 30, 2000, must be approved by USEPA before being used for CWA purposes. The final rule also provides that standards already in effect and submitted to USEPA by May 30, 2000, may be used for CWA purposes, whether or not approved by USEPA.
8. **Antidegradation Policy.** Section 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies. The permitted discharge must be consistent with the antidegradation provision of section 131.12 and State Water Board Resolution No. 68-16.
9. **Anti-Backsliding Requirements.** Sections 402(o)(2) and 303(d)(4) of the CWA and federal regulations at title 40, Code of Federal Regulations¹ section 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

D. Impaired Water Bodies on CWA 303(d) List

Section 303(d) of the CWA requires states to identify specific water bodies where water quality standards are not expected to be met after implementation of technology-based effluent limitations on point sources. For all 303(d)-listed water bodies and pollutants, the Regional Water Board plans to develop and adopt total maximum daily loads (TMDLs) that will specify waste load allocations (WLAs) for point sources and load allocations (LAs) for non-point sources, as appropriate.

On June 28, 2007 USEPA gave final approval to California's 2006 section 303(d) List of Water Quality Limited Segments. Certain receiving waters in the Los Angeles and Ventura County watersheds do not fully support beneficial uses and therefore have been classified as impaired on the 2006 303(d) list and have been scheduled for TMDL development.

King Harbor is not included on the 2006 303(d) List of Water Quality Limited Segments. No TMDLs are scheduled and no conditions in the proposed Order are based on TMDLs.

¹ All further statutory references are to title 40 of the Code of Federal Regulations unless otherwise indicated.

E. Other Plans, Policies and Regulations
Not Applicable

IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

The CWA requires point source dischargers to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States. The control of pollutants discharged is established through effluent limitations and other requirements in NPDES permits. There are two principal bases for effluent limitations in the Code of Federal Regulations: section 122.44(a) requires that permits include applicable technology-based limitations and standards; and section 122.44(d) requires that permits include water quality-based effluent limitations to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water.

The list of pollutants of concern is based on constituents that are regulated in the Basin Plan or CTR and were detected in the effluent and/or were regulated in Order No. R4-2005-0016. Based on these criteria, the following are pollutants of concern TSS, turbidity, ammonia, pH, BOD, and oil and grease. Because the water is heated from the AES Power Plant, temperature is also a pollutant of concern. Furthermore, treatment at the facility consists of chlorination/dechlorination, thus total residual chlorine is a pollutant of concern.

Generally, mass-based effluent limitations ensure that proper treatment, and not dilution, is employed to comply with the final effluent concentration limitations. However, section 122.45(f)(1) requires that all permit limitations, standards or prohibitions be expressed in terms of mass units except under the following conditions: (1) for pH, temperature, radiation or other pollutants that cannot appropriately be expressed by mass limitations; (2) when applicable standards or limitations are expressed in terms of other units of measure; or (3) if in establishing technology-based permit limitations on a case-by-case basis limitations based on mass are infeasible because the mass or pollutant cannot be related to a measure of production. Since these conditions do not apply, this Order includes new mass-based limitations.

A. Discharge Prohibitions

The discharge prohibitions are based on the requirements of the Basin Plan, State Board's plans and policies, the Water Code, and previous permit provisions, and are consistent with the requirements set for other discharges regulated by an NPDES permit to the King Harbor.

B. Technology-Based Effluent Limitations

1. Scope and Authority

Section 301(b) of the CWA and implementing USEPA permit regulations at section 122.44, title 40 of the Code of Federal Regulations, require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

technology-based requirements based on Best Professional Judgment (BPJ) in accordance with Part 125, section 125.3

The CWA requires that technology-based effluent limitations be established based on several levels of controls:

- a. Best practicable treatment control technology (BPT) represents the average of the best performance by plants within an industrial category or subcategory. BPT standards apply to toxic, conventional, and non-conventional pollutants.
- b. Best available technology economically achievable (BAT) represents the best existing performance of treatment technologies that are economically achievable within an industrial point source category. BAT standards apply to toxic and non-conventional pollutants.
- c. Best conventional pollutant control technology (BCT) represents the control from existing industrial point sources of conventional pollutants including BOD, TSS, fecal coliform, pH, and oil and grease. The BCT standard is established after considering the “cost reasonableness” of the relationship between the cost of attaining a reduction in effluent discharge and the benefits that would result, and also the cost effectiveness of additional industrial treatment beyond BPT.
- d. New source performance standards (NSPS) represent the best available demonstrated control technology standards. The intent of NSPS guidelines is to set limitations that represent state-of-the-art treatment technology for new sources.

The CWA requires USEPA to develop effluent limitations, guidelines and standards (ELGs) representing application of BPT, BAT, BCT, and NSPS. Section 402(a)(1) of the CWA and section 125.3 of the Code of Federal Regulations authorize the use of best professional judgment (BPJ) to derive technology-based effluent limitations on a case-by-case basis where ELGs are not available for certain industrial categories and/or pollutants of concern. Where BPJ is used, the permit writer must consider specific factors outlined in section 125.3.

2. Applicable Technology-Based Effluent Limitations

This Order includes technology-based effluent limitations based on BPJ in accordance with 40 CFR § 125.3. The previous Order discussed rationale based on effluent limitations from a preceding Order and similar facilities and implementation of BPJ to include the equivalent of technology-based effluent limitations. In addition, as discussed in section VII.B.3, this Order includes a requirement to develop a Best Management Practices Plan (BMPP). Furthermore, effluent limitations for turbidity, BOD, oil and grease, TSS, and total residual chlorine have been carried over as technology-based effluent limitations from the existing Order (No. R4-2005-0016) as explained below:

- a. Turbidity. Order No. R4-2005-0016 contains effluent limitations for turbidity equal to 50 NTU (monthly average) and 75 NTU (daily maximum). Turbidity is a Basin

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Plan constituent with a narrative objective. The objective has been interpreted as a numerical value in the current Order. The numerical criteria have been included in this Order as the constituent continues to be a contaminant of concern.

- b. BOD. Order No. R4-2005-0016 contains effluent limitations for BOD equal to 20 mg/L (monthly average) and 30 mg/L (daily maximum). The constituent continues to be a contaminant of concern. As a result, the BOD limitations from Order No. R4-2005-0016 are carried over to this Order.
- c. TSS. Order No. R4-2005-0016 contains effluent limitations for TSS equal to 50 mg/L (monthly average) and 75 mg/L (daily maximum). As discussed in section II.D of this Fact Sheet, the Facility has requested relaxed effluent limitations for TSS, based on the presence of TSS in the influent, as documented in the SIR. The intake water and the receiving water for effluent discharge for Seaside Lagoon is the King Harbor water. Based on 40 CFR Part 122.45 (g) the Discharger qualifies for intake credit for TSS, therefore, intake credits is included in the current Order.

For the SIR study, the Facility measured TSS in samples collected from influent, lagoon water, effluent, and two locations within King Harbor. The average of TSS concentrations for each sample location is provided in Table F-5.

Table F-5. Average TSS Concentrations (mg/L) Within Seaside Lagoon and King Harbor¹

Sample Location No.	Sample Location Description	Average TSS Concentration (mg/L)
1	Lagoon Influent Pump Discharge (Directly from Power Plant)	39.8
2A	Lagoon Overflow Pipe Structure A	41
2B	Lagoon Overflow Pipe Structure B	42
2C	Lagoon Overflow Pipe Structure C	43
3A	Lagoon Effluent Pipe	42.4
4	King Harbor Near Power Plant Outfall	45
5	Harbor Near Lagoon Outfall	48

¹ Source: *Seaside Lagoon TSO Source Identification Report*. Submitted to Los Angeles Regional Water Quality Control Board on October 1, 2007. Prepared by CDM

The results indicate that the average TSS concentration in the effluent sample (3A) was slightly higher (6 percent) than the average TSS concentration in the influent (1). The average effluent TSS concentration was slightly lower than averages for both King Harbor locations 4 and 5, by 6 percent and 12 percent, respectively.

Prior to the SIR study, the Facility collected samples for compliance monitoring at the effluent vault, where tidal action may have introduced additional solids to the effluent samples. As reported in the SIR, the historical average TSS from samples collected within the vault was 51 mg/L, compared to 42.4 mg/L when collected two to three feet upstream within the effluent pipe during the SIR study.

- d. Oil and Grease. Order No. R4-2005-0016 contains effluent limitations for oil and grease equal to 10 mg/L (monthly average) and 15 mg/L (daily maximum). Oil and grease has been detected in the effluent and remains a pollutant of concern. For this reason, oil and grease limitations from Order No. R4-2005-0016 are carried over to this Order.
- e. Total Residual Chlorine. Order No. R4-2005-0016 contains effluent limitations for total residual chlorine equal to 2 µg/L (monthly average) and 8 µg/L (daily maximum). The Facility treats lagoon water with sodium hypochlorite. As discussed in Section II.D of this Fact Sheet, total residual chlorine has been detected in the effluent. The total residual chlorine limitations from Order No. R4-2005-0016 are carried over as technology based effluent limitations to this Order.

Table F-6. Summary of Technology-based Effluent Limitations

Parameter	Units	Effluent Limitations	
		Average Monthly	Maximum Daily
Total Suspended Solids (TSS)	mg/L	60 ²	75 ²
	lbs/day ¹	1,150	1,440
Biochemical Oxygen Demand (BOD) (5-day @ 20 Deg. C)	mg/L	20	30
	lbs/day ¹	384	575
Oil and Grease	mg/L	10	15
	lbs/day ¹	192	288
Turbidity	NTU	50	75
Chlorine, Total Residual	µg/L	2	8
	lbs/day ¹	0.038	0.15

- 1 Mass based effluent limitations calculated using the following formula based on an average daily flow of 2.3 MGD: (lbs/day) = 2.3 MGD x 8.34 x effluent limitation (mg/L).
- 2 Compliance based on the numeric criteria or on the intake water credit, whichever is higher.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

C. Water Quality-Based Effluent Limitations (WQBELs)

1. Scope and Authority

Section 301(b) of the CWA and section 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards.

Section 122.44(d)(1)(i) mandates that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to

cause or contribute to an exceedance of a water quality standard (WQS), including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, water quality-based effluent limitations (WQBELs) must be established using: (1) USEPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state's narrative criterion, supplemented with other relevant information, as provided in section 122.44(d)(1)(vi).

The process for determining reasonable potential and calculating WQBELs when necessary is intended to protect the designated uses of the receiving water as specified in the Basin Plan, and achieve applicable water quality objectives and criteria that are contained in other state plans and policies, or any applicable water quality criteria contained in the CTR and NTR. The specific procedures for determining reasonable potential for discharges from the Seaside Lagoon, and if necessary for calculating WQBELs, are contained in the SIP.

2. Applicable Beneficial Uses and Water Quality Criteria and Objectives

As noted in section II of the Limitations and Discharge Requirements, the Regional Water Board adopted a Basin Plan that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the Basin Plan. The beneficial uses applicable to King Harbor are summarized in section III.C.1 of this Fact Sheet. The Basin Plan includes both narrative and numeric water quality objectives applicable to the receiving water.

Priority pollutant water quality criteria in the CTR are applicable to King Harbor. The CTR contains both saltwater and freshwater criteria. Because a distinct separation generally does not exist between freshwater and saltwater aquatic communities, the following apply, in accordance with section 131.38(c)(3), *“(1) freshwater criteria apply at salinities of 1 part per thousand (ppt) and below at locations where this occurs 95 percent or more of the time; (2) saltwater criteria apply at salinities of 10 parts per thousand and above at locations where this occurs 95% or more of the time; and (3) at salinities between 1 and 10 parts per thousand the more stringent of the two apply unless EPA approves the application of the freshwater or saltwater criteria based on an appropriate biological assessment.”* Based on the proximity of the discharge to the ocean and receiving water monitoring data, saltwater criteria are more appropriate for this discharge. As such, the CTR criteria for saltwater or human health for consumption of organisms, whichever is more stringent, are used to prescribe the effluent limitations in this Order to protect the beneficial uses of the King Harbor, a water of the United States in the vicinity of the discharge.

Table F-7 summarizes the applicable water quality criteria/objective for priority pollutants reported in detectable concentrations in the effluent or receiving water.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

These criteria were used in conducting the reasonable potential analysis (RPA) for this Order.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Table F-7. Applicable Water Quality Criteria

Constituent	Selected Criteria	CTR/NTR Water Quality Criteria					
		Freshwater		Saltwater		Human Health for Consumption of:	
		Acute	Chronic	Acute	Chronic	Water & Organisms	Organisms only
	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L
Antimony, Total Recoverable	4300.00	N/A		--	--	--	4,300
Arsenic, Total Recoverable	36			69	36	--	--
Beryllium, Total Recoverable	No Criteria			--	--	--	Narrative
Cadmium, Total Recoverable	9.4			42	9.4	--	Narrative
Chromium (VI)	50			1,108	50	--	Narrative
Copper , Total Recoverable	3.7			5.8	3.7	--	--
Lead, Total Recoverable	8.5			221	8.5	--	Narrative
Nickel, Total Recoverable	8.3			75	8.3	--	4,600
Selenium, Total Recoverable	71			291	71	--	Narrative
Silver, Total Recoverable	2.2			2.2	--	--	--
Thallium, Total Recoverable	6.3			--	--	--	6.3
Zinc, Total Recoverable	86			95	86	--	--
Bromoform	360			--	--	--	360
Chlorodibromomethane	34			--	--	--	34
Bis(2-Ethylhexyl)Phthalate	5.9			--	--	--	5.9
Di-n-Butyl Phthalate	12,000			--	--	--	12,000

"N/A" indicates the receiving water body is not characterized as freshwater.

3. Determining the Need for WQBELs

In accordance with Section 1.3 of the SIP, the Regional Water Board conducts a RPA for each priority pollutant with an applicable criterion or objective to determine if a WQBEL is required in the permit. The Regional Water Board analyzes effluent and receiving water data and identifies the maximum observed effluent concentration (MEC) and maximum background concentration (B) in the receiving water for each constituent. To determine reasonable potential, the MEC and the B are then compared with the applicable water quality objectives (C) outlined in the CTR, NTR, as well as the Basin Plan. For all pollutants that have a reasonable potential to cause or contribute to an excursion above a state water quality standard, numeric WQBELs are required. The

R E V I S E D T E N T A T I V E

RPA considers water quality criteria from the CTR and NTR, and when applicable, water quality objectives specified in the Basin Plan. To conduct the RPA, the Regional Water Board identifies the MEC and maximum background concentration in the receiving water for each constituent, based on data provided by the Discharger.

Section 1.3 of the SIP provides the procedures for determining reasonable potential to exceed applicable water quality criteria and objectives. The SIP specifies three triggers to complete a RPA:

- 1) Trigger 1 – If the $MEC \geq C$, a limit is needed.
- 2) Trigger 2 – If the background concentration (B) > C and the pollutant is detected in the effluent, a limit is needed.
- 3) Trigger 3 – If other related information such as CWA 303(d) listing for a pollutant, discharge type, compliance history, etc. indicates that a WQBEL is required.

Sufficient effluent and receiving water data are needed to conduct a complete RPA. If data are not sufficient, the Discharger will be required to gather the appropriate data for the Regional Water Board to conduct the RPA. Upon review of the data, and if the Regional Water Board determines that WQBELs are needed to protect the beneficial uses, the permit will be reopened for appropriate modification.

The RPA was performed for the priority pollutants regulated in the CTR for which data are available. Five sets of discharge data are available from 2005 through 2009 for Discharge Point No. 001 as well as the receiving water. Based on the RPA, pollutants that demonstrate reasonable potential are arsenic, cadmium, copper, nickel, selenium, silver, thallium, and zinc for discharge through Discharge Point No. 001. For antimony, five monitoring samples were collected. Four were non-detects and one was an outlier value which was orders of magnitude higher than the non-detect values. The outlier effluent value result was 4,500 µg/L and the receiving water result at the same time was 4,550 µg/L (similar to effluent, the receiving water results on four other sampling events were non-detects). It could have been a sampling error. Also, relative to the criterion of 4,300 µg/L, the MEC and background concentrations of 4,500 µg/L and 4,550 µg/L, respectively, the exceedances were relatively low (5 to 6 percent above the criterion) for outlier values. The four non-detect sampling results for both effluent and receiving waters indicate low potential for antimony to impair beneficial uses, thus the Regional Board has determined effluent limitations for antimony are not required based on one outlier value. Since the data sets for arsenic, cadmium, copper, nickel, selenium, silver, thallium, and zinc are small (five data points), and only one data point yielded concentrations above the criteria, additional data is required to evaluate reasonable potential. Refer to Attachment I for a summary of the RPA.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Work Plan – Special Study

The monitoring data collected, for metals showed temporal variability in the collected influent and effluent sample results. The water samples collected from the same locations on different days displayed large differences in metal concentrations and effluent samples collected at different times during the same day also displayed considerable variability. This variability coupled with the limited number of samples available (five samples with only one sample with contaminant concentration that exceeded the applicable water quality criteria) make it difficult to utilize statistics to calculate appropriate interim effluent concentrations (95 or 99 percentile concentration) or to determine reasonable potential. This permit includes a requirement to develop a Work Plan and conduct a Study. The objectives of the Work Plan are to design a study to:

- develop and implement an accelerated monitoring program (weekly sampling, at a minimum) for metals in the influent and effluent,
- refine sampling protocols (grab vs. composite),
- refine data collection points,
- refine data collection timing and other logistics in order to have the best data set for determining reasonable potential, intake credits and other permit provisions,
- examine sampling and laboratory protocols to insure adequate QA/QC.

In the Fall of 2011, City of Redondo Beach staff should schedule a meeting with the Regional Water Board staff to review and analyze the data. If Regional Water Board staff determines that the data set is adequate,. it will be used to re-evaluate reasonable potential. If the data set is not adequate then a second season of monitoring (Summer 2012) will be planned and executed.

Table F-8. Summary Reasonable Potential Analysis

Constituent	Applicable Water Quality Criteria (C)	Max Effluent Conc. (MEC)	Maximum Detected Receiving Water Conc. (B)	RPA Result - Need Limit?	Reason
	µg/L	µg/L	µg/L		
Antimony, Total Recoverable	4,300	4,450	4,500	No	1
Arsenic, Total Recoverable	36	730	680	No	More data required
Beryllium, Total Recoverable	No Criteria	30	29	No	No Criteria
Cadmium, Total Recoverable	9.4	40	40	No	More data required
Chromium (VI)	50	11	10	No	MEC<C & B is ND
Copper, Total Recoverable	3.7	88	97	No	More data required
Lead, Total Recoverable	8.5	0.40	0.29	No	MEC<C & B<=C
Nickel, Total Recoverable	8.3	100	100	No	More data required

 R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Constituent	Applicable Water Quality Criteria (C)	Max Effluent Conc. (MEC)	Maximum Detected Receiving Water Conc. (B)	RPA Result - Need Limit?	Reason
	µg/L	µg/L	µg/L		
Selenium, Total Recoverable	71	3,210	3,390	No	More data required
Silver, Total Recoverable	2.24	1,230	1,170	No	More data required
Thallium, Total Recoverable	6.3	3,170	3,250	No	More data required
Zinc, Total Recoverable	86	114	66	No	More data required
Bromoform	360	106	6.9	No	MEC<C & B<=C
Chlorodibromo-methane	34	4.3	--	No	MEC<C & B is ND
Bis(2-Ethylhexyl)Phthalate	5.9	1.2	0.97	No	MEC<C & B<=C
Di-n-Butyl Phthalate	12,000	1.07	1.8	No	MEC<C & B<=C

- 1 Antimony was detected in only one out of five monitoring events. The detected value was orders of magnitude higher than the four non-detect values. Moreover, the one detect in the effluent (outlier value) was slightly higher than the criteria and less than the receiving water concentration. Therefore the Regional Board has determined no reasonable potential exists for antimony.

4. WQBEL Calculations

- a. If a reasonable potential exists to exceed applicable water quality criteria or objectives, then a WQBEL must be established in accordance with one or more of the three procedures contained in Section 1.4 of the SIP. These procedures include:
 - i. If applicable and available, use of the WLA established as part of a TMDL.
 - ii. Use of a steady-state model to derive maximum daily effluent limitations (MDELs) and average monthly effluent limitations (AMELs).
 - iii. Where sufficient effluent and receiving water data exist, use of a dynamic model, which has been approved by the Regional Water Board.
- b. Water quality based effluent limits for arsenic, cadmium, chromium (VI), copper, nickel, selenium, silver, thallium, and zinc are based on monitoring results and following the procedure based on the steady-state model, available in Section 1.4 of the SIP.
- c. Since many of the streams in the Region have minimal upstream flows, mixing zones and dilution credits are usually not appropriate. Therefore, in this tentative Order, no dilution credit is being allowed. However, in accordance with the reopener provision in section VI.C.1.e in the tentative Order, this Order may be reopened upon the submission by the Discharger of adequate information to establish appropriate dilution credits or a mixing zone, as determined by the Regional Water Board.

R E V I S E D T E N T A T I V E

d. WQBELs Calculation Example

Using nickel as an example, the following demonstrates how WQBELs were established for this Order. The tables in Attachment I summarize the development and calculation of all WQBELs for this Order using the process described below.

Concentration-Based Effluent Limitations

A set of AMEL and MDEL values are calculated separately, one set for the protection of aquatic life and the other for the protection of human health. The AMEL and MDEL limitations for aquatic life and human health are compared, and the most restrictive AMEL and the most restrictive MDEL are selected as the WQBEL.

Calculation of aquatic life AMEL and MDEL:

Step 1: For each constituent requiring an effluent limit, identify the applicable water quality criteria or objective. For each criteria determine the effluent concentration allowance (ECA) using the following steady state equation:

$$\begin{aligned} \text{ECA} &= C + D(C-B) \quad \text{when } C > B, \text{ and} \\ \text{ECA} &= C \quad \text{when } C \leq B, \end{aligned}$$

Where C = The priority pollutant criterion/objective, adjusted if necessary for hardness, pH and translators
 D = The dilution credit, and
 B = The ambient background concentration

As discussed above, for this Order, dilution was not allowed; therefore:

$$\text{ECA} = C$$

For nickel the applicable water quality criteria are (reference Table F-7):

$$\begin{aligned} \text{ECA}_{\text{acute}} &= 74.75 \mu\text{g/L} \\ \text{ECA}_{\text{chronic}} &= 8.28 \mu\text{g/L} \end{aligned}$$

Step 2: For each ECA based on aquatic life criterion/objective, determine the long-term average discharge condition (LTA) by multiplying the ECA by a factor (multiplier). The multiplier is a statistically based factor that adjusts the ECA to account for effluent variability. The value of the multiplier varies depending on the coefficient of variation (CV) of the data set and whether it is an acute or chronic criterion/objective. Table 1 of the SIP provides pre-calculated values for the

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

multipliers based on the value of the CV. Equations to develop the multipliers in place of using values in the tables are provided in Section 1.4, Step 3 of the SIP and will not be repeated here.

$$LTA_{\text{acute}} = ECA_{\text{acute}} \times \text{Multiplier}_{\text{acute } 99}$$

$$LTA_{\text{chronic}} = ECA_{\text{chronic}} \times \text{Multiplier}_{\text{chronic } 99}$$

The CV for the data set must be determined before the multipliers can be selected and will vary depending on the number of samples and the standard deviation of a data set. If the data set is less than 10 samples, or at least 80% of the samples in the data set are reported as non-detect, the CV shall be set equal to 0.6.

For nickel, the following data was used to develop the acute and chronic LTA using equations provided in Section 1.4, Step 3 of the SIP (Table 1 of the SIP also provides this data up to three decimals):

No. of Samples	CV	ECA Multiplier _{acute 99}	ECA Multiplier _{chronic 99}
4	0.6	0.32	0.53

$$LTA_{\text{acute}} = 74.75 \mu\text{g/L} \times 0.32 = 23.92 \mu\text{g/L}$$

$$LTA_{\text{chronic}} = 8.28 \mu\text{g/L} \times 0.53 = 4.39 \mu\text{g/L}$$

Step 3: Select the most limiting (lowest) of the LTA.

$$LTA = \text{most limiting of } LTA_{\text{acute}} \text{ or } LTA_{\text{chronic}}$$

For nickel, the most limiting LTA was the LTA_{chronic}

$$LTA \ 4.39 \mu\text{g/L}$$

Step 4: Calculate the WQBELs by multiplying the LTA by a factor (multiplier). WQBELs are expressed as Average Monthly Effluent Limitations (AMEL) and Maximum Daily Effluent Limitation (MDEL). The multiplier is a statistically based factor that adjusts the LTA for the averaging periods and exceedance frequencies of the criteria/objectives and the effluent limitations. The value of the multiplier varies depending on the probability basis, the coefficient of variation (CV) of the data set, the number of samples (for AMEL) and whether it is a monthly or daily limit. Table 2 of the SIP provides pre-calculated values for the multipliers based on the value of the CV and the number of samples. Equations to develop the multipliers in place of using values in the tables are provided in Section 1.4, Step 5 of the SIP and will not be repeated here.

$$AMEL_{\text{aquatic life}} = LTA \times \text{AMEL}_{\text{multiplier } 95}$$

$$MDEL_{\text{aquatic life}} = LTA \times \text{MDEL}_{\text{multiplier } 99}$$

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

AMEL multipliers are based on a 95th percentile occurrence probability, and the MDEL multipliers are based on the 99th percentile occurrence probability. If the number of samples is less than four (4), the default number of samples to be used is four (4).

For nickel, the following data was used to develop the AMEL and MDEL for aquatic life using equations provided in Section 1.4, Step 5 of the SIP (Table 2 of the SIP also provides this data up to two decimals):

No. of Samples Per Month	CV	Multiplier _{MDEL 99}	Multiplier _{AMEL 95}
4	0.6	3.11	1.55

$$\text{AMEL}_{\text{aquatic life}} = 4.39 \times 1.55 = 6.8 \mu\text{g/L}$$

$$\text{MDEL}_{\text{aquatic life}} = 4.39 \times 3.11 = 13.6 \mu\text{g/L}$$

Calculation of human health AMEL and MDEL:

Step 5: For the ECA based on human health, set the AMEL equal to the $\text{ECA}_{\text{human health}}$

$$\text{AMEL}_{\text{human health}} = \text{ECA}_{\text{human health}}$$

For nickel:

$$\text{AMEL}_{\text{human health}} = 4,600 \mu\text{g/L}$$

Step 6: Calculate the MDEL for human health by multiplying the AMEL by the ratio of the Multiplier_{MDEL} to the Multiplier_{AMEL}. Table 2 of the SIP provides pre-calculated ratios to be used in this calculation based on the CV and the number of samples.

$$\text{MDEL}_{\text{human health}} = \text{AMEL}_{\text{human health}} \times (\text{Multiplier}_{\text{MDEL}} / \text{Multiplier}_{\text{AMEL}})$$

For nickel, the following data were used to develop the $\text{MDEL}_{\text{human health}}$:

No. of Samples Per Month	CV	Multiplier _{MDEL 99}	Multiplier _{AMEL 95}	Ratio
4	0.6	3.11	1.55	2.01

$$\text{MDEL}_{\text{human health}} = 4,600 \mu\text{g/L} \times 2.01 = 9,246 \mu\text{g/L}$$

Step 7: Select the lower of the AMEL and MDEL based on aquatic life and human health as the water-quality based effluent limit for the Order.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

For nickel:

AMEL _{aquatic life}	MDEL _{aquatic life}	AMEL _{human health}	MDEL _{human health}
6.8	13.6	4,600 µg/L	9,246 µg/L

The lowest (most restrictive) effluent limits are based on aquatic toxicity. The data set for each of the metals is small; five data points. Four of the five samples were non detected with only one sample yielding a concentration that exceeds applicable water quality criteria. Since the data set is so small with one data point demonstrated reasonable potential, this permit requires additional accelerated sampling.

e. Effluent Limitations for TSS and Metals Based on Intake Water Credits:

Section 1.4.4 of the SIP provides that, intake water credits for a pollutant may be established in an NPDES permit based on a Discharger's demonstration that the following conditions are met:

1. The observed maximum ambient background concentration, as determined in section 1.4.3.1 and the intake water concentration of the pollutant exceeds the most stringent applicable criterion/objective for that pollutant;
2. The intake water credits provided are consistent with any TMDL applicable to the discharge that has been approved by the Regional Water Board, State Water Board, and USEPA;
3. The intake water is from the same water body as the receiving water body. The discharger may demonstrate this condition by showing that;
 - a. the ambient background concentration of the pollutant in the receiving water, excluding any amount of the pollutant in the facility's discharge, is similar to that of the intake water;
 - b. there is a direct hydrological connection between the intake and discharge points;
 - c. the water quality characteristics are similar in the intake and receiving waters; and
 - d. the intake water pollutant would have reached the vicinity of the discharge point in the receiving water within a reasonable period of time and with the same effect had it not been diverted by the discharger.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

The Regional Water Board may also consider other factors when determining whether the intake water is from the same water body as the receiving water body;

4. The facility does not alter the intake water pollutant chemically or physically in a manner that adversely affects water quality and beneficial uses; and
5. The timing and location of the discharge does not cause adverse effects on water quality and beneficial uses that would not occur if the intake water pollutant had been left in the receiving water body.

Based on the monitoring data submitted as part of Source Identification Study in 2007 and additional information, the Discharger satisfies the conditions specified in Section 1.4.4 of the SIP. There are no TMDLs for ~~TSS, arsenic, cadmium, copper, nickel, selenium, silver, thallium, and zinc~~ for King Harbor nor is King Harbor listed for ~~TSS and arsenic, cadmium, copper, nickel, selenium, silver, thallium, and zinc~~ on the 2006 CWA 303(d) list of water quality limited segments. The intake water is from the same water body as the receiving water. ~~and the Discharger does not use or introduce metals or TSS in any of its Lagoon usage.~~

According to Section 1.4.4 of the SIP, the Regional Water Board may establish effluent limitations allowing the facility to discharge a mass and concentration of the intake water pollutant that is no greater than the mass and concentration found in the facility's intake water. The Regional Water Board may also determine compliance by simultaneously monitoring the pollutant concentrations in the intake water and in the effluent.

Monthly average intake concentration of pollutant is calculated by adding all analytical monitoring results in a calendar month divided by the number of monitoring events for that month. If only a single sample is taken during the calendar month then the analytical result for that sample will be considered as the monthly average value or result.

If the influent water pollutant concentration does not exceed the average monthly limitation then the limitations are applied as noted in Table F-10 Summary of Final Effluent Limitations Discharge Point 001. If the influent water pollutant concentration exceeds the average monthly limitation but does not exceed the maximum daily limitation then compliance with the average monthly limitation will be determined based on intake water credits and compliance with the maximum daily limitation is applied as noted in Table F-10. If the influent water pollutant concentration exceeds the maximum daily limitation then compliance with both the average monthly and the maximum daily will be determined based on intake water credits.

When applying intake water credit, the pollutant effluent limitation is equal to the maximum pollutant concentration in the influent water, which is the same as

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

the intake water. The equation is as follows:

Pollutant effluent limitation with intake water credit = maximum pollutant
influent water concentration

Two influent samples shall be collected to address the variability of the influent water. The first influent sample shall be collected two hours prior to the effluent sample. The second influent sample shall be collected at approximately the same time as the effluent sample. When evaluating compliance with the pollutant effluent limitations based on intake water credit, compare the pollutant effluent concentration to the maximum copper influent water concentration as follows:

If pollutant effluent concentration > maximum pollutant influent water concentration then violation.

If pollutant effluent concentration $\leq$ maximum pollutant influent water concentration then in compliance.

If pollutant monthly average effluent concentration $\leq$ monthly average pollutant influent concentration then in compliance.

(If only one effluent sample is taken per month, then the monitoring result has to comply with the monthly average limitation based on intake credits).

5. WQBELS based on Basin Plan Objectives

The Basin Plan states that the pH of bays or estuaries “*shall not be depressed below 6.5 or raised above 8.5 as a result of waste discharge and that ambient pH levels shall not be changed more than 0.2 units from natural conditions as a result of waste discharge.*” Based on the requirements of the Basin Plan an instantaneous minimum limitation of 6.5 and an instantaneous maximum limitation of 8.5 for pH are included in the proposed permit.

The Basin Plan lists temperature requirements for the receiving waters and references the Thermal Plan. Based on the requirements of the Thermal Plan and a white paper developed by Regional Water Board staff entitled *Temperature and Dissolved Oxygen Impacts on Biota in Tidal Estuaries and Enclosed Bays in the Los Angeles Region*, a maximum effluent temperature limitation of 86°F is included in the proposed permit. The white paper evaluated the optimum temperatures for steelhead, topsmelt, ghost shrimp, brown rock crab, jackknife clam, and blue mussel.

Unionized ammonia has been detected in the effluent during the previous permit term at a concentration of 0.1 mg/L. For inland surface waters not characteristic of freshwater (including enclosed bays, estuaries, and wetlands), the proposed objectives are a 4-day average concentration of unionized ammonia of 0.035 mg/L, and a one-hour average concentration of unionized ammonia of 0.233 mg/L. These objectives, as well as implementation procedures from the Basin Plan amendment are included in this Order as effluent limitations.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

6. Whole Effluent Toxicity (WET)

Whole effluent toxicity (WET) protects the receiving water quality from the aggregate toxic effect of a mixture of pollutants in the effluent. WET tests measure the degree of response of exposed aquatic test organisms to an effluent. The WET approach allows for protection of the narrative “no toxics in toxic amounts” criterion while implementing numeric criteria for toxicity. There are two types of WET tests: acute and chronic. An acute toxicity test is conducted over a short time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and may measure mortality, reproduction, and growth.

The Basin Plan specifies a narrative objective for toxicity, requiring that all waters be maintained free of toxic substances in concentrations that are lethal to or produce other detrimental responses by aquatic organisms. Detrimental response includes but is not limited to decreased growth rate, decreased reproductive success of resident or indicator species, and/or significant alterations in population, community ecology, or receiving water biota. The existing Order contains acute toxicity limitations and monitoring requirements in accordance with the Basin Plan, in which the acute toxicity objective for discharges dictates that the average survival in undiluted effluent for any three consecutive 96-hour static or continuous flow bioassay tests shall be at least 90%, with no single test having less than 70% survival. Annual acute toxicity data for the years 2005 through 2008 submitted by the Discharger showed 90-100% percent survival rates. Consistent with Basin Plan requirements, this Order carries over the acute toxicity limitations and monitoring requirements from the previous Order.

In addition to the Basin Plan requirements, Section 4 of the SIP states that a chronic toxicity effluent limitation is required in permits for all discharges that will cause, have the reasonable potential to cause, or contribute to chronic toxicity in receiving waters. No chronic toxicity data was available to determine reasonable potential. Therefore, this Order includes a requirement to conduct monitoring for chronic toxicity at a frequency of once per year.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

7. Final WQBELs

Summary of Water Quality-based Effluent Limitations for Discharge Point 001

Table F-9. Summary of Water Quality-based Effluent Limitations

Parameter	Units	Effluent Limitations	
		Average Monthly	Maximum Daily
Ammonia	mg/L	1.02 ¹	2.05 ¹
Arsenic, Total Recoverable	µg/L	30	59
	lbs/day ²	0.6	1.2
Cadmium, Total Recoverable	µg/L	7.7	15.4
	lbs/day ²	0.15	0.3
Copper, Total Recoverable	µg/L	3	6
	lbs/day ²	0.06	0.12
Nickel, Total Recoverable	µg/L	6.8	14
	lbs/day ²	0.13	0.27
Selenium, Total Recoverable	µg/L	58	117
	lbs/day ²	1.2	2.3
Silver, Total Recoverable	µg/L	1.1	2.2
	lbs/day ²	0.03	0.05
Thallium, Total Recoverable	µg/L	6.3	13
	lbs/day ²	0.12	0.25
Zinc, Total Recoverable	µg/L	47	95
	lbs/day ²	0.90	1.8
Acute Toxicity	% survival	--	³

1. Translation of un-ionized ammonia (NH₃) water quality objectives to total ammonia water quality objectives:

Total un-ionized ammonia (NH₃) water quality objectives of 0.035 mg/L for the 4-day average and 0.233 mg/L for the 1-hour average are to be translated to total ammonia (NH₄ + NH₃) utilizing the implementation procedure contained in Resolution No. 2004-022 which revised the saltwater ammonia water quality objectives in the 1994 Basin Plan. The equation for the translation is as follows:

$$[\text{NH}_4^+] + [\text{NH}_3] = [\text{NH}_3] + \text{NH}_3 \cdot 10^{\text{pK}_a^s + 0.0324(298 - T) + 0.0415(P/T - \text{pH})}$$

Where: P = 1 atm

T = temperature (°K)

$\text{pK}_a^s = 0.116 \cdot i + 9.245$, the stoichiometric acid hydrolysis constant of ammonium ions in saltwater based on i

$i = 19.9273 \text{ S} (1000 - 1.005109 \text{ S})^{-1}$, the molal ionic strength of saltwater based on S

S = salinity

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

In order to calculate total ammonia objectives, receiving water pH, temperature, and salinity data are required (for calculating current limits the following values were used: pH =8, temperature = 295°K, and salinity = 33 (ppt)).

- ² Mass based effluent limitations calculated using the following formula based on an average daily flow of 2.3 MGD: (lbs/day) = 2.3 MGD x 8.34 x effluent limitation (mg/L)
- ³ Average survival in effluent for any three consecutive 96-hour static or continuous flow bioassay tests shall be at least 90%, with no single test producing less than 70% survival.

D. Final Effluent Limitations

Section 402(o) of the CWA and section 122.44(l) require that effluent limitations or conditions in reissued Orders be at least as stringent as those in the existing Orders based on the submitted sampling data. Effluent limitations for pH, temperature, TSS, BOD, oil and grease, turbidity, total coliform, fecal coliform, enterococcus, and total residual chlorine at Discharge Point No. 001 are being carried over from the previous Order (Order No. R4-2005-0016). The Regional Water Board has determined that these numeric effluent limitations continue to be applicable to the Facility. ~~In addition, the effluent limitations for arsenic, cadmium, copper, nickel, selenium, silver, thallium, and zinc at Discharge Point No. 001 have been added to this Order because the Facility's discharge was found to have reasonable potential to exceed water quality criteria for these parameters.~~

In the ROWD, the Facility requested that the May sample be included in the monthly average results for June. Since the Facility discharges from Memorial Day through Labor day, the Facility has at maximum 6 days during which samples can be collected. Considering that the most frequent sample frequencies in the MRP is weekly, the monthly average for May becomes impractical. As a result, the effluent limitations in IV.A of this Order are modified so that the May results may be included in the monthly average value reported for June.

1. Satisfaction of Anti-Backsliding Requirements

All effluent limitations in this Order are at least as stringent as the effluent limitations in the previous Order.

2. Satisfaction of Antidegradation Policy

Section 131.12 requires that the state water quality standards include an anti-degradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

The permitted discharge is consistent with the antidegradation provision of section 131.12 and State Water Board Resolution No. 68-16 and the final limitations in this Order are in compliance with antidegradation requirements and meet the requirements of the SIP. The limits hold the Discharger to performance levels that will not cause or contribute to water quality impairment or further quality degradation that could result from an increase in the permitted design flow or a reduction in the level of treatment. Further, compliance with the requirements included in the permit will result in the use of best practicable treatment or control of the discharge.

3. Stringency of Requirements for Individual Pollutants

This Order contains both technology-based and water quality-based effluent limitations for individual pollutants. The technology-based effluent limitations consist of restrictions on for turbidity, BOD, oil and grease, total suspended solids, and total residual chlorine. This Order's technology-based pollutant restrictions implement the minimum, applicable federal technology-based requirements.

Table F-10. Summary of Final Effluent Limitations

Parameter	Units	Average Monthly	Maximum Daily	Instantaneous		Basis ¹
				Minimum	Maximum	
pH	s.u.	--	--	6.5	8.5	E, BP
BOD (5-day @ 20 Deg. C)	mg/L	20	30	--	--	E, BPJ
	lbs/day ²	384	575	--	--	
TSS	mg/L	50 ⁸	75 ⁸	--	--	E, BPJ
	lbs/day ²	959	1,439	--	--	
Oil and Grease	mg/L	10	15	--	--	E, BPJ
	lbs/day ²	192	288	--	--	
Turbidity	NTU	50	75	--	--	E, BPJ
Temperature	°F	--	--	--	86	E, TP
Chlorine, Total Residual	µg/L	2	8	--	--	E, BPJ
	lbs/day ²	0.038	0.15	--	--	
Total Coliform	mpn/100ml	1,000 ³	10,000	--	--	E, BP
Fecal Coliform	mpn/100ml	200 ⁴	400	--	--	E, BP
Enterococcus	mpn/100ml	35 ⁵	104	--	--	E, BPJ
Ammonia	mg/L	1.02 ⁶	2.05 ⁶	--	--	BP
Arsenic, Total Recoverable ⁸	µg/L	30 ⁸	59 ⁸	--	--	CTR
	lbs/day ²	0.6	1.2	--	--	
Cadmium, Total Recoverable ⁸	µg/L	7.7 ⁸	15.4 ⁸	--	--	CTR
	lbs/day ²	0.15	0.3	--	--	
Copper, Total Recoverable ⁸	µg/L	3 ⁸	6 ⁸	--	--	CTR
	lbs/day ²	0.06	0.12	--	--	

REVISED TENTATIVE

Parameter	Units	Average Monthly	Maximum Daily	Instantaneous		Basis ¹
				Minimum	Maximum	
Nickel, Total Recoverable ⁸	µg/L	6.8 ⁸	14 ⁸	--	--	CTR
	lbs/day ²	0.13	0.27	--	--	
Selenium, Total Recoverable ⁸	µg/L	58 ⁸	117 ⁸	--	--	CTR
	lbs/day ²	1.2	2.3	--	--	
Silver, Total Recoverable ⁸	µg/L	1.1 ⁸	2.2 ⁸	--	--	CTR
	lbs/day ²	0.03	0.05	--	--	
Thallium, Total Recoverable ⁸	µg/L	6.3 ⁸	13 ⁸	--	--	CTR
	lbs/day ²	0.12	0.25	--	--	
Zinc, Total Recoverable ⁸	µg/L	47 ⁸	95 ⁸	--	--	CTR
	lbs/day ²	0.90	1.8	--	--	
Acute Toxicity	% survival	--	7	--	--	E, BP

¹ BP = Basin Plan, E = Existing Permit, TP = Thermal Plan, BPJ = Best Professional Judgment, CTR = California Toxics Rule.

² Mass based effluent limitations calculated using the following formula based on an average daily flow of 2.3 MGD: (lbs/day) = 2.3 MGD x 8.34 x effluent limitation (mg/L)

³ The geometric mean density of total coliform organisms shall be less than 1,000 per 100 ml (10 per ml): provided that not more than 20% of the samples, in any 30-day period, may exceed 1,000 per 100 ml (10 per ml), and provided further that no single sample when verified by a repeat sample taken within 48 hours shall exceed 10,000 per 100 ml (100 per ml). Also, the total coliform density shall not exceed 1,000 per 100 ml if the ratio of fecal to total coliform exceeds 0.1.

⁴ The fecal coliform density for any 30-day period, shall not exceed a geometric mean of 200 per 100 ml nor shall more than 10% of the total samples during any 60-day period exceed 400 per 100ml.

⁵ The geometric mean enterococcus density of the discharge shall not exceed 35 organisms per 100 ml or 12 organisms per 100 ml within a six-month period.

⁶ Translation of un-ionized ammonia (NH₃) water quality objectives to total ammonia water quality objectives: Total un-ionized ammonia (NH₃) water quality objectives of 0.035 mg/L for the 4-day average and 0.233 mg/L for the 1-hour average are to be translated to total ammonia (NH₄ + NH₃) utilizing the implementation procedure contained in Resolution No. 2004-022 which revised the saltwater ammonia water quality objectives in the 1994 Basin Plan. The equation for the translation is as follows:

$$[\text{NH}_4^+] + [\text{NH}_3] = [\text{NH}_3] + [\text{NH}_4^+] \cdot 10^{(\text{pK}_a^s - \text{pH})}$$

Where: P = 1 atm

T = temperature (°K)

$\text{pK}_a^s = 0.116 \cdot i + 9.245$, the stoichiometric acid hydrolysis constant of ammonium ions in saltwater based on i

i = $19.9273 \cdot S (1000 - 1.005109 \cdot S)^{-1}$, the molal ionic strength of saltwater based on S

S = salinity

In order to calculate total ammonia objectives, receiving water pH, temperature, and salinity data are required (for calculating current limits the following values were used: pH = 8, temperature = 295°K, and salinity = 33 (ppt)).

⁷ Average survival in effluent for any three consecutive 96-hour static or continuous flow bioassay tests shall be at least 90%, with no single test producing less than 70% survival.

⁸ If the influent water pollutant concentration (measured at influent to the lagoon) does not exceed the average monthly limitation then the limitations are applied as noted in the Table. If the influent water pollutant concentration exceeds the average monthly limitation but does not exceed the maximum daily limitation then compliance with the average

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

monthly limitation will be determined based on intake water credits and compliance with the maximum daily limitation is applied as noted in the Table. If the influent water pollutant concentration exceeds the maximum daily limitation then compliance with both the average monthly and the maximum daily will be determined based on intake water credits. When determining compliance based on intake water credit, the pollutant effluent limitation is equal to the maximum pollutant concentration in the influent water. The equation is as follows:

Maximum Pollutant Effluent Limitation with Intake Water Credit = Maximum Pollutant Influent Water Concentration
Monthly Pollutant Effluent Limitation with Intake Water Credit = Monthly Pollutant Influent Water Concentration

4. Mass-based Effluent Limitations

Mass-based effluent limitations are established using the following formula:

Mass (lbs/day) = flow rate (MGD) x 8.34 x effluent limitation (mg/L)
where: Mass = mass limitation for a pollutant (lbs/day)
Effluent limitation = concentration limit for a pollutant (mg/L)
Flow rate = discharge flow rate (MGD)

E. Interim Effluent Limitations

Not Applicable

F. Land Discharge Specifications

Not Applicable

G. Reclamation Specifications

Not Applicable

V. RATIONALE FOR RECEIVING WATER LIMITATIONS

A. Surface Water

The Basin Plan contains numeric and narrative water quality objectives applicable to all surface waters within the Los Angeles Region. Water quality objectives include an objective to maintain the high quality waters pursuant to federal regulations (section 131.12) and State Water Board Resolution No. 68-16. Receiving water limitations in this Order are included to ensure protection of beneficial uses of the receiving water and are based on the water quality objectives contained in the Basin Plan.

B. Groundwater

Not Applicable

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

VI. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS

Section 122.48 requires that all NPDES permits specify requirements for recording and reporting monitoring results. Water Code sections 13267 and 13383 authorizes the Regional Water Board to require technical and monitoring reports. The Monitoring and Reporting Program (MRP), Attachment E of this Order, establishes monitoring and reporting requirements to implement federal and state requirements. The following provides the rationale for the monitoring and reporting requirements contained in the MRP for this Facility.

A. Influent Monitoring

Influent monitoring is required to collect data on the characteristics of the intake water and to assess compliance with the effluent limitations for TSS and metals.

According to section 1.4.4 of the SIP, the Regional Water Board may consider priority pollutants in intake water on a pollutant-by-pollutant basis when establishing WQBELs, provided the Discharger has demonstrated certain conditions specified in section 1.4.4 of the SIP. 40 CFR Part 122.45 provides a similar direction for TSS. The Discharger has demonstrated that intake water credit is appropriate for the discharge of TSS and metals. Therefore, the Discharger is required to monitor the intake water for TSS and metals at the specified frequency to provide data for the Regional Water Board to consider intake water credits.

B. Effluent Monitoring

Monitoring for those pollutants expected to be present in the Monitoring Location EFF-001 at Discharge Point No. 001 will be required as shown on the proposed MRP.

The sample collection location is tidally influenced. During high tide conditions, the sampling vault would be almost completely inundated with sea water and the effluent pipe would be completely submerged. Therefore, the grab samples collected during high tide may not be representative of the effluent. Sampling should be conducted when there is a discharge and during low tide conditions based on data provided by the National Oceanic and Atmospheric Administration's (NOAA), Station No. 9410840 (Santa Monica, CA).

To determine compliance with effluent limitations, the proposed monitoring plan carries over monitoring requirements from the MRP associated with Order No. R4-2005-0016, with some exceptions as follows.

1. TSS. The Facility was subject to three Time Schedule Orders (TSO). First one was for TSS and BOD and the last two were for TSS, as discussed in section II.D of this Fact Sheet. In order to more accurately assess the potential to exceed effluent limitations, the monitoring frequency of TSS is increased from once per month, in Order No. R4-2005-0016, to once per week in this Order. The Discharger has demonstrated that intake water credit is appropriate for the discharge of TSS. Therefore, influent monitoring is required to collect data of the intake water and to assess compliance with the effluent limitations for TSS.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

2. BOD. The monitoring frequency for BOD in effluent from Discharge Point No. 001 has been increased from once per year in Order No. R4-2005-0016 to once per month in this Order. BOD is a pollutant of concern because data collected from May 30, 2005, through August 31, 2009, resulted in four instances where the monthly average effluent concentration was greater than the monthly average limitation and seven instances where the effluent concentration was greater than the daily maximum limitation.
3. Temperature. Temperature is of concern in the discharge because the discharge consists of once through cooling water. To more accurately determine compliance with effluent limitations, the monitoring frequency for temperature is increased from once per year to once per month.

The Facility operates during the off-season for private events, which results in short-term discharges of one to two days. Order No. R4-2005-0016 established separate monitoring frequencies, during the off-season, of 1 per discharge for all parameters to account for the different discharge schedule. This monitoring frequency is capped at a maximum of 1 per week in the event that the facility operates longer than a week during the off-season.

According to the SIP, the Discharger is required to monitor the effluent for the CTR priority pollutants, to determine reasonable potential. Accordingly, the Regional Water Board is requiring that the Discharger conduct effluent monitoring of the CTR priority pollutants.

C. Whole Effluent Toxicity Testing Requirements

Whole effluent toxicity (WET) protects the receiving water quality from the aggregate toxic effect of a mixture of pollutants in the effluent. WET tests measure the degree of response of exposed aquatic test organisms to an effluent. The WET approach allows for protection of the narrative "no toxics in toxic amounts" criterion while implementing numeric criteria for toxicity. There are two types of WET tests: acute and chronic. An acute toxicity test is conducted over a short time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and may measure mortality, reproduction, and growth.

The Basin Plan specifies a narrative objective for toxicity, requiring that all waters be maintained free of toxic substances in concentrations that are lethal to or produce other detrimental responses by aquatic organisms. Detrimental response includes but is not limited to decreased growth rate, decreased reproductive success of resident or indicator species, and/or significant alterations in population, community ecology, or receiving water biota. This Order includes limitations for acute toxicity, and therefore, monitoring requirements are included in the MRP.

Section 4 of the SIP states that a chronic toxicity effluent limitation is required in permits for all discharges that will cause, have the reasonable potential to cause, or contribute to chronic toxicity in receiving waters. Since no chronic toxicity monitoring data of the discharge exists to determine reasonable potential, this Order does not include chronic toxicity limitations. In order to collect data for future RPAs, monitoring for chronic toxicity is required in the MRP of this Order.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

D. Receiving Water Monitoring

1. Surface Water

This Order includes receiving water limitations and therefore, monitoring requirements are included in the MRP to determine compliance with the receiving water limitations established in Limitations and Discharge Requirements, Receiving Water Limitations, section V.A. Monitoring for temperature, pH, and dissolved oxygen in the receiving water, within 50 feet of the discharge, outside of the influence of the discharge, is included in the proposed permit. The facility is also required to perform general observations of the receiving water when discharges occur and report the observations in the monitoring report. Attention shall be given to the presence or absence of: floating or suspended matter, discoloration, aquatic life, visible film, sheen or coating, and fungi, slime, or objectionable growths.

This Order includes temperature limitations in section IV.A that specify *“The maximum temperature of the discharge shall not exceed the natural receiving water temperature by more than 20° F”*. In order to monitor compliance with this limitation, a monitoring requirement for temperature at RSW-001 is included in this Order.

According to the SIP, the Discharger is required to monitor the upstream receiving water for the CTR priority pollutants and TCDD congeners, to determine reasonable potential. Accordingly, the Regional Water Board is requiring that the Discharger conduct upstream receiving water monitoring of the CTR priority pollutants and TCDD congeners at Monitoring Location RSW-001. The Discharger must analyze temperature, pH, and hardness of the upstream receiving water at the same time the samples are collected for priority pollutants analysis.

2. Groundwater

Not Applicable

E. Other Monitoring Requirements

Not Applicable

VII. RATIONALE FOR PROVISIONS

A. Standard Provisions

Standard Provisions, which apply to all NPDES permits in accordance with section 122.41, and additional conditions applicable to specified categories of permits in accordance with section 122.42, are provided in Attachment D. The discharger must comply with all standard provisions and with those additional conditions that are applicable under section 122.42.

Section 122.41(a)(1) and (b) through (n) establish conditions that apply to all State-issued NPDES permits. These conditions must be incorporated into the permits either expressly

or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. Section 123.25(a)(12) allows the state to omit or modify conditions to impose more stringent requirements. In accordance with section 123.25, this Order omits federal conditions that address enforcement authority specified in sections 122.41(j)(5) and (k)(2) because the enforcement authority under the Water Code is more stringent. In lieu of these conditions, this Order incorporates by reference Water Code section 13387(e).

B. Special Provisions

1. Reopener Provisions

These provisions are based on section 123 and the previous Order. The Regional Water Board may reopen the permit to modify permit conditions and requirements. Causes for modifications include the promulgation of new federal regulations, modification in toxicity requirements, or adoption of new regulations by the State Water Board or Regional Water Board, including revisions to the Basin Plan.

This Order may be reopened on or before the end of 1st Quarter of 2013 (March 31, 2013), if the Special Study results necessitates changes to the permit.

2. Work Plan for Special Studies

a. The City of Redondo Beach's Work Plan for Seaside Lagoon is due to the Regional Water Board on February 7, 2011, for Executive Officer approval. The objectives of the Special Study to:

- develop and implement an accelerated monitoring program (weekly sampling, at a minimum) for metals in the influent and effluent,
- refine sampling protocols (grab vs. composite),
- refine data collection points,
- refine data collection timing and other logistics in order to have the best data set for determining reasonable potential, intake credits and other permit provisions,
- examine sampling and laboratory protocols to insure adequate QA/QC.

b. The first phase of the study should occur during the 2011 operating season.

c. In the Fall of 2011, City of Redondo Beach staff must schedule a meeting with Regional Water Board staff to review and analyze the data. If Regional Water Board staff determines that the data set is adequate, it will be used to re-evaluate reasonable potential. If the data set is not adequate then a second season of monitoring (Summer 2012) will be planned and executed.

d. If the data indicates the inclusion of new limitations for the metals is warranted, the permit will be reopened to include them.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

This permit includes a reopener for 1st Quarter of 2013 (March 31, 2013) at the latest, to address the results of the Special Study Monitoring.

3. Special Studies and Additional Monitoring Requirements

- a. Chronic Toxicity Trigger. This provision is based on Section 4 of the SIP, Toxicity Control Provisions.
- b. Initial Investigation Toxicity Reduction Evaluation Workplan. This provision is based on section 4 of the SIP, Toxicity Control Provisions.

4. Best Management Practices and Pollution Prevention

In addition to providing a swimming lagoon, the Facility conducts other recreational activities that may introduce pollutants of concern. Therefore, this Order requires the Discharger to develop and implement a BMPP which should include measures to prevent pollutants from entering the lagoon. To ensure the Discharger considers and implements appropriate and effective BMPs, the Discharger is required to consider implementing BMPs contained in the USEPA *Guidance Manual for Developing Best Management Practices (BMPs)* (EPA 833-B-93-004) or equivalent alternatives when updating its BMPP. This provision is based on 40 CFR 122.44(k).

5. Construction, Operation, and Maintenance Specifications

This provision is based on the requirements of section 122.41(e).

6. Other Special Provisions

Not Applicable

7. Compliance Schedules

Not Applicable

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

VIII. PUBLIC PARTICIPATION

The Regional Water Board is considering the issuance of waste discharge requirements WDRs that will serve as a NPDES permit for the Facility. As a step in the WDR adoption process, the Regional Water Board staff has developed tentative WDRs. The Regional Water Board encourages public participation in the WDR adoption process.

A. Notification of Interested Parties

The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe waste discharge requirements for the discharge and has provided them with an opportunity to submit their written comments and recommendations.

Notification of Interested Parties Written Comments

B. Written Comments

The staff determinations are tentative. Interested persons are invited to submit written comments concerning these tentative WDRs. Comments must be submitted either in person or by mail to the Executive Office at the Regional Water Board at the address above on the cover page of this Order.

To be fully responded to by staff and considered by the Regional Water Board, written comments must be received at the Regional Water Board offices by 5:00 p.m. on August 31, 2010.

C. Public Hearing

The Regional Water Board will hold a public hearing on the tentative WDRs during its regular Board meeting on the following date and time and at the following location:

Date: October 7, 2010
Time: 9:00 A.M.
Location: ~~Metropolitan Water District of Southern California, Board Room~~
~~700 North Alameda Street, Los Angeles, California.~~
City of Simi Valley
2929 Tapo Canyon Road
Simi Valley, CA

Interested persons are invited to attend. At the public hearing, the Regional Water Board will hear testimony, if any, pertinent to the discharge, WDRs, and permit. Oral testimony will be heard; however, for accuracy of the record, important testimony should be in writing.

Please be aware that dates and venues may change. Our Web address is <http://www.waterboards.ca.gov/losangeles> where you can access the current agenda for changes in dates and locations.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

D. Nature of Hearing

This will be a formal adjudicative hearing pursuant to section 648 et seq. of title 23 of the California Code of Regulations. Chapter 5 of the California Administrative Procedure Act (commencing with section 11500 of the Government Code) will not apply to this proceeding.

Ex Parte Communications Prohibited: As a quasi-adjudicative proceeding, no board member may discuss the subject of this hearing with any person, except during the public hearing itself. Any communications to the Regional Water Board must be directed to staff.

E. Parties to the Hearing

The following are the parties to this proceeding:

1. The applicant/permittee

Any other persons requesting party status must submit a written or electronic request to staff not later than 20 business days before the hearing. All parties will be notified if other persons are so designated.

F. Public Comments and Submittal of Evidence

Persons wishing to comment upon or object to the tentative waste discharge requirements, or submit evidence for the Board to consider, are invited to submit them in writing to the above address. To be evaluated and responded to by staff, included in the Board's agenda folder, and fully considered by the Board, written comments must be received no later than close of business August 31, 2010. Comments or evidence received after that date will be submitted, ex agenda, to the Board for consideration, but only included in administrative record with express approval of the Chair during the hearing. Additionally, if the Board receives only supportive comments, the permit may be placed on the Board's consent calendar, and approved without an oral testimony.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

G. Hearing Procedure

The meeting, in which the hearing will be a part of, will start at 9:00 a.m. Interested persons are invited to attend. Staff will present the matter under consideration, after which oral statements from parties or interested persons will be heard. For accuracy of the record, all important testimony should be in writing. The Board will include in the administrative record written transcriptions of oral testimony that is actually presented at the hearing. Oral testimony may be limited to 3 minutes maximum or less for each speaker, depending on the number of persons wishing to be heard. Parties or persons with similar concerns or opinions are encouraged to choose one representative to speak. At the conclusion of testimony, the Board will deliberate in open or close session, and render a decision.

Parties or persons with special procedural requests should contact staff. Any procedure not specified in this hearing notice will be waived pursuant to section 648(d) of title 23 of the California Code of Regulations. Objections to any procedure to be used during this hearing must be submitted in writing not later than close of 15 business days prior to the date of the hearing. Procedural objections will not be entertained at the hearing.

H. Waste Discharge Requirements Petitions

Any aggrieved person may petition the State Water Resources Control Board to review the decision of the Regional Water Board regarding the final WDRs. The petition must be submitted within 30 days of the Regional Water Board's action to the following address:

State Water Resources Control Board
Office of Chief Counsel
P.O. Box 100, 1001 I Street
Sacramento, CA 95812-0100

I. Information and Copying

The Report of Waste Discharge (RWD), related documents, tentative effluent limitations and special provisions, comments received, and other information are on file and may be inspected at the address above at any time between 8:30 a.m. and 4:45 p.m., Monday through Friday. Copying of documents may be arranged through the Regional Water Board by calling (213) 576 – 6600.

J. Register of Interested Persons

Any person interested in being placed on the mailing list for information regarding the WDRs and NPDES permit should contact the Regional Water Board, reference this facility, and provide a name, address, and phone number.

K. Additional Information

Requests for additional information or questions regarding this order should be directed to Mazhar Ali at (213) 576-6652.

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT G – STATE WATER BOARDS MINIMUM LEVELS

The Minimum Levels (MLs) in this appendix are for use in reporting and compliance determination purposes in accordance with section 2.4 of the State Implementation Policy. These MLs were derived from data for priority pollutants provided by State certified analytical laboratories in 1997 and 1998. These MLs shall be used until new values are adopted by the State Water Board and become effective. The following tables (Tables 2a - 2d) present MLs for four major chemical groupings: volatile substances, semi-volatile substances, inorganics, and pesticides and PCBs.

Table 2a - VOLATILE SUBSTANCES*	GC	GCMS
1,1 Dichloroethane	0.5	1
1,1 Dichloroethylene	0.5	2
1,1,1 Trichloroethane	0.5	2
1,1,2 Trichloroethane	0.5	2
1,1,2,2 Tetrachloroethane	0.5	1
1,2 Dichlorobenzene (volatile)	0.5	2
1,2 Dichloroethane	0.5	2
1,2 Dichloropropane	0.5	1
1,3 Dichlorobenzene (volatile)	0.5	2
1,3 Dichloropropene (volatile)	0.5	2
1,4 Dichlorobenzene (volatile)	0.5	2
Acrolein	2.0	5
Acrylonitrile	2.0	2
Benzene	0.5	2
Bromoform	0.5	2
Methyl Bromide	1.0	2
Carbon Tetrachloride	0.5	2
Chlorobenzene	0.5	2
Chlorodibromo-methane	0.5	2
Chloroethane	0.5	2
Chloroform	0.5	2
Chloromethane	0.5	2
Dichlorobromo-methane	0.5	2
Dichloromethane	0.5	2
Ethylbenzene	0.5	2
Tetrachloroethylene	0.5	2
Toluene	0.5	2
Trans-1,2 Dichloroethylene	0.5	1
Trichloroethene	0.5	2
Vinyl Chloride	0.5	2

*The normal method-specific factor for these substances is 1; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
Benzo (a) Anthracene	10	5		
1,2 Dichlorobenzene (semivolatile)	2	2		
1,2 Diphenylhydrazine		1		
1,2,4 Trichlorobenzene	1	5		

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
1,3 Dichlorobenzene (semivolatile)	2	1		
1,4 Dichlorobenzene (semivolatile)	2	1		
2 Chlorophenol	2	5		
2,4 Dichlorophenol	1	5		
2,4 Dimethylphenol	1	2		
2,4 Dinitrophenol	5	5		
2,4 Dinitrotoluene	10	5		
2,4,6 Trichlorophenol	10	10		
2,6 Dinitrotoluene		5		
2- Nitrophenol		10		
2-Chloroethyl vinyl ether	1	1		
2-Chloronaphthalene		10		
3,3' Dichlorobenzidine		5		
Benzo (b) Fluoranthene		10	10	
3-Methyl-Chlorophenol	5	1		
4,6 Dinitro-2-methylphenol	10	5		
4- Nitrophenol	5	10		
4-Bromophenyl phenyl ether	10	5		
4-Chlorophenyl phenyl ether		5		
Acenaphthene	1	1	0.5	
Acenaphthylene		10	0.2	
Anthracene		10	2	
Benzidine		5		
Benzo(a) pyrene		10	2	
Benzo(g,h,i)perylene		5	0.1	
Benzo(k)fluoranthene		10	2	
bis 2-(1-Chloroethoxyl) methane		5		
bis(2-chloroethyl) ether	10	1		
bis(2-Chloroisopropyl) ether	10	2		
bis(2-Ethylhexyl) phthalate	10	5		
Butyl benzyl phthalate	10	10		
Chrysene		10	5	
di-n-Butyl phthalate		10		
di-n-Octyl phthalate		10		
Dibenzo(a,h)-anthracene		10	0.1	
Diethyl phthalate	10	2		
Dimethyl phthalate	10	2		
Fluoranthene	10	1	0.05	
Fluorene		10	0.1	
Hexachloro-cyclopentadiene	5	5		
Hexachlorobenzene	5	1		
Hexachlorobutadiene	5	1		
Hexachloroethane	5	1		
Indeno(1,2,3,cd)-pyrene		10	0.05	
Isophorone	10	1		
N-Nitroso diphenyl amine	10	1		
N-Nitroso-dimethyl amine	10	5		
N-Nitroso -di n-propyl amine	10	5		
Naphthalene	10	1	0.2	
Nitrobenzene	10	1		
Pentachlorophenol	1	5		
Phenanthrene		5	0.05	

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
Phenol **	1	1		50
Pyrene		10	0.05	

* With the exception of phenol by colorimetric technique, the normal method-specific factor for these substances is 1,000; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 1,000.

** Phenol by colorimetric technique has a factor of 1.

Table 2c – INORGANICS*	FAA	GFAA	ICP	ICPMS	SPGFAA	HYDRIDE	CVAA	COLOR	DCP
Antimony	10	5	50	0.5	5	0.5			1,000
Arsenic		2	10	2	2	1		20	1,000
Beryllium	20	0.5	2	0.5	1				1,000
Cadmium	10	0.5	10	0.25	0.5				1,000
Chromium (total)	50	2	10	0.5	1				1,000
Chromium VI	5							10	
Copper	25	5	10	0.5	2				1,000
Cyanide								5	
Lead	20	5	5	0.5	2				10,000
Mercury				0.5			0.2		
Nickel	50	5	20	1	5				1,000
Selenium		5	10	2	5	1			1,000
Silver	10	1	10	0.25	2				1,000
Thallium	10	2	10	1	5				1,000
Zinc	20		20	1	10				1,000

* The normal method-specific factor for these substances is 1; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

Table 2d – PESTICIDES – PCBs*	GC
4,4'-DDD	0.05
4,4'-DDE	0.05
4,4'-DDT	0.01
a-Endosulfan	0.02
alpha-BHC	0.01
Aldrin	0.005
b-Endosulfan	0.01
Beta-BHC	0.005
Chlordane	0.1
Delta-BHC	0.005
Dieldrin	0.01
Endosulfan Sulfate	0.05
Endrin	0.01
Endrin Aldehyde	0.01
Heptachlor	0.01
Heptachlor Epoxide	0.01
Gamma-BHC (Lindane)	0.02
PCB 1016	0.5

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

Table 2d – PESTICIDES – PCBs*	GC
PCB 1221	0.5
PCB 1232	0.5
PCB 1242	0.5
PCB 1248	0.5
PCB 1254	0.5
PCB 1260	0.5
Toxaphene	0.5

- * The normal method-specific factor for these substances is 100; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 100.

Techniques:

GC - Gas Chromatography

GCMS - Gas Chromatography/Mass Spectrometry

HRGCMS - High Resolution Gas Chromatography/Mass Spectrometry (i.e., EPA 1613, 1624, or 1625)

LC - High Pressure Liquid Chromatography

FAA - Flame Atomic Absorption

GFAA - Graphite Furnace Atomic Absorption

HYDRIDE - Gaseous Hydride Atomic Absorption

CVAA - Cold Vapor Atomic Absorption

ICP - Inductively Coupled Plasma

ICPMS - Inductively Coupled Plasma/Mass Spectrometry

SPGFAA - Stabilized Platform Graphite Furnace Atomic Absorption (i.e., EPA 200.9)

DCP - Direct Current Plasma

COLOR – Colorimetric

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT H – LIST OF PRIORITY POLLUTANTS

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
1	Antimony	7440360	1
2	Arsenic	7440382	1
3	Beryllium	7440417	1
4	Cadmium	7440439	1
5a	Chromium (III)	16065831	1
5a	Chromium (VI)	18540299	1
6	Copper	7440508	1
7	Lead	7439921	1
8	Mercury	7439976	1
9	Nickel	7440020	1
10	Selenium	7782492	1
11	Silver	7440224	1
12	Thallium	7440280	1
13	Zinc	7440666	1
14	Cyanide	57125	1
15	Asbestos	1332214	1
16	2,3,7,8-TCDD	1746016	1
17	Acrolein	107028	1
18	Acrylonitrile	107131	1
19	Benzene	71432	1
20	Bromoform	75252	1
21	Carbon Tetrachloride	56235	1
22	Chlorobenzene	108907	1
23	Chlorodibromomethane	124481	1
24	Chloroethane	75003	1
25	2-Chloroethylvinyl Ether	110758	1
26	Chloroform	67663	1
27	Dichlorobromomethane	75274	1
28	1,1-Dichloroethane	75343	1
29	1,2-Dichloroethane	107062	1
30	1,1-Dichloroethylene	75354	1
31	1,2-Dichloropropane	78875	1
32	1,3-Dichloropropylene	542756	1
33	Ethylbenzene	100414	1
34	Methyl Bromide	74839	1
35	Methyl Chloride	74873	1
36	Methylene Chloride	75092	1
37	1,1,2,2-Tetrachloroethane	79345	1
38	Tetrachloroethylene	127184	1
39	Toluene	108883	1
40	1,2-Trans-Dichloroethylene	156605	1
41	1,1,1-Trichloroethane	71556	1
42	1,1,2-Trichloroethane	79005	1

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
43	Trichloroethylene	79016	†
44	Vinyl Chloride	75014	†
45	2-Chlorophenol	95578	†
46	2,4-Dichlorophenol	120832	†
47	2,4-Dimethylphenol	105679	†
48	2-Methyl-4,6-Dinitrophenol	534521	†
49	2,4-Dinitrophenol	51285	†
50	2-Nitrophenol	88755	†
51	4-Nitrophenol	100027	†
52	3-Methyl-4-Chlorophenol	59507	†
53	Pentachlorophenol	87865	†
54	Phenol	108952	†
55	2,4,6-Trichlorophenol	88062	†
56	Acenaphthene	83329	†
57	Acenaphthylene	208968	†
58	Anthracene	120127	†
59	Benzidine	92875	†
60	Benzo(a)Anthracene	56553	†
61	Benzo(a)Pyrene	50328	†
62	Benzo(b)Fluoranthene	205992	†
63	Benzo(ghi)Perylene	191242	†
64	Benzo(k)Fluoranthene	207089	†
65	Bis(2-Chloroethoxy)Methane	111911	†
66	Bis(2-Chloroethyl)Ether	111444	†
67	Bis(2-Chloroisopropyl)Ether	108601	†
68	Bis(2-Ethylhexyl)Phthalate	117817	†
69	4-Bromophenyl Phenyl Ether	101553	†
70	Butylbenzyl Phthalate	85687	†
71	2-Chloronaphthalene	91587	†
72	4-Chlorophenyl Phenyl Ether	7005723	†
73	Chrysene	218019	†
74	Dibenzo(a,h)Anthracene	53703	†
75	1,2-Dichlorobenzene	95501	†
76	1,3-Dichlorobenzene	541731	†
77	1,4-Dichlorobenzene	106467	†
78	3,3'-Dichlorobenzidine	91941	†
79	Diethyl Phthalate	84662	†
80	Dimethyl Phthalate	131113	†
81	Di-n-Butyl Phthalate	84742	†
82	2,4-Dinitrotoluene	121142	†
83	2,6-Dinitrotoluene	606202	†
84	Di-n-Octyl Phthalate	117840	†
85	1,2-Diphenylhydrazine	122667	†
86	Fluoranthene	206440	†

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
87	Fluorene	86737	1
88	Hexachlorobenzene	118741	1
89	Hexachlorobutadiene	87863	1
90	Hexachlorocyclopentadiene	77474	1
91	Hexachloroethane	67721	1
92	Indeno(1,2,3-cd)Pyrene	193395	1
93	Isophorone	78591	1
94	Naphthalene	91203	1
95	Nitrobenzene	98953	1
96	N-Nitrosodimethylamine	62759	1
97	N-Nitrosodi-n-Propylamine	621647	1
98	N-Nitrosodiphenylamine	86306	1
99	Phenanthrene	85018	1
100	Pyrene	129000	1
101	1,2,4-Trichlorobenzene	120821	1
102	Aldrin	309002	1
103	alpha-BHC	319846	1
104	beta-BHC	319857	1
105	gamma-BHC	58899	1
106	delta-BHC	319868	1
107	Chlordane	57749	1
108	4,4'-DDT	50293	1
109	4,4'-DDE	72559	1
110	4,4'-DDD	72548	1
111	Dieldrin	60571	1
112	alpha-Endosulfan	959988	1
113	beta-Endosulfan	33213659	1
114	Endosulfan Sulfate	1031078	1
115	Endrin	72208	1
116	Endrin Aldehyde	7421934	1
117	Heptachlor	76448	1
118	Heptachlor Epoxide	1024573	1
119	PCB-1016	12674112	1
120	PCB-1221	11104282	1
121	PCB-1232	11141165	1
122	PCB-1242	53469219	1
123	PCB-1248	12672296	1
124	PCB-1254	11097691	1
125	PCB-1260	11096825	1
126	Toxaphene	8001352	1

1. Pollutants shall be analyzed using the methods described in 40 CFR Part 136

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT I – RPA ANALYSIS

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT J – PHOTOS OF FACILITY

Source: City of Redondo Beach Recreation and Community Services Department.
http://www.redondo.org/depts/recreation/facilities/seaside_lagoon/photos.asp



View from Southwest



Slides on Platform on South Side

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E



Layout of Seaside Lagoon



View from Southwest, King Harbor in Distance

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

ATTACHMENT I – RPA ANALYSIS

R
E
V
I
S
E
D

T
E
N
T
A
T
I
V
E

REASONABLE POTENTIAL ANALYSIS (RPA)																			
Parameters	Units	CV	MEC	CTR Water Quality Criteria (ug/L)		Organisms only	Human Health for	Tier 1 - Need limit?						Enter the pollutant B max conc (ug/L)	If all B is ND, is MDL > C?	If B > C, effluent limit required	Tier 3 - other info.	RPA Result - Need Limit?	Reason
				C acute = CMC tot	C chronic = CCC tot			MEC >= Lowest C	MEC >= Lowest C	B Available (Y/N)?	Are all B data points non-detects (Y/N)?	Enter the min detection limit (MDL)							
Antimony	ug/L	0.6	4450			4300.00		Yes	Yes	Y	N		4500		Limit required, B>C & pollutant		No	More data required	
Arsenic	ug/L	0.6	730			36.00		No Criteria	No Criteria	Y	N		680		Limit required, B>C & pollutant		No	More data required	
Beryllium	ug/L	0.6	No Criteria			Narrative		Yes	Yes	Y	N		40		Limit required, B>C & pollutant		No	More data required	
Cadmium	ug/L	0.6	40			Narrative		No Criteria	No Criteria	Y	N				No Criteria	No Criteria	UC	No Criteria	
Chromium (III)	ug/L	No Criteria	No Criteria			Narrative		No	No	Y	Y	10	97	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Chromium (VI)	ug/L	0.6	11	1107.75	50.35	3.73		No	No	Y	N				Limit required, B>C & pollutant		No	More data required	
Copper	ug/L	0.6	88	5.78	8.52	3.73		Yes	Yes	Y	N		0.29		B<=C, Step 7		No	MEC<C & B<=C	
Lead	ug/L	0.4	220.82	Reserved	8.52	Narrative		No	No	Y	N				No detected value of B, Step 7		No	UD: effluent ND, MDL>C, and	
Mercury	ug/L	0.6	100	Reserved	8.28	0.051		Yes	Yes	Y	N		0.5	Y	Limit required, B>C & pollutant		No	More data required	
Nickel	ug/L	0.6	3210	74.75	71.14	4600.00		Yes	Yes	Y	N		100		Limit required, B>C & pollutant		No	More data required	
Selenium	ug/L	0.6	1230	290.58	2.24	Narrative		Yes	Yes	Y	N		3390		Limit required, B>C & pollutant		No	More data required	
Silver	ug/L	0.6	3170	2.24	6.30	6.30		Yes	Yes	Y	N		1170		Limit required, B>C & pollutant		No	More data required	
Thallium	ug/L	0.6	114	85.62	1.00	85.62		Yes	Yes	Y	N		3250		Limit required, B>C & pollutant		No	More data required	
Zinc	ug/L	0.6	0.005	1.00	1.00	220000.00		No	No	Y	N		66		B<=C, Step 7		No	More data required	
Cyanide	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.005	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Asbestos	Fibers/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.2	N	No Criteria	No Criteria	UC	No Criteria	
2,3,7,8 TCDD	ug/L	0	0	1.40E-08	1.40E-08	1.40E-08		No	No	Y	Y		0	N	No detected value of B, Step 7		No	MEC<C & B is ND	
TCDD Equivalents	ug/L	0	0	1.40E-08	1.40E-08	1.40E-08		No	No	Y	Y		0	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Acrolein	ug/L	0.54	0.54	780	780	780		No	No	Y	Y		0.54	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Acrylonitrile	ug/L	0.34	0.34	0.66	0.66	0.66		No	No	Y	Y		0.34	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Benzene	ug/L	0.39	0.39	71	71	71		No	No	Y	Y		0.39	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Bromoforn	ug/L	143	143	360	360	360		No	No	Y	Y		6.9	N	B<=C, Step 7		No	MEC<C & B<=C	
Carbon Tetrachloride	ug/L	0.3	0.3	4.4	4.4	4.4		No	No	Y	Y		0.3	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Chlorobenzene	ug/L	0.2	0.2	21000	21000	21000		No	No	Y	Y		0.29	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Chlorobromomethane	ug/L	4.3	4.3	34	34	34		No	No	Y	Y		0.2	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Chloroethane	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.4	N	No Criteria	No Criteria	UC	No Criteria	
2-Chloroethylvinyl ether	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y			N	No Criteria	No Criteria	UC	No Criteria	
Chloroform	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y			N	No Criteria	No Criteria	UC	No Criteria	
Dichlorobromomethane	ug/L	0.34	0.34	46	46	46		No	No	Y	Y		0.34	N	No detected value of B, Step 7		No	MEC<C & B is ND	
1,1-Dichloroethane	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.33	N	No detected value of B, Step 7		No	No Criteria	
1,2-Dichloroethane	ug/L	0.33	0.33	99	99	99		No	No	Y	Y		0.33	N	No detected value of B, Step 7		No	MEC<C & B is ND	
1,1-Dichloroethylene	ug/L	0.43	0.43	3.2	3.2	3.2		No	No	Y	Y		0.33	N	No detected value of B, Step 7		No	MEC<C & B is ND	
1,2-Dichloropropane	ug/L	0.29	0.29	39	39	39		No	No	Y	Y		0.43	N	No detected value of B, Step 7		No	MEC<C & B is ND	
1,3-Dichloropropylene	ug/L	0.34	0.34	1700	1700	1700		No	No	Y	Y		0.29	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Ethylbenzene	ug/L	0.24	0.24	29000	29000	29000		No	No	Y	Y		0.34	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Methyl Bromide	ug/L	0.46	0.46	4000	4000	4000		No	No	Y	Y		0.24	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Methyl Chloride	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.46	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Methylene Chloride	ug/L	0.91	0.91	1600	1600	1600		No	No	Y	Y		0.33	N	No detected value of B, Step 7		No	No Criteria	
1,1,2,2-Tetrachloroethane	ug/L	0.22	0.22	11	11	11		No	No	Y	Y		0.91	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Tetrachloroethylene	ug/L	0.25	0.25	8.95	8.95	8.95		No	No	Y	Y		0.22	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Toluene	ug/L	0.24	0.24	200000	200000	200000		No	No	Y	Y		0.25	N	No detected value of B, Step 7		No	MEC<C & B is ND	
1,2-Trans-Dichloroethylene	ug/L	0.32	0.32	140000	140000	140000		No	No	Y	Y		0.24	N	No detected value of B, Step 7		No	MEC<C & B is ND	
1,1,1-Trichloroethane	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.32	N	No detected value of B, Step 7		No	MEC<C & B is ND	
1,1,2-Trichloroethane	ug/L	0.38	0.38	42	42	42		No	No	Y	Y		0.29	N	No detected value of B, Step 7		No	No Criteria	
Trichloroethylene	ug/L	0.45	0.45	81	81	81		No	No	Y	Y		0.32	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Vinyl Chloride	ug/L	0.46	0.46	525	525	525		No	No	Y	Y		0.45	N	No detected value of B, Step 7		No	MEC<C & B is ND	
2-Chlorophenol	ug/L	0.32	0.32	400	400	400		No	No	Y	Y		0.46	N	No detected value of B, Step 7		No	MEC<C & B is ND	
2,4-Dichlorophenol	ug/L	0.93	0.93	790	790	790		No	No	Y	Y		0.32	N	No detected value of B, Step 7		No	MEC<C & B is ND	
2,4-Dimethylphenol	ug/L	0.63	0.63	2300	2300	2300		No	No	Y	Y		0.93	N	No detected value of B, Step 7		No	MEC<C & B is ND	
4,6-dinitro-o-resol (aka 2-methyl-4,6-Dinitrophenol)	ug/L	2.8	2.8	765	765	765		No	No	Y	Y		0.63	N	No detected value of B, Step 7		No	MEC<C & B is ND	
2,4-Dinitrophenol	ug/L	3.1	3.1	14000	14000	14000		No	No	Y	Y		2.8	N	No detected value of B, Step 7		No	MEC<C & B is ND	
4-Nitrophenol	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		3.1	N	No detected value of B, Step 7		No	MEC<C & B is ND	
3-Methyl-4-Chlorophenol (aka p-chloro-m-resol)	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.95	N	No Criteria	No Criteria	UC	No Criteria	
Benzo(a)Anthracene	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		1.7	N	No Criteria	No Criteria	UC	No Criteria	
Phenol	ug/L	1	1	4600000	4600000	4600000		No	No	Y	Y		1.2	N	No Criteria	No Criteria	UC	No Criteria	
2,4,6-Trichlorophenol	ug/L	0.49	0.49	6.5	6.5	6.5		No	No	Y	Y		2.2	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Acenaphthene	ug/L	0.55	0.55	2700	2700	2700		No	No	Y	Y		1	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Acenaphthylene	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.49	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Anthracene	ug/L	0.64	0.64	110000	110000	110000		No	No	Y	Y		0.55	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Benzo(a)Pyrene	ug/L	0.049	0.049	0.00054	0.00054	0.00054		No	No	Y	Y		0.64	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Benzo(b)Fluoranthene	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.53	N	No detected value of B, Step 7		No	MEC<C & B is ND	
Benzo(k)Fluoranthene	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.56	Y	No detected value of B, Step 7		No	UD: effluent data & no B	
Bis(2-Chloroethoxy)Methan	ug/L	No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.77	Y	No detected value of B, Step 7		No	UD: effluent ND, MDL>C, and	
		No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.77	N	No detected value of B, Step 7		No	UD: effluent ND, MDL>C, and	
		No Criteria	No Criteria			No Criteria		No	No	Y	Y		0.82	N	No detected value of B, Step 7		No	No Criteria	

REASONABLE POTENTIAL ANALYSIS (RPA)															
Parameters	Units	CV	CTR Water Quality Criteria (ug/L)			MEC >= Lowest C	Tier 1 - Need limit?	B Available (Y/N)?	Are all B data points non-detects (Y/N)?	If all data points ND Enter the detection limit (MDL) min (ug/L)	Enter the pollutant B max conc (ug/L)	If all B is ND, is MDL > C?	Tier 3 - other info. ?	RPA Result - Need Limit?	Reason
			Saltwater	C acute = CMC tot	C chronic = CCC tot										
Bis(2-Chloroethyl) Ether	ug/L				0.45									No	MEC < C & B is ND
Bis(2-Chloroisopropyl) Ether	ug/L				1.5									No	MEC < C & B is ND
Bis(2-Ethylhexyl) Phthalate	ug/L				1.42									No	MEC < C & B <= C
4-Bromophenyl Phenyl Ether	ug/L				No Criteria		No Criteria	Y	Y	0.42		N	No Criteria	Uc	No Criteria
Butylbenzyl Phthalate	ug/L				0.62		No	Y	Y	0.62		N	No	No	MEC < C & B is ND
2-Chloronaphthalene	ug/L				0.71		No	Y	Y	0.71		N	No	No	MEC < C & B is ND
4-Chlorophenyl Phenyl Ether	ug/L				No Criteria		No Criteria	Y	Y	0.69		N	No Criteria	Uc	No Criteria
Chrysene	ug/L				No Criteria		No Criteria	Y	Y	0.47		N	No	No	UD; effluent ND, MDL > C, and
Dibenz(a,h)Anthracene	ug/L				0.049		No	Y	Y	1.6		Y	No	No	UD; effluent ND, MDL > C, and
1,2-Dichlorobenzene	ug/L				0.17		No	Y	Y	0.17		N	No	No	MEC < C & B is ND
1,3-Dichlorobenzene	ug/L				0.21		No	Y	Y	0.21		N	No	No	MEC < C & B is ND
1,4-Dichlorobenzene	ug/L				0.44		No	Y	Y	0.44		N	No	No	MEC < C & B is ND
3,3-Dichlorobenzidine	ug/L				0.63		No	Y	Y	1.7		N	No	No	UD; effluent ND, MDL > C, and
Diethyl Phthalate	ug/L				0.57		No	Y	Y	0.63		N	No	No	MEC < C & B is ND
Dimethyl Phthalate	ug/L				1.07		No	Y	Y	0.57		N	No	No	MEC < C & B is ND
Di-n-Butyl Phthalate	ug/L				No Criteria		No	Y	N	1.82		N	No	No	MEC < C & B <= C
2,4-Dinitrotoluene	ug/L				0.55		No	Y	Y	0.55		N	No	No	MEC < C & B is ND
2,6-Dinitrotoluene	ug/L				No Criteria		No Criteria	Y	Y	0.44		N	No Criteria	Uc	No Criteria
Di-n-Octyl Phthalate	ug/L				No Criteria		No Criteria	Y	Y	0.59		N	No Criteria	Uc	No Criteria
1,2-Diphenylhydrazine	ug/L				0.54		No	Y	Y	1.2		Y	No	No	UD; effluent ND, MDL > C, and
Fluoranthene	ug/L				0.47		No	Y	Y	0.47		N	No	No	MEC < C & B is ND
Fluorene	ug/L				0.32		No	Y	Y	0.32		N	No	No	MEC < C & B is ND
Hexachlorobenzene	ug/L				0.96		No	Y	Y	0.61		N	No	No	UD; effluent ND, MDL > C, and
Hexachlorobutadiene	ug/L				2.5		No	Y	Y	0.96		N	No	No	MEC < C & B is ND
Hexachlorocyclopentadiene	ug/L				0.93		No	Y	Y	2.5		N	No	No	MEC < C & B is ND
Hexachloroethane	ug/L				0.78		No	Y	Y	0.93		N	No	No	UD; effluent ND, MDL > C, and
Indeno(1,2,3-cd)Pyrene	ug/L				No Criteria		No Criteria	Y	Y	0.71		N	No	No	MEC < C & B is ND
Isophorone	ug/L				No Criteria		No Criteria	Y	Y	0.83		N	No	No	No Criteria
Naphthalene	ug/L				1.2		No	Y	Y	1.2		N	No	No	MEC < C & B is ND
Nitrobenzene	ug/L				1.7		No	Y	Y	1.7		N	No	No	MEC < C & B is ND
N-Nitrosodimethylamine	ug/L				0.74		No	Y	Y	0.74		N	No	No	MEC < C & B is ND
N-Nitrosodi-n-Propylamine	ug/L				0.76		No	Y	Y	0.76		N	No	No	MEC < C & B is ND
N-Nitrosodiphenylamine	ug/L				No Criteria		No Criteria	Y	Y	0.61		N	No Criteria	Uc	No Criteria
Phenanthrene	ug/L				0.61		No	Y	Y	0.61		N	No	No	MEC < C & B is ND
Pyrene	ug/L				No Criteria		No Criteria	Y	Y	0.45		N	No	No	No Criteria
1,2,4-Trichlorobenzene	ug/L				No Criteria		No Criteria	Y	Y			N	No	No	UD; effluent ND, MDL > C, and
Aldrin	ug/L				0.003		No	Y	Y	0.014		N	No	No	MEC < C & B is ND
alpha-BHC	ug/L				0.006		No	Y	Y	0.006		N	No	No	MEC < C & B is ND
beta-BHC	ug/L				0.004		No	Y	Y	0.004		N	No	No	MEC < C & B is ND
gamma-BHC	ug/L				No Criteria		No Criteria	Y	Y	0.009		N	No	No	MEC < C & B is ND
delta-BHC	ug/L				0.00059		No	Y	Y	0.014		N	No	No	No Criteria
Chlordane	ug/L				0.00059		No	Y	Y	0.012		Y	No	No	UD; effluent ND, MDL > C, and
4,4'-DDT	ug/L				0.00059		No	Y	Y	0.004		Y	No	No	UD; effluent ND, MDL > C, and
4,4'-DDE (linked to DDT)	ug/L				0.00084		No	Y	Y	0.011		Y	No	No	UD; effluent ND, MDL > C, and
4,4'-DDD	ug/L				0.00014		No	Y	Y	0.002		Y	No	No	UD; effluent ND, MDL > C, and
Dieldrin	ug/L				240		No	Y	Y	0.014		Y	No	No	MEC < C & B is ND
alpha-Endosulfan	ug/L				0.004		No	Y	Y	0.004		N	No	No	MEC < C & B is ND
beta-Endosulfan	ug/L				0.066		No	Y	Y	0.006		N	No	No	MEC < C & B is ND
Endosulfan Sulfate	ug/L				0.006		No	Y	Y	0.006		N	No	No	MEC < C & B is ND
Endrin	ug/L				0.023		No	Y	Y	0.023		N	No	No	MEC < C & B is ND
Endrin Aldehyde	ug/L				0.00021		No	Y	Y	0.003		Y	No	No	UD; effluent ND, MDL > C, and
Heptachlor	ug/L				0.00011		No	Y	Y	0.083		Y	No	No	UD; effluent ND, MDL > C, and
Heptachlor Epoxide	ug/L				0.00017		No	Y	Y	0.005		Y	No	No	UD; effluent ND, MDL > C, and
PCBs sum (2)	ug/L				0.00075		No	Y	Y	0.24		Y	No	No	UD; effluent ND, MDL > C, and
Toxaphene	ug/L							Y	Y			Y	No	No	

AQUATIC LIFE CALCULATIONS															
Saltwater / Freshwater / Basin Plan															
LIMITS															
	AMEL hh = ECA = C hh O only	MDEL/AMEL multiplier	MDEL hh	ECA acute multiplier (p.7)	LTA acute	ECA chronic multiplier	LTA chronic	Lowest LTA	AMEL multiplier 95	AMEL aq multiplier life	MDEL multiplier 99	MDEL aq life	Lowest AMEL	Lowest MDEL	Recommendation
Parameters	4300	2.01	8626.61	0.32	22.15	0.53	18.99	18.99	1.55	29.48	3.11	59.14	4300.00	8626.61	No Limit. More data required
Antimony		2.01		0.32					1.55		3.11				No Limit
Arsenic															No Limit
Beryllium															No Limit
Cadmium		2.01		0.32	13.57	0.53	4.93	4.93	1.55	7.66	3.11	15.37			No Limit. More data required
Chromium (III)															No Limit
Chromium (VI)															No Limit
Copper		2.01		0.32	1.86	0.53	1.97	1.86	1.55	2.88	3.11	5.78			No Limit. More data required
Lead															No Limit
Mercury															No Limit
Nickel	4600	2.01	9228.47	0.32	24.00	0.53	4.37	4.37	1.55	6.78	3.11	13.61			No Limit. More data required
Selenium		2.01		0.32	93.30	0.53	37.52	37.52	1.55	58.25	3.11	116.86			No Limit. More data required
Silver		2.01		0.32	0.72	0.53		0.72	1.55	1.11	3.11	2.24			No Limit. More data required
Thallium	6.3	2.01	12.64						1.55		3.11				No Limit. More data required
Zinc		2.01		0.32	30.55	0.53	45.16	30.55	1.55	47.42	3.11	95.14			No Limit. More data required
Cyanide															No Limit
Asbestos															No Limit
2,3,7,8 TCDD															No Limit
TCDD Equivalents															No Limit
Acrolein															No Limit
Acrylonitrile															No Limit
Benzene															No Limit
Bromotorm															No Limit
Carbon Tetrachloride															No Limit
Chlorobenzene															No Limit
Chlorodibromomethane															No Limit
Chloroethane															No Limit
2-Chloroethylvinyl ether															No Limit
Chloroform															No Limit
Dichlorobromomethane															No Limit
1,1-Dichloroethane															No Limit
1,2-Dichloroethane															No Limit
1,1-Dichloroethylene															No Limit
1,2-Dichloropropane															No Limit
1,3-Dichloropropylene															No Limit
Ethylbenzene															No Limit
Methyl Bromide															No Limit
Methyl Chloride															No Limit
Methylene Chloride															No Limit
1,1,2,2-Tetrachloroethane															No Limit
Tetrachloroethylene															No Limit
Toluene															No Limit
1,2-Trans-Dichloroethylene															No Limit
1,1,1-Trichloroethane															No Limit
1,1,2-Trichloroethane															No Limit
Trichloroethylene															No Limit
Vinyl Chloride															No Limit
2-Chlorophenol															No Limit
2,4-Dichlorophenol															No Limit
2,4-Dimethylphenol															No Limit
4,6-dinitro-o-resol (aka2-methyl-4,6-Dinitrophenol)															No Limit
2,4-Dinitrophenol															No Limit
2-Nitrophenol															No Limit
4-Nitrophenol															No Limit
3-Methyl-4-Chlorophenol (aka P-chloro-m-resol)															No Limit
Penachlorophenol															No Limit
Phenol															No Limit
2,4,6-Trichlorophenol															No Limit
Acenaphthene															No Limit
Acenaphthylene															No Limit
Anthracene															No Limit
Benzdine															No Limit
Benzo(a)Anthracene															No Limit
Benzo(a)Pyrene															No Limit
Benzo(b)Fluoranthene															No Limit
Benzo(ghi)Perylene															No Limit
Benzo(k)Fluoranthene															No Limit
Bis(2-Chloroethoxy)Methan															No Limit

Parameters	HUMAN HEALTH CALCULATIONS				AQUATIC LIFE CALCULATIONS										LIMITS			
	Organisms only				Saltwater / Freshwater / Basin Plan													
	AMEL hh = ECA = C hh O only	MEEL/AMEL multiplier	MEEL hh	ECA acute multiplier (p.7)	LTA acute	ECA chronic multiplier	LTA chronic	Lowest LTA	AMEL multiplier 95	AMEL aq multiplier life	MEEL aq multiplier 99	MEEL aq life	MEEL aq life	Lowest AMEL	Lowest MEEL	Recommendation		
Bis(2-Chloroethyl)Ether																No Limit		No Limit
Bis(2-Chloroisopropyl)Ether																No Limit		No Limit
Bis(2-Ethylhexyl)Phthalate																No Limit		No Limit
4-Bromophenyl Phenyl Ether																No Limit		No Limit
Bisphenol A Polycarbonate																No Limit		No Limit
2-Chlorophenyl Phenyl Ether																No Limit		No Limit
4-Chlorophenyl Phenyl Ether																No Limit		No Limit
Chrysene																No Limit		No Limit
Dibenz(a,h)Anthracene																No Limit		No Limit
1,2-Dichlorobenzene																No Limit		No Limit
1,3-Dichlorobenzene																No Limit		No Limit
1,4-Dichlorobenzene																No Limit		No Limit
3,3-Dichlorobenzidine																No Limit		No Limit
Diethyl Phthalate																No Limit		No Limit
Dimethyl Phthalate																No Limit		No Limit
Di-n-Butyl Phthalate																No Limit		No Limit
Di-n-Octyl Phthalate																No Limit		No Limit
2,4-Dinitrotoluene																No Limit		No Limit
2,6-Dinitrotoluene																No Limit		No Limit
Di-n-Octyl Phthalate																No Limit		No Limit
1,2-Diphenylhydrazine																No Limit		No Limit
Fluoranthene																No Limit		No Limit
Fluorene																No Limit		No Limit
Hexachlorobenzene																No Limit		No Limit
Hexachlorobutadiene																No Limit		No Limit
Hexachlorocyclopentadiene																No Limit		No Limit
Hexachloroethane																No Limit		No Limit
Indeno(1,2,3-cd)Pyrene																No Limit		No Limit
Isophorone																No Limit		No Limit
Naphthalene																No Limit		No Limit
Nitrobenzene																No Limit		No Limit
N-Nitrosodimethylamine																No Limit		No Limit
N-Nitrosodi-n-Propylamine																No Limit		No Limit
N-Nitrosodiphenylamine																No Limit		No Limit
Phenanthrene																No Limit		No Limit
Pyrene																No Limit		No Limit
1,2,4-Trichlorobenzene																No Limit		No Limit
Aldrin																No Limit		No Limit
alpha-BHC																No Limit		No Limit
beta-BHC																No Limit		No Limit
gamma-BHC																No Limit		No Limit
delta-BHC																No Limit		No Limit
Chlordane																No Limit		No Limit
4,4'-DDT																No Limit		No Limit
4,4'-DDE (linked to DDT)																No Limit		No Limit
4,4'-DDD																No Limit		No Limit
Dieldrin																No Limit		No Limit
alpha-Endosulfan																No Limit		No Limit
beta-Endosulfan																No Limit		No Limit
Endosulfan Sulfate																No Limit		No Limit
Endrin																No Limit		No Limit
Endrin Aldehyde																No Limit		No Limit
Heptachlor																No Limit		No Limit
Heptachlor Epoxide																No Limit		No Limit
pCBS sum (2)																No Limit		No Limit
Toxaphene																No Limit		No Limit