

## **Adoption of:**


**1) Waste Discharge/Emergency Water Recycling Requirements (Order No. R3-2014-0050, Title 22)**

**2) Revised Waste Discharge Requirements (Order No. 01-100)**

**For Cambria Community Services District,  
San Luis Obispo County**

**Central Coast Water Board  
Howard Kolb, Water Resource Control Engineer  
November 14, 2014**

# Emergency Water Supply Project

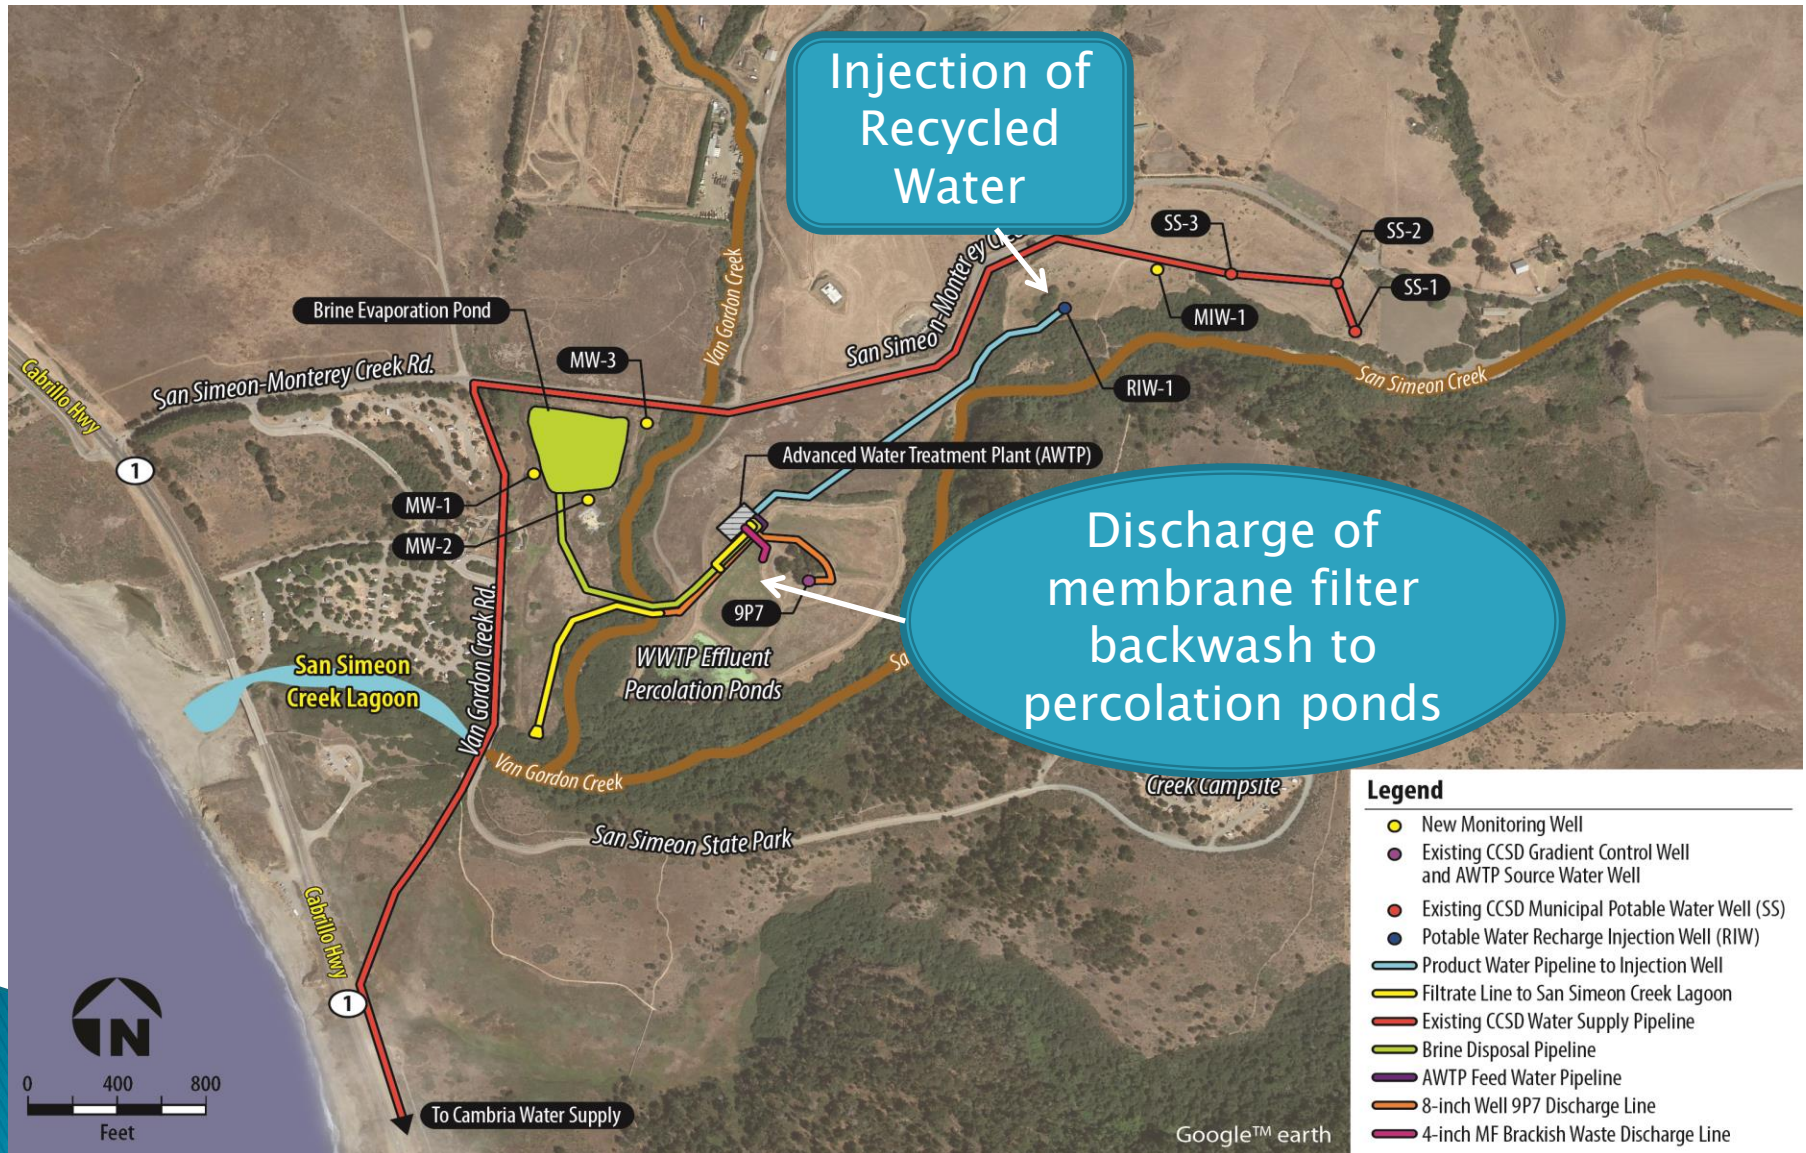








# Emergency Water Supply Project

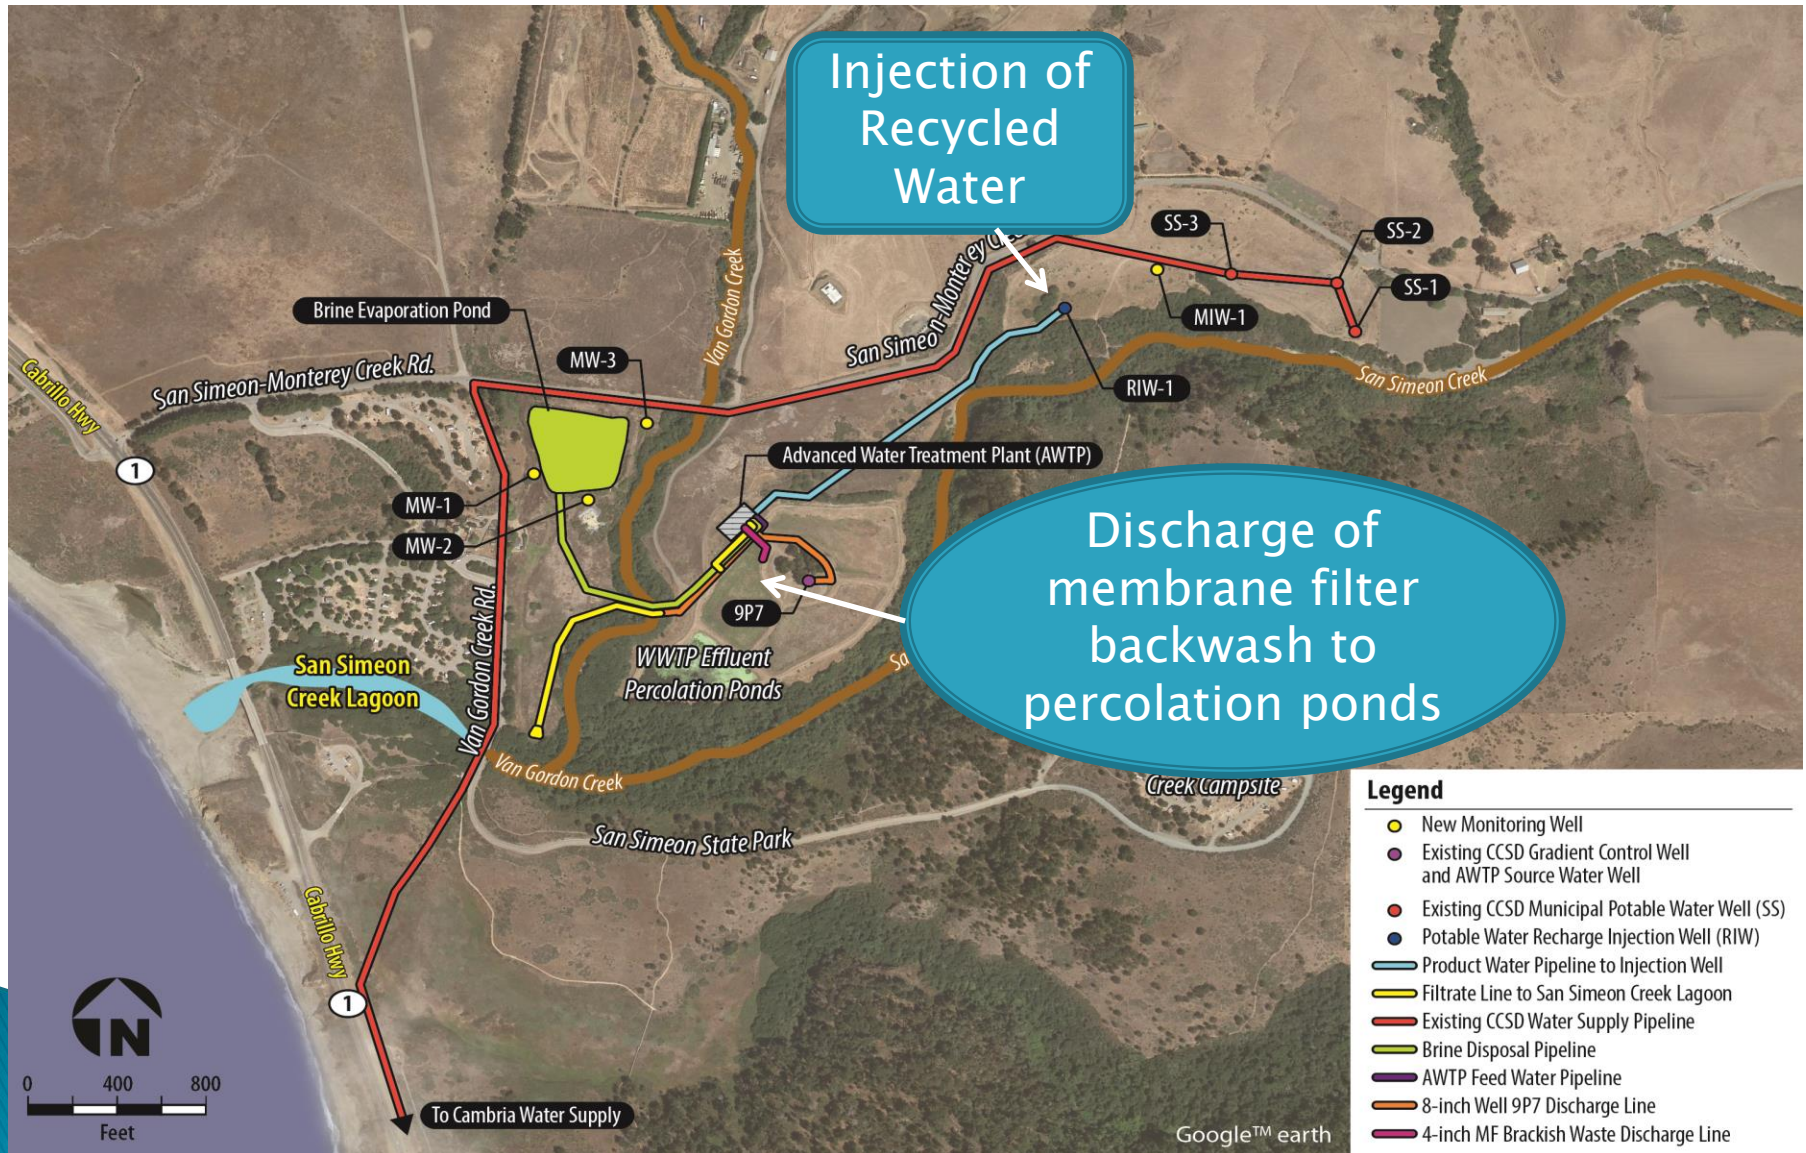



# CCSD WWTP - Percolation Ponds







# Public Review

- ▶ The Orders were posted for public review September 19th.
- ▶ Some of the issues raised:
  - Project needs full environmental review
  - Re-injection of treated water may impact water quality
  - Water quality in lower San Simeon Creek



# Needed Prior to Plant Operation

- ▶ Treatment plant start-up and shut down plan
- ▶ Lagoon mitigation and monitoring plan



# Changes to the Orders

- ▶ Supplemental sheet 1 – Update of Table 3.
- ▶ Supplemental sheet 2 – Updated CEQA findings.
- ▶ Order R3-2014-0050 – Typo finding 46.



# RECOMMENDATION

- ▶ Adopt Orders No. 01-100 and No. R3-2014-0050 as proposed



# Questions?