



EDMUND G. BROWN JR.  
GOVERNOR

MATTHEW RODRIGUEZ  
SECRETARY FOR  
ENVIRONMENTAL PROTECTION

## Los Angeles Regional Water Quality Control Board

February 22, 2016

VIA CERTIFIED MAIL  
RETURN RECEIPT REQUESTED  
No. 7009 0820 0001 6812 2237

Ms. Philomena Wong, Director  
Property Management  
Donald T. Sterling Corporation  
9441 Wilshire Blvd.  
Penthouse Suite,  
Beverly Hills, CA 90212

Dear Ms. Wong:

**TRANSMITTAL OF THE WASTE DISCHARGE REQUIREMENTS AND NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) PERMIT FOR DONALD T. STERLING CORPORATION, STERLING AMBASSADOR TOWERS, LOS ANGELES, CALIFORNIA (NPDES NO. CA0053091, CI NO. 5839)**

Our letter dated January 14, 2016, transmitted the revised tentative waste discharge requirements (WDRs) for renewal of your permit to discharge treated groundwater, irrigation drainage runoff, pool deck wash water, and storm water runoff to surface waters under the National Pollutant Discharge Elimination System (NPDES) Program.

Pursuant to Division 7 of the California Water Code, this Regional Water Board at a public hearing held on February 11, 2016, reviewed the revised tentative requirements, considered all factors in the case, and adopted Order No. R4-2016-0054 (NPDES permit). Order No. R4-2016-0054 serves as an NPDES permit, and expires on March 31, 2021. Section 13376 of the California Water Code requires that an application/Report of Waste Discharge (ROWD) for a new permit must be filed at least 180 days before the expiration date.

You are required to implement the Monitoring and Reporting Program (MRP) on the effective date (April 1, 2016) of Order No. R4-2016-0054. Your first monitoring report for the period of April 1, 2016, through June 30, 2016, is due by August 1, 2016. Donald T. Sterling Corporation, will electronically submit Self-Monitoring Reports (SMRs) using the State Water Board's California Integrated Water Quality System (CIWQS) (<http://www.waterboards.ca.gov/ciwqs/index.html>).

When submitting monitoring or technical reports to the Regional Water Board per these requirements, please include a reference to Compliance File CI-5839 and NPDES No. CA0053091, which will assure that the reports are directed to the appropriate file and staff.

We are sending the paper copy of the Permit to the Discharger only. For those on the mailing list or other interested parties who would like access to a copy of the Permit, please go to the Regional Water Board's website at:

Ms. Philomena Wong  
Donald T. Sterling Corporation  
Sterling Ambassador Towers

- 2 -

February 22, 2016

[http://www.waterboards.ca.gov/losangeles/board\\_decisions/adopted\\_orders/by\\_permits\\_tools.shtml](http://www.waterboards.ca.gov/losangeles/board_decisions/adopted_orders/by_permits_tools.shtml).

If you have any questions, please contact Ching Yin To at [Ching-Yin.To@waterboards.ca.gov](mailto:Ching-Yin.To@waterboards.ca.gov) or at (213) 576-6696.

Sincerely,



Cassandra D. Owens, Chief  
Industrial Permitting Unit (NPDES)

Enclosures: Order No. R4-2016-0054 - Waste Discharge Requirements  
Attachment E - Monitoring and Reporting Program (MRP No. 5839)  
Attachment F - Fact Sheet

cc: **(Via Email Only)**

Mr. David Smith, Environmental Protection Agency, Region 9, Permits Branch (WTR-5)  
Ms. Robyn Stuber, Environmental Protection Agency, Region 9, Permits Branch (WTR-5)  
Ms. Becky Mitschele, Environmental Protection Agency, Region 9, Permits Branch (WTR-5)  
NPDES Wastewater Unit, State Water Resources Control Board, Division of Water Quality  
Ms. Sutida Bergquist, State Water Resources Control Board, Drinking Water Division  
Mr. Kenneth Wong, U.S. Army Corps of Engineers  
Mr. Bryant Chesney, NOAA, National Marine Fisheries Service  
Mr. Jeff Phillips, Department of Interior, U.S. Fish and Wildlife Service  
Mr. William Paznokas, California Department of Fish and Wildlife, Region 5  
Ms. Teresa Henry, California Coastal Commission, South Coast Region  
Mr. Tim Smith, Los Angeles County, Department of Public Works  
Mr. Angelo Bellomo, Los Angeles County, Department of Public Health  
Mr. Theodore Johnson, Water Replenishment Districts of Southern California  
Ms. Rita Kampalath, Heal the Bay  
Ms. Bruce Reznik, Los Angeles Waterkeeper  
Ms. Laura West, Natural Resources Defense Council  
Ms. Becky Hayat, Natural Resources Defense Council  
Mr. Jason Weiner, Ventura Coastkeeper  
Mr. Daniel Cooper, Lawyers for Clean Water  
Mr. Jae Kim, Tetra Tech  
Ms. Kristy Allen, TetraTech, Inc.  
Mr. Sean Douglas, Donald T. Sterling Corporation  
Mr. Dean Segal, Donald T. Sterling Corporation  
Mr. Mike Slaby, Pure Effect, Inc.

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
LOS ANGELES REGION**

320 W. 4th Street, Suite 200, Los Angeles, California 90013  
Phone (213) 576-6600 • Fax (213) 576-6640  
<http://www.waterboards.ca.gov/losangeles>

**ORDER NO. R4-2016-0054  
NPDES NO. CA0053091**

**WASTE DISCHARGE REQUIREMENTS  
FOR DONALD T. STERLING CORPORATION, STERLING AMBASSADOR TOWERS  
DISCHARGE TO BALLONA CREEK VIA DISCHARGE POINT 001**

The following Discharger is subject to waste discharge requirements (WDRs) set forth in this Order:

**Table 1. Discharger Information**

Discharger	Donald T. Sterling Corporation
Name of Facility	Sterling Ambassador Towers
Facility Address	691 South Irolo Street
	Los Angeles, California 90005
	Los Angeles County

**Table 2. Discharge Location**

Discharge Point	Effluent Description	Discharge Point Latitude	Discharge Point Longitude	Receiving Water
001	Treated groundwater, irrigation drainage runoff, pool deck wash water, and storm water runoff	34.0598°	-118.3013°	Ballona Creek Reach 1

**Table 3. Administrative Information**

This Order was adopted on:	<b>February 11, 2016</b>
This Order shall become effective on:	<b>April 1, 2016</b>
This Order shall expire on:	<b>March 31, 2021</b>
The Discharger shall file a Report of Waste Discharge as an application for reissuance of WDR's in accordance with title 23, California Code of Regulations, and an application for reissuance of a National Pollutant Discharge Elimination System (NPDES) permit no later than:	<b>180 days prior to the Order expiration date</b>
The U.S. Environmental Protection Agency (U.S. EPA) and the California Regional Water Quality Control Board, Los Angeles Region have classified this discharge as follows:	<b>Minor discharge</b>

I, Samuel Unger, Executive Officer, do hereby certify that this Order with all attachments is a full, true, and correct copy of the Order adopted by the California Regional Water Quality Control Board, Los Angeles Region, on **February 11, 2016**.

  
 Samuel Unger, P.E., Executive Officer

**CONTENTS**

I. Facility Information..... 3  
II. Findings..... 3  
III. Discharge Prohibitions ..... 3  
IV. Effluent Limitations and Discharge Specifications ..... 4  
    A. Effluent Limitations – Discharge Point 001 ..... 4  
        1. Final Effluent Limitations – Discharge Point 001 ..... 4  
    B. Final Effluent Sediment Limitation– Discharge Point 001 ..... 6  
V. Land discharge specifications – not applicable..... 7  
VI. Recycling Specifications – Not Applicable ..... 7  
VII. Receiving Water Limitations ..... 7  
    A. Surface Water Limitations ..... 7  
    B. Groundwater Limitations – Not Applicable ..... 8  
VIII. Provisions..... 9  
    A. Standard Provisions ..... 9  
    B. Monitoring and Reporting Program (MRP) Requirements ..... 11  
    C. Special Provisions..... 11  
        1. Reopener Provisions ..... 11  
        2. Special Studies, Technical Reports and Additional Monitoring Requirements..... 12  
        3. Best Management Practices and Pollution Prevention..... 12  
        4. Construction, Operation and Maintenance Specifications ..... 13  
        5. Other Special Provisions – Not Applicable..... 13  
        6. Compliance Schedules – Not Applicable ..... 13  
IX. Compliance Determination ..... 13

**TABLES**

Table 1. Discharger Information..... 1  
Table 2. Discharge Location ..... 1  
Table 3. Administrative Information..... 1  
Table 4. Effluent Limitations at Discharge Point 001 ..... 4  
Table 5. Effluent Sediment Limitation–Discharge Point 001 ..... 6

**ATTACHMENTS**

Attachment A – Definitions..... A-1  
Attachment B – Maps..... B-1  
Attachment C-1 – Flow Schematic..... C-1  
Attachment C-2 – Flow Schematic of treatment system ..... C-2  
Attachment D – Standard Provisions ..... D-1  
Attachment E – Monitoring and Reporting Program (MPR No. 5839)..... E-1  
Attachment F – Fact Sheet ..... F-1  
Attachment G – Storm Water Pollution Prevention Plan Requirements..... G-1  
Attachment H – State Water Board Minimum Levels (micrograms/liter(ug/L)) ..... H-1  
Attachment I – List of Priority Pollutants..... I-1  
Attachment J – Summary Of Effluent Limitation Calculations..... J-1  
Attachment K – Ammonia RPA and Effluent Limitation Calculations ..... K-1

## I. FACILITY INFORMATION

Information describing Donald T. Sterling Corporation, Sterling Ambassador Towers (Facility) is summarized in Table 1 and in sections I and II of the Fact Sheet (Attachment F). Section I of the Fact Sheet also includes information regarding the Facility's permit application.

## II. FINDINGS

The California Regional Water Quality Control Board, Los Angeles Region (Regional Water Board), finds:

- A. Legal Authorities.** This Order serves as WDRs pursuant to article 4, chapter 4, division 7 of the California Water Code (commencing with section 13260). This Order is also issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. EPA and chapter 5.5, division 7 of the Water Code (commencing with section 13370). It shall serve as an NPDES permit for point source discharges from this Facility to surface waters.
- B. Background and Rationale for Requirements.** The Regional Water Board developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and other available information. The Fact Sheet (Attachment F), which contains background information and rationale for the requirements in this Order, is hereby incorporated into and constitutes Findings for this Order. Attachments A through E and G through J are also incorporated into this Order.
- C. Notification of Interested Parties.** The Regional Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe WDRs for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of the notification are provided in the Fact Sheet.
- D. Consideration of Public Comment.** The Regional Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet.

THEREFORE, IT IS HEREBY ORDERED that this Order supersedes Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 except for enforcement purposes, and, in order to meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the CWA and regulations and guidelines adopted thereunder, the Discharger is authorized to discharge from the identified Facility and outfall into waters of the United States and shall comply with the requirements in this Order. This action in no way prevents the Regional Water Board from taking enforcement action for past violations of the previous Order.

## III. DISCHARGE PROHIBITIONS

- A.** Wastes shall be limited to a maximum of 0.015 million gallons per day (MGD) of treated groundwater seepage, irrigation drainage runoff from planter boxes, pool deck wash water, and storm water through Discharge Point 001 as described in the Fact Sheet (Attachment F). The discharge of wastes from accidental spills or other sources is prohibited.
- B.** Discharges of water, materials, thermal wastes, elevated temperature wastes, toxic wastes, deleterious substances, or wastes other than those authorized by this Order, to a storm drain system, Ballona Creek, or other waters of the state, are prohibited.
- C.** Neither the treatment nor the discharge of pollutants shall create pollution, contamination, or a nuisance as defined by section 13050 of the Water Code.

- D. Wastes discharged shall not contain any substances in concentrations toxic to human, animal, plant, or aquatic life.
- E. The discharge shall not cause a violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or the State Water Resources Control Board (State Water Board) as required by the federal CWA and regulations adopted thereunder. If more stringent applicable water quality standards are promulgated or approved pursuant to section 303 of the federal CWA, and amendments thereto, the Regional Water Board will revise and modify this Order in accordance with such more stringent standards.
- F. The discharge of any radiological, chemical, or biological warfare agent or high level radiological waste is prohibited.
- G. Any discharge of wastes at any point(s) other than specifically described in this Order is prohibited, and constitutes a violation of the Order.

**IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS**

**A. Effluent Limitations – Discharge Point 001**

**1. Final Effluent Limitations – Discharge Point 001**

- a. The Discharger shall maintain compliance with the following effluent limitations at Discharge Point 001, with compliance measured at Monitoring Location EFF-001 as described in the Monitoring and Reporting Program, Attachment E:

**Table 4. Effluent Limitations at Discharge Point 001**

Parameter	Units	Effluent Limitations				Performance Goals <sup>6</sup>
		Average Monthly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum	
<b>Conventional Pollutants</b>						
Biochemical Oxygen Demand (BOD) (5-day @ 20°C)	mg/L	20	30	--	--	--
	lbs/day <sup>1</sup>	2.5	3.8	--	--	--
Oil and Grease	mg/L	10	15	--	--	--
	lbs/day <sup>1</sup>	1.3	1.9	--	--	--
pH	standard units	--	--	6.5	8.5	--
Total Suspended Solids (TSS) <sup>7</sup>	mg/L	50	75	--	--	--
	lbs/day <sup>1</sup>	6.3	9.4	--	--	--
<b>Non-Conventional Pollutants</b>						
Chronic Toxicity <sup>2</sup>	Pass or Fail, % Effect (for the TST Statistical Approach)	Pass <sup>3</sup>	Pass or % Effect <50	--	--	--
Settleable Solids	ml/L	0.1	0.3	--	--	--
Temperature	°F	--	--	--	86	--
Turbidity	NTU	50	75	--	--	--

Parameter	Units	Effluent Limitations				Performance Goals <sup>6</sup>
		Average Monthly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum	
<b>Priority Pollutants</b>						
Cadmium, Total Recoverable <sup>7,10</sup>	µg/L	--	--	--	--	2.3
	lbs/day <sup>1</sup>	--	--	--	--	0.00029
Copper, Total Recoverable, Wet Weather <sup>4,7</sup>	µg/L	4.2	14	--	--	--
	lbs/day <sup>1</sup>	0.00053	0.0018	--	--	--
Copper, Total Recoverable, Dry Weather <sup>5,7</sup>	µg/L	17	56	--	--	--
	lbs/day <sup>1</sup>	0.0021	0.0070	--	--	--
Lead, Total Recoverable, Wet Weather <sup>4,7</sup>	µg/L	30	77	--	--	--
	lbs/day <sup>1</sup>	0.0038	0.0096	--	--	--
Lead, Total Recoverable, Dry Weather <sup>5,7</sup>	µg/L	14	36	--	--	--
	lbs/day <sup>1</sup>	0.0018	0.0045	--	--	--
Selenium, Total Recoverable	µg/L	4.2	8.0	--	--	--
	lbs/day <sup>1</sup>	0.00053	0.0010	--	--	--
Silver, Total Recoverable <sup>7,10</sup>	µg/L	--	--	--	--	2.7
	lbs/day <sup>1</sup>	--	--	--	--	0.00034
Zinc, Total Recoverable, Wet Weather <sup>4,7</sup>	µg/L	32	105	--	--	--
	lbs/day <sup>1</sup>	0.0040	0.013	--	--	--
Zinc, Total Recoverable, Dry Weather <sup>5,7</sup>	µg/L	210	690	--	--	--
	lbs/day <sup>1</sup>	0.026	0.086	--	--	--
Chlordane <sup>7,8,10</sup>	µg/L	--	--	--	--	0.00059
	lbs/day <sup>1</sup>	--	--	--	--	7.4e-8
4,4'-DDT <sup>7,8,10</sup>	µg/L	--	--	--	--	0.00059
	lbs/day <sup>1</sup>	--	--	--	--	7.4e-8
4,4'-DDE <sup>7,8,10</sup>	µg/L	--	--	--	--	0.00059
	lbs/day <sup>1</sup>	--	--	--	--	7.4e-8
4,4'-DDD <sup>7,8,10</sup>	µg/L	--	--	--	--	0.00084
	lbs/day <sup>1</sup>	--	--	--	--	1.1e-7
PCBs, Total <sup>7,8,9,10</sup>	µg/L	--	--	--	--	0.00017
	lbs/day <sup>1</sup>	--	--	--	--	2.1e-8

<sup>1</sup> Mass loading limitations are based on the treatment system design flow at Discharge Point 001 of 0.015 MGD and are calculated as follows: Flow (MGD) x Concentration (mg/L) x 8.34 (conversion factor) = lbs/day.  
<sup>2</sup> The median monthly effluent limitation (MMEL) shall be reported as "Pass" or "Fail". The maximum daily effluent limitation (MDEL) shall be reported "Pass" or "Fail" and "% Effect". The MMEL for chronic toxicity shall only apply when there is a discharge more than one day in a calendar month period. During such calendar months, up to three independent toxicity tests are required when one toxicity test results in "Fail".  
<sup>3</sup> This is a median monthly effluent limitation.  
<sup>4</sup> The wet weather TMDL limits apply when the maximum daily flow of Ballona Creek at Stream Gauge No. F38C-R is equal to or greater than 64 cubic feet per second (cfs).  
<sup>5</sup> The dry weather TMDL limits apply when the maximum daily flow of Ballona Creek at Stream Gauge No. F38C-R is less than 64 cfs.

- <sup>6</sup> Performance goals are intended to ensure that effluent concentrations and mass discharges do not exceed levels currently achieved by the permitted Facility. They act as triggers to determine when treatment technologies fail to produce effluent concentrations consistent with these performance goals, and are not enforceable effluent limitations.
- <sup>7</sup> During each reporting period, if effluent monitoring results exceed **both** a TSS effluent limit and a CTR or TMDL-based effluent limit or performance goal for cadmium, copper, lead, silver, zinc, chlordane, DDTs (4,4'-DDT, 4,4'-DDE, and 4,4'-DDD), or total PCBs implementation of the effluent sediment monitoring program as included in section IV.B of this Order is required for that priority pollutant. Sediment monitoring of the effluent shall begin during the first discharge event following the effluent exceedance. An effluent sediment monitoring result at or below the sediment allocations in Table 5 of this Order demonstrates attainment with the applicable sediment allocation and additional sediment monitoring of the effluent is not required. A sediment monitoring result that exceeds the sediment allocation requires additional sediment monitoring of the effluent during discharge but not more frequently than once per year until the concentration for sediment monitoring results is at or below the sediment allocation.
- <sup>8</sup> Samples analyzed must be unfiltered samples.
- <sup>9</sup> Total PCBs (polychlorinated biphenyls) means the sum of chlorinated biphenyls whose analytical characteristics resembles those of Aroclor-1016, Aroclor-1221, Aroclor-1232, Aroclor-1242, Aroclor-1248, Aroclor-1254, and Aroclor-1260.
- <sup>10</sup> Performance goals for these parameters are based on their respective CTR aquatic life or human health criteria; CWA section 303(d) List classified Ballona Creek or Ballona Creek Estuary as impaired for these pollutants.

**B. Final Effluent Sediment Limitation– Discharge Point 001**

1. The Discharger shall maintain compliance with the following effluent sediment limitations at Discharge Point 001, with compliance measured at Monitoring Location EFF-001, as described in the attached MRP (Attachment E). Effluent sediment monitoring is only required when triggered by an exceedance in both a TSS effluent limit, and a CTR or TMDL-based effluent limit or performance goal for cadmium, copper, lead, silver, zinc, chlordane, DDTs, and PCB, as listed in Table 4 of this Order. If effluent sediment monitoring is not triggered by an exceedance, effluent sediment monitoring must be conducted at least once during the permit term. The Discharger shall collect sufficient effluent sample to provide an adequate amount of effluent sediments for contaminant analyses or other such analytical method approved in advance by the Regional Water Board that would allow direct comparison of effluent sediment concentrations with sediment waste load allocations (WLA) as included in the Ballona Creek Estuary Toxic Pollutant TMDL.

**Table 5. Effluent Sediment Limitation–Discharge Point 001**

Parameter	Units	Effluent Limitation (Resolution No. R13-010)
Cadmium, Total Recoverable	mg/kg	1.2
Copper, Total Recoverable	mg/kg	34
Lead, Total Recoverable	mg/kg	46.7
Silver, Total Recoverable	mg/kg	1.0
Zinc, Total Recoverable	mg/kg	150
Chlordane	ug/kg	1.3
DDTs <sup>1</sup>	ug/kg	1.9
Total PCBs <sup>2</sup>	ug/kg	3.2

- <sup>1</sup> The State Water Resources Control Board *Water Quality Control Plan for Enclosed Bays and Estuaries—Part 1 Sediment Quality*. August 25, 2009 (Sediment Quality Plan), listed chemical analytes needed to characterize sediment contamination exposure and effect. According to Attachment A of the Sediment Quality Plan, DDTs shall mean the sum of o,p'-DDE, o,p'-DDD, o,p'-DDT, p,p'-DDD, p,p'-DDE, and p,p'-DDT.
- <sup>2</sup> According to Attachment A of the Sediment Quality Plan, total PCBs shall mean the sum of the following PCB congeners: 2,4-dichlorobiphenyl, 2,2',5-trichloro biphenyl, 2,4,4'-trichlorobiphenyl, 2,2',3,5'-tetrachlorobiphenyl, 2,2',5,5'-tetrachlorobiphenyl, 2,3',4,4'-tetrachlorobiphenyl, 2,2',4,5,5'-pentachlorobiphenyl, 2,3,3',4,4'-pentachlorobiphenyl, 2,3',4,4',5-pentachlorobiphenyl, 2,2',3,3',4,4'-hexachlorobiphenyl, 2,2',4,4',5,5'-hexachlorobiphenyl, 2,2',3,3',4,4',5-heptachlorobiphenyl, 2,2',3,4,4',5,5'-heptachlorobiphenyl, 2,2',3,4',5,5',6-heptachlorobiphenyl, 2,2',3,3',4,4',5,6-octachlorobiphenyl, 2,2',3,3',4,4',5,5',6-nonachlorobiphenyl, decachlorobiphenyl.

**V. LAND DISCHARGE SPECIFICATIONS – NOT APPLICABLE**

**VI. RECYCLING SPECIFICATIONS – NOT APPLICABLE**

**VII. RECEIVING WATER LIMITATIONS**

**A. Surface Water Limitations**

The discharge shall not cause the following in Ballona Creek:

1. The normal ambient pH to fall below 6.5 nor exceed 8.5 units nor vary from normal ambient pH levels by more than 0.5 units.
2. Surface water temperature to rise greater than 5° F above the natural temperature of the receiving waters at any time or place. At no time shall the temperature be raised above 80° F as a result of waste discharged.
3. Depress the concentration of dissolved oxygen to fall below 5.0 mg/L anytime, and the median dissolved oxygen concentration for any three consecutive months shall not be less than 80 percent of the dissolved oxygen content at saturation.
4. Water Contact Standards
  - a. In fresh waters designated for non-contact recreation (REC-2), the waste discharged shall not cause the following bacterial standards to be exceeded in the receiving water:
    - i. Fecal coliform density shall not exceed 2,000/100 mL as a geometric mean from a minimum of four samples in any 30-day period.
    - ii. Fecal coliform density shall not exceed 4,000/100 mL more than 10 percent of samples collected during any 30-day period.
5. Exceed total ammonia (as N) concentrations specified in the 1994 Basin Plan and its amendments. The Regional Water Board revised the water quality objectives for ammonia to be consistent with the "1999 Update of Ambient Water Quality Criteria for Ammonia" through the adoption of Resolution No. 2002-011 on April 25, 2002. This amendment was approved by the State Water Board, OAL and U.S. EPA on April 30, 2003, June 5, 2003, and June 19, 2003, respectively. The amendment became effective on July 15, 2003. On December 1, 2005, Resolution No. 2005-014, Amendment to the Water Quality Control Plan for the Los Angeles Region to Revise the Early Life Stage Implementation Provision of the Freshwater Ammonia Objectives for Inland Surface Waters (including enclosed bays, estuaries and wetlands) for Protection of Aquatic Life, was adopted by the Regional Water Board. Resolution No. 2005-014 was approved by the State Water Board, OAL, and U.S. EPA on July 19, 2006, August 31, 2006, and April

5, 2007, respectively; it became effective on April 5, 2007. On June 7, 2007, the Regional Water Board adopted Resolution No. 2007-005 to incorporate site-specific 30-day average objectives for ammonia along with corresponding site-specific early life stage implementation provisions for select water body reaches and tributaries in the Santa Clara, Los Angeles, and San Gabriel River watersheds. The State Water Board, OAL, and U.S. EPA approved this Basin Plan amendment on January 15, 2008, May 12, 2008, and March 30, 2009, respectively. The amendment became effective on April 23, 2009.

6. The presence of visible, floating, suspended or deposited macroscopic particulate matter or foam.
7. Where natural turbidity is between 0 to 50 NTU, increases in turbidity shall not exceed 20%. Where natural turbidity is greater than 50 NTU, increases in turbidity shall not exceed 10%.
8. Oils, greases, waxes, or other materials in concentrations that result in a visible film or coating on the surface of the receiving water or on objects in the water.
9. Suspended or settleable materials, chemical substances or pesticides in amounts that cause nuisance or adversely affect any designated beneficial use.
10. Toxic or other deleterious substances in concentrations or quantities which cause deleterious effects on aquatic biota, wildlife, or waterfowl or render any of these unfit for human consumption either at levels created in the receiving waters or as a result of biological concentrations.
11. Accumulation of bottom deposits or aquatic growths.
12. Biostimulatory substances at concentrations that promote aquatic growth to the extent that such growth causes nuisance or adversely affects beneficial uses.
13. The presence of substances that result in increases of BOD that adversely affect beneficial uses.
14. Taste or odor-producing substances in concentrations that alter the natural taste, odor, and/or color of fish, shellfish, or other edible aquatic resources; cause nuisance; or adversely affect beneficial uses.
15. Alteration of turbidity, or apparent color beyond present natural background levels.
16. Damage, discolor, nor cause formation of sludge deposits on flood control structures or facilities nor overload the design capacity.
17. Degrade surface water communities and populations including vertebrate, invertebrate, and plant species.
18. Problems associated with breeding of mosquitoes, gnats, black flies, midges, or other pests.
19. Nuisance or adverse effects on beneficial uses of the receiving water.
20. Violation of any applicable water quality standards for receiving waters adopted by the Regional Water Board or State Water Board. If more stringent applicable water quality standards are promulgated or approved pursuant to section 303 of the CWA, or amendments thereto, the Regional Water Board will revise or modify this Order in accordance with such standards.

**B. Groundwater Limitations – Not Applicable**

## VIII. PROVISIONS

### A. Standard Provisions

1. The Discharger shall comply with all Standard Provisions included in Attachment D of this Order.
2. The Discharger shall comply with the following provisions. In the event that there is any conflict, duplication, or overlap between provisions specified by this Order, the more stringent provision shall apply:
  - a. This Order may be modified, revoked, reissued, or terminated in accordance with the provisions of 40 C.F.R., sections 122.44, 122.62, 122.63, 122.64, 125.62 and 125.64. Causes for taking such actions include, but are not limited to: failure to comply with any condition of this Order; endangerment to human health or the environment resulting from the permitted activity; or acquisition of newly-obtained information which would have justified the application of different conditions if known at the time of Order adoption. The filing of a request by the Discharger for an Order modification, revocation, and issuance or termination, or a notification of planned changes or anticipated noncompliance does not stay any condition of this Order.
  - b. The Discharger must comply with the lawful requirements of municipalities, counties, drainage districts, and other local agencies regarding discharges of storm water to storm drain systems or other watercourses under their jurisdiction; including applicable requirements in municipal storm water management programs developed to comply with NPDES permits issued by the Regional Water Board to local agencies.
  - c. A discharge of waste to any point other than specifically described in this Order is prohibited and constitutes a violation thereof.
  - d. The Discharger shall comply with all applicable effluent limitations, national standards of performance, toxic effluent standards, and all federal regulations established pursuant to sections 301, 302, 303(d), 304, 306, 307, 316, 318, 405, and 423 of the federal CWA and amendments thereto.
  - e. These requirements do not exempt the operator of the waste disposal facility from compliance with any other laws, regulations, or ordinances which may be applicable; they do not legalize this waste disposal facility, and they leave unaffected any further restraints on the disposal of wastes at this site which may be contained in other statutes or required by other agencies.
  - f. Oil or oily material, chemicals, refuse, or other waste materials shall not be stored or deposited in areas where they may be picked up by rainfall and carried off the property and/or discharged to surface waters. Any such spill of such materials shall be contained and removed immediately.
  - g. A copy of these waste discharge specifications shall be maintained at the discharge facility so as to be available at all times to operating personnel.
  - h. After notice and opportunity for a hearing, this Order may be terminated or modified for cause, including, but not limited to:
    - i. Violation of any term or condition contained in this Order;
    - ii. Obtaining this Order by misrepresentation, or failure to disclose all relevant facts;

- iii. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.
- i. If there is any storage of hazardous or toxic materials or hydrocarbons at this facility and if the facility is not manned at all times, a 24-hour emergency response telephone number shall be prominently posted where it can easily be read from the outside.
- j. The Discharger shall notify the Regional Water Board not later than 120 days in advance of implementation of any plans to alter production capacity of the product line of the manufacturing, producing or processing facility by more than ten percent. Such notification shall include estimates of proposed production rate, the type of process, and projected effects on effluent quality. Notification shall include submittal of a new report of waste discharge and the appropriate filing fee. The Discharger shall also file with the Regional Water Board a report of waste discharge at least 120 days before making any material change or proposed change in the character, location or volume of the discharge. A new report of waste discharge with the appropriate filing fee shall be included in this submittal.
- k. All existing manufacturing, commercial, mining, and silvicultural dischargers must notify the Regional Water Board as soon as they know or have reason to believe that they have begun or expect to begin to use or manufacture an intermediate or final product or byproduct of any toxic pollutant that was not reported on their application.
- l. In the event of any change in name, ownership, or control of these waste disposal facilities, the discharger shall notify this Regional Water Board of such change and shall notify the succeeding owner or operator of the existence of this Order by letter, copy of which shall be forwarded to the Regional Water Board.
- m. The Water Code provides that any person who violates a waste discharge requirement or a provision of the Water Code is subject to civil penalties of up to \$5,000 per day, \$10,000 per day, or \$25,000 per day of violation, or when the violation involves the discharge of pollutants, is subject to civil penalties of up to \$10 per gallon per day or \$25 per gallon per day of violation; or some combination thereof, depending on the violation, or upon the combination of violations.
- n. Violation of any of the provisions of the NPDES program or of any of the provisions of this Order may subject the violator to any of the penalties described herein, or any combination thereof, at the discretion of the prosecuting authority; except that only one kind of penalty may be applied for each kind of violation.
- o. The discharge of any product registered under the Federal Insecticide, Fungicide, and Rodenticide Act to any waste stream which may ultimately be released to waters of the United States, is prohibited unless specifically authorized elsewhere in this permit or another NPDES permit. This requirement is not applicable to products used for lawn and agricultural purposes.
- p. The discharge of any waste resulting from the combustion of toxic or hazardous wastes to any waste stream that ultimately discharges to waters of the United States is prohibited, unless specifically authorized elsewhere in this Order.
- q. The Discharger shall notify the Executive Officer in writing no later than 6 months prior to the planned discharge of any chemical, other than the products previously

reported to the Executive Officer, which may be toxic to aquatic life. Such notification shall include:

- i. Name and general composition of the chemical,
  - ii. Frequency of use,
  - iii. Quantities to be used,
  - iv. Proposed discharge concentrations, and
  - v. U.S. EPA registration number, if applicable.
- r. Failure to comply with provisions or requirements of this Order, or violation of other applicable laws or regulations governing discharges from this facility, may subject the Discharger to administrative or civil liabilities, criminal penalties, and/or other enforcement remedies to ensure compliance. Additionally, certain violations may subject the Discharger to civil or criminal enforcement from appropriate local, state, or federal law enforcement entities.
- s. In the event the Discharger does not comply or will be unable to comply for any reason, with any prohibition, effluent limitations, or receiving water limitation of this Order, the Discharger shall notify the Regional Water Board by telephone (213) 576-6600 within 24 hours of having knowledge of such noncompliance, and shall confirm this notification in writing within five days, unless the Regional Water Board waives confirmation. The written notification shall state the nature, time, duration, and cause of noncompliance, and shall describe the measures being taken to remedy the current noncompliance and, prevent recurrence including, where applicable, a schedule of implementation. Other noncompliance requires written notification as above at the time of the normal monitoring report.
- t. Prior to making any change in the point of discharge, place of use, or use of treated wastewater that results in a decrease of flow in any portion of a watercourse, the Discharger must file a petition with the State Water Board, Division of Water Rights, and receive approval for such a change. (Water Code § 1211.)

#### **B. Monitoring and Reporting Program (MRP) Requirements**

The Discharger shall comply with the MRP, and future revisions thereto, in Attachment E of this Order.

#### **C. Special Provisions**

##### **1. Reopener Provisions**

- a. If more stringent applicable water quality standards are promulgated or approved pursuant to section 303 of the federal CWA, and amendments thereto, the Regional Water Board may revise and modify this Order in accordance with such more stringent standards.
- b. This Order may be reopened to include effluent limitations for toxic constituents determined to be present in significant amounts in the discharge through a more comprehensive monitoring program included as part of this Order and based on the results of the RPA.
- c. This Order may be reopened and modified in accordance with the provisions set forth in 40 C.F.R., parts 122 and 124, to include requirements for the implementation of the watershed management approach or to include new MLs.

- d. This Order may be reopened and modified to revise effluent limitations as a result of future Basin Plan Amendments, such as an update of an objective or the adoption of a TMDL for Ballona Creek.
- e. This Order may also be reopened and modified, revoked, and reissued or terminated in accordance with the provisions of 40 C.F.R. sections 122.44, 122.62 to 122.64, 125.62, and 125.64. Causes for taking such actions include, but are not limited to, failure to comply with any condition of this Order, and endangerment to human health or the environment resulting from the permitted activity.
- f. This Order may be reopened for modification, or revocation and reissuance, as a result of the detection of a reportable priority pollutant generated by special conditions included in this Order. These special conditions may be, but are not limited to, fish tissue sampling, whole effluent toxicity, monitoring requirements on internal waste stream(s), and monitoring for surrogate parameters. Additional requirements may be included in this Order as a result of the special condition monitoring data.

## 2. Special Studies, Technical Reports and Additional Monitoring Requirements

### a. Initial Investigation Toxicity Reduction Evaluation (TRE) Workplan.

The Discharger shall submit to the Regional Water Board an Initial Investigation TRE workplan (1-2 pages) **within 90 days** of the effective date of this permit. This plan shall describe the steps the Discharger intends to follow in the event that toxicity is detected. See section V of the Monitoring and Reporting Program (Attachment E) for an overview of TRE requirements.

## 3. Best Management Practices and Pollution Prevention

### a. The Discharger shall submit, **within 90 days** of the effective date of this Order:

- i. A **Storm Water Pollution Prevention Plan (SWPPP)** that describes site-specific management practices for minimizing contamination of storm water runoff and for preventing contaminated storm water runoff from being discharged directly to waters of the state. The SWPPP shall be developed in accordance with the requirements in Attachment G.
- ii. An updated **Best Management Practices Plan (BMPP)** that will be implemented to reduce the discharge of pollutants to the receiving water. The BMPP shall include site-specific plans and procedures implemented and/or to be implemented to prevent hazardous waste/material from being discharged to waters of the State. Further, the Discharger shall ensure that the storm water discharges from the Facility would neither cause, nor contribute to the exceedance of water quality standards and objectives, nor create conditions of nuisance in the receiving water, and that unauthorized discharges (i.e., spills) to the receiving water have been effectively prohibited. In particular, a risk assessment of each area identified by the Discharger shall be performed to determine the potential for hazardous or toxic waste/material discharge to surface waters. The BMPP shall be developed in accordance with requirements in Attachment G.

Each plan shall cover all areas of the Facility and shall include an updated drainage map for the Facility. The Discharger shall identify on a map of appropriate scale the areas that contribute runoff to the permitted discharge point; describe the activities in each area and the potential for contamination of storm water runoff and the

discharge of hazardous waste/material; and address the feasibility of containment and/or treatment of storm water. The plans shall be reviewed annually and at the same time. Updated information shall be submitted within 30 days of revision.

The Discharger shall implement the SWPPP and BMPP within 10 days of the approval by the Executive Officer or no later than 90 days after submission to the Regional Water Board, whichever comes first.

**4. Construction, Operation and Maintenance Specifications**

The Discharger shall at all times properly operate and maintain all facilities and systems installed or used to achieve compliance with this order.

**5. Other Special Provisions – Not Applicable**

**6. Compliance Schedules – Not Applicable**

**IX. COMPLIANCE DETERMINATION**

Compliance with the effluent limitations contained in section IV of this Order will be determined as specified below:

**A. Single Constituent Effluent Limitation**

If the concentration of the pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reported Minimum Level (see Reporting Requirement I.G. of the MRP), then the Discharger is out of compliance.

**B. Effluent Limitations Expressed as a Sum of Several Constituents**

If the sum of the individual pollutant concentrations is greater than the effluent limitation, then the Discharger is out of compliance. In calculating the sum of the concentrations of a group of pollutants, consider constituents reported as ND or DNQ to have concentrations equal to zero, provided that the applicable ML is used.

**C. Effluent Limitations Expressed as a Median**

In determining compliance with a median limitation, the analytical results in a set of data will be arranged in order of magnitude (either increasing or decreasing order); and

1. If the number of measurements (n) is odd, then the median will be calculated as  $X_{(n+1)/2}$ , or
2. If the number of measurements (n) is even, then the median will be calculated as  $[X_{n/2} + X_{(n/2)+1}]/2$ , i.e. the midpoint between the  $n/2$  and  $n/2+1$  data points.

**D. Multiple Sample Data**

When determining compliance with an AMEL or MDEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:

1. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
2. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of

data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.

#### **E. Average Monthly Effluent Limitation (AMEL)**

If the average (or when applicable, the median determined by subsection D above for multiple sample data) of daily discharges over a calendar month exceeds the AMEL for a given parameter, this will represent a single violation; though the Discharger will be considered out of compliance for each day of that month for that parameter (e.g., resulting in 31 days of non-compliance in a 31-day month). If only a single sample is taken during the calendar month and the analytical result for that sample exceeds the AMEL, the Discharger will be considered out of compliance for that calendar month. For any one calendar month during which no sample (daily discharge) is taken, no compliance determination can be made for that calendar month.

In determining compliance with the AMEL, the following provisions shall also apply to all constituents:

1. If the analytical result of a single sample, monitored monthly, quarterly, semiannually, or annually, does not exceed the AMEL for that constituent, the Discharger has demonstrated compliance with the AMEL for that month;
2. If the analytical result of a single sample monitored monthly, quarterly, semiannually, or annually, exceeds the AMEL for any constituent, the Discharger shall collect four additional samples at approximately equal intervals during the month. All five analytical results shall be reported in the monitoring report for that month, or 45 days after results for the additional samples were received, whichever is later.

When all sample results are greater than or equal to the reported Minimum Level (see Reporting Requirement I.G. of the MRP), the numerical average of the analytical results of these five samples will be used for compliance determination.

When one or more sample results are reported as "Not-Detected (ND)" or "Detected, but Not Quantified (DNQ)" (see Reporting Requirement I.G. of the MRP), the median value of these four samples shall be used for compliance determination. If one or both of the middle values is ND or DNQ, the median shall be the lower of the two middle values.

3. In the event of noncompliance with an AMEL, the sampling frequency for that constituent shall be increased to weekly and shall continue at this level until compliance with the AMEL has been demonstrated.
4. If only one sample was obtained for the month or more than a monthly period and the result exceeds the AMEL; then the Discharger is in violation of the AMEL.

#### **F. Maximum Daily Effluent Limitation (MDEL)**

If a daily discharge exceeds the MDEL for a given parameter, an alleged violation will be flagged and the discharger will be considered out of compliance for that parameter for that 1 day only within the reporting period. For any 1 day during which no sample is taken, no compliance determination can be made for that day.

#### **G. Instantaneous Minimum Effluent Limitation**

If the analytical result of a single grab sample is lower than the instantaneous minimum effluent limitation for a parameter, a violation will be flagged and the discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within

a calendar day that both are lower than the instantaneous minimum effluent limitation would result in two instances of non-compliance with the instantaneous minimum effluent limitation).

#### **H. Instantaneous Maximum Effluent Limitation**

If the analytical result of a single grab sample is higher than the instantaneous maximum effluent limitation for a parameter, a violation will be flagged and the discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both exceed the instantaneous maximum effluent limitation would result in two instances of non-compliance with the instantaneous maximum effluent limitation.)

#### **I. Median Monthly Effluent Limitation (MMEL)**

If the median of daily discharges over a calendar month exceeds the MMEL for a given parameter, an alleged violation will be flagged and the Discharger will be considered out of compliance for each day of that month for that parameter (e.g., resulting in 31 days of noncompliance in a 31-day month). However, an alleged violation of the MMEL will be considered one violation for the purpose of assessing State mandatory minimum penalties. If no sample (daily discharge) is taken over a calendar month, no compliance determination can be made for that month with respect to effluent violation determination, but compliance determination can be made for that month with respect to reporting violation determination.

#### **J. Chronic Toxicity**

The discharge is subject to determination of “Pass” or “Fail” and “Percent (%) Effect” from a single-effluent concentration chronic toxicity test at the discharge IWC using the Test of Significant Toxicity (TST) statistical approach described in National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document (EPA 833-R-10-003, 2010), Appendix A, Figure A-1, and Table A-1. The null hypothesis ( $H_0$ ) for the TST statistical approach is: Mean discharge IWC response  $\leq$  (0.75  $\times$  Mean control response). A test result that rejects this null hypothesis is reported as “Pass”. A test result that does not reject this null hypothesis is reported as “Fail”. The relative “Percent Effect” at the discharge IWC is defined and reported as  $((\text{Mean control response} - \text{Mean discharge IWC response}) / \text{Mean control response}) \times 100\%$ .

The Median Monthly Effluent Limitation (MMEL) for chronic toxicity is exceeded and a violation will be flagged when the median of no more than three independent chronic toxicity tests, conducted within the same calendar month and analyzed using the TST statistical approach, results in “Fail”. The MMEL for chronic toxicity shall only apply when there is a discharge more than one day in a calendar month period. During such calendar months, up to three independent toxicity tests are required when one toxicity test results in “Fail.”

The Maximum Daily Effluent Limitation (MDEL) for chronic toxicity is exceeded and a violation will be flagged when a chronic toxicity test, analyzed using the TST statistical approach, results in “Fail” and the “Percent (%) Effect” is  $\geq$  50%.

#### **K. Mass and Concentration Limitations**

Compliance with mass effluent limitations and concentration effluent limitations for the same parameter shall be determined separately. When the concentration for a parameter in a sample is reported as ND or DNQ, the corresponding mass emission rate determined using that sample concentration shall also be reported as ND or DNQ.

**L. Bacterial Standards and Analyses**

The geometric mean used for determining compliance with bacterial standards is calculated using the following equation:

$$\text{Geometric Mean} = (C_1 \times C_2 \times \dots \times C_n)^{1/n}$$

where n is the number of days samples were collected during the period and C is the concentration of bacteria (MPN/100 mL or CFU/100 mL) found on each day of sampling. For bacterial analyses, sample dilutions should be performed so the expected range of values is bracketed (for example, with multiple tube fermentation method or membrane filtration method, 2 to 16,000 per 100 ml for total and fecal coliform, at a minimum, and 1 to 1000 per 100 ml for *Enterococcus*). The detection method used for each analysis shall be reported with the results of the analysis.

Detection methods used for coliforms (total and fecal) and *Enterococcus* shall be those presented in Table 1A of 40 C.F.R. part 136 (revised May 18, 2012), unless alternate methods have been approved by U.S. EPA pursuant to 40 C.F.R. part 136 or improved methods have been determined by the Executive Officer and/or U.S. EPA.

## ATTACHMENT A – DEFINITIONS

### Arithmetic Mean ( $\mu$ )

Also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

Arithmetic mean =  $\mu = \Sigma x / n$       where:  $\Sigma x$  is the sum of the measured ambient water concentrations, and  $n$  is the number of samples.

### Average Monthly Effluent Limitation (AMEL)

The highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

### Average Weekly Effluent Limitation (AWEL)

The highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

### Bioaccumulative

Those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

### Carcinogenic

Pollutants are substances that are known to cause cancer in living organisms.

### Coefficient of Variation (CV)

CV is a measure of the data variability and is calculated as the estimated standard deviation divided by the arithmetic mean of the observed values.

### Daily Discharge

Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of one day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

For composite sampling, if 1 day is defined as a 24-hour period other than a calendar day, the analytical result for the 24-hour period will be considered as the result for the calendar day in which the 24-hour period ends.

### Detected, but Not Quantified (DNQ)

DNQ are those sample results less than the RL, but greater than or equal to the laboratory's MDL. Sample results reported as DNQ are estimated concentrations.

### **Dilution Credit**

Dilution Credit is the amount of dilution granted to a discharge in the calculation of a water quality-based effluent limitation, based on the allowance of a specified mixing zone. It is calculated from the dilution ratio or determined through conducting a mixing zone study or modeling of the discharge and receiving water.

### **Dry Weather Event**

Any day when the maximum daily flow of Ballona Creek at Stream Gauge No. F38C-R is less than 64 cfs.

### **Effluent Concentration Allowance (ECA)**

ECA is a value derived from the water quality criterion/objective, dilution credit, and ambient background concentration that is used, in conjunction with the coefficient of variation for the effluent monitoring data, to calculate a long-term average (LTA) discharge concentration. The ECA has the same meaning as waste load allocation (WLA) as used in U.S. EPA guidance (Technical Support Document For Water Quality-based Toxics Control, March 1991, second printing, EPA/505/2-90-001).

### **Enclosed Bays**

Enclosed Bays means indentations along the coast that enclose an area of oceanic water within distinct headlands or harbor works. Enclosed bays include all bays where the narrowest distance between the headlands or outermost harbor works is less than 75 percent of the greatest dimension of the enclosed portion of the bay. Enclosed bays include, but are not limited to, Humboldt Bay, Bodega Harbor, Tomales Bay, Drake's Estero, San Francisco Bay, Morro Bay, Los Angeles-Long Beach Harbor, Upper and Lower Newport Bay, Mission Bay, and San Diego Bay. Enclosed bays do not include inland surface waters or ocean waters.

### **Estimated Chemical Concentration**

The estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

### **Estuaries**

Estuaries means waters, including coastal lagoons, located at the mouths of streams that serve as areas of mixing for fresh and ocean waters. Coastal lagoons and mouths of streams that are temporarily separated from the ocean by sandbars shall be considered estuaries. Estuarine waters shall be considered to extend from a bay or the open ocean to a point upstream where there is no significant mixing of fresh water and seawater. Estuarine waters included, but are not limited to, the Sacramento-San Joaquin Delta, as defined in Water Code section 12220, Suisun Bay, Carquinez Strait downstream to the Carquinez Bridge, and appropriate areas of the Smith, Mad, Eel, Noyo, Russian, Klamath, San Diego, and Otay rivers. Estuaries do not include inland surface waters or ocean waters.

### **Existing Discharger**

Any Discharger that is not a new discharger. An existing discharger includes an "increasing discharger" (i.e., any existing facility with treatment systems in places for its current discharge that is or will be expanding, upgrading, or modifying its permitted discharge after the effective date of this Order.)

### **Infeasible**

Not capable of being accomplished in a successful manner within a reasonable period of time, taking into account economic, environmental, legal, social, and technological factors.

### **Inland Surface Waters**

All surface waters of the state that do not include the ocean, enclosed bays, or estuaries.

**Instantaneous Maximum Effluent Limitation**

The highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

**Instantaneous Minimum Effluent Limitation**

The lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

**Maximum Daily Effluent Limitation (MDEL)**

The highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

**Median**

The middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of measurements (n) is odd, then the median =  $X_{(n+1)/2}$ . If n is even, then the median =  $(X_{n/2} + X_{(n/2)+1})/2$  (i.e., the midpoint between the n/2 and n/2+1).

**Method Detection Limit (MDL)**

MDL is the minimum concentration of a substance that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero, as defined in 40 C.F.R. part 136, Attachment B, revised as of July 3, 1999.

**Minimum Level (ML)**

ML is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

**Mixing Zone**

Mixing Zone is a limited volume of receiving water that is allocated for mixing with a wastewater discharge where water quality criteria can be exceeded without causing adverse effects to the overall water body.

**Monthly Median Effluent Limitation (MMEL)**

The Median Monthly Effluent Limitation (MMEL) for chronic toxicity is based on the median results of three independent toxicity tests, conducted within the same calendar month, and analyzed using the TST statistical approach. The MMEL is exceeded when the median result (i.e. two out of three) is a "fail."

**Not Detected (ND)**

Sample results which are less than the laboratory's MDL.

**Persistent Pollutants**

Persistent pollutants are substances for which degradation or decomposition in the environment is nonexistent or very slow.

**Pollutant Minimization Program (PMP)**

PMP means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Regional Water Board may consider cost effectiveness when establishing the requirements of a PMP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to Water Code section 13263.3(d), shall be considered to fulfill the PMP requirements.

**Pollution Prevention**

Pollution Prevention means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as defined in Water Code section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the State Water Resources Control Board (State Water Board) or Regional Water Board.

**Reporting Level (RL)**

The RL is the ML (and its associated analytical method) chosen by the Discharger for reporting and compliance determination from the MLs included in this Order, including an additional factor if applicable as discussed herein. The MLs included in this Order correspond to approved analytical methods for reporting a sample result that are selected by the Regional Water Board either from Appendix 4 of the SIP in accordance with section 2.4.2 of the SIP or established in accordance with section 2.4.3 of the SIP. The ML is based on the proper application of method-based analytical procedures for sample preparation and the absence of any matrix interferences. Other factors may be applied to the ML depending on the specific sample preparation steps employed. For example, the treatment typically applied in cases where there are matrix-effects is to dilute the sample or sample aliquot by a factor of ten. In such cases, this additional factor must be applied to the ML in the computation of the RL.

**Significant Storm Event**

A continuous discharge of storm water for a minimum of one hour, or the intermittent discharge of storm water for a minimum of 3 hours in a 12-hour period.

**Source of Drinking Water**

Any water designated as municipal or domestic supply (MUN) in a Regional Water Board Basin Plan.

**Standard Deviation ( $\sigma$ )**

Standard Deviation is a measure of variability that is calculated as follows:

$$\sigma = (\sum[(x - \mu)^2]/(n - 1))^{0.5}$$

where:

x is the observed value;

$\mu$  is the arithmetic mean of the observed values; and

n is the number of samples.

**Toxicity Reduction Evaluation (TRE)**

TRE is a study conducted in a step-wise process designed to identify the causative agents of effluent or ambient toxicity, isolate the sources of toxicity, evaluate the effectiveness of toxicity control options, and then confirm the reduction in toxicity. The first steps of the TRE consist of the collection of data relevant to the toxicity, including additional toxicity testing, and an evaluation of facility operations and maintenance practices, and best management practices. A Toxicity Identification Evaluation (TIE) may be required as part of the TRE, if appropriate. (A TIE is a set of procedures to identify the specific chemical(s) responsible for toxicity. These procedures are performed in three phases (characterization, identification, and confirmation) using aquatic organism toxicity tests.)

**Wet Weather Event**

Any day when the maximum daily flow of Ballona Creek at Stream Gauge No. F38C-R is equal to or greater than 64 cfs.

## ACRONYMS AND ABBREVIATIONS

AMEL.....	Average Monthly Effluent Limitation
B.....	Background Concentration
BAT .....	Best Available Technology Economically Achievable
Basin Plan .....	Water Quality Control Plan for the Coastal Watersheds of Los Angeles and Ventura Counties
BCT .....	Best Conventional Pollutant Control Technology
BMP.....	Best Management Practices
BMPP .....	Best Management Practices Plan
BPJ .....	Best Professional Judgment
BOD.....	Biochemical Oxygen Demand 5-day @ 20 °C
BPT .....	Best Practicable Treatment Control Technology
C.....	Water Quality Objective
CCR .....	California Code of Regulations
CEQA .....	California Environmental Quality Act
C.F.R.....	Code of Federal Regulations
CTR.....	California Toxics Rule
CV .....	Coefficient of Variation
CWA.....	Clean Water Act
CWC .....	California Water Code
Discharger .....	Donald T. Sterling Corporation
DMR .....	Discharge Monitoring Report
DNQ .....	Detected But Not Quantified
ELAP .....	State Water Resources Control Board, Drinking Water Division, Environmental Laboratory Accreditation Program
ELG .....	Effluent Limitations, Guidelines, and Standards
Facility .....	Sterling Ambassador Towers
g/kg.....	grams per kilogram
gpd .....	gallons per day
IC.....	Inhibition Coefficient
IC <sub>15</sub> .....	Concentration at which the organism is 15% inhibited
IC <sub>25</sub> .....	Concentration at which the organism is 25% inhibited
IC <sub>40</sub> .....	Concentration at which the organism is 40% inhibited
IC <sub>50</sub> .....	Concentration at which the organism is 50% inhibited
LA.....	Load Allocations
LOEC.....	Lowest Observed Effect Concentration
µg/L .....	micrograms per Liter
LACDPW .....	County of Los Angeles, Department of Public Works
mg/L .....	milligrams per Liter
MDEL .....	Maximum Daily Effluent Limitation
MEC .....	Maximum Effluent Concentration
MGD .....	Million Gallons per Day
ML .....	Minimum Level
MMEL .....	Monthly Median Effluent Limitation
MRP .....	Monitoring and Reporting Program
ND .....	Not Detected
ng/L .....	nanograms per liter
NOEC .....	No Observable Effect Concentration
NPDES .....	National Pollutant Discharge Elimination System


NSPS.....	New Source Performance Standards
NTR.....	National Toxics Rule
OAL.....	Office of Administrative Law
PAHs.....	Polynuclear Aromatic Hydrocarbons
pg/L.....	picograms per liter
PMEL.....	Proposed Maximum Daily Effluent Limitation
PMP.....	Pollutant Minimization Plan
POTW.....	Publicly Owned Treatment Works
ppm.....	parts per million
ppb.....	parts per billion
QA.....	Quality Assurance
QA/QC.....	Quality Assurance/Quality Control
Ocean Plan.....	Water Quality Control Plan for Ocean Waters of California
Regional Water Board.....	California Regional Water Quality Control Board, Los Angeles Region
RPA.....	Reasonable Potential Analysis
SCP.....	Spill Contingency Plan
Sediment Quality Plan.....	<i>Water Quality Control Plan for Enclosed Bays and Estuaries – Part 1 Sediment Quality</i>
SIP.....	State Implementation Policy (Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California)
SMR.....	Self-Monitoring Reports
State Water Board.....	California State Water Resources Control Board
SWPPP.....	Storm Water Pollution Prevention Plan
TAC.....	Test Acceptability Criteria
TBEL.....	Technology-Based Effluent Limitation
Thermal Plan.....	Water Quality Control Plan for Control of Temperature in the Coastal and Interstate Water and Enclosed Bays and Estuaries of California
TIE.....	Toxicity Identification Evaluation
TMDL.....	Total Maximum Daily Load
TOC.....	Total Organic Carbon
TRE.....	Toxicity Reduction Evaluation
TSD.....	Technical Support Document
TSS.....	Total Suspended Solid
TST.....	Test of Significant Toxicity
TU <sub>c</sub> .....	Chronic Toxicity Unit
U.S. EPA.....	United States Environmental Protection Agency
WDR.....	Waste Discharge Requirements
WET.....	Whole Effluent Toxicity
WLA.....	Waste Load Allocations
WQBELs.....	Water Quality-Based Effluent Limitations
WQS.....	Water Quality Standards
%.....	Percent

**ATTACHMENT B – MAPS**


Site Map for Ambassador Towers, CA0053091




Area Map. Ambassador Towers. CA0053091

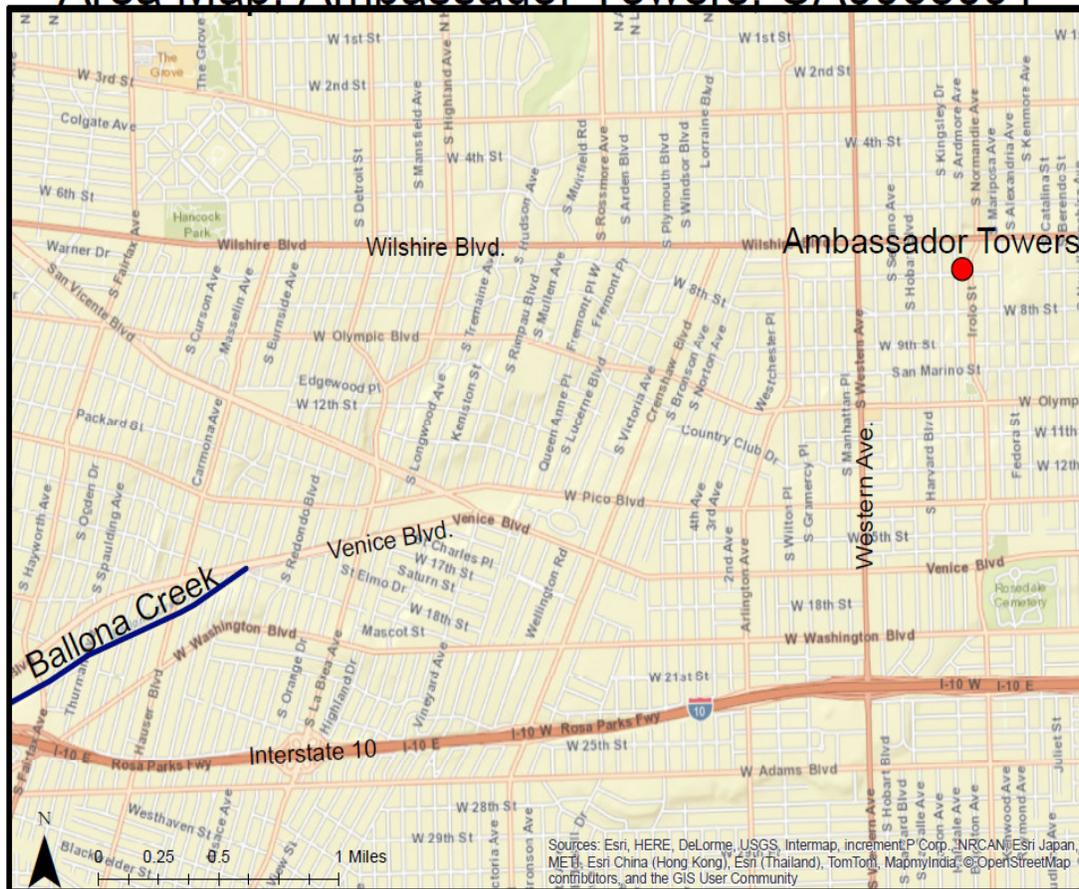

**ATTACHMENT C-1- FLOW SCHEMATIC**

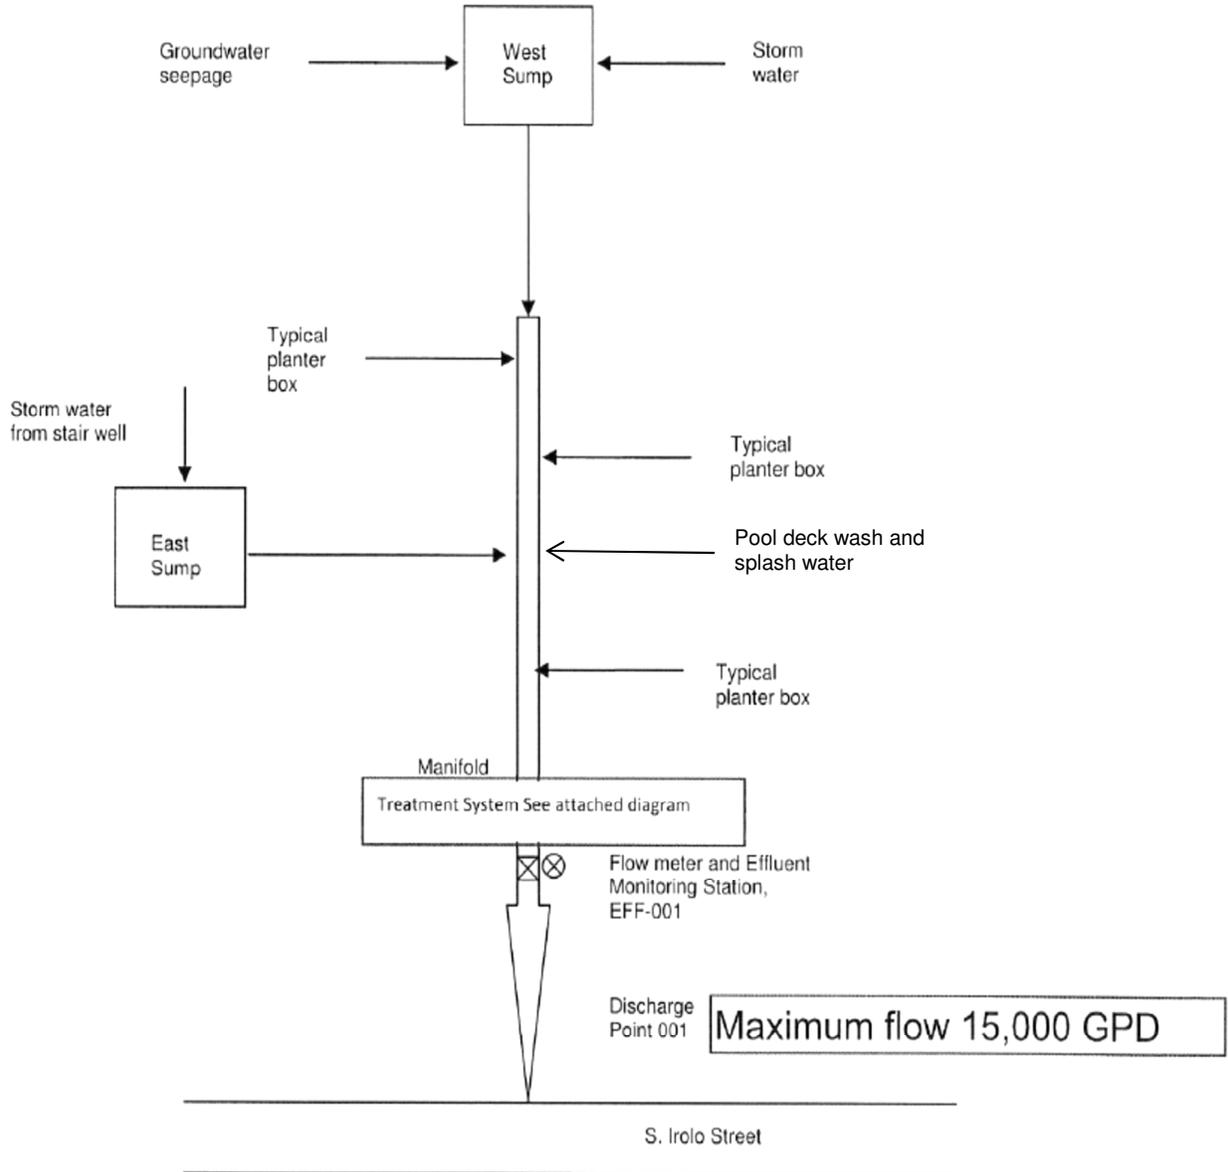

**ATTACHMENT C-2 – FLOW SCHEMATIC OF TREATMENT SYSTEM**

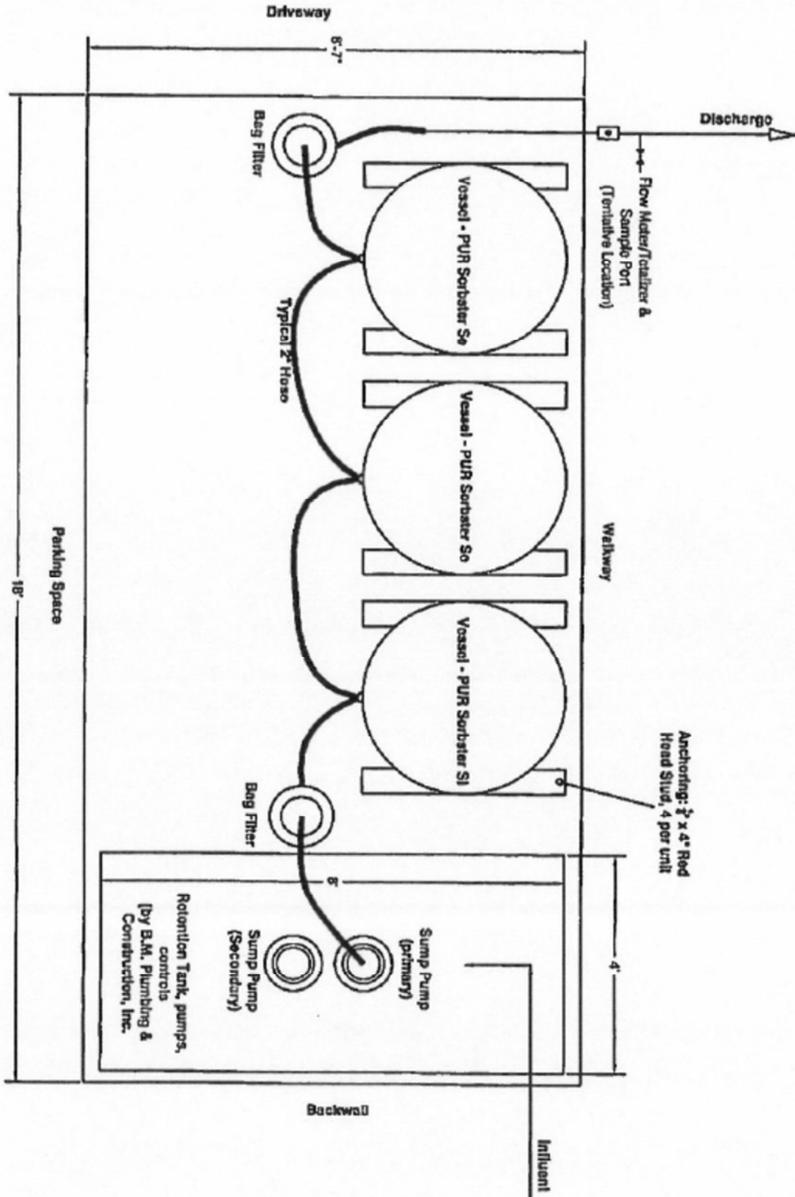

APPROVED and release for construction:

By: Print name Heidi Rept

Signature [Handwritten Signature]

Date 8/15/13

 <p><b>Pure Effect</b></p>	<p>601 W. Valencia Dr.          Fullerton CA 92832          (714) 639-7873          Fax: (714) 639-8530          www.pureeffect.com</p>
	<p>ENGINEERED SOLUTIONS FOR OUR ENVIRONMENT</p>
<p><b>Ambassador Tower Project</b></p>	
<p><b>Groundwater Treatment System for Selenium Removal</b></p>	
<p>DATE: 7/30/13</p>	
<p>Design Flow Rate: 20 GPM Maximum</p>	
<p>Scale: 1" = 3 ft.</p>	
<p>Legal Notice: This information is the property of Pure Effect, Inc., confidential and privileged, not for discussion or distribution to others outside your company, or used for reference or bidding purposes by others, without written authorization from Pure Effect, Inc. Please contact Pure Effect, Inc. to request written authorization. (714) 639-7873.</p>	
<p>Drawn by: <b>J. Tagarao</b></p>	

## **ATTACHMENT D – STANDARD PROVISIONS**

### **I. STANDARD PROVISIONS – PERMIT COMPLIANCE**

#### **A. Duty to Comply**

1. The Discharger must comply with all of the terms, requirements, and conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code and is grounds for enforcement action; permit termination, revocation and reissuance, or modification; denial of a permit renewal application; or a combination thereof. (40 C.F.R. § 122.41(a); Wat. Code, §§ 13261, 13263, 13265, 13268, 13000, 13001, 13304, 13350, 13385.)
2. The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants and with standards for sewage sludge use or disposal established under Section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement. (40 C.F.R. § 122.41(a)(1).)

#### **B. Need to Halt or Reduce Activity Not a Defense**

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order. (40 C.F.R. § 122.41(c).)

#### **C. Duty to Mitigate**

The Discharger shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment. (40 C.F.R. § 122.41(d).)

#### **D. Proper Operation and Maintenance**

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order. (40 C.F.R. § 122.41(e).)

#### **E. Property Rights**

1. This Order does not convey any property rights of any sort or any exclusive privileges. (40 C.F.R. § 122.41(g).)
2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of state or local law or regulations. (40 C.F.R. § 122.5(c).)

#### **F. Inspection and Entry**

The Discharger shall allow the Regional Water Board, State Water Board, U.S. EPA, and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to (33 U.S.C. § 1318(a)(4)(B); 40 C.F.R. § 122.41(i); Wat. Code, §§ 13267, 13383):

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order (33 U.S.C. § 1318(a)(4)(B)(i); 40 C.F.R. § 122.41(i)(1); Wat. Code, §§ 13267, 13383);
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order (33 U.S.C. § 1318(a)(4)(B)(ii); 40 C.F.R. § 122.41(i)(2); Wat. Code, §§ 13267, 13383);
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order (33 U.S.C. § 1318(a)(4)(B)(ii); 40 C.F.R. § 122.41(i)(3); Wat. Code, §§ 13267, 13383); and
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the Water Code, any substances or parameters at any location. (33 U.S.C. § 1318(a)(4)(B); 40 C.F.R. § 122.41(i)(4); Wat. Code, §§ 13267, 13383.)

#### **G. Bypass**

1. Definitions
  - a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility. (40 C.F.R. § 122.41(m)(1)(i).)
  - b. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production. (40 C.F.R. § 122.41(m)(1)(ii).)
2. Bypass not exceeding limitations. The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3, I.G.4, and I.G.5 below. (40 C.F.R. § 122.41(m)(2).)
3. Prohibition of bypass. Bypass is prohibited, and the Regional Water Board may take enforcement action against a Discharger for bypass, unless (40 C.F.R. § 122.41(m)(4)(i)):
  - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage (40 C.F.R. § 122.41(m)(4)(i)(A));
  - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance (40 C.F.R. § 122.41(m)(4)(i)(B)); and
  - c. The Discharger submitted notice to the Regional Water Board as required under Standard Provisions – Permit Compliance I.G.5 below. (40 C.F.R. § 122.41(m)(4)(i)(C).)
4. The Regional Water Board may approve an anticipated bypass, after considering its adverse effects, if the Regional Water Board determines that it will meet the three

conditions listed in Standard Provisions – Permit Compliance I.G.3 above. (40 C.F.R. § 122.41(m)(4)(ii).)

**5. Notice**

- a. Anticipated bypass. If the Discharger knows in advance of the need for a bypass, it shall submit a notice, if possible at least 10 days before the date of the bypass. (40 C.F.R. § 122.41(m)(3)(i).)
- b. Unanticipated bypass. The Discharger shall submit notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below (24-hour notice). (40 C.F.R. § 122.41(m)(3)(ii).)

**H. Upset**

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the Discharger. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation. (40 C.F.R. § 122.41(n)(1).)

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of Standard Provisions – Permit Compliance I.H.2 below are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review. (40 C.F.R. § 122.41(n)(2).)
2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that (40 C.F.R. § 122.41(n)(3)):
  - a. An upset occurred and that the Discharger can identify the cause(s) of the upset (40 C.F.R. § 122.41(n)(3)(i));
  - b. The permitted facility was, at the time, being properly operated (40 C.F.R. § 122.41(n)(3)(ii));
  - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b below (24-hour notice) (40 C.F.R. § 122.41(n)(3)(iii)); and
  - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above. (40 C.F.R. § 122.41(n)(3)(iv).)
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof. (40 C.F.R. § 122.41(n)(4).)

**II. STANDARD PROVISIONS – PERMIT ACTION**

**A. General**

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition. (40 C.F.R. § 122.41(f).)

**B. Duty to Reapply**

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit. (40 C.F.R. § 122.41(b).)

**C. Transfers**

This Order is not transferable to any person except after notice to the Regional Water Board. The Regional Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the Water Code. (40 C.F.R. §§ 122.41(l)(3), 122.61.)

**III. STANDARD PROVISIONS – MONITORING**

- A.** Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity. (40 C.F.R. § 122.41(j)(1).)
- B.** Monitoring results must be conducted according to test procedures approved under 40 C.F.R. part 136 for the analyses of pollutants unless another method is required under 40 C.F.R. subchapters N or O. In the case of pollutants for which there are no approved methods under 40 C.F.R. part 136 or otherwise required under 40 C.F.R. subchapters N or O, monitoring must be conducted according to a test procedure specified in this Order for such pollutants. (40 C.F.R. §§ 122.41(j)(4), 122.44(i)(1)(iv).)

**IV. STANDARD PROVISIONS – RECORDS**

- A.** Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 C.F.R. part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Regional Water Board Executive Officer at any time. (40 C.F.R. § 122.41(j)(2).)
- B.** Records of monitoring information shall include:
  - 1. The date, exact place, and time of sampling or measurements (40 C.F.R. § 122.41(j)(3)(i));
  - 2. The individual(s) who performed the sampling or measurements (40 C.F.R. § 122.41(j)(3)(ii));
  - 3. The date(s) analyses were performed (40 C.F.R. § 122.41(j)(3)(iii));
  - 4. The individual(s) who performed the analyses (40 C.F.R. § 122.41(j)(3)(iv));
  - 5. The analytical techniques or methods used (40 C.F.R. § 122.41(j)(3)(v)); and
  - 6. The results of such analyses. (40 C.F.R. § 122.41(j)(3)(vi).)
- C.** Claims of confidentiality for the following information will be denied (40 C.F.R. § 122.7(b)):
  - 1. The name and address of any permit applicant or Discharger (40 C.F.R. § 122.7(b)(1)); and
  - 2. Permit applications and attachments, permits and effluent data. (40 C.F.R. § 122.7(b)(2).)

## **V. STANDARD PROVISIONS – REPORTING**

### **A. Duty to Provide Information**

The Discharger shall furnish to the Regional Water Board, State Water Board, or U.S. EPA within a reasonable time, any information which the Regional Water Board, State Water Board, or U.S. EPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Regional Water Board, State Water Board, or U.S. EPA copies of records required to be kept by this Order. (40 C.F.R. § 122.41(h); Wat. Code, §§ 13267, 13383.)

### **B. Signatory and Certification Requirements**

1. All applications, reports, or information submitted to the Regional Water Board, State Water Board, and/or U.S. EPA shall be signed and certified in accordance with Standard Provisions – Reporting V.B.2, V.B.3, V.B.4, and V.B.5 below. (40 C.F.R. § 122.41(k).)
2. All permit applications shall be signed by a responsible corporate officer. For the purpose of this section, a responsible corporate officer means: (i) A president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy- or decision-making functions for the corporation, or (ii) the manager of one or more manufacturing, production, or operating facilities, provided, the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental laws and regulations; the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. (40 C.F.R. § 122.22(a)(1).)
3. All reports required by this Order and other information requested by the Regional Water Board, State Water Board, or U.S. EPA shall be signed by a person described in Standard Provisions – Reporting V.B.2 above, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
  - a. The authorization is made in writing by a person described in Standard Provisions – Reporting V.B.2 above (40 C.F.R. § 122.22(b)(1));
  - b. The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.) (40 C.F.R. § 122.22(b)(2)); and
  - c. The written authorization is submitted to the Regional Water Board and State Water Board. (40 C.F.R. § 122.22(b)(3).)
4. If an authorization under Standard Provisions – Reporting V.B.3 above is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Standard Provisions – Reporting V.B.3 above must be submitted to the Regional Water Board and

State Water Board prior to or together with any reports, information, or applications, to be signed by an authorized representative. (40 C.F.R. § 122.22(c).)

5. Any person signing a document under Standard Provisions – Reporting V.B.2 or V.B.3 above shall make the following certification:

“I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.” (40 C.F.R. § 122.22(d).)

### **C. Monitoring Reports**

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program (Attachment E) in this Order. (40 C.F.R. § 122.41(l)(4).)
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Regional Water Board or State Water Board for reporting results of monitoring of sludge use or disposal practices. (40 C.F.R. § 122.41(l)(4)(i).)
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under 40 C.F.R. part 136, or another method required for an industry-specific waste stream under 40 C.F.R. subchapters N or O, the results of such monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Regional Water Board. (40 C.F.R. § 122.41(l)(4)(ii).)
4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order. (40 C.F.R. § 122.41(l)(4)(iii).)

### **D. Compliance Schedules**

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date. (40 C.F.R. § 122.41(l)(5).)

### **E. Twenty-Four Hour Reporting**

1. The Discharger shall report any noncompliance that may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the Discharger becomes aware of the circumstances. A written submission shall also be provided within five (5) days of the time the Discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance. (40 C.F.R. § 122.41(l)(6)(i).)
2. The following shall be included as information that must be reported within 24 hours under this paragraph (40 C.F.R. § 122.41(l)(6)(ii)):
  - a. Any unanticipated bypass that exceeds any effluent limitation in this Order. (40 C.F.R. § 122.41(l)(6)(ii)(A).)

- b. Any upset that exceeds any effluent limitation in this Order. (40 C.F.R. § 122.41(l)(6)(ii)(B).)
3. The Regional Water Board may waive the above-required written report under this provision on a case-by-case basis if an oral report has been received within 24 hours. (40 C.F.R. § 122.41(l)(6)(iii).)

#### **F. Planned Changes**

The Discharger shall give notice to the Regional Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when (40 C.F.R. § 122.41(l)(1)):

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in section 122.29(b) (40 C.F.R. § 122.41(l)(1)(i)); or
2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are subject neither to effluent limitations in this Order nor to notification requirements under section 122.42(a)(1) (see Additional Provisions—Notification Levels VII.A.1). (40 C.F.R. § 122.41(l)(1)(ii).)
3. The alteration or addition results in a significant change in the Discharger's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan. (40 C.F.R. § 122.41(l)(1)(iii).)

#### **G. Anticipated Noncompliance**

The Discharger shall give advance notice to the Regional Water Board or State Water Board of any planned changes in the permitted facility or activity that may result in noncompliance with this Order's requirements. (40 C.F.R. § 122.41(l)(2).)

#### **H. Other Noncompliance**

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting V.C, V.D, and V.E above at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E above. (40 C.F.R. § 122.41(l)(7).)

#### **I. Other Information**

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Regional Water Board, State Water Board, or U.S. EPA, the Discharger shall promptly submit such facts or information. (40 C.F.R. § 122.41(l)(8).)

### **VI. STANDARD PROVISIONS – ENFORCEMENT**

- A. The Regional Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13268, 13385, 13386, and 13387.
- B. The CWA provides that any person who violates section 301, 302, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any such sections in a permit issued under section 402, or any requirement imposed in a pretreatment program approved

under sections 402(a)(3) or 402(b)(8) of the Act, is subject to a civil penalty not to exceed \$25,000 per day for each violation. The CWA provides that any person who negligently violates sections 301, 302, 306, 307, 308, 318, or 405 of the Act, or any condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, or any requirement imposed in a pretreatment program approved under section 402(a)(3) or 402(b)(8) of the Act, is subject to criminal penalties of \$2,500 to \$25,000 per day of violation, or imprisonment of not more than one (1) year, or both. In the case of a second or subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation, or by imprisonment of not more than two (2) years, or both. Any person who knowingly violates such sections, or such conditions or limitations is subject to criminal penalties of \$5,000 to \$50,000 per day of violation, or imprisonment for not more than three (3) years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than six (6) years, or both. Any person who knowingly violates section 301, 302, 303, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine of not more than \$250,000 or imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the CWA, shall, upon conviction of violating the imminent danger provision, be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions [section 122.41(a)(2)] [Water Code sections 13385 and 13387].

- C. Any person may be assessed an administrative penalty by the Regional Water Board for violating section 301, 302, 306, 307, 308, 318 or 405 of this Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of this Act. Administrative penalties for Class I violations are not to exceed \$10,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$25,000. Penalties for Class II violations are not to exceed \$10,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$125,000 [40 C.F.R. section 122.41(a)(3)].
- D. The CWA provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this Order shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than 2 years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than 4 years, or both [40 C.F.R. section 122.41(j)(5)].
- E. The CWA provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this Order, including monitoring reports or reports of compliance or noncompliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six months per violation, or by both [40 C.F.R. section 122.41(k)(2)].

## VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS

### A. Non-Municipal Facilities

Existing manufacturing, commercial, mining, and silvicultural Dischargers shall notify the Regional Water Board as soon as they know or have reason to believe (40 C.F.R. § 122.42(a)):

1. That any activity has occurred or will occur that would result in the discharge, on a routine or frequent basis, of any toxic pollutant that is not limited in this Order, if that discharge will exceed the highest of the following "notification levels" (40 C.F.R. § 122.42(a)(1)):
  - a. 100 micrograms per liter ( $\mu\text{g/L}$ ) (40 C.F.R. § 122.42(a)(1)(i));
  - b. 200  $\mu\text{g/L}$  for acrolein and acrylonitrile; 500  $\mu\text{g/L}$  for 2,4-dinitrophenol and 2-methyl-4,6-dinitrophenol; and 1 milligram per liter ( $\text{mg/L}$ ) for antimony (40 C.F.R. § 122.42(a)(1)(ii));
  - c. Five (5) times the maximum concentration value reported for that pollutant in the Report of Waste Discharge (40 C.F.R. § 122.42(a)(1)(iii)); or
  - d. The level established by the Regional Water Board in accordance with section 122.44(f). (40 C.F.R. § 122.42(a)(1)(iv).)
2. That any activity has occurred or will occur that would result in the discharge, on a non-routine or infrequent basis, of any toxic pollutant that is not limited in this Order, if that discharge will exceed the highest of the following "notification levels" (40 C.F.R. § 122.42(a)(2)):
  - a. 500 micrograms per liter ( $\mu\text{g/L}$ ) (40 C.F.R. § 122.42(a)(2)(i));
  - b. 1 milligram per liter ( $\text{mg/L}$ ) for antimony (40 C.F.R. § 122.42(a)(2)(ii));
  - c. Ten (10) times the maximum concentration value reported for that pollutant in the Report of Waste Discharge (40 C.F.R. § 122.42(a)(2)(iii)); or
  - d. The level established by the Regional Water Board in accordance with section 122.44(f). (40 C.F.R. § 122.42(a)(2)(iv).)

**ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MPR NO. 5839)**

**CONTENTS**

I. General Monitoring Provisions ..... E-2  
II. Monitoring Locations ..... E-5  
III. Influent Monitoring Requirements – Not Applicable ..... E-5  
IV. Effluent Monitoring Requirements ..... E-5  
    A. Monitoring Locations EFF-001 ..... E-5  
V. Whole Effluent Toxicity Testing Requirements ..... E-9  
VI. Land Discharge Monitoring Requirements – Not Applicable ..... E-12  
VII. Recycling Monitoring Requirements – Not Applicable ..... E-12  
VIII. Receiving Water Monitoring Requirements ..... E-13  
    A. Monitoring Location RSW-001 ..... E-13  
    B. Monitoring Location RSW-002 ..... E-13  
IX. Other Monitoring Requirements ..... E-13  
X. Reporting Requirements ..... E-14  
    A. General Monitoring and Reporting Requirements ..... E-14  
    B. Self-Monitoring Reports (SMRs) ..... E-14  
    C. Discharge Monitoring Reports (DMRs) ..... E-16  
    D. Other Reports ..... E-16

**TABLES**

Table E-1. Monitoring Station Locations ..... E-5  
Table E-2. Effluent Monitoring at EFF-001 ..... E-5  
Table E-3. Effluent Sediment Monitoring at EFF-001 ..... E-8  
Table E-4. Receiving Water Monitoring Requirements – Monitoring Location RSW-002 ..... E-13  
Table E-5. Monitoring Periods and Reporting Schedule ..... E-15

## **ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP)**

Section 308 of the federal Clean Water Act (CWA) and sections 122.41(h), (j)-(l), 122.44(i), and 122.48 of title 40 of the Code of Federal Regulations (40 C.F.R.) require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Regional Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. This MRP establishes monitoring, reporting, and recordkeeping requirements that implement the federal and California laws and/or regulations.

### **I. GENERAL MONITORING PROVISIONS**

- A.** An effluent sampling station, Monitoring Location EFF-001, shall be established for the point of discharge, Discharge Point 001, and shall be located where representative samples of that effluent can be obtained.
- B.** Laboratory Certification. Laboratories analyzing monitoring samples shall be certified by the State Water Board, Drinking Water Division, Environmental Laboratory Accreditation Program (ELAP) in accordance with the provision of Water Code section 13176, and must include quality assurance/quality control data with their reports. A copy of the laboratory certification shall be provided each time a new certification and/or renewal of the certification is obtained from ELAP.
- C.** Effluent samples shall be taken downstream of any additions to treatment works and prior to mixing with the receiving waters.
- D.** The Regional Water Board shall be notified in writing of any change in the sampling stations once established or in the methods for determining the quantities of pollutants in the individual waste streams.
- E.** Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. sections 136.3, 136.4, and 136.5 (revised August 19, 2014); or, where no methods are specified for a given pollutant, by methods approved by this Regional Water Board or the State Water Board.
- F.** For any analyses performed for which no procedure is specified in the U.S. EPA guidelines or in the MRP, the constituent or parameter analyzed and the method or procedure used must be specified in the monitoring report.
- G.** Each monitoring report must affirm in writing that “all analyses were conducted at a laboratory certified for such analyses by the State Water Board or approved by the Executive Officer and in accordance with current U.S. EPA guideline procedures or as specified in this MRP”.
- H.** The monitoring reports shall specify the analytical method used, the Method Detection Limit (MDL), and the Minimum Level (ML) for each pollutant. For the purpose of reporting compliance with numerical limitations, performance goals, and receiving water limitations, analytical data shall be reported by one of the following methods, as appropriate:
  - 1. An actual numerical value for sample results greater than or equal to the ML; or
  - 2. “Detected, but Not Quantified (DNQ)” if results are greater than or equal to the laboratory’s MDL but less than the ML; or,
  - 3. “Not-Detected (ND)” for sample results less than the laboratory’s MDL with the MDL indicated for the analytical method used.

Analytical data reported as “less than” for the purpose of reporting compliance with permit limitations shall be the same or lower than the permit limit(s) established for the given parameter.

Current MLs (Attachment H) are those published by the State Water Board in the Policy for the Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California, February 24, 2005.

- I. The MLs employed for effluent analyses to determine compliance with effluent limitations shall be lower than the effluent limitations established in this Order for a given parameter as per the sufficiently sensitive regulations at 40 C.F.R. section 122.44(i)(1)(iv). If the ML value is not below the effluent limitations, then the lowest ML value and its associated analytical method shall be selected for compliance purposes. At least once a year, the Discharger shall submit a list of the analytical methods employed for each test and associated laboratory QA/QC procedures.
- J. The MLs employed for effluent analyses not associated with determining compliance with effluent limitations in this Order shall be lower than the lowest applicable water quality objective, for a given parameter as per the sufficiently sensitive regulations at 40 C.F.R. section 122.44(i)(1)(iv). Water quality objectives for parameters may be found in Chapter 3 of the Basin Plan and the CTR (40 C.F.R. section 131.38). If the ML value is not below the water quality objective, then the lowest ML value and its associated analytical method shall be selected for compliance purposes. At least once a year, the Discharger shall submit a list of the analytical methods employed for each test, the associated laboratory QA/QC procedures, reporting levels (RLs), and method detection limits (MDLs).

The Regional Water Board, in consultation with the State Water Board Quality Assurance Program, shall establish a ML that is not contained in Attachment H to be included in the Discharger's permit in any of the following situations:

- 1. When the pollutant under consideration is not included in Attachment H;
  - 2. When the Discharger and Regional Water Board agree to include in the permit a test method that is more sensitive than that specified in 40 C.F.R. part 136 (revised August 19, 2014);
  - 3. When the Discharger agrees to use an ML that is lower than that listed in Attachment H;
  - 4. When the Discharger demonstrates that the calibration standard matrix is sufficiently different from that used to establish the ML in Attachment H, and proposes an appropriate ML for their matrix; or,
  - 5. When the Discharger uses a method whose quantification practices are not consistent with the definition of an ML. Examples of such methods are the U.S. EPA-approved method 1613 for dioxins and furans, method 1624 for volatile organic substances, and method 1625 for semi-volatile organic substances. In such cases, the Discharger, the Regional Water Board, and the State Water Board shall agree on a lowest quantifiable limit and that limit will substitute for the ML for reporting and compliance determination purposes.
- K. Water/wastewater samples must be analyzed within allowable holding time limits as specified in 40 C.F.R. section 136.3. All QA/QC items must be run on the same dates the samples were actually analyzed, and the results shall be reported in the Regional Water Board format, when it becomes available, and submitted with the laboratory reports. Proper chain of custody procedures must be followed, and a copy of the chain of custody shall be submitted with the report.
  - L. Field analyses with short sample holding times such as pH, total residual chlorine, and temperature, may be performed using properly calibrated and maintained portable instruments by trained personnel acting on the Discharger's behalf, using methods in

accordance with 40 C.F.R. part 136. All field instruments must be calibrated per manufacturer's instructions. A manual containing the standard operating procedures for all field analyses, including records of personnel proficiency training, instruments calibration and maintenance, and quality control procedures shall be maintained onsite, and shall be available for inspection by Regional Water Board staff. Information including instrument calibration, time of sample collection, time of analysis, name of analyst, quality assurance/quality control data, and measurement values shall be clearly documented during each field analysis and submitted to the Regional Water Board as part of the corresponding regular monitoring report.

- M.** All analyses shall be accompanied by the chain of custody, including but not limited to date and time of sampling, sample identification, and name of person who performed sampling, date of analysis, name of person who performed analysis, QA/QC data, method detection limits, analytical methods, copy of laboratory certification, and a statement under penalty of perjury executed by the person responsible for the laboratory.
- N.** The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments to insure accuracy of measurements, or shall insure that both equipment activities will be conducted.
- O.** The Discharger shall have, and implement, an acceptable written quality assurance (QA) plan for laboratory analyses. Unless otherwise specified in the analytical method, duplicate samples must be analyzed at a frequency of 5% (1 in 20 samples) with at least one if there are fewer than 20 samples in a batch. A batch is defined as a single analytical run encompassing no more than 24 hours from start to finish. A similar frequency shall be maintained for analyzing spiked samples.
- P.** When requested by the Regional Water Board or U.S. EPA, the Discharger will participate in the NPDES discharge monitoring report QA performance study. The Discharger must have a success rate equal to or greater than 80%.
- Q.** For parameters that both average monthly and daily maximum limits are specified and the monitoring frequency is less than four times a month, the following shall apply. If an analytical result is greater than the average monthly limit, the Discharger shall collect four additional samples at approximately equal intervals during the month, until compliance with the average monthly limit has been demonstrated. All five analytical results shall be reported in the monitoring report for that month, or 45 days after results for the additional samples were received, whichever is later. In the event of noncompliance with an average monthly effluent limitation, the sampling frequency for that constituent shall be increased to weekly and shall continue at this level until compliance with the average monthly effluent limitation has been demonstrated. The Discharger shall provide for the approval of the Executive Officer a program to ensure future compliance with the average monthly limit.
- R.** In the event wastes are transported to a different disposal site during the report period, the following shall be reported in the monitoring report:
  - 1. Types of wastes and quantity of each type;
  - 2. Name and address for each hauler of wastes (or method of transport if other than by hauling); and
  - 3. Location of the final point(s) of disposal for each type of waste.

If no wastes are transported off-site during the reporting period, a statement to that effect shall be submitted.

- S. Each monitoring report shall state whether or not there was any change in the discharge as described in the Order during the reporting period.

**II. MONITORING LOCATIONS**

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

**Table E-1. Monitoring Station Locations**

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
001	EFF-001	An effluent sampling location shall be established where representative samples of Discharge Point 001 can be obtained prior to discharge into the storm drain that conveys to the Ballona Creek. (Latitude 34.0598°, Longitude -118.3013°)
--	RSW-001	Flow data for Ballona Creek is currently monitored between Sawtelle Boulevard and Sepulveda Boulevard by Los Angeles County Department of Public Works at Stream Gauge No. F38C-R. The Discharger shall report the maximum daily flow values from data collected by Los Angeles County at Stream Gauge No. F38C-R.
--	RSW-002	A location downstream of the storm drain discharge location in Ballona Creek, outside the influence of the effluent discharge .

The North latitude and West longitude information in Table E-1 are approximate for administrative purposes.

**III. INFLUENT MONITORING REQUIREMENTS – NOT APPLICABLE**

**IV. EFFLUENT MONITORING REQUIREMENTS**

**A. Monitoring Locations EFF-001**

- The Discharger shall monitor groundwater seepage and storm water discharges from Discharge Point 001 at Monitoring Location EFF-001 as follows.

**Table E-2. Effluent Monitoring at EFF-001**

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Total Waste Flow <sup>1</sup>	Gallons	Meter	Continuous	--
Daily Average Flow <sup>1</sup>	MGD	Calculated	--	--
<b>Conventional Pollutants</b>				
Biochemical Oxygen Demand (BOD) (5-day @ 20°C) <sup>2</sup>	mg/L	Grab	1/Quarter <sup>12</sup>	3
Oil and Grease <sup>2</sup>	mg/L	Grab	1/Quarter <sup>12</sup>	3
pH	standard units	Grab	1/Quarter <sup>12</sup>	3
Total Suspended Solids (TSS) <sup>2,8</sup>	mg/L	Grab	1/Quarter <sup>12</sup>	3
<b>Non-Conventional Pollutants</b>				
Ammonia Nitrogen, Total (as N) <sup>2</sup>	mg/L	Grab	2/Year <sup>13</sup>	3

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Chronic Toxicity	Pass or Fail and % Effect (for TST Statistical Approach)	Grab	1/Year	3, 4
Fecal Coliform <sup>10</sup>	MPN/100 ml	Grab	1/Year	3,11
Hardness, Total (as CaCO <sub>3</sub> )	mg/L	Grab	1/Year	3
Nitrite plus Nitrate (as N)	mg/L	Grab	1/Year	3
Settleable Solids	mL/L	Grab	1/Quarter <sup>12</sup>	3
Temperature	°F	Grab	1/Quarter <sup>12</sup>	3
Turbidity	NTU	Grab	1/Quarter <sup>12</sup>	3
<b>Priority Pollutants</b>				
Cadmium, Total Recoverable <sup>2,8</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
Copper, Total Recoverable <sup>2,8</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
Lead, Total Recoverable <sup>2,8</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
Nickel, Total Recoverable <sup>2</sup>	µg/L	Grab	1/Year	3
Selenium, Total Recoverable <sup>2</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
Silver, Total Recoverable <sup>2,8</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
Zinc, Total Recoverable <sup>2,8</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
4,4'-DDT <sup>2,8,9</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
4,4'-DDE <sup>2,8,9</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
4,4'-DDD <sup>2,8,9</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
Chlordane <sup>2,8,9</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
PCBs (sum) <sup>2,5,8,9</sup>	µg/L	Grab	1/Quarter <sup>12</sup>	3
TCDD Equivalents <sup>6</sup>	µg/L	Grab	1/Year	3
Phenol, Total	µg/L	Grab	1/Year	3
Remaining Priority Pollutants <sup>7</sup>	µg/L	Grab	1/Year	3

<sup>1</sup> Total waste flow will indicate the volume of water (in gallons) discharged. The Discharger shall also calculate the daily average flow for each discharge event by dividing the total discharge flow by the number of days over which the discharge occurred; this shall represent the daily average flow (MGD). Periods of no flow shall also be reported.

<sup>2</sup> The mass emission (lbs/day) for the discharge shall be calculated and reported using the concentration and the actual flow rate measured at the time of discharge, using the formula:

$$M = 8.34 \times C_e \times Q$$

where: M = mass discharge for a pollutant, lbs/day  
 C<sub>e</sub> = Reported concentration for a pollutant in mg/L  
 Q = actual discharge flow rate (MGD).

<sup>3</sup> Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. part 136; for priority pollutants, the methods must meet the lowest MLs specified in Attachment 4 of the SIP, provided in

Attachment H. Where no methods are specified for a given pollutant, the methods must be approved by the Regional Water Board or the State Water Board. If more than one analytical test method is listed for a given parameter, the Discharger must select from the listed methods and corresponding ML necessary to demonstrate compliance with applicable effluent limitations.

4 Whole effluent toxicity monitoring shall be conducted as outlined in section V. Please refer to section V.A.7 of this MRP for the accelerated monitoring schedule. The median monthly summary result shall be reported as "Pass" or "Fail". The maximum daily single result shall be reported as "Pass" or "Fail" and "% Effect". When there is a discharge more than one day in a calendar month period, up to three independent toxicity tests are required when one toxicity test results in "Fail".

5 Total PCBs (polychlorinated biphenyls) shall mean the sum of chlorinated biphenyls whose analytical characteristics resemble those of Aroclor-1016, Aroclor-1221, Aroclor-1232, Aroclor-1242, Aroclor-1248, Aroclor-1254, and Aroclor-1260.

6 TCDD equivalents shall be calculated using the following formula, where the MLs and the toxicity equivalency factors (TEFs) are as listed in the Table below. The Discharger shall report all measured values of individual congeners, including data qualifiers. When calculating TCDD equivalents, the Discharger shall set congener concentrations below the MLs to zero. U.S. EPA method 1613 may be used to analyze dioxin and furan congeners.

Dioxin-TEQ (TCDD equivalents) =  $\Sigma(Cx \times TEFx)$   
 where: Cx = concentration of dioxin or furan congener x  
 TEFx = TEF for congener x

Congeners	Minimum Levels (pg/L)	Toxicity Equivalence Factor (TEF)
2,3,7,8 - tetra CDD	10	1.0
1,2,3,7,8 - penta CDD	50	1.0
1,2,3,4,7,8 - hexa CDD	50	0.1
1,2,3,6,7,8 - hexa CDD	50	0.1
1,2,3,7,8,9 - hexa CDD	50	0.1
1,2,3,4,6,7,8 - hepta CDD	50	0.01
Octa CDD	100	0.0001
2,3,7,8 - tetra CDF	10	0.1
1,2,3,7,8 - penta CDF	50	0.05
2,3,4,7,8 - penta CDF	50	0.5
1,2,3,4,7,8 - hexa CDF	50	0.1
1,2,3,6,7,8 - hexa CDF	50	0.1
1,2,3,7,8,9 - hexa CDF	50	0.1
2,3,4,6,7,8 - hexa CDF	50	0.1
1,2,3,4,6,7,8 - hepta CDFs	50	0.01
1,2,3,4,7,8,9 - hepta CDFs	50	0.01
Octa CDF	100	0.0001

7 Priority Pollutants as defined by the California Toxics Rule (CTR) and included in Attachment I to this Order.  
 8 During each reporting period, if effluent monitoring results exceed both a TSS effluent limit and a CTR- or TMDL-based effluent limit or performance goal for cadmium, copper, lead, silver, zinc, chlordane, DDTs (4,4'-DDT, 4,4'-DDE, and 4,4'-DDD), or total PCBs, then the Discharger has not demonstrated attainment with the sediment allocations stipulated by the Ballona Creek Toxic Pollutants TMDL, and implementation of the effluent sediment monitoring program is required for that priority pollutant. Sediment monitoring of the effluent shall begin during the first discharge event following the effluent exceedance.

9 Samples analyzed must be unfiltered samples.

10 For each annual monitoring event, at least five samples equally spaced over a 30-day period are required to calculate the geometric mean.

11 Detection methods used for coliforms (fecal) shall be those presented in Table 1A of 40 C.F.R. Part 136, unless alternate methods have been approved by U.S. EPA pursuant to Part 136 or improved methods have been determined by the Executive Officer and/or U.S. EPA.

12 Sampling shall be conducted during the first discharge event for each quarter (October 1- December 31, January 1-March 31, April 1-June 30, July 1- September 30).

<sup>13</sup> Semiannual sampling shall be conducted during the first discharge event of the half year (January 1 – June30, July 1 – December 31).

**2. Effluent Sediment Monitoring**

Effluent sediment monitoring is only required during years in which exceedance occurs as described in Footnote 1 to the following table. If effluent sediment monitoring is not triggered by an exceedance, effluent sediment monitoring must be conducted as described below at least once during the permit term.

The effluent sediment sampling shall be conducted according to methods or metrics described in 40 C.F.R. Part 136, *Guidelines Establishing Test Procedures for the Analysis of Pollutants Under the Clean Water Act*, and the State Water Board Sediment Quality Plan. The Discharger must collect sufficient effluent sample to provide an adequate amount of effluent sediments (suspended solids) for sediment analyses. The Discharger shall monitor sediment in discharges from Discharge Point 001 at Monitoring Location EFF-001 as follows.

**Table E-3. Effluent Sediment Monitoring at EFF-001**

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
Cadmium, Total Recoverable	mg/kg	Grab	1/Year <sup>1</sup>	<sup>2</sup>
Copper, Total Recoverable	mg/kg	Grab	1/Year <sup>1</sup>	<sup>2</sup>
Lead, Total Recoverable	mg/kg	Grab	1/Year <sup>1</sup>	<sup>2</sup>
Silver, Total Recoverable	mg/kg	Grab	1/Year <sup>1</sup>	<sup>2</sup>
Zinc, Total Recoverable	mg/kg	Grab	1/Year <sup>1</sup>	<sup>2</sup>
Chlordane	µg/kg	Grab	1/Year <sup>1</sup>	<sup>2</sup>
DDTs <sup>3</sup>	µg/kg	Grab	1/Year <sup>1</sup>	<sup>2</sup>
Total PCBs <sup>4</sup>	µg/kg	Grab	1/Year <sup>1</sup>	<sup>2</sup>

<sup>1</sup> Monitoring is only required during years in which a discharge occurs, and when sediment monitoring is triggered as specified in Footnote 7 to Table 4 of this Order. If monitoring is not triggered because of an exceedance, sediment monitoring must occur at least once during the term of this Order, if a discharge from the Facility occurs.

<sup>2</sup> Pollutants shall be analyzed in accordance with U.S.EPA or ASTM methodologies where such methods exist. Where no U.S.EPA or ASTM methods exist, the State Board or Regional Water Board shall approve the use of other methods. Analytical tests shall be conducted by laboratories certified by the State Water Board in accordance with Water Code section 13176.

<sup>3</sup> The State Water Resources Control Board *Water Quality Control Plan for Enclosed Bays and Estuaries—Part 1 Sediment Quality*. August 25, 2009 (Sediment Quality Plan), listed chemical analytes needed to characterize sediment contamination exposure and effect. According to Attachment A of the Sediment Quality Plan, DDTs shall mean the sum of o,p'-DDE, o,p'-DDD, o,p'-DDT, p,p'-DDD, p,p'-DDE. and p,p'-DDT.

<sup>4</sup> According to Attachment A of the Sediment Quality Plan, total PCBs shall mean the sum of the following PCB congeners: 2,4-dichlorobiphenyl, 2,2',5-trichloro biphenyl, 2,4,4'-trichlorobiphenyl, 2,2',3,5'-tetrachlorobiphenyl, 2,2',5,5'-tetrachlorobiphenyl, 2,3',4,4'-tetrachlorobiphenyl, 2,2',4,5,5'-pentachlorobiphenyl, 2,3,3',4,4'-pentachlorobiphenyl, 2,3',4,4',5-pentachlorobiphenyl, 2,2',3,3',4,4'-hexachlorobiphenyl, 2,2',4,4',5,5'-hexachlorobiphenyl, 2,2',3,3',4,4',5-heptachlorobiphenyl, 2,2',3,4,4',5,5'-heptachlorobiphenyl, 2,2',3,4',5,5',6-heptachlorobiphenyl, 2,2',3,3',4,4',5,6-octachlorobiphenyl, 2,2',3,3',4,4',5,5',6-nonachlorobiphenyl, decachlorobiphenyl.

## V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

### A. Chronic Toxicity Testing

#### 1. Discharge In-stream Waste Concentration (IWC) for Chronic Toxicity

The chronic toxicity IWC for this discharge is **100 percent** effluent.

#### 2. Sample Volume and Holding Time

The total sample volume shall be determined by the specific toxicity test method used. Sufficient sample volume shall be collected to perform the required toxicity test and Toxicity Identification Evaluation (TIE) studies. All toxicity tests shall be conducted as soon as possible following sample collection. No more than 36 hours shall elapse before the conclusion of sample collection and test initiation.

#### 3. Chronic Freshwater Species and Test Methods

If effluent samples are collected from outfalls discharging to receiving waters with salinity <1 ppt, the Discharger shall conduct the following chronic toxicity tests on effluent samples—at the in-stream waste concentration for the discharge—in accordance with species and test methods in *Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms* (EPA/821/R-02/013, 2002). In no case shall these species be substituted with another test species unless written authorization from the Regional Board Executive Officer is received.

- a. A static renewal toxicity test with the fathead minnow, *Pimephales promelas* (Larval Survival and Growth Test Method 1000.0).
- b. A static renewal toxicity test with the daphnid, *Ceriodaphnia dubia* (Survival and Reproduction Test Method 1002.0).
- c. A static renewal toxicity test with the green alga, *Selenastrum capricornutum* (also named *Raphidocelis subcapitata*) (Growth Test Method 1003.0).

#### 4. Species Sensitivity Screening

Species sensitivity screening shall be conducted monthly for a period of three months for this Order's first required sample collection event. During each month, the Discharger shall collect a single effluent sample and concurrently conduct three toxicity tests, using the fish, an invertebrate, and the alga species as referenced in this section. The samples shall also be analyzed for the parameters required for the discharge. The species that exhibits the highest "Percent Effect" at the discharge IWC during species sensitivity screening shall be used for subsequent routine monitoring during the permit cycle.

Rescreening is required at least once per five (5) years. The Discharger shall rescreen with the three species listed above and continue to monitor with the most sensitive species. If the first suite of rescreening tests demonstrates that the same species is the most sensitive, then the rescreening does not need to include more than one suit of tests. If a different species is the most sensitive or if there is ambiguity, then the Discharger shall proceed with suites of screening tests using enough collected effluent for a minimum of three, but not to exceed five suites.

#### 5. Quality Assurance and Additional Requirements

Quality assurance measures, instructions, and other recommendations and requirements are found in the test methods manuals previous referenced. Additional requirements are specified below.

- a. The discharge is subject to a determination of “Pass” or “Fail” and “Percent Effect” from a single-effluent concentration chronic toxicity test at the discharge IWC using the Test of Significant Toxicity (TST) statistical approach described in *National Pollutant Discharge Elimination System Test of Significant Toxicity/Implementation Document* (EPA 833-R-10-003, 2010), Appendix A, Figure A-1, and Table A-1. The null hypothesis ( $H_0$ ) for the TST statistical approach is: Mean discharge IWC response  $\leq$  (0.75 x Mean control response). A test result that does not reject this null hypothesis is reported as “Fail”. The relative “Percent Effect” at the discharge IWC is defined and reported as:  $((\text{Mean control response} - \text{Mean discharge IWC response}) \div \text{Mean control response}) \times 100\%$ .
- b. The Median Monthly Effluent Limitation (MMEL) for chronic toxicity only applies when there is a discharge on more than one day in a calendar month period. During such calendar months, exactly three independent toxicity tests are required when one toxicity test results in “Fail”.
- c. Dilution water and control water, including brine controls, shall be laboratory water prepared and used as specified in the test methods manual. If dilution water and control water is different from test organism culture water, then a second control using culture water shall also be used.
- d. Monthly reference toxicant testing is sufficient. All reference toxicant test results should be reviewed and reported.
- e. The Discharger shall perform toxicity tests on final effluent samples. Chlorine and ammonia shall not be removed from the effluent sample prior to toxicity testing, unless explicitly authorized under this section of the Monitoring and Reporting Program and the rationale is explained in the Fact Sheet (Attachment F).

#### **6. Preparation of Initial Investigation TRE Work Plan**

The Discharger shall prepare and submit a generic Initial Investigation TRE Work Plan within 90 days of the permit effective date to be ready to respond to toxicity events. The Discharger shall review and update this work plan as necessary so it remains current and applicable to the discharge. At a minimum, the work plan shall include:

- a. A description of the investigation and evaluation techniques that would be used to identify potential causes and source of toxicity, effluent variability, and treatment system efficiency.
- b. A description of methods for maximizing in-house treatment system efficiency, good housekeeping practices, and a list of all chemicals used in operations at the facility.
- c. If a Toxicity Identification Evaluation (TIE) is necessary, an indication of who would conduct the TIEs (i.e., an in-house expert or outside contractor).

#### **7. Accelerated Monitoring Schedule for Median Monthly Summary Result: “Fail”; and Accelerated Monitoring Schedule for Maximum Daily Single Result: “Fail and % Effect $\geq$ 50”.**

The summary result shall be used when there is discharge more than one day in a calendar month. The single result shall be used when there is discharge of only one day in a calendar month.

Within 24 hours of the time the Discharger becomes aware of this result, the Discharger shall implement an accelerated monitoring schedule consisting of four, five-concentration toxicity tests (including the discharge IWC), conducted at approximately two week

intervals, over an eight week period. If each of the accelerated toxicity tests results in "Pass", the Discharger shall return to routine monitoring for the next monitoring period. If one of the accelerated toxicity tests results in "Fail", the Discharger shall immediately implement the Toxicity Reduction Evaluation (TRE) Process conditions set forth below.

## 8. Toxicity Identification Evaluation and Toxicity Reduction Evaluation Process

- a. **Toxicity Identification Evaluation (TIE).** A toxicity test sample is immediately subject to TIE procedures to identify the toxic chemical(s), if a chronic toxicity test shows "Fail and % Effect value  $\geq 50$ ". The Discharger shall initiate a TIE using, as guidance, EPA manuals: *Methods for Aquatic Toxicity Identification Evaluations: Phase I Toxicity Characterization Procedures* (EPA/600/6-91/003, 1991); *Methods for Aquatic Toxicity Identification Evaluations, Phase II Toxicity Identification Procedures for Samples Exhibiting Acute and Chronic Toxicity* (EPA/600/R-92/080, 1993); *Methods for Aquatic Toxicity Identification Evaluations, Phase III Toxicity Confirmation Procedures for Samples Exhibiting Acute and Chronic Toxicity* (EPA/600/R-92/081, 1993); and *Marine Toxicity Identification Evaluation (TIE): Phase I Guidance Document* (EPA/600/R-96-054, 1996). The TIE should be conducted on the species demonstrating the most sensitive toxicity response.
- b. **Toxicity Reduction Evaluation (TRE).** When a toxicant or class of toxicants is identified, a TRE shall be performed for that toxicant. The TRE shall include all reasonable steps to identify the source(s) of toxicity and discuss appropriate BMPs to eliminate the causes of toxicity. No later than 30 days after the source of toxicity and appropriate BMPs and/or treatment are identified, the Discharger shall submit a TRE Corrective Action Plan to the Executive Officer for approval. At minimum, the plan shall include:
  - i. The potential sources of pollutant(s) causing toxicity.
  - ii. Recommended BMPs and/or treatment to reduce the pollutant(s) causing toxicity.
  - iii. Follow-up monitoring to demonstrate that toxicity has been removed.
  - iv. Actions the Discharger will take to mitigate the effects of the discharge and prevent the recurrence of toxicity.
  - v. A schedule for these actions, progress reports, and the final report.
- c. Many recommended TRE elements parallel required or recommended efforts for source control, pollution prevention, and storm water control programs. TRE efforts should be coordinated with such efforts. As toxic substances are identified or characterized, the Discharger shall continue the TRE by determining the sources and evaluating alternative strategies for reducing or eliminating the substances from the discharge. All reasonable steps shall be taken to reduce toxicity to levels consistent with toxicity evaluation parameters.
- d. The Discharger shall conduct routine effluent monitoring for the duration of the TIE/TRE process.
- e. The Regional Water Board recognizes that toxicity may be episodic and identification of causes and reduction of sources of toxicity may not be successful in all cases. The TRE may be ended at any stage if monitoring finds there is no longer toxicity.

## 9. Reporting

The Self-Monitoring Report (SMR) shall include a full laboratory report for each toxicity test. This report shall be prepared using the format and content of the test methods manual chapter titled *Report Preparation*, including:

- a. The toxicity test results for the TST statistical approach, reported as “Pass” or “Fail” and “Percent Effect” at the chronic toxicity IWC for the discharge.
- b. Water quality measurements for each toxicity test (e.g., pH, dissolved oxygen, temperature, conductivity, hardness, salinity, chlorine, ammonia).
- c. TRE/TIE results. The Regional Water Board Executive Officer shall be notified no later than 30 days from completion of each aspect of TRE/TIE analyses.
- d. Statistical program (e.g., TST calculator, CETIS, etc.) output results for each toxicity test.

### B. Ammonia Removal

1. Except with prior approval from the Executive Officer of the Regional Water Board, ammonia shall not be removed from bioassay samples. The Discharger must demonstrate the effluent toxicity is caused by ammonia because of increasing test pH when conducting the toxicity test. It is important to distinguish the potential toxic effects of ammonia from other pH sensitive chemicals, such as certain heavy metals, sulfide, and cyanide. The following may be steps to demonstrate that the toxicity is caused by ammonia and not other toxicants before the Executive Officer would allow for control of pH in the test.
  - a. There is consistent toxicity in the effluent and the maximum pH in the toxicity test is in the range to cause toxicity due to increased pH.
  - b. Chronic ammonia concentrations in the effluent are greater than 4 mg/L total ammonia.
  - c. Conduct graduated pH tests as specified in the toxicity identification evaluation methods. For example, mortality should be higher at pH 8 and lower at pH 6.
  - d. Treat the effluent with a zeolite column to remove ammonia. Mortality in the zeolite treated effluent should be lower than the non-zeolite treated effluent. Then add ammonia back to the zeolite-treated samples to confirm toxicity due to ammonia.
2. When it has been demonstrated that toxicity is due to ammonia because of increasing test pH, pH may be controlled using appropriate procedures which do not significantly alter the nature of the effluent, after submitting a written request to the Regional Water Board, and receiving written permission expressing approval from the Executive Officer of the Regional Water Board.

### C. Chlorine Removal

Except with prior approval from the Executive Office of the Regional Water Board, chlorine shall not be removed from bioassay samples.

## VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE

## VII. RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE

**VIII. RECEIVING WATER MONITORING REQUIREMENTS**

**A. Monitoring Location RSW-001**

1. The Discharger must provide maximum daily flow data for Ballona Creek with the quarterly monitoring reports. Flow data for Ballona Creek is currently monitored between Sawtelle Boulevard and Sepulveda Boulevard by the Los Angeles County Department of Public Works at Stream Gauge No. F38C-R. The stream flow data may be obtained by contacting the Los Angeles County Department of Public Works at (626) 458-5100. This information is necessary to determine the wet weather and dry weather condition of the creek, as defined in the Ballona Creek Metals TMDL. If the gauging station is not operational, an estimated maximum daily flow may be submitted.

**B. Monitoring Location RSW-002**

1. The Discharger shall monitor Ballona Creek at RSW-002 as follows:

**Table E-4. Receiving Water Monitoring Requirements – Monitoring Location RSW-002**

Parameter	Units	Sample Type	Minimum Sampling Frequency	Required Analytical Test Method
<b>Conventional Pollutants</b>				
pH <sup>1</sup>	standard units	Grab	1/Permit Term	<sup>2</sup>
<b>Non-Conventional Pollutants</b>				
Ammonia Nitrogen, Total (as N) <sup>1</sup>	mg/L	Grab	1/Permit Term	<sup>2</sup>
Temperature <sup>1</sup>	°F	Grab	1/Permit Term	<sup>2</sup>
Dissolved Oxygen <sup>1</sup>	mg/L	Grab	1/Permit Term	<sup>2</sup>
Hardness (as mg/L CaCO <sub>3</sub> ) <sup>1</sup>	mg/L	Grab	1/Permit Term	<sup>2</sup>
<b>Priority Pollutants</b>				
Priority Pollutants <sup>3</sup>	µg/L	Grab	1/Permit Term	<sup>2</sup>

<sup>1</sup> Receiving water pH, ammonia, temperature, dissolved oxygen, and hardness must be analyzed at the same time the samples are collected for priority pollutant analysis.

<sup>2</sup> Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. part 136, for priority pollutants the methods must meet the lowest MLs specified in Attachment H of this Order; where no methods are specified for a given pollutant, by method approved by the Regional Water Board or the State Water Board. If more than one analytical method is listed for a given parameter, the Discharger must select from the listed methods and corresponding ML.

<sup>3</sup> Priority pollutants as defined by the CTR, included in Attachment I of this Order.

**IX. OTHER MONITORING REQUIREMENTS**

**A. Storm Water Monitoring**

**1. Visual Observation**

The Discharger shall make visual observations of all storm water discharge on at least one storm event per quarter that produces a significant storm water discharge to observe the presence of floating and suspended materials, oil and grease, discoloration, turbidity, and odor. A “significant storm water discharge” is a continuous discharge of storm water for a minimum of one hour, or the intermittent discharge of storm water for a minimum of 3 hours in a 12-hour period.

## **X. REPORTING REQUIREMENTS**

### **A. General Monitoring and Reporting Requirements**

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. If there is no discharge during any reporting period, the report shall so state.
3. If the Discharger monitors (other than for process/operational control, startup, research, or equipment testing) any influent, effluent, or receiving water constituent more frequently than required by this Order using approved analytical methods, the results of those analyses shall be included in the monitoring report. These results shall be reflected in the calculation of the average (or median) used in demonstrating compliance with this Order/Permit.
4. Each monitoring report shall contain a separate section titled "Summary of Non-Compliance" which discusses the compliance record and corrective actions taken or planned that may be needed to bring the discharge into full compliance with waste discharge requirements. This section shall clearly list all non-compliance with waste discharge requirements, as well as all excursions of effluent limitations.
5. The Discharger shall inform the Regional Water Board well in advance of any proposed construction activity that could potentially affect compliance with applicable requirements.
6. The Discharger shall report the results of acute and chronic toxicity testing, TRE and TIE as required in the Attachment E, Monitoring and Reporting, section V.

### **B. Self-Monitoring Reports (SMRs)**

1. The Discharger shall electronically submit SMRs using the State Water Board's California Integrated Water Quality System (CIWQS) Program website (<http://www.waterboards.ca.gov/ciwqs/index.html>). The CIWQS website will provide additional information for SMR submittal in the event there will be a planned service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through IX. The Discharger shall submit quarterly SMRs including the results of all required monitoring using U.S. EPA-approved test methods or other test methods specified in this Order. SMRs are to include all new monitoring results obtained since the last SMR was submitted. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.
3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

**Table E-5. Monitoring Periods and Reporting Schedule**

Sampling Frequency	Monitoring Period Begins On...	Monitoring Period	SMR Due Date
Continuous	April 1, 2016	All	May 1 August 1 November 1 February 1
1/Day	April 1, 2016	January 1 – March 31 April 1 – June 30 July 1 – September 30 October 1 – December 31	May 1 August 1 November 1 February 1
1/Quarter	April 1, 2016	January 1 – March 31 April 1 – June 30 July 1 – September 30 October 1 – December 31	May 1 August 1 November 1 February 1
2/Year	April 1, 2016	January 1 – June 30 July 1 – December 31	August 1 February 1
1/Year	April 1, 2016	January 1 through December 31	February 1
1/Permit Term	April 1, 2016	All	February 1

**4. Reporting Protocols.** The Discharger shall report with each sample result the applicable Reporting Level (RL) and the current Method Detection Limit (MDL), as determined by the procedure in 40 C.F.R. part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory’s MDL, shall be reported as “Detected, but Not Quantified,” or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ. The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy ( $\pm$  a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory’s MDL shall be reported as “Not Detected,” or ND.
- d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.

**5. Compliance Determination.** Compliance with effluent limitations for priority pollutants shall be determined using sample reporting protocols defined above and Attachment A of this Order. For purposes of reporting and administrative enforcement by the Regional Water Board and State Water Board, the Discharger shall be deemed out of compliance

with effluent limitations if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reporting level (RL).

6. **Multiple Sample Data.** When determining compliance with an AMEL or MDEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of “Detected, but Not Quantified” (DNQ) or “Not Detected” (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
  - a. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
  - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
7. The Discharger shall submit SMRs in accordance with the following requirements:
  - a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data is required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
  - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the WDRs; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.

### C. Discharge Monitoring Reports (DMRs)

As of the effective date of this Order, if the Discharger operates a “minor” facility as designated on page 1 of this Order, electronic submittal of Discharge Monitoring Reports (DMRs) is not required. However, at any time during the term of this Order, the State Water Board or Regional Water Board may notify and require the Discharger to electronically submit DMRs.

### D. Other Reports

1. The Discharger shall report the results of any TRE/TIE required by the Special Provisions.
2. **Within 90 days** of the effective date of this permit, the Discharger is required to submit the following to the Regional Water Board:
  - a. Initial Investigation TRE workplan
  - b. SWPPP

c. Updated BMPP

The SWPPP and BMPP status shall be reviewed at a minimum once per year and updated as needed to ensure all actual or potential sources of pollutants in wastewater and storm water discharged from the Facility are addressed. All changes or revisions to the SWPPP and BMPP shall be submitted to the Regional Water Board within 30 days of revisions.

## ATTACHMENT F – FACT SHEET

### CONTENTS

I. Permit Information.....	F-3
II. Facility Description.....	F-4
A. Description of Wastewater and Biosolids Treatment and Controls .....	F-5
B. Discharge Points and Receiving Waters .....	F-5
C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data .....	F-6
D. Compliance Summary.....	F-8
E. Planned Changes .....	F-10
III. Applicable Plans, Policies, and Regulations.....	F-10
A. Legal Authorities .....	F-10
B. California Environmental Quality Act (CEQA).....	F-10
C. State and Federal Laws, Regulations, Policies, and Plans.....	F-10
D. Impaired Water Bodies on CWA 303(d) List.....	F-13
E. Other Plans, Policies and Regulations – Not Applicable .....	F-15
IV. Rationale For Effluent Limitations and Discharge Specifications .....	F-15
A. Discharge Prohibitions .....	F-16
B. Technology-Based Effluent Limitations .....	F-16
1. Scope and Authority .....	F-16
2. Applicable Technology-Based Effluent Limitations.....	F-17
C. Water Quality-Based Effluent Limitations (WQBELs) .....	F-18
1. Scope and Authority .....	F-18
2. Applicable Beneficial Uses and Water Quality Criteria and Objectives.....	F-19
3. Determining the Need for WQBELs .....	F-22
4. WQBEL Calculations .....	F-24
5. WQBELs Based on Basin Plan Objectives .....	F-28
6. Whole Effluent Toxicity (WET).....	F-30
7. Final WQBELs.....	F-31
D. Final Effluent Limitation Considerations .....	F-32
1. Anti-Backsliding Requirements .....	F-32
2. Antidegradation Policies .....	F-33
3. Mass-based Effluent Limitations .....	F-34
4. Stringency of Requirements for Individual Pollutants .....	F-34
5. Summary of Final Effluent Limitations.....	F-35
E. Interim Effluent Limitations – Not Applicable .....	F-37
F. Land Discharge Specifications – Not Applicable .....	F-37
G. Recycling Specifications – Not Applicable.....	F-37
V. Rationale for Receiving Water Limitations.....	F-37
A. Surface Water.....	F-37
B. Groundwater – Not Applicable .....	F-37
VI. Rationale for Provisions .....	F-38
A. Standard Provisions .....	F-38
B. Special Provisions.....	F-38
1. Reopener Provisions .....	F-38
2. Special Studies and Additional Monitoring Requirements .....	F-38
3. Best Management Practices and Pollution Prevention.....	F-38
4. Construction, Operation, and Maintenance Specifications .....	F-39
5. Other Special Provisions – Not Applicable.....	F-39

6. Compliance Schedules – Not Applicable ..... F-39

VII. Rationale for Monitoring and Reporting Requirements ..... F-39

    A. Influent Monitoring – Not Applicable ..... F-39

    B. Effluent Monitoring ..... F-39

    C. Effluent Sediment Monitoring ..... F-40

    D. Whole Effluent Toxicity Testing Requirements ..... F-40

    E. Receiving Water Monitoring ..... F-40

        1. Surface Water ..... F-40

        2. Groundwater – Not Applicable ..... F-41

    F. Other Monitoring Requirements ..... F-41

VIII. Public Participation ..... F-41

    A. Notification of Interested Parties ..... F-41

    B. Written Comments ..... F-41

    C. Public Hearing ..... F-41

    D. Reconsideration of Waste Discharge Requirements ..... F-42

    E. Information and Copying ..... F-42

    F. Register of Interested Persons ..... F-42

    G. Additional Information ..... F-42

**TABLES**

Table F-1. Facility Information ..... F-3

Table F-2. Historic Effluent Limitations and Monitoring Data ..... F-6

Table F-3. Summary of Compliance History ..... F-8

Table F-4. Basin Plan Beneficial Uses ..... F-11

Table F-5. Summary of Technology-based Effluent Limitations – Discharge Point 001 ..... F-18

Table F-6. Applicable Water Quality Criteria ..... F-19

Table F-7. Metals WLAs Assigned to Minor NPDES Permittees Discharging to Ballona Creek ..... F-20

Table F-8. Toxic Pollutants WLAs Assigned to Minor NPDES Permits ..... F-21

Table F-9. Applicable Fecal Coliform Bacteria Water Quality Objectives ..... F-22

Table F-10. Summary Reasonable Potential Analysis–Discharge Point 001 ..... F-23

Table F-11. Summary of Water Quality-based Effluent Limitations – EFF-001 ..... F-31

Table F-12. Summary of Final Effluent Limitations at Discharge Point 001 ..... F-35

Table F-13. Summary of Final Effluent Sediment Limitations at Discharge Point 001<sup>4</sup> ..... F-37

**ATTACHMENT F – FACT SHEET**

As described in section II.B of this Order, the Regional Water Board incorporates this Fact Sheet as findings of the Regional Water Board supporting the issuance of this Order. This Fact Sheet includes the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

This Order has been prepared under a standardized format to accommodate a broad range of discharge requirements for Dischargers in California. Only those sections or subsections of this Order that are specifically identified as “not applicable” have been determined not to apply to this Discharger. Sections or subsections of this Order not specifically identified as “not applicable” are fully applicable to this Discharger.

**I. PERMIT INFORMATION**

The following table summarizes administrative information related to the Facility.

**Table F-1. Facility Information**

<b>WDID</b>	4B191019001
<b>Discharger</b>	Donald T. Sterling Corporation
<b>Name of Facility</b>	Sterling Ambassador Towers
<b>Facility Address</b>	691 South Irolo Street
	Los Angeles, CA 90005
	Los Angeles County
<b>Facility Contact, Title and Phone</b>	Ms. Philomena Wong, Director – Property Management, (310) 278-8000
<b>Authorized Person to Sign and Submit Reports</b>	Mr. Dean Segal, Chief Engineer, (213) 385-0191
<b>Mailing Address</b>	9441 Wilshire Blvd., Penthouse Suite, Beverly Hills, CA 90212
<b>Billing Address</b>	Same as mailing address
<b>Type of Facility</b>	Apartment Building
<b>Major or Minor Facility</b>	Minor
<b>Threat to Water Quality</b>	3
<b>Complexity</b>	B
<b>Pretreatment Program</b>	N/A
<b>Recycling Requirements</b>	N/A
<b>Facility Permitted Flow</b>	0.015 million gallons per day (MGD)
<b>Facility Design Flow</b>	0.015 MGD
<b>Watershed</b>	Ballona Creek Watershed
<b>Receiving Water</b>	Ballona Creek
<b>Receiving Water Type</b>	Inland Surface Water

- A.** Donald T. Sterling Corporation (hereinafter Discharger) is the owner and operator of Sterling Ambassador Towers (hereinafter Facility), an apartment building.  
  
For the purposes of this Order, references to the “discharger” or “permittee” in applicable federal and state laws, regulations, plans, or policy are held to be equivalent to references to the Discharger herein.
- B.** The Facility discharges groundwater seepage, irrigation drainage from planter boxes, pool deck wash water, and storm water runoff to Ballona Creek, a water of the United States. The Discharger is currently regulated by Order No. R4-2010-0180 as amended by Order No. R4-

2010-0180-A01, which was adopted on October 7, 2010, and November 8, 2012, respectively, and expired on September 7, 2015. The Discharger submitted a letter on February 27, 2012, to request a revision to Order No. R4-2010-0180 of the permitted discharge flow rate, from 171 gallons per day (gpd) to 0.015 million gallons per day. The flow rate adjustment was based on the maximum flow recorded in January 2012 by a flow meter that was installed in July 2010. Therefore, based on new information submitted by the Discharger, Order No. R4-2010-0180 was amended by Order No. R4-2010-0180-A01 to change the discharge flow rate of the Facility; applicable changes to the mass effluent limitations were also incorporated into the amended Order No. R4-2010-0180-A01.

The discharge was also regulated by Time Schedule Order (TSO) No. R4-2012-0173, which was issued on November 8, 2012, and expired on September 7, 2015. The TSO requires the Discharger to investigate and implement any required upgrades to the Facility to achieve full compliance with the final effluent limitations for selenium prescribed in Order No. R4-2010-0180-A01. The interim average monthly effluent limitation for selenium included in the TSO was effective from December 10, 2012, through September 7, 2015.

- C.** Attachment B provides a map of the area around the Facility. Attachment C provides a flow schematic of the Facility.

Prior to making any change in the point of discharge, place of use, or purpose of use of treated wastewater that results in a decrease of flow in any portion of a watercourse, the Discharger must file a petition with the State Water Board, Division of Water Rights, and receive approval for such a change. The State Water Board retains the jurisdictional authority to enforce such requirements under Water Code section 1211.

- D.** The Discharger filed a report of waste discharge and submitted an application for reissuance of its WDRs and NPDES permit on March 4, 2015. Supplementary information was submitted on April 21, 2015, and May 29, 2015. The application was deemed complete on June 10, 2015. A site visit was conducted on March 24, 2015, to observe operations and collect additional data to develop permit limitations and requirements for waste discharge.

## **II. FACILITY DESCRIPTION**

The Discharger owns and operates an apartment building located at 691 South Irolo Street, Los Angeles, CA 90005. The Facility discharges groundwater seepage, irrigation drainage from planter boxes, pool deck wash water and splash water (negligible amount), and storm water runoff from balconies, stairwells, and parking deck operations through Discharge Point 001 into a storm drain system located at Irolo Street.

The following are the sources of wastewater discharged into Discharge Point 001:

- 1.** Storm water from the west stairwell and runoff from parking lot operations is collected via a floor drain that flows to the West Sump, a collection sump.
- 2.** Groundwater seepage also drains into the West Sump.
- 3.** Storm water from the east stairwell is collected in the East Sump, a collection sump.
- 4.** Storm water collected from the rooftop of the apartment building and irrigation drainage runoff from the planter boxes at the rooftop and around the property drain via the main influent pipe to the treatment system.
- 5.** Pool deck wash water and splash water from the rooftop pool also drain into the main influent pipe to the treatment system. The pool deck is occasionally hosed off with municipal potable water. The amount of pool deck wash water and splash water that may be discharged through Discharge Point 001 is negligible.

## **A. Description of Wastewater**

Storm water that flows to the loading dock and trash collection area is routed for discharge to the sanitation sewer system. Storm water collected in the East Sump is pumped to the main influent pipe when the water within the East Sump reaches a certain level. Commingled groundwater and storm water collected in the West Sump is also pumped to the main influent pipe when the water within the West Sump reaches a certain level. Irrigation runoff from the planter boxes; storm water runoff from roof drains, balcony drains, and from the parking deck; as well as pool splash water and pool deck wash water is also directed to the main influent pipe. The main influent pipe routes the collected discharges to the on-site treatment system.

The Facility experienced a series of chronic exceedances of copper, selenium, total suspended solids, and other constituents in the discharge from 2010 to 2013. As a response, the Discharger replaced the copper piping in the sump plumbing with case iron piping, and had the groundwater sump professionally cleaned out (a reported value of over 561 pounds of solids and fine sand was removed from the sump) to address exceedances of metals and solids. The Discharger also installed an on-site treatment system in 2013 after the issuance of TSO No. R4-2012-0173 (in 2012) to further address the selenium exceedances. It has a treatment capacity of 48 gallons per minute. Wastewater coming from the main influent pipe is discharged to an initial surge tank with a volume of approximately 1,000 gallons, after which it is pumped to a single 50 micron bag filter, a 25 micron four bag filter system, three specialty media filters arranged in a series, and a final 25 micron bag filter. The specialty media filters removes selenium and silicon (silicon being a by-product of the selenium removal process). When the sorption media reaches its absorption capacity, it is removed and replaced with new media containers.

The treatment system has two bypasses. The first bypass is installed prior to the main influent pipe discharging to the initial surge tank. Activation of this bypass requires the operator to manually open a valve, and any water coming from the influent pipe will bypass the entire treatment system (including Monitoring Location EFF-001). The Discharger has since placed a lock on the valve to prohibit activation of this bypass by Facility staff. The second bypass is located after the surge tank but prior to the filter system, and routes the water past the treatment system to the flow measurement device. The second bypass may be triggered automatically if the system is clogged, and an alarm will be activated to alert maintenance personnel for immediate attention. Bypass is prohibited unless under the extreme circumstances as specified in section I.G. of the Standard Provisions (Attachment D) of this Order, during which case the Discharger shall contain as much of the discharge on-site as possible until the treatment system is operational, and shall conduct proper monitoring of any untreated discharge. The Discharger has obtained an industrial wastewater permit with the City of Los Angeles Bureau of Sanitation to discharge any wastewater from the treatment system discharged as a result of the second bypass described above to the City of Los Angeles sanitary sewer system.

A p-trap is located at the east side of the building just before the effluent from the treatment unit leaves the building, and it is connected to a storm drain on Irolo Street. This storm drain is connected to a series of other storm drain lines that discharge to Ballona Creek Reach 1 flood control channel, which daylight near Venice Ave.

## **B. Discharge Points and Receiving Waters**

Consistent with the prior Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 and the submitted ROWD, the Facility proposes to discharge up to 0.015 MGD of groundwater seepage, irrigation drainage water, pool deck wash water, and storm water into Ballona Creek Reach 1, a water of the United States, through Discharge Point 001, located at Latitude 34.0598° and Longitude -118.3013°.

**C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data**

Effluent limitations contained in the existing Order for discharges from Discharge Point 001 (Monitoring Location EFF-001) and representative monitoring data from the term of the Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 are as follows:

**Table F-2. Historic Effluent Limitations and Monitoring Data**

Parameter	Units	Effluent Limitation		Monitoring Data (From November 2010 – June 2015)			
		Average Monthly	Maximum Daily	Highest Average Monthly Discharge (Before Treatment)	Highest Daily Discharge (Before Treatment)	Highest Average Monthly Discharge (After Treatment)	Highest Daily Discharge (After Treatment)
<b>Conventional Pollutants</b>							
Biochemical Oxygen Demand (BOD) (5-day @ 20°C)	mg/L	20	30	6.0	6.0	7.2	7.2
	lbs/day	2.5	3.75	0.39	0.39	--	--
Oil and Grease	mg/L	10	15	8.6	8.6	ND	ND
	lbs/day	1.25	1.88	0.61	0.61	--	--
pH	std units	6.5 - 8.5 <sup>1</sup>		6.2 – 8.0 <sup>2</sup>		6.55 – 8.0 <sup>2</sup>	
Total Suspended Solids (TSS)	mg/L	50	75	106	106	ND	ND
	lbs/day	6.26	9.38	13	13	--	--
<b>Non-Conventional Pollutants</b>							
Acute Toxicity	% Survival	3		90 <sup>4</sup>		100 <sup>4</sup>	
Settleable Solids	ml/L	0.1	0.3	0.6	0.6	ND	ND
Temperature	°F	--	86	--	80	--	75
Turbidity	NTU	50	75	21	21	0.25	0.25
Sulfides, Total	mg/L	--	--	ND	ND	ND	ND

Parameter	Units	Effluent Limitation		Monitoring Data (From November 2010 – June 2015)			
		Average Monthly	Maximum Daily	Highest Average Monthly Discharge (Before Treatment)	Highest Daily Discharge (Before Treatment)	Highest Average Monthly Discharge (After Treatment)	Highest Daily Discharge (After Treatment)
<b>Priority Pollutants</b>							
Chloroform	µg/L	--	--	ND	ND	0.67	0.67
Chlordane	µg/L	--	--	ND	ND	--	--
Tetrachloroethylene	µg/L	--	--	--	7.4	ND	ND
4,4-DDD	µg/L	--	--	ND	ND	--	--
4,4,-DDE	µg/L	--	--	ND	ND	--	--
4,4-DDT	µg/L	--	--	ND	ND	--	--
Total PCBs	µg/L	--	--	ND	ND	ND	ND
Cadmium, Total Recoverable	µg/L	--	--	ND	ND	ND	ND
Phenols	mg/L	--	1.0	0.03	0.03	ND	ND
	lbs/day	--	0.13	--	NR	--	--
Copper, Total Recoverable (Dry Weather)	µg/L	20	39	52 <sup>6</sup>	190 <sup>6</sup>	11	11
	lbs/day	0.0025	0.0049	0.0037	0.014	--	--
Copper, Total Recoverable (Wet Weather)	µg/L	9.0	18	52 <sup>6</sup>	190 <sup>6</sup>	11	11
	lbs/day	0.001	0.002	0.0037	0.014	--	--
Lead, Total Recoverable (Dry Weather)	µg/L	11	21	9.5	9.5	ND	ND
	lbs/day	0.0014	0.0026	0.00018	0.00018	--	--
Lead, Total Recoverable (Wet Weather)	µg/L	29	59	9.5	9.5	ND	ND
	lbs/day	0.004	0.007	0.00018	0.00018	--	--
Selenium, Total Recoverable (Dry Weather)	µg/L	4.1	8.2	8.4	8.4	3.5	3.5
	lbs/day	0.0005	0.001	0.00075	0.00075	--	--
Selenium, Total Recoverable (Wet Weather)	µg/L	4.1	8.2	8.4	8.4	3.5	3.5
	lbs/day	0.0005	0.001	0.00075	0.00075	--	--
Silver, Total Recoverable	µg/L	--	--	ND	ND	ND	ND
Zinc, Total Recoverable (Dry Weather)	µg/L	248	498	673 <sup>5</sup>	673 <sup>5</sup>	ND	ND
	lbs/day	0.031	0.062	0.0028	0.0028	--	--

Parameter	Units	Effluent Limitation		Monitoring Data (From November 2010 – June 2015)			
		Average Monthly	Maximum Daily	Highest Average Monthly Discharge (Before Treatment)	Highest Daily Discharge (Before Treatment)	Highest Average Monthly Discharge (After Treatment)	Highest Daily Discharge (After Treatment)
Zinc, Total Recoverable (Wet Weather)	µg/L	59	119	673 <sup>5</sup>	673 <sup>5</sup>	ND	ND
	lbs/day	0.007	0.015	0.0028	0.0028	--	--

ND = Non-detect

- 1 Instantaneous minimum and maximum range.
- 2 Observed pH range.
- 3 The average survival in the undiluted effluent for any three (3) consecutive 96-hour static or continuous flow bioassay test shall be at least 90%, and no single test shall produce less than 70% survival.
- 4 Represents the lowest observed minimum percent survival.
- 5 The highest discharge occurred in February 2013. The second highest discharge has a value of 46 ug/L. Both of these values were taken before the installation of the treatment unit and other implementations of BMP.
- 6 Value recorded before BMP implementations. The Discharger replaces copper piping and also cleaned out solids accumulated in the groundwater sump.

**D. Compliance Summary**

Monitoring data submitted by the Discharger to the Regional Water Board during term of Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01, indicate that the Discharger exceeded permit limitations as outlined in Table F-3.

**Table F-3. Summary of Compliance History**

Date	Monitoring Period	Violation Type	Pollutant	Reported Value	Limitation Value	Units
1/12/2011	1 <sup>st</sup> Quarter 2011	MDEL	Total Suspended Solids	13	9.16	lbs/day
1/12/2011	1 <sup>st</sup> Quarter 2011	MDEL	Total Suspended Solids	106	75	mg/L
1/12/2011	1 <sup>st</sup> Quarter 2011	MDEL	Settleable Solids	0.6	0.3	mL/L
1/31/2011	1 <sup>st</sup> Quarter 2011	AMEL	Total Suspended Solids	13	6.11	lbs/day
1/31/2011	1 <sup>st</sup> Quarter 2011	AMEL	Total Suspended Solids	106	50	mg/L
1/31/2011	1 <sup>st</sup> Quarter 2011	AMEL	Settleable Solids	0.6	0.1	ml/L
2/28/2011	1 <sup>st</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	5.8	4.1	µg/L
2/28/2011	1 <sup>st</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	0.000349	0.000247	lbs/day
2/28/2011	1 <sup>st</sup> Quarter 2011	AMEL	Copper, Total Recoverable	29	20	µg/L
2/28/2011	1 <sup>st</sup> Quarter 2011	AMEL	Copper, Total Recoverable	0.00175	0.00121	lbs/day

Date	Monitoring Period	Violation Type	Pollutant	Reported Value	Limitation Value	Units
3/23/2011	1 <sup>st</sup> Quarter 2011	MDEL	Copper, Total Recoverable	190	18	µg/L
3/23/2011	1 <sup>st</sup> Quarter 2011	MDEL	Copper, Total Recoverable	0.0135	0.00128	lbs/day
3/31/2011	1 <sup>st</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	6.125	4.1	µg/L
3/31/2011	1 <sup>st</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	0.000436	0.000292	lbs/day
3/31/2011	1 <sup>st</sup> Quarter 2011	AMEL	Copper, Total Recoverable	52.05	20	µg/L
3/31/2011	1 <sup>st</sup> Quarter 2011	AMEL	Copper, Total Recoverable	0.00371	0.00142	lbs/day
5/31/2011	2 <sup>nd</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	5.7	4.1	µg/L
5/31/2011	2 <sup>nd</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	0.000473	0.00034	lbs/day
8/31/2011	3 <sup>rd</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	6.7	4.1	µg/L
8/31/2011	3 <sup>rd</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	0.000436	0.000267	lbs/day
11/30/2011	4 <sup>th</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	7.1	4.1	µg/L
11/30/2011	4 <sup>th</sup> Quarter 2011	AMEL	Selenium, Total Recoverable	0.000751	0.000434	lbs/day
2/22/2012	1 <sup>st</sup> Quarter 2012	AMEL	pH	6.2	6.5	standard units
2/28/2012	1 <sup>st</sup> Quarter 2012	AMEL	Selenium, Total Recoverable	7.0	4.1	µg/L
2/28/2012	1 <sup>st</sup> Quarter 2012	AMEL	Selenium, Total Recoverable	0.000496	0.00029	lbs/day
5/31/2012	2 <sup>nd</sup> Quarter 2012	AMEL	Selenium, Total Recoverable	7.64	4.1	µg/L
5/31/2012	2 <sup>nd</sup> Quarter 2012	AMEL	Selenium, Total Recoverable	0.000724	0.000389	lbs/day
8/31/2012	3 <sup>rd</sup> Quarter 2012	AMEL	Selenium, Total Recoverable	0.000025	0.0000162	lbs/day
8/31/2012	3 <sup>rd</sup> Quarter 2012	AMEL	Selenium, Total Recoverable	0.00635	0.0041	mg/L
2/13/2013	1 <sup>st</sup> Quarter 2013	MDEL	Zinc, Total Recoverable	673	498	µg/L
2/13/2013	1 <sup>st</sup> Quarter 2013	MDEL	Selenium, Total Recoverable	8.4	8.2	µg/L
2/28/2013	1 <sup>st</sup> Quarter 2013	AMEL	Zinc, Total Recoverable	673	248	µg/L

Date	Monitoring Period	Violation Type	Pollutant	Reported Value	Limitation Value	Units
2/28/2013	1 <sup>st</sup> Quarter 2013	AMEL	Selenium, Total Recoverable	8.4	7.85	µg/L

On November 8, 2012, the Discharger was issued a Time Schedule Order (TSO) No. R4-2012-0173 to comply with the final effluent limitations for selenium included in Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01. The provisions of the TSO expired on September 7, 2015. On May 17, 2013, the Regional Water Board issued a Settlement Offer No. R4-2013-0055 with a Notice of Violation (NOV) notifying the Discharger for one reporting violation and twenty-nine effluent limit violations for total suspended solids, settleable solids, copper, selenium, zinc, and pH, during the period between January 12, 2011, and August 31, 2012; a mandatory minimum penalty (MMP) was issued for \$93,000. Fourteen counts of effluent limit violations and one reporting violations identified in the NOV were found to be invalid and were dismissed on January 2, 2014, and the Offer was amended to \$51,000 with four additional effluent limit violations incurred during the period from February 13, 2013, to February 28, 2013. The Discharger accepted the Offer and submitted an Acceptance and Waiver on January 23, 2014. The Acceptance and Waiver was executed as a Stipulated Order on February 27, 2014.

There are no other effluent limit violations stipulated. One reporting violation was cited on February 15, 2014. The Regional Water Board is currently evaluating violations that occurred after the citation period of Settlement Offer No. R4-2013-0055 for appropriate action.

**E. Planned Changes**

The Discharger has indicated that there are no anticipated alterations to the Facility or treatment processes.

**III. APPLICABLE PLANS, POLICIES, AND REGULATIONS**

The requirements contained in this Order are based on the requirements and authorities described in this section.

**A. Legal Authorities**

This Order serves as Waste Discharge Requirements (WDRs) pursuant to article 4, chapter 4, division 7 of the California Water Code (commencing with section 13260). This Order is also issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. Environmental Protection Agency (U.S. EPA) and chapter 5.5, division 7 of the Water Code (commencing with section 13370). It shall serve as a National Pollutant Discharge Elimination System (NPDES) permit for point source discharges from this Facility to surface waters.

**B. California Environmental Quality Act (CEQA)**

Under Water Code section 13389, this action to adopt an NPDES permit is exempt from the provisions of Chapter 3 of CEQA, (commencing with section 21100) of Division 13 of the Public Resources Code.

**C. State and Federal Laws, Regulations, Policies, and Plans**

1. **Water Quality Control Plan.** The Regional Water Board adopted a *Water Quality Control Plan for the Los Angeles Region* (hereinafter Basin Plan) on June 13, 1994 that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters

addressed through the plan. Requirements in this Order implement the Basin Plan. In addition, the Basin Plan implements State Water Board Resolution 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply (MUN). Municipal and domestic supply is a potential, not existing, use for Ballona Creek Reach 1. The Regional Water Board is expected to identify those waters in the Region that should be excepted from the MUN designation. Such exceptions will be proposed under a special Basin Plan Amendment. Until such time, page 2-4 of the Basin Plan specifies that “no new effluent limitations will be placed in Waste Discharge Requirements as a result of these designations until the Regional Water Board adopts this amendment.”

**Table F-4. Basin Plan Beneficial Uses**

Discharge Point	Receiving Water Name	Beneficial Use(s)
001	Ballona Creek Reach 1	<p><u>Existing:</u>            Noncontact water recreation (REC-2), and wildlife habitat (WILD).</p> <p><u>Potential:</u>            Municipal and domestic supply (MUN)<sup>1</sup>, water contact recreation (REC-1)<sup>2,3</sup>, and warm freshwater habitat (WARM).</p>

<sup>1</sup> MUN designations are designated under State Water Board Resolution 88-63 and Regional Water Board Resolution 89-03. Some designations may be considered for exemption at a later date (See pages 2-3, 4 of the Basin Plan for more details)

<sup>2</sup> Access prohibited by Los Angeles County Department of Public Works.

<sup>3</sup> The REC-1 use designation does not apply to recreational activities associated with the swimmable goal as expressed in the Federal Clean Water Act section 101(a)(2) and regulated under the REC-1 use in the Basin Plan, or the associated bacteriological objectives set to protect those activities. However, water quality objectives set to protect other REC-1 uses associated with the fishable goal as expressed in the Federal Clean Water Act section 1010(a)(2) shall remain in effect.

2. **High Flow Suspension.** On July 10, 2003, the Regional Water Board adopted Resolution No. 2003-010 (High Flow Suspension) to suspend recreational beneficial uses in engineered channels during unsafe weather conditions. Resolution No. 2003-010 became effective on November 2, 2004 for water contact recreational activities associated with the swimmable goal as expressed in the federal Clean Water Act section 101(a)(2) and regulated under the REC-1 use, non-contact water recreation involving incidental water contact regulated under the REC-2 use, and the associated bacteriological objectives set to protect those activities. Water quality objectives set to protect (1) other recreational uses associated with the fishable goal as expressed in the federal CWA section 101(a)(2) and regulated under the REC-1 use and (2) other REC-2 uses (e.g., uses involving the aesthetic aspects of water) shall remain in effect at all times for water bodies to which the High Flow Suspension applies, on days with rainfall greater than or equal to one-half inch and the 24 hours following the end of the one-half inch or greater rain event, as measured at the nearest local rain gauge, using local Doppler radar, or using widely accepted rainfall estimation methods. The High Flow Suspension is applicable to Ballona Creek Reach 1.
3. **Thermal Plan.** The State Water Board adopted the *Water Quality Control Plan for Control of Temperature in the Coastal and Interstate Waters and Enclosed Bays and Estuaries of California* (Thermal Plan) on January 7, 1971, and amended this plan on

September 18, 1975. This plan contains temperature objectives for surface waters. Requirements of this Order implement the Thermal Plan and a white paper developed by Regional Water Board staff entitled *Temperature and Dissolved Oxygen Impacts on Biota in Tidal Estuaries and Enclosed Bays in the Los Angeles Region*. The white paper evaluated the optimum temperatures for steelhead, topsmelt, ghost shrimp, brown rock crab, jackknife clam, and blue mussel, a number of aquatic species prevalent in the region. The white paper provided the basis to conclude the maximum effluent temperature limitation of 86°F is appropriate for protection of aquatic life and it is included in this Order.

4. **National Toxics Rule (NTR) and California Toxics Rule (CTR).** U.S. EPA adopted the NTR on December 22, 1992, and later amended it on May 4, 1995, and November 9, 1999. About forty criteria in the NTR applied in California. On May 18, 2000, U.S. EPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on February 13, 2001. These rules contain federal water quality criteria for priority pollutants.
5. **State Implementation Policy.** On March 2, 2000, the State Water Board adopted the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California* (State Implementation Policy or SIP). The SIP became effective on April 28, 2000, with respect to the priority pollutant criteria promulgated for California by the U.S. EPA through the NTR and to the priority pollutant objectives established by the Regional Water Board in the Basin Plan. The SIP became effective on May 18, 2000, with respect to the priority pollutant criteria promulgated by the U.S. EPA through the CTR. The State Water Board adopted amendments to the SIP on February 24, 2005, that became effective on July 13, 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.
6. **Antidegradation Policy.** 40 C.F.R. section 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution 68-16 ("*Statement of Policy with Respect to Maintaining High Quality of Waters in California*"). Resolution 68-16 is deemed to incorporate the federal antidegradation policy where the federal policy applies under federal law. Resolution 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the state and federal antidegradation policies. The permitted discharge must be consistent with the antidegradation provision of 40 C.F.R. section 131.12 and State Water Board Resolution 68-16.
7. **Anti-Backsliding Requirements.** Sections 402(o) and 303(d)(4) of the CWA and federal regulations at 40 C.F.R. section 122.44(l) restrict backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed. Clean Water Act section 402(o)(2) and 40 C.F.R. section 122.44(l) provide that the relaxation of effluent limits may be allowed where:
  - a. There has been material and substantial alternations or additions to the permitted facility which justify relaxation.
  - b. New information (other than revised regulations, guidance, or test methods) is available that was not available at the time of permit issuance which would have justified a less stringent effluent limitation.

- c. Technical mistakes or mistaken interpretations of the law were made in issuing the permit under section 402(a)(1)(b) of the Clean Water Act.
  - d. Good cause exists due to events beyond the permittee's control and for which there is no reasonably available remedy.
  - e. The permit has been modified under 40 C.F.R. § 122.62, or a variance has been granted.
  - f. The permittee has installed and properly operated and maintained treatment facilities required to meet the effluent limitations in the previous permit but still has been unable to meet the permit limitations (relaxation may only be allowed to the treatment levels actually achieved).
- 8. Endangered Species Act Requirements.** This Order does not authorize any act that results in the taking of a threatened or endangered species or any act that is now prohibited, or becomes prohibited in the future, under either the California Endangered Species Act (Fish and Game Code, §§ 2050 to 2097) or the Federal Endangered Species Act (16 U.S.C.A. §§ 1531 to 1544). This Order requires compliance with effluent limits, receiving water limits, and other requirements to protect the beneficial uses of waters of the state. The discharger is responsible for meeting all requirements of the applicable Endangered Species Act.

**D. Impaired Water Bodies on CWA 303(d) List**

Section 303(d) of the CWA requires states to identify specific water bodies where water quality standards are not expected to be met after implementation of technology-based effluent limitations on point sources. For all CWA section 303(d)-listed water bodies and pollutants, the Regional Water Board plans to develop and adopt total maximum daily loads (TMDLs) that will specify waste load allocations (WLAs) for point sources and load allocations (LAs) for non-point sources, as appropriate.

Certain receiving waters in the Los Angeles and Ventura County watersheds do not fully support beneficial uses and therefore have been classified as impaired on the 2010 CWA section 303(d) list and have been scheduled for TMDL development. On November 12, 2010, U.S. EPA approved California's 2010 CWA Section 303(d) list of impaired waters and disapproved the omission of several water bodies and associated pollutants that met federal listing requirements. U.S. EPA identified additional water bodies and pollutants for inclusion on the State's CWA section 303(d) list. On October 11, 2011, U.S. EPA issued its final decision regarding the waters U.S. EPA added to the State's CWA section 303(d) list.

The Facility discharges into Ballona Creek Reach 1. The 2010 State Water Board's California 303(d) list classifies Ballona Creek as impaired. The pollutants/stressors for Ballona Creek include: cadmium (sediment), coliform bacteria, copper, cyanide, lead, selenium, toxicity, trash, viruses (enteric), and zinc. Downstream to Ballona Creek, the Ballona Creek Estuary is listed as impaired for cadmium, chlordane, coliform bacteria, copper, DDT, lead (sediment), PAHs (sediment), PCBs (sediment), toxicity (sediment), shellfish harvesting advisory, silver, and zinc (sediment). The Ballona Creek Wetlands are listed as impaired for exotic vegetation, habitat alterations, hydromodification, reduced tidal flushing, and trash.

- 1. Ballona Creek Trash TMDL.** The Ballona Creek Trash TMDL was adopted by the Regional Water Board on September 19, 2001; by the OAL on July 18, 2002; and by U.S. EPA on August 1, 2002. The TMDL was petitioned and a settlement agreement became effective on September 23, 2003. The Regional Water Board incorporated the conditions of the settlement agreement into the TMDL on March 4, 2004, by Resolution No. 04-023. The amendment was approved by the State Water Board on September 30,

2004; by OAL on February 8, 2005; it became effective on August 11, 2005. The TMDL identifies storm water discharges as the major source of trash in Ballona Creek and Wetland. A WLA of zero trash is assigned to the Los Angeles County Municipal Separate Sewer System (MS4), Caltrans NPDES permittees, and Phase II storm water permittees. The Ballona Creek Trash TMDL does not directly address discharges from the Facility. However, to address the trash impairment in Ballona Creek, this Order requires the Discharger to develop and implement a Storm Water Pollution Prevention Plan (SWPPP), which is expected when implemented to minimize/prevent the discharge of trash from the Facility to the Ballona Creek Watershed.

- 2. Metals TMDL for Ballona Creek:** The Regional Board adopted the Ballona Creek Metals TMDL for Ballona Creek, Resolution R05-007, on July 7, 2005, which was approved by the State Water Board on October 20, 2005; by the OAL on December 9, 2005; by the U.S. EPA on December 22, 2005; and became effective on January 11, 2006. The TMDL was revised by Resolution No. 2007-015 on September 6, 2007; by the State Water Board on June 17, 2008; by the OAL on October 6, 2008; and by the U.S. EPA on October 29, 2008. On December 5, 2013, the Regional Water Board adopted Resolution No. R13-010 to amend the Metals TMDL. The State Water Board approved the amendment on June 17, 2014, and OAL and U.S. EPA approval were granted on May 4, 2015, and October 26, 2015, respectively. Resolution No. R13-010 included changes to the definition of wet and dry weather flows in the Ballona Creek, revised the concentration-based WLAs for copper, lead, and zinc, and removed the WLAs for selenium based on additional receiving water monitoring data. This Order includes effluent limitations in accordance to Resolution No. R13-010.
- 3. Ballona Creek Estuary Toxic Pollutants TMDL.** The Ballona Creek Estuary Toxic Pollutants TMDL was approved by the Regional Water Board on July 7, 2005 through Resolution No. R05-008. The State Water Board approved the TMDL on October 20, 2005; OAL and U.S. EPA approvals were received on December 9, 2005 and December 22, 2005 respectively. The TMDL became effective on January 11, 2006. The TMDL assigned concentration-based WLAs for sediments with respect to cadmium, copper, lead, silver, zinc, chlordane, DDT, PAHs, and total PCBs to the minor NPDES permittees that discharge to Ballona Creek Estuary or its tributaries. On December 5, 2013, the Regional Water Board adopted Resolution No. R13-010 to amend the Toxic Pollutants TMDL. The State Water Board approved the amendments on June 17, 2014, and OAL and U.S. EPA approval were granted on May 4, 2015, and October 26, 2015, respectively. Resolution No. R13-010 revised the concentration-based sediment WLAs for cadmium, copper, lead, silver, zinc, chlordane, DDT, and total PCBs, and removed the WLAs for PAHs. The provisions of this permit implement the WLAs established in the Ballona Creek Estuary Toxics Pollutants TMDL applicable to discharges from this Facility.
- 4. Total Maximum Daily Loads for Bacterial Indicator Densities in Ballona Creek, Ballona Estuary, and Sepulveda Channel.** The Regional Water Board adopted the Total Maximum Daily Loads for Bacterial Indicator Densities in Ballona Creek, Ballona Estuary, and Sepulveda Channel (Ballona Creek Bacteria TMDL) on June 8, 2006. The TMDL was approved by the State Water Board on November 15, 2006; by the OAL on February 22, 2009; by the U.S. EPA on March 23, 2007. The Regional Water Board subsequently adopted revisions to the TMDL with Resolution R12-008 on June 7, 2012. The revised TMDL was approved by the State Water Board on March 19, 2013, by OAL on November 8, 2013, and by the U.S. EPA (became effective) on July 2, 2014. The TMDL establishes bacterial objectives for Ballona Creek Reach 1 based on the bacterial objectives for REC-2 (non-contact water recreation) freshwater beneficial uses in the

Basin Plan. However, the TMDL does not specifically address individual minor NPDES permittees, and the Discharger is not expected to be a significant source of bacteria. This Order addresses the bacterial impairments for Ballona Creek Reach 1 with the receiving water limitation for fecal coliform, and includes effluent monitoring requirements for fecal coliform in the MRP to monitor the contribution of bacteria from the discharge to the receiving water.

5. **Ballona Creek Wetlands Total Maximum Daily Loads for Sediment and Invasive Exotic Vegetation.** U.S. EPA established the Ballona Creek Wetlands Total Maximum Daily Loads for Sediment and Invasive Exotic Vegetation (Ballona Creek Wetlands TMDL) on March 26, 2012. The TMDL addresses the deterioration of the Ballona Creek Wetlands and impairment of beneficial uses due to excess sediment and invasive exotic vegetation. It establishes WLAs and LAs for sediments and for invasive exotic vegetation to discharges that are determined to be a significant source of sediment and invasive exotic vegetation to the Ballona Creek Wetlands. However, the TMDL does not specifically address individual minor NPDES permittees, and discharges from the Facility are not expected to be a significant source of sediment and exotic vegetation.

#### **E. Other Plans, Policies and Regulations – Not Applicable**

### **IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS**

The CWA requires point source dischargers to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States. The control of pollutants discharged is established through effluent limitations and other requirements in NPDES permits. There are two principal bases for effluent limitations in the Code of Federal Regulations: 40 C.F.R. section 122.44(a) requires that permits include applicable technology-based limitations and standards; and 40 C.F.R. section 122.44(d) requires that permits include water quality-based effluent limitations (WQBELs) to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water.

The list of pollutants of concern is based on constituents that are typically found in discharges of groundwater seepage and storm water, and pollutants addressed in the TMDLs applicable to Ballona Creek and Ballona Creek Estuary. Discharges from the Facility are comprised of groundwater seepage and storm water, with a small amount of irrigation runoff and pool deck wash water (using potable water). Typical pollutants expected to be present in this type of discharge include pH, temperature, TSS, turbidity, BOD<sub>5</sub>, oil and grease, settleable solids, and phenols. Selenium was a historical pollutant of concern. In addition, the Ballona Creek Metals TMDL established concentration-based dry and wet weather WLAs for copper, lead, and zinc. Thus, pollutants of concern for the discharge of groundwater seepage and storm water through Discharge Point 001 include pH, temperature, TSS, turbidity, BOD<sub>5</sub>, oil and grease, settleable solids, phenols, selenium, copper, lead, and zinc.

Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 established effluent limitations for a number of pollutants believed to be present in the discharge of groundwater seepage and storm water runoff from the Facility. Effluent limitations in Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 were established for pH, temperature, TSS, turbidity, BOD<sub>5</sub>, oil and grease, settleable solids, phenols, acute toxicity, copper, lead, selenium, and zinc. Due to the nature of discharge from the Facility and its past monitoring history, as well as waste load allocations for the receiving water as established in applicable TMDLs, these constituents, except phenols (as explained in section IV.B.2 of this Fact Sheet), continue to be pollutants of concern for discharges from the Facility.

Generally, mass-based effluent limitations ensure that proper treatment, and not dilution, is employed to comply with the final effluent concentration limitations. Section 122.45(f)(1) requires

that all permit limitations, standards or prohibitions be expressed in terms of mass units except under the following conditions: (1) for pH, temperature, radiation or other pollutants that cannot appropriately be expressed by mass limitations; (2) when applicable standards or limitations are expressed in terms of other units of measure; or (3) if in establishing technology-based permit limitations on a case-by-case basis limitations based on mass are infeasible because the mass or pollutant cannot be related to a measure of production. The limitations, however, must ensure that dilution will not be used as a substitute for treatment.

#### **A. Discharge Prohibitions**

The discharge prohibitions are based on the requirements of the Basin Plan, State Water Board's plans and policies, the CWA, the Water Code, and previous permit provisions, and are consistent with the requirements set for other discharges regulated by NPDES permits.

#### **B. Technology-Based Effluent Limitations**

##### **1. Scope and Authority**

Section 301(b) of the CWA and implementing U.S. EPA permit regulations at 40 C.F.R. section 122.44 require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal technology-based requirements based on Best Professional Judgment (BPJ) in accordance with 40 C.F.R. section 125.3.

The CWA requires that technology-based effluent limitations be established based on several levels of controls:

- a. Best practicable treatment control technology (BPT) represents the average of the best existing performance by well-operated facilities within an industrial category or subcategory. BPT standards apply to toxic, conventional, and non-conventional pollutants.
- b. Best available technology economically achievable (BAT) represents the best existing performance of treatment technologies that are economically achievable within an industrial point source category. BAT standards apply to toxic and non-conventional pollutants.
- c. Best conventional pollutant control technology (BCT) represents the control from existing industrial point sources of conventional pollutants including BOD, TSS, fecal coliform, pH, and oil and grease. The BCT standard is established after considering a two-part reasonableness test. The first test compares the relationship between the costs of attaining a reduction in effluent discharge and the resulting benefits. The second test examines the cost and level of reduction of pollutants from the discharge from publicly owned treatment works to the cost and level of reduction of such pollutants from a class or category of industrial sources. Effluent limitations must be reasonable under both tests.
- d. New source performance standards (NSPS) represent the best available demonstrated control technology standards. The intent of NSPS guidelines is to set limitations that represent state-of-the-art treatment technology for new sources.

The CWA requires U.S. EPA to develop effluent limitations, guidelines and standards (ELGs) representing application of BPT, BAT, BCT, and NSPS. Section 402(a)(1) of the CWA and 40 C.F.R. section 125.3 authorize the use of Best Professional Judgment (BPJ) to derive technology-based effluent limitations on a case-by-case basis where ELGs are not available for certain industrial categories and/or pollutants of concern.

Where BPJ is used, the Regional Water Board must consider specific factors outlined in 40 C.F.R. section 125.3.

## **2. Applicable Technology-Based Effluent Limitations**

Federal ELGs have not been developed for groundwater seepage, irrigation runoff, and storm water runoff from commercial apartment buildings. Pursuant to section 122.44(k), the prior Order required the Discharger to develop and implement a Best Management Practices Plan (BMPP) to establish site-specific procedures that will ensure proper operation and maintenance of trash transfer and storage areas, and to ensure that unauthorized non-storm water discharges (i.e. spills) do not occur at the Facility. This Order continues to require the Discharger to develop and implement a BMPP; additionally, this Order requires the Discharger to submit a Storm Water Pollution Prevention Plan (SWPPP) to outline site-specific management processes for minimizing storm water runoff contamination and for preventing contaminated storm water runoff from being discharged directly into the storm drain or receiving water or through the Facility's perimeters. At a minimum, the management practices should ensure that unauthorized non-storm water discharges do not occur at the Facility.

The combination of the SWPPP, BMPP, and effluent limitations based on past performance and reflecting BPJ will serve as the equivalent of technology based effluent limitations, in the absence of established ELGs, in order to carry out the purposes and intent of the CWA.

The technology-based requirements in this Order are based on case-by-case numeric limitations developed using BPJ in accordance with 40 C.F.R. section 125.3. Effluent limitations were established in Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 for total suspended solids, turbidity, settleable solids, phenols, oil and grease, and BOD at Discharge Point 001. This Order retains effluent limitations for the above except phenol based on BPJ and with consideration of federal antibacksliding requirements. The limitations for these pollutants are consistent with technology-based effluent limitations (TBEL) included in other Orders within the State for similar types of discharges. The Regional Water Board considered other relevant factors pursuant to 40 C.F.R. section 125.3; and concluded that the limitations are appropriate. The effluent limitations for phenol were inherited from historical Orders for the Discharger and are no longer applicable. There have been significant modifications to the Facility with implementation of additional BMPs and a treatment system since the implementation of those limits. In addition, recent effluent monitoring results from the Discharger consistently showed non-detected levels (there was one detected value at the reporting limit of 30 ug/L, which is within the effluent limitation of 1 mg/L, in 2011 before the installation of the treatment system) for phenols. There is no reasonable potential that phenol is present in the discharge in amounts that can cause or contribute to an exceedance of its water quality standard. Therefore, removing these effluent limitations is appropriate. The Discharger is required to monitor phenol in future discharges as stated in the MRP.

**Table F-5. Summary of Technology-based Effluent Limitations – Discharge Point 001**

Parameter	Units	Effluent Limitations	
		Average Monthly	Maximum Daily
Biochemical Oxygen Demand (BOD) (5-day @ 20°C)	mg/L	20	30
	lbs/day <sup>1</sup>	2.5	3.8
Oil and Grease	mg/L	10	15
	lbs/day <sup>1</sup>	1.3	1.9
Settleable Solids	ml/L	0.1	0.3
Total Suspended Solids (TSS)	mg/L	50	75
	lbs/day <sup>1</sup>	6.3	9.4
Turbidity	NTU	50	75

<sup>1</sup> The mass emission rates are based on the design flow rate of 0.015 MGD at Discharge Point 001, and are calculated as follows: Flow (MGD) x Concentration (mg/L) x 8.34 (conversion factor) = lbs/day.

**C. Water Quality-Based Effluent Limitations (WQBELs)**

**1. Scope and Authority**

CWA Section 301(b) and 40 C.F.R. section 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards.

40 C.F.R. Section 122.44(d)(1)(i) requires that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, water quality-based effluent limitations (WQBELs) must be established using: (1) U.S. EPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state’s narrative criterion, supplemented with other relevant information, as provided in section 122.44(d)(1)(vi). WQBELs must also be consistent with the assumption and requirements of TMDL WLAs approved by U.S. EPA.

The process for determining reasonable potential and calculating WQBELs when necessary is intended to protect the designated beneficial uses of the receiving water as specified in the Basin Plan, and achieve applicable water quality objectives and criteria that are contained in other state plans and policies, or any applicable water quality criteria contained in the CTR and NTR.

The specific procedures for determining reasonable potential for discharges from the Facility, and if necessary for calculating WQBELs, are contained in the U.S. EPA Technical Support Document for Water Quality-Based Toxics Control (TSD) for storm water discharges and in the SIP for non-storm water discharges. The TSD in section 3.3.8 in the first paragraph on page 64 states: “The statistical approach shown in Box 3-2 or an analogous approach developed by a regulatory authority can be used to determine the reasonable potential.” The Regional Water Board has determined the procedures for determining reasonable potential and calculating WQBELs contained in the SIP for non-storm water discharges may be used to evaluate reasonable potential and calculate WQBELs for storm water discharges as well. Hence, for this Order, the Regional Water

Board has used the SIP methodology to evaluate reasonable potential for discharges through Discharge Point 001.

**2. Applicable Beneficial Uses and Water Quality Criteria and Objectives**

As noted in section II of the Limitations and Discharge Requirements of this Order, the Regional Water Board adopted a Basin Plan that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the Basin Plan. The beneficial uses applicable to Ballona Creek are summarized in section III.C.1 of this Fact Sheet. The Basin Plan includes both narrative and numeric water quality objectives applicable to the receiving water.

Priority pollutant water quality criteria in the CTR are applicable to Ballona Creek. The CTR contains both saltwater and freshwater criteria. Because a distinct separation generally does not exist between freshwater and saltwater aquatic communities, the following apply, in accordance with section 131.38(c)(3). Freshwater criteria apply at salinities of 1 part per thousand (ppt) and below at locations where this occurs 95 percent or more of the time. The Regional Water Board has determined that freshwater criteria apply within Ballona Creek. The CTR aquatic life criteria for freshwater or human health for consumption of organisms, whichever is more stringent, are used to prescribe the effluent limitations in this Order to protect the beneficial uses of Ballona Creek, a water of the United States.

Table F-8 summarizes the applicable water quality criteria/objective for priority pollutants that were reported in detectable concentrations in the effluent at EFF-001, and are not addressed in any TMDLs applicable to Ballona Creek. Some water quality criteria are hardness dependent. A median receiving water hardness value of 118 mg/L (as CaCO<sub>3</sub>) was used for calculation of metals criteria, based on the monitoring data from Los Angeles County Department of Public Works at the downstream location at Sawtelle Boulevard (about 5 miles from the discharge location). These criteria are used in the reasonable potential analysis (RPA) for this order.

**Table F-6. Applicable Water Quality Criteria**

CTR No.	Constituent	Selected Criteria	CTR/NTR Water Quality Criteria		
			Freshwater		Human Health for Consumption of: Organisms only
			Acute	Chronic	
µg/L	µg/L	µg/L	µg/L	µg/L	
2	Arsenic, Total Recoverable	150	340	150	--
5b	Chromium (VI)	11	16	11	Narrative
9	Nickel, Total Recoverable	60	538 <sup>1</sup>	60	4,600
10	Selenium, Total Recoverable	5	20	5	Narrative
19	Benzene	71	--	--	71
36	Methylene Chloride	1,600	--	--	1,600
24	Chloroethane	--	--	--	--
26	Chloroform	--	--	--	--
38	Tetrachloroethylene	8.9	--	--	8.9
54	Phenol	4,600,000	--	--	4,600,000

**Ballona Creek Trash TMDL.** The Ballona Creek Trash TMDL established a zero trash final WLA to the Los Angeles County Municipal Separate Sewer System (MS4), Caltrans NPDES permittees, and Phase II storm water permittees discharging to Ballona Creek and Wetland. The TMDL may be revised in response to the adoption of State Water Board’s Trash Amendment in 2015. The TMDL identifies storm water discharges as the major source of trash in Ballona Creek and Wetland. The Ballona Creek Trash TMDL is not directly applicable to the Facility. However, implementation of the SWPPP, as discussed in section IV.B.2 of this Fact Sheet, is expected to prevent/minimize the discharge of trash from the Facility to the Ballona Creek Watershed.

**Metals TMDL for Ballona Creek.** The Ballona Creek Metals TMDL established concentration-based water column WLAs in Ballona Creek for copper, lead, selenium, and zinc through Resolution No. R2007-015, which was revised by Resolution No. R13-010. The numeric target portion of the TMDL specifies when the wet weather and dry weather targets (based on numeric water quality criteria established by the CTR) are applicable. As per Resolution No. R13-010, wet weather targets are applicable when the flow in the Ballona Creek at station F38C-R is greater than or equal to 64 cfs; dry weather targets are applicable when flow at that location is less than 64 cfs. The TMDL states that permit writers may translate applicable WLAs into effluent limitations for minor NPDES permits by applying the effluent limitation procedures in Section 1.4 of the SIP or other applicable engineering practices authorized under federal regulations. This Order includes dry and wet weather effluent limitations for copper, lead, and zinc.

Table F-7 summarizes the dry and wet weather WLAs for copper, lead, and zinc. These aWLAs are applicable to discharges from the Facility through Discharge Point 001 to the Ballona Creek, and are converted into effluent limitations by applying SIP procedures as included in section 1.4 of the SIP.

**Table F-7. Metals WLAs Assigned to Minor NPDES Permittees Discharging to Ballona Creek**

Parameter	Weather/Flow Conditions	WLA Based on Resolution No. R13-010 (µg/L)
Copper, Total Recoverable	Dry Weather	35.56
	Wet Weather	13.70
Lead, Total Recoverable	Dry Weather	19.65
	Wet Weather	76.75
Zinc, Total Recoverable	Dry Weather	446.55
	Wet Weather	104.77

**Toxic Pollutants TMDL for Ballona Creek Estuary.** The Ballona Creek Estuary Toxic Pollutants TMDL (Resolution No. R13-010) assigned concentration-based WLAs for sediments with respect to cadmium, copper, lead, silver, zinc, chlordane, DDT, and total PCBs to minor NPDES permittees that discharge to Ballona Creek Estuary or its tributaries. This Order implements the WLAs established in this TMDL applicable to discharges from this Facility through sediment effluent limitations.

Table F-8 summarizes the sediment WLAs as included in Resolutions No. R13-010.

**Table F-8. Toxic Pollutants WLAs Assigned to Minor NPDES Permits**

Parameter	Units	Sediment WLA (Resolution No. R13-010)
Cadmium, Total Recoverable	mg/kg	1.2
Copper, Total Recoverable	mg/kg	34
Lead, Total Recoverable	mg/kg	46.7
Silver, Total Recoverable	mg/kg	1.0
Zinc, Total Recoverable	mg/kg	150
Chlordane	ug/kg	1.3
DDTs	ug/kg	1.9
Total PCBs	ug/kg	3.2

Resolution No. R13-010 also assigned water column WLAs to copper, lead, and zinc for Ballona Creek, which are statistically translated into applicable effluent limits for the discharge in this Order. However, no water column WLAs were assigned for cadmium, silver, chlordane, DDTs, and total PCBs. Therefore, this Order sets performance goals for these pollutants, to ensure proper implementation of the Ballona Creek Toxics Pollutants TMDL sediment allocations applicable to the discharge as listed in Table F-8. Performance goals for these parameters are intended to ensure that effluent concentrations and mass discharges do not exceed levels that can be attained by performance of the Facility’s treatment technologies existing at the time of permit issuance, reissuance, or modification. These performance goals are not enforceable effluent limitations. They act as triggers to determine when sediment monitoring of the effluent is required for these parameters. The performance goal for cadmium and silver are based on their respective CTR aquatic life criteria, using a hardness value of 118 mg/L (as CaCO<sub>3</sub>), and the performance goal for chlordane, DDTs, and total PCBs are based on their respective CTR human health criteria. The tables in Attachment J summarize the development and calculation of the performance goals for cadmium, silver, chlordane, DDTs, and total PCBs in this Order.

During each reporting period, if effluent monitoring results exceed **both** a TSS effluent limit and an effluent limit or performance goal for cadmium, copper, lead, silver, zinc, chlordane, DDTs, or PCBs, then the Discharger has **not** demonstrated attainment with the sediment allocations stipulated in the Ballona Creek Estuary TMDL and implementation of the effluent sediment monitoring program will be required for that priority pollutant. Sediment monitoring of the effluent shall begin during the first discharge event following the effluent exceedances. An effluent sediment monitoring result at or below the sediment effluent limitation (monitoring thresholds) in Table 5 of this Order demonstrates attainment with the monitoring thresholds and additional effluent sediment monitoring of the effluent is not required.

**Total Maximum Daily Loads for Bacterial Indicator Densities in Ballona Creek, Ballona Estuary, and Sepulveda Channel.** The Bacterial TMDL identifies a number of responsible jurisdictions and responsible agencies for the Ballona Creek Watershed and specifies that they are jointly responsible for complying with the waste load allocation in

each reach. The applicable objectives for Ballona Creek Reach 1 are based on the bacterial objectives for REC-2 (non-contact water recreation) freshwater beneficial uses in the Basin Plan.

**Table F-9. Applicable Fecal Coliform Bacteria Water Quality Objectives**

Sample Type	Objective
Geometric Mean	Fecal coliform density shall not exceed 2,000/100 ml.
Single Sample	Fecal coliform density shall not exceed 4,000/100 ml.

However, the TMDL does not specifically address individual minor NPDES permittees, and discharges from the Facility are not expected to be a significant source of bacteria. This Order addresses the bacterial impairment for Ballona Creek Reach 1 with a receiving water limitation, and includes effluent monitoring requirements for bacteria in the MRP to evaluate the pollutant concentration discharged to the receiving water.

**3. Determining the Need for WQBELS**

In accordance with Section 1.3 of the SIP, the Regional Water Board conducts a Reasonable Potential Analysis (RPA) for each priority pollutant with an applicable criterion or objective to determine if a WQBEL is required in the permit. The Regional Water Board analyzes effluent and receiving water data and identifies the maximum observed effluent concentration (MEC) and maximum background concentration (B) in the receiving water for each constituent, based on data provided by the Discharger. To determine reasonable potential, the MEC and the B are then compared with the applicable water quality objectives (C) outlined in the CTR, NTR, as well as the Basin Plan. For all pollutants that have a reasonable potential to cause or contribute to an excursion above a state water quality standard, numeric WQBELS are required.

Section 1.3 of the SIP provides the procedures for determining reasonable potential to exceed applicable water quality criteria and objectives. The SIP specifies three triggers to complete a RPA:

- i. Trigger 1 – if  $MEC \geq C$ , a limit is needed.
- ii. Trigger 2 – If the background concentration (B) > C and the pollutant is detected in the effluent, a limit is needed.
- iii. Trigger 3 – If other related information such as CWA section 303(d) listing for a pollutant, discharge type, compliance history, or other applicable factors indicate that a WQBEL is required.

Sufficient effluent and receiving water data are needed to conduct a complete RPA. If data are not sufficient, the Discharger will be required to gather the appropriate data for the Regional Water Board to conduct the RPA. Upon review of the data, and if the Regional Water Board determines that WQBELS are needed to protect the beneficial uses, the permit will be reopened for appropriate modification. Effluent monitoring data collected by the Discharger from November 2010 through June 2015, as well as the hardness data based on the monitoring data from Los Angeles County Department of Public Works at the downstream location, Sawtelle Boulevard, were considered in the RPA. No background data for the priority pollutants in the receiving water was provided; Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 did not include any upstream or downstream receiving water monitoring requirements.

Section 1.4.3.1 of the SIP states that “if possible, preference should be given to ambient water column concentrations measured immediately upstream or near the discharge, but not within an allowed mixing zone for the discharge”. Discharge from the Facility reaches

a storm drain, which joins a network of other underground storm drain lines that discharges close to the origin of the Ballona Creek Reach 1 flood control channel. Ballona Creek daylights near Venice Ave, approximately 5 miles downstream from the storm drain to which discharges from the Facility are routed. Therefore, upstream receiving water monitoring is not feasible for this Facility; downstream receiving water monitoring data at Ballona Creek after it daylights at Venice Boulevard (5 miles downstream) are not available for this RPA.

The Regional Water Board developed dry and wet weather WQBELs for copper, lead, and zinc that have specified WLAs in the Ballona Creek Metals TMDL. As described in section III.D of this Fact Sheet, and in accordance with the Ballona Creek Metals TMDL, the final wet and dry weather WQBELs were statistically-calculated based on water column final concentration-based WLAs for copper, lead, selenium, and zinc (see section IV.C.4 of this Fact Sheet). The effluent limitations for these pollutants were established for dry and wet weather discharges regardless of whether or not there is reasonable potential for the pollutants to be present in the discharge at levels that would cause or contribute to a violation of water quality standards. The Regional Water Board developed WQBELs for these pollutants pursuant to 40 C.F.R. section 122.44(d)(1)(vii), which does not require or contemplate a reasonable potential analysis. Similarly, section 1.3 of the SIP recognizes that reasonable potential analysis is not appropriate if a TMDL has been developed.

**Table F-10. Summary Reasonable Potential Analysis–Discharge Point 001**

CTR No.	Constituent	Applicable Water Quality Criteria (µg/L)	Max Effluent Conc. (MEC) (µg/L)	RPA Result - Need Limit?	Reason
2	Arsenic, Total Recoverable	150	2.4	No	MEC<C
5b	Chromium (VI)	11	1	No	MEC<C
6	Copper, Total Recoverable (Wet Weather)	13.7	190	Yes <sup>1</sup>	MEC>C; TMDL
6	Copper, Total Recoverable (Dry Weather)	35.56	190	Yes <sup>1</sup>	MEC>C; TMDL
7	Lead, Total Recoverable (Wet Weather)	19.65	9.5	Yes <sup>1</sup>	TMDL
7	Lead, Total Recoverable (Dry Weather)	76.75	9.5	Yes <sup>1</sup>	TMDL
9	Nickel, Total Recoverable	60	3.1	No	MEC<C
10	Selenium, Total Recoverable	5.0	10.9	Yes	MEC>C
13	Zinc, Total Recoverable (Wet Weather)	104.77	673	Yes <sup>1</sup>	MEC>C; TMDL
13	Zinc, Total Recoverable (Dry Weather)	446.55	673	Yes <sup>1</sup>	MEC>C; TMDL
19	Benzene	71	0.19	No	MEC<C
36	Methylene Chloride	1,600	0.62	No	MEC<C
24	Chloroethane	--	15	No	MEC<C

CTR No.	Constituent	Applicable Water Quality Criteria (µg/L)	Max Effluent Conc. (MEC) (µg/L)	RPA Result - Need Limit?	Reason
26	Chloroform	--	0.67	No	MEC<C
38	Tetrachloroethylene	8.9	7.4	No	MEC<C
54	Phenol	4,600,000	30	No	MEC<C

NA = No Result available for the RPA

<sup>1</sup> Dry and wet weather limitations are required for this constituent, regardless of reasonable potential determination, to implement the Ballona Creek Metals TMDL.

**4. WQBEL Calculations**

- a. If reasonable potential exists to exceed applicable water quality criteria or objectives, then a WQBEL must be established in accordance with one or more of the three procedures contained in section 1.4 of the SIP. These procedures include:
  - i. If applicable and available, use the WLA established as part of a TMDL.
  - ii. Use of a steady-state model to derive maximum daily effluent limitations (MDELs) and average monthly effluent limitations (AMELs).
  - iii. Where sufficient effluent and receiving water data exist, use of a dynamic model, which has been approved by the Regional Water Board.
- b. WQBELs for copper, lead, and zinc are based on the Metals TMDL developed for Ballona Creek.
- c. Since many of the streams in the Region have minimal upstream flows, mixing zones and dilution credits are usually not appropriate. Therefore, in this Order, no dilution credit is included.

**WQBELs Calculation Example**

Using total recoverable copper (dry weather and wet weather) and selenium as examples, the following demonstrates how WQBELs were established for this Order. The tables in Attachment J summarize the development and calculation of all WQBELs for this Order using the process described below.

**Concentration-Based Effluent Limitations**

A set of AMEL and MDEL values are calculated separately, one set for the protection of aquatic life and the other for the protection of human health. The AMEL and MDEL limitations for aquatic life and human health are compared, and the most restrictive AMEL and the most restrictive MDEL are selected as the WQBEL.

**Calculation of aquatic life AMEL and MDEL:**

**Step 1:** For each constituent requiring an effluent limit, identify the applicable water quality criteria or objective. For each criterion determine the effluent concentration allowance (ECA) using the following steady state equation:

$$\begin{aligned}
 ECA &= C + D(C-B) && \text{when } C > B, \text{ and} \\
 ECA &= C && \text{when } C \leq B,
 \end{aligned}$$

- Where C = The priority pollutant criterion/objective, adjusted if necessary for hardness, pH and translators. In this Order a hardness value of 118 mg/L (as CaCO<sub>3</sub>) was used for development of hardness-dependent criteria for Discharge Point 001, and a pH of 6.2 was used for pH-dependent criteria.
- D = The dilution credit, and
- B = The ambient background concentration.

As discussed above, for this Order, dilution was not allowed; therefore:

$$ECA = C$$

When a WLA has been established through a TMDL for a parameter, the WLA is set equal to the ECA. Note that for copper, lead, and zinc, the acute criterion was used to develop the wet weather WLA and therefore wet weather WLA for these constituents will become the ECA<sub>acute</sub>. Chronic criterion was used to develop dry weather WLA and therefore dry weather WLA will become the ECA<sub>chronic</sub>. The chronic criterion is used for dry weather because it is the most protective and the most applicable to dry weather, which occurs for long, uninterrupted periods of time in the Los Angeles Region.

For total recoverable copper the applicable water quality criteria are (reference Table F-7):

$$ECA_{acute} = 13.70 \mu\text{g/L (TMDL wet weather WLA, Resolution No. 13-010)}$$

$$ECA_{chronic} = 35.56 \mu\text{g/L (TMDL dry weather WLA, Resolution No. 13-010)}$$

For total recoverable selenium, there is no applicable TMDL WLA in Resolution No. R13-010. Therefore, the aquatic life criteria for freshwater as specified in the CTR are used:

$$ECA_{acute} = 20.00 \mu\text{g/L}$$

$$ECA_{chronic} = 5.00 \mu\text{g/L}$$

**Step 2:** For each ECA based on aquatic life criterion/objective, determine the long-term average discharge condition (LTA) by multiplying the ECA by a factor (multiplier). The multiplier is a statistically based factor that adjusts the ECA to account for effluent variability. The value of the multiplier varies depending on the coefficient of variation (CV) of the data set and whether it is an acute or chronic criterion/objective. Table 1 of the SIP provides pre-calculated values for the multipliers based on the value of the CV. Equations to develop the multipliers are provided in Section 1.4, Step 3 of the SIP and will not be repeated here.

$$LTA_{acute} = ECA_{acute} \times \text{Multiplier}_{acute}^{99}$$

$$LTA_{chronic} = ECA_{chronic} \times \text{Multiplier}_{chronic}^{99}$$

The CV for the data set must be determined before the multipliers can be selected and will vary depending on the number of samples and the standard deviation of a data set. If the data set is less than 10 samples, or at least 80% of the samples in the data set are reported as non-detect, the CV shall be set equal to 0.6. In the case for copper and selenium, CVs are calculated in accordance to the SIP by dividing the estimated standard deviation by the arithmetic mean of the observed values.

The following values were used to develop the acute and chronic LTA using equations provided in Section 1.4, Step 3 of the SIP (Table 1 of the SIP also provides these values up to three decimals):

No. of Samples	CV	ECA Multiplier <sub>acute 99</sub>	ECA Multiplier <sub>chronic 99</sub>
Copper (dry weather)			
21	2.96	0.0933	0.146
Copper (wet weather)			
21	2.96	0.0933	0.146
Selenium			
28	0.55	0.345	0.553

Total recoverable copper (dry weather):

$$LTA_{acute} = \text{Not applicable}$$

$$LTA_{chronic} = 35.56 \mu\text{g/L} \times 0.146 = 5.192 \mu\text{g/L}$$

Total recoverable copper (wet weather):

$$LTA_{acute} = 13.7 \mu\text{g/L} \times 0.0933 = 1.278 \mu\text{g/L}$$

$$LTA_{chronic} = \text{Not applicable}$$

Total recoverable selenium

$$LTA_{acute} = 20.0 \mu\text{g/L} \times 0.345 = 6.90 \mu\text{g/L}$$

$$LTA_{chronic} = 5.00 \mu\text{g/L} \times 0.553 = 2.765 \mu\text{g/L}$$

**Step 3:** Select the most limiting (lowest) of the LTA.

For copper, since the acute criteria will be used to develop the wet weather effluent limitations and chronic criteria will be used to develop the dry weather effluent limitations, we only have one criterion for each condition for the parameters listed in the Ballona Creek Metals TMDL; thus, both LTAs (wet and dry) will be used.

For total recoverable selenium, the chronic criterion (based on the chronic aquatic life criteria) was selected as it is the most limiting LTA.

**Step 4:** Calculate the WQBELs by multiplying the LTA by a factor (multiplier). WQBELs are expressed as Average Monthly Effluent Limitations (AMEL) and Maximum Daily Effluent Limitation (MDEL). The multiplier is a statistically based factor that adjusts the LTA for the averaging periods and exceedance frequencies of the criteria/objectives and the effluent limitations. The value of the multiplier varies depending on the probability basis, the coefficient of variation (CV) of the data set, the number of samples (for AMEL) and whether it is a monthly or daily limit. Table 2 of the SIP provides pre-calculated values for the multipliers based on the value of the CV and the number of samples. Equations to develop the multipliers in place of using values in the tables are provided in Section 1.4, Step 5 of the SIP and will not be repeated here.

$$AMEL_{aquatic\ life} = LTA \times AMEL_{multiplier\ 95}$$

$$MDEL_{aquatic\ life} = LTA \times MDEL_{multiplier\ 99}$$

AMEL multipliers are based on a 95<sup>th</sup> percentile occurrence probability, and the MDEL multipliers are based on the 99<sup>th</sup> percentile occurrence probability. If the number of samples is less than four (4), the default number of samples to be used is four (4).

For copper and selenium, the following values were used to develop the AMEL and MDEL for aquatic life using equations provided in Section 1.4, Step 5 of the SIP (Table 2 of the SIP also provides this data up to two decimals):

No. of Samples Per Month	CV	Multiplier <sub>MDEL 99</sub>	Multiplier <sub>AMEL 95</sub>
For copper			
4	2.96	10.71	3.292
For selenium			
4	0.55	2.899	1.504

Total recoverable copper (dry weather):

$$AMEL_{\text{aquatic life}} = 5.192 \times 3.292 = 17.1 \mu\text{g/L}$$

$$MDEL_{\text{aquatic life}} = 5.192 \times 10.71 = 55.6 \mu\text{g/L}$$

Total recoverable copper (wet weather):

$$AMEL_{\text{aquatic life}} = 1.278 \times 3.292 = 4.2 \mu\text{g/L}$$

$$MDEL_{\text{aquatic life}} = 1.278 \times 10.71 = 13.7 \mu\text{g/L}$$

Total recoverable selenium:

$$AMEL_{\text{aquatic life}} = 2.765 \times 1.504 = 4.16 \mu\text{g/L}$$

$$MDEL_{\text{aquatic life}} = 2.765 \times 2.899 = 8.0 \mu\text{g/L}$$

Calculation of human health AMEL and MDEL:

**Step 5:** For the ECA based on human health, set the AMEL equal to the  $ECA_{\text{human health}}$

$$AMEL_{\text{human health}} = ECA_{\text{human health}}$$

For copper, this is not necessary since the WLAs were based on a TMDL. There is no human health criterion for selenium in the CTR. Therefore, AMELs based on human health criteria for copper and selenium are not appropriate.

**Step 6:** Calculate the MDEL for human health by multiplying the AMEL by the ratio of the  $Multiplier_{\text{MDEL}}$  to the  $Multiplier_{\text{AMEL}}$ . Table 2 of the SIP provides pre-calculated ratios to be used in this calculation based on the CV and the number of samples.

$$MDEL_{\text{human health}} = AMEL_{\text{human health}} \times (Multiplier_{\text{MDEL}} / Multiplier_{\text{AMEL}})$$

This step is not applicable for the parameters addressed in this example.

**Step 7:** Select the lower of the AMEL and MDEL based on aquatic life and human health as the water-quality based effluent limit for the Order.

For copper (wet and dry weather), lead (wet and dry weather), and zinc (wet and dry weather), there are no human health (Consumption of Organism Only) criteria, and WLAs have been established based on the Ballona Creek Metals TMDL; therefore, the established effluent limitations are based on aquatic life criteria used for the Ballona Creek Metals TMDL WLAs. There are no human health criteria for selenium; therefore,

the established effluent limitations are based on the aquatic life criteria as listed in the CTR.

**Final WQBELs:**

Parameters	AMEL	MDEL
Total Recoverable Copper (dry weather)	17	56
Total Recoverable Copper (wet weather)	4.2	14
Total Recoverable Selenium	4.2	8.0

These limitations are expected to be protective of the beneficial uses. Final WQBELs for each are summarized in Table F-11 of this Fact Sheet.

**5. WQBELs Based on Basin Plan Objectives**

The following Basin Plan Objectives, evaluated with respect to effluent monitoring data and Facility operations, are applicable to the discharge:

- a. **Ammonia.** The ammonia water quality objective is calculated based on pH and temperature of the receiving water. Receiving water monitoring data were not available for this Facility. As an alternative, the pH and temperature data of Ballona Creek based on the monitoring data collected by LACDPW at Sawtelle Boulevard from 2012 through 2014, at a location approximately 4.8 miles downstream of the discharge were used. The critical receiving water pH and temperature are as follows:

At 50th percentile: pH = 7.35 and temperature = 16.2°C  
 At 90th percentile: pH = 8.70

Certain cold water fish species are more sensitive to ammonia concentrations. As a result, the equation to calculate the one-hour objective is dependent on whether the receiving water beneficial uses include “COLD” and/or “MIGR”. The receiving water for discharges from the Facility is not designated as “COLD” and/or “MIGR”.

From Table 3-1 of the Basin Plan, using the 90<sup>th</sup> percentile pH value of 8.70:

One-hour Average Objective (for water not designated Cold and/or MIGR)

$$= \frac{0.411}{1+10^{7.204-pH}} + \frac{58.4}{1+10^{pH-7.204}}$$

$$= 2.22 \text{ mg/L ammonia as nitrogen, total (as N)}$$

The Basin Plan ammonia implementation procedure No. 3 (for the 30-day average objective) states that “*Early life stages of fish are presumptively present and must be protected at all times of the year unless the water body is listed in Table 3-5 or unless a site-specific study is conducted, which justifies applying the ELS absent condition or a seasonal ELS present condition.*” Since Ballona Creek is listed on Table 3-5 of the Basin Plan, it is subjected to the 30-day average objective applicable to “ELS Absent” condition.

From Table 3-3 of the Basin Plan, using the 50th percentile pH (7.35) and temperature (16.2°C) values in the formula below:

30-Day Average Objective for “ELS Absent” condition

$$= \left( \frac{0.0577}{1 + 10^{7.688 - pH}} + \frac{2.487}{1 + 10^{pH - 7.688}} \right) \times 1.45 \times 10^{0.028(25 - \text{MAX}(T, 7))}$$

= 4.41 mg/L ammonia as nitrogen, total (as N)

From page 3-4 of the Basin Plan:

4-day Average Objective

= 2.5 times the 30-Day Average Objective  
= 2.5 x 2.22 = 11.03 mg/L ammonia as nitrogen, total (as N)

There were nine effluent ammonia sampling events at EFF-001 from May 2011 through June 2015, with the highest detected value of 0.2 mg/L. None of the ammonia concentrations exceeded the Basin Plan ammonia objectives as calculated above; the discharge did not exhibit reasonable potential for ammonia. Therefore, ammonia effluent limitations at Discharge Point 001 are not included in this Order. Rather, monitoring requirements are prescribed to gather more information on ammonia from discharges of the Facility and the receiving water for future RPA.

- b. **pH.** The pH of inland surface waters shall not be depressed below 6.5 or raised above 8.5 as a result of waste discharge. Ambient pH levels shall not be changed more than 0.5 units from natural conditions as a result of waste discharge. This Order includes effluent and receiving water limitations for pH to ensure compliance with Basin Plan Objectives for pH.
- c. **Bacteria.** Ballona Creek is listed as impaired for bacteria. The *Ballona Creek Bacterial Indicator Densities TMDL in Ballona Creek, Ballona Estuary, and Sepulveda Channel* (Ballona Creek Bacteria TMDL) addresses impairment in these waterbodies. Although there are no WLAs assigned to individual minor NPDES dischargers to Ballona Creek Reach 1, this Order addresses the receiving water bacterial impairment through effluent monitoring and receiving water limitations. The following freshwater water quality objectives designated for Water Contact Recreation (REC-2) applies to the receiving water:

Geometric Mean Limits

Fecal coliform density shall not exceed 2,000/100 ml.

Single Sample Limits

Fecal coliform density shall not exceed 4,000/100 ml.

- d. **Dissolved Oxygen.** The discharge shall not depress the concentration of dissolved oxygen to fall below 5.0 mg/L anytime, and the median dissolved oxygen concentration for any three consecutive months shall not be less than 80 percent of the dissolved oxygen content at saturation. This Order addresses dissolved oxygen through receiving water monitoring and receiving water limitations.
- e. **Turbidity.** Where natural turbidity is between 0 to 50 NTU, increases shall not exceed 20%. Where natural turbidity is greater than 50 NTU, increases shall not exceed 10%. This Order addresses turbidity through effluent monitoring and effluent limitations.
- f. **Temperature.** The Basin Plan lists temperature requirements for the receiving waters and references the Thermal Plan. Based on the requirements of the Thermal Plan and a white paper developed by Regional Water Board staff titled "Temperature and Dissolved Oxygen Impacts on Biota in Tidal Estuaries and

Enclosed Bays in the Los Angeles Region”, a maximum effluent temperature limitation of 86 °F is included in the permit. The white paper evaluated the optimum temperatures for aquatic species routinely available in surface water bodies within the Los Angeles Region including: steelhead, topsmelt, ghost shrimp, brown rock crab, jackknife clam, and blue mussel. This Order addresses the water quality objective for temperature by establishing effluent limitations based on the interpretation of the Thermal Plan and the White Paper.

- g. **Total Suspended Solids.** The Basin Plan requires that, “Waters shall not contain suspended or settleable material in concentrations that cause nuisance or adversely affect beneficial uses.” This narrative objective has been translated into a numeric effluent limit, based on U.S. EPA’s Quality Criteria for Water (commonly known as the “Gold Book”). In the Gold Book, U.S. EPA notes that “In a study downstream from a discharge where inert suspended solids were increased to 80 mg/L, the density of macroinvertebrates decreased by 60 percent...” This indicates that suspended solids concentrations of 80 mg/L in the receiving water resulted in adverse effects to aquatic life. As such, the Regional Water Board implemented an AMEL of 50 mg/L and MDEL of 75 mg/L for the implementation of the narrative water quality objective for solids. These limitations are consistent with the limitations in Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 and are retained as the technology-based effluent limitations.

#### 6. Whole Effluent Toxicity (WET)

Whole effluent toxicity (WET) protects the receiving water quality from the aggregate toxic effect of a mixture of pollutants in the effluent. WET tests measure the degree of response of exposed aquatic test organisms to an effluent. The WET approach allows for protection of the narrative “no toxics in toxic amounts” criterion while implementing numeric criteria for toxicity. There are two types of WET tests: acute and chronic. An acute toxicity test is conducted over a short time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and may measure mortality, reproduction, and growth.

The Basin Plan specifies a narrative objective for toxicity, requiring that all waters be maintained free of toxic substances in concentrations that are lethal to or produce other detrimental responses by aquatic organisms. Detrimental response includes, but is not limited to, decreased growth rate, decreased reproductive success of resident or indicator species, and/or significant alterations in population, community ecology, or receiving water biota. Order No. R4-2010-0180 as amended by R4-2010-0180-A01 contains acute toxicity limitations and monitoring requirements in accordance with the Basin Plan, in which the acute toxicity objective for discharges dictates that the average survival in undiluted effluent for any three consecutive 96-hour static or continuous flow bioassay tests shall be at least 90%, with no single test having less than 70% survival. For the period of November 10, 2010, through June 25, 2015, effluent acute toxicity monitoring results were between 90% and 100% survival for all sample events.

Chronic toxicity is a more stringent requirement than acute toxicity. A chemical at a low concentration can have chronic effects but no acute effects. Because discharge from the Facility may include a number of chemicals, which individually may not be present in toxic concentrations while exhibiting aggregated toxic effects as a whole, this Order prescribes a chronic toxicity effluent limitation and requires chronic toxicity monitoring for the effluent at Discharge Point 001. The whole effluent toxicity testing requirements are based on U.S. EPA’s 2010 Test of Significant Toxicity (TST) statistical testing approach. In 2010, U.S. EPA endorsed the peer-reviewed TST statistical approach in National

Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document (EPA 833-R-10-003, 2010) as an improved statistical tool to evaluate data from U.S. EPA’s toxicity test methods. The TST statistical approach more reliably identifies toxicity than the current no observed effect concentration (NOEC) statistical approach. TST statistical results are also more transparent than the point estimate model approach used for acute toxicity that is not designed to address the question of statistical uncertainty around the modeled toxicity test result in relation to the effect level of concern. The TST statistical approach is the superior statistical approach for addressing statistical uncertainty when used in combination with U.S. EPA’s toxicity test methods and is implemented in federal permits issued by U.S. EPA Region 9.

The TST’s null hypothesis for chronic toxicity is:

$H_0$ : Mean response (In-stream Waste Concentration (IWC) in % effluent)  $\leq$  (0.75 x mean response (Control)).

Results obtained from a single-concentration chronic toxicity test are analyzed using the TST statistical approach and an acceptable level of chronic toxicity is demonstrated by rejecting the null hypothesis and reporting “Pass” or “P”. Chronic toxicity results are expressed as “Pass” or “Fail” and “% Effect. The chronic toxicity IWCs for Discharge Points 001 is 100 percent effluent.

**7. Final WQBELs**

**Table F-11. Summary of Water Quality-based Effluent Limitations – EFF-001**

Parameter	Units	Effluent Limitations			
		Average Monthly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum
pH	standard units	--	--	6.5	8.5
Chronic Toxicity <sup>2</sup>	Pass or Fail, % Effect (for TST Statistical Approach)	Pass <sup>3</sup>	Pass or % Effect < 50	--	--
Temperature	Degrees F	--	--	--	86
Copper, Total Recoverable, Wet Weather <sup>4,6</sup>	µg/L	4.2	14	--	--
	lbs/day <sup>1</sup>	0.00053	0.0018	--	--
Copper, Total Recoverable, Dry Weather <sup>5,6</sup>	µg/L	17	56	--	--
	lbs/day <sup>1</sup>	0.0021	0.0070	--	--
Lead, Total Recoverable, Wet Weather <sup>4,6</sup>	µg/L	30	77	--	--
	lbs/day <sup>1</sup>	0.0038	0.0096	--	--
Lead, Total Recoverable, Dry Weather <sup>5,6</sup>	µg/L	14	36	--	--
	lbs/day <sup>1</sup>	0.0018	0.0045	--	--
Selenium, Total Recoverable	µg/L	4.2	8.0	--	--
	lbs/day <sup>1</sup>	0.00053	0.0010	--	--
Zinc, Total Recoverable, Wet Weather <sup>4,6</sup>	µg/L	32	105	--	--
	lbs/day <sup>1</sup>	0.0040	0.013	--	--
Zinc, Total Recoverable, Dry Weather <sup>5,6</sup>	µg/L	210	690	--	--
	lbs/day <sup>1</sup>	0.026	0.086	--	--

1. Mass loading limitations are based on the flow of the treatment system at Discharge Point 001 (0.015 MGD) and are calculated as follows:  
Flow (MGD) x Concentration (mg/L) x 8.34 (conversion factor) = lbs/day.
2. The median monthly effluent limitation (MMEL) shall be reported as "Pass" or "Fail". The maximum daily effluent limitation (MDEL) shall be reported "Pass" or "Fail" and "% Effect". The MMEL for chronic toxicity shall only apply when there is a discharge more than one day in a calendar month period. During such calendar months, up to three independent toxicity tests are required when one toxicity test results in "Fail".
3. This is an MMEL.
4. Wet weather applies when the flow is equal to or greater than 64 cubic feet per second (cfs) as measured at Stream Gauge No. F38C-R (Sawtelle Boulevard) in Ballona Creek.
5. Dry weather applies when the flow is less than 64 cfs as measured at Stream Gauge No. F38C-R (Sawtelle Boulevard) in Ballona Creek.
6. Limitations derived based on WLAs as included in Resolution No. R13-010.

#### **D. Final Effluent Limitation Considerations**

Effluent limitations for copper, lead, selenium, and zinc in both dry and wet weather are included consistent with Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01, and consistent with the amendments of the Ballona Creek Metals TMDL. In addition, this Order establishes new effluent limitations for sediment based on the Ballona Creek Toxicity TMDL. Effluent limitations for BOD, oil and grease, pH, TSS, settleable solids, temperature, and turbidity from Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01, and consistent with the Basin Plan water quality objectives, are also included. A chronic toxicity effluent limitation (evaluated using the TST statistical approach), which is a more stringent requirement than acute toxicity as it measures the synergistic toxic effects of the chemicals that may be present in the discharge, is included in this Order in lieu of acute toxicity.

Effluent limitations are established based on CTR and SIP procedures for pollutants that exhibited reasonable potential (such as selenium) based on available effluent monitoring data. Refer to Attachment J for a summary of the RPA and associated effluent limitation calculations.

##### **1. Anti-Backsliding Requirements**

Sections 402(o) and 303(d)(4) of the CWA and federal regulations at 40 C.F.R. section 122.44(l) prohibit backsliding in NPDES permits. These anti-backsliding provisions require effluent limitations in a reissued permit to be as stringent as those in the previous permit, with some exceptions where limitations may be relaxed. All effluent limitations in this Order are at least as stringent as the effluent limitations in the previous Order, with the exception of the removal of technology-based effluent limitations for phenol. As discussed below, the relaxations of effluent limitations for phenol are consistent with the anti-backsliding exceptions allowed in the CWA and federal regulations.

The effluent limitations for phenols in Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 were included to be consistent with historical Orders. Since the introduction of these limitations, the Facility has implemented additional BMPs and a new treatment system, and monitoring results for phenols from recent discharges were mostly non-detected, with one detected valued in 2011 at the reporting limit of 30 µg/L (before the installation of the treatment system), which is below the effluent limitation of 1 mg/L, demonstrating the Facility's ability to comply with the effluent limits and that there is no reasonable potential for phenols to exceed applicable limits. Monitoring requirements for phenols are included in this Order, as stated in the MRP. The removal of effluent limitations for phenol that were included in the previous Order are consistent with the

exceptions to the anti-backsliding requirements of the CWA and federal regulations, based on consideration of modifications to the Facility and recent monitoring data.

Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 contained an acute toxicity effluent limitation in accordance with the Basin Plan's narrative objective for toxicity. This Order includes a chronic toxicity effluent limitation which is assessed using the TST statistical approach, and which, under this testing framework, is protective of the Basin Plan's narrative objective for toxicity. The chronic toxicity limitation is more stringent than the acute toxicity limitation. Therefore, consistent with section 402(o)(2)(B) the acute toxicity limitation contained in the previous permit has not been retained in this Order.

Limits for copper, lead, selenium, and zinc included in the previous Order were based on the Ballona Creek Metals TMDL, Resolution No. R2007-015, which was effective in 2008. The TMDL was revised through Resolution No. R13-010, which became effective on October 26, 2015. This Order implements the dry and wet weather effluent limitations for copper, lead, and zinc based on the revised WLAs for these parameters in Resolution No. R13-010. The effluent limitations for selenium will be implemented based on its CTR water quality objectives (as the discharge demonstrated reasonable potential for selenium); and Resolution No. R13-010 does not contain a WLA for selenium. This results in a less stringent effluent limit for selenium. The relaxation of the effluent limit is consistent with CWA section 303(d)(4)(A) which allows a revision of the effluent limitation based on a TMDL WLA when the receiving water has been identified as not meeting applicable water quality standards (i.e., impaired), and when the TMDL WLA has been implemented as part of an overall strategy for achieving attainment of those water quality standards.

## **2. Antidegradation Policies**

40 C.F.R. section 131.12 requires that the state water quality standards include an anti-degradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution No. 68-16. Resolution No. 68-16 incorporates the federal antidegradation policy where the federal policy applies under federal law. Resolution No. 68-16 requires that existing water quality be maintained unless degradation is justified based on specific findings. The Regional Water Board's Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies. Compliance with these requirements will result in the use of best practicable treatment or control of the discharge.

The permitted discharge is not a new discharge. This Order does not provide for an increase in the permitted design flow or allow for a reduction in the level of treatment. This Order includes wash water from the pool deck as a source of wastewater discharged from the Facility. However, the wash water is routed to the treatment system for treatment, and is subjected to applicable effluent limitations at the final discharge point; in addition, it does not result in any increase of permitted waste flow from the Facility to the receiving water. The final limitations in this Order, which include concentration based and mass based limitations, hold the discharger to performance levels that will not adversely impact the beneficial uses of the Ballona Creek or degrade water quality. The inclusion of the effluent limitations and prohibitions in the NPDES permit, which ensure that any discharge would not result in the lowering of water quality, support the conclusion that no degradation will arise as a result of reissuing this Order.

Removal of the effluent limitations for phenols will not result in the degradation of high quality waters, because sampling conducted after improvements in the BMPs and installation of the treatment system at the Facility consistently resulted in non-detect of

phenol (with one detected value that did not exceed the applicable water quality standard for phenol before implementations of BMPs and installation of the treatment system).

The effluent limitations in this Order hold the Discharger to performance levels that will not cause or contribute to water quality impairments or water quality degradation. The effluent limitations, receiving water limitations, and monitoring requirements ensure that excursions in excess of the water quality limits that are designed to protect beneficial uses will be apparent and addressed immediately. Further, compliance with these requirements will result in the use of best practicable treatment or control of the discharge. Therefore, the permitted discharge is consistent with the state's antidegradation policy.

### 3. Mass-based Effluent Limitations

Generally, mass-based effluent limitations ensure that proper treatment, and not dilution, is employed to comply with the final effluent concentration limitations. 40 C.F.R. 122.45(f)(1) requires that all permit limitations, standards or prohibitions be expressed in terms of mass units except under the following conditions: (1) for pH, temperature, radiation or other pollutants that cannot appropriately be expressed by mass limitations; (2) when applicable standards or limitations are expressed in terms of other units of measure; or (3) if in establishing technology-based permit limitation on a case-by-case basis, limitation based on mass are infeasible because the mass or pollutant cannot be related to a measure of production.

Mass-based effluent limitations are established using the following formula:

$$\text{Mass (lbs/day)} = \text{flow rate (MGD)} \times 8.34 \times \text{effluent limitation (mg/L)}$$

where: Mass = mass limitation for a pollutant (lbs/day)

Effluent limitation = concentration limit for a pollutant (mg/L)

Flow rate = discharge flow rate (MGD)

### 4. Stringency of Requirements for Individual Pollutants

This Order contains both technology-based and water quality-based effluent limitations for individual pollutants. The technology-based effluent limitations consist of restrictions on BOD, TSS, oil and grease, settleable solids, and turbidity. Restrictions on these pollutants are discussed in section IV.B of the Fact Sheet. This Order's technology-based pollutant restrictions implement the minimum, applicable federal technology-based requirements.

Water quality-based effluent limitations have been derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable federal water quality standards. To the extent that toxic pollutant water quality-based effluent limitations were derived from the CTR, the CTR is the applicable standard pursuant to 40 C.F.R. section 131.38. The procedures for calculating the individual water quality-based effluent limitations for priority pollutants are based on the CTR implemented by the SIP, which was approved by U.S. EPA on May 18, 2000. All beneficial uses and water quality objectives contained in the Basin Plan were approved under state law and submitted to and approved by U.S. EPA prior to May 30, 2000. Any water quality objectives and beneficial uses submitted to U.S. EPA prior to May 30, 2000, but not approved by U.S. EPA before that date, are nonetheless "applicable water quality standards for purposes of the CWA" pursuant to 40 C.F.R. section 131.21(c)(1). Collectively, this Order's

restrictions on individual pollutants are no more stringent than required to implement the requirements of the CWA.

**5. Summary of Final Effluent Limitations**

**Table F-12. Summary of Final Effluent Limitations at Discharge Point 001**

Parameter	Units	Effluent Limitations				Performance Goals <sup>7</sup>	Basis <sup>1</sup>
		Average Monthly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum		
<b>Conventional Pollutants</b>							
Biochemical Oxygen Demand (BOD) (5-day @ 20 °C)	mg/L	20	30	--	--	--	E, BPJ
	lbs/day <sup>2</sup>	2.5	3.8	--	--		
Oil and Grease	mg/L	10	15	--	--	--	E, BPJ
	lbs/day <sup>2</sup>	1.3	1.9	--	--		
pH	std units	--	--	6.5	8.5	--	E, BP
Total Suspended Solids (TSS) <sup>8</sup>	mg/L	50	75	--	--	--	E, BPJ
	lbs/day <sup>2</sup>	6.3	9.4	--	--		
<b>Non-Conventional Pollutants</b>							
Chronic Toxicity <sup>3</sup>	Pass or Fail, % Effect (TST Statistical Approach )	Pass <sup>4</sup>	Pass or % Effect < 50	--	--	--	BP
Settleable Solids	mL/L	0.1	0.3	--	--	--	E, BPJ
Temperature	Degrees F	--	--	--	86	--	E, BP, WP, TP
Turbidity	NTU	50	75	--	--	--	E, BPJ
<b>Priority Pollutants</b>							
Cadmium, Total Recoverable <sup>8,11</sup>	µg/L	--	--	--	--	2.3	TMDL
	lbs/day <sup>2</sup>	--	--	--	--	0.00029	
Copper, Total Recoverable, Wet Weather <sup>5,8</sup>	µg/L	4.2	14	--	--	--	TMDL
	lbs/day <sup>2</sup>	0.00053	0.0018	--	--		
Copper, Total Recoverable, Dry Weather <sup>6,8</sup>	µg/L	17	56	--	--	--	TMDL
	lbs/day <sup>2</sup>	0.0021	0.0070	--	--		
Lead, Total Recoverable, Wet Weather <sup>5,8</sup>	µg/L	30	77	--	--	--	TMDL
	lbs/day <sup>2</sup>	0.0038	0.0096	--	--		
Lead, Total Recoverable, Dry Weather <sup>6,8</sup>	µg/L	14	36	--	--	--	TMDL
	lbs/day <sup>2</sup>	0.0018	0.0045	--	--		
Selenium, Total Recoverable	µg/L	4.2	8.0	--	--	--	CTR, SIP
	lbs/day <sup>2</sup>	0.00053	0.0010	--	--		
Silver, Total Recoverable <sup>8,11</sup>	µg/L	--	--	--	--	2.7	TMDL
	lbs/day <sup>2</sup>	--	--	--	--	0.00034	

Parameter	Units	Effluent Limitations				Performance Goals <sup>7</sup>	Basis <sup>1</sup>
		Average Monthly	Maximum Daily	Instantaneous Minimum	Instantaneous Maximum		
Zinc, Total Recoverable, Wet Weather <sup>5,8</sup>	µg/L	32	105	--	--	--	TMDL
	lbs/day <sup>2</sup>	0.0040	0.013	--	--		
Zinc, Total Recoverable, Dry Weather <sup>6,8</sup>	µg/L	210	690	--	--	--	TMDL
	lbs/day <sup>2</sup>	0.026	0.086	--	--		
4,4'-DDT <sup>8,9,11</sup>	µg/L	--	--	--	--	0.00059	TMDL
	lbs/day <sup>2</sup>	--	--	--	--	7.4e-8	
4,4'-DDE <sup>8,9,11</sup>	µg/L	--	--	--	--	0.00059	TMDL
	lbs/day <sup>2</sup>	--	--	--	--	7.4e-8	
4,4'-DDD <sup>8,9,11</sup>	µg/L	--	--	--	--	0.00084	TMDL
	lbs/day <sup>2</sup>	--	--	--	--	1.1e-7	
Chlordane <sup>8,9,11</sup>	µg/L	--	--	--	--	0.00059	TMDL
	lbs/day <sup>2</sup>	--	--	--	--	7.4e-8	
PCBs (sum) <sup>8,9,10,11</sup>	µg/L	--	--	--	--	0.00017	TMDL
	lbs/day <sup>2</sup>	--	--	--	--	2.1e-8	

- <sup>1</sup> E = Existing Order; BPJ = Best Professional Judgment; BP = Basin Plan; WP = White Paper; TMDL = Total Maximum Daily Load; CTR = California Toxic Rule; TP = Thermal Plan; SIP = State Implementation Policy.
- <sup>2</sup> Mass loading limitations are based on the maximum observed flow of the storm water treatment plant at Discharge Point 001 (0.015 MGD) and are calculated as follows: Flow (MGD) x Concentration (mg/L) x 8.34 (conversion factor) = lbs/day.
- <sup>3</sup> The median monthly effluent limitation (MMEL) shall be reported as "Pass" or "Fail". The maximum daily effluent limitation (MDEL) shall be reported "Pass" or "Fail" and "% Effect". The MMEL for chronic toxicity shall only apply when there is a discharge more than one day in a calendar month period. During such calendar months, up to three independent toxicity tests are required when one toxicity test results in "Fail".
- <sup>4</sup> This is an MMEL.
- <sup>5</sup> Wet weather is assumed for any discharge that occurs when the flow is equal to or greater than 64 cubic feet per second (cfs) as measured at Stream Gauge No F38C-R in Ballona Creek.
- <sup>6</sup> Dry weather is assumed for any discharge that occurs when the flow is less than 64 cfs as measured at Stream Gauge No F38C-R in Ballona Creek.
- <sup>7</sup> Performance goals are intended to ensure that effluent concentrations and mass discharges do not exceed levels currently achieved by the permitted Facility. They act as triggers to determine when treatment technologies fail to produce effluent concentrations consistent with these performance goals, and **are not** enforceable effluent limitations.
- <sup>8</sup> During each reporting period, if effluent monitoring results exceed **both** a TSS effluent limit and a CTR or TMDL-based effluent limit or performance goal for cadmium, copper, lead, silver, zinc, chlordane, DDTs (4,4'-DDT, 4,4'-DDE, and 4,4'-DDD), or total PCBs, implementation of the effluent sediment monitoring program as included in section IV.B of this Order is required for that priority pollutant. Sediment monitoring of the effluent shall begin during the first discharge event following the effluent exceedance. An effluent sediment monitoring result at or below the sediment allocations in Table 5 of this Order demonstrates attainment with the applicable sediment allocation and additional sediment monitoring of the effluent is not required. A sediment monitoring result that exceeds the sediment allocation requires additional sediment monitoring of the effluent during discharge but not more frequently than once per year until the concentration for sediment monitoring results is at or below the sediment allocation.
- <sup>9</sup> Samples analyzed must be unfiltered samples.
- <sup>10</sup> Total PCBs (polychlorinated biphenyls) means the sum of chlorinated biphenyls whose analytical characteristics resembles those of Aroclor-1016, Aroclor-1221, Aroclor-1232, Aroclor-1242, Aroclor-1248, Aroclor-1254, and Aroclor-1260.
- <sup>11</sup> Performance goals are based on the CTR human health or aquatic life criteria for these parameters; CWA section 303(d) List classified Ballona Creek and Ballona Creek Estuary as impaired for these pollutants.

**Table F-13. Summary of Final Effluent Sediment Limitations at Discharge Point 001<sup>4</sup>**

Parameter	Units	Effluent Limitation (Resolution No. R13-010)	Basis <sup>1</sup>
Cadmium	mg/kg	1.2	TMDL
Copper	mg/kg	34	TMDL
Lead	mg/kg	46.7	TMDL
Silver	mg/kg	1.0	TMDL
Zinc	mg/kg	150	TMDL
Chlordane	µg/kg	1.3	TMDL
DDTs <sup>2</sup>	µg/kg	1.9	TMDL
PCBs <sup>3</sup>	µg/kg	3.2	TMDL

1. TMDL = Ballona Creek Estuary Toxic Pollutants TMDL, Resolution No. R13-010.
2. The State Water Resources Control Board *Water Quality Control Plan for Enclosed Bays and Estuaries—Part 1 Sediment Quality*. August 25, 2009 (Sediment Quality Plan), listed chemical analytes needed to characterize sediment contamination exposure and effect. According to Attachment A of the Sediment Quality Plan, DDTs shall mean the sum of o,p'-DDE, o,p'-DDD, o,p'-DDT, p,p'-DDD, p,p'-DDE. and p,p'-DDT.
3. According to Attachment A of the Sediment Quality Plan, total PCBs shall mean the sum of the following PCB congeners: 2,4-dichlorobiphenyl, 2,2',5-trichloro biphenyl, 2,4,4'-trichlorobiphenyl, 2,2',3,5'-tetrachlorobiphenyl, 2,2',5,5'-tetrachlorobiphenyl, 2,3',4,4'-tetrachlorobiphenyl, 2,2',4,5,5'-pentachlorobiphenyl, 2,3,3',4,4'-pentachlorobiphenyl, 2,3',4',4',5-pentachlorobiphenyl, 2,2',3,3',4,4'-hexachlorobiphenyl, 2,2',4,4',5,5'-hexachlorobiphenyl, 2,2',3,3',4,4',5-heptachlorobiphenyl, 2,2',3,4,4',5,5'-heptachlorobiphenyl, 2,2',3,4',5,5',6-heptachlorobiphenyl, 2,2',3,3',4,4',5,6-octachlorobiphenyl, 2,2',3,3',4,4',5,5',6-nonachlorobiphenyl, decachlorobiphenyl.
4. Attainment with these final effluent sediment limitations shall be demonstrated in accordance with Footnote 8 to Table F-12 of this Order.

**E. Interim Effluent Limitations – Not Applicable**

**F. Land Discharge Specifications – Not Applicable**

**G. Recycling Specifications – Not Applicable**

**V. RATIONALE FOR RECEIVING WATER LIMITATIONS**

The receiving water limitations in this Order are based upon the water quality objectives contained in the Basin Plan. As such, they are a required part of the Order.

**A. Surface Water**

The Basin Plan contains numeric and narrative water quality objectives applicable to all surface waters within the Los Angeles Region. Water quality objectives include an objective to maintain the high quality waters pursuant to federal regulations (40 C.F.R. section 131.12) and State Water Board Resolution No. 68-16. Receiving water limitations in this Order are included to ensure protection of the beneficial uses of the receiving water and are based on the water quality objectives contained in the Basin Plan. If there is reasonable potential (RP) or a U.S. EPA-approved TMDL WLA, then WQBELs are included in this Order to ensure protection of the water quality standards.

**B. Groundwater – Not Applicable**

## VI. RATIONALE FOR PROVISIONS

### A. Standard Provisions

Standard Provisions, which apply to all NPDES permits in accordance with 40 C.F.R. section 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 C.F.R. section 122.42, are provided in Attachment D. The Discharger must comply with all standard provisions and with those additional conditions that are applicable under section 122.42.

Sections 122.41(a)(1) and (b) through (n) of 40 C.F.R. establish conditions that apply to all state-issued NPDES permits. These conditions must be incorporated into the permits either expressly or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. Section 123.25(a)(12) of 40 C.F.R. allows the state to omit or modify conditions to impose more stringent requirements. In accordance with 40 C.F.R. section 123.25, this Order omits federal conditions that address enforcement authority specified in 40 C.F.R. sections 122.41(j)(5) and (k)(2) because the enforcement authority under the Water Code is more stringent. In lieu of these conditions, this Order incorporates by reference Water Code section 13387(e).

### B. Special Provisions

#### 1. Reopener Provisions

These provisions are based on 40 C.F.R. part 123 of and Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01. The Regional Water Board may reopen the permit to modify permit conditions and requirements. Causes for modifications include the promulgation of new federal regulations, modification in toxicity requirements, or adoption of new regulations by the State Water Board or Regional Water Board, including revisions to the Basin Plan or revisions to the TMDLs associated with Ballona Creek Watershed.

#### 2. Special Studies and Additional Monitoring Requirements

- a. **Initial Investigation Toxicity Reduction Evaluation (TRE) Workplan.** This provision is based on section 4 of the SIP, Toxicity Control Provisions, which establishes minimum toxicity control requirements for implementing the narrative toxicity objective for aquatic life protection established in the basin plans of the State of California.

#### 3. Best Management Practices and Pollution Prevention

- a. **Storm Water Pollution Prevention Plan (SWPPP).** This Order includes a new requirement to develop and update, as necessary, a SWPPP. The SWPPP will outline site-specific management processes for minimizing storm water runoff contamination and for preventing contaminated storm water runoff from being discharged directly into the receiving water. At a minimum, the management practices should ensure that raw materials and chemicals do not come into contact with storm water. SWPPP requirements are included as Attachment G, based on 40 CFR 122.44(k).
- b. **Best Management Practices Plan (BMPP).** This Order requires the Discharger to develop and implement a BMPP. The BMPP may be included as a component of the SWPPP. The purpose of the BMPP is to establish site-specific procedures that ensure proper operation and maintenance of equipment, to ensure that unauthorized non-storm water discharges (i.e., spills) do not occur at the Facility. The BMPP shall incorporate the requirements contained in Attachment G and shall

address Discharge Point 001 as well as the site in general. Attachment G requires a discussion on the effectiveness of each BMP to reduce or prevent pollutants in storm water discharges and authorized non-storm water discharges.

**4. Construction, Operation, and Maintenance Specifications**

This provision is based on the requirements of 40 C.F.R. section 122.41(e) and Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01.

**5. Other Special Provisions – Not Applicable**

**6. Compliance Schedules – Not Applicable**

**VII. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS**

CWA section 308 and 40 C.F.R. sections 122.41(h), (j)-(l), 122.44(i), and 122.48 require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Regional Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. The Monitoring and Reporting Program (MRP), Attachment E of this Order establishes monitoring, reporting, and recordkeeping requirements that implement federal and state requirements. The following provides the rationale for the monitoring and reporting requirements contained in the MRP for this Facility.

**A. Influent Monitoring – Not Applicable**

**B. Effluent Monitoring**

Effluent monitoring for pollutants expected to be present in the discharge will be required at Monitoring Location EFF-001 as prescribed in Table E-2 in the MRP. To demonstrate compliance with established effluent limitations, the Order includes monitoring requirements of at least once per quarter for parameters with effluent limitations. Monitoring requirements of once per quarter are established for parameters for which effluent limitations have been established and WLAs have been prescribed in a TMDL. Monitoring for additional pollutants is required based on considerations of pollutants commonly associated with similar operations, and is consistent with the monitoring requirements included in the MRP of Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01. For parameters that were detected in the monitoring events during the term of Order No. R4-2010-0180 as amended by Order No. R4-2010-0180-A01 and were not associated with any effluent limitations, monitoring frequencies of at least once per year are prescribed. This Order did not retain monitoring requirements as prescribed in the previous Orders for sulfides, methyl tertiary butyl ether (MTBE), and acute toxicity, as these pollutants no longer possess effluent limitations, were undetected in the effluent monitoring data during the term of the prior Order, or are replaced by a more stringent and comprehensive method (with associated monitoring requirements) to assess their individual effects to the receiving water quality. (A monitoring requirement of once per year for chronic toxicity using the TST statistical approach for analysis is included in lieu of the acute toxicity monitoring requirements).

The SIP states that the Regional Water Board will require periodic monitoring for pollutants for which criteria or objectives apply and for which no effluent limitations have been established. This Order requires the Discharger to conduct annual monitoring for the remaining CTR priority pollutants at Discharge Point 001. The Regional Water Board will use the additional data to conduct an RPA and determine if additional WQBELs are required. The Regional Water Board may reopen the permit to incorporate additional effluent limitations and requirements, if necessary.

### **C. Effluent Sediment Monitoring**

The Ballona Creek Estuary Toxic Pollutants TMDL assigned concentration based WLAs for sediments with respect to cadmium, copper, lead, silver, zinc, chlordane, DDTs, and PCBs for minor NPDES permittees that discharge to Ballona Creek Estuary or its tributaries. This Order implements these applicable WLAs for effluent sediment. Effluent at this Facility is primarily composed of irrigation water, storm water runoff, and groundwater that have been effectively treated to remove sediments prior to discharge. When the amount of TSS present in the effluent are within its limits established in this Order, it may be infeasible for the Discharger to collect an adequate amount of effluent water sample to obtain enough sediment to conduct sediment analyses. Therefore, as an alternative to monitoring the effluent sediment for the Ballona Creek Estuary Toxics Pollutants TMDL parameters, the Discharger may demonstrate compliance with the sediment WLAs if effluent water concentrations of TSS or TMDL parameters are within their respective effluent limitations or performance goals as included in Table 4 of this Order. If sediment monitoring is triggered by an exceedance of both TSS and the TMDL parameters, this order requires the Discharger to perform effluent sediment monitoring in accordance with Table E-3 in the MRP of this Order to demonstrate compliance with the sediment objectives as prescribed in the Ballona Creek Estuary Toxic Pollutants TMDL. If effluent sediment monitoring is not triggered by an exceedance, effluent sediment monitoring must be conducted at least once during the permit term.

### **D. Whole Effluent Toxicity Testing Requirements**

Whole effluent toxicity (WET) protects the receiving water quality from the aggregate toxic effect of a mixture of pollutants in the effluent. An acute toxicity test is conducted over a short time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and may measure mortality, reproduction, and growth. A chemical at a low concentration can have chronic effects but no acute effects. Chronic toxicity is a more stringent requirement than acute toxicity. For this Order, chronic toxicity monitoring in the discharge is required. The chronic toxicity testing requirements are based on U.S. EPA's 2010 TST statistical approach.

### **E. Receiving Water Monitoring**

#### **1. Surface Water**

Monitoring requirements are included in the MRP (Attachment E) to determine compliance with the receiving water limitations established in Section VII.A (Receiving Water Limitations) of this Order.

The Discharger is required to report the maximum daily flow in the Ballona Creek, at the Los Angeles County Department of Public Works' Sawtelle Gauge Station at Sawtelle Boulevard (Sawtelle gauging station F38C-R). This station is designated as RSW-001 in this Order. The stream flow data can be obtained by contacting LACDPW at (626)458-5100. This data shall be used to determine wet weather and dry weather conditions for compliance with the effluent limitations set forth in this Order.

Monitoring requirements at the downstream receiving water monitoring location RSW-002 are included for this Order. The SIP recommends monitoring of the upstream receiving water for the CTR priority pollutants, including TCDD equivalents, to determine reasonable potential. However, as the point of discharge is at a storm drain that, together with a network of underground storm drains, discharges close to the origin of Ballona Creek Reach 1 flood control channel, upstream receiving water monitoring is not feasible for this Facility. Therefore, this Order requires the Discharger to conduct receiving water monitoring of the CTR priority pollutants, including TCDD equivalents, at a downstream receiving water monitoring location RSW-002. Additionally, the Discharger must analyze

pH, temperature, hardness, dissolved oxygen, and ammonia of the receiving water at the same time as the samples are collected for priority pollutants analyses. The Discharger is required to perform downstream receiving monitoring at RSW-002 at least once per permit term.

**2. Groundwater – Not Applicable**

**F. Other Monitoring Requirements**

**1. Storm Water Monitoring**

The discharge is comprised of treated irrigation water, groundwater, and storm water runoff. As such, the Discharger is required to conduct visual observations of all storm water discharges in the vicinity of the discharge to observe the presence of floating and suspended materials, oil and grease, discoloration, turbidity, and odor.

**VIII. PUBLIC PARTICIPATION**

The Regional Water Board has considered the issuance of waste discharge requirements (WDRs) that will serve as a National Pollutant Discharge Elimination System (NPDES) permit for the Donald T. Sterling Corporation, Sterling Ambassador Towers. As a step in the WDR adoption process, the Regional Water Board staff developed tentative WDRs. The Regional Water Board encouraged public participation in the WDR adoption process

**A. Notification of Interested Parties**

The Regional Water Board notified the Discharger and interested agencies and persons of its intent to prescribe WDRs for the discharge and provided an opportunity to submit written comments and recommendations. Notification was provided to all interested parties through email.

The public had access to the agenda and any changes in dates and locations through the Regional Water Board's website at:

<http://www.waterboards.ca.gov/losangeles>

**B. Written Comments**

Interested persons were invited to submit written comments concerning the tentative WDRs as provided through the notification process. Comments were required to be submitted either in person or by mail to the Executive Office at the Regional Water Board at 320 West 4<sup>th</sup> Street, Suite 200, Los Angeles, CA 90013, or by email to [losangeles@waterboards.ca.gov](mailto:losangeles@waterboards.ca.gov) with a copy to [Ching-Yin.To@waterboards.ca.gov](mailto:Ching-Yin.To@waterboards.ca.gov).

To be fully responded to by staff and considered by the Regional Water Board, written comments were due at the Regional Water Board office by 5:00 p.m. on December 21, 2015.

**C. Public Hearing**

The Regional Water Board held a public hearing on the tentative WDRs during its regular Board meeting on the following date and time and at the following location:

Date: February 11, 2016

Time: 9:00 a.m.

Location: Metropolitan Water District of Southern California  
700 North Alameda Street  
Los Angeles, California

Interested persons were invited to attend. At the public hearing, the Regional Water Board will hear testimony, if any, pertinent to the discharge, WDRs, and permit. Oral testimony was heard; however, for accuracy of the record, important testimony was requested to be in writing.

**D. Reconsideration of Waste Discharge Requirements**

Any aggrieved person may petition the State Water Board to review the decision of the Regional Water Board regarding the final WDRs. The petition must be received by the State Water Board at the following address within 30 calendar days of the Regional Water Board's action:

State Water Resources Control Board  
Office of Chief Counsel  
P.O. Box 100, 1001 I Street  
Sacramento, CA 95812-0100

For instructions on how to file a petition for review, see

[http://www.waterboards.ca.gov/public\\_notices/petitions/water\\_quality/wqpetition\\_instr.shtml](http://www.waterboards.ca.gov/public_notices/petitions/water_quality/wqpetition_instr.shtml)

**E. Information and Copying**

The Report of Waste Discharge (ROWD), tentative WDRs, comments received, and other supporting documents are on file and may be inspected at the Regional Water Board's office at any time between 8:30 a.m. and 4:45 p.m., Monday through Friday. Viewing and copying of documents may be arranged through the Regional Water Board by calling (213) 576 – 6600.

**F. Register of Interested Persons**

Any person interested in being placed on the mailing list for information regarding the WDRs and NPDES permit should contact the Regional Water Board, reference this Facility, and provide a name, mailing address, email address, and phone number.

**G. Additional Information**

Requests for additional information or questions regarding this order should be directed to Ching-Yin To at [Ching-Yin.To@waterboards.ca.gov](mailto:Ching-Yin.To@waterboards.ca.gov) or at (213) 576-6696.

## **ATTACHMENT G – STORM WATER POLLUTION PREVENTION PLAN REQUIREMENTS**

### **I. IMPLEMENTATION SCHEDULE**

A storm water pollution prevention plan (SWPPP) shall be developed and submitted to the Regional Water Board within 90 days following the adoption of this Order. The SWPPP shall be implemented for each facility covered by this Permit within 10 days of approval from the Regional Water Board, or 6-months from the date of the submittal of the SWPPP to the Regional Water Board (whichever comes first).

### **II. OBJECTIVES**

The SWPPP has two major objectives: (a) to identify and evaluate sources of pollutants associated with industrial activities that may affect the quality of storm water discharges and authorized non-storm water discharges from the facility; and (b) to identify and implement site-specific best management practices (BMPs) to reduce or prevent pollutants associated with industrial activities in storm water discharges and authorized non-storm water discharges. BMPs may include a variety of pollution prevention measures or other low-cost and pollution control measures. They are generally categorized as non-structural BMPs (activity schedules, prohibitions of practices, maintenance procedures, and other low-cost measures) and as structural BMPs (treatment measures, run-off controls, overhead coverage.) To achieve these objectives, facility operators should consider the five phase process for SWPPP development and implementation as shown in Table A.

The SWPPP requirements are designed to be sufficiently flexible to meet the needs of various facilities. SWPPP requirements that are not applicable to a facility should not be included in the SWPPP.

A facility's SWPPP is a written document that shall contain a compliance activity schedule, a description of industrial activities and pollutant sources, descriptions of BMPs, drawings, maps, and relevant copies or references of parts of other plans. The SWPPP shall be revised whenever appropriate and shall be readily available for review by facility employees or Regional Water Board inspectors.

### **III. PLANNING AND ORGANIZATION**

#### **A. Pollution Prevention Team**

The SWPPP shall identify a specific individual or individuals and their positions within the facility organization as members of a storm water pollution prevention team responsible for developing the SWPPP, assisting the facility manager in SWPPP implementation and revision, and conducting all monitoring program activities required in Attachment E of this Permit. The SWPPP shall clearly identify the Permit related responsibilities, duties, and activities of each team member. For small facilities, storm water pollution prevention teams may consist of one individual where appropriate.

#### **B. Review Other Requirements and Existing Facility Plans**

The SWPPP may incorporate or reference the appropriate elements of other regulatory requirements. Facility operators should review all local, state, and federal requirements that impact, complement, or are consistent with the requirements of this General permit. Facility operators should identify any existing facility plans that contain storm water pollutant control measures or relate to the requirements of this Permit. As examples, facility operators whose facilities are subject to Federal Spill Prevention Control and Countermeasures' requirements

should already have instituted a plan to control spills of certain hazardous materials. Similarly, facility operators whose facilities are subject to air quality related permits and regulations may already have evaluated industrial activities that generate dust or particulates.

#### IV. SITE MAP

The SWPPP shall include a site map. The site map shall be provided on an 8-½ x 11 inch or larger sheet and include notes, legends, and other data as appropriate to ensure that the site map is clear and understandable. If necessary, facility operators may provide the required information on multiple site maps.

**TABLE A**  
**FIVE PHASES FOR DEVELOPING AND IMPLEMENTING INDUSTRIAL**  
**STORM WATER POLLUTION PREVENTION PLANS**

<b>PLANNING AND ORGANIZATION</b> Form Pollution Prevention Team Review other plans
<b>ASSESSMENT PHASE</b> Develop a site map Identify potential pollutant sources Inventory of materials and chemicals List significant spills and leaks Identify non-storm water discharges Assess pollutant risks
<b>BEST MANAGEMENT PRACTICES IDENTIFICATION PHASE</b> Non-structural BMPs Structural BMPs Select activity and site-specific BMPs
<b>IMPLEMENTATION PHASE</b> Train employees Implement BMPs Conduct recordkeeping and reporting
<b>EVALUATION / MONITORING</b> Conduct annual site evaluation Review monitoring information Evaluate BMPs Review and revise SWPPP

The following information shall be included on the site map:

- A. The facility boundaries; the outline of all storm water drainage areas within the facility boundaries; portions of the drainage area impacted by run-on from surrounding areas; and direction of flow of each drainage area, on-site surface water bodies, and areas of soil erosion. The map shall also identify nearby water bodies (such as rivers, lakes, and ponds) and municipal storm drain inlets where the facility's storm water discharges and authorized non-storm water discharges may be received.
- B. The location of the storm water collection and conveyance system, associated points of discharge, and direction of flow. Include any structural control measures that affect storm water discharges, authorized non-storm water discharges, and run-on. Examples of structural control measures are catch basins, berms, detention ponds, secondary containment, oil/water separators, diversion barriers, etc.
- C. An outline of all impervious areas of the facility, including paved areas, buildings, covered storage areas, or other roofed structures.
- D. Locations where materials are directly exposed to precipitation and the locations where significant spills or leaks identified in section VI.A.4 below have occurred.
- E. Areas of industrial activity. This shall include the locations of all storage areas and storage tanks, shipping and receiving areas, fueling areas, vehicle and equipment storage/maintenance areas, material handling and processing areas, waste treatment and disposal areas, dust or particulate generating areas, cleaning and rinsing areas, and other areas of industrial activity which are potential pollutant sources.

## V. LIST OF SIGNIFICANT MATERIALS

The SWPPP shall include a list of significant materials handled and stored at the site. For each material on the list, describe the locations where the material is being stored, received, shipped, and handled, as well as the typical quantities and frequency. Materials shall include raw materials, intermediate products, final or finished products, recycled materials, and waste or disposed materials.

## VI. DESCRIPTION OF POTENTIAL POLLUTANT SOURCES

- A. The SWPPP shall include a narrative description of the facility's industrial activities, as identified in section IV.E above, associated potential pollutant sources, and potential pollutants that could be discharged in storm water discharges or authorized non-storm water discharges. At a minimum, the following items related to a facility's industrial activities shall be considered:
  - 1. **Industrial Processes.** Describe each industrial process, the type, characteristics, and quantity of significant materials used in or resulting from the process, and a description of the manufacturing, cleaning, rinsing, recycling, disposal, or other activities related to the process. Where applicable, areas protected by containment structures and the corresponding containment capacity shall be described.
  - 2. **Material Handling and Storage Areas.** Describe each handling and storage area, type, characteristics, and quantity of significant materials handled or stored, description of the shipping, receiving, and loading procedures, and the spill or leak prevention and response procedures. Where applicable, areas protected by containment structures and the corresponding containment capacity shall be described.
  - 3. **Dust and Particulate Generating Activities.** Describe all industrial activities that generate dust or particulates that may be deposited within the facility's boundaries and

identify their discharge locations; the characteristics of dust and particulate pollutants; the approximate quantity of dust and particulate pollutants that may be deposited within the facility boundaries; and a description of the primary areas of the facility where dust and particulate pollutants would settle.

4. **Significant Spills and Leaks.** Describe materials that have spilled or leaked in significant quantities in storm water discharges or non-storm water discharges since April 17, 1994. Include toxic chemicals (listed in 40 CFR, part 302) that have been discharged to storm water as reported on U.S. Environmental Protection Agency (U.S. EPA) Form R, and oil and hazardous substances in excess of reportable quantities (see 40 Code of Federal Regulations [CFR], parts 110, 117, and 302).

The description shall include the type, characteristics, and approximate quantity of the material spilled or leaked, the cleanup or remedial actions that have occurred or are planned, the approximate remaining quantity of materials that may be exposed to storm water or non-storm water discharges, and the preventative measures taken to ensure spill or leaks do not reoccur. Such list shall be updated as appropriate during the term of this Permit.

5. **Non-Storm Water Discharges.** Facility operators shall investigate the facility to identify all non-storm water discharges and their sources. As part of this investigation, all drains (inlets and outlets) shall be evaluated to identify whether they connect to the storm drain system.

All non-storm water discharges shall be described. This shall include the source, quantity, frequency, and characteristics of the non-storm water discharges and associated drainage area.

Non-storm water discharges that contain significant quantities of pollutants or that do not meet the conditions provided in Special Conditions D of the storm water general permit are prohibited by this Permit (Examples of prohibited non-storm water discharges are contact and non-contact cooling water, rinse water, wash water, etc.). Non-storm water discharges that meet the conditions provided in Special Condition D of the general storm water permit are authorized by this Permit. The SWPPP must include BMPs to prevent or reduce contact of non-storm water discharges with significant materials or equipment.

6. **Soil Erosion.** Describe the facility locations where soil erosion may occur as a result of industrial activity, storm water discharges associated with industrial activity, or authorized non-storm water discharges.

- B. The SWPPP shall include a summary of all areas of industrial activities, potential pollutant sources, and potential pollutants. This information should be summarized similar to Table B. The last column of Table B, "Control Practices", should be completed in accordance with section VIII. below.

## VII. ASSESSMENT OF POTENTIAL POLLUTANT SOURCES

- A. The SWPPP shall include a narrative assessment of all industrial activities and potential pollutant sources as described in section VI above to determine:
  1. Which areas of the facility are likely sources of pollutants in storm water discharges and authorized non-storm water discharges, and
  2. Which pollutants are likely to be present in storm water discharges and authorized non-storm water discharges. Facility operators shall consider and evaluate various factors when performing this assessment such as current storm water BMPs; quantities of

significant materials handled, produced, stored, or disposed of; likelihood of exposure to storm water or authorized non-storm water discharges; history of spill or leaks; and run-on from outside sources.

- B. Facility operators shall summarize the areas of the facility that are likely sources of pollutants and the corresponding pollutants that are likely to be present in storm water discharges and authorized non-storm water discharges.

Facility operators are required to develop and implement additional BMPs as appropriate and necessary to prevent or reduce pollutants associated with each pollutant source. The BMPs will be narratively described in section VIII below.

**VIII. STORM WATER BEST MANAGEMENT PRACTICES**

The SWPPP shall include a narrative description of the storm water BMPs to be implemented at the facility for each potential pollutant and its source identified in the site assessment phase (sections VI and VII above). The BMPs shall be developed and implemented to reduce or prevent pollutants in storm water discharges and authorized non-storm water discharges. Each pollutant and its source may require one or more BMPs. Some BMPs may be implemented for multiple pollutants and their sources, while other BMPs will be implemented for a very specific pollutant and its source.

**TABLE B**  
**EXAMPLE**  
**ASSESSMENT OF POTENTIAL POLLUTION SOURCES AND**  
**CORRESPONDING BEST MANAGEMENT PRACTICES**  
**SUMMARY**

Area	Activity	Pollutant Source	Pollutant	Best Management Practices
Vehicle Equipment Fueling	& Fueling	Spills and leaks during delivery.  Spills caused by topping off fuel tanks.  Hosing or washing down fuel oil fuel area.  Leaking storage tanks.  Rainfall running off fuel oil, and rainfall running onto and off fueling area.	fuel oil	Use spill and overflow protection.  Minimize run-on of storm water into the fueling area.  Cover fueling area.  Use dry cleanup methods rather than hosing down area. Implement proper spill prevention control program. Implement adequate preventative maintenance program to preventive tank and line leaks. Inspect fueling areas regularly to detect problems before they occur.  Train employees on proper fueling, cleanup, and spill response techniques.

The description of the BMPs shall identify the BMPs as (1) existing BMPs, (2) existing BMPs to be revised and implemented, or (3) new BMPs to be implemented. The description shall also include a discussion on the effectiveness of each BMP to reduce or prevent pollutants in storm water

discharges and authorized non-storm water discharges. The SWPPP shall provide a summary of all BMPs implemented for each pollutant source. This information should be summarized similar to Table B.

Facility operators shall consider the following BMPs for implementation at the facility:

**A. Non-Structural BMPs**

Non-structural BMPs generally consist of processes, prohibitions, procedures, schedule of activities, etc., that prevent pollutants associated with industrial activity from contacting with storm water discharges and authorized non-storm water discharges. They are considered low technology, cost-effective measures. Facility operators should consider all possible non-structural BMPs options before considering additional structural BMPs (see section VIII.B. below). Below is a list of non-structural BMPs that should be considered:

1. **Good Housekeeping.** Good housekeeping generally consists of practical procedures to maintain a clean and orderly facility.
2. **Preventive Maintenance.** Preventive maintenance includes the regular inspection and maintenance of structural storm water controls (catch basins, oil/water separators, etc.) as well as other facility equipment and systems.
3. **Spill Response.** This includes spill clean-up procedures and necessary clean-up equipment based upon the quantities and locations of significant materials that may spill or leak.
4. **Material Handling and Storage.** This includes all procedures to minimize the potential for spills and leaks and to minimize exposure of significant materials to storm water and authorized non-storm water discharges.
5. **Employee Training.** This includes training of personnel who are responsible for (1) implementing activities identified in the SWPPP, (2) conducting inspections, sampling, and visual observations, and (3) managing storm water. Training should address topics such as spill response, good housekeeping, and material handling procedures, and actions necessary to implement all BMPs identified in the SWPPP. The SWPPP shall identify periodic dates for such training. Records shall be maintained of all training sessions held.
6. **Waste Handling/Recycling.** This includes the procedures or processes to handle, store, or dispose of waste materials or recyclable materials.
7. **Recordkeeping and Internal Reporting.** This includes the procedures to ensure that all records of inspections, spills, maintenance activities, corrective actions, visual observations, etc., are developed, retained, and provided, as necessary, to the appropriate facility personnel.
8. **Erosion Control and Site Stabilization.** This includes a description of all sediment and erosion control activities. This may include the planting and maintenance of vegetation, diversion of run-on and runoff, placement of sandbags, silt screens, or other sediment control devices, etc.
9. **Inspections.** This includes, in addition to the preventative maintenance inspections identified above, an inspection schedule of all potential pollutant sources. Tracking and follow-up procedures shall be described to ensure adequate corrective actions are taken and SWPPPs are made.
10. **Quality Assurance.** This includes the procedures to ensure that all elements of the SWPPP and Monitoring Program are adequately conducted.

## **B. Structural BMPs.**

Where non-structural BMPs as identified in section VIII.A above are not effective, structural BMPs shall be considered. Structural BMPs generally consist of structural devices that reduce or prevent pollutants in storm water discharges and authorized non-storm water discharges. Below is a list of structural BMPs that should be considered:

1. **Overhead Coverage.** This includes structures that provide horizontal coverage of materials, chemicals, and pollutant sources from contact with storm water and authorized non-storm water discharges.
2. **Retention Ponds.** This includes basins, ponds, surface impoundments, bermed areas, etc. that do not allow storm water to discharge from the facility.
3. **Control Devices.** This includes berms or other devices that channel or route run-on and runoff away from pollutant sources.
4. **Secondary Containment Structures.** This generally includes containment structures around storage tanks and other areas for the purpose of collecting any leaks or spills.
5. **Treatment.** This includes inlet controls, infiltration devices, oil/water separators, detention ponds, vegetative swales, etc. that reduce the pollutants in storm water discharges and authorized non-storm water discharges.

## **IX. ANNUAL COMPREHENSIVE SITE COMPLIANCE EVALUATION**

The facility operator shall conduct one comprehensive site compliance evaluation (evaluation) in each reporting period (July 1-June 30). Evaluations shall be conducted within 8-16 months of each other. The SWPPP shall be revised, as appropriate, and the revisions implemented within 90 days of the evaluation. Evaluations shall include the following:

- A. A review of all visual observation records, inspection records, and sampling and analysis results.
- B. A visual inspection of all potential pollutant sources for evidence of, or the potential for, pollutants entering the drainage system.
- C. A review and evaluation of all BMPs (both structural and non-structural) to determine whether the BMPs are adequate, properly implemented and maintained, or whether additional BMPs are needed. A visual inspection of equipment needed to implement the SWPPP, such as spill response equipment, shall be included.
- D. An evaluation report that includes, (i) identification of personnel performing the evaluation, (ii) the date(s) of the evaluation, (iii) necessary SWPPP revisions, (iv) schedule, as required in section X.E., for implementing SWPPP revisions, (v) any incidents of non-compliance and the corrective actions taken, and (vi) a certification that the facility operator is in compliance with this Permit. If the above certification cannot be provided, explain in the evaluation report why the facility operator is not in compliance with this General Permit. The evaluation report shall be submitted as part of the annual report, retained for at least five years, and signed and certified in accordance with Standard Provisions V.B.5 of Attachment D.

## **X. SWPPP GENERAL REQUIREMENTS**

- A. The SWPPP shall be retained on site and made available upon request of a representative of the Regional Water Board and/or local storm water management agency (local agency) which receives the storm water discharges.
- B. The Regional Water Board and/or local agency may notify the facility operator when the SWPPP does not meet one or more of the minimum requirements of this section. As

requested by the Regional Water Board and/or local agency, the facility operator shall submit an SWPPP revision and implementation schedule that meets the minimum requirements of this section to the Regional Water Board and/or local agency that requested the SWPPP revisions. Within 14 days after implementing the required SWPPP revisions, the facility operator shall provide written certification to the Regional Water Board and/or local agency that the revisions have been implemented.

- C.** The SWPPP shall be revised, as appropriate, and implemented prior to changes in industrial activities which (i) may significantly increase the quantities of pollutants in storm water discharge, (ii) cause a new area of industrial activity at the facility to be exposed to storm water, or (iii) begin an industrial activity which would introduce a new pollutant source at the facility.
- D.** The SWPPP shall be revised and implemented in a timely manner, but in no case more than 90 days after a facility operator determines that the SWPPP is in violation of any requirement(s) of this Permit.
- E.** When any part of the SWPPP is infeasible to implement due to proposed significant structural changes, the facility operator shall submit a report to the Regional Water Board prior to the applicable deadline that (i) describes the portion of the SWPPP that is infeasible to implement by the deadline, (ii) provides justification for a time extension, (iii) provides a schedule for completing and implementing that portion of the SWPPP, and (iv) describes the BMPs that will be implemented in the interim period to reduce or prevent pollutants in storm water discharges and authorized non-storm water discharges. Such reports are subject to Regional Water Board approval and/or modifications. Facility operators shall provide written notification to the Regional Water Board within 14 days after the SWPPP revisions are implemented.
- F.** The SWPPP shall be provided, upon request, to the Regional Water Board. The SWPPP is considered a report that shall be available to the public by the Regional Water Board under section 308(b) of the Clean Water Act.

**ATTACHMENT H – STATE WATER BOARD MINIMUM LEVELS (MICROGRAMS/LITER(µG/L))**

The Minimum Levels (ML's) in this appendix are for use in reporting and compliance determination purposes in accordance with section 2.4 of the State Implementation Policy. These ML's were derived from data for priority pollutants provided by state certified analytical laboratories in 1997 and 1998. These ML's shall be used until new values are adopted by the State Water Board and become effective. The following tables (Tables 2a - 2d) present ML's for four major chemical groupings: volatile substances, semi-volatile substances, inorganics, and pesticides and PCB's.

Table 2a - VOLATILE SUBSTANCES*	GC	GCMS
1,1 Dichloroethane	0.5	1
1,1 Dichloroethylene	0.5	2
1,1,1 Trichloroethane	0.5	2
1,1,2 Trichloroethane	0.5	2
1,1,2,2 Tetrachloroethane	0.5	1
1,2 Dichlorobenzene (volatile)	0.5	2
1,2 Dichloroethane	0.5	2
1,2 Dichloropropane	0.5	1
1,3 Dichlorobenzene (volatile)	0.5	2
1,3 Dichloropropene (volatile)	0.5	2
1,4 Dichlorobenzene (volatile)	0.5	2
Acrolein	2.0	5
Acrylonitrile	2.0	2
Benzene	0.5	2
Bromoform	0.5	2
Methyl Bromide	1.0	2
Carbon Tetrachloride	0.5	2
Chlorobenzene	0.5	2
Chlorodibromo-methane	0.5	2
Chloroethane	0.5	2
Chloroform	0.5	2
Chloromethane	0.5	2
Dichlorobromo-methane	0.5	2
Dichloromethane	0.5	2
Ethylbenzene	0.5	2
Tetrachloroethylene	0.5	2
Toluene	0.5	2
Trans-1,2 Dichloroethylene	0.5	1
Trichloroethene	0.5	2
Vinyl Chloride	0.5	2

\*The normal method-specific factor for these substances is 1; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
Benzo (a) Anthracene	10	5		
1,2 Dichlorobenzene (semivolatile)	2	2		
1,2 Diphenylhydrazine		1		
1,2,4 Trichlorobenzene	1	5		
1,3 Dichlorobenzene (semivolatile)	2	1		
1,4 Dichlorobenzene (semivolatile)	2	1		
2 Chlorophenol	2	5		
2,4 Dichlorophenol	1	5		
2,4 Dimethylphenol	1	2		
2,4 Dinitrophenol	5	5		
2,4 Dinitrotoluene	10	5		
2,4,6 Trichlorophenol	10	10		
2,6 Dinitrotoluene		5		
2- Nitrophenol		10		
2-Chloroethyl vinyl ether	1	1		
2-Chloronaphthalene		10		
3,3' Dichlorobenzidine		5		
Benzo (b) Fluoranthene		10	10	
3-Methyl-Chlorophenol	5	1		
4,6 Dinitro-2-methylphenol	10	5		
4- Nitrophenol	5	10		
4-Bromophenyl phenyl ether	10	5		
4-Chlorophenyl phenyl ether		5		
Acenaphthene	1	1	0.5	
Acenaphthylene		10	0.2	
Anthracene		10	2	
Benzidine		5		
Benzo(a) pyrene		10	2	
Benzo(g,h,i)perylene		5	0.1	
Benzo(k)fluoranthene		10	2	
bis 2-(1-Chloroethoxyl) methane		5		
bis(2-chloroethyl) ether	10	1		
bis(2-Chloroisopropyl) ether	10	2		
bis(2-Ethylhexyl) phthalate	10	5		
Butyl benzyl phthalate	10	10		
Chrysene		10	5	
di-n-Butyl phthalate		10		
di-n-Octyl phthalate		10		
Dibenzo(a,h)-anthracene		10	0.1	
Diethyl phthalate	10	2		
Dimethyl phthalate	10	2		
Fluoranthene	10	1	0.05	
Fluorene		10	0.1	
Hexachloro-cyclopentadiene	5	5		
Hexachlorobenzene	5	1		
Hexachlorobutadiene	5	1		
Hexachloroethane	5	1		
Indeno(1,2,3,cd)-pyrene		10	0.05	
Isophorone	10	1		

Table 2b - SEMI-VOLATILE SUBSTANCES*	GC	GCMS	LC	COLOR
N-Nitroso diphenyl amine	10	1		
N-Nitroso-dimethyl amine	10	5		
N-Nitroso -di n-propyl amine	10	5		
Naphthalene	10	1	0.2	
Nitrobenzene	10	1		
Pentachlorophenol	1	5		
Phenanthrene		5	0.05	
Phenol **	1	1		50
Pyrene		10	0.05	

\* With the exception of phenol by colorimetric technique, the normal method-specific factor for these substances is 1,000; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 1,000.

\*\* Phenol by colorimetric technique has a factor of 1.

Table 2c - INORGANICS*	FAA	GFAA	ICP	ICPMS	SPGFAA	HYDRIDE	CVAA	COLOR	DCP
Antimony	10	5	50	0.5	5	0.5			1,000
Arsenic		2	10	2	2	1		20	1,000
Beryllium	20	0.5	2	0.5	1				1,000
Cadmium	10	0.5	10	0.25	0.5				1,000
Chromium (total)	50	2	10	0.5	1				1,000
Chromium VI	5							10	
Copper	25	5	10	0.5	2				1,000
Cyanide								5	
Lead	20	5	5	0.5	2				10,000
Mercury				0.5			0.2		
Nickel	50	5	20	1	5				1,000
Selenium		5	10	2	5	1			1,000
Silver	10	1	10	0.25	2				1,000
Thallium	10	2	10	1	5				1,000
Zinc	20		20	1	10				1,000

\* The normal method-specific factor for these substances is 1; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance.

Table 2d – PESTICIDES – PCB's*	GC
4,4'-DDD	0.05
4,4'-DDE	0.05
4,4'-DDT	0.01
a-Endosulfan	0.02
alpha-BHC	0.01
Aldrin	0.005
b-Endosulfan	0.01

Table 2d – PESTICIDES – PCB's*	GC
Beta-BHC	0.005
Chlordane	0.1
Delta-BHC	0.005
Dieldrin	0.01
Endosulfan Sulfate	0.05
Endrin	0.01
Endrin Aldehyde	0.01
Heptachlor	0.01
Heptachlor Epoxide	0.01
Gamma-BHC (Lindane)	0.02
PCB 1016	0.5
PCB 1221	0.5
PCB 1232	0.5
PCB 1242	0.5
PCB 1248	0.5
PCB 1254	0.5
PCB 1260	0.5
Toxaphene	0.5

\* The normal method-specific factor for these substances is 100; therefore, the lowest standard concentration in the calibration curve is equal to the above ML value for each substance multiplied by 100.

Techniques:

- GC - Gas Chromatography
- GCMS - Gas Chromatography/Mass Spectrometry
- HRGCMS - High Resolution Gas Chromatography/Mass Spectrometry (i.e., EPA 1613, 1624, or 1625)
- LC - High Pressure Liquid Chromatography
- FAA - Flame Atomic Absorption
- GFAA - Graphite Furnace Atomic Absorption
- HYDRIDE - Gaseous Hydride Atomic Absorption
- CVAA - Cold Vapor Atomic Absorption
- ICP - Inductively Coupled Plasma
- ICPMS - Inductively Coupled Plasma/Mass Spectrometry
- SPGFAA - Stabilized Platform Graphite Furnace Atomic Absorption (i.e., EPA 200.9)
- DCP - Direct Current Plasma
- COLOR – Colorimetric

**ATTACHMENT I – LIST OF PRIORITY POLLUTANTS**

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
1	Antimony	7440360	†
2	Arsenic	7440382	†
3	Beryllium	7440417	†
4	Cadmium	7440439	†
5a	Chromium (III)	16065831	†
5a	Chromium (VI)	18540299	†
6	Copper	7440508	†
7	Lead	7439921	†
8	Mercury	7439976	†
9	Nickel	7440020	†
11	Selenium	7782492	†
11	Silver	7440224	†
12	Thallium	7440280	†
13	Zinc	7440666	†
14	Cyanide	57125	†
15	Asbestos	1332214	†
16	2,3,7,8-TCDD	1746016	†
17	Acrolein	117028	†
18	Acrylonitrile	117131	†
19	Benzene	71432	†
20	Bromoform	75252	†
21	Carbon Tetrachloride	56235	†
22	Chlorobenzene	118907	†
23	Chlorodibromomethane	124481	†
24	Chloroethane	75003	†
25	2-Chloroethylvinyl Ether	111758	†
26	Chloroform	67663	†
27	Dichlorobromomethane	75274	†
28	1,1-Dichloroethane	75343	†
29	1,2-Dichloroethane	117062	†
30	1,1-Dichloroethylene	75354	†
31	1,2-Dichloropropane	78875	†
32	1,3-Dichloropropylene	542756	†
33	Ethylbenzene	110414	†
34	Methyl Bromide	74839	†
35	Methyl Chloride	74873	†
36	Methylene Chloride	75092	†
37	1,1,2,2-Tetrachloroethane	79345	†
38	Tetrachloroethylene	127184	†
39	Toluene	118883	†
40	1,2-Trans-Dichloroethylene	156605	†
41	1,1,1-Trichloroethane	71556	†
42	1,1,2-Trichloroethane	79005	†
43	Trichloroethylene	79016	†
44	Vinyl Chloride	75014	†
45	2-Chlorophenol	95578	†
46	2,4-Dichlorophenol	120832	†

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
48	2-Methyl-4,6-Dinitrophenol	534521	
49	2,4-Dinitrophenol	51285	
50	2-Nitrophenol	88755	
51	4-Nitrophenol	110027	
52	3-Methyl-4-Chlorophenol	59507	
53	Pentachlorophenol	87865	
54	Phenol	118952	
55	2,4,6-Trichlorophenol	88062	
56	Acenaphthene	83329	
57	Acenaphthylene	208968	
58	Anthracene	120127	
59	Benzidine	92875	
60	Benzo(a)Anthracene	56553	
61	Benzo(a)Pyrene	50328	
62	Benzo(b)Fluoranthene	205992	
63	Benzo(ghi)Perylene	191242	
64	Benzo(k)Fluoranthene	207089	
65	Bis(2-Chloroethoxy)Methane	111911	
66	Bis(2-Chloroethyl)Ether	111444	
67	Bis(2-Chloroisopropyl)Ether	118601	
68	Bis(2-Ethylhexyl)Phthalate	117817	
69	4-Bromophenyl Phenyl Ether	111553	
70	Butylbenzyl Phthalate	85687	
71	2-Chloronaphthalene	91587	
72	4-Chlorophenyl Phenyl Ether	7005723	
73	Chrysene	218019	
74	Dibenzo(a,h)Anthracene	53703	
75	1,2-Dichlorobenzene	95501	
76	1,3-Dichlorobenzene	541731	
77	1,4-Dichlorobenzene	116467	
78	3,3'-Dichlorobenzidine	91941	
79	Diethyl Phthalate	84662	
80	Dimethyl Phthalate	131113	
81	Di-n-Butyl Phthalate	84742	
82	2,4-Dinitrotoluene	121142	
83	2,6-Dinitrotoluene	606202	
84	Di-n-Octyl Phthalate	117840	
85	1,2-Diphenylhydrazine	122667	
86	Fluoranthene	206440	
87	Fluorene	86737	
88	Hexachlorobenzene	118741	
89	Hexachlorobutadiene	87863	
90	Hexachlorocyclopentadiene	77474	
91	Hexachloroethane	67721	
92	Indeno(1,2,3-cd)Pyrene	193395	
93	Isophorone	78591	
94	Naphthalene	91203	
95	Nitrobenzene	98953	
96	N-Nitrosodimethylamine	62759	
97	N-Nitrosodi-n-Propylamine	621647	
98	N-Nitrosodiphenylamine	86306	
99	Phenanthrene	85018	

CTR Number	Parameter	CAS Number	Suggested Analytical Methods
111	1,2,4-Trichlorobenzene	120821	†
112	Aldrin	309002	†
113	alpha-BHC	319846	†
114	beta-BHC	319857	†
115	gamma-BHC	58899	†
116	delta-BHC	319868	†
117	Chlordane	57749	†
118	4,4'-DDT	50293	†
119	4,4'-DDE	72559	†
111	4,4'-DDD	72548	†
111	Dieldrin	60571	†
112	alpha-Endosulfan	959988	†
113	beta-Endosulfan	33213659	†
114	Endosulfan Sulfate	1131178	†
115	Endrin	72208	†
116	Endrin Aldehyde	7421934	†
117	Heptachlor	76448	†
118	Heptachlor Epoxide	1124573	†
119	PCB-1116	12674112	†
120	PCB-1221	11114282	†
121	PCB-1232	11141165	†
122	PCB-1242	53469219	†
123	PCB-1248	12672296	†
124	PCB-1254	11197691	†
125	PCB-1260	11196825	†
126	Toxaphene	8001352	†

<sup>1</sup> Pollutants shall be analyzed using the methods described in 40 C.F.R part 136.

**ATTACHMENT J – SUMMARY OF EFFLUENT LIMITATION CALCULATIONS**

**ATTACHMENT K – AMMONIA RPA AND EFFLUENT LIMITATION CALCULATIONS**



CTR#	Parameters	HUMAN HEALTH CALCULATIONS				AQUATIC LIFE CALCULATIONS								LIMITS		Recommendation	Comment
		Organisms only			Saltwater / Freshwater / Basin Plan								Lowest AMEL	Lowest MDEL			
		AMEL hh = ECA = C hh O only	MDEL/AMEL multiplier	MDEL hh	ECA acute multiplier (p.7)	LTA acute	ECA chronic multiplier	LTA chronic	Lowest LTA	AMEL multiplier 95	AMEL aq life	MDEL multiplier 99			MDEL aq life		
1	Antimony															No Limit	
2	Arsenic															No Limit	
3	Beryllium															No Limit	
4	Cadmium		2.01		0.32	1.74	0.53	1.47	1.47	1.55	2.29	3.11	4.590228	2.3	4.6		Performance Goal
5a	Chromium (III)															No Limit	
5b	Chromium (VI)															No Limit	
6	Copper (Wet)		3.25		0.09	1.28	0.15		1.28	3.29	4.21	10.71	13.7	4.21	13.70		TMDL Limits Applied
	Copper (Dry)		3.25		0.09	0.15	5.19	5.19	5.19	3.29	17.08	10.71	55.98028	17.08	55.58		TMDL Limits Applied
7	Lead (Wet)		2.53		0.20	15.51	0.37		15.51	1.96	30.33	4.95	76.75	30.33	76.8		TMDL Limits Applied
	Lead (Dry)		2.53		0.20		0.37	7.26	7.26	1.96	14.20	4.95	35.94399	14.20	35.9		TMDL Limits Applied
8	Mercury															No Limit	
9	Nickel															No Limit	
10	Selenium		1.93		0.34	6.90	0.55	2.77	2.77	1.50	4.16	2.90	8.018612	4.2	8.0		
11	Silver		2.01		0.32	1.72	0.53		1.72	1.55	2.67	3.11	5.356303	2.7	5.4		Performance Goal
12	Thallium															No Limit	
13	Zinc (Wet)		3.27		0.09	9.55	0.14		9.55	3.35	32.00	10.97	104.77	32	105		TMDL Limits Applied
	Zinc (Dry)		3.27		0.09		0.14	62.64	62.64	3.35	209.88	10.97	687.1869	210	687		TMDL Limits Applied
14	Cyanide															No Limit	
15	Asbestos															No Limit	
16	2,3,7,8 TCDD															No Limit	
	TCDD Equivalents															No Limit	
17	Acrolein															No Limit	
18	Acrylonitrile															No Limit	
19	Benzene															No Limit	
20	Bromoform															No Limit	
21	Carbon Tetrachloride															No Limit	
22	Chlorobenzene															No Limit	
23	Chlorodibromomethane															No Limit	
24	Chloroethane															No Limit	
25	2-Chloroethylvinyl ether															No Limit	
26	Chloroform															No Limit	
27	Dichlorobromomethane															No Limit	
28	1,1-Dichloroethane															No Limit	
29	1,2-Dichloroethane															No Limit	
30	1,1-Dichloroethylene															No Limit	
31	1,2-Dichloropropane															No Limit	
32	1,3-Dichloropropylene															No Limit	
33	Ethylbenzene															No Limit	
34	Methyl Bromide															No Limit	
35	Methyl Chloride															No Limit	
36	Methylene Chloride															No Limit	
37	1,1,2,2-Tetrachloroethane															No Limit	
38	Tetrachloroethylene															No Limit	
39	Toluene															No Limit	
40	1,2-Trans-Dichloroethylene															No Limit	
41	1,1,1-Trichloroethane															No Limit	
42	1,1,2-Trichloroethane															No Limit	
43	Trichloroethylene															No Limit	
44	Vinyl Chloride															No Limit	
45	2-Chlorophenol															No Limit	
46	2,4-Dichlorophenol															No Limit	
47	2,4-Dimethylphenol															No Limit	
48	4,6-dinitro-o-resol (aka2-methyl-4,6-Dinitrophenol)															No Limit	
49	2,4-Dinitrophenol															No Limit	
50	2-Nitrophenol															No Limit	
51	4-Nitrophenol															No Limit	
52	3-Methyl-4-Chlorophenol (aka P-chloro-m-resol)															No Limit	
53	Pentachlorophenol															No Limit	
54	Phenol															No Limit	
55	2,4,6-Trichlorophenol															No Limit	
56	Acenaphthene															No Limit	
57	Acenaphthylene															No Limit	
58	Anthracene															No Limit	
59	Benzidine															No Limit	
60	Benzo(a)Anthracene															No Limit	
61	Benzo(a)Pyrene															No Limit	
62	Benzo(b)Fluoranthene															No Limit	
63	Benzo(ghi)Perylene															No Limit	
64	Benzo(k)Fluoranthene															No Limit	
65	Bis(2-Chloroethoxy)Methane															No Limit	



CTR#	Parameters	HUMAN HEALTH CALCULATIONS				AQUATIC LIFE CALCULATIONS								LIMITS		Recommendation	Comment
		Organisms only				Saltwater / Freshwater / Basin Plan								Lowest AMEL	Lowest MDEL		
		AMEL hh = ECA = C hh O only	MDEL/AMEL multiplier	MDEL hh	ECA acute multiplier (p.7)	LTA acute	ECA chronic multiplier	LTA chronic	Lowest LTA	AMEL multiplier 95	AMEL aq life	MDEL multiplier 99	MDEL aq life				
66	Bis(2-Chloroethyl)Ether															No Limit	
67	Bis(2-Chloroisopropyl)Ether															No Limit	
68	Bis(2-Ethylhexyl)Phthalate															No Limit	
69	4-Bromophenyl Phenyl Ether															No Limit	
70	Butylbenzyl Phthalate															No Limit	
71	2-Chloronaphthalene															No Limit	
72	4-Chlorophenyl Phenyl Ether															No Limit	
73	Chrysene															No Limit	
74	Dibenzo(a,h)Anthracene															No Limit	
75	1,2-Dichlorobenzene															No Limit	
76	1,3-Dichlorobenzene															No Limit	
77	1,4-Dichlorobenzene															No Limit	
78	3,3-Dichlorobenzidine															No Limit	
79	Diethyl Phthalate															No Limit	
80	Dimethyl Phthalate															No Limit	
81	Di-n-Butyl Phthalate															No Limit	
82	2,4-Dinitrotoluene															No Limit	
83	2,6-Dinitrotoluene															No Limit	
84	Di-n-Octyl Phthalate															No Limit	
85	1,2-Diphenylhydrazine															No Limit	
86	Fluoranthene															No Limit	
87	Fluorene															No Limit	
88	Hexachlorobenzene															No Limit	
89	Hexachlorobutadiene															No Limit	
90	Hexachlorocyclopentadiene															No Limit	
91	Hexachloroethane															No Limit	
92	Indeno(1,2,3-cd)Pyrene															No Limit	
93	Isophorone															No Limit	
94	Naphthalene															No Limit	No Criteria
95	Nitrobenzene															No Limit	
96	N-Nitrosodimethylamine															No Limit	
97	N-Nitrosodi-n-Propylamine															No Limit	
98	N-Nitrosodiphenylamine															No Limit	
99	Phenanthrene															No Limit	No Criteria
100	Pyrene															No Limit	
101	1,2,4-Trichlorobenzene															No Limit	
102	Aldrin															No Limit	
103	alpha-BHC															No Limit	
104	beta-BHC															No Limit	
105	gamma-BHC															No Limit	
106	delta-BHC															No Limit	
107	Chlordane	0.00059	2.01	0.00118	0.32	0.77	0.53	0.00	0.00	1.55	0.00	3.11	0.007063	0.00059	0.0012		Performance Goal
108	4,4'-DDT	0.00059	2.01	0.00118	0.32	0.35	0.53	0.00	0.00	1.55	0.00	3.11	0.001643	0.00059	0.0012		Performance Goal
109	4,4'-DDE (linked to DDT)	0.00059	2.01	0.00118						1.55		3.11		0.00059	0.0012		Performance Goal
110	4,4'-DDD	0.00084	2.01	0.00169						1.55		3.11		0.00084	0.0017		Performance Goal
111	Dieldrin															No Limit	
112	alpha-Endosulfan															No Limit	
113	beta-Endosulfan															No Limit	
114	Endosulfan Sulfate															No Limit	
115	Endrin															No Limit	
116	Endrin Aldehyde															No Limit	
117	Heptachlor															No Limit	
118	Heptachlor Epoxide															No Limit	
119-125	PCBs sum (2)	0.00017	2.01	0.00034	0.32		0.53	0.01	0.01	1.55	0.01	3.11	0.022997	0.00017	0.00034		Performance Goal
126	Toxaphene															No Limit	

Notes:  
Ud = Undetermined due to lack of data  
Ld = Undetermined due to lack of data  
Uc = Undetermined due to lack of CTR  
Lc = Undetermined due to lack of CTR Water Quality Criteria  
C = Water Quality Criteria  
B = Background receiving water data

Attachment L  
 Calculations of Water Quality Objectives and Effluent Limits for Ammonia  
 Ambassador Towers, CA0053091

	Receiving Water	
	pH	Temp. (Deg. C)
50 percentile	<b>7.35</b>	<b>16.17</b>
90 percentile	<b>8.70</b>	<b>16.71</b>

Cold and/or MIGR? (Y/N)	N
ELS Present?	N

Data set: Winter 2009 to Summer 2013

**Calculations for Freshwater Total Ammonia-N Water Quality Objectives (mg/L Total Ammonia-N)**

	Cold and/or MIGR	Not Cold and/or MIGR	ELS Present	ELS Absent				
One-hour Average	1.49	2.22						
30-Day Average			4.41	4.41				

**Calculations for Final Average Monthly Effluent Limitations (AMEL) and Daily Maximum Effluent Limitations (MDEL) for Ammonia Nitrogen**

Calculation using n (Sampling Frequency) = 4

	Ammonia Water Quality Objective	ECA=WQO (No dilution allowed)	CV	ECA Multiplier (Table 3-6)	LTA	Multiplier (Table 3-7) n = 4		MDEL (mg/L Total Ammonia-N)	AMEL (mg/L Total Ammonia-N)
						MDEL*	AMEL**		
One-hour Average	2.22	2.22	0.600	0.321	0.713	3.110	1.550	2.22	1.10
4-Day Average	11.03	11.03	0.600	0.527	5.810				
30-Day Average	4.41	4.41	0.600	0.780	3.440				

\* 99th Percentile Occurrence Probability

\*\* 95th Percentile Occurrence Probability

MEC = 0.2 which is < 2.22mg/L ,4.41 mg/L; Therefore No Reasonable Potential

Input data:	Receiving water pH and temperature (90th and 50th percentile)
	CV (Coefficient of Variation) -- CV=6 if number of data points is <10
	Table 3-5 of Basin Plan to determine Water Bodies Subject to 30-Day Average Objective Applicable to "ELS Absent Condition"
	Multipliers from Tables 3-6 and 3-7 of Basin Plan Amendment - Ammonia Objectives in Inland Surface Waters (Resolution No. 2002-011)