

STATE OF CALIFORNIA
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LOS ANGELES REGION
320 West 4th Street, Suite 200, Los Angeles, California 90013

**FACT SHEET
WASTE DISCHARGE REQUIREMENTS
FOR**

**FOREST LAWN MEMORIAL PARK COVINA HILLS
SLOPE STABILIZATION PROJECT
ORDER NO. R4-2003-0111
(NPDES NO. CAG994004 SERIES NO. 192)
CI-9181**

FACILITY ADDRESS

21300 Via Verde Drive
Covina, CA 91723

FACILITY MAILING ADDRESS

1712 South Glendale Avenue
Glendale, CA 91723

PROJECT DESCRIPTION:

Forest Lawn Memorial Park, Covina Hills is undertaking a slope stabilization project at the above mentioned site. The project involves installation of gravity drainage system at the site for collection and disposal of seepage groundwater. Groundwater collected at the site will be discharged to a nearby storm drain.

VOLUME AND DESCRIPTION OF DISCHARGE:

Approximately 0.03 million gallons per day of groundwater will be discharged from this site. The discharge flows into a nearby storm drain (latitude: 34° 03' 50" and longitude: 117° 50' 50") thence, to Walnut Creek a tributary to San Gabriel River, a water of the United States. The site location map is shown in Figure 1.

APPLICABLE EFFLUENT LIMITATIONS

Based on the information provided in the NPDES Application Supplemental Requirements, the following constituents listed in the Table below have been determined to show reasonable potential to exist in your discharge. The discharge flows to San Gabriel River - between Morris Dam and Ramona Blvd. Therefore, the limitations in Attachment B.8.b of Order No. R4-2003-0111 are applicable to your discharge.

This Table lists the specific constituents and effluent limitations applicable to the discharge.


Constituents	Units	Discharge Limitations	
		Daily Maximum	Monthly Average
Total Suspended Solids	mg/L	150	50
Turbidity	NTU	150	50
BOD ₅ 20°C	mg/L	30	20
Oil and Grease	mg/L	15	10
Settleable Solids	ml/L	0.3	0.1
Sulfides	mg/L	1.0	---
Phenols	mg/L	1.0	---
Residual Chlorine	mg/L	0.1	---
Total Dissolved Solids	mg/L	450	---
Sulfate	mg/L	100	---
Chloride	mg/L	100	---
Boron	mg/L	0.5	---
Nitrogen (NO ₃ -N +NO ₂ -N)	mg/L	8	---
Methylene Blue Active Substances (MBAS)	mg/L	0.5	---

FREQUENCY OF DISCHARGE:

The groundwater discharge will be intermittent but permanent.

REUSE OF WATER:

It is not economically feasible to haul the groundwater for off-site disposal. Since there are no other feasible reuse options, groundwater generated from the project will be discharged in compliance with the attached Order.

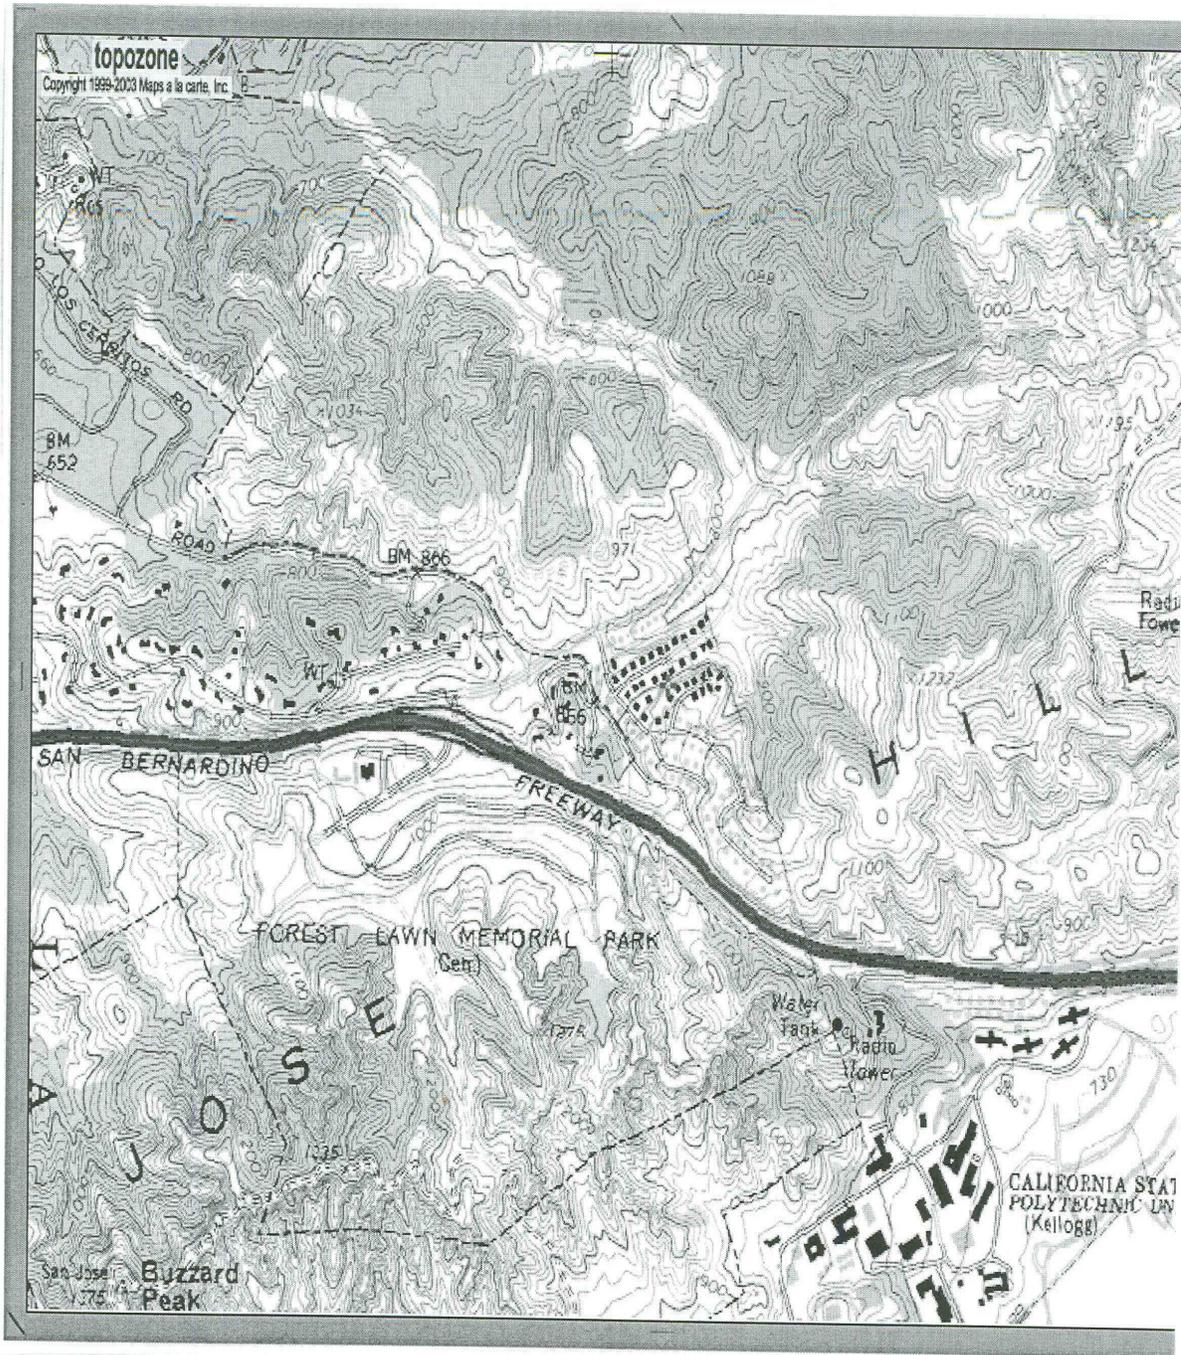

Location Map

FIGURE 1