

STATE OF CALIFORNIA  
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
LOS ANGELES REGION  
320 West 4<sup>th</sup> Street, Suite 200, Los Angeles, California 90013

FACT SHEET  
WASTE DISCHARGE REQUIREMENTS  
FOR  
CALLEGUAS MUNICIPAL WATER DISTRICT  
(Regional Salinity Management Pipeline - Phase 1C)

NPDES NO. CAG674001  
CI-9209

**FACILITY ADDRESS**

Along Hueneme Road between Arnold Rd.  
and Edison Dr.  
Oxnard, CA 93036

**FACILITY MAILING ADDRESS**

2100 Olsen Road, Thousand Oaks,  
CA 91360

**PROJECT DESCRIPTION:**

Calleguas Municipal Water District (CMWD) proposes to construct Phase 1C of the Regional Salinity Management Pipeline project. The brine line extension is 6.3 miles and is being constructed along Hueneme Road (between Lewis Road and Edison Drive) in an unincorporated area of Ventura County, California. Hydrostatic testing of the newly constructed brine line will be conducted by using potable water provided by the City of Oxnard or Ocean View Municipal Water District. CMWD will dechlorinate the water before it is discharged to nearby storm drain.

**VOLUME AND DESCRIPTION OF DISCHARGE:**

Up to 374,000 gallons per day (GPD) of hydrostatic test water will be discharged to a nearby storm drain at Latitude 34°08'00", Longitude 119°91'00" which flows into Oxnard Industrial Drain thence to Pacific Ocean, a water of the United States. The site location is shown in Figure 1.

**APPLICABLE EFFLUENT LIMITATIONS**

Based on the information provided in the NPDES Application Supplemental Requirements, the following constituents listed in the Table below have been determined to show reasonable potential to exist in the discharge. The discharge flows into Pacific Ocean. Therefore, effluent limitations in Attachment B are not applicable to the discharge.

This Table lists the specific constituents and effluent limitations applicable to the discharge.


Constituents	Units	Discharge Limitations	
		Daily Maximum	Monthly Average
Total Suspended Solids	mg/L	150	50
Turbidity	NTU	150	50
BOD <sub>5</sub> 20°C	mg/L	30	20
Oil and Grease	mg/L	15	10
Settable Solids	ml/L	0.3	0.1
Residual Chlorine	mg/L	0.1	---

**FREQUENCY OF DISCHARGE:**

The short term discharge will occur over a week period.

**REUSE OF WATER:**

It is not feasible to discharge the wastewater to the sanitary sewer system. It is not economically feasible to haul the wastewater for off-site disposal. There are no feasible reuse options for the discharge. Therefore, the hydrostatic test water will be discharged into the storm drain in compliance with the requirements of the attached order.

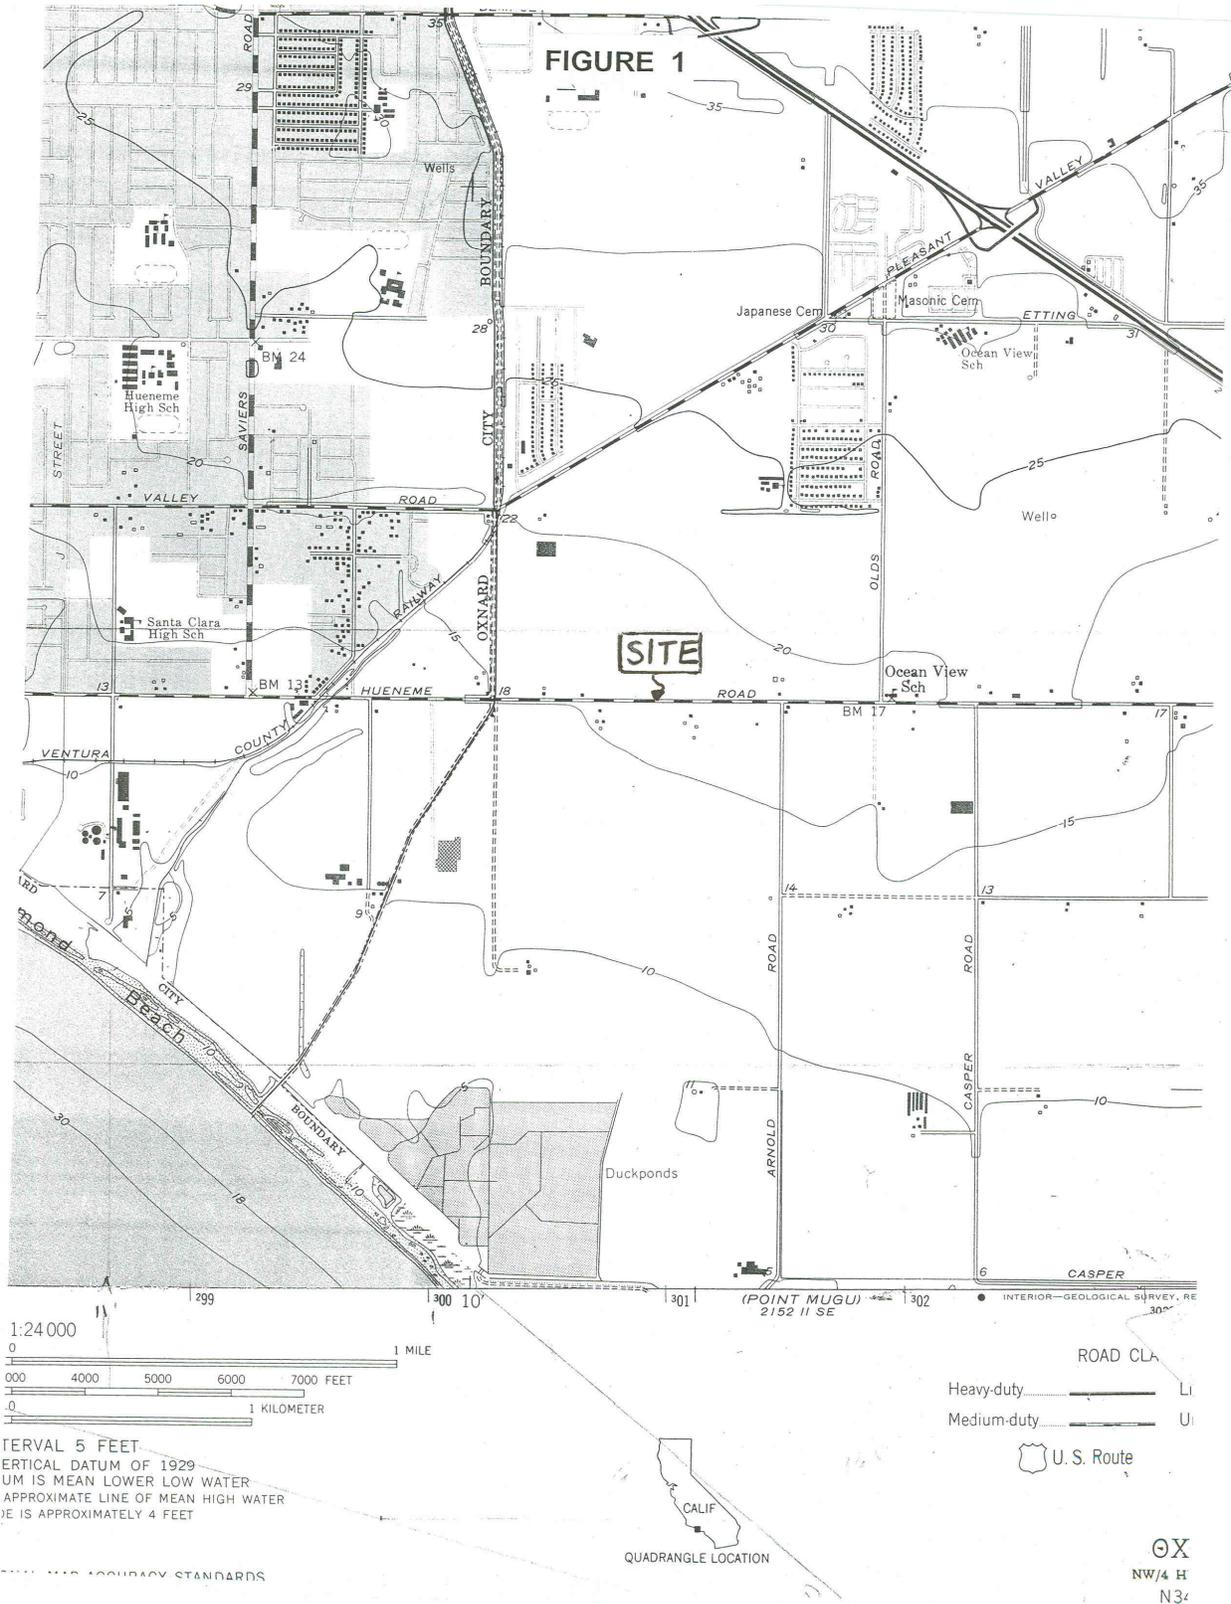

**SITE LOCATION  
 FIGURE 1**