

STATE OF CALIFORNIA  
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
LOS ANGELES REGION  
320 West 4<sup>th</sup> Street, Suite 200, Los Angeles, California 90013

FACT SHEET  
WASTE DISCHARGE REQUIREMENTS  
FOR  
CORA CONSTRUCTORS INC.  
(Foothill Municipal Water District - Pipeline Hydrostatic Test Project)

NPDES NO. CAG674001  
CI-9296

**FACILITY ADDRESS**

Baptise Way to Hampton Road, La Canada-  
Flintridge, CA 91011

**FACILITY MAILING ADDRESS**

42240 Green Way, Suite A  
Palm Desert, CA 92211

**PROJECT DESCRIPTION:**

Foothill Municipal Water District proposes to conduct hydrostatic testing of their newly constructed 660 foot pipeline. The pipeline runs from District Well No. 6 site at Baptise Way to their Reservoir located at 4536 Hampton Road in the City of La Canada-Flintridge, California. Hydrostatic test will be conducted by using potable water provided by the Metropolitan Water District of Southern California. The hydrostatic test will be completed in one week.

**VOLUME AND DESCRIPTION OF DISCHARGE:**

Up to 3,000 gallons per day (gpd) of hydrostatic test water will be discharged to nearby Flint Canyon Channel at Latitude 34°12'14", Longitude 118°11'10" , which drains into Arroyo Seco, thence to the Los Angeles River, a water of the United States. The site location is shown in Figure 1.

**APPLICABLE EFFLUENT LIMITATIONS**

Based on the information provided in the NPDES Application Supplemental Requirements, the following constituents listed in the Table below have been determined to show reasonable potential to exist in the discharge. The receiving waterbody for the discharge, Arroyo Seco, has designated beneficial use of (MUN) Potential. The effluent limitations in Attachment B.7.j. of the Order are applicable to the discharge.

July 25, 2007

This Table lists the specific constituents and effluent limitations applicable to the discharge.



Constituents	Units	Discharge Limitations	
		Daily Maximum	Monthly Average
Total Dissolved Solids	mg/L	300	---
Sulfate	mg/L	40	---
Chloride	mg/L	15	---
Total Suspended Solids	mg/L	150	50
Turbidity	NTU	150	50
BOD <sub>5</sub> 20°C	mg/L	30	20
Oil and Grease	mg/L	15	10
Settable Solids	ml/L	0.3	0.1
Residual Chlorine	mg/L	0.1	---

**FREQUENCY OF DISCHARGE:**

The discharge will last one week.

**REUSE OF WATER:**

It is not feasible to discharge the wastewater to the sanitary sewer system. It is not economically feasible to haul the wastewater for off-site disposal. There are no feasible reuse options for the discharge. Therefore, the hydrostatic test water will be discharged into Arroyo Simi in compliance with the requirements of the attached order.

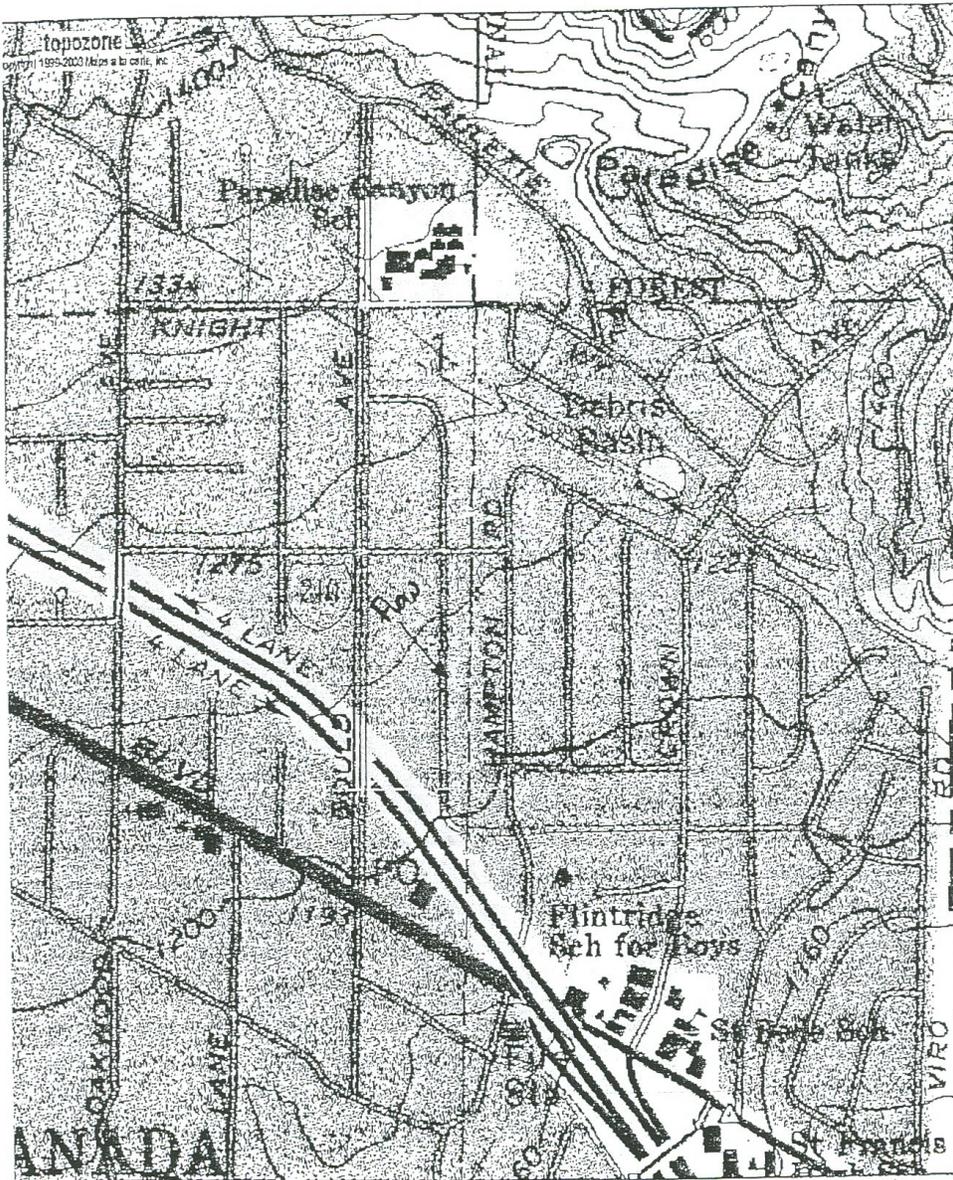

34° 12' 14"N, 118° 11' 10"W (NAD27)  
USGS PASADENA (CA) Quadrangle  
Projection is UTM Zone 11 NAD83 Datum



FIGURE 1