

STATE OF CALIFORNIA
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LOS ANGELES REGION
320 West 4th Street, Suite 200, Los Angeles, California 90013

FACT SHEET
WASTE DISCHARGE REQUIREMENTS
FOR
CALLEGUAS MUNICIPAL WATER DISTRICT
(Hueneme Outfall Replacement Hydrostatic Test Project)

NPDES NO. CAG6740014
CI-9394

FACILITY ADDRESS

Port Hueneme Beach Park and Point Mugu,
City of Port Hueneme and City of Oxnard, CA

FACILITY MAILING ADDRESS

2100 Olsen Road
Thousand Oaks, CA 91360

PROJECT DESCRIPTION:

The Calleguas Municipal Water District (The District) proposes to discharge hydrostatic test water from the Hueneme Outfall Replacement Hydrostatic Test Project. The project entails installation of pipelines at two locations: at the Naval Base Ventura County, Point Mugu and at the Port Hueneme Beach Park, Port Hueneme. The new pipelines will be hydrostatically tested before they can be placed into service. The hydrostatic test water will be discharged into Outfall No. 001 which drains into Point Mugu storm drain, thence to a Miscellaneous Ventura Coastal Stream. Discharge from Outfall No. 002 drains into Bubbling Springs which also flows into a Miscellaneous Ventura Coastal Stream.

VOLUME AND DESCRIPTION OF DISCHARGE:

Up to 0.8 million gallons per day (mgd) of hydrostatic test water will be discharged from the project. The hydrostatic test water will be discharged from the following outfall locations:

Outfall No.	Location	Latitude	Longitude	Receiving Water
1	Point Mugu storm drain, Point Mugu	34° 10' 00"	119° 14' 00"	Miscellaneous Coastal Stream
2	Bubbling Srrings, Port of Hueneme	34° 08' 37"	119° 11' 42"	Miscellaneous Coastal Stream

The discharge flows into Miscellaneous Ventura Coastal Streams of the Pacific Ocean, a water of the United States. The site location maps are shown in Figures 1 and 2.

APPLICABLE EFFLUENT LIMITATIONS

Based on the information provided in the NPDES Application Supplemental Requirements, the following constituents listed in the Table below have been determined to show reasonable

potential to exist in the discharge. The discharge from the outfalls drain to Miscellaneous Ventura Coastal Streams. Therefore, attachment B of the Order is not applicable to this discharge.

This table lists the specific constituents and effluent limitations applicable to the discharge.

Constituents	Units	Discharge Limitations	
		Daily Maximum	Monthly Average
Total Suspended Solids	mg/L	150	50
Turbidity	NTU	150	50
BOD ₅ 20°C	mg/L	30	20
Oil and Grease	mg/L	15	10
Settleable Solids	ml/L	0.3	0.1
Sulfides	mg/L	1.0	
Phenols	mg/L	1.0	
Residual Chlorine	mg/L	0.1	
Methylene Blue Active Substances (MBAS)	mg/L	0.5	

FREQUENCY OF DISCHARGE:

The discharge of hydrostatic test water will be intermittent and will last for about two weeks.

REUSE OF WATER:

The reuse of hydrostatic test water at the site was evaluated. It is not feasible to discharge the wastewater to the sanitary sewer system and it is not cost effective to truck the water off-site. The project area lacks landscaped area for irrigation at the time of discharge. Therefore, the hydrostatic test water will be discharged into the coastal stream and springs in accordance with the attached order.

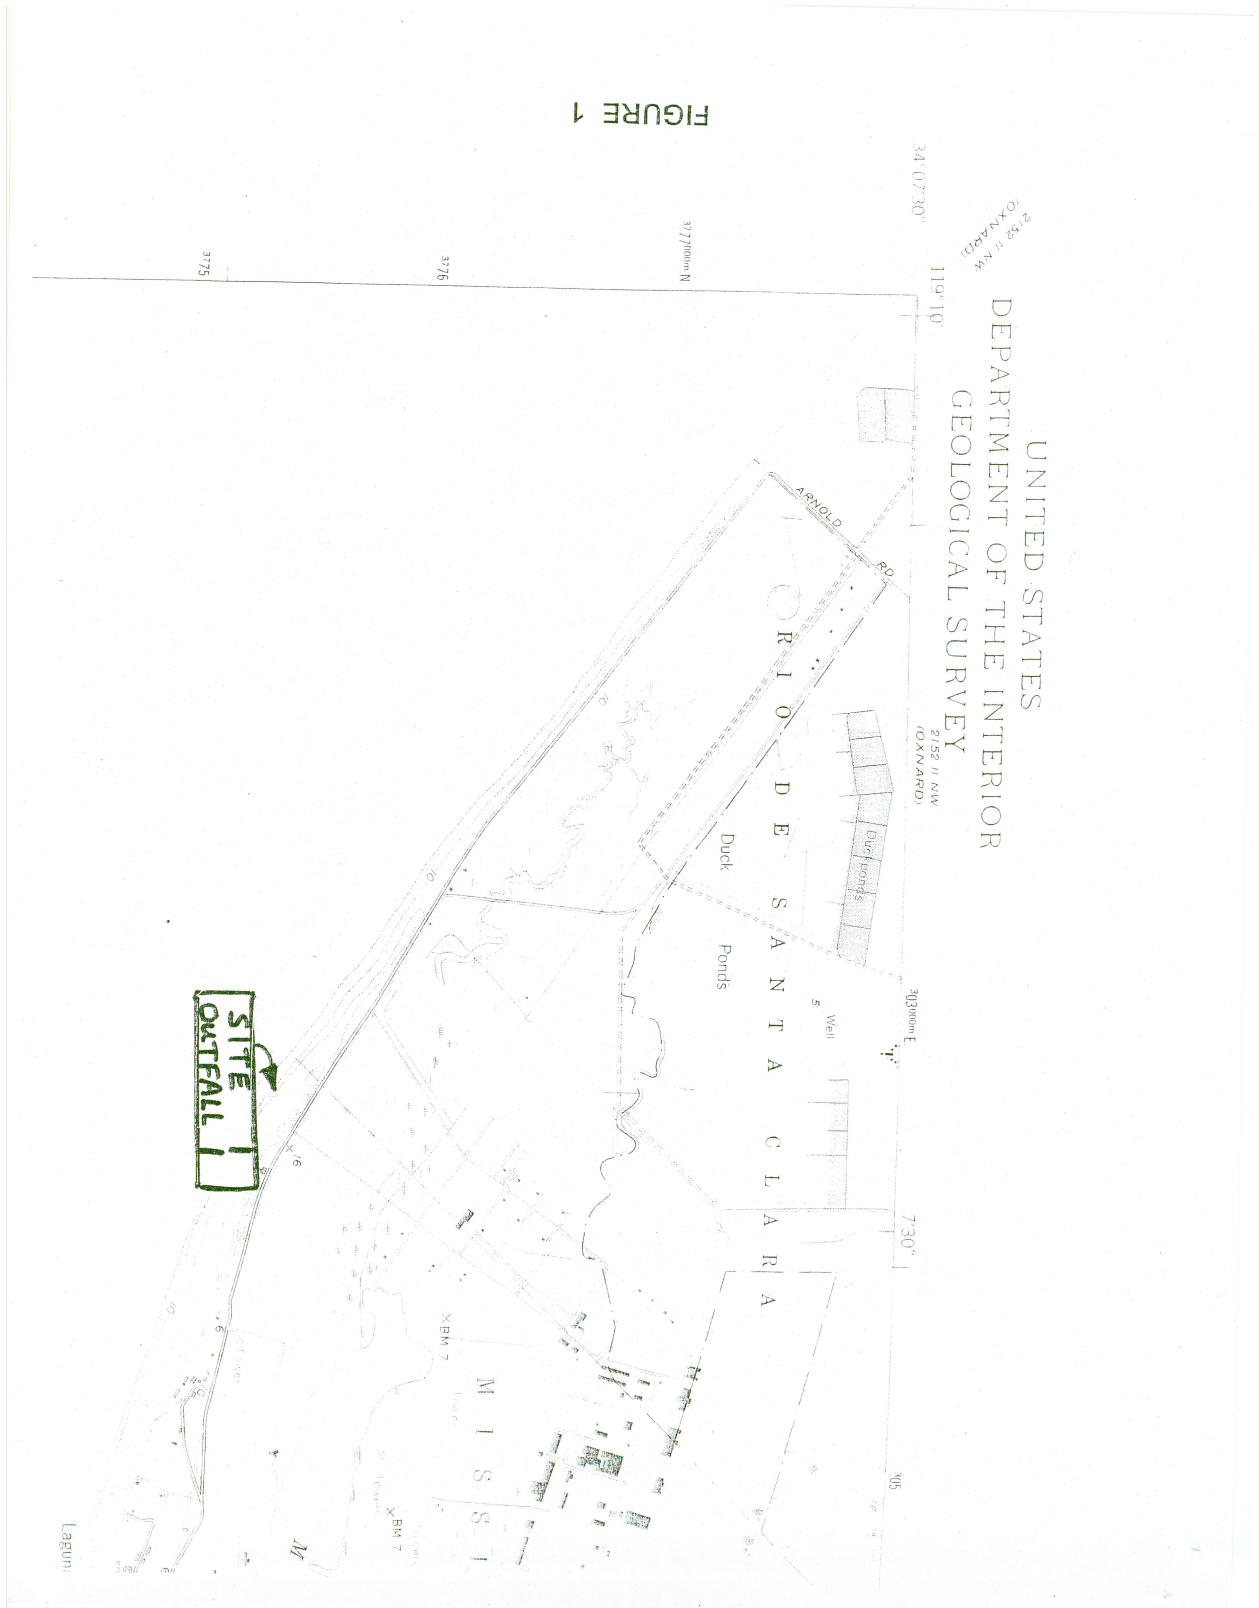


FIGURE 1

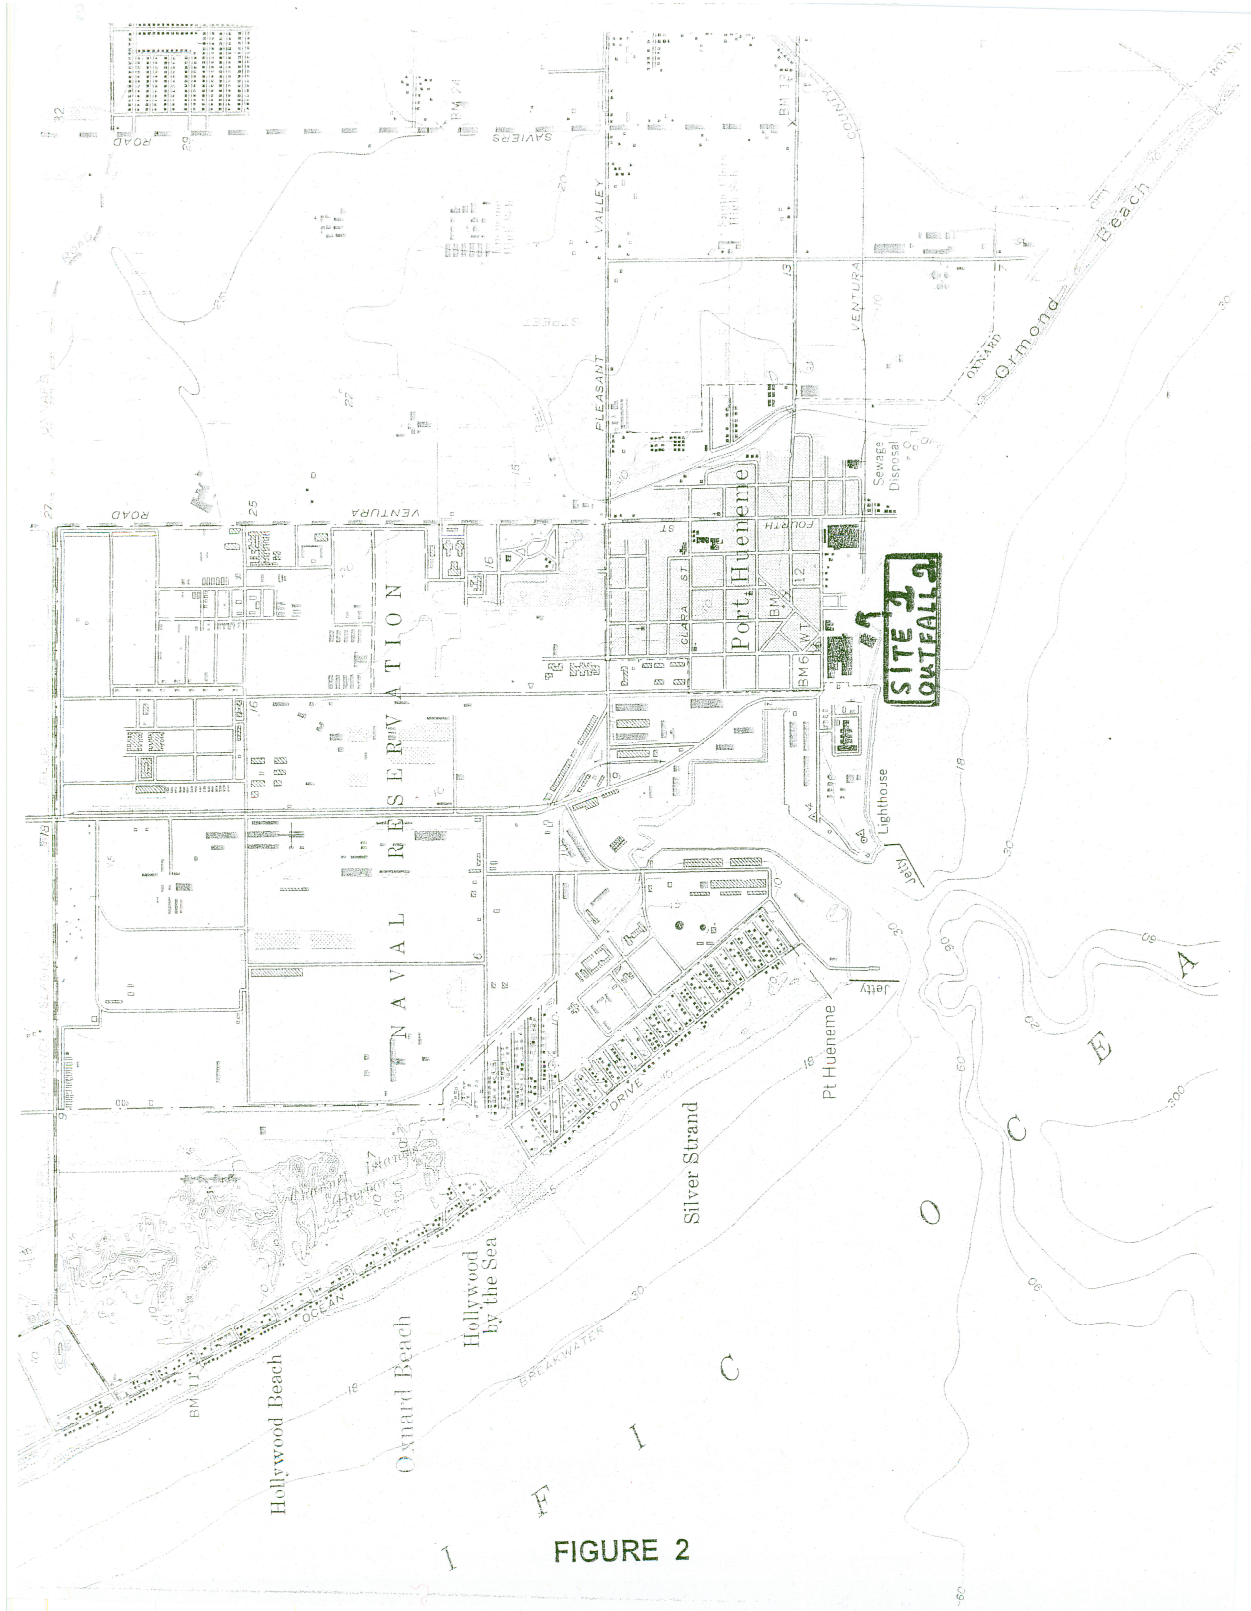


FIGURE 2