

State of California  
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
LOS ANGELES REGION  
320 West 4th Street, Suite 200, Los Angeles

**FACT SHEET**  
**NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM PERMIT**  
**FOR**  
**THE BOEING COMPANY**  
**(Santa Susana Field Laboratory)**

NPDES PERMIT NO.: CA0001309  
Public Notice No.: 07-030

**FACILITY MAILING ADDRESS**

The Boeing Company  
5800 Woolsey Canyon Road  
Canoga Park, CA 91304-1148

**FACILITY LOCATION**

The Boeing Company  
Santa Susana Field Laboratory  
Top of Woolsey Canyon  
Simi Hills, CA 91311  
Contact: Paul Costa  
(818) 466-8778

**I. Public Participation**

The California Regional Water Quality Control Board, Los Angeles Region, (Regional Board) will consider, during its October 4, 2007, meeting, the reissuance of waste discharge requirements (WDRs), which serve as a National Pollutant Discharge Elimination System (NPDES) permit to the Boeing Company for the Santa Susana Field Laboratory. Modifications to the NPDES permit are being considered in response to Order WQ 2006-0012 issued by the State Water Resources Control Board (State Board) remanding the permit to the Regional Board and to an updated Record of Waste Discharge (ROWD) submitted by Boeing on February 20, 2007. As an initial step in the process, the Regional Board staff has developed tentative WDRs. The Regional Board encourages public participation in the WDR adoption process.

**A. Written Comments**

Interested persons are invited to submit written comments concerning the tentative WDRs. Comments should be submitted either in person, or by mail to:

California Regional Water Quality Control Board  
Los Angeles Region  
320 West 4th Street, Suite 200  
Los Angeles, CA 90013

Written comments regarding the tentative Order must be received at the Regional Board office by 5:00 p.m. on September 4, 2007, in order to be evaluated by staff and included in the Board's agenda folder.

July 30, 2007

**B. Public Hearing**

The proposed WDRs will be considered by the Regional Board at a public hearing. The hearing is scheduled as follows:

Date: October 4, 2007  
Time: 9:00 A.M.  
Location: City of Simi Valley Council Chambers  
2929 Tapo Canyon Road  
Simi Valley, California

Please check the website address (<http://www.waterboards.ca.gov/losangeles/>) for the most up to date public hearing location as it is subject to change. Interested persons are invited to attend. At the public hearing the Regional Board will hear testimony, if any, pertinent to the discharge, WDRs and permit. Oral testimony will be heard; however, for accuracy of the record, important testimony should be in writing.

**C. Waste Discharge Requirements Appeals**

Any person may petition the State Water Resources Control Board to review the decision of the Regional Board regarding the final Waste Discharge Requirements. The petition must be filed within 30 days of the Regional Board's action to the following address:

State Water Resources Control Board, Office of the Chief Counsel  
Attn: Elizabeth Miller Jennings, Senior Staff Counsel  
1001 I Street, 22<sup>nd</sup> Floor  
Sacramento, CA 95812

**D. Additional Information and Copies**

The proposed language and other information and documents relied upon are available for inspection and copying between the hours of 8:00 a.m. and 4:30 p.m. by appointment at the following address:

Los Angeles Regional Water Quality Control Board  
320 West 4<sup>th</sup> Street, Suite 200  
Los Angeles, CA 90013

Arrangements for file review and/or obtaining copies of the documents may be made by calling the Los Angeles Regional Board at (213) 576-6600.

**E. Register Of Interested Persons**

Persons wishing to comment on, or object to, the tentative TSO, or submit evidence for the Board to consider, are invited to submit them in writing to Cassandra Owens at the above address, or send them electronically to: [cowens@waterboards.ca.gov](mailto:cowens@waterboards.ca.gov). To be evaluated and responded to by Regional Board staff, included in the Board's agenda folder, and fully considered by the Board, written comments or testimony regarding the tentative revisions must be received at the Regional Board office no

later than close of business on **September 4, 2007**. Failure to comply with these requirements is grounds for the Regional Water Board to refuse to admit the proposed written comment or exhibit into evidence pursuant to section 648.4, title 23 of the California Code of Regulations.

Any person interested in being placed on the mailing list for information regarding the WDRs and NPDES permit should contact the Regional Board, reference this facility, and provide a name, address, and phone number.

#### **F. Staff Contacts**

If you have any question regarding this proposed action, please contact Cassandra Owens at (213) 5760-6750 or via email at [cowens@waterboards.ca.gov](mailto:cowens@waterboards.ca.gov).

## **II. Introduction**

The Boeing Company (hereinafter Boeing or Discharger) discharged waste from its Santa Susana Field Laboratory under waste discharge requirements, which served as an NPDES permit, contained in Order No. 98-051 adopted by this Regional Board on June 29, 1998 (NPDES Permit No. CA0001309).

Boeing filed a report of waste discharge (ROWD) and applied for renewal of its WDRs and NPDES permit for discharge of wastes to surface waters. Order No. R4-2004-0111 was adopted on July 1, 2004. It incorporated effluent limitations based on the California Toxics Rule (CTR) where appropriate and added nine new compliance points.

Order R4-2006-0008 (adopted January 19, 2006), an amendment to Order No R4-2004-0111 (adopted July 1, 2004) was the result of new information incorporated into the Order after one year of compliance and routine monitoring based on Monitoring and Reporting Program (MRP) No. 6027. On March 9, 2006 Order R4-2006-0036 was adopted which incorporated total maximum daily loads (TMDLs) based effluent limitations for discharges to the Los Angeles River and to Calleguas Creek.

Subsequent to the adoption of Order R4-2004-0111, the Discharger filed a petition challenging the permit with the State Water Resources Control Board. The discharger immediately put the petition in abeyance. After the adoption of Order R4-2006-0008 in January 2006 the discharger petitioned that order, activated the previous petition and ultimately petitioned the subsequent amendment, Order R4-2006-0036. The discharger also requested that the permit be stayed pending a decision on the permit on the basis of merit.

After considering the evidence, the State Board adopted Order WQ 2006-0007 on June 21, 2006, which vacated a previous stay order issued by one of its members, and denied Boeing's request for a stay.

On December 13, 2006, the State Board held a public hearing to consider the various petitions that the discharger had filed with respect to its permit, and thereafter adopted Order WQ 2006-0012. The Order:

- Remanded the permit to the Regional Board to revise the provisions concerning Outfalls 001, 002, 011, and 018,
- Stayed the effluent limitations at Outfalls 011 and 018 pending a determination by the Regional Board to delete either Outfalls 011 and 018 or Outfalls 001 and 002 as compliance points,
- Directed the Regional Board to issue a Cease and Desist Order with the shortest possible compliance schedule and interim effluent limitations. The effective date of the CDO was to be January 19, 2006,
- Review the permit to ensure that numeric effluent limitations for different outfalls do not count the same violation twice in such a manner as to treat a single violation as multiple violations.
- In all other respects, the petitions were denied.

This Order includes the updates required by the State Board Order, updates associated with a revised Record of Waste Discharge submitted by the Discharger, and any new effluent limits that are a result of the reasonable potential analysis completed on the data obtained through May 22, 2006.

### **III. Facility and Waste Discharge Description**

The Santa Susana Field Laboratory (SSFL) is located at the top of Woolsey Canyon, in the Simi Hills, CA (Figure 1). The developed portion of the site comprises approximately 1,500 acres. There is 1,200-acres of undeveloped property located to the south. Recently, an additional 150-acres of undeveloped land has been purchased to the north of the site. SSFL is owned by both Boeing and the National Aeronautics and Space Administration (NASA). The United States Department of Energy (DOE) also owns several buildings located in Area IV, with the land being under the ownership of Boeing.

Boeing operations at SSFL since 1950 include research, development, assembly, disassembly, and testing of nuclear reactors, rocket engines, and chemical lasers. DOE conducted past operations in research and development of energy related programs, and seismic testing experiments. Current DOE activities onsite are solely related to facility closure, environmental remediation, and restoration.

SSFL was permitted to discharge excess water from its groundwater treatment system, industrial activities, onsite wastewater reclamation system, and rainfall runoff that has the potential to contain pollutants from the facilities. Approximately 60% of the discharge exited the property via two southerly discharge points (Discharge Outfalls 001 and 002) to Bell Creek, a tributary to the Los Angeles River, a water of the United States, with its confluence located near the intersection of Bassett Street and Owensmouth Avenue in Canoga Park, see Figure 1).

Past operations at the SSFL that may potentially contribute contaminants to discharges from the site include:

- Nuclear Operations, decontamination and decommissioning
- Monomethyl Hydrazine Usage,
- CTL-3 Chemical Laser Testing, and

- Energy Technology Engineering Center (ETEC) Cogeneration Operations.
- Rocket Engine and Component Testing

**Nuclear Operations, decontamination and decommissioning:** Nuclear research and development for the U.S. Department of Energy (DOE) and its predecessors was conducted at the SSFL from 1954 – 1989. The activities included developing and operating reactors, and fabricating and disassembling nuclear fuel. The government began to phase out the program in the 1960s. The last reactor was shut down in 1980, and nuclear research was terminated in 1989. This research and the associated activities resulted in residual contamination in Area IV.

There are currently no programs at the SSFL which employ special nuclear materials. Current decommissioning activities have reduced the inventory of radioactive waste at the SSFL to approximately 5 curies. Essentially all of this material is stored in shielded vaults located at the Radioactive Materials Handling Facility (RMHF). SSFL continues to utilize radioisotopes in the form of calibration sources which are necessary to calibrate radiation detectors and counting equipment. Periodic radiological monitoring of surface waters is conducted under the existing NPDES permit. Three radiological facilities located in Area IV of the SSFL remain to be decommissioned. Storm water run-off from Area IV of the SSFL is monitored for radioactivity. The Department of Energy (DOE) is responsible for the cost of decontamination and decommissioning, the California Department of Health Services (Radiological Health Branch) has radiological oversight responsibilities at Area IV of the SSFL.

**Monomethyl Hydrazine Usage:** Monomethyl hydrazine (MMH), a propellant, was used for research, development, and testing of rocket engines at the SSFL since 1955. The MMH, which was generated from testing operations was captured and treated by an ozonation unit under a variance, granted by the Department of Toxic Substances Control (DTSC). As a result, MMH was not released to the ponds from this area. In July 2004, the Discharger indicated that MMH may be used at the Systems Test Lab 4 (STL-4) and supplies of the propellant may be stored at the Storage Propellant Area (SPA). At that time, it was not used at the Advanced Propulsion Test Facility (APTF).

**CTL-3 Chemical Laser Testing:** CTL-3 Chemical Laser Testing was shutdown for chemical based laser operations and is now only used for limited research and development, with no industrial discharges.

**Energy Technology Engineering Center (ETEC) Cogeneration Operations:** The Sodium Component Testing Installation (SCTI) (cogeneration) unit of ETEC utilized two cooling tower operations, Power Pac and E-5. Both systems were shut down and will not be reactivated. The facility has been decommissioned and was demolished in July 2003.

**Rocket Engine and Component Testing:** An engine test consisted of a cycle of one to three engine runs lasting one to three minutes each. A test cycle may take one to two weeks to complete. Each engine run results in the use of 50,000 to 200,000 gallons of deluge/cooling water that may come in contact with fuels such as LOX or kerosene and associated combustion products. The frequency of testing historically varied depending on production requirements. In July 2004 the frequency of testing was one test cycle every one to two months. In January 2006 the Discharger indicated that the frequency of testing

had significantly decreased over the past year and was likely to shut down completely during the life of this permit (expiration date June 10, 2009). The updated ROWD submitted February 2007 provided documentation that rocket engine and component testing operations at the facility had terminated.

**Current and Future Operations:** Since the SSFL is a test facility, it is difficult to anticipate future test projects and possible wastewater generation. Following are descriptions of expected operations:

1. Treatment Under Tiered Permitting Rules. Boeing may explore the feasibility of treating certain waste streams by either a mobile or fixed hazardous waste treatment unit operating under DTSC Permit-by-Rule requirements. Treated effluent would then be released into the ponds.
2. Unspecified waste streams generated during remediation, cleaning, assembly, testing and support operations at the facility.

**Groundwater Remediation:** During the early 1950s to the mid-1970s, volatile organic compounds were utilized for the cleaning of hardware and rocket engine thrust chambers, and for the cleaning of other equipment. These solvents migrated into the subsurface, contaminating groundwater primarily with trichloroethylene (TCE) and 1,2-dichloroethylene (1,2-DCE).

As a result, in July 2004 there was an extensive groundwater remediation/investigation program in progress at the SSFL, which included pumping, treating and storing groundwater at the facility. The system was composed of eight treatment systems, five being active and three being inactive, which had the capability of producing up to 578 million gallons per year of groundwater treated to remove the volatile organic compounds. The treatment system was not designed to treat other pollutants such as perchlorate or metals. The chemical treatments used in groundwater treatment operations consisted of ultraviolet light and hydrogen peroxide oxidation, carbon adsorption, and the physical treatment consisted of air stripping towers. These treatment systems were regulated under Resource Conservation and Recovery Act (RCRA) part A and part B hazardous waste permits by DTSC, and various air quality control permits issued by Ventura County. Plans to add new wells may increase the volume into the system by 25%. Pumping rates in the future may increase or decrease depending upon the outcome of the groundwater remediation program. In addition, there will also be intermittent pilot projects where test wells will be drilled and groundwater treated to determine optimum locations for future wells. Effluent from the groundwater remediation operations was discharged to the water reclamation system onsite via naturally occurring streambeds and in some cases man made watercourses present onsite.

**Sewage Treatment Plants:** Historically, two package-type activated sludge sewage treatment plants (STP1 and STP3) provide secondary and tertiary treatment for the sewage. Disinfected sewage effluent from the activated sludge facilities was directed to the ponds. A third activated sludge sewage treatment plant (STP2) was available, but was used only as a pump station to STP-3 and as temporary storage of excess sewage. There were no discharges to receiving waters from STP-2.

Operations terminated at STP3 in October 2001 and at STP1 in December 2001. Recently, domestic sewage that had previously been treated at STP1 and STP3 has been diverted offsite. The STP1 and STP3 basins are used as collection points. Every few days, vacuum trucks transport the accumulated waste offsite for treatment. In July 2004, the Discharger requested that the permit continue to cover potential discharges from these plants, as it may be necessary to bring them back on line in the future.

The ROWD submitted in February 2007 indicated that discharges from the sewage treatment plants would not be resumed. Waste water collected would continue to be shipped offsite for disposal at one of the Los Angeles County Sanitation District's publicly owned treatment wastewater (POTW) facilities. The Discharger also requested that the compliance locations be deleted from this order (R4-2007-0XXX).

**Water Reclamation System and Discharges:** When in operation, effluent discharges from STP1 and STP3, the two sewage treatment plants, subsequently enter an onsite water retention system. Historically, SSFL utilized a system of natural, unlined and man-made ponds and channels to collect water from onsite operations. Water supplied to the retention system came from any one or a combination of the following sources: storm water, treated groundwater, treated sanitary sewage, rocket engine test cooling water, or domestic water purchased from an established purveyor. The water was stored in a series of 100,000-gallon steel tanks located in Area 2 called Skyline. Water from Perimeter and R-1 ponds may be pumped to the Skyline tanks where it can be transferred to Silvernale Pond. Water purchased from the Calleguas Water District was also stored at Skyline where it was used to cool test stands during engine testing and discharges to Silvernale Pond.

The water reclamation system consists of five ponds (see Figure 2).

R-1 Pond	capacity 3.7 million gallons
Perimeter Pond	capacity 1.3 million gallons
Silvernale Pond	capacity 6.0 million gallons
R2-B Pond	capacity 200,000 gallons
R2-A Pond	capacity 2.5 million gallons

Also shown on Figure 2 in Area 1 is the Coca Pond. This pond was previously used as a retention basin to collect water from the space shuttle main engine testing area. When Coca Pond is filled to capacity, it discharges to the R-2 Pond. The pond is currently used to collect water that may leak from the fire suppression system located in the former test area. If sufficient leaks occur, the pond discharges to R-2.

Area I utilized the R-1 Pond as a reservoir. Water retained in the R-1 Pond was primarily comprised of storm water. Other sources include effluent from Sewage Treatment Plant 1 and treated groundwater. While this was a water reclamation system in the past, it is currently used as a retention system to minimize discharges.

Storm water collected at the facility is primarily stored at Silvernale Pond and R-2A Pond. As in Area I, the primary source of water stored in the ponds comes from storm water. Other sources included effluent from Sewage Treatment Plant 3, cooling water runoff from test operations and treated groundwater. While this was a water reclamation system in the past, it is currently used as a retention system to minimize discharges. If the supply of

reclaimed water exceeded requirements, the water was discharged to the south through R-2A Pond, and then to Bell Creek through Outfall 002.

The SSFL is underlain by alluvium, weathered bedrock and unweathered bedrock. The alluvium occurs in narrow drainages and alluvial valleys and is underlain by the Chatsworth Formation. The Chatsworth Formation consists of fractured sandstone with interbeds of siltstone and claystone, which can transmit water as well as contaminants.

The groundwater system at the SSFL is divided into two aquifers; the shallow and the deep. The alluvium and weathered bedrock comprise the shallow aquifer, and the unweathered and fractured Chatsworth Formation comprise the deep aquifer.

The groundwater in the shallow aquifer generally reflects surface topography. In April 2002, groundwater depths in the shallow aquifer ranged from approximately 6 feet to 40 feet below grade. Wells in the deeper aquifer, contained groundwater between approximately 23 feet to approximately 520 feet below grade.

In dry weather, ongoing activities were normally sufficient to use the water generated from onsite groundwater treatment systems. However, in recent years this water balance has changed. In July 2004, the Discharger indicated that water added into the system from the Calleguas Water District, plus the reduction of testing activities, had caused releases from R-2A Pond (located upstream from Outfall 002) to become intermittent. During hot weather, the water released either evaporated or percolated into the ground before reaching Discharge Outfall 002. Thus, no offsite discharge of water occurred.

In July 2004, the discharges from Outfalls 001 and 002 which were characterized in the permit application are as follows:

<b>Constituents</b>	<b>Units</b>	<b>30-Day Average<sup>1</sup></b>	<b>Daily Maximum</b>
Flow	MGD	1.5	20
Temperature			
Winter (Oct. – April)	°F	57	59.2
Summer (May – September)	°F	71	76.2
pH	pH Units	7.9	8.41
BOD <sub>5</sub> 20°C	mg/L	6	15
Total suspended solids	mg/L	15	62
Total organic carbon	µg/L	7.4	18
Total residual chlorine	mg/L	ND	ND
Fluoride	mg/L	0.4	0.7
Nitrate	mg/L	0.42	1.1
Oil and grease	mg/L	ND	ND
Radioactivity			
Total Alpha	pCi/L	----	8.9+/-5
Total Beta	pCi/L	----	20+/-9.1
Total Radium	pCi/L	----	3.54+/-1

<sup>1</sup> The maximum of the value presented for Discharge No. 001 or Discharge No. 002.



<b>Constituents</b>	<b>Units</b>	<b>30-Day Average<sup>1</sup></b>	<b>Daily Maximum</b>
Sulfate as SO <sub>4</sub>	mg/L	120	173
Surfactants	mg/L	0.1	0.1
Barium	mg/L	17	90
Boron	mg/L	0.11	0.36
Iron	mg/L	0.09	0.22
Manganese	mg/L	51.6	170
Antimony	mg/L	2.8	5.7
Arsenic	mg/L	6.5	11
Beryllium	mg/L	ND	ND
Cadmium	mg/L	ND	ND
Chromium, Total	mg/L	7.7	10
Copper, Total	mg/L	5.2	15
Lead, Total	mg/L	1.6	3.5
Mercury, Total	mg/L	ND	ND
Nickel	mg/L	2	2
Selenium <sup>2</sup>	mg/L	2.1	2.1
Silver <sup>2</sup>	mg/L	1.2	1.4
Zinc	mg/L	28	80

Other priority pollutants were reported as not detected or not believed to be present in the discharge in the application.

Discharges from the groundwater treatment systems, the engine test stands and the water reclamation ponds located onsite in most cases enter naturally occurring drainage channels. Some of these channels are unlined, but portions of many of them have been lined or the flow is transported using piping to a natural drainage channel. Since the wastewater enters natural water transport channels onsite, these channels are considered waters of the United States and are thus subject to the Clean Water Act. These onsite natural drainage channels are tributaries to Bell Creek, hence limits for discharges to them must protect the beneficial uses for discharges to Bell Creek and the downstream reaches of the Los Angeles River. Similarly, because certain natural drainage channels are unlined and groundwater recharge is a designated beneficial use in Bell Creek and its tributaries, limits for discharges to the channels must protect the underlying beneficial uses of the groundwater.

Many of the areas that discharged wastewater to the drainage areas and streambeds were associated with RCRA activities that are being directed by DTSC. The RCRA activities at the site include Post Closure Permits and investigation and corrective action oversight of contaminated areas. The Post Closure Permits cover the operation of the groundwater treatment systems. The investigation and corrective action oversight includes the site characterization and delineation of areas of contamination as well as subsequent cleanup operations at areas of concern onsite.

The 1995 Final SB 1082 Framework which was issued on December 14, 1995 documents the framework for implementing Health and Safety Code Section 25204.6(b) dealing with

<sup>2</sup> This analyte was reported ND at Discharge No. 001. The values reported were for Discharge No. 002.

jurisdictional overlap between DTSC and the Regional Water Quality Control Boards (RWQCBs). SB 1082 requires that “sole jurisdiction over the supervision of that action [meaning oversight of those corrective action activities] is vested in either the department or the State Water Resources Control Board and the California Regional Water Quality Control Boards.” Since many of the identified wastewater sources are currently involved in the RCRA corrective action or the Post Closure Permits with DTSC as the oversight agency, consistent with RCRA, DTSC will ensure that the discharges from these operations through the RCRA permitting process meet the substantive Clean Water Act requirements. Regional Board staff will provide appropriate comments during the revision of RCRA permits to ensure the Clean Water Act, Porter-Cologne Act, and the Basin Plan requirements are met. However, at all times, the final downstream Outfalls 001 and 002 will be regulated by the accompanying NPDES permit and will implement relevant water quality standards.

There were several other operations that discharged wastewater to the onsite drainageways and streambeds which were not included in the RCRA corrective action. Order R4-2004-0111 covered these activities.

The operations evaluated at SSFL, the agency (Regional Board or DTSC) with primary oversight authority, and the NPDES outfall number associated with the operation if the Regional Board has oversight are listed below and in Figure 3.

	<b>Operation</b>	<b>NPDES Outfall No.</b>	<b>Agency</b>
1.	Wastewater and Storm water runoff	001	RWQCB
2.	Wastewater and Storm water runoff	002	RWQCB
3.	Storm water Radioactive Material Handling Facility	003	RWQCB
4.	Storm water Sodium Reactor Exp.	004	RWQCB
5.	Storm water Sodium Burn Pit 1	005	RWQCB
6.	Storm water Sodium Burn Pit 2	006	RWQCB
7.	Storm water Building 100	007	RWQCB
8.	Storm water Happy Valley	008	RWQCB
9.	Storm water WS-13 Drainage	009	RWQCB
10.	Storm water Building 203	010	RWQCB
11.	R-1 Pond	----	DTSC
12.	Perimeter Pond	011	RWQCB
13.	R-2 Ponds (R-2A and R-2B)	----	DTSC
14.	R-2 Spillway	018	RWQCB
15.	Silvernale Pond	----	DTSC
16.	Alfa Test Stand	012	RWQCB
17.	Bravo Test Stand	013	RWQCB
18.	WS-5 Groundwater Treatment System (GWTS)	----	DTSC
19.	RD-9 GWTS	----	DTSC
20.	Alfa GWTS	----	DTSC
21.	Delta GWTS	----	DTSC
22.	STLV-IV GWTS	----	DTSC

	<b>Operation</b>	<b>NPDES Outfall No.</b>	<b>Agency</b>
23.	Area 1 Road GWTS/AST	----	DTSC
24.	Bravo GWTS/AST	----	DTSC
25.	Canyon GWTS/AST	----	DTSC
26.	Interim GWTS near FSDF*	----	DTSC
27.	Interim GWTS near Bldg 59*	----	DTSC
28.	Interim GWTS near RMHF*	----	DTSC
29.	APTF	014	RWQCB
30.	STP-1 – effluent	015	RWQCB
31.	STP-2 – effluent	016	RWQCB
32.	STP-3 – effluent	017	RWQCB
33.	Groundwater Treatment System	019	RWQCB

\* Implemented in Interim Measures at the site. If the systems continue they will be included in the revised Post Closure Permit.

Operations enumerated in items 1 through 32 were included in Order R4-2004-0111 and subsequent revisions (Orders R4-2006-0008 and R4-2006-0036). Item 33 identifies a new outfall that is added in this Order (R4-2007-0XXX). The updated ROWD submitted on February 20, 2007, included a request to discharge treated groundwater to the streambed downstream of Outfall 011 and upstream of Outfall 001. The treated groundwater is a wastewater from a point source and thus will be regulated by the RWQCB in this permit. Order R4-2004-0111 and subsequent revisions did not regulate treated groundwater at the point of discharge. However, once the treated groundwater mixed with wastewater from the sewage treatment plants, rocket engine test operations, and storm water runoff in the onsite water reclamation/retention system and was subsequently discharged via Outfalls 011, 018, 001, and 002 it was regulated as a component of the mixed wastewater. The new compliance point (Outfall 019) will regulate treated groundwater only. The new compliance point is included in the previous table.

**Storm Water Discharges**

In 1989, EPA conducted an investigation and submitted a report on SSFL environmental issues. The report specified under the recommended and planned actions that the Regional Board was to use the Clean Water Act to ensure run-off from the northwest side of Area IV was not contaminated. In response to the request, Rocketdyne developed a surface water monitoring program for the northwest slope area that was subsequently approved by EPA and implemented.

The topography of the SSFL is such that approximately 60% of rainfall runoff is routed to one of the two southerly-located retention ponds and is discharged from the site via Discharge Outfalls 001 or 002. Storm water runoff from the northwest slope of the facility is monitored at Discharge Outfalls 003, 004, 005, 006, and 007 which discharge towards the Arroyo Simi. The outfall locations near the Northwest slope are located such that they capture runoff from past and existing radiological facilities.

<u>Discharge Outfall</u>	<u>Latitude (North)</u>	<u>Longitude (West)</u>	<u>Vicinity</u>
003 (RMHF)	34° 14' 4.0"	118° 42' 38.4"	Radioactive Materials Handling Facility
004 (SRE)	34° 14' 9.1"	118° 42' 23.9"	Sodium Reactor Experiment
005 (SBP-1)	34° 13' 48.1"	118° 43' 3.9"	Sodium Burn Pit 1
006 (SBP 2)	34° 13' 50.7"	118° 42' 59.9"	Sodium Burn Pit 2
007 (B100)	34° 13' 50.2"	118° 42' 52.5"	Building 100

The samples collected are analyzed for radioactivity and for a number of other priority pollutants that may be present.

There is one more storm water monitoring location Discharge Outfall 008 (formerly referred to as Happy Valley and Happy Valley 1). This outfall captures runoff from an area that has previously been used for operations that involved perchlorate and monitoring events have yielded detections of perchlorate in the storm water runoff. Storm water from Happy Valley flows to Dayton Canyon Creek. The flow from Dayton Canyon Creek joins Chatsworth Creek, which flows south to Bell Creek southwest of the intersection of Shoup Avenue and Sherman Way. Bell Creek flows east to the Los Angeles River. Order R4-2004-0111 implements effluent limits for conventional pollutants and perchlorate at Outfall 008. Monitoring for the emergent chemicals and EPA priority pollutants except asbestos was also required in that Order.

A second Happy Valley sample location (referred to as Happy Valley 2) was monitored during the 2002-2003 rainy season. The samples in most cases yielded nondetect at Happy Valley 2 while samples collected during the same rain event yielded detections of perchlorate. However on May 3, 2003 samples collected from Happy Valley 1 (Discharge Outfall 008) were nondetect for perchlorate. The sample collected from Happy Valley 2 collected on that date resulted in a perchlorate concentration of 4.6 µg/L. The nondetect at 4 µg/L and the detected concentration of 4.6 µg/L may represent very similar concentrations.

The objective of this Order is to protect the beneficial uses of receiving waters. To meet this objective, storm water runoff discharges from the SSFL are subject to requirements stipulated in this NPDES permit and the Discharger will be required to comply with all applicable provisions of the Storm Water Pollution Prevention Plan (Attachment A of the Order). This plan includes requirements to develop, implement, and when appropriate update a Storm Water Pollution Prevention Plan (SWPPP) along with Best Management Practices (BMPs) that will prevent all pollutants from contacting storm water and with the intent of keeping all contaminants of concern from moving into receiving waters.

Storm water sampling events during 1999, 2000 and 2001 yielded exceedances of existing effluent limitations for several contaminants of concern. These effluent violations indicate that the implementation of best management practices (BMPs) to control the transport of contaminants off site were not effective. Previous attempts to utilize BMPs to control the transport of contaminants offsite have proven ineffective as is demonstrated by the effluent limitation exceedances noted from Outfalls 003 through 007 on page 11 of the Fact Sheet (in the Compliance History Section). Storm water runoff exiting the northern boundary of the site travels via Meir and Runkle Canyons to the Arroyo Simi, a tributary of Calleguas Creek. Hence, this Order includes effluent limits for the storm water discharges from the site for priority pollutants with reasonable potential.

Recent site inspections resulted in the identification of two other storm water monitoring locations:

- WS-13 Drainage Area                      Discharge Outfall 009
- Building 203                                      Discharge Outfall 010

Storm water runoff from the area that drains to discharge points 001, and 002 is estimated at 160 million gallons per day (MGD) (based on a 24-hour duration, 10-year return storm). This runoff is mixed with industrial waste collected in the ponds prior to discharge. Discharges from Outfall 008 are composed solely of storm water runoff.

The estimated flow from the area that drains storm water only from the northwest slope and discharges it via discharge points 003, 004, 005, 006, 007, 009 and 010 and via various drainage channels into Meir, Runkle and Woolsey Canyons is 018 MGD. (Figure 2).

The locations and the associated drainage areas are listed below for each of the seven storm water only discharge locations:

<u>Discharge Outfall</u>	<u>Latitude (North)</u>	<u>Longitude (West)</u>	<u>Vicinity</u>
003 (RMHF)	34° 14' 4.0"	118° 42' 38.4"	Radioactive Materials Handling Facility
004 (SRE)	34° 14' 9.1"	118° 42' 23.9"	Former Sodium Reactor Experiment
005 (SBP-1)	34° 13' 48.1"	118° 43' 3.9"	Former Sodium Burn Pit 1
006 (SBP 2)	34° 13' 50.7"	118° 42' 59.9"	Former Sodium Burn Pit 2
007 (B100)	34° 13' 50.2"	118° 42' 52.5"	Building 100
009(WS-13)	Not Available	Not Available	WS-13 Drainage Area
010(Bldg. 203)	Not Available	Not Available	Building 203

There is no flow from these locations except during heavy rainfall. For purposes of access and safety, these sampling stations have been established inside the SSFL northwest property boundary. The stations are located in close proximity to past and/or existing radiological facilities or other operations, as noted in the vicinity column above.

Storm water from APTF flows toward Bell Creek and the Los Angeles River. Current operations at the facility have shut down. Past operations included small engine testing using kerosene (RP-1), hydrogen, potentially alcohol, methanol, peroxide, and liquid oxygen (LOX). Nitrogen was also used for purge gas. After testing the staging areas were not routinely washed down to remove residual contaminants from the test operations. During normal operations testing may have occurred during storm events.

It is likely that contaminants associated with the engine test material would be present in the storm water runoff from the area. Hence, this permit requires that the storm water runoff from the area be monitored. If the monitoring data indicates reasonable potential, the permit will be reopened and effluent limitations will be implemented. In July 2004, the Discharger indicated that the standard operating procedures for the area in the future would include washdowns of the staging areas after engine tests. The water associated with the washdown would be collected and disposed of offsite. If testing operations occurred during storm events, the Discharger would collect the storm water runoff from the staging area for

offsite disposal. If washdowns did not occur after test operations or if testing occurs during storm events and the water is not collected for offsite disposal, the Discharger would be required to sample it as stipulated for other storm water monitoring locations.

Historical engine testing in the area has likely resulted in residual contamination. Therefore, this permit (Order R4-2007-0XXX) includes requirements to monitor storm water runoff from the area.

**Compliance History**

An audit of the file revealed several exceedances of the effluent limits prescribed in Order No. 98-051. The Table below lists the exceedances and/or potential exceedances noted in the self-monitoring reports submitted by the Discharger. The contaminant, effluent limit, detected value and date of detection is recorded for each exceedance in the table that follows. The Table also includes footnote references to describe the disposition of each violation.

Footnote	Outfall Number	Contaminant	Effluent Limit (units)	Detected Value	Date of Exceedance
1	002	Total Suspended Solids	15 mg/L	21	08/31/1998
2	005	Mercury	0.012 µg/L	0.2	11/30/1998
10	STP1	Turbidity	2 NTU	3.1	10/13/1998
3	STP1	Turbidity	2 NTU	2.2	10/14/1998
3	STP1	Turbidity	2 NTU	2.3	11/10/1998
3	STP1	Turbidity	2 NTU	2.3	11/11/1998
3	STP1	Turbidity	2 NTU	2.4	11/24/1998
4	001	Manganese	50 µg/L	120	05/11/1999
4	001	Manganese	50 µg/L	60	05/20/1999
4	001	Manganese	50 µg/L	90	05/21/1999
4	001	Manganese	50 µg/L	110	05/24/1999
4	001	Manganese	50 µg/L	70	05/25/1999
2	004	Mercury	0.012 µg/L	0.26	02/09/1999
10	005	Antimony	6 µg/L	8	02/08/1999
10	005	Antimony	6 µg/L	7	02/09/1999
10	005	Antimony	6 µg/L	7	01/20/1999
5	005	Mercury	0.012 µg/L	8.04	11/08/1999
10	005	Copper	11 µg/L	14	11/08/1999
2	006	Mercury	0.012 µg/L	0.45	02/09/1999
10	007	Antimony	6 µg/L	8	02/09/1999
10	007	Antimony	6 µg/L	11	03/25/1999
10	007	Cadmium	3.7 µg/L	4	03/25/1999
9	003	Mercury	0.012 µg/L	0.025	2/00
9	004	Mercury	0.012 µg/L	2.3	2/00
9	005	Mercury	0.012 µg/L	0.87	2/00
9	006	Mercury	0.012 µg/L	0.17	2/00
9	007	Copper	11 µg/L	13	2/00
9	007	Mercury	0.012 µg/L	0.055	2/00
9	STP III	BOD <sub>5</sub>	>85 % removal	71.6	2/00

Footnote	Outfall Number	Contaminant	Effluent Limit (units)	Detected Value	Date of Exceedance
9	STP III	Total coliform	2.2 MPN/100 mL	60	2/00
9	STP III	Total coliform	2.2 MPN/100 mL	60	2/00
9	002	TSS	15 mg/L	20	6/00
9	007	Mercury	0.012 µg/L	0.055	2/00
9	STP III	BOD <sub>5</sub>	>85 % removal	71.6	2/00
9	STP III	Total coliform	2.2 MPN/100 mL	60	2/00
9	STP III	Total coliform	2.2 MPN/100 mL	60	2/00
9	002	TSS	15 mg/L	20	6/00
9	002	TSS	15 mg/L	16	9/00
9	005	Mercury	2.1 µg/L	3.6	1/25/00
9	005	Thallium	2.0 µg/L	3.2	3/5/00
9	006	Oil and Grease	15 mg/L	30.5	3/8/00
9	002	Thallium	2.0 µg/L	4.1	2/8/01
9	005	(NO <sub>2</sub> + NO <sub>3</sub> ) as N	8.0 µg/L	14	2/27/01
9	005	(NO <sub>2</sub> + NO <sub>3</sub> ) as N	8.0 µg/L	8.4	3/7/01
6	STP III	Turbidity	2 NTU	2.6	8/14/98
6	STP III	Turbidity	2 NTU	2.6	8/17/98
6	STP III	Turbidity	2 NTU	3.0	8/18/98
6	STP III	Turbidity	2 NTU	2.6	8/20/98
6	STP III	Turbidity	2 NTU	2.8	8/21/98
6	STP III	Turbidity	2 NTU	3.0	8/24/98
6	STP III	Turbidity	2 NTU	3.0	8/25/98
6	STP III	Turbidity	2 NTU	3.0	9/04/98
6	STP III	Turbidity	2 NTU	3.2	9/22/98
6	STP III	Turbidity	2 NTU	2.8	9/23/98
6	STP III	Turbidity	2 NTU	2.8	9/24/98
6	STP III	Turbidity	2 NTU	3.3	10/01/98
6	STP III	Turbidity	2 NTU	2.8	10/02/98
6	STP III	Turbidity	2 NTU	2.8	11/23/98
6	STP III	Turbidity	2 NTU	3.9	11/24/98
6	STP III	Turbidity	2 NTU	2.9	11/25/98
6	STP III	Turbidity	2 NTU	5.5	12/05/98
6	STP III	Turbidity	2 NTU	7.5	12/06/98
6	STP III	Turbidity	2 NTU	3.3	12/07/98
6	007	Cadmium	1	4	03/31/99
7	001	Iron	0.3 mg/L	0.67	2/12/03
7	002	Iron	0.3 mg/L	0.7	2/12/03
8	001	MBAS	0.5 mg/L	2	5/03/03

1. **The detected value should be adjusted** - Discharger sampled seven additional days during the month for a monthly average of 21 mg/L. The value of 16 mg/L on 08/06/98 was only one sample.
2. **These violations should not be included** - The method detection limit (MDL) used by the discharger is higher than the permit limit, the permit allows for the use of a PQL in

place of the permitted monthly average limit. Per the permit the PQL for this limits was calculated by taking the Permittees' MDL (0.2 µg/L) and multiplying by a factor of 10 (due to the fact that Hg is a non-carcinogen).

3. **These violations should not be included** - The daily average permit limit for turbidity is 2 NTUs. For consistency purposes the Enforcement Unit uses the following guideline: since the permit limit is only shown with one significant figure, the Permittees' results are rounded to one significant figure.
4. **These identified violations should not be included** - The Permittee stated that no flow occurred from Outfall 001 during the month of May. The Permittee took samples although no wastewater was discharged from Outfall 001.
5. **This violation should not be included** – Additional analyses were performed on the same sample within the holding time for Hg. The results varied from 8.04 µg/L to 0.2 µg/L.
6. **These identified violations should be included** - Additional violations identified by the Enforcement Unit.
7. **This violation should not be included** – Additional analyses were performed on the same samples, which yielded results consistent with historical findings and below the specified limit.
8. **This violation should not be included** – The discharger has a letter from the laboratory indicating that an inappropriate method was used to analyze the sample. A subsequent analysis of the sample yielded a nondetect result at 0.1 mg/L.
9. **This violation was included** - The NOV issued June 27, 2001 included this violation.
10. **This violation was included** – The NOV issued February 6, 2004 included this violation.

A Notice of Violation (NOV) was issued for exceedances occurring after January 2000 on June 27, 2001 and SSFL provided additional information. A revised NOV was issued on October 19, 2001 and the Administrative Civil Liability complaint was issued on April 29, 2002. The Discharger completed the stipulated requirements on October 9, 2002.

On February 6, 2004 a NOV was issued for the violations identified in the Table that occurred prior to January 2000, and subsequent to the previously mentioned NOV that have not been adequately addressed by the Discharger.

Order No. R4-2004-0111 was adopted on July 1, 2004 and implemented effluent limits that are more stringent than those from Order 98-051. That Order was updated in January 2006 and in March 2006. The discharger has reported numerous violations of the effluent limits included in these orders. Notices of Violation were issued on February 6, 2004, March 14, 2005, October 7, 2005, April 20, 2006, and November 7, 2006, for violations included in self monitoring reports submitted through May 31, 2006.



**IV. Applicable Statutes, Plans, Policies, and Regulations**

- A. *Clean Water Act (CWA)*. The federal CWA requires that any point source discharge of pollutants to a water of the United States must be done in conformance with an NPDES permit. NPDES permits establish effluent limitations that incorporate various requirements of the CWA designed to protect water quality.
- B. *Water Quality Control Plan for the Coastal Watersheds of Los Angeles and Ventura Counties (Basin Plan)*. The Basin Plan contains water quality objectives and beneficial uses for inland surface waters and for the Pacific Ocean. The receiving water for storm water runoff from Outfall 008 (Happy Valley) is Dayton Canyon Creek which flows to Chatsworth Creek. Chatsworth Creek merges with Bell Creek and Bell Creek flows into the Los Angeles River. The receiving water for the permitted discharge of the treated effluent via Outfalls 001, 002, 011 and 018 is Bell Creek a tributary to the Los Angeles River. The beneficial uses of the Dayton Canyon Creek, Bell Creek and the Los Angeles River are:

Dayton Canyon Creek – Hydrologic Unit 405.21

Existing: wildlife habitat

Intermittent: groundwater recharge, contact and non-contact water recreation; warm freshwater habitat.

Bell Creek – Hydrologic Unit 405.21

Existing: wildlife habitat

Intermittent: groundwater recharge, contact and non-contact water recreation; warm freshwater habitat.

The Los Angeles River upstream of Figueroa Street – Hydrologic Unit 405.21:

Existing: groundwater recharge; contact and non-contact water recreation, warm freshwater habitat; wildlife habitat; and wetland habitat.

Potential: industrial service supply.

Los Angeles River downstream of Figueroa Street –Hydrologic Unit 405.15

Existing: groundwater recharge, contact and non-contact water recreation, and warm freshwater habitat.

Potential: industrial service supply and wildlife habitat.

Los Angeles River downstream of Figueroa Street – Hydrologic Unit 405.12

Existing: groundwater recharge; contact and noncontact water recreation; warm freshwater habitat; marine habitat; wildlife habitat; and rare, threatened, or endangered species.

Potential: industrial service supply; industrial process supply; migration of aquatic organisms; spawning, reproduction, and/or early development; and shellfish harvesting.

Los Angeles River Estuary – Hydrologic Unit 405.12

- Existing: industrial service supply; navigation; contact and non-contact water recreation; commercial and sport fishing; estuarine habitat; marine habitat; wildlife habitat; rare, threatened, or endangered species; migration of aquatic organisms; spawning, reproduction, and/or early development; and wetland habitat.
- Potential: shellfish harvesting.

Dayton Canyon Creek, Bell Creek and all of the reaches of the Los Angeles River listed except for the estuary also have municipal and domestic supply (MUN) listed as a potential beneficial use with an asterisk in the Basin Plan. This is consistent with Regional Board Resolution 89-03; however the Regional Board has only conditionally designated the MUN beneficial uses and at this time cannot establish effluent limitations designed to protect the conditional designation.

The storm water runoff from Outfalls 003 through 007, 009 and 010 discharges from the SSFL exit the site to the northwest and flows down the Meier and Runkle Canyons toward the Arroyo Simi. The Arroyo Simi is tributary to the Calleguas Creek. The beneficial uses for the receiving water are listed below.

Arroyo Simi – Hydrologic Unit 403.62

- Existing: wildlife habitat, rare, threatened, or endangered species habitat,  
Intermittent: industrial process supply, groundwater recharge, freshwater replenishment, contact and non-contact water recreation, warm freshwater habitat;

Arroyo Las Posas – Hydrologic Unit 403.62

- Existing: groundwater recharge, freshwater replenishment, contact and non-contact water recreation, warm freshwater habitat, wildlife habitat,  
Potential: industrial process supply, industrial service supply, agricultural supply, and cold freshwater habitat.

Calleguas Creek – Hydrologic Unit 403.12

- Existing: industrial service supply, industrial process supply, agricultural supply, groundwater recharge, contact and non-contact water recreation, warm freshwater habitat, and wildlife habitat,

Calleguas Creek – Hydrologic Unit 403.11

- Existing: agricultural supply, groundwater recharge, freshwater replenishment; contact and non-contact water recreation, warm freshwater habitat, cold freshwater habitat, wildlife habitat, rare, threatened or endangered species, and wetland habitat,

Calleguas Creek Estuary – Hydrologic Unit 403.11

Existing: noncontact water recreation, commercial and sport fishing, estuarine habitat, wildlife habitat, rare, threatened or endangered species, migration of aquatic organisms, spawning, reproduction, and/or early development, and wetland habitat;  
Potential: navigation and water contact recreation.

Mugu Lagoon – Hydrologic Unit 403.11

Existing: navigation, non-contact water recreation, commercial and sport fishing, estuarine habitat, marine habitat, preservation of biological habitats, wildlife habitat, rare, threatened or endangered species, migration of aquatic organisms, spawning, reproduction, and/or early development, shellfish harvesting, and wetland habitat,  
Potential: water contact recreation.

All of the reaches of Calleguas Creek except the estuary also include conditional municipal and domestic supply designations as an intermittent or potential beneficial use in the Basin Plan.

- C. **Ammonia Basin Plan Amendment.** The 1994 Basin Plan provided water quality objectives for ammonia to protect aquatic life, in Tables 3-1 through Tables 3-4. However, those ammonia objectives were revised on April 25, 2002, by the Regional Board with the adoption of Resolution No. 2002-011, *Amendment to the Water Quality Control Plan for the Los Angeles Region to Update the Ammonia Objectives for Inland Surface Waters (including enclosed bays, estuaries and wetlands) with Beneficial Use designations for protection of Aquatic Life*. The ammonia Basin Plan amendment was approved by the State Board, the Office of Administrative Law, and USEPA on April 30, 2003, June 5, 2003, and June 19, 2003, respectively. Although the revised ammonia water quality objectives may be less stringent than those contained in the 1994 Basin Plan, they are protective of aquatic life and are consistent with USEPA's 1999 ammonia criteria update.
- D. **Title 22 of the California Code of Regulations.** The California Department of Health Services established primary and secondary maximum contaminant levels (MCLs) for a number of chemical and radioactive contaminants. These MCLs can be found in Title 22, California Code of Regulations (Title 22). Chapter 3 of the Basin Plan incorporates portions of Title 22 by reference. In addition, narrative objectives require the ground waters shall not contain taste or odor-producing substances in concentrations that affect beneficial uses. The secondary MCLs in Title 22 are designed to ensure that the water's taste and odor does not affect its suitability as drinking water. Title 22 MCLs have been incorporated into NPDES permits and Non-Chapter 15 WDRs to protect the municipal and domestic supply (MUN) and groundwater recharge (GWR), where the underlying groundwater has a designated MUN beneficial use.

Groundwater Recharge. Sections of Bell Creek and Arroyo Simi, near the SSFL discharge points, are designated as GWR indicating that groundwater recharge is a beneficial use. Surface water from the Bell Creek enter the Los Angeles River

Watershed. The headwaters of the Los Angeles River originate in the Santa Monica, Santa Susana, and San Gabriel Mountains. Four basins in the San Fernando Valley area contain substantial deep groundwater reserves and are recharged mainly through runoff and infiltration.

Surface water discharges from the north west edge of the SSFL are directed to Arroyo Simi, a tributary located in the Calleguas Creek Watershed. Supplies of groundwater are critical to agricultural operations and industry (sand and gravel mining) in this watershed.

Moreover, much of the population in the watershed relies upon groundwater for drinking. Since groundwater from these basins is used to provide drinking water to a large portion of the population, Title 22-based limits are needed to protect that drinking water supply. By limiting the contaminants in the SSFL discharges, the amount of pollutants entering the surface waters and groundwater basins are correspondingly reduced. Once groundwater basins are contaminated, it may take years to clean up, depending on the pollutant. Compared to surface water pollution, investigations and remediation of groundwater are often more difficult, costly, and extremely slow. For these reasons Title 22-based limits will remain in the NPDES permit where there is reasonable potential.

On December 17, 2003, the Regional Board received the December *2003 Technical Memorandum Analysis of Groundwater Recharge, Santa Susana Field Laboratory, Ventura County, California*, prepared by Montgomery Watson Harza on behalf of the Boeing Company. This document was submitted to DTSC in order to present a qualitative and quantitative analysis of groundwater recharge at the Santa Susana Field Laboratory. Regional Board staff have also reviewed this document and find that a reasonable conclusion for the amount of rainfall that infiltrates soil using a water balance method is between 23% to 26%. Using a chloride mass balance method resulted in a range of 1% to 12% rainfall infiltration. As these calculations by different methodologies differ significantly and are inconclusive, Regional Board staff find that there is insufficient data to suggest that rainfall will not significantly recharge groundwater in the underlying surficial soils, weathered and fractured bedrock. In addition, there has been no site-specific soil attenuation factor/model submitted for Regional Board staff review. Inasmuch, those limits placed in this Order to protect groundwater recharge beneficial uses and beneficial uses of underlying groundwater apply at end-of-pipe.

Action Levels. California Department of Health Services (DHS) establishes Action Levels (ALs), or health based advisory levels, for chemicals in drinking water that lack MCLs. An AL is the concentration of a chemical in drinking water that is considered not to pose a significant risk to people ingesting that water on a daily basis. ALs may be established by DHS for non-regulated chemical contaminants when one of the following occurs:

1. A chemical is found in an actual or proposed drinking water source, or
2. A chemical is in proximity to a drinking water source, and guidance is needed, should it reach the source.

An AL is calculated using standard risk assessment methods for non-cancer and cancer endpoints, and typical exposure assumptions, including a 2-liter per day ingestion rate, a 70-kilogram adult body weight, and a 70-year lifetime. For chemicals that are considered carcinogens, the AL is considered to pose “de minimus” risk, i.e., a theoretical lifetime risk of up to one excess case of cancer in a population of 1,000,000 people – the  $10^{-6}$  risk level. (In that population, approximately 250,000 – 300,000 cases of cancer would be anticipated to occur naturally.) ALs may be revised from time to time to reflect new risk assessment information. Chemicals for which ALs are established may eventually be regulated by MCLs, depending on the extent of contamination, the levels observed, and the risk to human health. A number of the contaminants for which action levels were originally established now have MCLs.

In 1997, DHS established an 18  $\mu\text{g/L}$  AL for perchlorate. DHS used the upper value of the 4 to 18  $\mu\text{g/L}$  range that resulted from the “provisional” reference dose that USEPA prepared in support of its Superfund activities. A revised external review draft perchlorate reference dose corresponding to a drinking water concentration of 1  $\mu\text{g/L}$  was released in 2002. DHS concluded that the AL needed to be revised downward. On January 18, 2002, DHS reduced the perchlorate AL to 4  $\mu\text{g/L}$ . The revised AL coincided with the analytical detection limit for purposes of reporting and was at the lower end of the 4 to 18  $\mu\text{g/L}$  range from the USEPA 1992-1995 assessment. The Public Health Goal (PHG) for perchlorate was developed by Office of Environmental Health Hazard Assessment based on a contemporary health risk assessment. This new information was provided to DHS and on March 11, 2004 the AL for perchlorate was revised to 6  $\mu\text{g/L}$ , a value identical to the PHG that will be used by DHS to develop the MCL for perchlorate. The effluent limit for perchlorate included in this Fact Sheet and in the revised-tentative WDR (dated March 25, 2004) has been updated to reflect the change in the AL by DHS (from 4  $\mu\text{g/L}$  to 6  $\mu\text{g/L}$ ).

Perchlorate and its salts are used in, but not limited to, solid propellant for rockets, missiles, and fireworks. The defense and aerospace industries purchase more than 90 percent of all the perchlorate manufactured. Perchlorate has historically been used at SSFL and thus is considered a chemical of concern at the site. Monitoring data collected during the tenure of the current permit indicates that perchlorate was present in the storm water runoff in Happy Valley and it has been detected in some of the groundwater wells utilized in the cleanup operations ongoing with DTSC oversight.

Perchlorate can interfere with iodide uptake by the thyroid gland; this can result in a decrease in the production of thyroid hormones, which are needed for prenatal and postnatal growth and development, as well as for normal body metabolism. Neither, the CTR, NTR or the Basin Plan has requirements stipulated for perchlorate. Since there is no drinking water standard, or maximum contaminant level (MCL), the DHS uses the AL as an advisory level. The Regional Board, exercising its best professional judgement, in the review of the “best available science” has in the past considered and used ALs when deemed appropriate to establish final effluent limitations in WDRs and NPDES permits adopted by this Board, to implement the Basin Plan narrative WQO, *“all waters shall be maintained free of toxic substance*

*that produce detrimental physiological responses in human, plant, animal, or aquatic life,”* and to prevent degradation of valuable groundwater sources of drinking water.

- E. Under title 40 Code of Federal Regulations (40 CFR) section 122.44(d), *Water Quality Standards and State Requirements*, “Limitations must control all pollutants or pollutant parameters (either conventional, non-conventional, or toxic pollutants), which the Director determines are or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality.” Where numeric effluent limitations for a pollutant or pollutant parameter have not been established in the applicable state water quality control plan, 40 CFR section 122.44(d)(1)(vi) specifies that water quality-based effluent limitations (WQBELs) may be set based on United States Environmental Protection Agency (USEPA) criteria, and may be supplemented where necessary by other relevant information to attain and maintain narrative water quality criteria, and to fully protect designated beneficial uses.
- F. In July 2004 the influent to the package type sewage treatment plants located at SSFL meet the requirements for the special consideration for less concentrated influent wastewaters. Section 133.103 of 40 CFR provides guidance on special considerations for secondary treated effluent. Paragraph (d) address less concentrated influent wastewater for separate sewers. The regulation states that:
- “The Regional Administrator or, if appropriate, State Director is authorized to substitute either a lower percent removal requirement or a mass loading limit for the percent removal requirements set forth in sections 133.102 (a) (3), 133.102 (a) (4) (iii), 133.102 (b) (3), 102.105 (a) (3), 133.105(b) (3) and 133.105(e) (1) (iii) provided that the permittee satisfactorily demonstrates that: (1) The treatment works is consistently meeting, or will consistently meet, its permit effluent concentration limits but its percent removal requirements cannot be due to less concentrated influent wastewater (2) to meet the percent removal requirements, the treatment works would have to achieve significantly more stringent limitations than would otherwise be required by the concentration-based standard, and (3) the less concentrated influent wastewater is not the result of excessive infiltration/inflow.”
- Consequently, this permit has substituted the mass loading limit for the percent removal requirement. However, there is a requirement that the influent monitoring be completed at least annually such that the per cent removal can be calculated.
- G. Section 402(p) of the federal Clean Water Act (CWA), as amended by the Water Quality Act of 1987, requires NPDES permits for storm water discharges. The Discharger in addition to meeting the effluent limits included in this permit for storm water discharges only will be required to develop and implement a SWPPP as stipulated in Finding 27 of the Waste Discharge Requirements. These requirements as they are met will protect and maintain existing beneficial uses of the receiving water.
- H. On May 18, 2000, the USEPA promulgated numeric criteria for priority pollutants for the State of California [known as the *California Toxics Rule* (CTR) and codified as

40 CFR section 131.38]. On March 2, 2000, the State Board adopted the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (State Implementation Policy or SIP)*. The SIP was effective on April 28, 2000 with respect to the priority pollutant criteria promulgated for California by the USEPA through National Toxics Rule (NTR) and to the priority pollutant objectives established by the Regional Boards in their Basin Plans, with the exception of the provision on alternate test procedures for individual discharges that have been approved by the USEPA Regional Administrator. The alternate test procedures provision was effective on May 22, 2000. The SIP was effective on May 18, 2000, with respect to the priority pollutant criteria promulgated by the USEPA through the CTR. The State Board adopted an amendment to the SIP on February 24, 2005, that became effective on July 13, 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control.

- I. Section 402(o) of the Clean Water Act and 40 CFR section 122.44(l) require that water-quality based effluent limits in re-issued permits must be at least as stringent as in the existing permit (anti-backsliding). There are, however, exceptions to the prohibition which are codified in sections 303(d)(4) and/or 402(o)(2) of the Clean Water Act. Hence, many of the limits from the existing waste discharge requirements contained in Regional Board Order No. 98-051, adopted by the Regional Board on June 29, 1998 have been included in this Order. For those limits carried forward, the Regional Board has determined that there is reasonable potential for the pollutant to cause or contribute to an exceedance of water quality standards in accordance with State Board Order No. WQ2003-0009. Reasonable potential is determined using the procedures established in the SIP, informed by professional judgment.
- J. Antidegradation. On October 28, 1968, the State Board adopted Resolution No. 68-16, *Maintaining High Quality Water*, which established an antidegradation policy for State and Regional Boards. Similarly, the CWA (section 304(d)(4)(B)) and USEPA regulations (40 CFR section 131.12) require that all NPDES permitting actions be consistent with the federal antidegradation policy. Specifically, waters that are of a higher quality than needed to maintain designated beneficial uses shall be maintained at the higher water quality unless specific findings are made.
- K. *Watershed Management Approach*. The Regional Board has implemented a Watershed Management Approach, in accordance with *Watershed Protection: A Project Focus* (EPA841-R-95-003, August 1995), to address water quality protection in the Los Angeles Region. Programs covered under the Watershed Management Approach include regulatory (e.g., NPDES), monitoring and assessment, basin planning and water quality standards, watershed management, wetlands, TMDLs, 401 certifications, groundwater (as appropriate), and nonpoint source management activities. The Watershed Management Approach integrates the Regional Board's many diverse programs, particularly, permitting, planning, and other surface-water oriented programs. It emphasizes cooperative relationships between regulatory agencies, the regulated community, environmental groups, and other stakeholders in the watershed to achieve the greatest environmental improvements with the resources available. This approach facilitates a more accurate assessment of cumulative impacts of pollutants from both point and nonpoint sources.

The Los Angeles River watershed is one of the largest in the Region. The headwaters of the Los Angeles River originate in the Santa Monica, Santa Susana, and San Gabriel Mountains. The river flows through industrial and commercial areas and is bordered by rail yards, freeways, and major commercial and government buildings. The Los Angeles River tidal prism/estuary begins in Long Beach at Willow Street and runs approximately three miles before joining with Queensway Bay located between the Port of Long Beach and the city of Long Beach.

The wastewater discharge from Outfalls 001 and 002 at the SSFL enters Bell Creek near the headwaters of the Los Angeles River. The storm water runoff from Happy Valley (Outfall 008) exits the site via Dayton Canyon Creek which flows to Bell Creek and subsequently the Los Angeles River.

The other storm water runoff exiting the SSFL site does so near the northwest site boundary from Outfalls 003 through 007, 009 and 010. The receiving water for the storm water runoff from these locations is the Arroyo Simi, a tributary of Calleguas Creek. The Calleguas Creek Watershed extends from the Santa Monica Mountains and Simi Hills in the south, to the Santa Susana Mountains, South Mountain, and Oak Ridge in the north. Land uses vary throughout the watershed. Urban developments are generally restricted to the city limits of Simi Valley, Moorpark, Thousand Oaks, and Camarillo. Agricultural activities are spread out along valleys and on the Oxnard Plain.

The storm water discharge exits the site and travels down Meier and Runkle Canyons towards the Arroyo Simi. Most of the land use around the facility is open area. Overall the Calleguas Creek Watershed is considered an impaired watershed. It appears that the sources of many of these pollutants are agricultural activities. Approximately fifty percent of the watershed is still open space although there is a severe lack of benthic and riparian habitat present. The discharge, when it is sufficient to reach the Arroyo Simi, enters it in Reach 1 – Hydrological Unit 403.62.

- L. *303(d) Listing of Impaired Waterways.* Bell Creek, which is the receiving water for the wastewater discharge from Outfalls 001, and 002 is on the 2002 303(d) list with high coliform count as the stressor.

The storm water runoff discharge from Outfalls 003 through 007, 009 and 010, when it is sufficient to reach the Arroyo Simi, enters it in Reach 1 – Hydrological Unit 403.62. The stressors listed in the 2002 State Board's California 303(d) list for this reach of Arroyo Simi are ammonia, boron, chloride, sulfates, fecal coliform, organophosphorous pesticides, sediment/siltation, and total dissolved solids.

- M. Total Maximum Daily Load (TMDL)

The TMDL development for the Los Angeles River watershed and for Calleguas Creek has been developed for a number of the constituents on the California State Water Board 2002 303(d) list. The WQBELS in this permit have been analyzed to ensure they are consistent with the assumptions and requirements of the WLAs in those TMDLS. The TMDLS, which are not scheduled for completion within the lifetime of this permit, will include WLAs for the 303(d) listed pollutants. When each TMDL is complete, the Regional Board will adopt WQBELS consistent with the



corresponding WLAs. If authorized, a time schedule may be included in a revised permit to require compliance with the final WQBELs.

- N. LA River Nitrogen (Nutrients) TMDL. The TMDL for Nitrogen (nutrients) in the Los Angeles River received Regional Board approval on July 10, 2003 (Resolution No. 03-009) and State Board approval with adoption of Order 2003-0074 on November 19, 2003. Office of Administrative Law (OAL) and USEPA approval dates were February 27, 2003 and March 18, 2003, respectively. The Regional Board filed a Notice of Decision with the California Resources Agency on March 23, 2004 and the TMDL was effective as of that date. The Los Angeles River Nutrient TMDL revision with Interim WLAs was approved by the Regional Board on December 4, 2003 (Resolution No. 2003-016). The State Board approved the TMDL with Resolution 2004-0014 on March 24, 2004. OAL approved it on September 27, 2004, and the effective date for the Order was September 27, 2004.

The TMDL includes numeric targets for ammonia as nitrogen (NH<sub>3</sub>-N), Nitrate-nitrogen and nitrite-Nitrogen within Reach 5 (within Sepulveda Basin), Reach 3 (Riverside Drive to Figueroa Street), and the Burbank Western Channel. Waste loads are allocated to minor point sources in these reaches that are enrolled in industrial and construction storm water permits.

- O. LA River Metals TMDL. The TMDL for metals in the Los Angeles River was approved by the Regional Board during the June 2, 2005 hearing (Resolution No. 2005-006). State Board approved the TMDL on October 20, 2005. OAL approved the TMDL on December 9, 2005 and EPA approved it on December 22, 2005. The TMDL for metals in storm water is in effect for discharges to the specified reaches of the Los Angeles River.

The metals TMDL implements numeric water quality targets that are based on objectives established by USEPA in the CTR. Targets for copper, lead, zinc and/or selenium (total recoverable) are established in designated reaches of the Los Angeles River. Separate water quality targets are established for dry and wet weather discharges.

The TMDL for metals in the Los Angeles River includes an implementation schedule for non-storm water NPDES permits (including POTWs, other major, minor, and general permits). SSFL is included in this group of permittees. The implementation schedule states that NPDES permits shall achieve waste load allocations, which shall be expressed as NPDES water quality-based effluent limitations. Compliance schedules may allow up to five years in individual NPDES permits to meet permit requirements.

Discharges from SSFL, of wastewater and of storm water runoff only, exiting the site enter Bell Creek or Dayton Canyon Creek. Dry weather numeric water quality targets for copper, lead, and selenium are established for Bell Creek in the TMDL. WLAs are assigned to all point source discharges to Bell Creek and tributaries to Bell Creek. Wet-weather numeric targets for cadmium, copper lead and zinc are established for Los Angeles (LA) River Reach 1 in the TMDL. WLAs are assigned to all point source discharges to LA River Reach 1 and all upstream reaches and tributaries to Reach 1 (including Bell Creek and tributaries to Bell Creek). Hence, effluent limits for

cadmium, copper, lead, zinc, and selenium in discharges to Bell Creek, Dayton Canyon Creek, or any tributaries of the LA River will be based on WLAs established by the TMDL or existing permit limits, whichever are more protective.

- P. LA River Trash TMDL. The Los Angeles River Trash TMDL was adopted by the Regional Board on September 19, 2001. The TMDL established a numeric target of zero trash in the river. The TMDL was to be implemented via storm water permits in a phased reduction for a period of ten years. The LA River Trash TMDL was approved by the State Water Resources Control Board on February 19, 2002, Office of Administrative Law on July 16, 2002 and by the US EPA on August 1, 2002. The TMDL became effective on August 28, 2002.

There were a number of challenges to the LA River Trash TMDL. The consideration of the challenges resulted in a requirement that the TMDL be set aside and not implemented until the California Environmental Quality Act (CEQA) requirements have been satisfied. On June 8, 2006, the Los Angeles Regional Water Quality Control Board adopted a resolution to set aside the adopted TMDL. On July 17, 2006, the State Board adopted Resolution 2006-0051, setting the TMDL aside.

Since, it has been set aside, this Order does not include any requirements associated with the LA River Trash TMDL.

- Q. Calleguas Creek Chloride (Salts) TMDL. On March 22, 2002, the consent decree deadline for the establishment of a chloride TMDL, USEPA Region 9 established the Calleguas Creek Total Maximum Daily Load for chloride. The TMDL adopted by USEPA was based largely on the technical efforts produced by the Regional Board staff.

The Calleguas Creek Watershed Group in collaboration with USEPA Region 9 and the Regional Board is developing the *Calleguas Creek Watershed Salts TMDL Work Plan*. The work plan addresses chloride, TDS, sulfate and boron in the watershed. The Regional Board and USEPA may use the work product from the Calleguas Creek Watershed Group to establish a subsequent TMDL for chloride in the Calleguas Creek Watershed.

Discharges from SSFL enter the Calleguas Creek Watershed in Arroyo Simi Reach 7, which is included on the 303 (d) list as a chloride water quality limited segment in the Calleguas Creek Watershed. There are no waste load allocations (WLAs) for point source discharges or load allocations (LAs) for nonpoint sources in effect under storm conditions in the TMDL. Since all discharges from the SSFL to the Arroyo Simi occur as a result of storm water runoff, no chloride WLAs will be included in this Order for discharges from Outfalls 003 through 007, 009 and 010 to Arroyo Simi. Based on existing data, SSFL does not appear to contribute chloride loading to the watershed at levels that would alter the assumptions of the TMDL or contribute to further impairment.

- R. Calleguas Creek Nitrogen Compounds and Related Effects TMDL. On October 24, 2002, the Regional Board adopted Resolution No. 2002-017, Amendment to the *Basin Plan for the Los Angeles Region* to Include a TMDL for Nitrogen Compounds

and Related Effects in Calleguas Creek (*Nitrogen Compounds and Related Effects TMDL*). The State Board approved the Nitrogen Compounds and Related Effects TMDL on March 19, 2003. The Office of Administrative Law approved the TMDL on June 5, 2003 and USEPA approved it on June 20, 2003.

The *Nitrogen Compounds and Related Effects TMDL* includes waste load allocations for ammonia (NH<sub>3</sub>), nitrite as nitrogen (NO<sub>2</sub>-N), nitrate as nitrogen (NO<sub>3</sub>-N), and nitrate plus nitrite as nitrogen (NO<sub>2</sub>-N + NO<sub>3</sub>-N). The TMDL authorizes interim limits (expressed as interim waste allocations) for total nitrogen (NO<sub>3</sub>-N + NO<sub>2</sub>-N). The WLA applied to the publicly owned treatment works (POTW) in the watershed and the LAs are specified for agricultural discharges. Hence, this Order does not include the TMDL limits for ammonia, nitrate as nitrogen, nitrite as nitrogen, or nitrate plus nitrite as nitrogen for discharges of storm water only from the SSFL to Arroyo Simi and Calleguas Creek. However, based on existing data, SSFL does not appear to contribute nitrogen loading to the watershed at levels that would alter the assumptions of the TMDL or contribute to further impairment.

- S. Calleguas Creek Toxicity, Chlorpyrifos, Diazinon TMDL. The Regional Board approved the Basin Plan amendment to incorporate the TMDL for toxicity, chlorpyrifos, and diazinon in the Calleguas Creek, its tributaries and Mugu Lagoon (Resolution No. R4-2005-009) on July 7, 2005. The TMDL addresses impairment to water quality due to elevated levels of chlorpyrifos, diazinon, other pesticides and/or other toxicants. The amendment includes numeric targets, WLAs, and load allocations for Toxicity Unit Chronic, chlorpyrifos, and diazinon. It also includes a compliance schedule of two years from the effective date of the TMDL to meet the final WLAs and ten years to meet the LAs applied to nonpoint sources.

State Board approved the TMDL on September 22, 2005 (Resolution No. 2005-0067). OAL and EPA approvals were effective on November 27, 2005, and March 14, 2006, respectively. The TMDL became effective on March 24, 2006. A wasteload of 1.0 TUC is allocated to the major point sources (POTWs) and minor port sources discharging to the Calleguas Creek Watershed. Interim and final waste load allocations and were also established for chlorpyrifos and diazinon. The implementation schedule specifies that the interim limits for chlorpyrifos and diazinon in storm water NPDES permits be in stream limits. The appropriate waste load allocations will be translated into permit limits and included in this Order (R4-2007-0XXX).

- T. Calleguas Creek and Mugu Lagoon OC Pesticides, PCBs, and Siltation TMDL. Resolution No. R4-2005-0010, a TMDL for organochlorine (OC) pesticides, polychlorinated biphenyl (PCBs) and siltation in Calleguas Creek, its tributaries, and Mugu Lagoon, was also approved by the Regional Board on July 7, 2005. The TMDL addresses impairment to water quality due to elevated concentrations of OC pesticides and PCBs, which can bioaccumulate in fish tissue and cause toxicity to aquatic life in estuarine and inland waters. Siltation may transport these contaminants to surface waters and impair aquatic life and wildlife habitats. The TMDL establishes water column targets, fish tissue targets, and sediment targets to ensure the protection of beneficial uses. The TMDL establishes a twenty-year compliance plan for reducing OC pesticides, PCBs and siltation loads from point sources and nonpoint sources.

State Board approved the TMDL on September 22, 2005 (Resolution No. 2005-0068). OAL and EPA approvals followed on January 20, 2006, and March 14, 2006, respectively. The TMDL was effective on March 24, 2006. The appropriate targets will apply to discharges from Outfalls 003 through 007, 009, and 010 which enter Arroyo Simi, a tributary of Calleguas Creek.

The TMDL also includes waste load allocations for OC pesticides and PCBs in sediment in Calleguas Creek and its tributaries. The waste load allocations have been translated directly into ambient contaminant concentrations in the sediment of Arroyo Simi. Those ambient contaminant concentrations will be compared directly to sediment concentrations measured in the samples collected to determine compliance with the interim or final waste load allocations stipulated.

The Calleguas Creek OC Pesticides and PCBs TMDL includes a compliance schedule of twenty years. As per the May 10, 2007, memorandum with the subject "Compliance Schedules for Water Quality-Based Effluent limitations in NPDES Permits" from James A. Hanlon, Director of Wastewater Management to Alexis Strauss, Director of the Water Division at USEPA Region 9, this permit includes both the final and interim WLAs with a compliance schedule providing a maximum of five years of operation utilizing the interim WLAs. The permit includes a provision to reopen the permit to implement the final WLAs if the data collected supports implementation of the final WLAs prior to the renewal of the permit.

The waste load allocations in the water column will be translated into effluent limitations utilizing the steady state model from the SIP. The calculated effluent limits will be included in the permit as receiving water effluent limits. Since the discharge is storm water and it is near the top of the watershed, the Discharger may utilize the option of sampling the discharge for the OC pesticides and PCBs or sampling the receiving water. The Discharger may also choose to join the Calleguas Creek Watershed TMDL Monitoring Program (CCWTMP) and monitor at an established compliance sampling location in Arroyo Simi.

- U. Calleguas Creek and Mugu Lagoon Metals and Selenium TMDL. Resolution R4-2006-012, the TMDL for metals and selenium for Calleguas Creek, its tributaries and Mugu Lagoon was adopted by the Los Angeles Regional Board on June 8, 2006. The TMDL establishes numeric targets for dissolved copper, nickel, and zinc, and in total recoverable mercury and selenium. It also includes fish tissue targets for mercury, bird egg targets for mercury and selenium and sediment quality guidelines for copper, nickel, and zinc.

State Board approved the TMDL on October 25, 2006 (Resolution No. 2006-0078). OAL and EPA approval the TMDL on February 6, 2007, and March 26, 2007, respectively. The TMDL became effective on March 26, 2007. The TMDL includes final waste load allocations for wet weather total recoverable copper and nickel. A concentration-based waste load allocation applied during both wet and dry weather was also included in the TMDL for mercury.

Discharges from the Boeing SSFL site (Outfalls 003 through 007, 009, and 010) enter Calleguas Creek in Reach 7, which was noted as Arroyo Simi Reaches 1 and

2 in the 1998 303(d) List. Dry weather discharges from this area do not reach Calleguas Creek and Mugu Lagoon. Therefore, no dry weather waste load allocations are established for the constituents in the water column. Selenium waste load allocations have not been developed for this reach as it is not on the 303 (d) list. The final waste load allocation developed for mercury was 0.051 µg/L based on CTR. The mercury waste load allocation was used to develop a daily maximum effluent limit, implemented at Outfalls 003 through 007, 009, and 010.

Final waste load allocations for wet daily maximum concentrations of copper and nickel are stipulated as 31.0 and 958 µg/L, respectively. The daily maximum limit for copper is included in the permit. The TMDL-based daily maximum for nickel (958 µg/L), which was developed to protect aquatic life in the lower Calleguas Creek and Mugu Lagoon, is greater than the Title 22-based MCL limit of 100 µg/L. Since the groundwater basin below the Arroyo Simi has the municipal and domestic supply as an existing beneficial use and Arroyo Simi has groundwater recharge as an intermittent beneficial use, the effluent limitation implemented must be protective of both groundwater recharge and of the downstream aquatic life beneficial uses. Therefore, the 100 µg/L effluent limitation, which is protective of the beneficial uses of Arroyo Simi and the groundwater basin below it, has been implemented for nickel.

## **V. Regulatory Basis for Effluent Limitations**

### **A. General Basis for Effluent Limits**

Effluent limitations established pursuant to Sections 301 (Effluent Limitations), 302 (Water Quality-Related Effluent Limitations), 303 (Water Quality Standards and Implementation Plans), 304 (Information and Guidelines), and 402 (NPDES) of the Federal Clean Water Act and amendments thereto, are applicable to the discharges covered by the tentative order.

### **B. Water Quality Based Effluent Limitations (WQBELs)**

The WQBELs are based on the Basin Plan, other State plans and policies, or USEPA water quality criteria. These requirements, as they are met will protect and maintain existing beneficial uses of the receiving water. Where numeric water quality objectives have not been established in the Basin Plan, 40 CFR section 122.44(d) specifies that WQBELs may be set based on USEPA criteria and supplemented, where necessary by, other relevant information to attain and maintain narrative water quality criteria to fully protect designated beneficial uses.

The previous NPDES permit for SSFL (Order No. 98-051) included monthly averages for chemicals of concern discharged from Outfalls 003 through 008. The discharges from these outfalls consist solely of storm water runoff. These discharges are seasonal and infrequent. Individual NPDES permits that regulate storm water runoff only discharges issued recently by the Regional Board do not contain monthly average limitations. Hence, this Order does not contain monthly average limitations for the storm water runoff only discharges from these outfalls.

C. Reasonable Potential Analysis

Discharges from the engine test stands had not been previously regulated independently. These discharges did not have specific monitoring requirements or effluent limits. This permit includes effluent limits for conventional pollutants and requires monitoring for the EPA priority pollutants excluding asbestos from the engine test areas.

In accordance with Section 1.3 of the SIP, the Regional Board will conduct a reasonable potential analysis (RPA) for each priority pollutant with an applicable criterion or objective to determine if a WQBEL is required in the permit. The Regional Board will analyze effluent data to determine if a pollutant in a discharge has a reasonable potential to cause or contribute to an excursion above a state water quality standard. For all parameters that have a reasonable potential, numeric WQBELs are required. The RPA considers water quality objectives outlined in the CTR, NTR, as well as the Basin Plan. To conduct the RPA, the Regional Board must identify the maximum observed effluent concentration (MEC) for each constituent, based on data provided by the Discharger.

Section 1.3 of the SIP provides the procedures for determining reasonable potential to exceed water applicable water quality criteria and objectives. The preliminary steps involve the following:

- Identifying the lowest or most stringent criterion or water quality objective for the pollutant "(C)";
- Adjusting the selected criterion/objective, when appropriate, for hardness, pH, and translators of the receiving water ( $C_a$ ). There is no hardness data available for Arroyo Simi. For the storm water only discharges to Arroyo Simi, the hardness used was 100 mg/L as  $\text{CaCO}_3$ , which is the default value. Consequently, the default value was used to complete the calculation of the final effluent limits. The acute and chronic dilution factors utilized to complete the calculation are zero since Arroyo Simi, which is a tributary to Calleguas Creek, has intermittent flows and many of the beneficial uses specified for Arroyo Simi are intermittent. A site-specific study would need to be completed to determine if seasonal dilution factors would be appropriate.

Wastewater discharges from industrial process and storm water from Happy Valley exit the site and flow into Bell Creek, a tributary to the Los Angeles River. The hardness data submitted by the Discharger for the receiving water provided hardness values less than the 100 mg/L as  $\text{CaCO}_3$  default.

In fact, the hardness data was very similar for the discharge and the receiving water, indicating that the discharge was a primary contributing flow to the receiving water. The default value of 100 mg/L for hardness was used to adjust the selected criteria.

- Collating the appropriate effluent data for the pollutant;

- Determining the observed maximum concentration in the effluent (MEC) from the effluent data; and
- Determining the observed maximum ambient background concentration of the pollutant (B). Ambient data was submitted for Bell Creek upstream of Discharge Serial 001 and 002. This ambient data was included in the calculation of effluent limits for the wastewater discharges from these two locations. Ambient data was not available for Arroyo Simi and was not included in the analysis of the discharges from Outfalls 003 through 007.

The SIP specifies three triggers to complete a RPA:

1. Trigger 1 – If the MEC is greater than or equal to the CTR water quality criteria or applicable objective (C), a limitation is needed. For certain constituents present in this discharge that were nondetect, the MEC was set at the method detection limit consistent with section 1.3 of the SIP.
2. Trigger 2 – If  $MEC < C$  and background water quality  $(B) > C$ , a limitation is needed.
3. Trigger 3 – If other related information such as CWA 303(d) listing for a pollutant, discharge type, compliance history, etc. indicates that a WQBEL is required.

The first two triggers were evaluated using the California Permit Writers Training Tool (CAPWTT). While on contract with the State Board, Scientific Applications International Corporation (SAIC) developed this software to determine RPAs and, when reasonable potential exists, calculate the WQBELs, following procedures in SIP. The third trigger is evaluated by the permit writer utilizing all other information available to determine if a water quality-based effluent limitation is required to protect beneficial uses.

The results of the RPA for each analyte evaluated is presented in Attachment 1 for discharges from Outfall 001 and 002 and in Attachment 2 for the storm water only discharges (Outfalls 003 – 007) of Order No. R4-2004-0111. Most of the targeted analytes evaluated have a response of (Best Professional Judgement) BPJ or No Criteria required. The BPJ response requires the permit writer use all other available information to determine if a limit should be stipulated and if necessary to determine the applicable limit. The No Criteria result indicated that CTR does not include criteria to evaluate this analyte.

A numeric limit has not been prescribed for a toxic constituent if it has been determined that it has no reasonable potential to cause or contribute to excursions of water quality standards. However, if the constituent had a limit in the previous permit, and if none of the Antibacksliding exceptions apply, then the limit will be retained if the Regional Board concludes there is reasonable potential. For those pollutants with existing effluent limitations where the CAPWTT did not statistically determine reasonable potential, the Regional Board staff conducted a further analysis under Trigger 3 of the SIP. If reasonable potential was found based on Trigger 3, the basis for that decision is articulated in this fact sheet. A narrative limit to comply with

all water quality objectives is provided in *Standard Provisions* for the priority pollutants, which have no available numeric criteria.

Sufficient effluent and ambient data are needed to conduct a complete RPA. If data are not sufficient, the Discharger will be required to gather the appropriate data for the Regional Board to conduct the RPA. Upon review of the data, and if the Regional Board determines that WQBELs are needed to protect the beneficial uses, the permit will be reopened for appropriate modification.

D. Calculating WQBELs

If a reasonable potential exists to exceed applicable water quality criteria or objectives, then a WQBEL must be established in accordance with one of three procedures contained in Section 1.4 of the SIP. These procedures include:

- 1) If applicable and available, use of the wasteload allocation (WLA) established as part of a total maximum daily load (TMDL).
- 2) Use of a steady-state model to derive maximum daily effluent limitations (MDELs) and average monthly effluent limitations (AMELs).
- 3) Where sufficient effluent and receiving water data exist, use of a dynamic model, which has been approved by the Regional Board.
- 4) WQBELs Calculation Example

Using Copper as an example, the following demonstrates how WQBELs were established for this Order.

*Concentration-Based Effluent Limitations*

A set of AMEL and MDEL values are calculated separately, one set for the protection of aquatic life and the other for the protection of human health. The AMEL and MDEL limitations for aquatic life and human health are compared, and the most restrictive AMEL and the most restrictive MDEL are selected as the WQBEL.

*Calculation of aquatic life AMEL and MDEL:*

**Step 1:** For each constituent requiring an effluent limit, identify the applicable water quality criteria or objective. For each criterion determine the effluent concentration allowance (ECA) using the following steady state equation:

$$\begin{array}{ll} \text{ECA} = C + D(C-B) & \text{when } C > B, \text{ and} \\ \text{ECA} = C & \text{when } C \leq B, \end{array}$$

Where C = The priority pollutant criterion/objective, adjusted if necessary for hardness, pH and translators. In this Order a hardness value of 100 mg/L (as CaCO<sub>3</sub>) was used for development of hardness-dependant criteria, and a pH of 8.1 was used for pH-dependant criteria.



D = The dilution credit, and  
 B = The ambient background concentration

As discussed above, for this Order, dilution was not allowed; therefore:

$$ECA = C$$

For copper the applicable water quality criteria are (reference Table F-5):

$$ECA_{acute} = 14.00 \mu\text{g/L}$$

$$ECA_{chronic} = 9.33 \mu\text{g/L}$$

**Step 2:** For each ECA based on aquatic life criterion/objective, determine the long-term average discharge condition (LTA) by multiplying the ECA by a factor (multiplier). The multiplier is a statistically based factor that adjusts the ECA to account for effluent variability. The value of the multiplier varies depending on the coefficient of variation (CV) of the data set and whether it is an acute or chronic criterion/objective. Table 1 of the SIP provides pre-calculated values for the multipliers based on the value of the CV. Equations to develop the multipliers in place of using values in the tables are provided in Section 1.4, Step 3 of the SIP and will not be repeated here.

$$LTA_{acute} = ECA_{acute} \times \text{Multiplier}_{acute\ 99}$$

$$LTA_{chronic} = ECA_{chronic} \times \text{Multiplier}_{chronic\ 99}$$

The CV for the data set must be determined before the multipliers can be selected and will vary depending on the number of samples and the standard deviation of a data set. If the data set is less than 10 samples, or at least 80% of the samples in the data set are reported as non-detect, the CV shall be set equal to 0.6.

For copper, the following data were used to develop the acute and chronic LTA using equations provided in Section 1.4, Step 3 of the SIP (Table 1 of the SIP also provides this data up to three decimals):

CV	ECA Multiplier <sub>acute 99</sub>	ECA Multiplier <sub>chronic 99</sub>
0.581	0.32	0.53

$$LTA_{acute} = 14.00 \mu\text{g/L} \times 0.33 = 4.48 \mu\text{g/L}$$

$$LTA_{chronic} = 9.33 \mu\text{g/L} \times 0.54 = 4.94 \mu\text{g/L}$$

**Step 3:** Select the most limiting (lowest) of the LTA.

$$LTA = \text{most limiting of } LTA_{acute} \text{ or } LTA_{chronic}$$

For Copper, the most limiting LTA was the  $LTA_{chronic}$

$$LTA = 4.48 \mu\text{g/L}$$

**Step 4:** Calculate the WQBELs by multiplying the LTA by a factor (multiplier). WQBELs are expressed as Average Monthly Effluent Limitations (AMEL) and Maximum Daily Effluent Limitation (MDEL). The multiplier is a statistically based factor that adjusts the LTA for the averaging periods and exceedance frequencies of the criteria/objectives and the effluent limitations. The value of the multiplier varies depending on the probability basis, the coefficient of variation (CV) of the data set, the number of samples (for AMEL) and whether it is a monthly or daily limit. Table 2 of the SIP provides pre-calculated values for the multipliers based on the value of the CV and the number of samples. Equations to develop the multipliers in place of using values in the tables are provided in Section 1.4, Step 5 of the SIP and will not be repeated here.

$$AMEL_{\text{aquatic life}} = LTA \times AMEL_{\text{multiplier } 95}$$

$$MDEL_{\text{aquatic life}} = LTA \times MDEL_{\text{multiplier } 99}$$

AMEL multipliers are based on a 95<sup>th</sup> percentile occurrence probability, and the MDEL multipliers are based on the 99<sup>th</sup> percentile occurrence probability. If the number of samples is less than four (4), the default number of samples to be used is four (4).

For copper, the following data were used to develop the AMEL and MDEL for aquatic life using equations provided in Section 1.4, Step 5 of the SIP (Table 2 of the SIP also provides this data up to two decimals):

No. of Samples Per Month	CV	Multiplier <sub>MDEL 99</sub>	Multiplier <sub>AMEL 95</sub>
4	0.6	3.11	1.55

$$AMEL_{\text{aquatic life}} = 4.48 \times 1.55 = 6.94 \text{ } \mu\text{g/L}$$

$$MDEL_{\text{aquatic life}} = 4.48 \times 3.11 = 13.9 \text{ } \mu\text{g/L}$$

*Calculation of human health AMEL and MDEL:*

**Step 5:** For the ECA based on human health, set the AMEL equal to the ECA<sub>human health</sub>

However, for copper, the ECA<sub>human health</sub> = Not Available. The CTR does not contain a numeric copper criterion protective of human health; therefore, it was not possible to develop a copper AMEL based on human health criteria.

**Step 6:** Calculate the MDEL for human health by multiplying the AMEL by the ratio of the Multiplier<sub>MDEL</sub> to the Multiplier<sub>AMEL</sub>. Table 2 of the SIP provides pre-calculated ratios to be used in this calculation based on the CV and the number of samples.

A copper MDEL<sub>human health</sub> could not be calculated because a copper AMEL<sub>human health</sub> was not available. There are no criteria protective of human health for copper; therefore, none of the limitations for copper are based on human health criteria.

**Step 7:** Select the lower of the AMEL and MDEL based on aquatic life and human health as the WQBEL for the Order.

For copper:

AMEL <sub>aquatic life</sub>	MDEL <sub>aquatic life</sub>	AMEL <sub>human health</sub>	MDEL <sub>human health</sub>
7.0 µg/L	14 µg/L	Not Applicable	Not Applicable

The lowest (most restrictive) effluent limits are based on aquatic toxicity and were incorporated into this Order. For copper, there are no human health criteria; therefore, the AMEL and MDEL based on aquatic life criteria are considered for WQBELs.

E. Impaired Water Bodies in 303 (d) List

Section 303(d) of the CWA requires states to identify specific water bodies where water quality standards are not expected to be met after implementation of technology-based effluent limitations on point sources. For all 303(d) listed water bodies and pollutants, the Regional Board plans to develop and adopt TMDLs that will specify WLAs for point sources and load allocations (LAs) for non-point sources, as appropriate.

The USEPA has approved the State's 303(d) list of impaired water bodies. Certain receiving waters in the Los Angeles and Ventura County watersheds do not fully support beneficial uses and therefore have been classified as impaired on the 2002 303(d) list and have been scheduled for TMDL development.

The Los Angeles River flows for 55 miles from the Santa Monica Mountains at the western end of the San Fernando Valley to the Pacific Ocean. The Los Angeles River drains an area of about 825 square miles. Approximately 324 square miles of the watershed are covered by forest or open space land. The rest of the watershed is highly developed. The river flows through industrial, residential, and commercial areas, including major refineries and petroleum products storage facilities, major freeways, rail lines, and rail yards serving the Ports of Los Angeles and Long Beach.

The majority of the Los Angeles River watershed is considered impaired due to a variety of point and nonpoint sources. The 2002 303(d) list includes total aluminum, dissolved cadmium, dissolved copper, dissolved zinc, high coliform count, pH, ammonia, nutrients (algae), odors, lead, coliform, trash, scum, oil, dichloroethylene, tetrachloroethylene, and trichloroethylene. High coliform count is a pollutant stressor for Bell Creek. The pollutant stressors listed for the Los Angeles River estuary include chlordane, DDT, lead, PCBs and zinc in sediment. The beneficial uses potentially threatened or impaired by degraded water quality are aquatic life, recreation, groundwater recharge, and municipal water supply.

Calleguas Creek Watershed and its major tributaries, Revlon Slough, Conejo Creek, Arroyo Conejo, Arroyo Santa Rosa, and Arroyo Simi drain an area of 343 square miles in southern Ventura and a small portion of western Los Angeles County. The northern boundary of the watershed is formed by the Santa Susana Mountains,

South Mountain, and Oak Ridge; the southern boundary is formed by the Simi Hills and Santa Monica Mountains.

Urban developments within the watershed are generally restricted to the city limits of Simi Valley, Moorpark, Thousand Oaks, and Camarillo. Agricultural activities, primarily cultivation of orchards and row crops, are spread out along valleys and on the Oxnard Plain.

The Watershed Management Initiative characterizes the Calleguas Creek Watershed as a very impaired watershed. Calleguas Creek Reach 7 (the Arroyo Simi) is on the 2002 303 (d) list for ammonia, chloride, boron, sulfates, total dissolved solids, fecal coliform, organophosphorus pesticides, and sedimentation/siltation. The 2006 303(d) list includes the constituents listed on the 2002 303 (d) list except ammonia, organophosphorus pesticides and sedimentation/siltation. The beneficial uses potentially threatened or impaired by degraded water quality are wildlife habitat, and rare, threatened or endangered species habitat. The intermittent beneficial uses potentially impacted include industrial process supply, groundwater recharge, freshwater replenishment, contact and non-contact water recreation, and warm freshwater habitat.

F. Whole Effluent Toxicity

Whole Effluent Toxicity (WET) protects the receiving water quality from the aggregate toxic effect of a mixture of pollutants in the effluent. WET tests measure the degree of response of exposed aquatic test organisms to an effluent. The WET approach allows for protection of the narrative "no toxics in toxic amounts" criterion while implementing numeric criteria for toxicity. There are two types of WET tests: acute and chronic. An acute toxicity test is conducted over a short time period and measures mortality. A chronic toxicity test is conducted over a longer period of time and measures mortality, reproduction, and growth.

The Basin Plan specifies a narrative objective for toxicity, requiring that all waters be maintained free of toxic substances in concentrations that are lethal to or produce other detrimental response on aquatic organisms. Detrimental response includes but is not limited to decreased growth rate, decreased reproductive success of resident or indicator species, and/or significant alterations in population, community ecology, or receiving water biota. The existing permit does not contain toxicity limitations or monitoring requirements.

In accordance with the Basin Plan, acute toxicity limitations dictate that the average survival in undiluted effluent for any three consecutive 96-hour static or continuous flow bioassay tests shall be at least 90%, with no single test having less than 70% survival. Consistent with Basin Plan requirements, this Order includes acute toxicity limitations.

In addition to the Basin Plan requirements, Section 4 of the SIP states that a chronic toxicity effluent limitation is required in permits for all discharges that will cause, have the reasonable potential to cause, or contribute to chronic toxicity in receiving waters.

The Discharger will be required to conduct chronic toxicity testing. The Order includes a chronic testing trigger hereby defined as an exceedance of 1.0 toxic units chronic (TUC) in a critical life stage test for 100% effluent. (The monthly median for chronic toxicity of 100% effluent shall not exceed 1.0 TUC in a critical life stage test.) If the chronic toxicity of the effluent exceeds 1.0 TUC, the Discharger will be required to immediately implement accelerated chronic toxicity testing according to Monitoring and Reporting Program, Item IV.D.1. If the results of two of the six accelerated tests exceed 1.0 TUC, the Discharger shall initiate a toxicity identification evaluation (TIE).

G. Specific Rationale for Each Numerical Effluent Limitation

Section 402(o) of the Clean Water Act and 40 CFR 122.44(l) require that effluent limitations standards or conditions in re-issued permits are at least as stringent as in the existing permit unless an antibacksliding exception applies. The Regional Board has determined that reasonable potential exists for all pollutants that are regulated under the current permit; therefore effluent limitations have been established for these pollutants. Furthermore, effluent limitations for several contaminants have been included based on BPJ with the CTR WQBELs or with effluent limits from the current Order.

In compliance with 40 CFR 122.45(f), mass-based limitations have also been established in the proposed Order for conventional and priority pollutants. The mass for both the maximum and the monthly or 30-day average limits and when appropriate the 7-day average effluent limits were calculated using the flow for the associated operation, which was provided by the Discharger.

When calculating the mass for discharges, the maximum permitted flow rate was used to calculate the daily maximum, the monthly average, or 7-day average mass. When calculating the appropriate mass for the discharge event or events evaluated the actual flow rate should be substituted in the following equation. The daily maximum flow will be used to calculate the daily maximum, the monthly average, 30-day average or 7-day average flows will be used to calculate the respective mass discharge limit.

$$\text{Mass (lbs/day)} = \text{flow rate (MGD)} \times 8.34 \times \text{effluent limitation (mg/L)}$$

where: mass = mass limit for a pollutant in lbs/day  
effluent limitation = concentration limit for a pollutant, mg/L  
flow rate = discharge flow rate in MGD

**Order R4-2004-0111**

Outfalls 001 and 002. RPAs were performed using CAPWTT for each of 126 priority pollutants for which effluent data were available. The input data for the RPAs were provided in the Self-Monitoring Reports submitted by the Discharger. One RPA was performed for discharges from Outfalls 001 and 002, which are composed of treated wastewater, water from the groundwater treatment systems, excess reclaimed water, water from the engine test stands, and storm water. Four analytes had reasonable potential to exceed WQBELs: copper, lead, mercury, and TCDD. Three

of these analytes (copper, lead, and mercury) had effluent limitations in the previous order (Order No. 98-051).

The Discharger also submitted data for the receiving water associated with discharges from Outfalls 001 and 002. This data was collected using elevated detection limits and hence several other constituents had reasonable potential. The constituents are 2,4,6-trichlorophenol, 2,4-dinitrotoluene, alpha-BHC, bis(2-ethylhexyl)phthalate, N-nitrosodimethylamine and pentachlorophenol. Effluent limits for these constituents have also been included in this Order.

Since perchlorate has been detected above the Department of Health Services action level in storm water runoff from the facility and it has been detected in the influent to some of the groundwater treatment systems, BPJ has been used to establish reasonable potential for it to be present in discharges from the site via Outfalls 001 and 002. Consequently an effluent limit for perchlorate has been included in this Order for these discharges. Since perchlorate is typically not a naturally occurring pollutant and its presence in the receiving waters is the result of operations at the facility, the effluent limitation was developed based on anti-degradation grounds (State Board Res. No. 68-16 and 40 CFR § 131.12). The effluent limitation was therefore set at 6 µg/L, which would prevent the degradation of receiving waters and maintain and protect receiving water quality.

Several volatile organic compounds (VOCs) had effluent limits in Order No. 98-051 for discharges from Outfalls 001 and 002. The number of samples evaluated for each contaminant ranged from 19 to 60, and none of the contaminants were detected. The CTR based effluent limits for all of the VOCs except 1,1-dichloroethylene, were less stringent than the limits in Order No. 98-051. Since none of the contaminants were detected during numerous sampling events and the limits in the tentative Order would be the same as those from the previous Order, the limits for these analytes were not included. The only VOC that has limits in the tentative Order is 1,1-dichloroethylene. The limit is included since the CTR based limit for this analyte is more stringent than the limit included in the previous Order.

As set forth above, Section 1.3 of the State Board's State Implementation Plan (SIP) establishes a stepwise procedure for determining which toxic pollutants require water quality-based effluent limitations in conformance with 40 C.F.R. § 122.44(d). This stepwise procedure for toxic pollutants is called a reasonable potential analysis. The SIP's reasonable potential analysis applies to water quality standards for priority pollutants, whether promulgated by USEPA or established as water quality objectives by the Regional Board. Steps 1 through 6 establish an analytical procedure for requiring water quality-based limitations based solely on discharge and ambient receiving water data. Except as noted in the preceding paragraph, reasonable potential for toxic pollutants regulated by this Order was determined using the analytical procedure in Steps 1 through 6 of SIP section 1.3 as explained above.

Step 7 of SIP Section 1.3 recognizes that in certain instances a rote, mathematical analysis of the data will not be sufficient to protect beneficial uses. Step 7 therefore reserves for the Regional Board the obligation to "review other available information to determine if a water quality-based effluent limitation is required, notwithstanding the

above analysis in *Steps 1 through 6*, to protect beneficial uses.” Among the factors the State Board identifies as relevant to the Step 7 analysis are: the facility type, discharge type, and potential toxic impact of the discharge. With respect to the Facility, the Regional Board finds sufficient, unusual circumstances to require a water quality-based effluent limitation for trichloroethylene (TCE). Data and testimony indicate that approximately 530,000 gallons of TCE were released to the soil and groundwater at the Facility. The tremendous volume of TCE released at the site warrants significant scrutiny. While recent monitoring data do not show TCE in surface water discharges, scouring from large storm events may release soils with adsorbed TCE. The large volumes of TCE in scoured soils may become chemically available in the surface water runoff and cause or contribute to an exceedance of the water quality standard. In addition, the existing monitoring data has been collected far downstream from on-site sources. The data may not reliably indicate the presence of TCE in waters of the United States because the turbid conditions may have volatilized the TCE before it reached existing monitoring points. Further, contamination is spotty and not completely characterized; pathways are not always predictable and are not fully characterized; and the site is in a hilly environment with uncertain pathways and seeps which could possibly lead to surfacing of water with contamination that cannot be predicted. Finally, TCE is a probable carcinogen that can cause skin rashes on contact, and when ingested has been associated with liver and kidney damage, impaired immune system function, and in large volumes unconsciousness, impaired heart function, or death. Considering the toxic nature of TCE and that past practices at the site released extraordinary volumes of TCE into the environment that can continue to leach into surface water through the scouring from storm events, and further considering that the existing monitoring data may not be representative of direct discharges to waters of the United States since the data were collected downstream of the initial discharge, the Regional Board has determined that a water quality-based effluent limitation for TCE is necessary to protect beneficial uses.

Outfalls 003 through 007. Discharges from Outfall 003 through 007 are storm water runoff only. Daily maximum and monthly average limits for storm water were included in Order No. 98-051. This Order does not include monthly average limits for priority pollutants in storm water only discharges since storm events are infrequent and often occur less than once per month during the rainy season. This change in the limits is consistent with permits adopted by the Regional Board for storm water discharges only.

The storm water only discharges from Discharge Outfalls 003 through 007 were also evaluated using CAPWTT (Attachment 2 of Order No. R4-2004-0111). The analytes with statistical reasonable potential are cadmium, copper, cyanide, mercury, and TCDD (Attachment 2 page 1). Cyanide was detected only once during the period evaluated at a concentration of 5.8 micrograms/liter. That detection triggered the reasonable potential since it exceeds that calculated average monthly effluent limit (AMEL). However, the discharges evaluated are storm water only discharges, which do not have monthly average limits. When the maximum effluent concentration (MEC) of 5.8 µg/L is compared to the maximum daily effluent limit (MDEL) the MEC is less than the MDEL. Consequently, this permit does not include an effluent limit for cyanide in the storm water only discharges. CTR-WQBELs for cadmium copper, mercury and TCDD have been included in this Order. The previous order included effluent limits for all of these analytes except TCDD. The effluent limits for the

analytes with a positive RPA are the most stringent of the limit included in Order 98-051, and the applicable CTR criteria which include the freshwater aquatic life criteria, and the human health criteria for consumption of organisms only. The previous permit included limits for these analytes from Title 22, which are more stringent than the CTR limits. The compliance history reveals that the effluent limit for antimony (6 µg/L) was exceeded at Outfalls 005 and 007 in 1999 and the limit for thallium (2 µg/L) was exceeded at Outfall 005 on March 8, 2000. Therefore, limits for antimony and thallium were established using best professional judgement.

The monthly average effluent limit for mercury included in Order No. 98-051 (0.012 µg/L) was based on freshwater continuous criteria from 40 CFR 131.36. This limit is based on a fish consumption advisory, which appeared in the July 1, 1998 edition but was subsequently withdrawn. CTR included criteria for mercury, which was used to develop the WQBEL for mercury that is included in Order R4-2004-0111.

The CTR-WQBELs for cadmium in the tentative Order is greater than the limit stipulated in Order 98-051 (previous order). The daily maximum concentrations for cadmium from the previous order were taken directly from NTR and were expressed as dissolved criteria. The daily maximum limits for all metals included in this order were calculated based on criteria that appears in CTR when they were the most protective criteria available. The dissolved criteria were adjusted using conversion factors to total recoverable. Since the effluent limit for cadmium in the Order R4-2004-0111 is total cadmium it is slightly higher than the limit included in the Order 98-051.

The criteria stipulated for TDS, sulfate, chloride, and nitrogen also changed for storm water discharges to the Arroyo Simi, a tributary of Calleguas Creek. The criteria listed previously were the stipulated criteria for the Los Angeles River Watershed. The criteria stipulated for Calleguas Creek above Potrero Road are 850, 250, 150, 1.0, and 10 mg/L for TDS, sulfate, chloride, boron and nitrogen respectively.

Outfall 008. The area commonly referred to as Happy Valley receives storm water runoff from the former solid propellant testing area. Operations at the former solid propellant testing area ended in 1994. A major component of the propellant was perchlorate. Since the propellant has been used in the area and it has been detected in the storm water runoff at concentrations exceeding the Department of Health Services action level of 4 µg/L (which was changed to 6 µg/L on March 11, 2004), an effluent limit for perchlorate has been included in this Order. The effluent limitation for perchlorate is established based on antidegradation as explained for Outfalls 001 and 002. A requirement for sampling of the storm water runoff all other constituents tested for at Outfalls 003 through 007, has also been included in this Order. The new storm water monitoring location is Discharge Outfall 008. Storm water from Happy Valley flows to Dayton Canyon Creek. Dayton Canyon Creek merges with flows from Chatsworth Creek, which flows south to Bell Creek southwest of the intersection of Shoup Avenue and Sherman Way. Bell Creek subsequently flows east to the Los Angeles River.

This area has since undergone an interim measure cleanup, with final excavation occurring in September 2004, under the direction of DTSC.



Outfalls 009. The WS-13 Drainage area begins near the entrance to the property and traverses several potential areas of concern. The WS-13 drainage area collects storm water runoff from the Area 1 and Area 2 Landfills, and the former LOX plant located on NASA owned property. In addition, WS-13 picks up storm water run on from Sage Ranch where agricultural operations took place and a gun shooting range is located. Prior to Order R4-2004-0111, this drainage had only been sampled once. Additional data would provide information regarding the transport of contaminants in these areas offsite by storm water runoff. The WS-13 Drainage area will become Discharge Outfall 009; this outfall drains to Arroyo Simi.

Outfall 010. Building 203 was formally used as an instrumentation laboratory where various types of instrumentation were repaired and calibrated. The instrumentation included but was not limited to, thermometers and manometers that contained mercury. Currently the building houses operations related to laser research. Operations include polishing fibers, hand wipe solvent and chemical cleaning, assembly and test of various components in both open warehouse and clean room environments. All wastes are currently containerized and transported off site for disposal. An interim measures cleanup was completed in this area during the summer of 2004. With DTSC oversight, soil containing mercury and trichloroethylene was removed, hauled offsite and disposed of at a permitted disposal facility.

Outfall 011. The Perimeter Pond collects wastewater generated from Area 1. The discharges from groundwater treatment systems located in Area 1, discharges from Sewage Treatment Plant 1 and storm water runoff from the vicinity is discharged initially to R-1 Pond which flows to the Perimeter Pond. Discharges from the Perimeter Pond exit the site via Outfall 001. The Perimeter Pond is the final step in the storage of water. Consequently, this Order includes effluent limits and requirements for monitoring of the effluent from the pond for the priority pollutants and for other targeted chemicals of concern at the site.

Outfalls 012 – 014. The various test stands are used to test fire rocket engines built onsite. The fire suppression water used during testing may contain residual fuels and solvents. This wastewater is directed via lined and unlined channels to the reclamation ponds, which are used to store wastewater collected from the various onsite operations along with any storm water runoff for reuse onsite.

The Regional Board will have oversight of the discharges from the engine test stands. R4-2004-0111 included requirements for monitoring of the discharges. The data collected will be used to evaluate reasonable potential of the discharge to exceed applicable requirements and if warranted; effluent limits will be implemented for the discharges.

Outfalls 015 – 017. In July 2004 the two operational plants (STP-1 and STP-3) were activated sludge sewage treatment plants that provided secondary and tertiary treatment for the domestic sewage from the facility. The disinfected sewage effluent was subsequently directed to the reclaimed water system reservoir. The two plants which are currently being used as collection reservoirs only, previously had effluent limits for BOD<sub>5</sub>20°C, coliform, and turbidity on discharges from the facilities. Sewage sludge was hauled offsite to the one of the facilities operated by Los Angeles County Sanitation Districts. The monitoring program for the sewage treatment plants included

requirements for the previously mentioned constituents as well as pH, oil and grease and suspended solids. Order R4-2004-0111 included requirements to monitor for priority pollutants except asbestos, perchlorate, N-nitrosodimethylamine, 1,4-dioxane, and 1,2,3-trichloropropane to provide the data required to evaluate reasonable potential. If reasonable potential exists, effluent limits will be implemented.

Outfall 018. The R-2A and R-2B Ponds are used to collect wastewater from Areas II and III. R-2A Ponds collect wastewater from the Delta Groundwater Treatment System and storm water runoff from the location of the former Delta Test Stand. The R-2B Ponds receive overflow from the Silvernale Pond which includes discharges from the Bravo, Alpha and RD-9 Groundwater Treatment Systems and storm water runoff from the Alpha and Bravo Engine Test Stands. The R-2B Pond also receives wastewater discharges and storm water runoff from the STL-IV Test Stand area. The R-2 Spillway is an overflow area used to allow the wastewater from the two ponds to flow via a drainageway to Outfall 002. Wastewater released from the R-2 Spillway travels approximately 4,500 feet prior to reaching Outfall 002. Hence, this permit includes a monitoring requirement for discharges from the R-2 Spillway.

Data collected from August 20, 2004 (the effective date of Order R4-2004-0111) through May 5, 2005 was used to evaluate reasonable potential at the compliance points enumerated in that Order. This analysis has been completed to supplement the initial results presented in Order R4-2004-0111.

#### **R4-2006-0008**

Outfalls 001, 002, 011, and 018 discharge wastewater and storm water runoff from SSFL to Bell Creek at the south. Outfalls 011, the Perimeter Pond, and 018, the R-2 Pond Spillway, are located directly upstream of Outfalls 001 and 002 respectively. Discharges from Outfalls 011 and 018 receive no additional treatment prior to exiting Outfalls 001 and 002. However, storm water runoff traversing other RCRA areas of concern may pick up other contaminants and subsequently enter the streambed between the upstream outfalls (Outfalls 011 and 018) and the corresponding downstream outfalls (Outfalls 001 and 002). Since there was no additional treatment, the discharges from these outfalls were evaluated together.

The statistical analysis yielded reasonable potential for copper, lead, mercury, and TCDD. The data, site history, and other information available were incorporated into the BPJ analysis. This analysis supported the retention of effluent limits established at Outfalls 001 and 002 in Order No. R4-2004-0111 and it supported the inclusion of those effluent limits for discharges from Outfalls 011 and 018.

Outfalls 008, 009 and 010 are storm water only outfalls. Data collected at these locations since the adoption of Order No. R4-2004-0111 indicated that the discharges from these locations are very similar to those from the other storm water only discharge locations. The statistical RPA of the data collected from all of the storm water locations resulted in Tier 1 RPA for copper, lead, mercury and TCDD. Since the discharges from Outfalls 008, 009 and 010 are very similar to those from Outfalls 003 through 007, BPJ was used to establish effluent limits for other priority

pollutants and other chemicals of concern (i.e. perchlorate) at all of the storm water only outfalls.

Outfalls 012-014 (Rocket Engine Test Stands) Data collected at Outfall 012 resulted in Tier 1 reasonable potential using the method specified in the SIP for copper, lead, mercury, TCDD. Additional constituents including settleable solids, total suspended solids, 1,4-dioxane, total petroleum hydrocarbons, naphthalene, oil and grease, tertiary-butyl alcohol, and ethylene dibromide demonstrated RP utilizing the TSD method. RP was established for total dissolved solids and perchlorate based on BPJ. These constituents as well as other applicable Basin Plan constituents have been included in this addendum.

During the development and adoption of Order R4-2004-0111, Regional Board staff was informed that Boeing was not utilizing the three package type sewage treatment plants located onsite (STP1, STP2, STP-3), which are NPDES Outfalls 15-17. A rain event on January 11, 2005, resulted in the discharge of partially treated wastewater from Outfalls 015 and 017. The evaluation of the data collected resulted in Tier 1 reasonable potential for cadmium, chromium III, copper, mercury, nickel, TCDD. Other constituents of concern that demonstrate reasonable potential include MBAS, TSS, BOD, perchlorate, total coliform oil and grease, total residual chlorine, and nitrate as nitrogen. The BPJ analysis resulted in reasonable potential for total dissolved solids, chloride, sulfate, fluoride, nitrate + nitrite as nitrogen, and barium. Effluent limitations for these constituents were included in Order R4-2006-0008.

#### **R4-2006-0036**

Discharges from Outfalls 001, 002, 011 and 018 flow to Bell Creek a tributary of the LA River. The TMDL for metals in the Los Angeles River assigned WLAs to all point source discharges to LA River and all upstream reaches and tributaries to (including Bell Creek and tributaries to Bell Creek). Effluent limits for cadmium, copper, lead, zinc, and selenium at the aforementioned outfalls were based on WLAs established by the TMDL or existing effluent limits, whichever were more protective. The LA River Nutrient TMDL requires WLAs for ammonia-N, nitrate-N, and nitrite-N, which are included for these outfalls.

Outfalls 003 through 010 are storm water only outfalls. Outfall 008 is the only storm water only compliance point that discharges to Dayton Canyon Creek which flows to Bell Creek, a tributary of the Los Angeles River. The storm water only discharges do not have statistical reasonable potential for zinc. However, discharges from Outfall 008 flow to the LA River, which has a TMDL that provides a WLA for zinc. That WLA will also be incorporated as an effluent limitation at Outfall 008 only. The LA River Nutrient TMDL requires WLAs for ammonia-N, nitrate-N, and nitrite-N, which are also included for this outfall.

Discharges from Outfalls 012 through 014 (rocket engine test stands) exit the site via tributaries to Bell Creek. The metals that have TMDL WLAs that do not have reasonable potential at these outfalls are cadmium, selenium and zinc. Effluent limits for these constituents are included based on the TMDL. The Los Angeles River Nutrient TMDL developed WLAs for ammonia-N, nitrate-N, and nitrite-N. Daily maximum effluent limitations for these constituent were also applicable and included

for discharges from these locations. The LA River Nutrient TMDL requires WLAs for ammonia-N, nitrate-N, and nitrite-N.

Discharges from Outfalls 015 through 017 exited the site via tributaries to Bell Creek. The Metals TMDL resulted in new WLAs for lead and selenium and a wet weather discharge WLA for cadmium. The LA River Nutrient TMDL requires WLAs for ammonia-N, nitrate-N, and nitrite-N. TMDL based effluent limitations were included in the order for the noted metals and nutrients.

#### **R4-2007-0XXX**

On February 21, 2007, the discharger submitted a new ROWD that requested that outfalls 012, 013, and 014 be removed from the permit. Since discharges from the rocket engine test stands have terminated, wastewater will no longer be discharged. However, years of using the rocket engine test stands have resulted in contamination in the immediate vicinity of the test stands. RCRA investigations have resulted in the delineation of areas surrounding the test stands as RCRA Facility Investigation (RFI) sites. Chemicals of concern identified at these sites include TPH-gasoline, TPH-diesel, TPH-kerosene, oil and grease, trichloroethene and 1,2-dichloroethene. Since these contaminants are documented as present in these locations the discharger will be required to monitor during storm events for chemicals of concern. The effluent limits included in Orders R4-2006-0008 and R4-2006-0036 for the rocket engine test stands will be included as "benchmarks".

A "benchmark" is a water quality based effluent limit or a performance based limit that is used to evaluate the performance of BMPs with regard to the removal of contaminants present in the discharge. In this permit, the benchmarks are established based on water quality based effluent limits. Exceedance of a benchmark two times consecutively at the same location triggers an evaluation of the BMPs implemented at the site. The evaluation may determine that the BMPs require augmentation, upgrading, or replacement. If so, the Discharger must develop a plan to implement the required upgrades and report to the Regional Board staff within 60 days of the second reported exceedance. The Discharger will continue monitoring as directed in the Monitoring and Reporting Program and the Basin Management Practices Compliance Plan.

The Topanga Fire occurred on September 28, 2005. The fire resulted in significant alterations to the site. Over 70 percent of the SSFL burned with significant areas denuded of vegetation, making much of the steep terrain highly erodible. The exposure of the surface soils with no vegetative cover to runoff has increased the potential for the transport of those surface soils and associated contaminants offsite as a result of the fire. All of the BMPs in place onsite were destroyed.

After the fire Boeing immediately began efforts to replace the BMPs that were destroyed. Many of the drainage areas were vacuumed to remove accumulated ash. The Discharger hydromulched in excess of 800 acres onsite and installed erosion control devices throughout much of the SSFL site prior to the January 19, 2006 Board Meeting. BMPs implemented prior to the fire were typical of those routinely used at construction sites to retard the transport of sediment (silt fences, plastic sheeting, etc). In most cases, the BMPs implemented after the fire

were designed to slow flows (i.e. using underdrain systems) and to treat specific contaminant groups (i.e. metals) using bags filled with carbon or vermiculite.

During the Regional Board hearing on the 2005-07 Triennial Review of the Basin Plan, many stakeholders raised the issue of compliance with water quality standards and TMDLs during wet weather as a significant challenge and suggested that the formation of a Wet Weather Task Force to discuss and identify potential solutions to the challenges involved in complying with water quality standards during wet weather would be helpful. The Regional Board requested that staff convene a task force to identify project ideas that would address these wet weather concerns. The task force identified as a top priority a project to evaluate alternative design storm criteria. A design storm is a specific size storm event used to plan for and design storm water controls. Specifically, a design storm would assist in determining the scale and treatment capacity of controls such as BMPs. The Regional design storm issue arose again as a high priority for stakeholders as well as the Board at the hearing on the Los Angeles River Metals TMDL. During the TMDL hearing, the Executive Officer, Jonathan Bishop, committed Regional Board resources to fund an initial 2-year contract with Southern California Coastal Water Research Project (SCCWRP) to begin an evaluation of potential design storms that could be used by responsible agencies when implementing TMDLs.

Over the last two years, Regional Board staff has been working with SCCWRP, GeoSyntec, and a cross-section of stakeholders in the region known as the Design Storm Project Steering Committee on this project to evaluate potential design storms in terms of capturing storm water runoff, achieving water quality standards and implementability. A draft report is scheduled for circulation in early September 2007, which will summarize the results of the first two years of the project; discuss the complexities of establishing a regional design storm; and set forth recommendations for additional technical studies, sensitivity analysis and modeling.

Regional Board staff recognizes that while there are an infinite number of site specific considerations and permutations that could be considered in evaluating potential design storms (e.g. different land uses, different pollutants, different inter-event times, different levels of effluent quality, etc.), it was necessary to make many assumptions and generalizations during this initial evaluation of regional design storms.

Therefore, Regional Board staff anticipates that further work will be needed before proposing a regional design storm policy or any site-specific design storm in order to further explore these assumptions and generalizations; evaluate the efficacy of the design storm for different pollutants and land uses; refine the data used in modeling the water quality outcomes of potential design storms and consider policy with regard to incorporating design storms into permits. It is therefore premature to establish a regional design storm or site-specific design storm at this time prior to this additional technical work and prior to a full consideration of the policy considerations of adopting a regional design storm policy.

On February 23, 2007, Boeing submitted to the Regional Board a memo entitled Outfall BMP Capacity Evaluation – 1 year storm 1 hour time of concentration. The memo evaluated the capacity of onsite structural best management practices. The

memo also documented discussions with Regional Board staff which introduced the possibility of the use of the design storm size used for the trash TMDL in the Los Angeles River. The site specific storm proposed by Boeing utilized the same approach as was utilized in the Los Angeles River Trash TMDL, with some modifications. Boeing's concluded that a storm that generated a flow of 2.3 inches depth could be considered the "site specific design storm" and it was used to design the structural BMPs.

On April 3, 2007, Boeing submitted to the Regional Board a letter entitled Boeing SSFL Best Management Practice Rainfall Capacity Submittal. The letter included a summary of the site specific storm analysis and an evaluation of the BMPs in place. The analysis of the BMPs in place concluded that BMPs at Outfalls 003 and 004 required upgrades to capture and treat the 2.3 inches of rainfall. All other storm water only outfalls had best management practices capable of treating the storm depth of 2.3 inches, except Outfalls 008 and 009. The Discharger proposed the implementation of natural BMPs to treat the 2.3 inches of rainfall at Outfalls 008 and 009. The Discharger indicated that the location, terrain, and size of these outfalls make the implementation of structural BMPs to treat that volume of water (2.3 inches) much more difficult at these locations. The modeling and the structural BMP upgrades required to treat the site specific storm have been implemented at Outfalls 003 through 007.

The assumptions and generalizations utilized to develop the site specific storm have not been enumerated by the Discharger. The Regional Board has not developed a regional design storm policy or a policy for the consideration and evaluation of site specific storms developed for individual discharges. Therefore, this permit does not implement the 2.3 inches as the upper bound of the runoff that the discharger must treat for compliance with the final effluent limitations. When the Regional Board Design Storm Project, and associated policy considerations, are further developed along with an evaluation of acceptable assumptions and generalizations, the storm size developed by the Discharger may be considered by the Regional Board.

On May 24, 2007, Boeing submitted to the Regional Board the *Phase 2 Post-Fire Vegetation Recovery Assessment Report* prepared for Geosyntech Consultants by Western Botanical Services, Inc. The report assessed the status of and time to recovery of chaparral and scrub at the project site subsequent to the Topanga Fire which began on September 28, 2005. The executive summary of the report asserts that chaparral and scrub represent the dominant vegetation types at SSFL and that these plant communities represent an important natural vegetation-based means of erosion control at the site. It further states that the "perennial plant cover differed by significantly more than 30 percent between burned and unburned transects, total vegetative cover differed by significantly greater than 20 percent cover and ground cover differed by significantly more than 30 percent cover." The executive summary also states that the burned chaparral and scrub vegetation will likely recover to previous conditions within five to ten years.

The report also includes a section titled *Chaparral Recovery after Fire*. The section includes summaries of other studies completed on chaparral. Several studies (Guo 2001, Grace & Keeley 2006, Keeley & Keeley 1981, Horton & Kraebel 1955, Robi chaud et al 2000) concluded that the total vegetative cover is generally high in the

first two years following a fire: reported values are from 11 to 85 percent. The report estimates that between March 26 and April 12, 2007, the mean total vegetative cover within the burned areas on the SSFL site is 46.6 percent.

Soil infiltration capacity is sometimes reduced after a fire. This reduction in soil infiltration capacity is due to an increase in soil water repellency (hydrophobicity) which is caused by waxy residues that are deposited on the soils during the burning of vegetation. On July 17, 2007, Boeing submitted the "Post Fire Soil Hydrophobicity and Recovery of Infiltration Capacity Report". The report documented an investigation of the pre-fire and post fire hydrophobicity conditions in four onsite target soil groups. The analysis was completed in April 2007. The conclusion suggests no statistical difference in the hydrophobicity of the soils between the burned and unburned tested areas onsite other than a portion of watershed 002 (west of Outfall 018). (Based on a confidence level of  $\alpha=0.05$ .) The report included the statement that case studies indicate that the recovery time ranged from one to three years. The study at SSFL was completed nineteen months after the fire which began on September 28, 2005.

Outfalls 015 through 017 will be deleted. The discharger currently trucks the wastewater offsite for disposal at one of the County Sanitation Districts of Los Angeles facilities and there are no plans to initiate discharges from the treatment plants in the future. Therefore, the updated ROWD included a request that Outfalls 015 through 017 be removed from the permit.

A reasonable potential analysis was completed for data collected through May 22, 2006. The analysis did not result in the inclusion of any new constituents with effluent limitations in this Order.

To prevent further degradation of the water quality of the Los Angeles River and Calleguas Creek and to protect their beneficial uses, mixing zones and dilution credits are not allowed in this Order. This determination is based on:

- Many of the beneficial uses stipulated are intermittent for Dayton Canyon Creek, Bell Creek and the Arroyo Simi. The discharges from SSFL in many cases provide a significant portion of the headwaters for these waterbodies. Since there is little assimilative capacity of the receiving water, a dilution factor is not appropriate and the final WQBEL should be a numeric objective applied end-of-pipe.
- The discharge may contain the 303(d) listed pollutants that are bioaccumulative such as metals. These pollutants, when exceeding water quality criteria within the mixing zone, can potentially result in tissue contamination of an organism directly or indirectly through contamination of bed sediments with subsequent incorporation into the food chain. The SIP, section 1.4.2.2.B. states that the "Regional Board shall deny or significantly limit a mixing zone and dilution credit as necessary to protect beneficial uses..." It continues that "such situations may exist based upon the quality of the discharge... or the overall discharge environment (including ... potential for bioaccumulation)."

For some pollutants, including aldrin, alpha-BHC, chlordane, DDT, dieldrin, heptachlor, heptachlor epoxide, several PAHs, PCBs, TCDD equivalents, and toxaphene the applicable water quality objectives are below the levels that current analytical techniques can measure. Reasonable potential analyses have been completed on each of these constituents and two of them had reasonable potential: alpha-BHC and TCDD equivalents. The MEC detected for TCDD exceeded the CTR criterion and the detection limits for alpha-BHC in the receiving water and the effluent exceeded the criterion.

**VI. MODIFICATIONS ASSOCIATED WITH STATE BOARD ORDER WQ 2006-0012 AND WITH THE REVISED RECORD OF WASTE DISCHARGE SUBMITTED BY BOEING ON FEBRUARY 20, 2007**

The State Board Order included the following provisions:

- Remanded the permit to the Regional Board to revise the provisions concerning Outfalls 001, 002, 011, and 018,
- Stayed the effluent limitations at Outfalls 011 and 018 pending a determination by the Regional Board deleting either Outfalls 011 and 018 or Outfalls 001 and 002,
- Directed the Regional Board to issue a Cease and Desist Order with the shortest possible compliance schedule and interim effluent limitations. The effective date of the CDO was to be January 19, 2006,
- Review the permit to ensure that numeric effluent limitations for different outfalls do not count the same violation twice in such a manner as to treat a single violation as multiple violations.
- In all other respects, the petitions were denied.

Orders R4-2006-0008 and R4-2006-0036 included numeric effluent limits for discharges from Outfalls 001, 002, 011, and 018. Outfall 018 is located upstream of Outfall 002 and Outfall 011 is upstream of Outfall 001. The same effluent limits were applicable to all four outfalls. The State Board Order concluded that Outfalls 001 and 002 were duplicative of Outfalls 011 and 018 and directed the Regional Board to retain only two of the four compliance points with numeric effluent limits. Since Outfalls 011 and 018 are closer to the developed portion of the site, this Order (Order R4-2007-0XXX) retains the numeric effluent limits. However, since these outfalls currently only transport storm water runoff from the site, the effluent limits will be daily maximum limitations only because storm events only discharges from this region typically have only daily maximum effluent limitations for the priority pollutants.

Outfalls 001 and 002 will have monitoring requirements with benchmarks and a requirement for the Discharger to implement BMPs that will be upgraded based on the monitoring data relative to the benchmark. The benchmarks for Outfall 001 will include daily maximum and monthly average limits since the discharge from Outfall 001 will include treated groundwater from Outfall 019 and storm water runoff. Since the discharge at Outfall 001 will be composed of both storm water runoff and treated groundwater both the daily maximum and monthly average benchmarks are applicable. The benchmarks for Outfall 002 are the daily maximum effluent limits stipulated for Outfalls 011 and 018, since Outfall 002 will transport storm water runoff only.



The State Board Order concluded that the discharge from Outfall 018 was duplicative of the discharge from Outfall 002 and that the discharge from Outfall 011 was duplicative of the Outfall 001. Discharges from Outfalls 018 and 011 only occur during storm events. A large portion of the discharge is storm water runoff. Outfall 018 is located in the same subwatershed with several solid waste management units (SWMU). Flow leaving the R-2 Pond travels 4,500 feet prior to reaching Outfall 002. Prior to the discharge reaching Outfall 002 storm water from STL-IV and from various regions of the buffer zone will also enter the drainage. Storm water from the uncontaminated buffer zone will provide dilution for the contaminants in the discharge. However, storm water from STL-IV may contain elevated levels of benzo(a)anthracene, benzo(a)pyrene, benzo(b)fluoranthene, dibenz(a,h)anthracene, indeno(1,2,3-cd)pyrene, chromium, copper, lead, and zinc, all chemicals of concern associated with this SWMU. Therefore, discharges from Outfall 018 may pick up additional contaminants from storm water runoff traversing contaminated areas at STL-IV and entering the drainage prior to the water exiting Outfall 002.

Discharges from Outfall 011, Perimeter Pond, travel along the southeastern edge of Area 1 Burn Pit (A1BP) prior to entering the buffer zone. A partial list of the chemicals of concern in soil associated with the A1BP include perchlorate, dioxins, metals (including cadmium, chromium, selenium, copper, mercury, boron, etc.) total petroleum hydrocarbons, and pentachlorophenol. Downstream in the buffer zone discharges from the Perimeter Pond also join with storm water runoff from the southeastern portion of the COCA area of concern (AOC) and the Component Test Laboratory V (CTL V) AOC. Additional runoff from the buffer zone is added to the drainage prior to the flow reaching Outfall 001. Discharges from Outfall 011 may pick up additional contaminants from storm water runoff from the COCA and CTL V AOCs prior to being discharged offsite at Outfall 001.

Outfalls 001 and 002, are downstream from Outfalls 011 and 018. Outfall 001 includes storm water runoff from the southern portion of STL IV and the buffer zone south of Outfall 018. Outfall 002 includes storm water runoff from CTL V the COCA area, A1BP and the buffer zone south of Outfall 011. The discharger will be required to continue to monitor at Outfalls 001 and 002 while implementing BMPs to ensure that contaminants associated with site activities are not transported offsite by storm water runoff.

Based on the State Board Order, a Cease and Desist Order will also be developed to address new effluent limits included in Order R4-2006-0008.

## **VII. SPECIFIC RATIONALES FOR EACH OF THE NUMERICAL EFFLUENT LIMITATIONS**

A. The following table presents the effluent limitations and the specific rationales for pollutants that are expected to be present in the discharge from Outfalls 011, 018 and 019. The daily maximum effluent limitations are applicable for discharges of storm water runoff from Outfalls 011 and 018. The daily maximum and monthly average effluent limitations are applicable for discharges from Outfall 019, the groundwater treatment unit.

These effluent limitations will also be used as benchmarks when evaluating the performance of BMPs implemented at Outfalls 001 (daily maximum and monthly average) and Outfall 002 (daily maximum discharge limitations only).

<b>Constituents</b>	<b>Units</b>	<b>Discharge Limitations</b>		<b>Rationale<sup>1</sup></b>
		<b>Monthly Average</b>	<b>Daily Maximum</b>	
pH	pH Units	---	6.5-8.5	Basin Plan
Temperature	°F	---	86	BPJ/Thermal Plan
Total suspended solids	mg/L	15	45	BPJ-Previous Order
BOD <sub>5</sub> 20 °C	mg/L	20	30	BPJ – Previous Order
Oil and grease	mg/L	10	15	BPJ – Previous Order
Settleable solids	ml/L	0.1	0.3	BPJ – Previous Order
Total residual chlorine	mg/L	----	0.1	Basin Plan
Total dissolved solids	mg/L	----	950	Basin Plan
Chloride	mg/L	----	150	Basin Plan
Sulfate	mg/L	----	300	Basin Plan
Barium	mg/L	----	1.0	BPJ-Previous Order
Iron	mg/L	----	0.3	BPJ-Previous Order
Fluoride	mg/L	----	1.6	Basin Plan
Detergents (as MBAS)	mg/L	----	0.5	Basin Plan
Nitrate + Nitrate-N	mg/L	----	8.0	Basin Plan
Ammonia-N	mg/L	1.96 <sup>©</sup>	10.1 <sup>®</sup>	LA River Nutrients TMDL
Nitrate-N	mg/L	----	8.0	LA River Nutrients TMDL
Nitrite-N	mg/L	----	1.0	LA River Nutrients TMDL
Manganese	µg/L	----	50	BPJ-Previous Order
Cyanide	µg/L	4.3	8.5	CTR
Antimony	µg/L	----	6.0	Basin Plan-Title 22
Arsenic	µg/L	----	10	USEPA MCL
Beryllium	µg/L	----	4.0	Basin Plan-Title 22
Cadmium	µg/L	2.0	4.0/3.1*	CTR/TLA River Metals TMDL
Chromium (VI)	µg/L	8.1	16.3	CTR
Copper	µg/L	7.1	14.0	CTR
Lead	µg/L	2.6	5.2	CTR
Mercury	µg/L	0.05	0.1	CTR
Nickel	µg/L	35	96	CTR
Selenium	µg/L	4.1	8.2/5 <sup>#</sup>	CTR/LA River Metals TMDL
Silver	µg/L	2.0	4.1	CTR
Thallium	µg/L	----	2.0	Basin Plan
Zinc	µg/L	53.6	119	CTR
1,1-Dichloroethylene	µg/L	3.2	6.0	CTR/BPJ-Title 22

<sup>1</sup> The rationale includes plans, policies, regulations, and other sources of effluent limitations. Basin Plan is Water Quality Control Plan Los Angeles Region, BPJ is Best Professional Judgement, TMDL is Total Maximum Daily Load, CTR is California Toxics Rule (40 CFR Part 131).

\* Effluent limit applies only during wet weather discharges.

# Effluent limit applies only during dry weather discharges.

© Thirty day average at pH = 7.9 and 20°C, when hourly samples are collected and composited or only one grab sample is collected.

® One hour average WLA at 7.9 pH and 20°C, applies if hourly samples are taken throughout the storm and each is analyzed. No single sample may exceed the 10.1 mg/L limit.

<b>Constituents</b>	<b>Units</b>	<b>Discharge Limitations</b>		<b>Rationale<sup>1</sup></b>
		<b>Monthly Average</b>	<b>Daily Maximum</b>	
Trichloroethylene	µg/L	----	5.0	BPJ/Basin Plan-Title 22
Perchlorate	µg/L	----	6.0	BPJ/DHS Action Level
2,4,6-Trichlorophenol	µg/L	6.5	13.0	CTR
2,4-Dinitrotoluene	µg/L	9.1	18.3	CTR
Alpha-BHC	µg/L	0.01	0.03	CTR
Bis(2-ethylhexyl)phthalate	µg/L	----	4.0	Basin Plan/Title 22
N-Nitrosodimethylamine	µg/L	8.1	16.3	CTR
Pentachlorophenol	µg/L	8.2	16.5	CTR
TCDD	µg/L	1.4E-08	2.8E-08	CTR
Radioactivity Gross Alpha	pCi/L	----	15	BPJ/Basin Plan
Gross Beta	pCi/L	----	50	BPJ/Basin Plan
Combined Radium-226 & Radium-228	pCi/L	----	5	BPJ/Basin Plan
Tritium	pCi/L	----	20,000	BPJ/Basin Plan
Strontium-90	pCi/L	----	8	BPJ/Basin Plan

B. Following are the effluent limitations and the specific rationales for pollutants discharged from Outfalls 003 through 010. The effluent limits are effective on the effective date of the permit for Outfalls 003 through 007 and 010. Discharges from Outfalls 008 and 009 must demonstrate compliance with the effluent limits after September 28, 2008.

The effluent limits also serve as benchmarks effective from the effective date of the permit through September 28, 2008, for Outfalls 008 and 009.

<b>Constituents</b>	<b>Units</b>	<b>Discharge Limitations</b>		<b>Rationale</b>
		<b>Monthly Average</b>	<b>Daily Maximum</b>	
pH	pH Units	----	6.5-8.5	Basin Plan
Oil and grease	mg/L	----	15	BPJ
Chloride	mg/L	----	150	Basin Plan
Sulfate	mg/L	----	250 <sup>2a</sup>	Basin Plan
Sulfate	mg/L	----	300 <sup>2b</sup>	Basin Plan
Boron <sup>1</sup>	mg/L	----	1.0	Basin Plan
Fluoride	mg/L	----	1.6	Basin Plan
Nitrate + Nitrate-N	mg/L	----	10.0 <sup>2a</sup>	Basin Plan
Nitrate + Nitrate-N	mg/L	----	8 <sup>2b</sup>	Basin Plan
Total dissolved solids	mg/L	----	850 <sup>2a</sup>	Basin Plan
Total dissolved solids	mg/L	----	950 <sup>2b</sup>	Basin Plan

<sup>1</sup> Limit is for discharges for Outfalls 003 through 007, 009, and 010 which flows to Calleguas Creek. It is not applicable to discharges from Outfall 008 to Dayton Canyon Creek.

<sup>2a</sup> This limit is for discharges which flow to Calleguas Creek from Outfalls 003 through 007, 009, and 010.

<b>Constituents</b>	<b>Units</b>	<b>Discharge Limitations</b>		<b>Rationale</b>
		<b>Monthly Average</b>	<b>Daily Maximum</b>	
Ammonia-N <sup>(Outfall 008 only)</sup>	mg/L	----	10.1 <sup>®</sup>	LA River Nutrients TMDL
Nitrate-N <sup>(Outfall 008 only)</sup>	mg/L	----	8.0	LA River Nutrients TMDL
Nitrite-N <sup>(Outfall 008 only)</sup>	mg/L	----	1.0	LA River Nutrients TMDL
Selenium <sup>(Outfall 008 only)</sup>	µg/L	----	5 <sup>#</sup>	LA River Metals TMDL
Zinc <sup>(Outfall 008 only)</sup>	µg/L	----	159*	LA River Metals TMDL
Antimony	µg/L	----	6.0	Basin Plan/Title 22
Cadmium	µg/L	----	4.0/3.1*	CTR/LA River Metals TMDL
Copper	µg/L	----	14.0	CTR
Mercury	µg/L	----	0.10	Calleguas Creek Metals TMDL
Nickel	µg/L	----	100	Calleguas Creek Metals TMDL/Basin Plan (Title 22)
Thallium	µg/L	----	2.0	Basin Plan
Lead	µg/L	----	5.2	CTR
TCDD	µg/L	----	2.8E-08	CTR
Perchlorate	µg/L	----	6.0	BPJ/ DHS Notification Level
Radioactivity Gross Alpha	pci/L	----	15	Basin Plan/Title 22
Gross Beta	pci/L	----	50	Basin Plan/Title 22
Combined Radium-226 & Radium-228	pci/L	----	5	Basin Plan/Title 22
Tritium	pci/L	----	20,000	Basin Plan/Title 22
Strontium-90	pci/L	----	8	Basin Plan/Title 22

C. Following are the benchmarks and the specific rationales for pollutants discharged in storm water runoff from Outfalls 012 through 014.

<b>Constituents</b>	<b>Units</b>	<b>Discharge Limitations</b>		<b>Rationale</b>
		<b>Monthly Average</b>	<b>Daily Maximum</b>	
pH	pH Units	----	6.5-8.5	Basin Plan
Oil and grease	mg/L	----	15	BPJ
Chloride	mg/L	----	150	Basin Plan
Sulfate	mg/L	----	300	Basin Plan
Fluoride	mg/L	----	1.6	Basin Plan
Nitrate + Nitrate-N	mg/L	----	8	Basin Plan
Total dissolved solids	mg/L	----	950	Basin Plan
Settleable solids	ml/L	----	0.3	Basin Plan
Total suspended solids	mg/L	----	45	BPJ
Ammonia-N	mg/L	----	10.1 <sup>®</sup>	LA River Nitrogen TMDL
Nitrate-N	mg/L	----	8.0	LA River Nitrogen TMDL
Nitrite-N	mg/L	----	1.0	LA River Nitrogen TMDL
Cadmium	µg/L	----	3.1*	LA River Metals TMDL
Selenium	µg/L	----	5 <sup>#</sup>	LA River Metals TMDL

<b>Constituents</b>	<b>Units</b>	<b>Discharge Limitations</b>		<b>Rationale</b>
		<b>Monthly Average</b>	<b>Daily Maximum</b>	
Zinc	µg/L	----	159*	LA River Metals TMDL
Copper	µg/L	----	13.5	CTR
Mercury	µg/L	----	0.10	CTR
Lead	µg/L	----	5.2	CTR
TCDD	µg/L	----	2.8E-08	CTR
Naphthalene	µg/L	----	21	BPJ
Total Petroleum Hydrocarbons	µg/L	----	100	BPJ
Ethylene dibromide	µg/L	----	50	BPJ
Tertiary butyl alcohol	µg/L	----	12	BPJ
1,4-dioxane	µg/L	----	3	BPJ
Perchlorate	µg/L	----	6.0	BPJ/ DHS Notification Level

**VIII. Receiving Water Limitations**

- A. The discharge shall not cause the concentration of constituents in Arroyo Simi, a tributary of Calleguas Creek, in excess of the following limits.

<b>Constituents</b>	<b>Units</b>	<b>Discharge Monthly Average</b>	<b>Limitations Daily Maximum</b>	<b>Rationale</b>
Chlorpyrifos	µg/L	--	0.02 <sup>1</sup>	Toxicity TMDL
Diazinon	µg/L	--	0.16 <sup>1</sup>	Toxicity TMDL
Chlordane	µg/L	--	0.001	OC Pest & PCBs TMDL
4,4-DDD	µg/L	--	0.0014	OC Pest & PCBs TMDL
4,4-DDE	µg/L	--	0.001	OC Pest & PCBs TMDL
4,4-DDT	µg/L	--	0.001	OC Pest & PCBs TMDL
Dieldrin	µg/L	--	0.0002	OC Pest & PCBs TMDL
PCBs	µg/L	--	0.0003	OC Pest & PCBs TMDL
Toxaphene	µg/L	--	0.0003	OC Pest & PCBs TMDL

<sup>1</sup> Limit effective March 24, 2008, through June 10, 2009. The TMDL specifies interim limits which are effective from March 24, 2006, through March 23, 2008.

- B. Interim effluent limitations effective for Arroyo Simi from the effective date of the permit through March 23, 2008. The final effluent limitations in Table A for these constituents are effective from March 24, 2008, through the term of the permit.

<b>Constituents</b>	<b>Units</b>	<b>Discharge Monthly Average</b>	<b>Limitations Daily Maximum</b>	<b>Rationale</b>
Chlorpyrifos	µg/L	--	0.74	Toxicity TMDL
Diazinon	µg/L	--	0.91	Toxicity TMDL

**IX. Receiving Water Sediment Effluent Limitations**

A. Final Ambient WLAs for Pollutants in Sediment for Storm Water Dischargers

The following are the final ambient WLAs for storm water permittees that were established in the Calleguas Creek OC Pesticides & PCBs TMDL. They are measured as in-stream annual averages at the base of each subwatershed where the discharges are located.

The final WLAs must be achieved and become sediment limits after the sampling indicates that the Discharger is able to comply with the final WLAs or at the end of the 20-year compliance schedule specified in the TMDL (March 24, 2026), which ever occurs first. In either event, the permit will be reopened at that time to include appropriate sediment limits.

<u>Constituents</u>	<u>Units</u>	<u>Discharge Monthly Average</u>	<u>Limitations Daily Maximum</u>	<u>Rationale</u>
Chlordane	µg/g	--	0.0033	OC Pest & PCBs TMDL
4,4-DDD	µg/g	--	0.002	OC Pest & PCBs TMDL
4,4-DDE	µg/g	--	0.0014	OC Pest & PCBs TMDL
4,4-DDT	µg/g	--	0.0003	OC Pest & PCBs TMDL
Dieldrin	µg/g	--	0.0002	OC Pest & PCBs TMDL
PCBs	µg/g	--	0.12	OC Pest & PCBs TMDL
Toxaphene	µg/g	--	0.0006	OC Pest & PCBs TMDL

B. Interim Ambient WLAs for Pollutants in Sediment for Storm Water Dischargers

The following sediment interim WLAs are effective from November 23, 2007, through June 10, 2009. If the permit is administratively extended, these WLAs will continue to be in effect up to November 23, 2012 (five years from the effective date of this permit).

<u>Constituents</u>	<u>Units</u>	<u>Discharge Monthly Average</u>	<u>Limitations Daily Maximum</u>	<u>Rationale</u>
Chlordane	µg/g	--	0.0033	OC Pest & PCBs TMDL
4,4-DDD	µg/g	--	0.014	OC Pest & PCBs TMDL
4,4-DDE	µg/g	--	0.17	OC Pest & PCBs TMDL
4,4-DDT	µg/g	--	0.025	OC Pest & PCBs TMDL
Dieldrin	µg/g	--	0.0011	OC Pest & PCBs TMDL
PCBs	µg/g	--	25.7	OC Pest & PCBs TMDL
Toxaphene	µg/g	--	0.23	OC Pest & PCBs TMDL

**X. Monitoring Requirements**

A. Effluent Monitoring

To assess the impact of the discharge to the beneficial uses of the receiving waters, the Discharger is required to monitor the conventional and priority pollutants and other

identified parameters. Monitoring of these pollutants during treatment operations will characterize the wastes discharged.

B. Storm Water Monitoring and Reporting

Storm water runoff discharges from the SSFL are subject to requirements stipulated in this NPDES permit and the Discharger is required to comply with all applicable provisions of the Storm Water Pollution Prevention Plan (Attachment A of the Order). This plan includes requirements to develop, implement, and when appropriate update a Storm Water Pollution Prevention Plan (SWPPP) along with Best Management Practices (BMPs) with the goal of preventing all pollutants from contacting storm water and with the intent of keeping all contaminants of concern from moving into receiving waters. The BMPs are designed to treat flows generated by storm water runoff from a storm depth up to 2.3 inches to meet the final effluent limits.


C. Receiving Water Monitoring and Reporting

The Calleguas Creek Toxicity TMDL and the Calleguas Creek OC Pesticides & PCBs TMDL include receiving water concentrations that are to be accomplished utilizing BMPs. The OC Pesticides & PCBs TMDL includes sediment contaminant concentrations for tributaries of Calleguas Creek as well. This permit includes monitoring requirements to demonstrate compliance with the stipulated effluent limits.

D. Sediment Monitoring and Reporting

The Calleguas Creek OC Pesticides & PCBs TMDL includes waste load allocations and a requirement for monitoring of the sediment. The TMDL stipulates that compliance with the sediment based WLAs is measured as an in-stream annual average at the base of each subwatershed where the discharges are located.


# SANTA SUSANA FIELD LABORATORY AND VICINITY - FIGURE 1

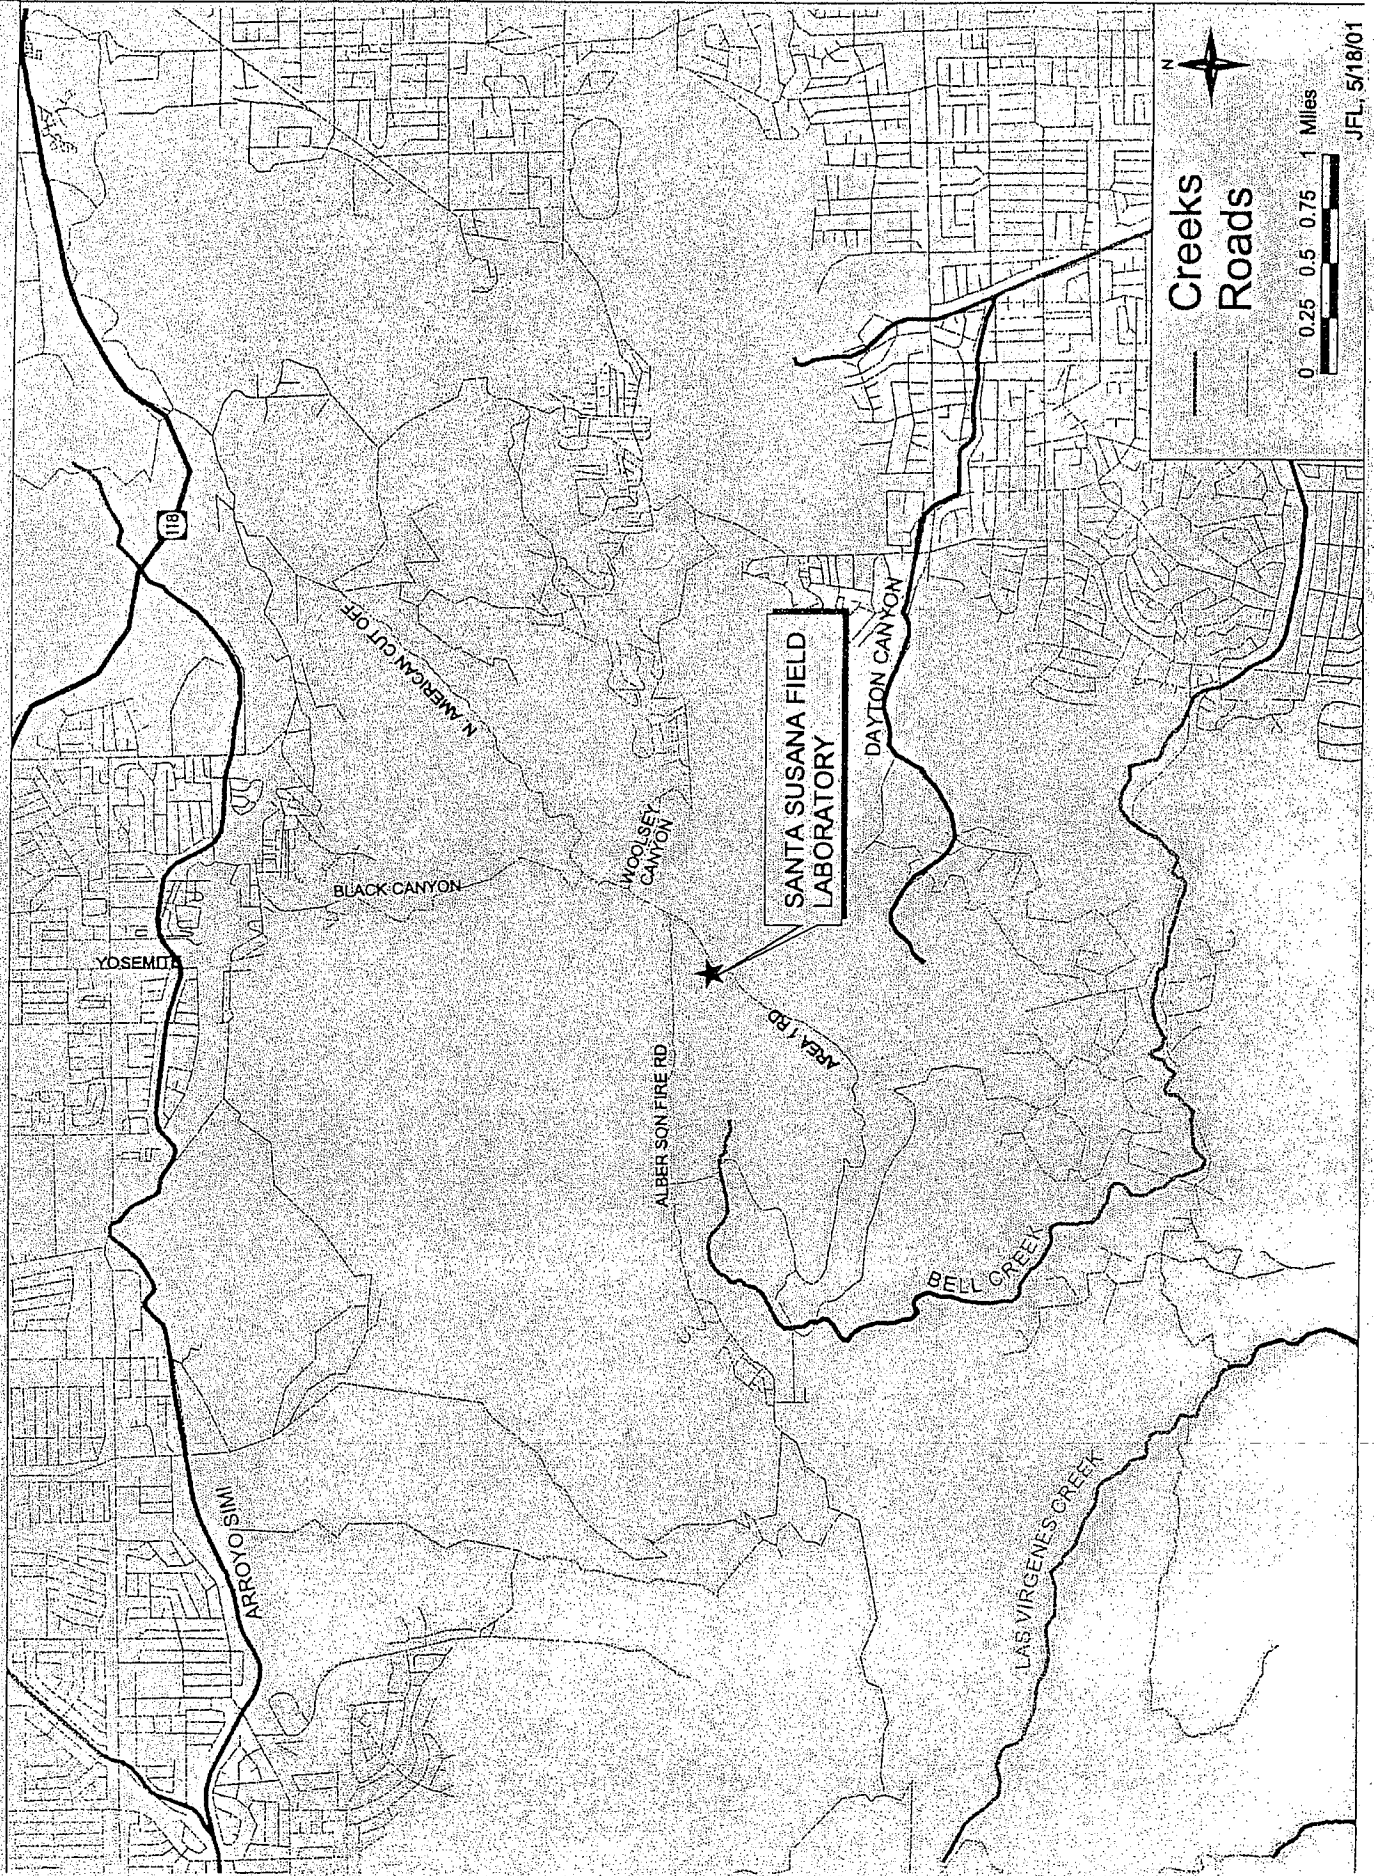




# FIGURE 2

## SSFL Surface Water Drainage Channels, Ponds & Discharge Locations

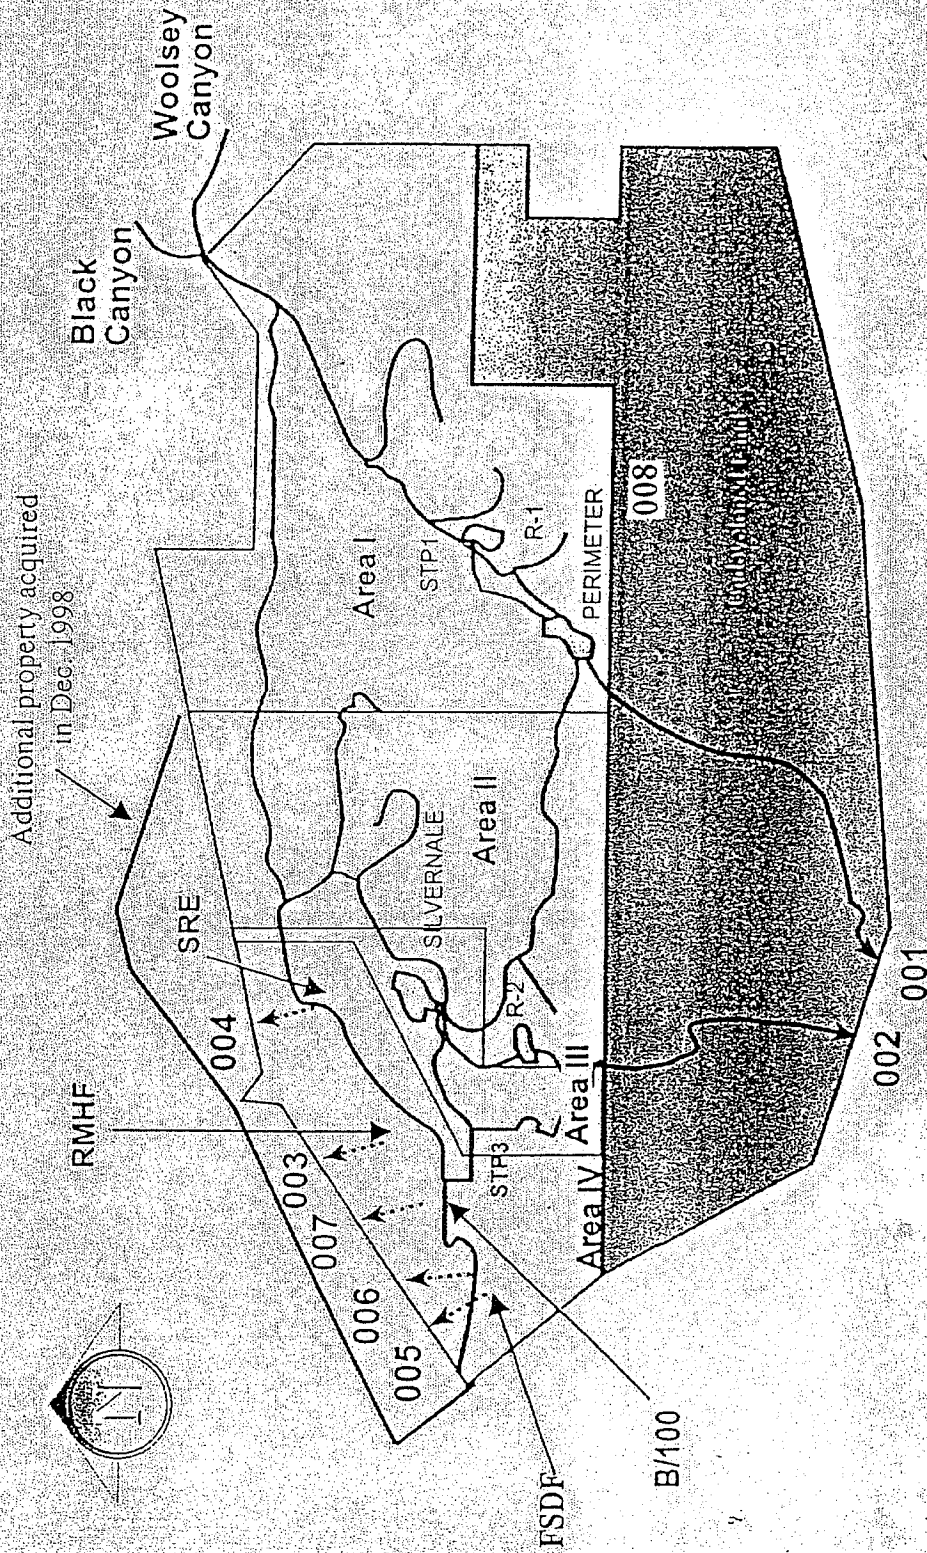

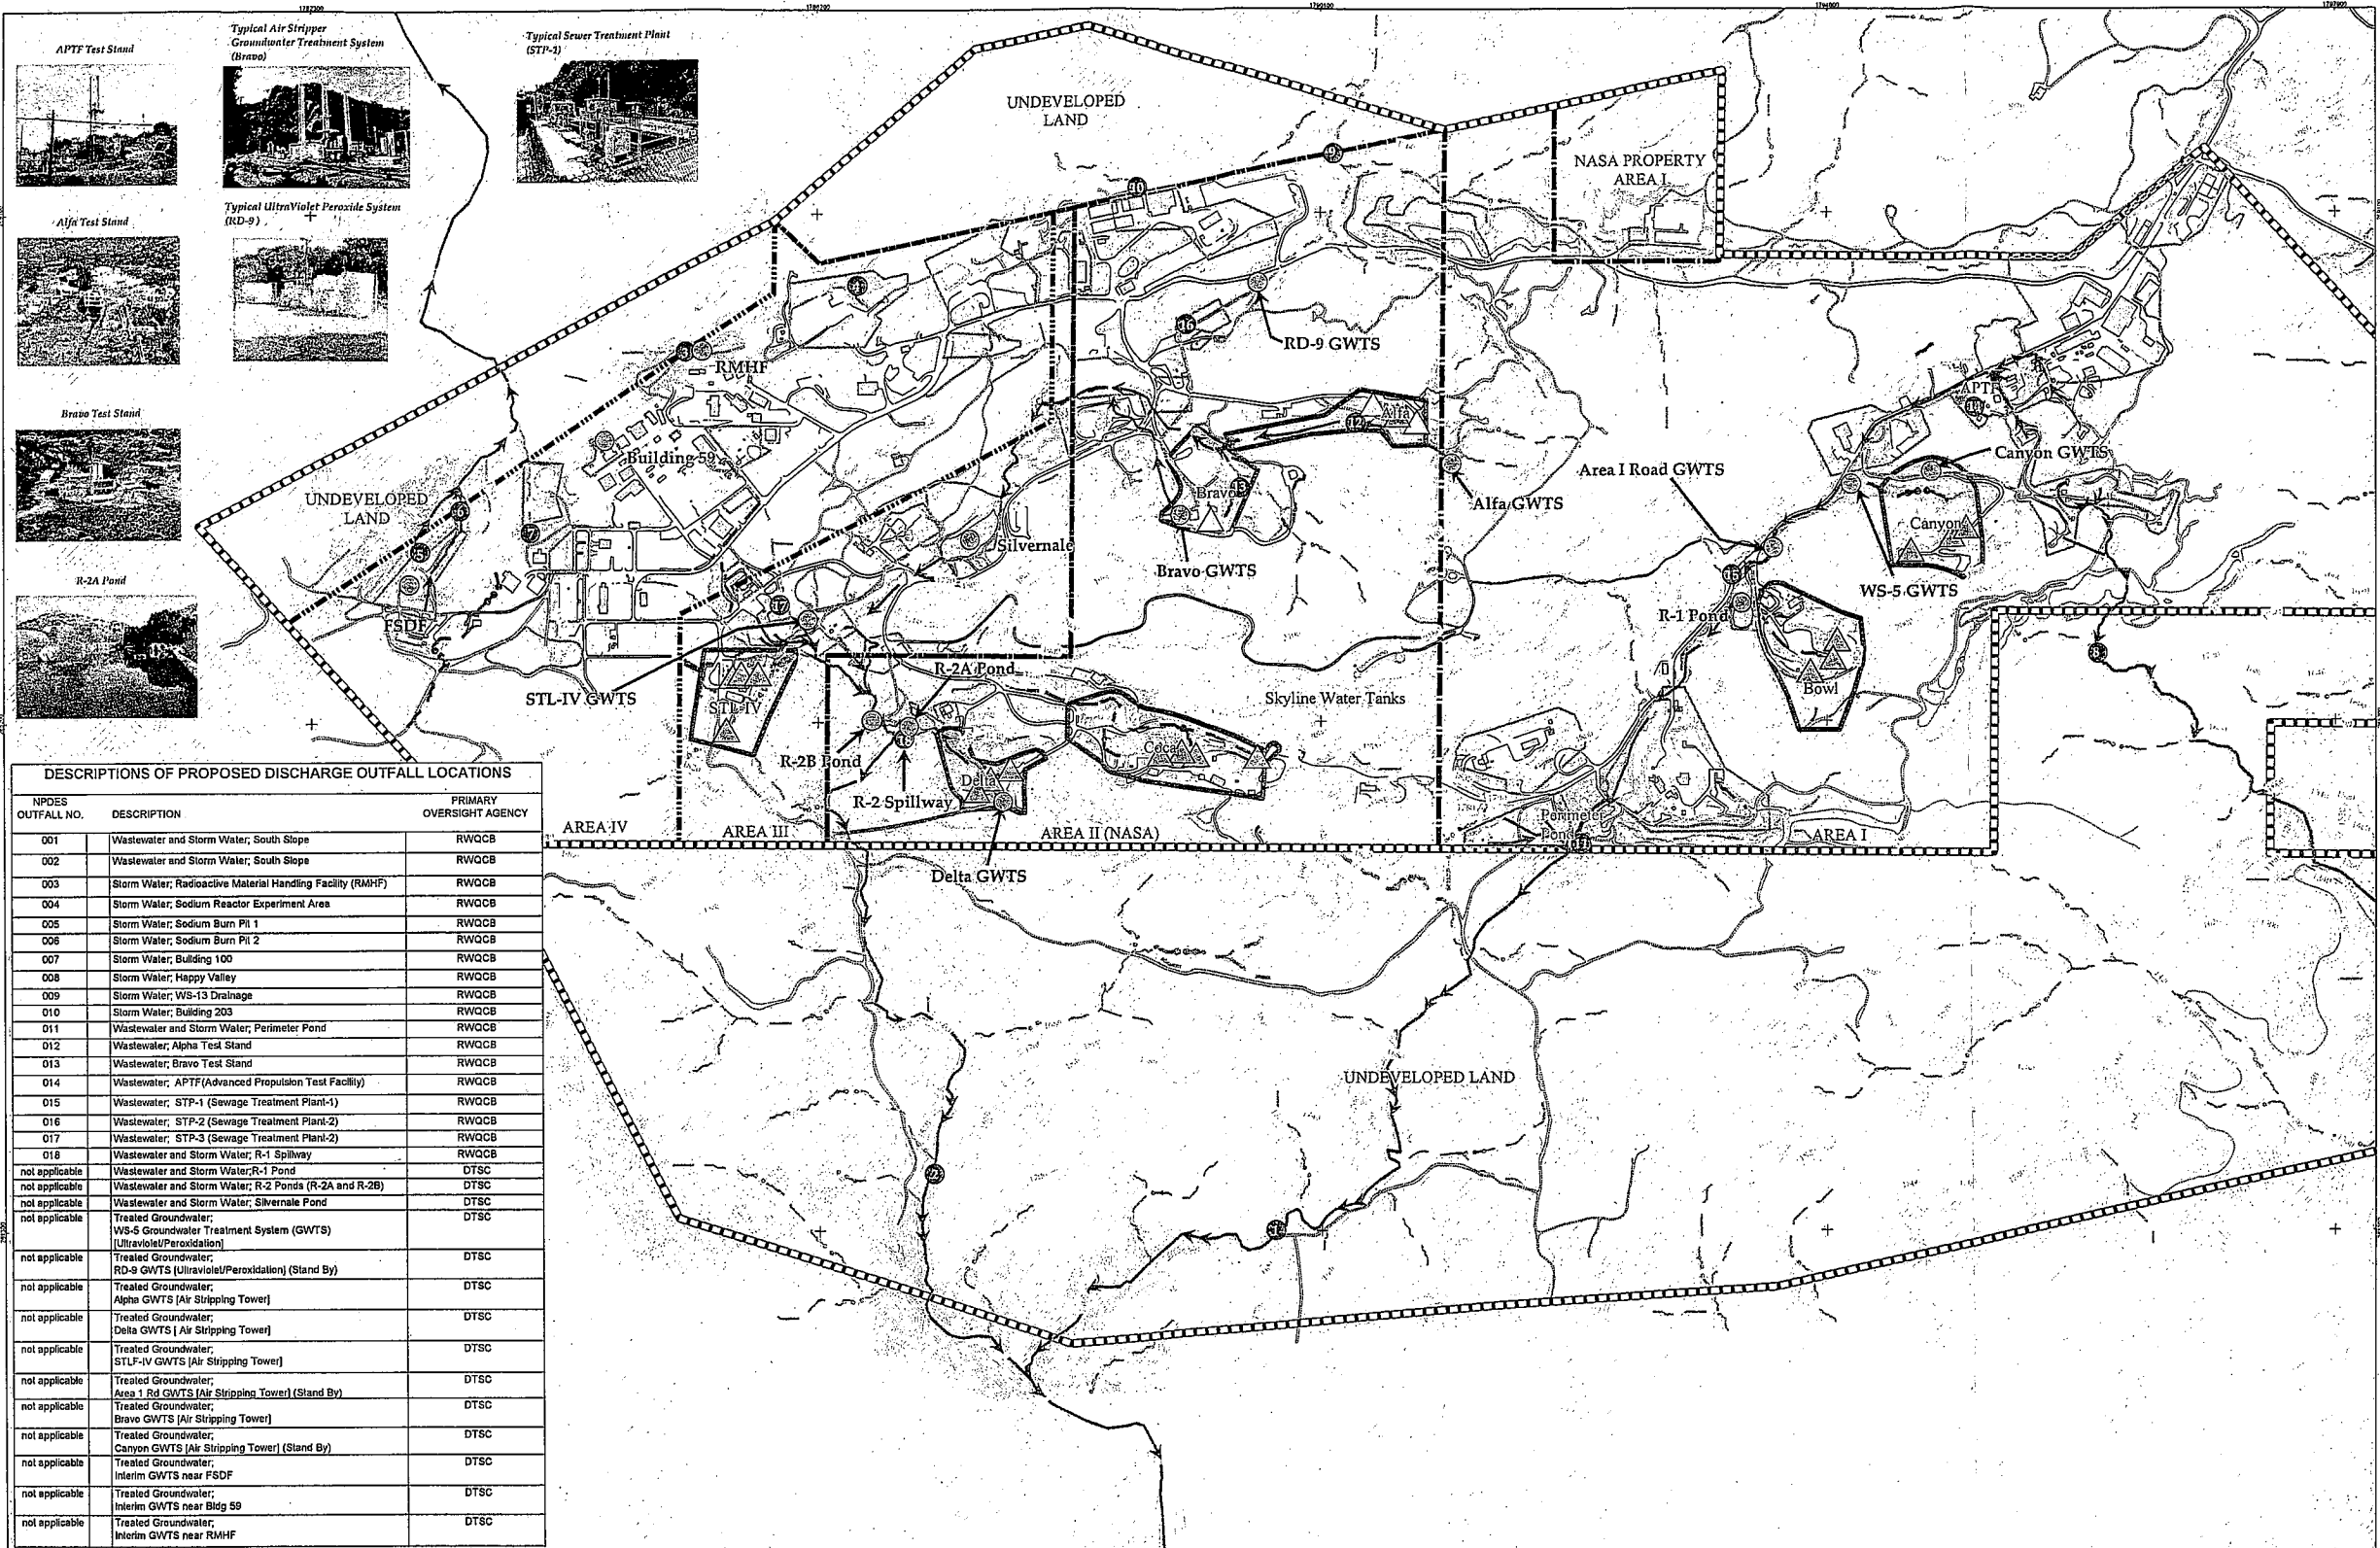

**DESCRIPTIONS OF PROPOSED DISCHARGE OUTFALL LOCATIONS**

NPDES OUTFALL NO.	DESCRIPTION	PRIMARY OVERSIGHT AGENCY
001	Wastewater and Storm Water; South Slope	RWQCB
002	Wastewater and Storm Water; South Slope	RWQCB
003	Storm Water; Radioactive Material Handling Facility (RMHF)	RWQCB
004	Storm Water; Sodium Reactor Experiment Area	RWQCB
005	Storm Water; Sodium Burn Pil 1	RWQCB
006	Storm Water; Sodium Burn Pil 2	RWQCB
007	Storm Water; Building 100	RWQCB
008	Storm Water; Happy Valley	RWQCB
009	Storm Water; WS-13 Drainage	RWQCB
010	Storm Water; Building 203	RWQCB
011	Wastewater and Storm Water; Perimeter Pond	RWQCB
012	Wastewater; Alpha Test Stand	RWQCB
013	Wastewater; Bravo Test Stand	RWQCB
014	Wastewater; APTF (Advanced Propulsion Test Facility)	RWQCB
015	Wastewater; STP-1 (Sewage Treatment Plant-1)	RWQCB
016	Wastewater; STP-2 (Sewage Treatment Plant-2)	RWQCB
017	Wastewater; STP-3 (Sewage Treatment Plant-2)	RWQCB
018	Wastewater and Storm Water; R-1 Spillway	RWQCB
not applicable	Wastewater and Storm Water; R-1 Pond	DTSC
not applicable	Wastewater and Storm Water; R-2 Ponds (R-2A and R-2B)	DTSC
not applicable	Wastewater and Storm Water; Silverdale Pond	DTSC
not applicable	Treated Groundwater; WS-5 Groundwater Treatment System (GWTS) (Ultraviolet/Peroxidation)	DTSC
not applicable	Treated Groundwater; RD-9 GWTS (Ultraviolet/Peroxidation) (Stand By)	DTSC
not applicable	Treated Groundwater; Alfa GWTS (Air Stripping Tower)	DTSC
not applicable	Treated Groundwater; Delta GWTS (Air Stripping Tower)	DTSC
not applicable	Treated Groundwater; STL-IV GWTS (Air Stripping Tower)	DTSC
not applicable	Treated Groundwater; Area I Rd GWTS (Air Stripping Tower) (Stand By)	DTSC
not applicable	Treated Groundwater; Bravo GWTS (Air Stripping Tower)	DTSC
not applicable	Treated Groundwater; Canyon GWTS (Air Stripping Tower) (Stand By)	DTSC
not applicable	Treated Groundwater; Interim GWTS near FSDF	DTSC
not applicable	Treated Groundwater; Interim GWTS near Bldg 59	DTSC
not applicable	Treated Groundwater; Interim GWTS near RMHF	DTSC

MAP COORDINATES IN STATE PLANE, NAD 83, ZONE V

**Legend**

- NPDES Outfalls (RWQCB Primary Oversight Authority)
- ◐ DTSC Primary Oversight Authority
- Treated Effluent Pathways
- HPDE Transmission Pipelines
- Natural Drainage
- Concrete Lined Drainage
- Graded Drainage
- ◻ Surface Water Reclamation Ponds
- ◻ Water Tanks
- ◻ Rocket Engine Test Stand RFI Sites
- ◻ Groundwater Remediation Facilities (GRF)
- ◻ Former Surface Impoundments (TPCA Evaluated)
- ◻ Existing Test Stand With Engine Test Fire Quenching Operation
- ◻ Existing Test Stand Without Engine Test Fire Quenching Operation
- ◻ Dismantled Test Stand

**Base Map Legend**

- SSFL Property Boundary
- Administrative Area Boundary
- RFI Site Boundary

**NPDES Permit Related Features  
Santa Susana Field Laboratory**

DATE: 01/15/04  
FILE: r:\rock\plots\eromsp\groundwater\_treatment\_systems\_36e48.mxd

**MWH**

**FIGURE 3**