



Central Valley Regional Water Quality Control Board

19 June 2020

Mark Liebenow
Water Reclamation Facility Supervisor
City of Placerville
3101 Center Street
Placerville, CA 95667

VIA EMAIL:
mliebenow@cityofplacerville.org
CERTIFIED MAIL
7019 2280 0001 9243 5548

NOTICE OF APPLICABILITY (NOA); MUNICIPAL GENERAL WASTE DISCHARGE REQUIREMENTS ORDER R5-2017-0085-01 (NPDES CAG585001); CITY OF PLACERVILLE, HANGTOWN CREEK WATER RECLAMATION FACILITY, EL DORADO COUNTY

Our office received a Notice of Intent (NOI) dated 24 July 2018 from the City of Placerville (Discharger), for discharge of tertiary treated domestic wastewater to surface water from the Hangtown Creek Water Reclamation Facility (Facility) to Hangtown Creek. The General Order for Municipal Wastewater Dischargers That Meet Objectives/Criteria at the Point of Discharge to Surface Water Order R5-2017-0085-01 (Municipal General Order) requires the submittal of an NOI to apply for regulatory coverage of a surface water discharge. Based on the NOI and subsequent information submitted by the Discharger, staff has determined that the NOI requirements have been fulfilled and the Facility is eligible for coverage under the Municipal General Order. This Facility's discharge is assigned Municipal General Order enrollee number R5-2017-0085-007 and National Pollutant Discharge Elimination System (NPDES) Permit CAG585001. Please reference your Municipal General Order enrollee number, **R5-2017 0085-007**, in your correspondence and submitted documents.

Discharges to surface water from the Facility are currently regulated by an individual NPDES permit, Order R5-2014-0015-01 (NPDES CA0078956) issued by the Central Valley Regional Water Quality Control Board (Central Valley Water Board) on 7 February 2014. The current individual NPDES permit expired on 1 February 2019 and was administratively extended by the Executive Officer on 23 January 2019. This NOA, authorizing coverage under the Municipal General Order, shall become effective on **1 August 2020**, at which time the terms and conditions in Order R5-2014-0015-01 will cease to be effective except for enforcement purposes. To meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the Clean Water Act and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements contained in the Municipal General Order and as specified in this NOA. This action in no way prevents the Central Valley Water Board from taking enforcement action for past violations of Order R5-2014-0015-01.

KARL E. LONGLEY SCD, P.E., CHAIR | PATRICK PULUPA, ESQ., EXECUTIVE OFFICER

The enclosed Municipal General Order is not currently available online but can be requested by email or phone from the [NPDES Permitting Contacts](https://www.waterboards.ca.gov/centralvalley/water_issues/waste_to_surface_water/contacts/) webpage (https://www.waterboards.ca.gov/centralvalley/water_issues/waste_to_surface_water/contacts/). You are urged to familiarize yourself with the entire contents of the enclosed document.

The Monitoring and Reporting Program, Attachment E to the Municipal General Order, contains the general monitoring and reporting requirements. The Discharger specific monitoring and reporting requirements are included within this NOA as Appendix D. Only the monitoring and reporting requirements specifically listed in Appendix D of this NOA are applicable to this Facility. Additionally, please note the new requirement in Appendix D, Section X.B.6.c of this NOA to attach all final laboratory reports from all contracted commercial laboratories with your Self-Monitoring Reports (SMRs).

The discharge of treated domestic wastewater shall be in accordance with the requirements contained in the Municipal General Order, as specified in this NOA.

Table 1. Facility Information

WDID	5A090100001
CIWQS Facility Place ID	229595
Discharger	City of Placerville
Name of Facility	Hangtown Creek Water Reclamation Facility
Facility Street Address	2300 Coolwater Creek Road
Facility City, State, Zip Code	Placerville, CA 95667
Facility County	El Dorado County
Facility Contact, Title and Phone	Mark Liebenow, Water Reclamation Facility Superintendent, (530) 626-5230
Authorized Person to Sign and Submit Reports	Same as Facility Contact
Mailing Address	3101 Center Street, Placerville, CA 95667
Billing Address	Same as Mailing Address
Type of Facility	Publicly Owned Treatment Works (POTW)
Major or Minor Facility	Major
Threat to Water Quality	2
Complexity	B
Pretreatment Program	Not Applicable
Recycling Requirements	Not Applicable
Facility Design Average Dry Weather Flow (ADWF)	2.3 Million Gallons Per Day (MGD)
Permitted ADWF	2.3 MGD
Watershed	South Fork American
Receiving Water	Hangtown Creek
Receiving Water Type	Inland Surface Water
Discharge Point 001	38° 43' 40" N, 120° 51' 04" W

I. FACILITY INFORMATION

The Facility provides sewerage service for the community of Placerville and a small portion of El Dorado County and serves a population of approximately 10,335. The current design average dry weather flow capacity of the Facility is 2.3 MGD.

The tertiary treatment system at the Facility consists of the following:

- one rotary fine screen;
- two primary clarifiers;
- three aeration basins;
- two anoxic basins;
- three secondary clarifiers;
- three cooling tower units;
- six multi-media filters;
- one ultraviolet light disinfection channel; and
- a cascade aerator prior to discharge to Hangtown Creek.

Solids collection and disposal consist of the following:

- solids collected from the primary clarifiers are digested in anaerobic digesters;
- solids collected from the secondary clarifiers are stored in waste activated sludge holding tanks, sent to a gravity thickener, and then also digested in anaerobic digesters;
- digested solids are dewatered using belt filter presses;
- the biosolids are hauled off-site and land applied by a separate commercial entity; and
- filter backwash water and decant from the belt filter press are collected in a sump and pumped to storage basin, then returned to the influent of the primary clarifier splitter box for treatment.

II. RECEIVING WATER BENEFICIAL USES

The Facility discharges from Discharge Point 001 to Hangtown Creek, which flows to Weber Creek, a tributary to the South Fork of the American River within the South Fork of the American River watershed. According to the Water Quality Control Plan for the Sacramento River and San Joaquin River Basins (Basin Plan) and the Tributary Rule, the following beneficial uses apply to Hangtown Creek:

- Municipal and Domestic Supply (MUN);
- Agricultural Supply (AGR);
- Hydropower Generation (POW);
- Water Contact Recreation (REC-1);
- Non-contact Water Recreation (REC-2);
- Warm Freshwater Habitat (WARM);
- Cold Freshwater Habitat (COLD); and
- Wildlife Habitat (WILD).

According to the Basin Plan, groundwater underlying the Facility is designated with the following existing beneficial uses:

- Municipal and Domestic Supply (MUN);
- Agricultural Supply, including irrigation and stock watering (AGR);
- Industrial Service Supply (IND); and
- Industrial Process Supply (PRO).

III. RECEIVING WATER TOTAL MAXIMUM DAILY LOADS (TMDLS)

Hangtown Creek is not listed for constituent(s) on the Clean Water Act 303(d) List of impaired water bodies. Therefore, no additional 303(d) based effluent limitations or monitoring requirements are included in this NOA.

IV. DISCHARGE PROHIBITIONS

Discharge prohibitions are contained in section IV of the Municipal General Order. Only the discharge prohibitions listed below are applicable to this Facility.

1. The discharge of wastes, other than those described in section I.A and meeting the eligibility criteria in section I.B of the Municipal General Order, is prohibited unless the Discharger obtains coverage under another general or individual Order that regulates the discharge of such wastes. (see Municipal General Order section IV.A)
2. The by-pass or overflow of wastes to surface waters is prohibited, except as allowed by Federal Standard Provisions sections I.G. and I.H in Attachment D, Standard Provisions, of the Municipal General Order. (see Municipal General Order section IV.B)
3. Neither the discharge nor its treatment shall create a nuisance as defined in section 13050 of the Water Code. (see Municipal General Order section IV.C)
4. **Average Dry Weather Flow.** Discharges exceeding an average dry weather flow of 2.3 MGD are prohibited. (see Municipal General Order section IV.D)

V. EFFLUENT LIMITATIONS

The Discharger shall maintain compliance with the following effluent limitations at Discharge Point 001. Effluent limitations are provided in the Municipal General Order. Only the effluent limitations listed below in Table 2 and items 1-5 are applicable to this Facility. Unless otherwise specified in this NOA, compliance shall be measured at Monitoring Location EFF-001, as described in the Monitoring and Reporting Program, Appendix D of this NOA.

The Discharger shall maintain compliance with the effluent limitations specified in Table 2.

Table 2. Effluent Limitations

Parameter	Units	Average Monthly	Average Weekly	Municipal General Order Section Reference
Biochemical Oxygen Demand (5-day @ 20°Celsius) (BOD ₅)	milligrams per liter (mg/L)	10	15	V.A.1.a.ii.(a)

Parameter	Units	Average Monthly	Average Weekly	Municipal General Order Section Reference
Total Suspended Solids (TSS)	mg/L	10	15	V.A.1.a.ii.(a)
Ammonia Nitrogen, Total as Nitrogen (as N)	mg/L	1.9	4.2	V.A.1.c.v.(b) Table 17E
Nitrate plus Nitrite, Total (as N)	mg/L	10	14	V.A.1.c.vi Table 19B

1. **pH (Municipal General Order section V.A.1.c.iv.(a), Table 15).** The pH shall at all times be within the range of 6.5 and 8.5.
2. **Percent Removal (Municipal General Order section V.A.1.a.ii.(b)(1)).** The average monthly percent removal of BOD₅ and TSS shall not be less than 85 percent.
3. **Total Coliform Organisms (Municipal General Order section V.A.1.a.ii.(c)).** Effluent total coliform organisms shall not exceed:
 - i. 2.2 most probable number per 100 milliliters (MPN/100 mL), as a 7-day median;
 - ii. 23 MPN/100 mL, more than once in any 30-day period; and
 - iii. 240 MPN/100 mL, at any time.
4. **Whole Effluent Toxicity, Acute (Municipal General Order section V.A.1.c.i).** Survival of aquatic organisms in 96-hour bioassays of undiluted waste shall be no less than:
 - i. 70%, minimum for any one bioassay; and
 - ii. 90%, median for any three consecutive bioassays.
5. **Electrical Conductivity (Municipal General Order section V.A.1.c.viii, Table 21).**
 The effluent electrical conductivity shall not exceed the calendar annual average of 625 µmhos/cm.

VI. RECEIVING WATER LIMITATIONS

1. **Surface Water Limitations (Municipal General Order section VI.A).**
 The Municipal General Order includes receiving surface water limitations in Section VI.A. Based on the information provided in the NOI, only the following receiving surface water limitations listed in Municipal General Order Section VI.A are applicable to the Facility.
 - Bacteria (VI.A.2);
 - Biostimulatory Substances (VI.A.3);
 - Chemical Constituents (VI.A.4);
 - Color (VI.A.5);
 - Dissolved Oxygen (VI.A.6.a.i, ii, iv);
 - Floating Material (VI.A.7);

- Oil and Grease (VI.A.8);
- pH (VI.A.9.a);
- Pesticides (VI.A.10);
- Radioactivity (VI.A.11);
- Suspended Sediments (VI.A.12);
- Settleable Substances (VI.A.13);
- Suspended Material (VI.A.14);
- Taste and Odors (VI.A.15);
- Temperature (VI.A.16.f). In Hangtown Creek, the annual average ambient temperature shall not be increased by more than 5° F and the discharge shall not cause an exceedance of the limitations in Table 3 at Monitoring Location RSW-002;
- Toxicity (VI.A.17); and
- Turbidity (VI.A.18.a).

Table 3. Temperature Receiving Water Limitations for Hangtown Creek

Period	Instantaneous Maximum (°F)	Weekly Average (°F)
1 December through 30 April	--	58
1 May through 31 May	--	67
1 June through 15 October	77	72
16 October through 30 November	--	67

2. Groundwater Limitations (Municipal General Order section VI.B).

Release of waste constituents from any storage, treatment, or disposal component associated with the Facility shall not cause the underlying groundwater to contain waste constituents in concentrations greater than background water quality or water quality objectives, whichever is greater.

VII. MONITORING AND REPORTING

Monitoring and reporting program requirements are contained in Appendix D of this NOA.

VIII. PROVISIONS

1. Provisions are contained in section VII of the Municipal General Order and the applicable provisions to the Facility are referenced below, unless specified otherwise:

A. Standard Provisions. Section VII.A

Applicable to all Dischargers.

B. Monitoring and Reporting Program (MRP) Requirements. Section VII.B

The MRP applicable to this Facility is contained in Appendix D of this NOA.

C. Special Provisions. Special Provisions are contained in section VII.C of the Municipal General Order. Only the following Special Provision sections from the Municipal General Order specified in Table 4 apply to this Facility:

Table 4: Summary of Applicable Special Provisions

Special Provision	Section Reference
1. Reopener Provisions	a. Major Modification of Treatment Works c. Whole Effluent Toxicity d. Water Effect Ratios (WERs) and Metal Translators
2. Special Studies, Technical Reports and Additional Monitoring Requirements	a.iii-iv. Toxicity Reduction Evaluation Requirements
4. Construction, Operation and Maintenance Specifications	a.i.(a)-(c). Filtration System Operating Specifications b.i.(a). UV Disinfection System – Dose b.ii.(a). UV Disinfection System – Transmittance b.iii-vi. UV Disinfection System – General c.i-x. Pond Operating Specifications
5. Special Provisions for Municipal Facilities	b. Sludge/Biosolids Treatment or Discharge Specifications
6. Other Special Provisions	a. Title 22, or Equivalent, Disinfection Requirements

IX. COMPLIANCE DETERMINATION

The following compliance determinations, as contained and more fully described in the Municipal General Order, are applicable to this discharge (Municipal General Order section given in brackets, if applicable):

- BOD₅ and TSS Effluent Limitations (VIII.A);
- Average Dry Weather Flow Effluent Prohibition (VIII.D);
- Total Coliform Organisms Effluent Limitations (VIII.E);
- Dissolved Oxygen Receiving Water Limitation (VIII.I);
- Chronic Whole Effluent Toxicity Trigger (VIII.J);
- Period Average, Calendar Month Average, and Annual Average (VIII.N);
- Turbidity Receiving Water Limitation (VIII.O); and
- Reporting Requirements (**NOA, Appendix D, section X**).

X. ANTI-BACKSLIDING REQUIREMENTS

Anti-backsliding requirements are specified in the Municipal General Order, section V.D.3, Attachment F (Fact Sheet). Sections 402(o) and 303(d)(4) of the Clean Water Act (CWA) and federal regulations at 40 Code of Federal Regulations (C.F.R.) section 122.44(l) restrict backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed.

Effluent limitations for mercury, total chlorine residual, lead, zinc, ammonia, BOD₅, pH, and TSS are less stringent than prescribed in previous Order R5-2014-0015-01. A more detailed anti-backsliding analysis is provided in Appendix C to this NOA in section II.A Satisfaction of Anti-Backsliding Requirements, the relaxation of effluent limitations meets the exceptions proved in the federal anti-backsliding regulations.

XI. ANTIDegradation Requirements

Antidegradation requirements are specified in the Municipal General Order, section V.D.4, Attachment F (Fact Sheet). This NOA does not allow an increase in flow or mass of pollutants to the receiving water and the relaxation of effluent limitations for mercury, total chlorine residual, lead, zinc, ammonia, BOD₅, pH, and TSS is consistent with the antidegradation provisions of 40 C.F.R. 131.12 and State Water Board Resolution 68-16.

A more detailed discussion of antidegradation is provided in Appendix C to this NOA, section I.B Antidegradation Policies.

XII. Rationale for Limitations and Monitoring Requirements

Additional rationale for limitations and monitoring requirements is included in Attachment F, section V (Rationale for Effluent Limitations and Discharge Specifications), of the Municipal General Order and Appendix C of this NOA.

XIII. Enforcement

Failure to comply with the applicable requirements of the Municipal General Order, as specified in this NOA, may result in enforcement actions, which could include civil liability (penalties). Effluent limitation violations may be subject to a Mandatory Minimum Penalty (MMP) of \$3,000 per violation. In addition, late monitoring reports may be subject to MMPs and/or discretionary penalties of up to \$1,000 per day late. If discharges do not occur during any report monitoring period, the Discharger must still submit the monitoring report indicating that no discharge occurred to avoid being subject to enforcement actions.

XIV. Communication

Until this NOA becomes effective on 1 August 2020, you will need to comply with the effluent limitations and requirements contained in your existing permit, Order R5-2014-0015-01. For your June and July 2020 monthly self-monitoring reports, you will need to demonstrate compliance with existing Order R5-2014-0015-01 through 31 July 2020. For your August 2020 self-monitoring report, you will need to demonstrate and compliance with this NOA beginning 1 August 2020.

The Central Valley Water Board is implementing a Paperless Office system to reduce our paper use, increase efficiency, and provide a more effective way for our staff, the public, and interested parties to view documents in electronic form. Therefore, the Discharger is required to submit all self-monitoring, technical, and progress reports required by this NOA via California Integrated Water Quality System (CIWQS) submittal. In general, if any monitoring data for a monitoring location can be submitted using a computable document format (CDF) file upload, then it should be submitted as a CDF file upload, such as characterization monitoring data. However, certain parameters that cannot be uploaded to the CIWQS data tables, such as Annual Operations Reports, should be uploaded as a Portable Document Format (PDF), Microsoft Word, or Microsoft Excel file attachment. Also, please upload or enter a cover letter summarizing the content of the report to the submittal tab of the CIWQS module for each submittal.

All other documents not required to be submitted via CIWQS shall be converted to a searchable PDF and submitted by email to

centralvalleysacramento@waterboards.ca.gov. Please include the following information in the body of the email:

- Attention: NPDES Compliance and Enforcement Section
- Discharger: City of Placerville
- Facility: Hangtown Creek Water Reclamation Facility
- County: El Dorado County
- CIWQS Place ID: 229595

Documents that are 50 megabytes or larger must be transferred to a DVD or flash drive, and mailed to our office, attention "ECM Mailroom-NPDES".

Any person aggrieved by this action of the Central Valley Water Board may petition the State Water Board to review the action in accordance with California Water Code section 13320 and California Code of Regulations, title 23, sections 2050 and following. The State Water Board must receive the petition by 5:00 p.m., 30 days after the date this NOA is issued, except that if the thirtieth day following the date this NOA is issued falls on a Saturday, Sunday, or state holiday, the petition must be received by the State Water Board by 5:00 p.m. on the next business day. [Links to the laws and regulations applicable to filing petitions](#) (http://www.waterboards.ca.gov/public_notices/petitions/water_quality) may be found on the Internet or will be provided upon request.

Now that your NOA has been issued, the Central Valley Water Board's Compliance and Enforcement Section will take over management of your case. Jon Rohrbough of the Compliance and Enforcement section is your point of contact for any questions regarding this NOA. If you find it necessary to make a change to your permitted operations, you will be directed to the appropriate Permitting staff. You may contact Jon Rohrbough at (916) 464-4822 or at Jon.Rohrbough@waterboards.ca.gov.

Patrick Pulupa
Executive Officer

Appendices:

- Appendix A – Location Map
- Appendix B – Flow Schematic
- Appendix C – Rationale for Limitations and Monitoring Requirements
- Appendix D – Monitoring and Reporting Program
- Appendix E – Determination of WQBELs

Enclosures:

- Municipal General Order R5-2017-0085-01 (Discharger Only)
- Analytical Methods Certification Report (Discharger Only)


City of Placerville
Hangtown Creek Water Reclamation Facility

19 June 2020
R5-2017-0085-007


cc:

Elizabeth Sablad, U.S. EPA, Region IX, San Francisco (email only)
Peter Kozelka, U.S. EPA, Region IX, San Francisco (email only)
Afrooz Farsimadan, California State Water Resources Control Board (email only)
Renan Jauregui, California State Water Resources Control Board (email only)
Jarma Bennett, California State Water Resources Control Board (email only)
ICIS NPDES (Sarah Torres), PG Environmental, (email only)

APPENDIX A – LOCATION MAP

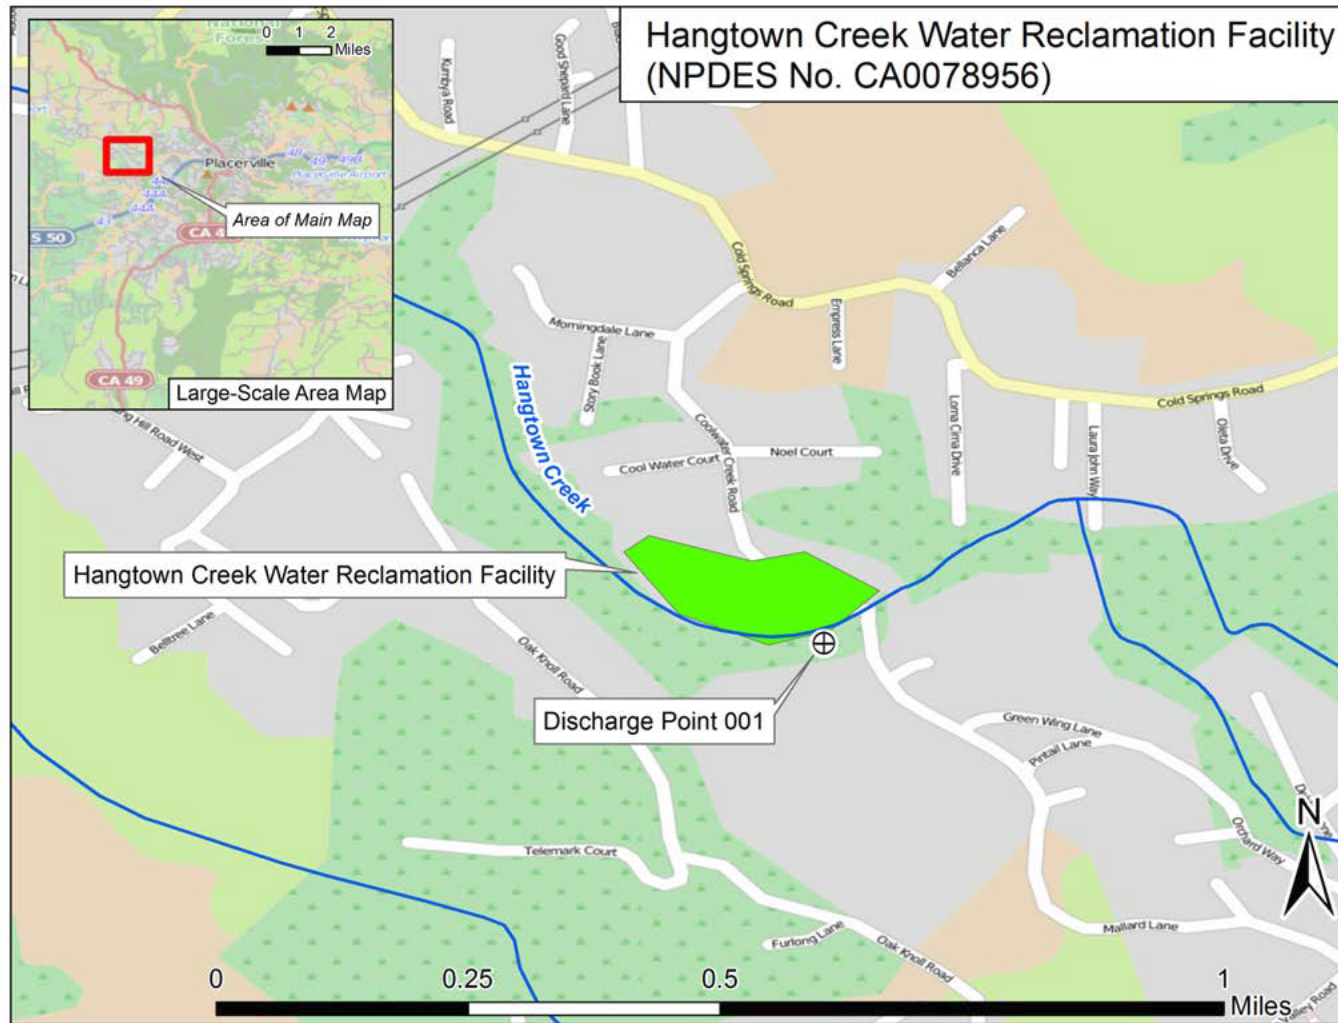

APPENDIX B – FLOW SCHEMATIC

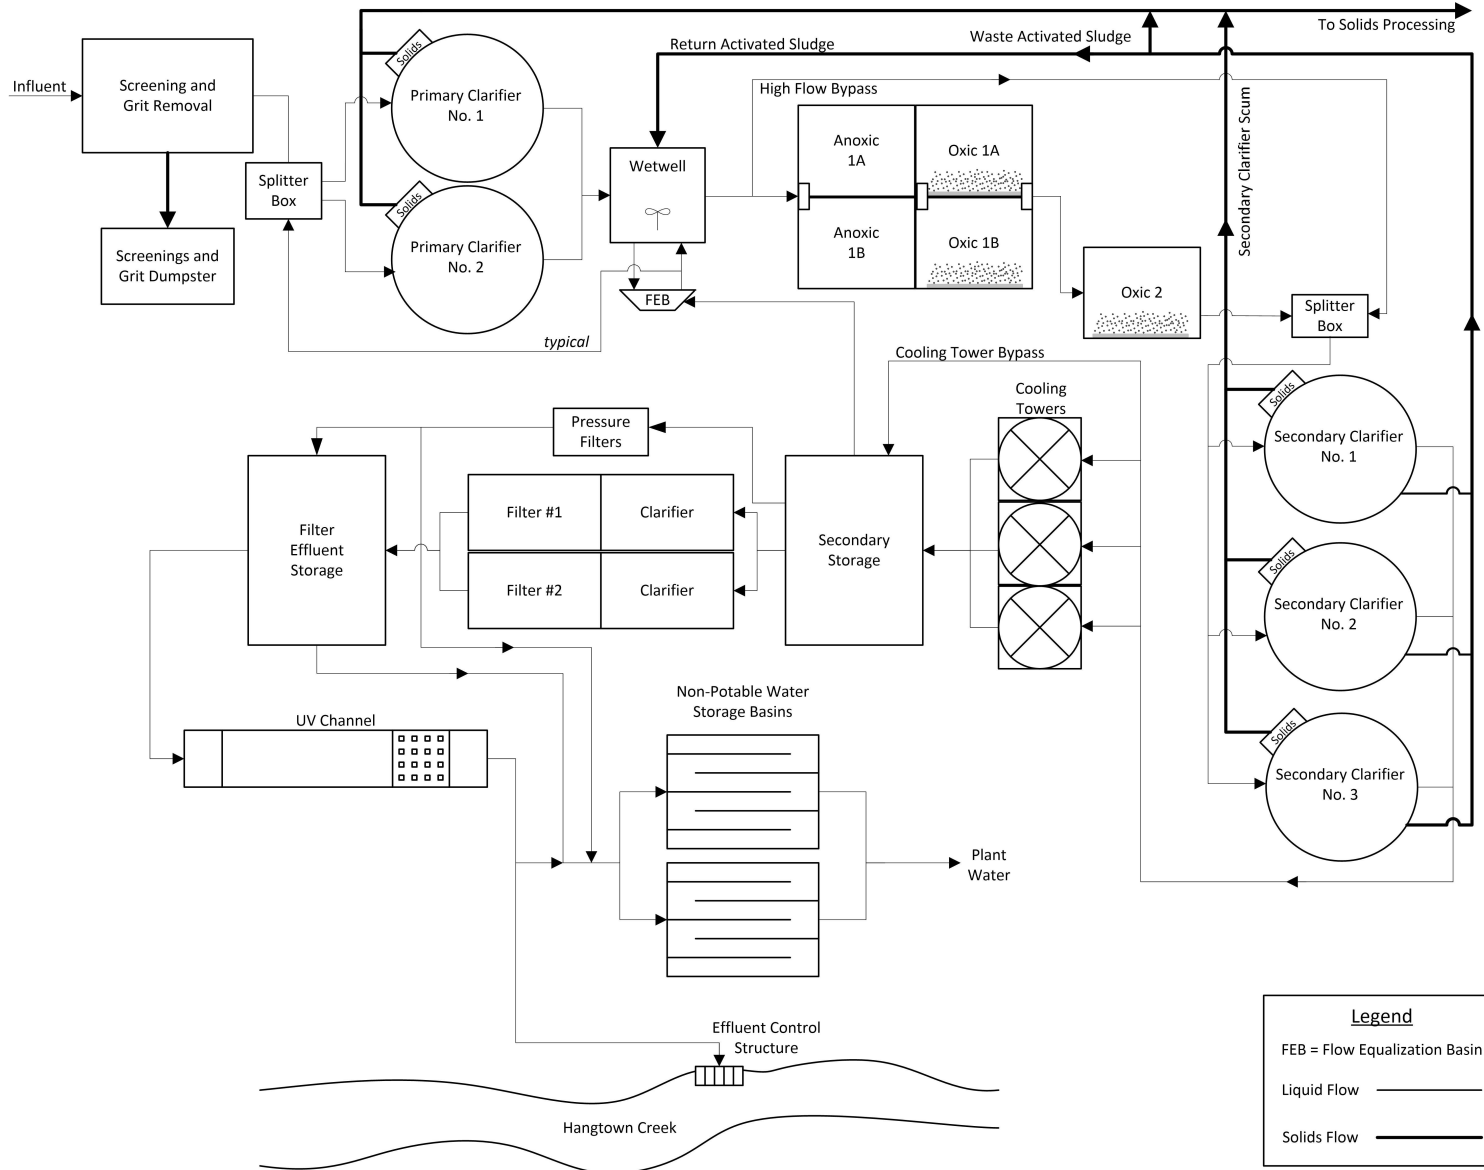

APPENDIX C – RATIONALE FOR LIMITATIONS AND MONITORING REQUIREMENTS

I. FINAL EFFLUENT LIMITATION CONSIDERATIONS

A. Satisfaction of Anti-Backsliding Requirements

The Clean Water Act (CWA) specifies that a revised permit may not include effluent limitations that are less stringent than the previous permit unless a less stringent limitation is justified based on exceptions to the anti-backsliding provisions contained in CWA sections 402(o) or 303(d)(4), or, where applicable 40 C.F.R. section 122.44(l).

The effluent limitations in this NOA are at least as stringent as the effluent limitations in the Facility's previous Order R5-2014-0015-01, with the exception of effluent limitations for mercury, total chlorine residual, lead, zinc, pH, and the maximum daily and mass-based effluent limits for ammonia, BOD₅ and TSS. The effluent limitations for these pollutants are less stringent than those in Order R5-2014-0015-01. This relaxation of effluent limitations is consistent with the anti-backsliding requirements of the CWA and federal regulations.

1. **CWA section 402(o)(1) and 303(d)(4).** CWA section 402(o)(1) prohibits the establishment of less stringent water quality-based effluent limits "except in compliance with Section 303(d)(4)." CWA section 303(d)(4) has two parts: paragraph (A) which applies to nonattainment waters and paragraph (B) which applies to attainment waters.
 - a. For waters where standards are not attained, CWA section 303(d)(4)(A) specifies that any effluent limit based on a TMDL or other waste load allocation (WLA) may be revised only if the cumulative effect of all such revised effluent limits based on such TMDLs or WLAs will assure the attainment of such water quality standards.
 - b. For attainment waters, CWA section 303(d)(4)(B) specifies that a limitation based on a water quality standard may be relaxed where the action is consistent with the antidegradation policy.

Hangtown Creek is considered an attainment water for mercury, total chlorine residual, lead, zinc, ammonia, pH, BOD₅, and TSS because the receiving water is not listed as impaired on the 303(d) list for these constituents. The exceptions in Section 303(d)(4) address both waters in attainment with water quality standards and those not in attainment, i.e. waters on the section 303(d) impaired waters list (State Water Resources Control Board Order WQ-2008-0006, Berry Petroleum Company, Poso Creek/McVan Facility). As discussed below, removal of these effluent limitations complies with federal and state antidegradation requirements. Thus, removal of the effluent limitations for mercury, total chlorine residual, lead, zinc, pH, and the maximum daily and mass-based effluent limits for ammonia, BOD₅ and TSS for this NOA meets the exception in CWA section 303(d)(4)(B).

2. **CWA section 402(o)(2).** CWA section 402(o)(2) provides several exceptions to the anti-backsliding regulations. CWA 402(o)(2)(B)(i) allows a renewed, reissued, or modified permit to contain a less stringent effluent limitation for a pollutant if information is available which was not available at the time of permit issuance (other than revised regulations, guidance, or test methods) and which would have justified the application of a less stringent effluent limitation at the time of permit issuance.

Updated information that was not available at the time Order R5-2014-0015-01 was issued indicates that mercury, total chlorine residual, lead, and zinc do not exhibit reasonable potential to cause or contribute to an exceedance of water quality objectives in the receiving water. Additionally, updated information that was not available at the time Order R5-2014-0015-01 was issued indicates that removal of effluent limitations for mercury, total chlorine residual, lead, and zinc, based on available data, satisfy requirements in CWA section 402(o)(2). The updated information that supports the removal of effluent limitations for these constituents includes the following:

- a. **Mercury.** Monitoring data collected over the permit term for Order R5-2014-0015-01 indicates that mercury in the discharge does not exhibit reasonable potential to cause or contribute to an exceedance of their respective water quality objectives/criteria.
- b. **Total Chlorine Residual.** Monitoring data collected over the permit term for Order R5-2014-0015-01 indicates that the total residual of chlorine in the discharge does not exhibit reasonable potential to cause or contribute to an exceedance of their respective water quality objectives/criteria.
- c. **Lead.** Monitoring data collected over the permit term for Order R5-2014-0015-01 indicates that lead in the discharge does not exhibit reasonable potential to cause or contribute to an exceedance of their respective water quality objectives/criteria.
- d. **Zinc.** The Central Valley Board approved the discharger specific WER of 1.7 for zinc at Hangtown Creek as indicated section V of Attachment F (Fact Sheet) of the Municipal General Order. Monitoring data collected over the permit term for Order R5-2014-0015-01 indicates that zinc in the discharge does not exhibit reasonable potential to cause or contribute to an exceedance of their respective water quality objectives/criteria.

Thus, removal of the effluent limitations for mercury, total chlorine residual, lead, and zinc from this NOA is in accordance with CWA section 402(o)(2)(B)(i), which allows for the removal or relaxation of effluent limitations based on information that was not available at the time previous Order R5-2014-0015-01 was issued.

B. Antidegradation Policies

This NOA does not allow for an increase in flow or mass of pollutants to the receiving water. Therefore, a complete antidegradation analysis is not necessary. This NOA requires compliance with applicable federal technology-based standards and with WQBEL's where the discharge could have the reasonable potential to cause or contribute to an exceedance of water quality standards. The permitted discharge is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and the State Anti-Degradation Policy. Compliance with these requirements will result in the use of best practicable treatment or control of the discharge. The impact on existing water quality will be insignificant.

This NOA removes effluent limitations for mercury, total chlorine residual, lead, and zinc based on updated monitoring data demonstrating that the effluent does not cause or contribute to an exceedance of the applicable water quality criteria or objectives in the

receiving water. The removal of effluent limitations is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and State Water Resources Control Board (State Water Board) Resolution No. 68-16.

This NOA also relaxes the maximum pH effluent limitation, and removes mass-based effluent limitations for ammonia, BOD₅, and TSS, and maximum daily effluent limitations for BOD₅ and TSS based on 40 C.F.R. Part 122.45 (d) and (f). These changes in effluent will not result in a decrease in the level of treatment or control, or a reduction in water quality. Furthermore, concentration-based average monthly effluent limitations (AMELs) and average weekly effluent limitations (AWELs) are included for ammonia, BOD₅, and TSS, as well as a dry weather flow prohibition (section IV.4 of this NOA) that limits the amount of flow that can be discharged to the receiving water during dry weather months. The combination of the average dry weather flow prohibition and concentration-based effluent limits in this NOA are equivalent to mass-based effluent limitations, which were redundant limits contained in previous individual Orders by multiplying the concentration based effluent limits and permitted average dry weather flow by a conversion factor to determine the mass-based effluent limitations. These effluent limitation changes do not result in an allowed increase in pollutants or any additional degradation of the receiving water, therefore are consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and the State Antidegradation Policy.

C. Salinity (Electrical Conductivity or EC)

Based on effluent and upstream receiving water EC data collected from January 2017 to December 2019, the maximum calendar annual average EC of the effluent was 399 µmhos/cm and the upstream receiving water was 241 µmhos/cm. The Municipal General Order includes a screening level for EC of 1600 µmhos/cm based on the Secondary Maximum Contaminant Level (MCL) to protect the municipal and domestic supply beneficial use.

When only considering the numeric water quality standards for salinity, the discharge does not have reasonable potential to cause or contribute to an in-stream excursion of water quality objectives for salinity. However, due to the Region-wide concerns regarding salinity and to ensure implementation of the Basin Plan's Salinity Control Program the Municipal General Order includes performance-based effluent limitations for EC that are applicable to this Facility. The EC concentration of the effluent is greater than the background concentration observed in Hangtown Creek, therefore limited degradation is occurring in a high-quality water. Under the State Antidegradation Policy, the waste discharge requirements must result in the best practicable treatment or control (BPTC) of the discharge necessary to assure that (a) a pollution or nuisance will not occur; and (b) the highest water quality consistent with maximum benefit to the people of the State will be maintained. In this case, the Discharger is currently utilizing BPTC, and a performance-based calendar annual average effluent limitation of 625 µmhos/cm for EC is applied limiting the discharge to current levels (thus ensuring that BPTC will continue to be met).

II. RATIONALE FOR RECEIVING WATER LIMITATIONS

A. Temperature

Order R5-2014-0015-01 contained a site-specific receiving water limitation V.A.15 which limits the instantaneous maximum and weekly average ambient receiving water temperature on a seasonal basis. Furthermore, the annual average ambient temperature is not to be increased by more 5 °F relative to upstream conditions. These limits were developed on the basis of a 1-year initial investigative study to assess the temperature impacts of the discharge, entitled *Investigation of Water Temperatures in Hangtown Creek Above and Below the Hangtown Creek Wastewater Treatment Plant, Placerville, California, December 1999*. In 2003, the Discharger completed a supplemental temperature study entitled *Survey of the Aquatic Biological Resources and Seasonal Water Temperature Regime of Hangtown Creek, Placerville, California (April 2003)* and included recommendations for modifications to the receiving water limitation for temperature. With Department of Fish and Wildlife (DFW) staff concurrence (15 September 2005 letter), Central Valley Water Board staff approved the Discharger's study and implemented the receiving water temperature limitations, as shown in Table 3 of the NOA, for the Facility with the DFW-recommended site-specific ecological and temperature data and related considerations that are unique to this site.

In February 2011, the Discharger submitted an additional study entitled *Supplemental Evaluation of Temperature and Fish and Benthic Macroinvertebrate Communities of Hangtown Creek*. This supplemental study evaluated the efficacy of the site-specific receiving water limitations and of three secondary effluent evaporative cooling towers which were installed at the Facility during the 2009 upgrade. Based on monitoring data collected since January 2010, only one exceedance of the site-specific receiving water limits was observed. The Discharger's supplemental study demonstrated that the discharge is not having an adverse effect on aquatic life in Hangtown Creek. The site-specific receiving water limitations for temperature have been retained in this NOA and are included in section VI, Table 3.

III. RATIONALE FOR MONITORING REQUIREMENTS

CWA section 308 and 40 C.F.R. sections 122.41(h), (j)-(l), 122.44(i), and 122.48 require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Central Valley Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. The Monitoring and Reporting Program, Attachment E of the Municipal General Order establishes monitoring, reporting, and recordkeeping requirements that implement federal and state requirements. The following provides the rationale for the monitoring requirements contained in Monitoring and Reporting Program, Appendix D, of this NOA.

A. Influent Monitoring

1. Influent monitoring is required to collect data on the characteristics of the wastewater and to assess compliance with effluent limitations (e.g., BOD₅ and TSS reduction requirements). The monitoring frequency for flow was retained from Order R5-2014-0015-01.
2. Influent monitoring frequencies for BOD₅ (two times per week) and TSS (two times per week) were not retained from Order R5-2014-0015-01. Data collected within the

current permit term support the reduction of influent monitoring frequencies for BOD₅ and TSS (once per week).

B. Effluent Monitoring

1. Pursuant to the requirements of 40 C.F.R. section 122.44(i)(2) effluent monitoring is required for all constituents with effluent limitations. Effluent monitoring is necessary to assess compliance with effluent limitations, assess the effectiveness of the treatment process, and to assess the impacts of the discharge on the receiving stream and groundwater.
2. Effluent monitoring frequencies and sample types for pH, ammonia, electrical conductivity, nitrate, and nitrite have been retained from Order R5-2014-0015-01 to determine compliance with effluent limitations for these parameters. The frequencies for these parameters are shown on Table D-3 (Effluent Monitoring).
3. The effluent monitoring frequency and sample type for temperature has been retained from Order R5-2014-0015-01.
4. Effluent monitoring frequencies for BOD₅ (three times per week), TSS (three times per week), hardness (once per month), and total coliform organisms (three times per week) were not retained from Order R5-2014-0015-01. Data collected within the current permit term support the reduction of effluent monitoring frequencies for BOD₅ and TSS (twice per week), hardness (once per quarter), and total coliform organisms (twice per week). As discussed in Section I.B of this Appendix, the maximum daily and mass-based effluent limits for ammonia, BOD₅ and TSS have not been retained from Order R5-2014-0015-01.
5. Monitoring data collected over the previous permit term for mercury (total recoverable and methyl), total chlorine residual, lead, zinc, TDS, and bis (2-ethylhexyl) phthalate, did not demonstrate reasonable potential to exceed water quality objectives/criteria. Thus, monitoring requirements for these parameters have not been retained from Order R5-2014-0015-01.
6. This NOA includes effluent monitoring for dissolved organic carbon (once per quarter) to calculate site-specific freshwater aluminum criteria in accordance with the 2018 United State Environmental Protection Agency (U.S. EPA) National Ambient Water Quality Criteria (NAWQC) for aluminum in freshwater for the next permit renewal.
7. This NOA includes a new effluent monitoring requirement for dissolved oxygen (once per month). Monitoring of the effluent will provide information of the Facility's influence on dissolved oxygen concentrations at the downstream receiving water monitoring location, RSW-002, and will be used to assess compliance with dissolved oxygen receiving water limitations.

C. Whole Effluent Toxicity Testing Requirements

1. **Acute Toxicity.** Effluent monitoring frequency for acute toxicity 96-hour bioassay (once per quarter) has not been retained from previous Order R5-2014-0015-01. An effluent monitoring frequency of once per year was assigned for acute toxicity 96-hour bioassay to demonstrate compliance with the effluent limitation for acute toxicity.

2. **Chronic Toxicity.** Effluent monitoring frequency for chronic toxicity bioassay testing (once per quarter) has been retained from previous Order R5-2014-0015-01. Chronic whole effluent toxicity testing is required when discharging to Hangtown Creek in order to demonstrate compliance with the Basin Plan's narrative toxicity objective.

D. Receiving Water Monitoring

1. Hangtown Creek

- a. Receiving water monitoring is necessary to assess compliance with receiving water limitations and to assess the impacts of the discharge to Hangtown Creek.
- b. The receiving water monitoring frequency and sample type for temperature has been retained from Order R5-2014-0015-01 to determine compliance with the receiving water limitation for this parameter. The frequency is shown on Table D-5 of this NOA.
- c. Order R5-2014-0015-01 required receiving water monitoring for pH (twice per week), dissolved oxygen (twice per week), hardness (once per month), electrical conductivity (twice per week), and turbidity (twice per week). Monitoring data collected during the term of Order R5-2014-0015-01 indicates that the discharge has not caused significant impacts to Hangtown Creek. Therefore, this NOA decreases the monitoring frequency for pH (once per week), dissolved oxygen (once per week), hardness (once per quarter), electrical conductivity (once per week), and turbidity (once per week).
- d. Receiving water monitoring for flow is not required for permitting purposes. Therefore, receiving water monitoring from Order R5-2014-0015-01 was not retained in this NOA.
- e. This NOA includes receiving water monitoring for dissolved organic carbon (once per quarter) to calculate site-specific freshwater aluminum criteria in accordance with the 2018 U.S. EPA NAWQC for aluminum in freshwater for the next permit renewal.

2. Groundwater – Not Applicable

E. Biosolids Monitoring – Not Applicable

F. Water Supply Monitoring – Not Applicable

G. Filtration System Monitoring

1. Filtration system monitoring for turbidity is required for Dischargers of tertiary treated wastewater that meet the eligibility criteria in section I.B.4 of the Municipal General Order to determine compliance with the filtration system operating specifications in section VII.C.4.a of the Municipal General Order.
2. Continuous monitoring for turbidity was reported through monitoring locations FIL-001, FIL-002, and FIL-003. This NOA retains the sample type and monitoring frequency and location for turbidity.

H. UV Disinfection System Monitoring

1. Monitoring for flow (continuous), number of UV rows in operation (continuous), UV transmittance (continuous), and UV dose have been retained from previous Order R5-2014-0015-01. The monitoring location for these parameters has been moved from EFF-001 to UVS-001.

I. Pond Monitoring

1. Per section VIII.E.5 in the Fact Sheet in the Municipal General Order, pond monitoring is required to ensure proper operation of the storage ponds.
2. When any type of wastewater is directed to the ponds, this NOA requires the Discharger to keep a log related to the use of the ponds per section IX.B.1.a of Appendix D of this NOA.

J. Discharge Monitoring Report-Quality Assurance (DMR-QA) Study Program

1. Under the authority of section 308 of the CWA (33 U.S.C. section 1318), U.S. EPA requires all dischargers under the NPDES Program to participate in the annual DMR-QA Study Program. The DMR-QA Study evaluates the analytical ability of laboratories that routinely perform or support self-monitoring analyses required by NPDES permits. There are two options to satisfy the requirements of the DMR-QA Study Program: (1) The Discharger can obtain and analyze a DMR-QA sample as part of the DMR-QA Study; or (2) Per the waiver issued by U.S.EPA to the State Water Board, the Discharger can submit the results of the most recent Water Pollution Performance Evaluation Study from their own laboratories or their contract laboratories. A Water Pollution Performance Evaluation Study is similar to the DMR-QA Study. Thus, it also evaluates a laboratory's ability to analyze wastewater samples to produce quality data that ensure the integrity of the NPDES Program. The Discharger shall submit annually the results of the DMR-QA Study or the results of the most recent Water Pollution Performance Evaluation Study to the State Water Board. The State Water Board's Quality Assurance Program Officer will send the DMR-QA Study results or the results of the most recent Water Pollution Performance Evaluation Study to U.S. EPA's DMR-QA Coordinator and Quality Assurance Manager.

K. Effluent and Receiving Water Characterization Monitoring

1. Order R5-2014-0015-01 included quarterly effluent characterization monitoring for one year when discharging to Hangtown Creek. This NOA retains the quarterly effluent characterization monitoring for one year.
2. Order R5-2014-0015-01 included quarterly receiving water characterization monitoring for one year. This NOA reduces the receiving water characterization monitoring to semiannual to determine receiving water constituent concentrations during both the dry and wet seasons.

IV. SUMMARY OF REASONABLE POTENTIAL ANALYSIS

Abbreviations used in Table C-1:

- MEC = Maximum Effluent Concentration
- B = Maximum Receiving Water Concentration
- C = Criterion used for Reasonable Potential Analysis
- CMC = Criterion Maximum Concentration
- CCC = Criterion Continuous Concentration
- Water and Org = Human Health Criterion for Consumption of Water and Organisms
- Org Only = Human Health Criterion for Consumption of Organisms Only
- Basin Plan = Numeric Site-Specific Basin Plan Water Quality Objective
- MCL = Drinking Water Standards Maximum Contaminant Level
- NA = Not Available
- ND = Non-detect
- RP= Reasonable Potential

Table C-1: SUMMARY OF REASONABLE POTENTIAL ANALYSIS

Parameter	Units	MEC	B	C	CMC	CCC	Water and Org	Org. Only	Basin Plan	MCL	RP
Ammonia (as N)	mg/L	1.7	1.1	1.47	6.77	1.47	--	--	--	--	Yes
Nitrate Plus Nitrite (as N)	mg/L	7.4	0.92	10	--	--	--	--	--	10	Yes
Bis (2-ethylhexyl) phthalate	µg/L	1.0	1	1.8	--	--	1.8	5.9		4	No
Electrical Conductivity @ 25°C	µmhos/cm	399	241	1,600	--	--	--	--	--	1,600	No
Lead, Total Recoverable	µg/L	0.36	0.31	0.91	--	--	--	--	--	--	No
Zinc, Total Recoverable	µg/L	64	22	93.7	93.7	93.7	--	--	--	--	No

1. Table C-1 Notes:

- i. **CMC.** For ammonia, the CMC or criterion maximum concentration is based on the U.S. EPA National Recommended Ambient Water Quality Criteria Freshwater Aquatic Life Protection, 1-hour average. For copper and cyanide, the CMC is based on the California Toxics Rule, 1-hour average criterion.
- ii. **CCC.** For ammonia, the CCC or criterion continuous concentration is based on the U.S. EPA National Recommended Ambient Water Quality Criteria Freshwater Aquatic Life Protection, 30-day average. For copper and cyanide, the CCC is based on the California Toxics Rule, 4-day average criterion.

- iii. **Ammonia and Nitrate + Nitrite.** Reasonable potential exists due to the biological processes inherent to the treatment of domestic wastewater (see sections V.C.3.b.ii and V.C.3.b.ix in Attachment F, Fact Sheet, of the Municipal General Order).

APPENDIX D – MONITORING AND REPORTING PROGRAM

I.	GENERAL MONITORING PROVISIONS.....	23
II.	MONITORING LOCATIONS	24
III.	INFLUENT MONITORING REQUIREMENTS.....	25
	A. Monitoring Location INF-001.....	25
IV.	EFFLUENT MONITORING REQUIREMENTS.....	26
	A. Monitoring Location EFF-001.....	26
V.	WHOLE EFFLUENT TOXICITY (WET) TESTING REQUIREMENTS	27
	A. Acute Toxicity Testing.....	27
	B. Chronic Toxicity Testing.....	28
	C. WET Testing Notification Requirements.....	30
	D. WET Testing Reporting Requirements.....	30
VI.	LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE.....	31
VII.	RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE.....	31
VIII.	RECEIVING WATER MONITORING REQUIREMENTS	31
	A. Monitoring Locations RSW-001 and RSW-002.....	31
IX.	OTHER MONITORING REQUIREMENTS.....	32
	A. Biosolids – Not Applicable	32
	B. Ponds.....	32
	C. Municipal Water Supply – Not Applicable	32
	D. Filtration System	33
	E. Ultraviolet Light (UV) Disinfection System	33
	F. Effluent and Receiving Water Characterization	34
X.	REPORTING REQUIREMENTS	39
	A. General Monitoring and Reporting Requirements.....	39
	B. Self-Monitoring Reports	39
	C. Discharge Monitoring Reports (DMRs).....	42
	D. Other Reports	42

Tables

Table D-1.	Monitoring Station Locations.....	25
Table D-2.	Influent Monitoring	25
Table D-3.	Effluent Monitoring	26
Table D-4.	Chronic Toxicity Testing Dilution Series.....	29
Table D-5.	Receiving Water Monitoring Requirements.....	31
Table D-6.	Filtration System Monitoring Requirements	33
Table D-7.	UV Disinfection System Monitoring Requirements.....	33
Table D-8.	Effluent and Receiving Water Characterization Monitoring.....	35
Table D-9.	Monitoring Periods and Reporting Schedule.....	40
Table D-10.	Technical Reports	44

APPENDIX D – MONITORING AND REPORTING PROGRAM (MRP)

The Municipal General Order contains monitoring and reporting requirements in Attachment E. Some of the monitoring and reporting requirements listed in the Municipal General Order are not applicable to the Discharger. The monitoring and reporting requirements applicable to the Discharger are contained in this Appendix and are described herein.

The Code of Federal Regulations (40 C.F.R. § 122.48) requires that all NPDES permits specify monitoring and reporting requirements. California Water Code sections 13267 and 13383 also authorize the Central Valley Water Board to require technical and monitoring reports. This MRP establishes monitoring and reporting requirements that implement state and federal regulations.

I. GENERAL MONITORING PROVISIONS

- A.** Samples and measurements taken as required herein shall be representative of the volume and nature of the monitored discharge. All samples shall be taken at the monitoring locations specified below and, unless otherwise specified, before the monitored flow joins or is diluted by any other waste stream, body of water, or substance. Monitoring locations shall not be changed without notification to and the approval of the Central Valley Water Board.
- B.** Final effluent samples shall be taken downstream of the last addition of wastes to the treatment or discharge works where a representative sample may be obtained prior to mixing with the receiving waters. Samples shall be collected at such a point and in such a manner to ensure a representative sample of the discharge.
- C.** Chemical, bacteriological, and bioassay analyses of any material required by this Order shall be conducted by a laboratory accredited for such analyses by the State Water Resources Control Board (State Water Board), Division of Drinking Water (DDW), in accordance with the provision of Water Code section 13176. Laboratories that perform sample analyses must be identified in all monitoring reports submitted to the Central Valley Water Board. Data generated from field measurements such as pH, dissolved oxygen, electrical conductivity (EC), turbidity, temperature, and residual chlorine are exempt pursuant to Water Code Section 13176. A manual containing the steps followed in this program for any field measurements such as pH, dissolved oxygen, EC, turbidity, temperature, and residual chlorine must be kept onsite in the treatment facility laboratory and shall be available for inspection by Central Valley Water Board staff. The Discharger must demonstrate sufficient capability (qualified and trained employees, properly calibrated and maintained field instruments, etc.) to adequately perform these field measurements. The Quality Assurance-Quality Control Program must conform to U.S. EPA guidelines or to procedures approved by the Central Valley Water Board.
- D.** Appropriate flow measurement devices and methods consistent with accepted scientific practices shall be selected and used to ensure the accuracy and reliability of measurements of the volume of monitored discharges. All monitoring instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary, at least yearly, to ensure their continued accuracy. All flow measurement devices shall be calibrated at least once per year to ensure continued accuracy of the devices.
- E.** Monitoring results, including noncompliance, shall be reported at intervals and in a manner specified in this MRP.

- F.** Laboratory analytical methods shall be sufficiently sensitive in accordance with the Sufficiently Sensitive Methods Rule (SSM Rule) specified under 40 C.F.R. 122.21(e)(3) and 122.44(i)(1)(iv). A U.S. EPA-approved analytical method is sufficiently sensitive for pollutant/parameter where:
- The method minimum level (ML) is at or below the applicable water quality objective for the receiving water, or;
 - The method ML is above the applicable water quality objective for the receiving water but the amount of the pollutant/parameter in the discharge is high enough that the method detects and quantifies the level of the pollutant/parameter, or;
 - The method ML is above the applicable water quality objective for the receiving water, but the ML is the lowest of the 40 C.F.R. 136 U.S. EPA-approved analytical methods for the pollutant/parameter.
- G.** Dischargers shall ensure that the results of the Discharge Monitoring Report-Quality Assurance (DMR-QA) Study or the most recent Water Pollution Performance Evaluation Study are submitted annually, [via email](mailto:QualityAssurance@waterboards.ca.gov), to QualityAssurance@waterboards.ca.gov to the State Water Resources Control Board.
- H.** The Discharger shall file with the Central Valley Water Board technical reports on self-monitoring performed according to the detailed specifications contained in this MRP.
- I.** The results of all monitoring required by this MRP shall be reported to the Central Valley Water Board and shall be submitted in such a format as to allow direct comparison with the limitations and requirements of the NOA. Unless otherwise specified, discharge flows shall be reported in terms of the monthly average and the daily maximum discharge flows.
- J.** Multiple Discharge Points – Not Applicable.

II. MONITORING LOCATIONS

The Discharger shall establish the monitoring locations listed in Table D-1 to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in the NOA.

Table D-1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
--	INF-001	Composite sampler after grit chamber and before the Parshall flume.
001	EFF-001	A location where a representative sample of the effluent can be collected prior to discharging to surface water Latitude: 38° 43' 51.7" N - Longitude: 120° 50' 48.8" W
--	RSW-001	100 feet upstream of the point of discharge and not influenced by the discharge of effluent.
--	RSW-002	1,000 feet downstream of the point of discharge.
--	FEB-001	Flow Equalization Basin Latitude: 38° 43' 54.0" N - Longitude: 120° 50' 56.2" W
--	FIL-001	Monitoring of the filter effluent to be measured immediately downstream of Gravity Filter MTU1 and prior to the UV disinfection system.
--	FIL-002	Monitoring of the filter effluent to be measured immediately downstream of Gravity Filter MTU2 and prior to the UV disinfection system.
--	FIL-003	Monitoring of the filter effluent to be measured immediately downstream of the pressure filters and prior to the UV disinfection system.
--	UVS-001	A location where a representative sample of wastewater can be collected upstream or downstream of the ultraviolet light (UV) disinfection system

The North latitude and West longitude information in Table D-1 are approximate for administrative purposes.

III. INFLUENT MONITORING REQUIREMENTS

A. Monitoring Location INF-001

1. The Discharger shall monitor influent to the Facility at Monitoring Location INF-001 as specified in Table D-2 and the testing requirements described in section III.A.2 below:

Table D-2. Influent Monitoring

Parameter	Units	Sample Type	Minimum Sampling Frequency
Flow	MGD	Meter	Continuous
Biochemical Oxygen Demand (5-day @ 20°Celsius)	mg/L	24-hour Composite	1/Week
Total Suspended Solids	mg/L	24-hour Composite	1/Week

2. Table D-2 Testing Requirements. The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-2:

- a. **Applicable to all parameters.** Parameters shall be analyzed using the analytical methods described in 40 C.F.R. part 136; or by methods approved by the Central Valley Water Board or the State Water Board. In addition, if requested by the Discharger, the sample type may be modified by the Executive Officer to another 40 C.F.R. part 136 allowed sample type.
- b. All composite samples shall be collected from a 24-hour flow proportional composite.

IV. EFFLUENT MONITORING REQUIREMENTS

A. Monitoring Location EFF-001

- 1. The Discharger shall monitor treated domestic wastewater at Monitoring Location EFF-001 as specified in Table D-3 and the testing requirements in section IV.A.2. If there was no discharge to receiving water during the designated monitoring period, monitoring is not required for that period. If there was no discharge, the Discharger shall so state in the monthly self-monitoring report (SMR).

Table D-3. Effluent Monitoring

Parameter	Units	Sample Type	Minimum Monitoring Frequency
Flow	MGD	Meter	Continuous
Biochemical Oxygen Demand (5-day @ 20° C)	mg/L	24-hr Composite	2/Week
Biochemical Oxygen Demand (5-day @ 20° C)	percent removal	Calculate	1/Month
pH	standard units	Grab	5/Week
Total Suspended Solids	mg/L	24-hr Composite	2/Week
Total Suspended Solids	percent removal	Calculate	1/Month
Ammonia Nitrogen, Total (as N)	mg/L	Grab	1/Week
Dissolved Oxygen	mg/L	Grab	1/Month
Electrical Conductivity @ 25°C	µmhos/cm	Grab	1/Month
Hardness, Total (as CaCO ₃)	mg/L	Grab	1/Quarter
Dissolved Organic Carbon (DOC)	mg/L	Grab	1/Quarter
Nitrate Nitrogen, Total (as N)	mg/L	Grab	1/Week
Nitrite Nitrogen, Total (as N)	mg/L	Grab	1/Week
Nitrate Plus Nitrite (as N)	mg/L	Grab	1/Week
Temperature	°F	Grab	1/Day
Total Coliform Organisms	MPN/100 mL	Grab	2/Week

2. Table D-3 Testing Requirements. The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-3:
 - a. All composite samples shall be collected from a 24-hour flow proportional composite.
 - b. **Applicable to all parameters.** Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
 - c. A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.
 - d. **Ammonia.** Samples for pH and temperature shall be recorded at the time of ammonia sample collection.
 - e. A hand-held field meter may be used for pH, electrical conductivity, temperature, and dissolved oxygen, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
 - f. **Total Coliform Organisms.** Total coliform organisms samples may be collected at any point following disinfection.
 - g. **Dissolved Organic Carbon.** Hardness, total (as CaCO₃) and pH samples shall be taken concurrent with dissolved organic carbon samples.
 - h. **Temperature, pH, Hardness, Dissolved Oxygen, and Dissolved Organic Carbon.** The effluent samples for temperature, pH, hardness, dissolved oxygen, and dissolved organic carbon shall be taken approximately the same time and on the same date with the receiving water samples for these parameters.

V. WHOLE EFFLUENT TOXICITY (WET) TESTING REQUIREMENTS

A. Acute Toxicity Testing.

The Discharger shall conduct acute toxicity testing to determine whether the effluent is contributing acute toxicity to the receiving water. The Discharger shall meet the following acute toxicity testing requirements:

1. Monitoring Frequency – The Discharger shall perform **annual** acute toxicity testing, while the Facility is discharging to Hangtown Creek and concurrent with effluent ammonia sampling.
2. Sample Types – The Discharger may use flow-through or static renewal testing. For static renewal testing, the samples shall be flow proportional 24-hour composite or grab samples and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at Monitoring Location EFF-001.
3. Test Species – The test species shall be rainbow trout (*Oncorhynchus mykiss*).
4. Test Duration – Test duration shall be 96 hours.

5. Methods – The acute toxicity testing samples shall be analyzed using EPA-821-R-02-012, Fifth Edition. Temperature and pH shall be recorded at the time of sample collection. No pH adjustment may be made unless approved by the Executive Officer.
6. Test Failure – If an acute toxicity test does not meet all test acceptability criteria, as specified in the test method, the Discharger must re-sample and re-test as soon as possible, not to exceed 7 days following notification of test failure.

B. Chronic Toxicity Testing.

The Discharger shall conduct chronic toxicity testing to determine whether the effluent is contributing chronic toxicity to the receiving water. The Discharger shall meet the following chronic toxicity testing requirements:

1. Monitoring Frequency – The Discharger shall perform **quarterly** chronic toxicity testing when discharging to Hangtown Creek. If the result of the routine chronic toxicity testing event exhibits toxicity, demonstrated by a result greater than 1.3 TUc (as 100/EC₂₅) **AND** a percent effect greater than 25 percent at 100 percent effluent, the Discharger has the option of conducting two additional compliance monitoring chronic toxicity testing events in order to calculate a median. The optional compliance monitoring events shall occur at least one week apart, and the final monitoring event shall be initiated no later than 6 weeks from the routine monitoring event that exhibited toxicity. See Compliance Determination Section VIII.J of the Municipal General Order for procedures for calculating the 6-week median.
2. Sample Types – Effluent samples shall be grab samples and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at Monitoring Location EFF-001. The receiving water control shall be a grab sample obtained from Monitoring Location RSW-001.
3. Sample Volumes – Adequate sample volumes shall be collected to provide renewal water to complete the test in the event that the discharge is intermittent.
4. Test Species – Chronic toxicity testing measures sublethal (e.g., reduced growth, reproduction) and/or lethal effects to test organisms exposed to an effluent compared to that of the control organisms. The Discharger shall conduct chronic toxicity tests with one of the following species that is the most sensitive:
 - a. The cladoceran, water flea, *Ceriodaphnia dubia* (survival and reproduction test);
 - b. The fathead minnow, *Pimephales promelas* (larval survival and growth test); and
 - c. The green alga, *Selenastrum capricornutum* (growth test).
5. Most Sensitive Species Determination – The Discharger submitted a letter to the Central Valley Water Board on 30 October 2018 for Executive Officer approval of *Ceriodaphnia dubia* as the most sensitive species. Central Valley Water Board staff have determined that the chronic toxicity test results from the Discharger are inconclusive to determine the most sensitive species. None of the submitted chronic toxicity test results for the most sensitive species determination exceeded the 1 TUc trigger or had a percent effect greater than 25%. Therefore, consistent with the most sensitive species determination method in section V.B.5 of Attachment E (Monitoring and Reporting Program) of the Municipal General Order, the Executive Officer is

requiring the Discharger to rotate the test species every calendar year as described below.

6. **Most Sensitive Species Monitoring Requirements** – If a single test exhibits toxicity, demonstrated by a result greater than 1.3 TUc (as 100/EC₂₅) **AND** a percent effect greater than 25 percent at 100 percent effluent, then the species used in that test shall be established as the most sensitive species **until the next NOA renewal**. Otherwise, the species test rotation order shall be as follows:
 - *Ceriodaphnia dubia* **upon the effective date of this NOA** through the remainder of this calendar year;
 - *Pimephales promelas* **after** *Ceriodaphnia dubia* for the entire calendar year;
 - *Selenastrum capricornutum* **after** *Pimephales promelas* for the entire calendar year; and
 - cycling back to *Ceriodaphnia dubia* **after** *Selenastrum capricornutum* for the entire calendar year and back through the same rotation until the next permit renewal.
7. **Methods** – The presence of chronic toxicity shall be estimated as specified in Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA/821-R-02-013, October 2002.
8. **Reference Toxicant** – As required by the *Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California* (SIP), all chronic toxicity tests shall be conducted with concurrent testing with a reference toxicant and shall be reported with the chronic toxicity test results.
9. **Dilutions** –For routine and compliance chronic toxicity monitoring, chronic toxicity testing shall be performed using the dilution series identified in Table D-4, below. For TRE monitoring, chronic toxicity testing shall be performed using the dilution series identified, below, unless an alternative dilution series is detailed in the submitted TRE Action Plan. A receiving water control or laboratory water control may be used as the diluent.

Table D-4. Chronic Toxicity Testing Dilution Series

Sample	100% Dilution	75% Dilution	50% Dilution	25% Dilution	12.5% Dilution	Control
% Effluent	100%	75%	50%	25%	12.5%	0%
% Control Water	0%	25%	50%	75%	87.5%	100%

10. **Test Failure** – The Discharger must re-sample and re-test as soon as possible, but no later than fourteen (14) days after receiving notification of a test failure. A test failure is defined as follows:
 - a. The reference toxicant test or the effluent test does not meet all test acceptability criteria as specified in the Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA/821-R-02-013, October 2002 (Method Manual), and its subsequent amendments or revisions; or

- b. The percent minimum significant difference (PMSD) measured for the test exceeds the upper PMSD bound variability criterion in Table 6 on page 52 of the Method Manual. (A retest is only required in this case if the test results do not exceed the monitoring trigger specified in the Special Provision at section VII.C.2.a.iii of the Municipal General Order.)

C. WET Testing Notification Requirements.

The Discharger shall notify the Central Valley Water Board within 24-hours after the receipt of test results exceeding the monitoring trigger during regular monitoring, or an exceedance of the acute toxicity effluent limitation.

D. WET Testing Reporting Requirements.

All toxicity test reports shall include the contracting laboratory's complete report provided to the Discharger and shall be in accordance with the appropriate "Report Preparation and Test Review" sections of the method manuals. At a minimum, whole effluent toxicity monitoring shall be reported as follows:

1. **Chronic WET Reporting.** Chronic toxicity monitoring results shall be reported to the Central Valley Water Board with the quarterly self-monitoring report, and shall contain, at minimum:
 - a. The results expressed in TUC, measured as 100/NOEC, and also measured as 100/LC50, 100/EC25, 100/IC25, and 100/IC50, as appropriate.
 - b. The percent effect at the instream waste concentration;
 - c. The statistical methods used to calculate endpoints;
 - d. The statistical output page, which includes the calculation of the percent minimum significant difference (PMSD);
 - e. The dates of sample collection and initiation of each toxicity test; and
 - f. The results compared to the numeric toxicity monitoring trigger or effluent limitation.

Additionally, the quarterly SMR shall contain an updated chronology of chronic toxicity test results expressed in TUC (as 100/EC₂₅) and percent effect at the instream waste concentration, and organized by type of test (survival, growth or reproduction), and monitoring frequency, i.e., either quarterly, monthly, monthly median, or TRE.

2. **Acute WET Reporting.** Acute toxicity test results shall be submitted with the quarterly SMR and reported as percent survival.
3. **TRE or Toxicity Evaluation Study Reporting.** Reports for TREs or a Toxicity Evaluation Study shall be submitted in accordance with the schedule contained in the Discharger's approved TRE Workplan, or as amended by the Discharger's TRE Action Plan.
4. **Quality Assurance (QA).** The Discharger must provide the following information for QA purposes:

- a. Results of the applicable reference toxicant data with the statistical output page giving the species, NOEC, LOEC, type of toxicant, dilution water used, concentrations used, PMSD, and dates tested.
- b. The reference toxicant control charts for each endpoint, which include summaries of reference toxicant tests performed by the contracting laboratory.
- c. Any information on deviations or problems encountered and how they were dealt with.

VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE

VII. RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE

VIII. RECEIVING WATER MONITORING REQUIREMENTS

A. Monitoring Locations RSW-001 and RSW-002

1. The Discharger shall monitor Hangtown Creek at Monitoring Locations RSW-001 and RSW-002 as specified in Table D-5 and the testing requirements in section VIII.A.2. If there was no discharge to receiving water during the designated monitoring period, monitoring is not required during that period. If there is no upstream flow in the receiving water during the designated monitoring period, monitoring is not required at RSW-001 during that period. Whenever monitoring is not required, the Discharger shall state so in the monthly SMR.

Table D-5. Receiving Water Monitoring Requirements

Parameter	Units	Sample Type	Minimum Monitoring Frequency
pH	standard units	Grab	1/Week
Dissolved Oxygen	mg/L	Grab	1/Week
Electrical Conductivity @ 25°C	µmhos/cm	Grab	1/Week
Hardness, Total (as CaCO ₃)	mg/L	Grab	1/Quarter
Temperature (1 June – 15 October)	°F	Grab	5/Week
Temperature (16 October – 31 May)	°F	Grab	2/Week
Turbidity	NTU	Grab	1/Week
Dissolved Organic Carbon (DOC)	mg/L	Grab	1/Quarter

2. Table D-5 Testing Requirements. The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-5:
 - a. A hand-held field meter may be used for pH, electrical conductivity, temperature, dissolved oxygen, and turbidity, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
 - b. A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.

- c. **Applicable to all parameters.** Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
 - d. **Dissolved Organic Carbon.** Hardness, total (as CaCO₃) and pH samples shall be taken concurrent with dissolved organic carbon samples.
 - e. **Temperature, pH, Hardness, Dissolved Oxygen, and Dissolved Organic Carbon.** The receiving water samples for temperature, pH, hardness, dissolved oxygen, and dissolved organic carbon shall be taken approximately the same time and on the same date with the effluent samples for these parameters.
3. In conducting the receiving water sampling required by section VIII.A.1 above, a log shall be kept of the receiving water conditions throughout the reach bounded by Monitoring Locations RSW-001 and RSW-002. Attention shall be given to the presence or absence of:
- a. Floating or suspended matter;
 - b. Discoloration;
 - c. Bottom deposits;
 - d. Aquatic life;
 - e. Visible films, sheens, or coatings;
 - f. Fungi, slimes, or objectionable growths; and
 - g. Potential nuisance conditions.

Notes on receiving water conditions shall be summarized in the monitoring report.

IX. OTHER MONITORING REQUIREMENTS

A. Biosolids – Not Applicable

B. Ponds

1. Monitoring Location FEB-001

- a. The Discharger shall keep a log regarding the use of the flow equalization basin. In particular, the Discharger shall record the following when any type of wastewater is directed to the basin:
 - i. The date(s) when the wastewater is directed to the basin;
 - ii. The type(s) of wastewater (e.g., untreated due to plant upset, tertiary treated, etc.) directed to the basin;
 - iii. The total volume of wastewater directed to the basin (volume may be estimated);
 - iv. The daily freeboard in the basin.

C. Municipal Water Supply – Not Applicable

D. Filtration System

1. Monitoring Locations FIL-001, FIL-002, and FIL-003

- a. The Discharger shall monitor the filtration system at Monitoring Location FIL-001, FIL-002, and FIL-003 as specified in Table D-6 and the testing requirements in section IX.D.2.

Table D-6. Filtration System Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency
Turbidity	NTU	Meter	Continuous

- 2. Table D-6 Testing Requirements. The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-6:
 - a. Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. part 136 or by methods that have been approved by the Central Valley Water Board or the State Water Board.
 - b. For continuous analyzers, the Discharger shall report documented routine meter maintenance activities including date, time of day, and duration, in which the analyzer(s) is not in operation. If analyzer(s) fail to provide continuous monitoring for more than two hours and influent and/or effluent from the disinfection process is not diverted for retreatment, the Discharger shall obtain and report hourly manual and/or grab sample results.
 - c. Report daily average and maximum turbidity.

E. Ultraviolet Light (UV) Disinfection System

1. Monitoring Location UVS-001

- a. The Discharger shall monitor the UV disinfection system at Monitoring Location UVS-001 as specified in Table D-7 and the testing requirements in section IX.E.2.

Table D-7. UV Disinfection System Monitoring Requirements

Parameter	Units	Sample Type	Sampling Frequency	Monitoring Location
Flow	MGD	Meter	Continuous	UVS-001
Number of UV rows in operation	Number	Observation	Continuous	N/A
UV Transmittance	Percent (%)	Meter	Continuous	UVS-001
UV Dose	mJ/cm ²	Calculated	Continuous	N/A

- 2. Table D-7 Testing Requirements. The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-7:
 - a. For continuous analyzers, the Discharger shall report documented routine meter maintenance activities including date, time of day, and duration, in which the analyzer(s) is not in operation. If analyzer(s) fail to provide continuous monitoring for more than two hours and influent and/or effluent from the disinfection process

- is not diverted for retreatment, the Discharger shall obtain and report hourly manual and/or grab sample results.
- b. The Discharger shall not decrease power settings or reduce the number of UV lamp rows in operation while the continuous analyzers are out of service and water is being disinfected.
 - c. Report daily minimum number of UV rows in operation.
 - d. Report daily minimum hourly average UV transmittance. The minimum hourly average transmittance shall consist of lowest average transmittance recorded over an hour of a day when flow is being discharged. If the system does not operate for an entire hour interval on a given day or if effluent flow is not discharged for an entire hour, the transmittance will be averaged based on the actual operation time when discharges are occurring.
 - e. Report daily minimum hourly average UV dose. The minimum hourly average dose shall consist of lowest hourly average dose provided in any channel that had at least one row of lamps operating during the hour interval. For channels that did not operate for the entire hour interval or when effluent flow is not discharged for the entire hour, the dose will be averaged based on the actual operation time when discharges occurred.

F. Effluent and Receiving Water Characterization

The Discharger shall monitor the effluent and receiving water at Monitoring Locations EFF-001 and RSW-001, respectively, for the constituents listed in Table D-8, as described in this section.

1. Monitoring Frequency

- a. **Effluent Sampling.** Samples shall be collected from the effluent (Monitoring Location EFF-001) quarterly between **1 July 2021 and 30 June 2022**.
- b. **Receiving Water Sampling.** Samples shall be collected from the upstream receiving water (Monitoring Location RSW-001) twice, once between **1 July 2021 and 30 September 2021** (dry season) and once between **1 January 2022 and 31 March 2022** (wet season).

All sampling shall be analyzed for the constituents listed in Table D-8, below. The results of such monitoring shall be submitted to the Central Valley Water Board with the quarterly SMRs. Each individual monitoring event shall provide representative sample results for the effluent and upstream receiving water.

2. **Concurrent Sampling.** Receiving water sampling shall be performed at approximately the same time and on the same date as the effluent sampling events.
3. **Sample Type.** All receiving water samples shall be taken as grab samples. Effluent samples shall be taken as described in Table D-8, below and the testing requirements in section IX.F.5.
4. **Analytical Methods Report Certification.** Prior to beginning the Effluent and Receiving Water Characterization monitoring, the Discharger shall provide a certification acknowledging the scheduled start date of the Effluent and Receiving Water Characterization monitoring and confirming that samples will be collected and analyzed as described in the previously submitted Analytical Methods Report. If

there are changes to the previously submitted Analytical Methods Report, the Discharger shall outline those changes. A one-page certification form will be provided by the Central Valley Water Board staff with the Notice of Applicability that the Discharger can use to satisfy this requirement. The certification form shall be submitted electronically via CIWQS in accordance with the reporting requirements in Table D-10, Technical Reports.

Table D-8. Effluent and Receiving Water Characterization Monitoring

Parameter	Units	Effluent Sample Type
2- Chloroethyl vinyl ether	µg/L	Grab
Acrolein	µg/L	Grab
Acrylonitrile	µg/L	Grab
Benzene	µg/L	Grab
Bromoform	µg/L	Grab
Carbon Tetrachloride	µg/L	Grab
Chlorobenzene	µg/L	Grab
Chloroethane	µg/L	Grab
Chloroform	µg/L	Grab
Chloromethane	µg/L	Grab
Dibromochloromethane	µg/L	Grab
Dichlorobromomethane	µg/L	Grab
Dichloromethane	µg/L	Grab
Ethylbenzene	µg/L	Grab
Hexachlorobenzene	µg/L	Grab
Hexachlorobutadiene	µg/L	Grab
Hexachloroethane	µg/L	Grab
Methyl bromide (Bromomethane)	µg/L	Grab
Naphthalene	µg/L	Grab
3-Methyl-4-Chlorophenol	µg/L	Grab
Tetrachloroethylene	µg/L	Grab
Toluene	µg/L	Grab
trans-1,2-Dichloroethylene	µg/L	Grab
Trichloroethene	µg/L	Grab
Vinyl chloride	µg/L	Grab
Methyl-tert-butyl ether (MTBE)	µg/L	Grab
1,1,1-Trichloroethane	µg/L	Grab
1,1,2- Trichloroethane	µg/L	Grab
1,1-dichloroethane	µg/L	Grab
1,1-dichloroethylene	µg/L	Grab
1,2-dichloropropane	µg/L	Grab
1,3-dichloropropylene	µg/L	Grab
1,1,2,2-tetrachloroethane	µg/L	Grab
1,2,4-trichlorobenzene	µg/L	Grab
1,2-dichloroethane	µg/L	Grab

Parameter	Units	Effluent Sample Type
1,2-dichlorobenzene	µg/L	Grab
1,3-dichlorobenzene	µg/L	Grab
1,4-dichlorobenzene	µg/L	Grab
1,2-Benzanthracene	µg/L	Grab
1,2-Diphenylhydrazine	µg/L	Grab
2-Chlorophenol	µg/L	Grab
2,4-Dichlorophenol	µg/L	Grab
2,4-Dimethylphenol	µg/L	Grab
2,4-Dinitrophenol	µg/L	Grab
2,4-Dinitrotoluene	µg/L	Grab
2,4,6-Trichlorophenol	µg/L	Grab
2,6-Dinitrotoluene	µg/L	Grab
2-Nitrophenol	µg/L	Grab
2-Chloronaphthalene	µg/L	Grab
3,3'-Dichlorobenzidine	µg/L	Grab
3,4-Benzofluoranthene	µg/L	Grab
4-Chloro-3-methylphenol	µg/L	Grab
4,6-Dinitro-2-methylphenol	µg/L	Grab
4-Nitrophenol	µg/L	Grab
4-Bromophenyl phenyl ether	µg/L	Grab
4-Chlorophenyl phenyl ether	µg/L	Grab
Acenaphthene	µg/L	Grab
Acenaphthylene	µg/L	Grab
Anthracene	µg/L	Grab
Benzidine	µg/L	Grab
Benzo(a)pyrene (3,4-Benzopyrene)	µg/L	Grab
Benzo(g,h,i)perylene	µg/L	Grab
Benzo(k)fluoranthene	µg/L	Grab
Bis(2-chloroethoxy) methane	µg/L	Grab
Bis(2-chloroethyl) ether	µg/L	Grab
Bis(2-chloroisopropyl) ether	µg/L	Grab
Bis(2-ethylhexyl) phthalate	µg/L	Grab
Butyl benzyl phthalate	µg/L	Grab
Chrysene	µg/L	Grab
Di-n-butylphthalate	µg/L	Grab
Di-n-octylphthalate	µg/L	Grab
Dibenzo(a,h)-anthracene	µg/L	Grab
Diethyl phthalate	µg/L	Grab
Dimethyl phthalate	µg/L	Grab
Fluoranthene	µg/L	Grab
Fluorene	µg/L	Grab

Parameter	Units	Effluent Sample Type
Hexachlorocyclopentadiene	µg/L	Grab
Indeno(1,2,3-c,d)pyrene	µg/L	Grab
Isophorone	µg/L	Grab
N-Nitrosodiphenylamine	µg/L	Grab
N-Nitrosodimethylamine	µg/L	Grab
N-Nitrosodi-n-propylamine	µg/L	Grab
Nitrobenzene	µg/L	Grab
Pentachlorophenol	µg/L	Grab
Phenanthrene	µg/L	Grab
Phenol	µg/L	Grab
Pyrene	µg/L	Grab
Aluminum	µg/L	24-hr Composite
Antimony	µg/L	24-hr Composite
Arsenic	µg/L	24-hr Composite
Asbestos	MFL	24-hr Composite
Beryllium	µg/L	24-hr Composite
Cadmium	µg/L	24-hr Composite
Chromium (Total)	µg/L	24-hr Composite
Copper	µg/L	24-hr Composite
Cyanide	µg/L	24-hr Composite
Iron	µg/L	24-hr Composite
Lead	µg/L	24-hr Composite
Mercury	µg/L	Grab
Manganese	µg/L	24-hr Composite
Nickel	µg/L	24-hr Composite
Selenium	µg/L	24-hr Composite
Silver	µg/L	24-hr Composite
Thallium	µg/L	24-hr Composite
Zinc	µg/L	24-hr Composite
4,4'-DDD	µg/L	Grab
4,4'-DDE	µg/L	Grab
4,4'-DDT	µg/L	Grab
alpha-Endosulfan	µg/L	Grab
alpha-Hexachlorocyclohexane (BHC)	µg/L	Grab
Aldrin	µg/L	Grab
beta-Endosulfan	µg/L	Grab
beta-Hexachlorocyclohexane	µg/L	Grab
Chlordane	µg/L	Grab
delta-Hexachlorocyclohexane	µg/L	Grab
Dieldrin	µg/L	Grab
Endosulfan sulfate	µg/L	Grab
Endrin	µg/L	Grab

Parameter	Units	Effluent Sample Type
Endrin Aldehyde	µg/L	Grab
Heptachlor	µg/L	Grab
Heptachlor Epoxide	µg/L	Grab
Lindane (gamma-Hexachlorocyclohexane)	µg/L	Grab
PCB-1016	µg/L	Grab
PCB-1221	µg/L	Grab
PCB-1232	µg/L	Grab
PCB-1242	µg/L	Grab
PCB-1248	µg/L	Grab
PCB-1254	µg/L	Grab
PCB-1260	µg/L	Grab
Toxaphene	µg/L	Grab
2,3,7,8-TCDD (Dioxin)	µg/L	24-hr Composite
Ammonia (as N)	mg/L	Grab
Boron	µg/L	24-hr Composite
Chloride	mg/L	24-hr Composite
Flow	MGD	Meter
Hardness (as CaCO ₃)	mg/L	Grab
Foaming Agents (MBAS)	µg/L	24-hr Composite
Mercury, Methyl	ng/L	Grab
Nitrate (as N)	mg/L	Grab
Nitrite (as N)	mg/L	Grab
pH	Std Units	Grab
Phosphorus, Total (as P)	mg/L	24-hr Composite
Specific conductance (Electrical Conductivity)	µmhos/cm	Grab
Sulfate	mg/L	24-hr Composite
Sulfide (as S)	mg/L	24-hr Composite
Sulfite (as SO ₃)	mg/L	24-hr Composite
Temperature	°C	Grab
Total Dissolved Solids (TDS)	mg/L	Grab
Dissolved Organic Carbon (DOC)	mg/L	Grab

5. Table D-8 Testing Requirements. The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-8:
 - a. **Bis (2-ethylhexyl) phthalate.** In order to verify if bis (2-ethylhexyl) phthalate is truly present in the effluent discharge, the Discharger shall take steps to assure that sample containers, sampling apparatus, and analytical equipment are not sources of the detected contaminant.
 - b. All composite samples shall be collected from a 24-hour flow proportional composite.

- c. A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.
- d. The Discharger is not required to conduct effluent monitoring for constituents that have already been sampled in a given month, as required in Table D-3, except for hardness, pH, and temperature, which shall be conducted concurrently with the effluent sampling.
- e. **Total Mercury and methylmercury.** Samples for total mercury and methylmercury shall be taken using clean hands/dirty hands procedures, as described in U.S. EPA method 1669: Sampling Ambient Water for Trace Metals at EPA Water Quality Criteria Levels, for collection of equipment blanks (section 9.4.4.2), and shall be analyzed by U.S. EPA method 1630/1631 (Revision E) with a reporting limit of 0.05 ng/L for methylmercury and 0.5 nanograms per liter (ng/L) for total mercury.

X. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D of the Municipal General Order) related to monitoring, reporting, and recordkeeping. Upon written request of the Central Valley Water Board, the Discharger shall submit a summary monitoring report. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year(s).
2. **Compliance Time Schedules - Not Applicable**
3. The Discharger shall report to the Central Valley Water Board any toxic chemical release data it reports to the State Emergency Response Commission within 15 days of reporting the data to the Commission pursuant to section 313 of the "Emergency Planning and Community Right to Know Act" of 1986.
4. Monitoring frequencies may be adjusted by the Executive Officer to a less frequent basis if a Discharger makes a request and the request is backed by statistical trends of monitoring data submitted.

B. Self-Monitoring Reports

1. The Discharger shall electronically submit SMRs using the State Water Board's California Integrated Water Quality System (CIWQS) [Program website](http://www.waterboards.ca.gov/ciwqs/index.html) (www.waterboards.ca.gov/ciwqs/index.html). The CIWQS Web site will provide additional information for SMR submittal in the event there will be a planned service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through IX. The Discharger shall submit monthly SMRs including the results of all required monitoring using U.S. EPA-approved test methods or other test methods specified in this MRP. SMRs are to include all new monitoring results obtained since the last SMR was submitted. If the Discharger monitors any pollutant more frequently than required by this MRP, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.

3. Monitoring periods and reporting for all required monitoring shall begin on 1 August 2020 and be completed according to the following:

Table D-9. Monitoring Periods and Reporting Schedule

Sampling Frequency	Monitoring Period	SMR Due Date
Continuous	All	Submit with monthly SMR
1/Day	(Midnight through 11:59 PM) or any 24-hour period that reasonably represents a calendar day for purposes of sampling.	Submit with monthly SMR
1/Week	Sunday through Saturday	Submit with monthly SMR
2/Week	Sunday through Saturday	Submit with monthly SMR
5/Week	Sunday through Saturday	Submit with monthly SMR
1/Month	1st day of calendar month through last day of calendar month	First day of second calendar month following month of sampling
1/Quarter	1 January through 31 March; 1 April through 30 June; 1 July through 30 September; 1 October through 31 December	1 May; 1 August; 1 November; 1 February of following year (respectively)
1/Year	1 January through 31 December	1 February of following year

4. **Reporting Protocols.** The Discharger shall report with each sample result the applicable RL and the current laboratory’s MDL, as determined by the procedure in 40 C.F.R. part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory’s MDL, shall be reported as “Detected, but Not Quantified,” or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ. The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (\pm a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory’s MDL shall be reported as “Not Detected,” or ND.
- d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the

Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.

5. **Multiple Sample Data.** When determining compliance with an AMEL, AWEL, or maximum daily effluent limitation (MDEL) for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of “Detected, but Not Quantified” (DNQ) or ND. In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
 - a. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
6. The Discharger shall submit SMRs in accordance with the following requirements:
 - a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data are required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the waste discharge requirements; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation. The cover letter must be uploaded directly into CIWQS and violations must be entered into CIWQS under the Violations tab for the reporting period in which the violation occurred in addition to them being identified in the cover letter.
 - c. The Discharger shall attach final laboratory reports for all contracted, commercial laboratories, including quality assurance/quality control information, with all its SMR’s for which sample analyses were performed. Bench sheets are not required but should be available upon request by Regional Board staff.
7. The Discharger shall submit in the SMRs calculations and reports in accordance with the following requirements.
 - a. **Calendar Annual Average Limitations.** For Dischargers subject to effluent limitations specified as “calendar annual average” (e.g., electrical conductivity), the Discharger shall report the calendar annual average in the December SMR. The annual average shall be calculated as the average of the samples gathered for the calendar year.

- b. **Mass Loading Limitations** - Not Applicable.
- c. **Removal Efficiency (BOD₅ and TSS)**. The Discharger shall calculate and report the percent removal of BOD₅ and TSS in the SMRs. The percent removal shall be calculated as specified in section VIII.A of the Limitations and Discharge Requirements in the Municipal General Order.
- d. **Total Coliform Organisms Effluent Limitations**. The Discharger shall calculate and report the 7-day median of total coliform organisms for the effluent. The 7-day median of total coliform organisms shall be calculated as specified in section VIII.E of the Limitations and Discharge Requirements in the Municipal General Order.
- e. **Total Calendar Annual Mass Loading Mercury Effluent Limitations** - Not Applicable.
- f. **Temperature Effluent Limitation** - Not Applicable.
- g. **Chlorpyrifos and Diazinon Effluent Limitations** - Not Applicable
- h. **Dissolved Oxygen Receiving Water Limitations**. The Discharger shall report monthly in the SMR the dissolved oxygen concentrations in the receiving water (Monitoring Locations RSW-001 and RSW 002).
- i. **Turbidity Receiving Water Limitations**. The Discharger shall calculate and report the turbidity increase in the receiving water applicable to the natural turbidity condition specified in section VI.A.18.a, of the Limitations and Discharge Requirements in the Municipal General Order.
- j. **Temperature Receiving Water Limitations**. The Discharger shall calculate and report the annual average ambient temperature increase in the receiving water based on the difference in temperature at Monitoring Locations RSW-001 and RSW-002 as well as report the instantaneous maximum and weekly average temperature at RSW-002 as specified in section VI.A.16.f, of the Limitations and Discharge Requirements in the Municipal General Order.

C. Discharge Monitoring Reports (DMRs)

1. The Discharger shall electronically submit DMRs together with SMRs using Electronic Self-Monitoring Reports module eSMR 2.5 or any upgraded version. Electronic submittal of DMRs will be in addition to electronic submittal of SMRs. Information about electronic submittal of DMRs is provided by the [Discharge Monitoring Report website](http://www.waterboards.ca.gov/water_issues/programs/discharge_monitoring/):
(http://www.waterboards.ca.gov/water_issues/programs/discharge_monitoring/).

D. Other Reports

1. **Special Study Reports**. Special study reports required by section VIII.C, Provisions, in this NOA shall be submitted in accordance with the reporting requirements in Table D-10, Technical Reports.
2. **Analytical Methods Report**. The Discharger shall complete and submit an Analytical Methods Report, electronically via CIWQS submittal, by the due date specified in Table D-10 below. The Analytical Methods Report shall include the following for each constituent listed in tables D-2, D-3, D-5, and D-8 of this NOA: 1) applicable water quality objective, 2) reporting level (RL), 3) method detection limit

(MDL), and 4) analytical method. The analytical methods shall be sufficiently sensitive with RLs consistent with the SSM Rule (see also General Monitoring Provision F in the Municipal General Order), and with the Minimum Levels (MLs) in the SIP, Appendix 4. The “Reporting Level or RL” is synonymous with the “Method Minimum Level” described in the SSM Rule. If an RL is greater than the applicable water quality objective for a constituent, the Discharger shall explain how the proposed analytical method complies with the SSM Rule. Central Valley Water Board staff will provide a tool with the Notice of Applicability to assist the Discharger in completing this requirement. The tool will include the constituents and associated applicable water quality objectives to be included in the Analytical Methods Report.

3. **Annual Operations Report.** The Discharger shall submit in accordance with the reporting requirements in Table D-10, Technical Reports, a written report containing the following:
 - a. The names, certificate grades, and general responsibilities of all persons employed at the Facility.
 - b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
 - c. A statement certifying when the flow meter(s) and other monitoring instruments and devices were last calibrated, including identification of who performed the calibration.
 - d. A statement certifying whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last revised and last reviewed for adequacy.
 - e. The Discharger may also be requested to submit an annual report to the Central Valley Water Board with both tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the compliance record. If violations have occurred, the report shall also discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.
4. **Annual Pretreatment Reporting Requirements** – Not Applicable
5. **Recycled Water Policy Annual Reports.** In accordance with Section 3 of the Water Quality Control Policy for Recycled Water (Recycled Water Policy) and as specified in this NOA, the Discharger shall electronically submit an annual report of monthly data to the State Water Board by 30 April annually covering the previous calendar year using the State Water Board’s [GeoTracker website](https://geotracker.waterboards.ca.gov/) (<https://geotracker.waterboards.ca.gov/>). Information for setting up and using the GeoTracker system can be found in the ESI Guide for Responsible Parties document on the State Water Board’s website for [Electronic Submittal of Information](https://www.waterboards.ca.gov/ust/electronic_submittal/index.html) (https://www.waterboards.ca.gov/ust/electronic_submittal/index.html).

The annual report to GeoTracker must include volumetric reporting of the items listed in Section 3.2 of the [Recycled Water Policy](https://www.waterboards.ca.gov/board_decisions/adopted_orders/resolutions/2018/121118_7_final_amendment_oal.pdf) (https://www.waterboards.ca.gov/board_decisions/adopted_orders/resolutions/2018/121118_7_final_amendment_oal.pdf). A PDF of the upload confirmation from

GeoTracker for the Recycled Water Policy Annual Report shall be uploaded into CIWQS to demonstrate compliance with this reporting requirement.

6. **Technical Report Submittals.** The Municipal General Order, as specified in this NOA, includes requirements to submit various reports and documents that may include, a Notice of Intent, special study technical reports, progress reports, and other reports identified in the MRP (hereafter referred to collectively as “technical reports”). The Technical Reports Table D-10 below summarizes the technical reports that are applicable to this discharge and required by this NOA, and the due dates for each submittal. All technical reports shall be submitted electronically via CIWQS submittal. Technical reports should be uploaded as a PDF, Microsoft Word, or Microsoft Excel file attachment.

Table D-10. Technical Reports

Report #	Technical Report	Due Date	CIWQS Report Name
1	Notice of Intent	1 August 2024	NOI
2	Analytical Methods Report	1 September 2020	MRP IX.D.2
3	Analytical Methods Report Certification	1 June 2021	MRP IX.F.4
4	Annual Operations Report #1	1 February 2021	MRP X.D.3
5	Annual Operations Report #2	1 February 2022	MRP X.D.3
6	Annual Operations Report #3	1 February 2023	MRP X.D.3
7	Annual Operations Report #4	1 February 2024	MRP X.D.3
8	Annual Operations Report #5	1 February 2025	MRP X.D.3
9	Recycled Water Policy Annual Reports #1	30 April 2021	MRP X.D.4
10	Recycled Water Policy Annual Reports #2	30 April 2022	MRP X.D.4
11	Recycled Water Policy Annual Reports #3	30 April 2023	MRP X.D.4
12	Recycled Water Policy Annual Reports #4	30 April 2024	MRP X.D.4
13	Recycled Water Policy Annual Reports #5	30 April 2025	MRP X.D.4

APPENDIX E – DETERMINATION OF WATER QUALITY-BASED EFFLUENT LIMITATIONS (WQBELS)

The Central Valley Water Board determined water quality-based effluent limitations (WQBELS) as described in the Municipal General Order, section V.C.4 of the Fact Sheet (Attachment F), using the effluent limits tables included in the Municipal General Order, section V.A.1 of the Limitations and Discharge Requirements. For parameters with both human health and aquatic life objectives/criteria, the final effluent limitations in this NOA are based on the lower of the effluent limitations based on the aquatic life objectives/criteria and human health objectives/criteria.

Abbreviations and Notes for Table E-1:

1. CV = Coefficient of Variation (established in accordance with section 1.4 of the SIP)
2. MDEL = Maximum Daily Effluent Limitation
3. AMEL = Average Monthly Effluent Limitation
4. MDEL = Maximum Daily Effluent Limitation
5. AWEL = Average Weekly Effluent Limitation
6. CMC = Criterion Maximum Concentration
7. CCC = Criterion Continuous Concentration
8. Coefficient of Variation (CV) calculated using effluent sample data for the parameter listed.
9. Effluent Limit Table as indicated and contained in section V, Effluent Limitations and Discharge Specifications, of the Municipal General Order. Specific table listed is used to determine the appropriate AMEL, AWEL, or MDEL.

Table E-1. Human Health WQBELS Calculations

Parameter	Units	Criteria	CV	Effluent Limit Table in Municipal General Order	AMEL	AWEL
Nitrate Plus Nitrite (as N)	mg/L	10	0.3	Table 19B	10	14

Table E-2. Aquatic Life WQBELS Calculations

Parameter	Units	CMC	CCC	CV	Effluent Limit Table in Municipal General Order	AMEL	AWEL
Ammonia, Total (as N)	mg/L	6.77	2.0	0.6	Table 17E	1.9	4.2