

Hookston Station and Adjacent Areas



Project Status
July 26, 2006

Mary Rose Cassa
Engineering Geologist
San Francisco Bay
Regional Water Quality Control Board

1




Vincent Road – 4/19/06 Workplan

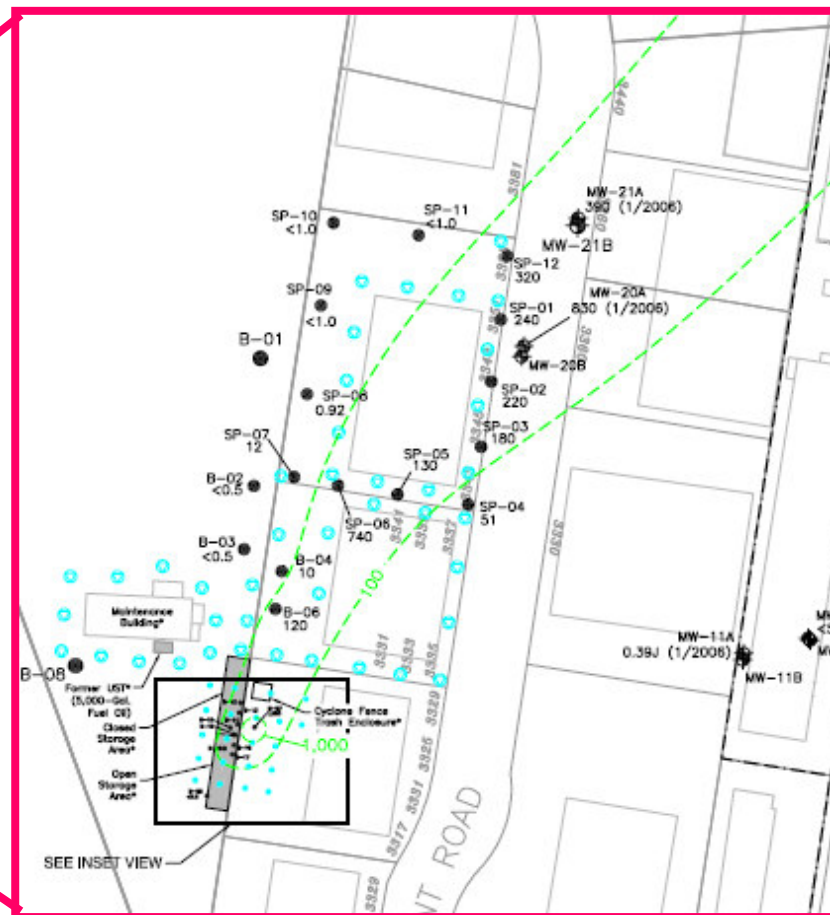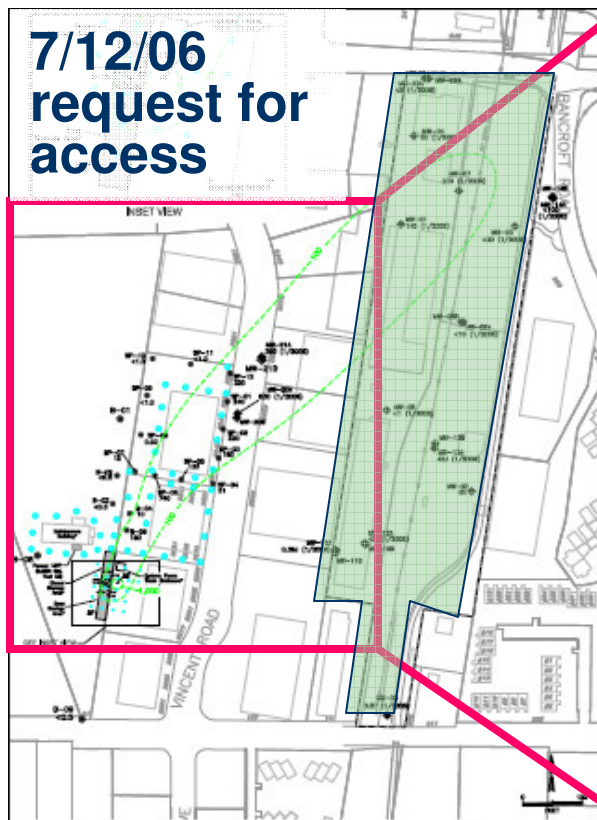


Additional Soil Vapor Sampling June 1, 2006

- Three additional active soil vapor samples
- All results non-detect

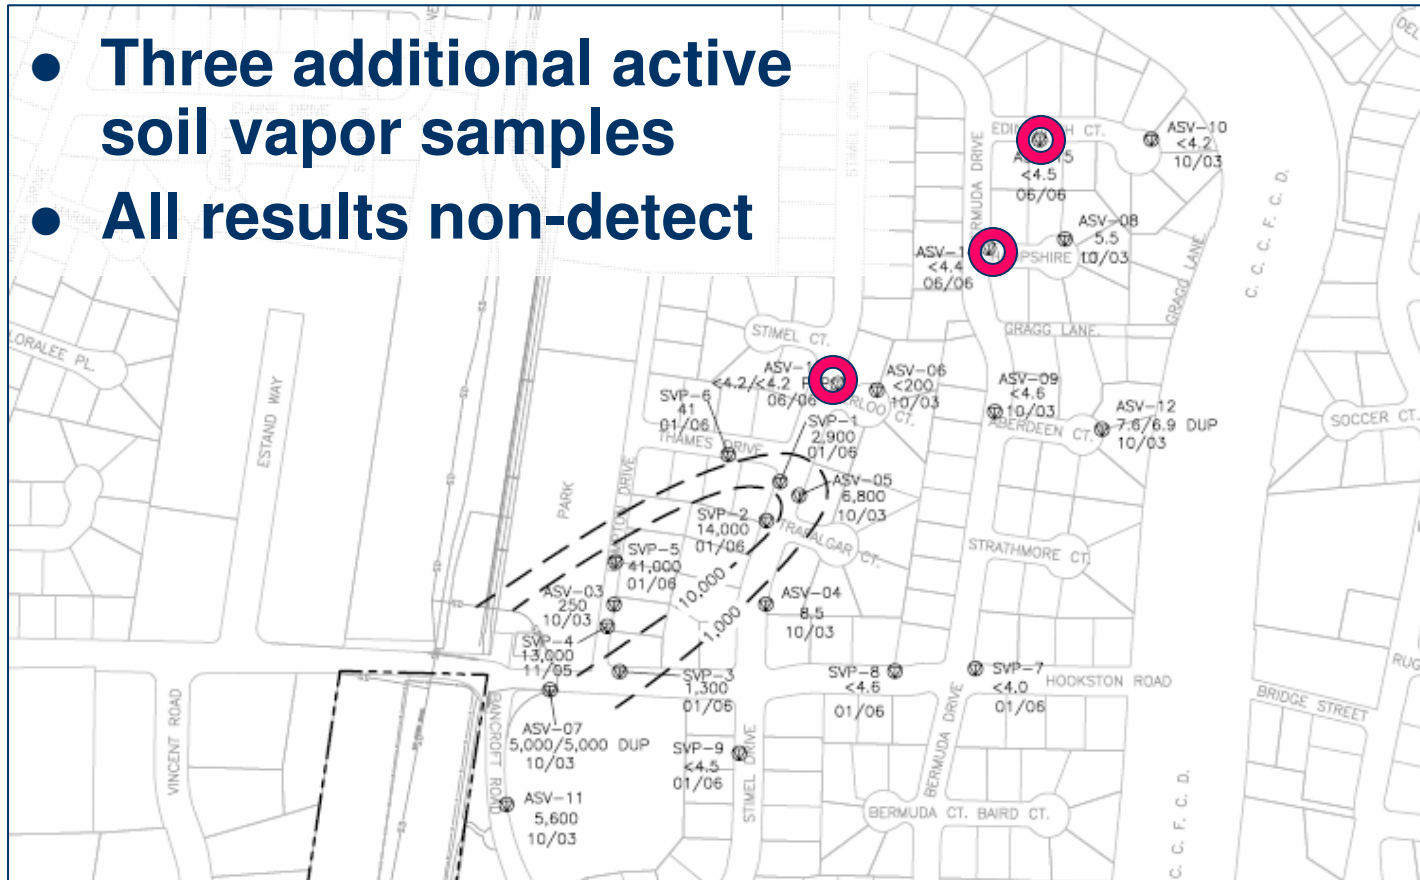

Requirement for Ongoing Indoor Air Monitoring

- Water Code §13267 Directive
- Request for access – September 2006

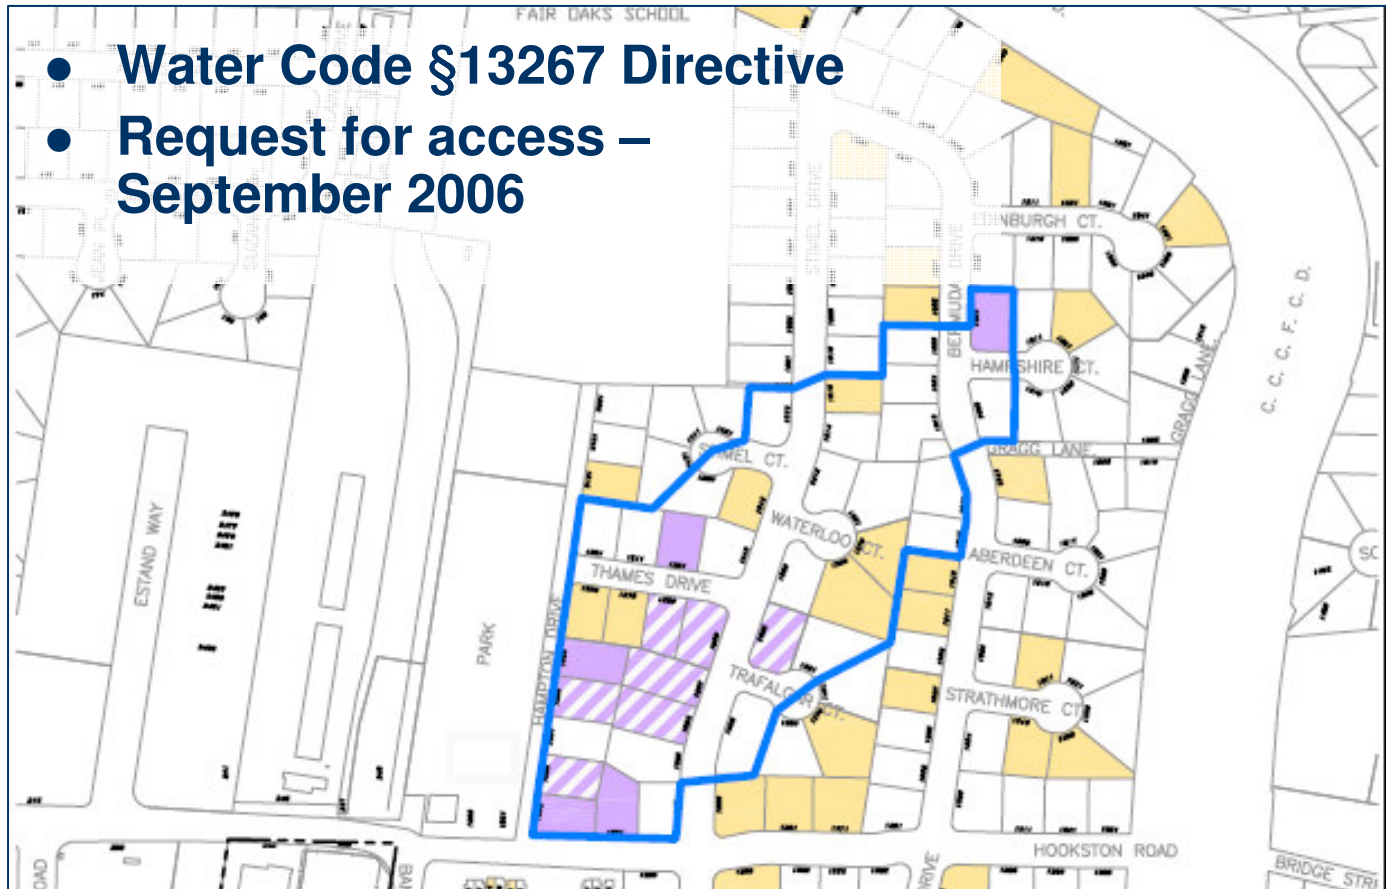

Additional Arsenic Sampling

- Samples at 6 inches and 2 feet bgs
- B-69, B-84, S-09
- Confirmed high concentrations at B-69 at 2 feet below ground surface

