


# NORTH DELTA WATER AGENCY SACRAMENTO RIVER AT THREE-MILE SLOUGH 14-DAY MEAN ELECTRICAL CONDUCTIVITY

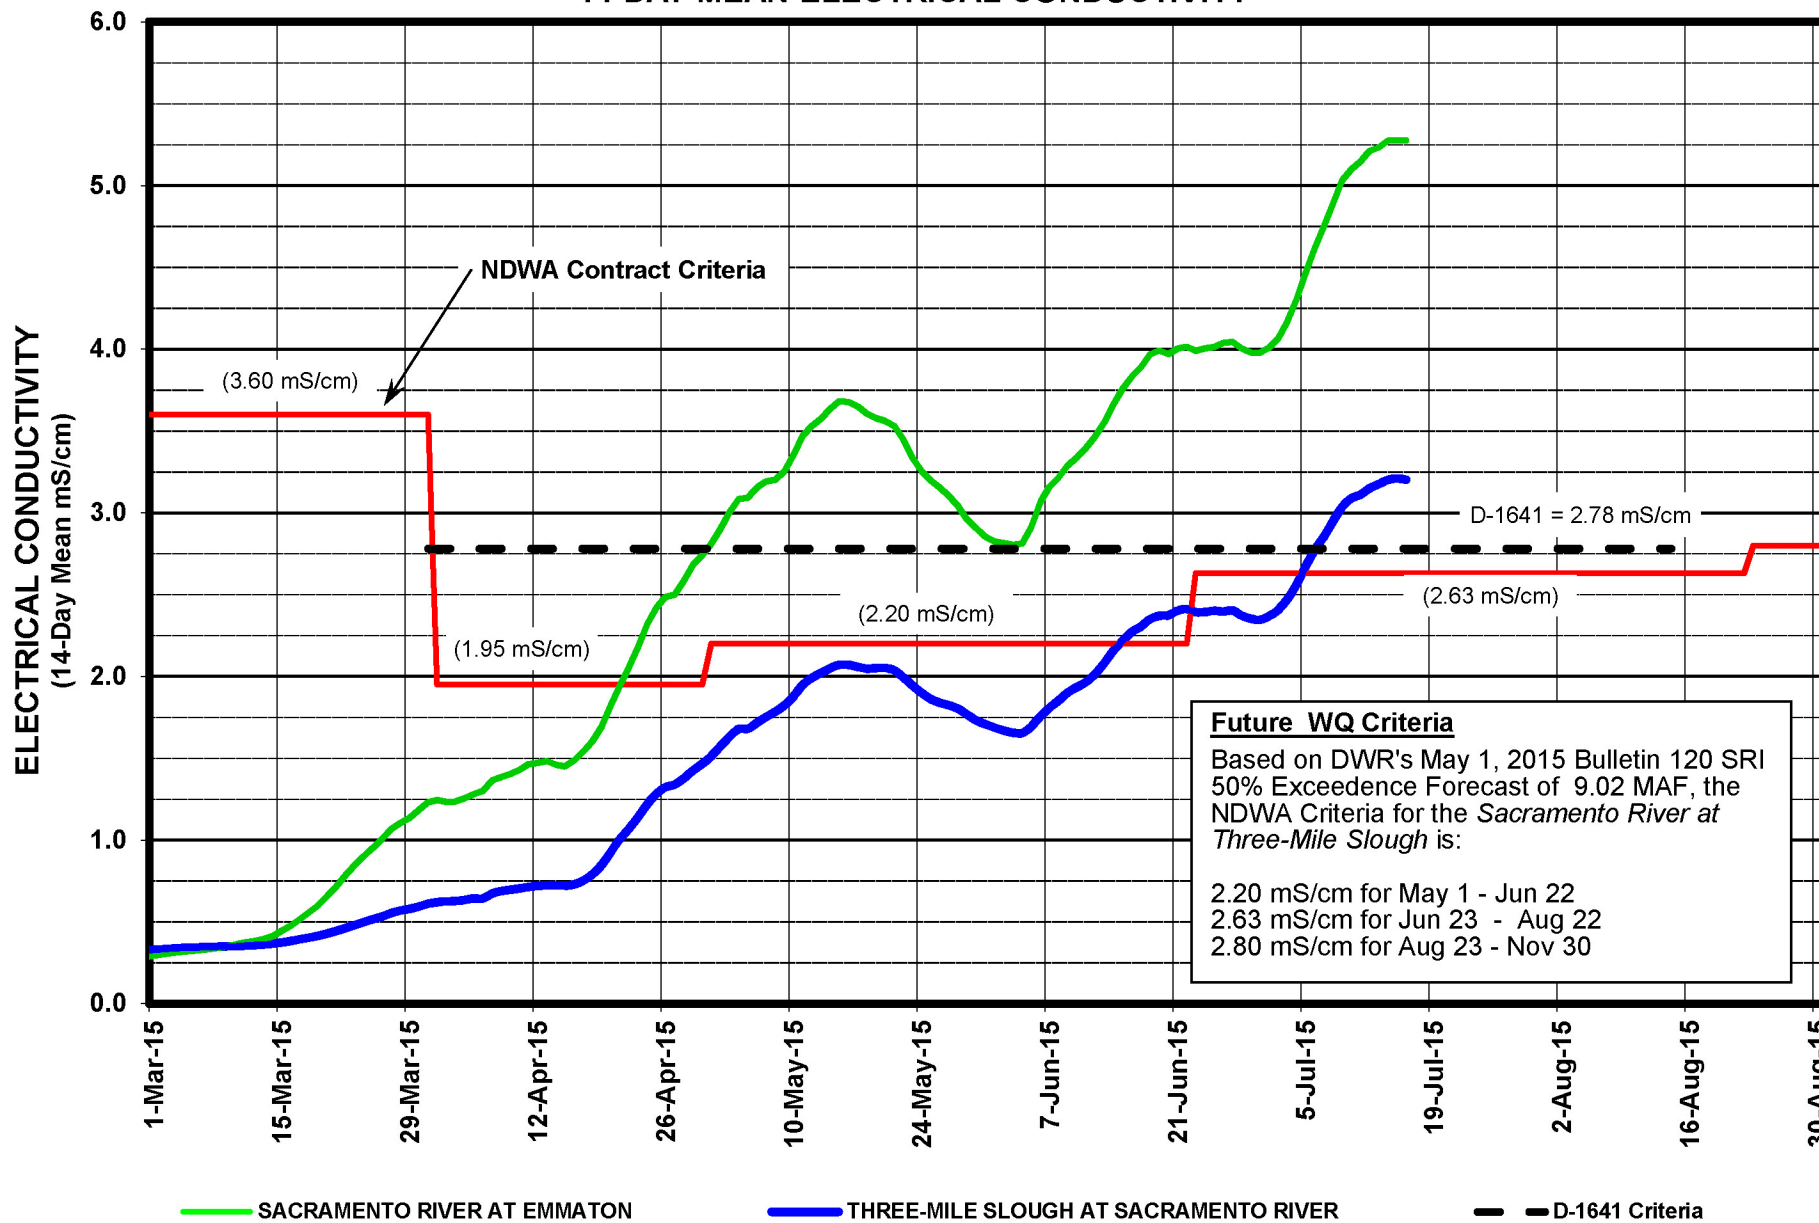

**Future WQ Criteria**  
Based on DWR's May 1, 2015 Bulletin 120 SRI 50% Exceedence Forecast of 9.02 MAF, the NDWA Criteria for the Sacramento River at Three-Mile Slough is:

- 2.20 mS/cm for May 1 - Jun 22
- 2.63 mS/cm for Jun 23 - Aug 22
- 2.80 mS/cm for Aug 23 - Nov 30