

Brentwood 121, p. 12, Figure 3

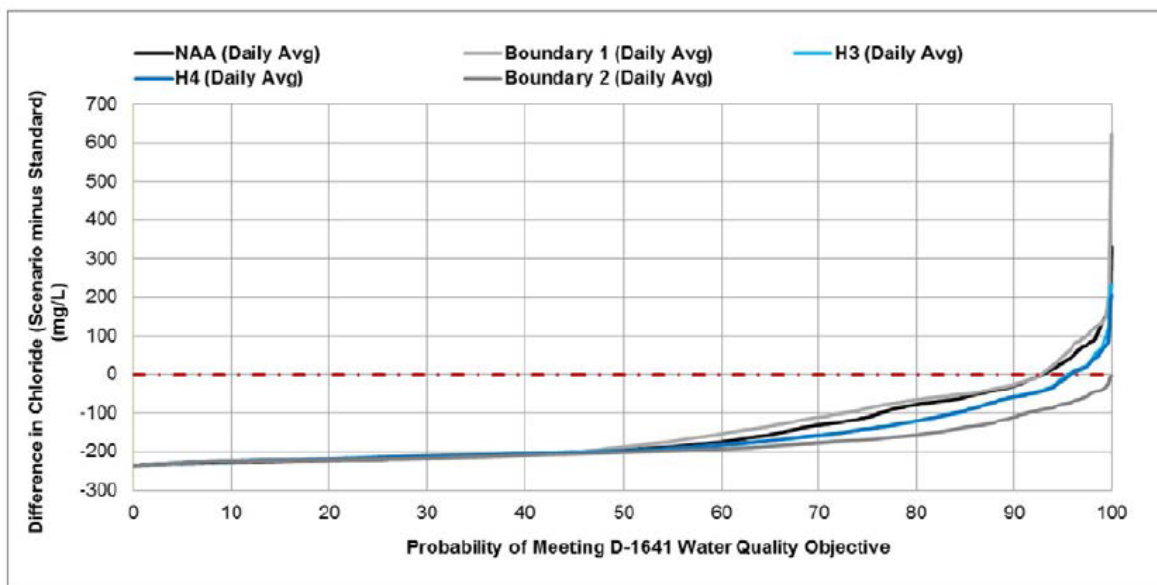


Figure 3 DWR-513 Figure C5, showing the probability of meeting the D-1641 250 mg/L chloride objective at Contra Costa Canal at Pumping Plant No. 1 (CCPP#1).

Brentwood 121, p. 14, Figure 5

Chloride Exceedance Probability at CCPP#1 (Node 206) – All Years

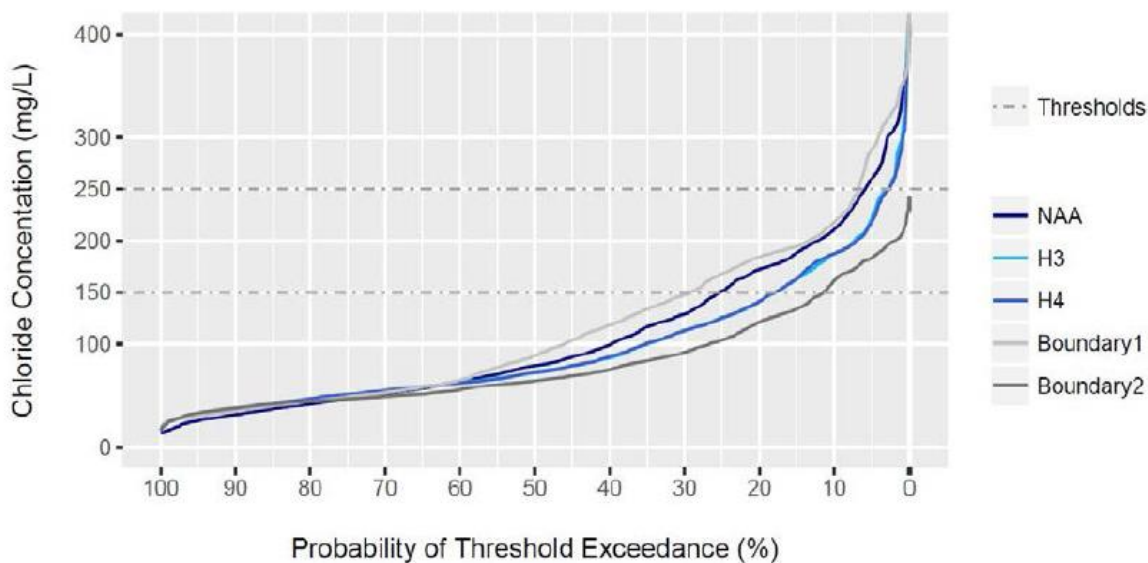


Figure 5 Probability exceedance diagram for chloride at CCPP#1 for all years (1976-1991).