

SHASTA

| Account | Release | | | Storage | | |
|------------------|--------------|--------------|----------|------------------|-------------|----------|
| | Base | Game | Chg | Base | Game | Chg |
| SWP | 0 | 0 | 0 | 0 | 0 | 0 |
| CVP | 10900 | 10900 | 0 | 3962 | 3962 | 0 |
| Acct #3 | 0 | 0 | 0 | 0 | 0 | 0 |
| B2 Stor | 0 | 0 | 0 | 0 | 0 | 0 |
| EWA | 0 | 0 | 0 | 0 | 0 | 0 |
| Total | 10900 | 10900 | 0 | 3962 | 3962 | 0 |
| Keswick Flow Req | | | | Max Storage 4419 | | |
| Actual 13341 | | | | 13341 | | |
| NCP Flow Req | | | | 0 | | |
| Actual 11096 | | | | 11096 | | |

CVP NOD

| Type | Delivery | | | Allocation | | |
|--------------|----------|----------|----------|------------|------|-----|
| | Base | Game | Chg | Base | Game | Chg |
| SC | 0 | 0 | 0 | 0% | 0% | 0 |
| AG | 0 | 0 | 0 | 0% | 0% | 0 |
| MI | 0 | 0 | 0 | 0% | 0% | 0 |
| RF | 0 | 0 | 0 | 0% | 0% | 0 |
| Total | 0 | 0 | 0 | | | |

OROVILLE

| Account | Release | | | Storage | | |
|------------------------|--------------|--------------|----------|------------------|-------------|----------|
| | Base | Game | Chg | Base | Game | Chg |
| SWP | 12744 | 12744 | 0 | 3073 | 3073 | 0 |
| CVP | 0 | 0 | 0 | 0 | 0 | 0 |
| Acct #3 | 0 | 0 | 0 | 0 | 0 | 0 |
| Acct #4 | 0 | 0 | 0 | 0 | 0 | 0 |
| EWA | 0 | 0 | 0 | 0 | 0 | 0 |
| Total | 12744 | 12744 | 0 | 3073 | 3073 | 0 |
| Thermalito Flow Req | | | | Max Storage 3200 | | |
| Actual 12500 | | | | 12500 | | |
| Feather @ Mth Flow Req | | | | 0 | | |
| Actual 12981 | | | | 12981 | | |

B2 Accounting (taf)

| | Base | Game | Chg |
|--------------|-------------|-------------|-------------|
| Keswick | 16.7 | 16.7 | 0.0 |
| Clear Cr | 0.3 | 0.3 | 0.0 |
| Nimbus | 11.9 | 4.1 | -7.8 |
| N. Mel | 0.0 | 0.0 | 0.0 |
| Delta | 6.2 | 6.2 | 0.0 |
| Total | 35.1 | 27.3 | -7.8 |
| Cum Tot | 302.8 | 285.2 | -17.5 |

FOLSOM

| Account | Release | | | Storage | | |
|-----------------|-------------|-------------|--------------|-----------------|------------|-----------|
| | Base | Game | Chg | Base | Game | Chg |
| SWP | 0 | 0 | 0 | 0 | 0 | 0 |
| CVP | 7919 | 3991 | -3928 | 689 | 707 | 18 |
| Acct #3 | 0 | 0 | 0 | 0 | 0 | 0 |
| B2 Stor | 0 | 0 | 0 | 0 | 0 | 0 |
| EWA | 0 | 0 | 0 | 0 | 0 | 0 |
| Total | 7919 | 3991 | -3928 | 689 | 707 | 18 |
| Nimbus Flow Req | | | | Max Storage 721 | | |
| Actual 7928 | | | | 4000 | | |
| H St Flow Req | | | | 0 | | |
| Actual 7928 | | | | 4000 | | |

Delta Operations

| | Base | Game | Chg |
|-----------------|-------|-------|-------|
| Delta Inflow | 39104 | 35137 | -3967 |
| Delta Outflow | 33725 | 29758 | -3967 |
| NDOI Req | 7100 | 7100 | 0 |
| Rio Vista | 29766 | 26326 | -3439 |
| Rio Vista Req | 0 | 0 | 0 |
| E/I Ratio | 20% | 20% | 0 |
| E/I Ratio Max | 35% | 35% | 0 |
| X2 (km) | 64.4 | 64.5 | 0.1 |
| CW Cost | | | |
| Feb-Jun X2 (km) | 67.72 | 67.72 | 0.00 |

Delta Salinity (EC umhos/cm)

| Station | Max | Base | Game | Chg |
|-------------|-----|------|------|-----|
| Chippis | | 278 | 328 | 51 |
| Antioch | | 220 | 220 | 0 |
| Jersey Pt | | 200 | 200 | 0 |
| Emmaton | | 150 | 150 | 0 |
| Rock Slough | | 170 | 170 | 0 |
| Vernalis | | 0 | 0 | 0 |
| Clifton Ct | | 262 | 262 | 0 |
| Tracy PP | | 339 | 339 | 0 |

COA Balance

| | Base | | Game | |
|----------------|-------|-------|-------|-------|
| | SWP | CVP | SWP | CVP |
| Stor Wtd | 0 | 0 | 0 | 0 |
| UWFE | 13565 | 16580 | 11780 | 14398 |
| IBU | 0 | 0 | 0 | 0 |
| COA Share | 13565 | 16580 | 11780 | 14398 |
| Unused Share | 11576 | 15361 | 9791 | 13179 |
| Export Max COA | 28926 | 28156 | 24959 | 24189 |
| Export Actual | 1989 | 1219 | 1989 | 1219 |

EXPORT OPERATIONS

| Account | Banks PP | | | Tracy PP | | | Total | | |
|--------------|-------------|-------------|----------|-------------|-------------|----------|-------------|-------------|----------|
| | Base | Game | Chg | Base | Game | Chg | Base | Game | Chg |
| SWP | 1989 | 1989 | 0 | 0 | 0 | 0 | 1989 | 1989 | 0 |
| CVP | 0 | 0 | 0 | 1219 | 1219 | 0 | 1219 | 1219 | 0 |
| Acct #3 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| B2 Stor | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| EWA | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Total | 1989 | 1989 | 0 | 1219 | 1219 | 0 | 3208 | 3208 | 0 |
| Max Cap | | 6680 | 6680 | 4600 | 4600 | 0 | 11280 | 11280 | 0 |
| Physical | | 8500 | 8500 | 4600 | 4600 | 0 | 13100 | 13100 | 0 |
| Permit | | 6680 | 6680 | 4600 | 4600 | 0 | 11280 | 11280 | 0 |
| SJR Pulse | 99999 | 99999 | 0 | 99999 | 99999 | 0 | 199998 | 199998 | 0 |
| B2 | 0 | 0 | 0 | 99999 | 99999 | 0 | 99999 | 99999 | 0 |
| EWA | 99999 | 99999 | 0 | 99999 | 99999 | 0 | 199998 | 199998 | 0 |
| Salinity | | 0 | 99999 | 99999 | 0 | 99999 | 0 | 99999 | -1388 |
| EI | | 13686 | 12298 | -1388 | | | | | |

CVP SOD

| Type | Delivery | | | Allocation | | |
|--------------|----------|----------|----------|------------|------|-----|
| | Base | Game | Chg | Base | Game | Chg |
| EX | 0 | 0 | 0 | 0% | 0% | 0 |
| AG | 0 | 0 | 0 | 0% | 0% | 0 |
| MI | 0 | 0 | 0 | 0% | 0% | 0 |
| RF | 0 | 0 | 0 | 0% | 0% | 0 |
| Total | 0 | 0 | 0 | | | |

SWP SOD



| Type | Delivery | | | Allocation | | |
|--------------|----------|----------|----------|------------|------|-----|
| | Base | Game | Chg | Base | Game | Chg |
| MWD | 0 | 0 | 0 | 0% | 0% | 0 |
| MI | 0 | 0 | 0 | 0% | 0% | 0 |
| AG | 0 | 0 | 0 | 0% | 0% | 0 |
| ART 21 | 0 | 0 | 0 | 0% | 0% | 0 |
| Total | 0 | 0 | 0 | | | |

MWD GROUNDWATER PROGRAMS

| Bank | Put(+)/Take(-) | | Put Cap | Take Cap | Storage | | Max Stor |
|--------------|----------------|----------|-------------|-------------|----------|----------|-------------|
| | Base | Game | | | Base | Game | |
| Semitropic | 0 | 0 | 880 | 300 | 0 | 0 | 350 |
| Kern | 0 | 0 | 1200 | 1200 | 0 | 0 | 0 |
| Kern-Delta | 0 | 0 | 0 | 0 | 0 | 0 | 250 |
| Arvin-Edison | 0 | 0 | 150 | 150 | 0 | 0 | 350 |
| Mojave | 0 | 0 | 0 | 0 | 0 | 0 | 75 |
| Total | 0 | 0 | 2230 | 1650 | 0 | 0 | 1025 |

OPERATION STATUS

| Operation | Status |
|--------------|--------|
| Shasta | 0 |
| Oroville | 0 |
| Folsom | 0 |
| Delta | 0 |
| Exports | 0 |
| COA | 0 |
| San Luis | 0 |
| Aqueduct | 0 |
| GW Banks | 0 |
| Terminal Res | 0 |

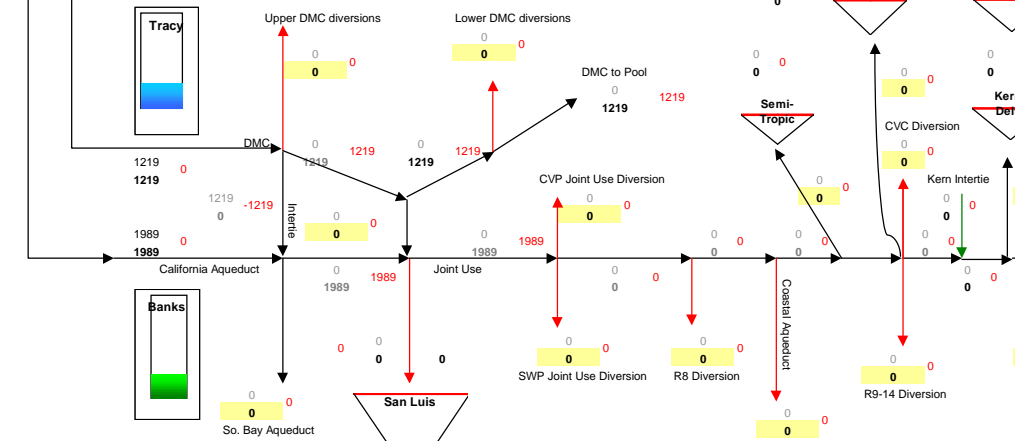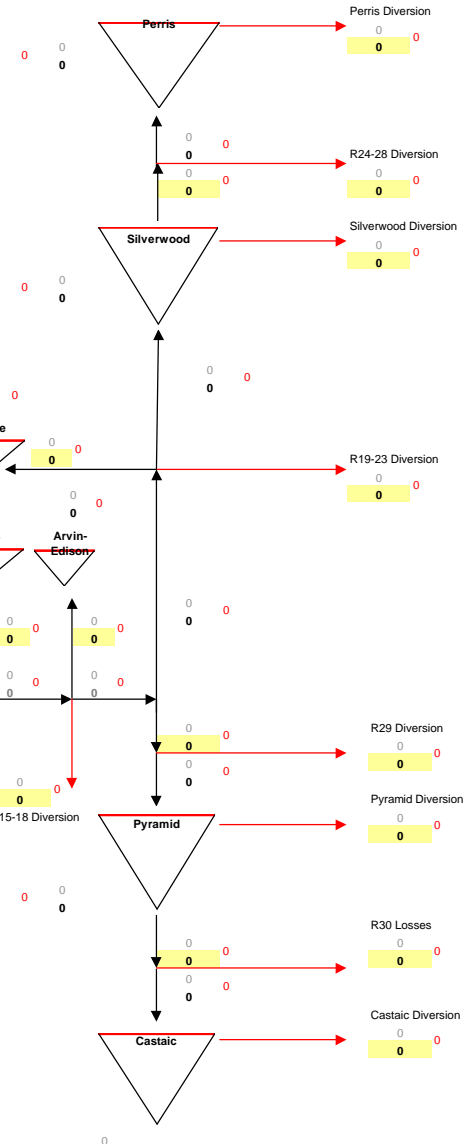

SAN LUIS

| Account | O'Neil to SL | | | Storage | | |
|-------------------|--------------|----------|----------|-------------|------------|------------|
| | Base | Game | Chg | Base | Game | Chg |
| SWP | 0 | 0 | 0 | 0 | 225 | 225 |
| CVP | 0 | 0 | 0 | 0 | 300 | 300 |
| Acct #3 | 0 | 0 | 0 | 0 | 0 | 0 |
| B2 Stor | 0 | 0 | 0 | 0 | 0 | 0 |
| EWA | 0 | 0 | 0 | 0 | 0 | 0 |
| Total | 0 | 0 | 0 | 0 | 525 | 525 |
| Max Pump Capacity | | 11000 | | Max Storage | | 2039 |

AQUEDUCT FLOWS AND CAPACITIES

| | Flow | Capacity |
|---------------------|------|----------|
| Dos Amigos PP | 1989 | 15450 |
| Reach 9-13 | 0 | 7300 |
| Buena Vista PP | 0 | 5350 |
| Edmonston PP | 0 | 4400 |
| E. Branch Bifurcat. | 0 | 3150 |
| W. Branch Bifurcat. | 0 | 3130 |